


 PT. MNA SERANG	WORKING INSTRUCTION VACUUM CIRCUIT BREAKER INSPECTION & FUNCTIONAL CHECKS PREVENTIVE MAINTENANCE	WI/MNASRG-E&I-19-004	
		Dept.	ENGINEERING
		Section	E&I
		Revision	0
		Effective Date	
		Page	1 of 2

Instruksi / Instruction Pre-Action / Pre-Action
--



Siapkan dokumen checklist dan alat pembersih; sikat dan kain lap . (<i>Prepare checklist documents also cleaning tools; brush and wiper</i>)	Koordinasi dengan user plant (<i>Coordinate with the plant user</i>)
--	--

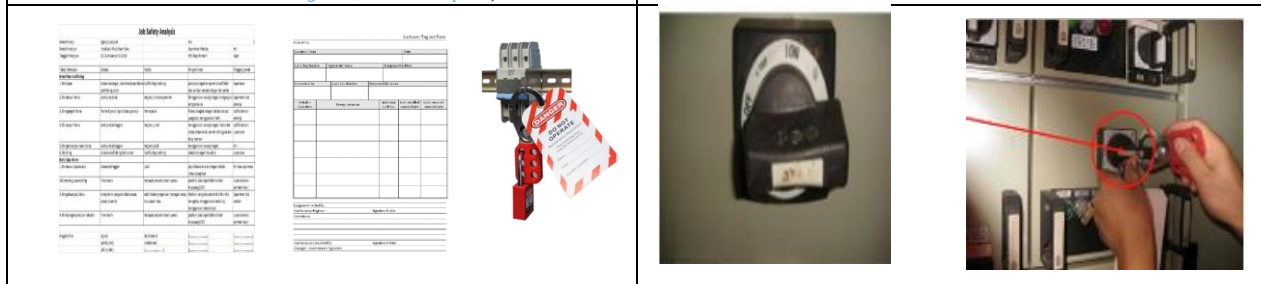

Siapkan JSA, Work Permit LOTO dan form LOTO (<i>Prepare JSA, LOTO Work Permit and LOTO form</i>)	Matikan sumber energi terkait dan lakukan pemasangan LOTO pada breaker dan key switch (<i>Turn off the power source and install LOTO on breaker and key switch</i>)
--	---

Visual Cek & Inspeksi Tanpa Tegangan / Visual Check & Inspection without Voltage



Periksa secara visual apakah ada kotoran, karat, electrical discharge phenomena pada kontak sinyal breaker. (<i>Do visual checks is there any dirt, corrosion, electrical discharge phenomena on breaker signal contact</i>)	Lakukan pemeriksaan dan bersihkan sistem kontak (<i>Checks and clean alternately on contacts system</i>)
--	--



Lakukan pembersihan pada area kontak yang terdapat indikasi panas berlebih (<i>Cleans contacts area that indicated overheating</i>)	Lakukan overhaul jika terjadi abnormal fungsi pada sistem kontak interruptor (<i>Do overhaul if there's abnormal function on interruptor contacts system</i>)
---	---