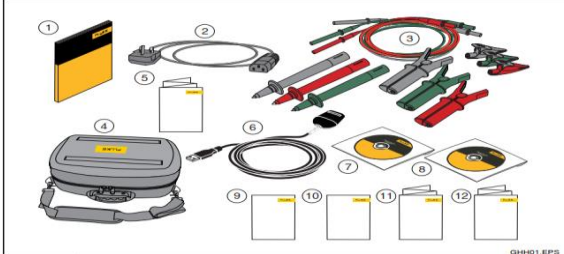
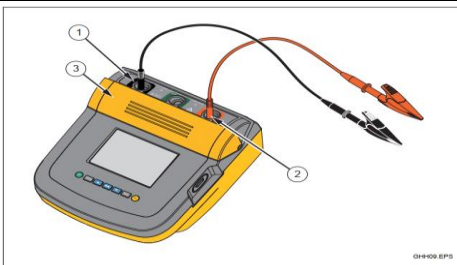
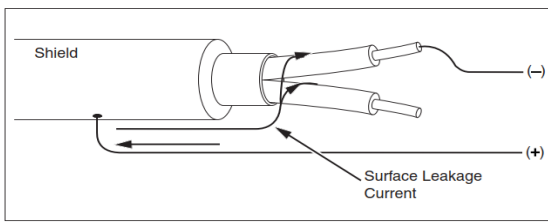


 PT. MNA SERANG	WORKING INSTRUCTION	WI/MNASRG-E&I-19-021	
		Dept.	ENGINEERING
	CABLE INSULATION TEST PREVENTVE MAINTENANCE	Section	E&I
		Revision	0
		Effective Date	
		Page	1 of 2

Instruksi / <i>Instruction</i> Pre-Action / <i>Pre-Action</i>
--

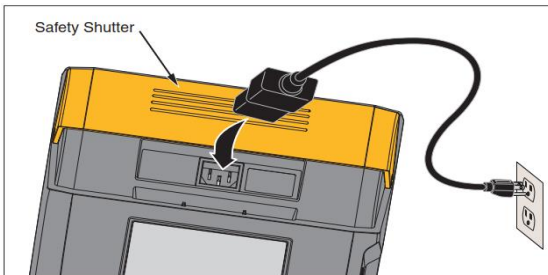
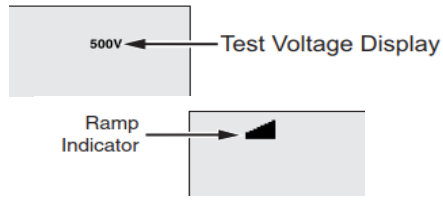
	
---	--

Siapkan Fluke 1555 (<i>Prepare Fluke 1555</i>)	Koordinasi dengan user plant (<i>Coordinate with the plant user</i>)
--	--

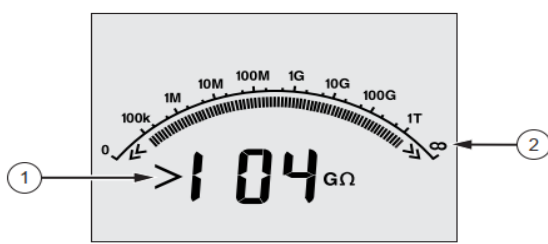
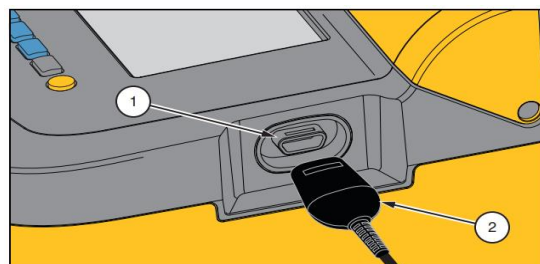
	
---	--

Pasang konektor pada Fluke (<i>Put the connector on the Fluke</i>)	Pasang konektor fluke pada kabel yang akan di tes (<i>Place the fluke connector on the cable to be tested</i>)
--	--

Pengujian / <i>Testing</i>

	
---	--

Pasang Fluke ke sumber tegangan (<i>Attach the Fluke to the voltage source</i>)	Pilih tegangan uji, tes ramp, dan lama tes (<i>Select the test voltage, the test ramp, and the test length</i>)
---	---

	
---	--

Lihat hasil pembacaan pada layar LCD (<i>See the reading results on the LCD screen</i>)	Download hasil pengujian. (<i>Download the test results.</i>)
---	---