

Insulation Testing Work Instruction

First step:

Inform the workshop operation content, inform the operation purpose, and sign the work ticket.




Second step: Prepare the insulation tester and confirm the energy level of the insulation voltage testing.




Third step: Choose the appropriate PPE (protective clothing, protective mask, arc flash-proof gloves, earplugs). PPE is required to be tested and within the validity period.



Fourth step: Please refer to the "Emergency Rescue-Electric Shock Accident" document. The guardian should have sufficient training (for example: how to rescue cardiopulmonary resuscitation, the use of automatic defibrillators).

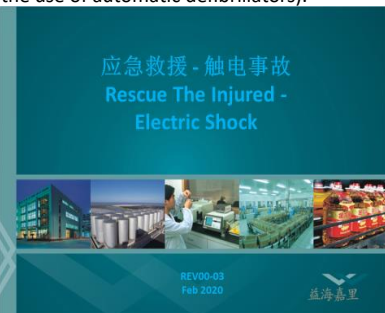

Fifth step: Cut a piece of insulation end cable to expose the conductor.

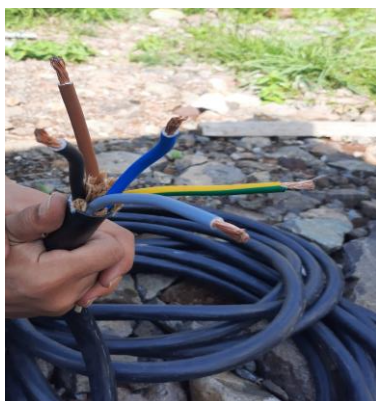


Sixth step: Set the range of insulation test voltage to 500 V



Seventh step:

Attention should be paid to "restrict access to the boundary".

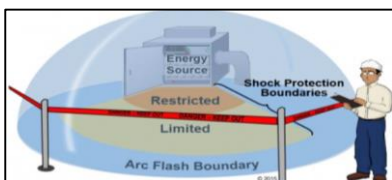

Nominal System Voltage Range, Phase to Phase ^a	Limited Approach Boundary ^b		Restricted Approach Boundary ^c ; Include Insulator Movement Adder
	Exposed Movable Conductor ^d	Exposed Fixed Circuit Part	
<50 V	Not specified	Not specified	Not specified
50 V–15 V ^d	3.0 m (10 ft 0 in.)	1.0 m (3 ft 6 in.)	Avoid contact
151 V–750 V	3.0 m (10 ft 0 in.)	1.0 m (3 ft 6 in.)	0.3 m (1 ft 0 in.)
751 V–15 kV	3.0 m (10 ft 0 in.)	1.5 m (5 ft 0 in.)	0.7 m (2 ft 2 in.)
15.1 kV–36 kV	3.0 m (10 ft 0 in.)	1.8 m (6 ft 0 in.)	0.8 m (2 ft 7 in.)
36.1 kV–46 kV	3.0 m (10 ft 0 in.)	2.5 m (8 ft 0 in.)	0.8 m (2 ft 9 in.)
46.1 kV–72.5 kV	3.0 m (10 ft 0 in.)	2.5 m (8 ft 0 in.)	1.0 m (3 ft 3 in.)

Eighth step: Place the positive clamp to shield insulation cable and the negative clamp to exposed conductor.



Nineth step: Push the test button on positive clamp or insulation test button on tester.



Tenth step: Look at the test result. Ensure each conductor insulation test conforms to the standard test value.



Eleventh step: The test results are recorded and archived, and maintenance plans are developed and executed. Perform summary analysis on a regular basis

[illegible]