

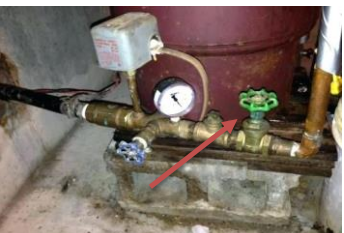
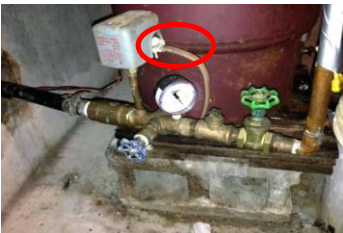


 PT. MNA SERANG	WORKING INSTRUCTION Pressure Switch Reactive Maintenance	WI/MNASRG-E&I-19-106	
		Dept.	ENGINEERING
		Section	E&I
		Revision	0
		Effective Date	
		Page	1 of 1 page

Instruksi / <i>Instruction</i>	
Persiapan Alignment / <i>Prepare of Alignment Process</i>	
	
Siapkan peralatan dan APD (<i>Prepare equipment and APD</i>)	Identifikasi : Tidak ada fluida terdeteksi atau kontak switch terbakar <i>No water in pressure system Switch contacts severely burned</i>
Pengecekan Elemen Sensor / <i>Sensor Element Checking</i>	

	
1. Cek level fluida <i>Check the pumping water level.</i>	2. Lepaskan pressure switch dari pipa/tanki <i>Remove the pressure switch from the pipe and</i>
	
3. Lakukan pengecekan pada valve di sistem sebelum dan sesudah pressure switch. <i>Confirm that any check valves in the system between the source and the pressure tank are functioning</i>	4. Konfirmasi pembacaan pressure switch dengan tekanan real di tanki <i>Confirm that pressure reading at the pressure switch accurately reflects the pressure in the pressure tank.</i>
	
5. Lakukan Penggantian pada kontak <i>Replace the contacts.</i>	6. Ganti pressure switch <i>Replace the pressure switch</i>