

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

1		2		3		4		5		6		7		8									
A																							
B																							
C																							
D																							
E																							
F																							
UniSec Medium Voltage Switchgear PT MULTIMAS NABATI ASAHAN MVD-24 20kV Compressor SCHEMATIC DIAGRAM SBC-W OUTGOING H02																							
				Date Prep.		15.11.2018		PROJECT TITLE				ABB		EPMV		COVER SHEET		Scale		NTS		= H02	
				Prepared		YR		MV Switchgear for MNA Serang Plant				PT. ABB Sakti Industri		MVD-24 20kV Compressor		Customer		PT Multimas Nabati Asahan		& 306			
00		Issued for Approval		15.01.19		YR										Checked		AW		Drawing Nbr.		18.042-MNA-306.06	
Ind.		Revision		Date		Name		Approved		AI		Based on: BE318042				SBC-W OUTGOING		Customer Doc. Nbr.				Cont. 27	
1		2		3		4		5		6		7		8									

UniSec

Medium Voltage Switchgear
PT MULTIMAS NABATI ASAHAN
MVD-24 20kV Compressor
SCHEMATIC DIAGRAM
SBC-W OUTGOING
H02

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

	1	2	3	4	5	6	7	8						
A	SHEET INDEX								A					
A	PAGE			PAGE NAME				REVISION						
	==MVD-24=H02&306/1			COVER SHEET				00						
	==MVD-24=H02&306/2			Index of Sheet				00						
B	==MVD-24=H02&306/3			REFERENCE DESIGNATIONS				00						
	==MVD-24=H02&306/4			REFERENCE DESIGNATIONS				00						
	==MVD-24=H02&306/5			REFERENCE DESIGNATIONS				00						
	==MVD-24=H02&306/6			REFERENCE DESIGNATIONS				00						
	==MVD-24=H02&306/7			DISTRIBUTION OF AUXILIARY CIRCUITS				00						
	==MVD-24=H02&306/8			AUXILIARY SUPPLY CIRCUIT				00						
	==MVD-24=H02&306/9			CIRCUIT BREAKER CONTROL				00						
C	==MVD-24=H02&306/10			AUXILIARY MOTOR & RELAY				00						
	==MVD-24=H02&306/11			DIGITAL INPUT/OUPUT RELAY				00						
	==MVD-24=H02&306/12			SPARE CONTACT				00						
	==MVD-24=H02&306/13			CURRENT TRANSFOMER				00						
	==MVD-24=H02&306/14			VOLTAGE TRANSFORMER				00						
	==MVD-24=H02&306/15			LV DOOR LAYOUT				00						
	==MVD-24=H02&306/16			LV BOX LAYOUT				00						
	==MVD-24=H02&306/17			PART LIST				00						
	==MVD-24=H02&306/18			Terminal diagram ==MVD-24=H02+-XDA										
	==MVD-24=H02&306/19			Terminal diagram ==MVD-24=H02+-XDB1										
D	==MVD-24=H02&306/20			Terminal diagram ==MVD-24=H02+-XDC1										
	==MVD-24=H02&306/21			Terminal diagram ==MVD-24=H02+-XDC2										
	==MVD-24=H02&306/22			Terminal diagram ==MVD-24=H02+-XDI										
	==MVD-24=H02&306/23			Terminal diagram ==MVD-24=H02+-XDI2										
	==MVD-24=H02&306/24			Terminal diagram ==MVD-24=H02+-XDI3										
	==MVD-24=H02&306/25			Terminal diagram ==MVD-24=H02+-XDI6										
	==MVD-24=H02&306/26			Terminal diagram ==MVD-24=H02+-XDV										
	==MVD-24=H02&306/27			Terminal diagram ==MVD-24=H02+-XDX										
E									E					
F					Date Prep.	15.11.2018	PROJECT TITLE		ABB	EPMV	Index of Sheet MVD-24 20kV Compressor SCHEMATIC DIAGRAM SBC-W OUTGOING	Scale	NTS	= H02
					Prepared	YR	MV Switchgear for MNA Serang Plant					Customer	PT Multimas Nabati Asahan	& 306
	00	Issued for Approval	15.01.19	YR	Checked	AW			PT. ABB Sakti Industri			Drawing Nbr.	18.042-MNA-306.06	Sh. 2
	Ind.	Revision	Date	Name	Approved	AI	Based on: BE318042					Customer Doc. Nbr.		Cont. 27
		1	2	3	4	5	6	7	8					


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

1		2		3		4		5		6		7		8				
A	-MAE	MOTOR FOR ELECTRICAL OPERATION OF EARTHING SWITCH -QCE						-QBH	MANUAL CIRCUIT-BREAKERS							A		
	-MAE1	MOTOR FOR ELECTRICAL OPERATION OF EARTHING SWITCH -QCE1 OR -QCE2						-QBL	LINKS									
	-MAE8	MOTOR FOR ELECTRICAL OPERATION OF EARTHING SWITCH -QCE SUPPLIED TOGETHER WITH SWITCH-DISCONNECTOR -QBS						-QBM	MINIATURE SWITCH-DISCONNECTORS									
	-MAS	MOTOR FOR CIRCUIT-BREAKER SPRINGS CHARGING						-QBS	SWITCH-DISCONNECTORS									
	-MAT	MOTOR FOR ELECTRICAL OPERATION OF TRUCK RACKING-IN/OUT						-QBT	TRUCK									
	-MBC	CLOSING RELEASE OF CIRCUIT-BREAKER						-QCA	EARTHING SWITCH FOR ELIMINATION OF INTERNAL ARCING									
	-MBC4	CLOSING RELEASE OF SWITCH-DISCONNECTOR -QBS						-QCE	EARTHING SWITCH									
	-MBO1	FIRST OPENING RELEASE OF CIRCUIT-BREAKER						-QCE1	EARTHING SWITCH OF BUSBARS (SINGLE BUSBAR SYSTEM) OR OF FRONT BUSBARS (DOUBLE BUSBAR SYSTEM)									
	-MBO2	SECOND OPENING RELEASE OF CIRCUIT-BREAKER						-QCE2	EARTHING SWITCH OF REAR BUSBARS (DOUBLE BUSBAR SYSTEM)									
	-MBO3	OPENING SOLENOID FOR OVERCURRENT RELEASE OF CIRCUIT-BREAKER OR INDIRECT OVERCURRENT RELEASE ON CIRCUIT-BREAKER						-QQ	CLUTCHES									
	B	-MBO4	OPENING RELEASE OF SWITCH-DISCONNECTOR -QBS						-RAA	ANTIFERRORESONANCE RESISTOR							B	
		-MBU	UNDERVOLTAGE RELEASE OF CIRCUIT-BREAKER						-RAD	DIODES								
-PFB		BLUE SIGNAL LAMPS						-RAI	INDUCTORS									
-PFF		FLAG RELAYS						-RAR	RESISTORS									
	-PFG	GREEN SIGNAL LAMPS						-RF	FILTERS									
	-PFR	RED SIGNAL LAMPS						-RLE1	ELECTROMECHANICAL LOCK PREVENTING CIRCUIT-BREAKER CLOSING									
	-PFS	SHORT CIRCUIT INDICATORS						-RLE2	ELECTROMECHANICAL LOCK PREVENTING TRUCK RACKING-IN/OUT									
	-PFV	VOLTAGE INDICATORS						-RLE3	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR CLOSING OPERATION OF EARTHING SWITCH -QCE									
	-PFV1	VOLTAGE INDICATORS ON FEEDER SIDE						-RLE4	ELECTROMECHANICAL LOCK PREVENTING THE DOOR OPENING OPERATION									
	-PFV2	VOLTAGE INDICATORS ON BUSBAR SIDE						-RLE5	ELECTROMECHANICAL LOCK PREVENTING OPERATION OF DISCONNECTOR -QBD									
	C	-PFW	WHITE SIGNAL LAMPS						-RLE6	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR CLOSING OPERATION OF DISCONNECTOR -QBD1							C	
		-PFX	CROSS INDICATORS, ELECTROMECHANICAL INDICATORS						-RLE7	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR CLOSING OPERATION OF DISCONNECTOR -QBD2								
-PFY		YELLOW SIGNAL LAMPS						-RLE8	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR CLOSING OPERATION OF EARTHING SWITCH -QCE1 OR -QCE2									
-PGA		AMMETERS						-RLE9	ELECTROMECHANICAL LOCK PREVENTING OPERATION OF SWITCH-DISCONNECTOR -QBS									
	-PGC	COUNTERS						-RLE11	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR OPERATION OF DISCONNECTOR -QBD4									
	-PGF	FREQUENCYMETERS						-RLE12	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR OPERATION OF DISCONNECTOR -QBD5									
	-PGH	HOURMETERS						-SFA	AMMETRIC SWITCHES									
	-PGI	PROTECTION AND CONTROL UNIT: HUMAN MACHINE INTERFACE						-SFC	CONTROL SWITCHES, CLOSING PUSH-BUTTONS									
	-PGI1	HUMAN MACHINE INTERFACE OF ELECTRONIC CONTROLLED CIRCUIT-BREAKER (ON CIRCUIT-BREAKER)						-SFL	LOCKING CONTACTS									
	-PGI2	HUMAN MACHINE INTERFACE FOR ELECTRONIC CONTROLLED CIRCUIT-BREAKER (ON SWITCHGEAR)						-SFO	OPENING PUSH-BUTTONS									
	-PGJ	ACTIVE ENERGY METERS						-SFR	RESET PUSH-BUTTONS									
	-PGK	REACTIVE ENERGY METERS						-SFS	SELECTOR SWITCHES									
	-PGM	MULTIFUNCTION INDICATORS						-SFT	TEST PUSH-BUTTONS									
	-PGP	POWER-FACTOR METERS						-SFU	UNLOCKING PUSH-BUTTONS									
	-PGQ	VARMETERS						-SFV	VOLTMETRIC SWITCHES									
	-PGS	SYNCHRONOSCOPES						-TA	POWER TRANSFORMERS									
	-PGV	VOLTMETERS						-TB	CONVERTER									
	-PGW	WATTMETERS						-TB1	RECTIFIER FOR FIRST OPENING RELEASE									
	-PJ	ACOUSTICAL SIGNAL DEVICES (BELLS, SIRENS)						-TB2	RECTIFIER FOR SECOND OPENING RELEASE									
	-QAB	CIRCUIT-BREAKERS						-TB3	RECTIFIER FOR CLOSING RELEASE									
E	-QAC	CONTACTORS (FOR POWER)						-TB4	RECTIFIER FOR ELECTROMECHANICAL LOCK PREVENTING CIRCUIT-BREAKER CLOSING							E		
	-QBD	DISCONNECTORS						-TB5	RECTIFIER FOR ELECTROMECHANICAL LOCK PREVENTING TRUCK RACKING-IN/OUT									
	-QBD1	FRONT BUSBAR DISCONNECTORS (DOUBLE BUSBAR SYSTEM)						-TB6	RECTIFIER FOR UNDERVOLTAGE RELEASE									
	-QBD2	REAR BUSBAR DISCONNECTORS (DOUBLE BUSBAR SYSTEM)						-TB7	ERECTIFIER FOR INDIRECT OVERCURRENT RELEASE ON CIRCUIT-BREAKER									
	-QBD3	FEEDER DISCONNECTORS (DOUBLE BUSBAR SYSTEM)														F		
	-QBD4	TWO-WAY DISCONNECTOR																
	-QBD5	TWO-WAY DISCONNECTOR ON BUSBAR RISER																
F					Date Prep.	15.11.2018	PROJECT TITLE		ABB	EPMV	REFERENCE DESIGNATIONS		Scale	NTS		= H02		
					Prepared	YR	MV Switchgear for MNA Serang Plant				MVD-24 20kV Compressor		Customer	PT Multimas Nabati Asahan		& 306		
	00	Issued for Approval	15.01.19	YR	Checked	AW			PT. ABB Sakti Industri		SCHEMATIC DIAGRAM		Drawing Nbr.	18.042-MNA-306.06		Sh. 5		
	Ind.	Revision	Date	Name	Approved	AI	Based on: BE318042				SBC-W OUTGOING		Customer Doc. Nbr.			Cont. 27		
1		2		3		4		5		6		7		8				

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.


A	-TFA	ACTIVE POWER TRANSDUCERS	A		
	-TFC	CURRENT TRANSDUCERS			
	-TFF	FREQUENCY TRANSDUCERS			
	-TFJ	ACTIVE ENERGY TRANSDUCERS			
	-TFK	REACTIVE ENERGY TRANSDUCERS			
	-TFM	MULTIFUNCTION TRANSDUCERS			
	-TFP	POWER-FACTOR TRANSDUCERS			
	-TFQ	REACTIVE POWER TRANSDUCERS			
	-TFS	SIGNAL CONVERTERS			
	-TFV	VOLTAGE TRANSDUCERS			
	-WA	BUSBARS			
	-WBC	POWER CABLES			
	-WE	EARTHING CABLES FOR L.V. INSTRUMENT COMPARTMENT.			
	-WGC	CONTROL CABLES			
	-WGS	COMMUNICATION CABLES (SHIELDED TWISTED PAIRS)			
	-WH	OPTICAL FIBRES			
	-XDA	TERMINAL BLOCK FOR CIRCUITS OF CURRENT TRANSFORMERS			
	-XDA1	CONNECTOR FOR CIRCUITS OF CURRENT TRANSFORMERS LOCATED ON PHASE L1			
	-XDA2	CONNECTOR FOR CIRCUITS OF CURRENT TRANSFORMERS LOCATED ON PHASE L2			
	B	-XDA3		CONNECTOR FOR CIRCUITS OF CURRENT TRANSFORMERS LOCATED ON PHASE L3	B
-XDA5		CONNECTOR FOR CIRCUITS OF NEUTRAL (RESIDUAL) CURRENT TRANSFORMER			
-XDB		CONNECTOR FOR ISOLATION OF CIRCUIT-BREAKER (OR UPPER VOLTAGE TRANSFORMER TRUCK) AUXILIARY CIRCUITS			
-XDB1		CONNECTOR FOR AUXILIARY CIRCUITS OF CIRCUIT-BREAKER (OR UPPER VOLTAGE TRANSFORMER TRUCK)			
-XDB2		CONNECTOR FOR ADDITIONAL AUXILIARY CIRCUITS OF CIRCUIT-BREAKER			
-XDB10...-XDB89		CONNECTOR FOR CIRCUIT-BREAKER INTERNAL CIRCUITS			
-XDB7		CONNECTOR FOR TRUCK POSITION CONTACTS			
-XDB91		CONNECTOR FOR OPENING RELEASE CIRCUITS OF SWITCH-DISCONNECTOR			
-XDB92		CONNECTOR FOR CLOSING RELEASE CIRCUITS OF SWITCH-DISCONNECTOR			
-XDB93		CONNECTOR FOR POSITION SWITCHES OF SWITCH-DISCONNECTOR			
-XDB95		CONNECTOR FOR CIRCUITS OF EARTHING SWITCH LOCKING MAGNET			
-XDC		CUSTOMER TERMINAL BLOCK			
-XDC1		CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF CIRCUIT BREAKER			
-XDC2		CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF SWITCH-DISCONNECTOR			
-XDC3		CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF PROTECTION RELAY AND MULTIFUNCTION UNIT			
-XDC4		CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF VOLTAGE TRANSFORMERS			
-XDC5		CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF MINIATURE CIRCUIT BREAKER			
-XDE		TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF EARTHING SWITCH -QCE			
-XDE1		TERMINAL BLOCK FOR INTERNAL CIRCUITS OF EARTHING SWITCH -QCE			
-XDE2		TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF EARTHING SWITCH -QCE1 OR -QCE2			
-XDE3	TERMINAL BLOCK FOR INTERNAL CIRCUITS OF EARTHING SWITCH -QCE1 OR -QCE2				
-XDF	TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF FORCED COOLING VENTILATORS				
-XDF1	CONNECTOR FOR ISOLATION OF CIRCUITS OF FRONT VENTILATOR				
-XDF2	CONNECTOR FOR REAR VENTILATOR CIRCUITS				
-XDF3	CONNECTOR FOR FRONT VENTILATOR CIRCUITS				
-XDH	TERMINAL BLOCK FOR VARIOUS CIRCUITS (HEATERS, POSITION SWITCHES DETECTING INTERNAL ARCING, ETC.)				
-XDI	TERMINAL BLOCK FOR INTERCONNECTION (CONNECTION BETWEEN PANELS)				
B	-XDI1	TERMINAL BLOCK FOR INTERCONNECTIONS OF CONTROL CIRCUITS	B		
	-XDI2	TERMINAL BLOCK FOR INTERCONNECTIONS OF CIRCUITS OF MOTOR FOR CIRCUIT-BREAKER SPRINGS CHARGING			
	-XDI3	TERMINAL BLOCK FOR INTERCONNECTIONS OF CIRCUITS OF MOTOR FOR SWITCH-DISCONNECTOR OPERATION			
	-XDI4	TERMINAL BLOCK FOR INTERCONNECTIONS OF A.C. AUXILIARY CIRCUITS			
	-XDI6	TERMINAL BLOCK FOR INTERCONNECTION (CONNECTION BETWEEN PANELS) OF VOLTAGE CIRCUITS			
	-XDI7	TERMINAL BLOCK FOR INTERCONNECTION OF MOD-BUS			
	-XDI8	TERMINAL BLOCK FOR INTERCONNECTIONS OF CURRENT CIRCUITS			
	-XDI9	TERMINAL BLOCK FOR SPECIAL USE			
	-XDJ	TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF DISCONNECTORS -QBD			
	-XDJ1	TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF SWITCH-DISCONNECTOR -QBS			
	-XDM	SEALABLE TERMINAL BLOCK FOR MEASUREMENT			
	-XDS	CURRENT SOCKETS			
	-XDT	TERMINAL BLOCK FOR POSITION CONTACTS OF TRUCK AND OF CONNECTOR -XDB			
	-XDU	CONNECTOR FOR ISOLATION OF CIRCUITS OF LOWER VOLTAGE TRANSFORMER TRUCK			
	-XDU1	TERMINAL BLOCK FOR CIRCUITS OF LOWER VOLTAGE TRANSFORMER TRUCK			
	-XDV	TERMINAL BLOCK FOR CIRCUITS OF VOLTAGE TRANSFORMERS			
	-XDV1	CONNECTOR FOR CIRCUITS OF VOLTAGE TRANSFORMERS LOCATED ON PHASE L1			
	-XDV2	CONNECTOR FOR CIRCUITS OF VOLTAGE TRANSFORMERS LOCATED ON PHASE L2			
	-XDV3	CONNECTOR FOR CIRCUITS OF VOLTAGE TRANSFORMERS LOCATED ON PHASE L3			
	-XDV4	CONNECTOR FOR CIRCUITS OF ANTIFERRORESONANCE RESISTOR			
-XDX	SUPPORT TERMINAL BLOCK				
-XE1	EARTHING TERMINAL BLOCKS FOR LV COMPARTMENT, LEFT SIDE				
-XE2	EARTHING TERMINAL BLOCKS FOR LV COMPARTMENT, RIGHT SIDE				
-XE5	EARTHING TERMINAL BLOCKS FOR MV COMPARTMENT, VOLTAGE INDICATOR SIDE				
-XE6	EARTHING TERMINAL BLOCKS FOR MV COMPARTMENT, REAR BOTTOM SIDE				
-XE7	EARTHING TERMINAL BLOCKS FOR MV COMPARTMENT, LEFT SIDE				
-XE8	EARTHING TERMINAL BLOCKS FOR MV COMPARTMENT, FRONT BOTTOM SIDE				
-XE9	EARTHING TERMINAL BLOCK FOR TRANSFORMERS IN BUSBAR COMPARTMENT				
C			C		
	D				D
E				E	
	F				F

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

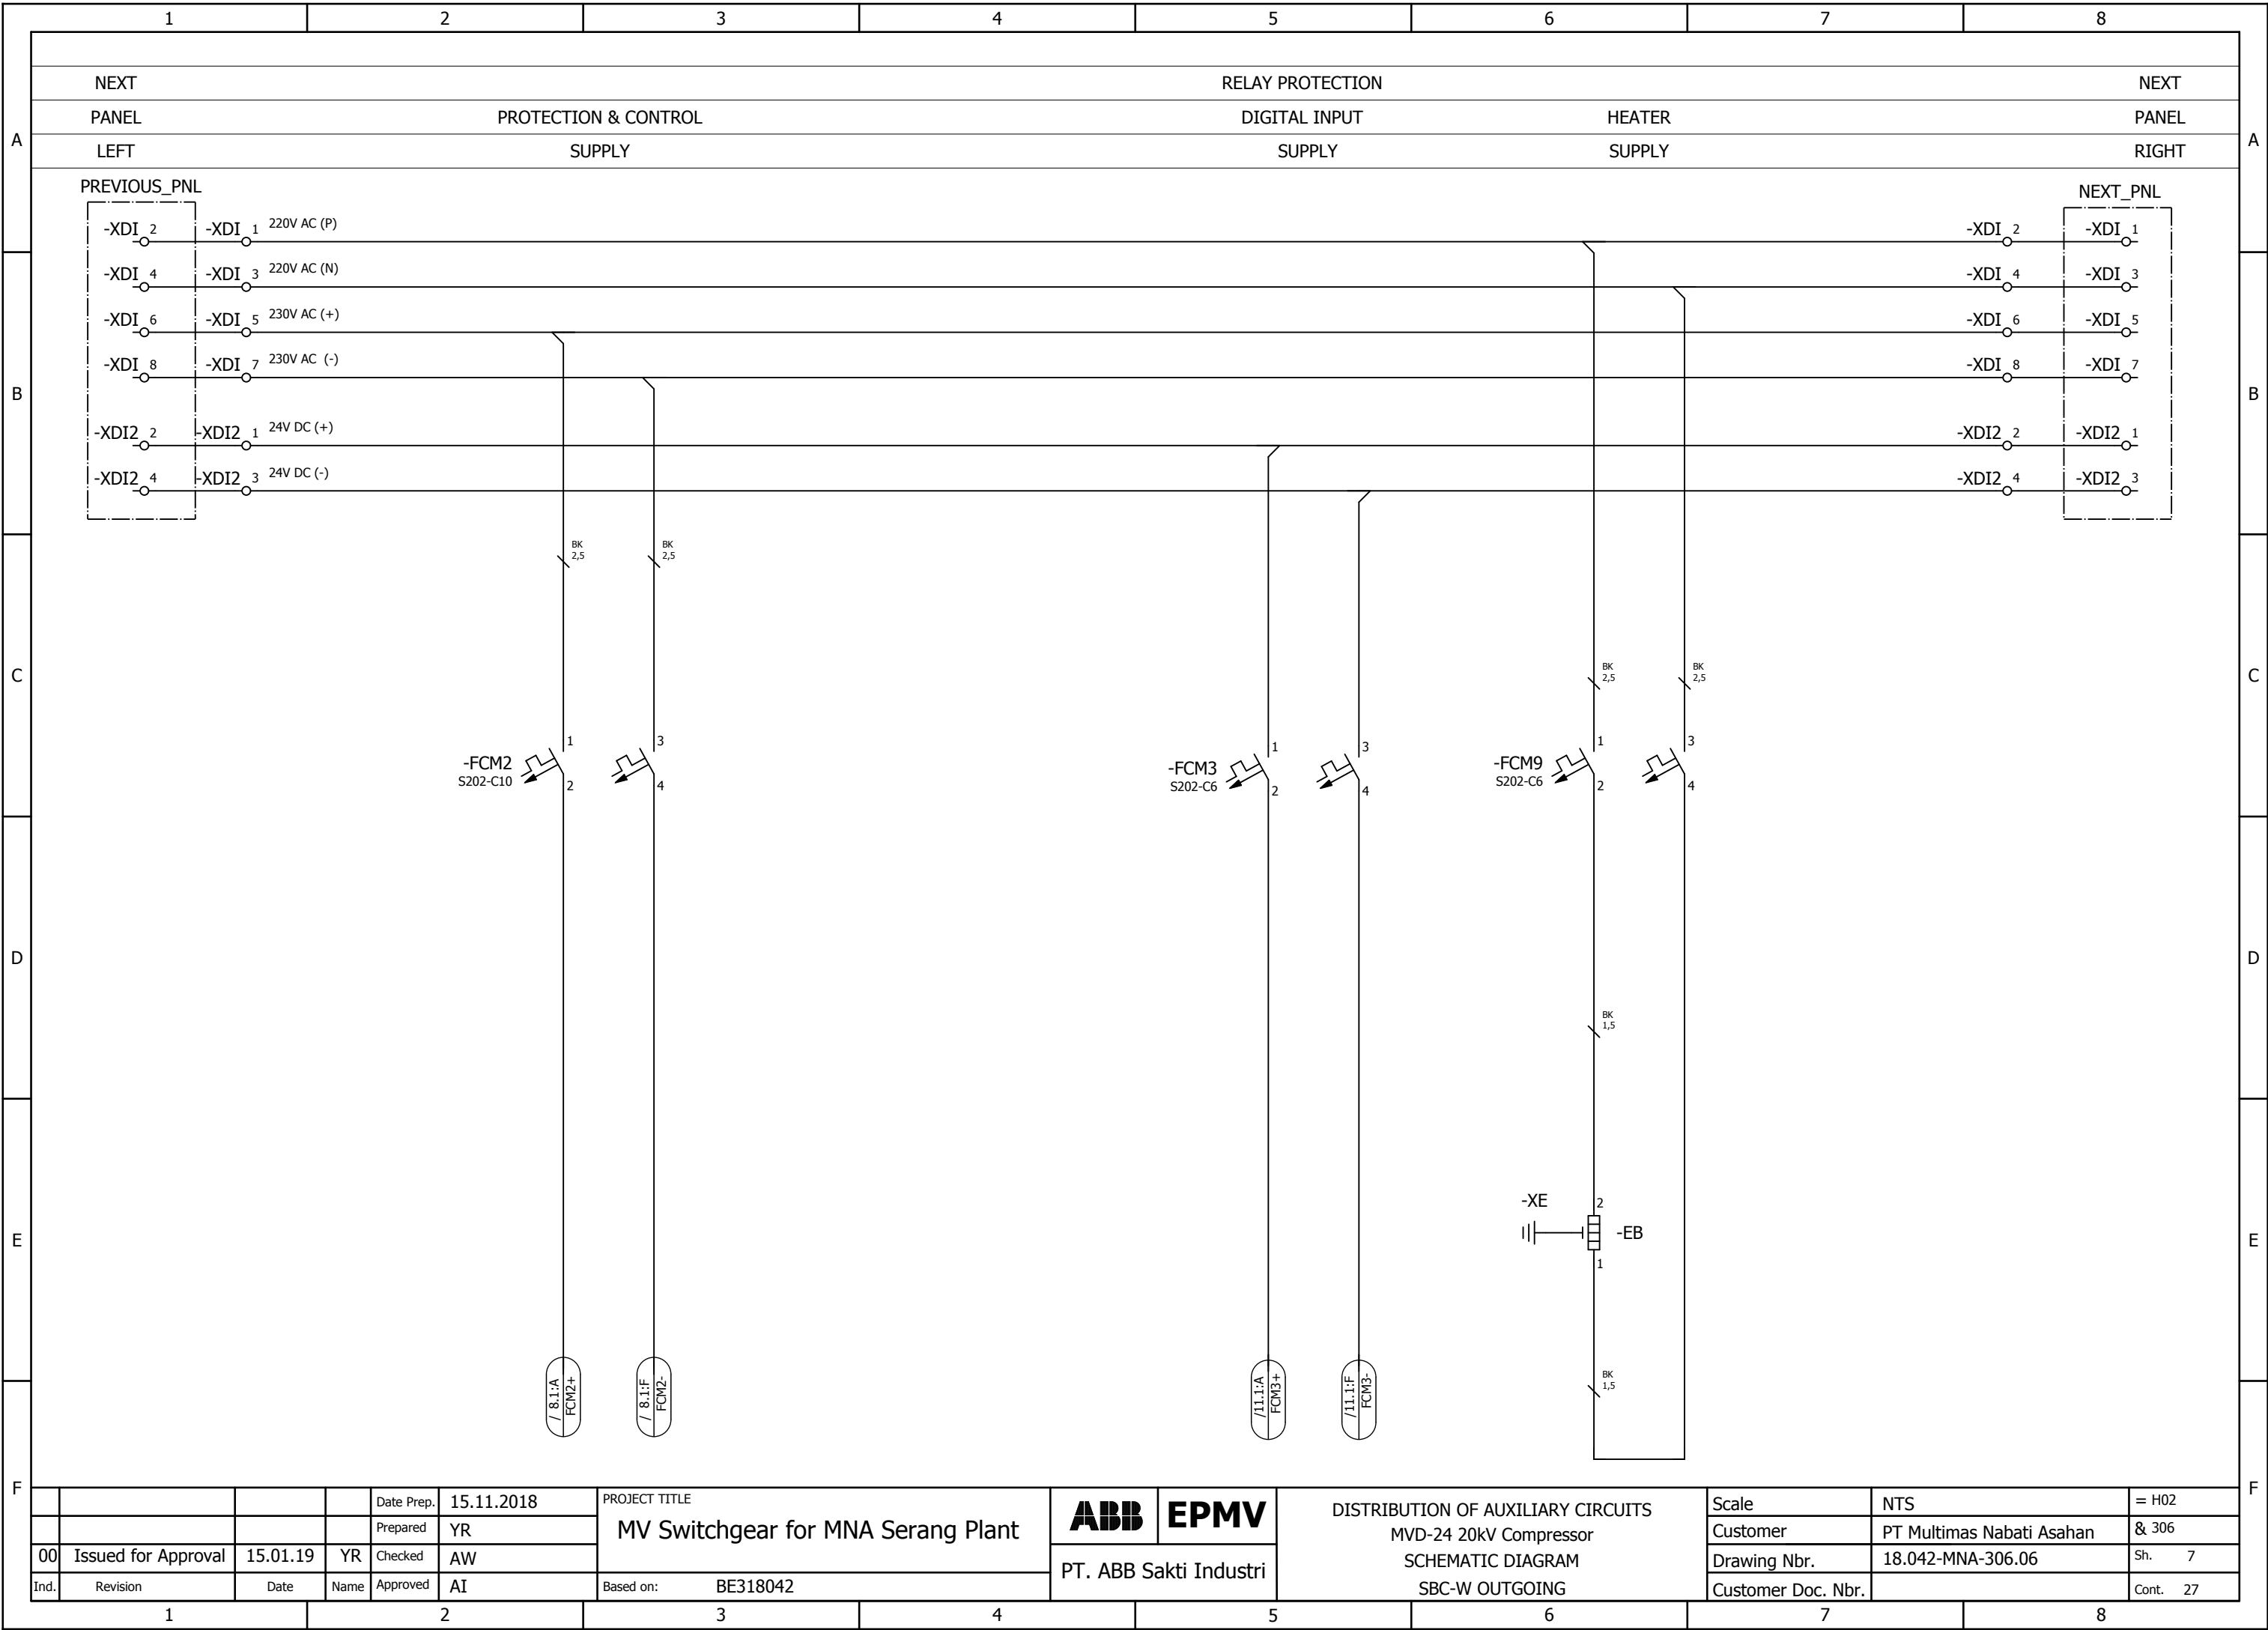


				Date Prep.	15.11.2018	PROJECT TITLE MV Switchgear for MNA Serang Plant	ABB	EPMV	DISTRIBUTION OF AUXILIARY CIRCUITS MVD-24 20kV Compressor SCHEMATIC DIAGRAM SBC-W OUTGOING	Scale	NTS	= H02
				Prepared	YR					Customer	PT Multimas Nabati Asahan	& 306
00	Issued for Approval	15.01.19	YR	Checked	AW		PT. ABB Sakti Industri	Drawing Nbr.		18.042-MNA-306.06	Sh.	7
Ind.	Revision	Date	Name	Approved	AI			Based on:		BE318042	Customer Doc. Nbr.	

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

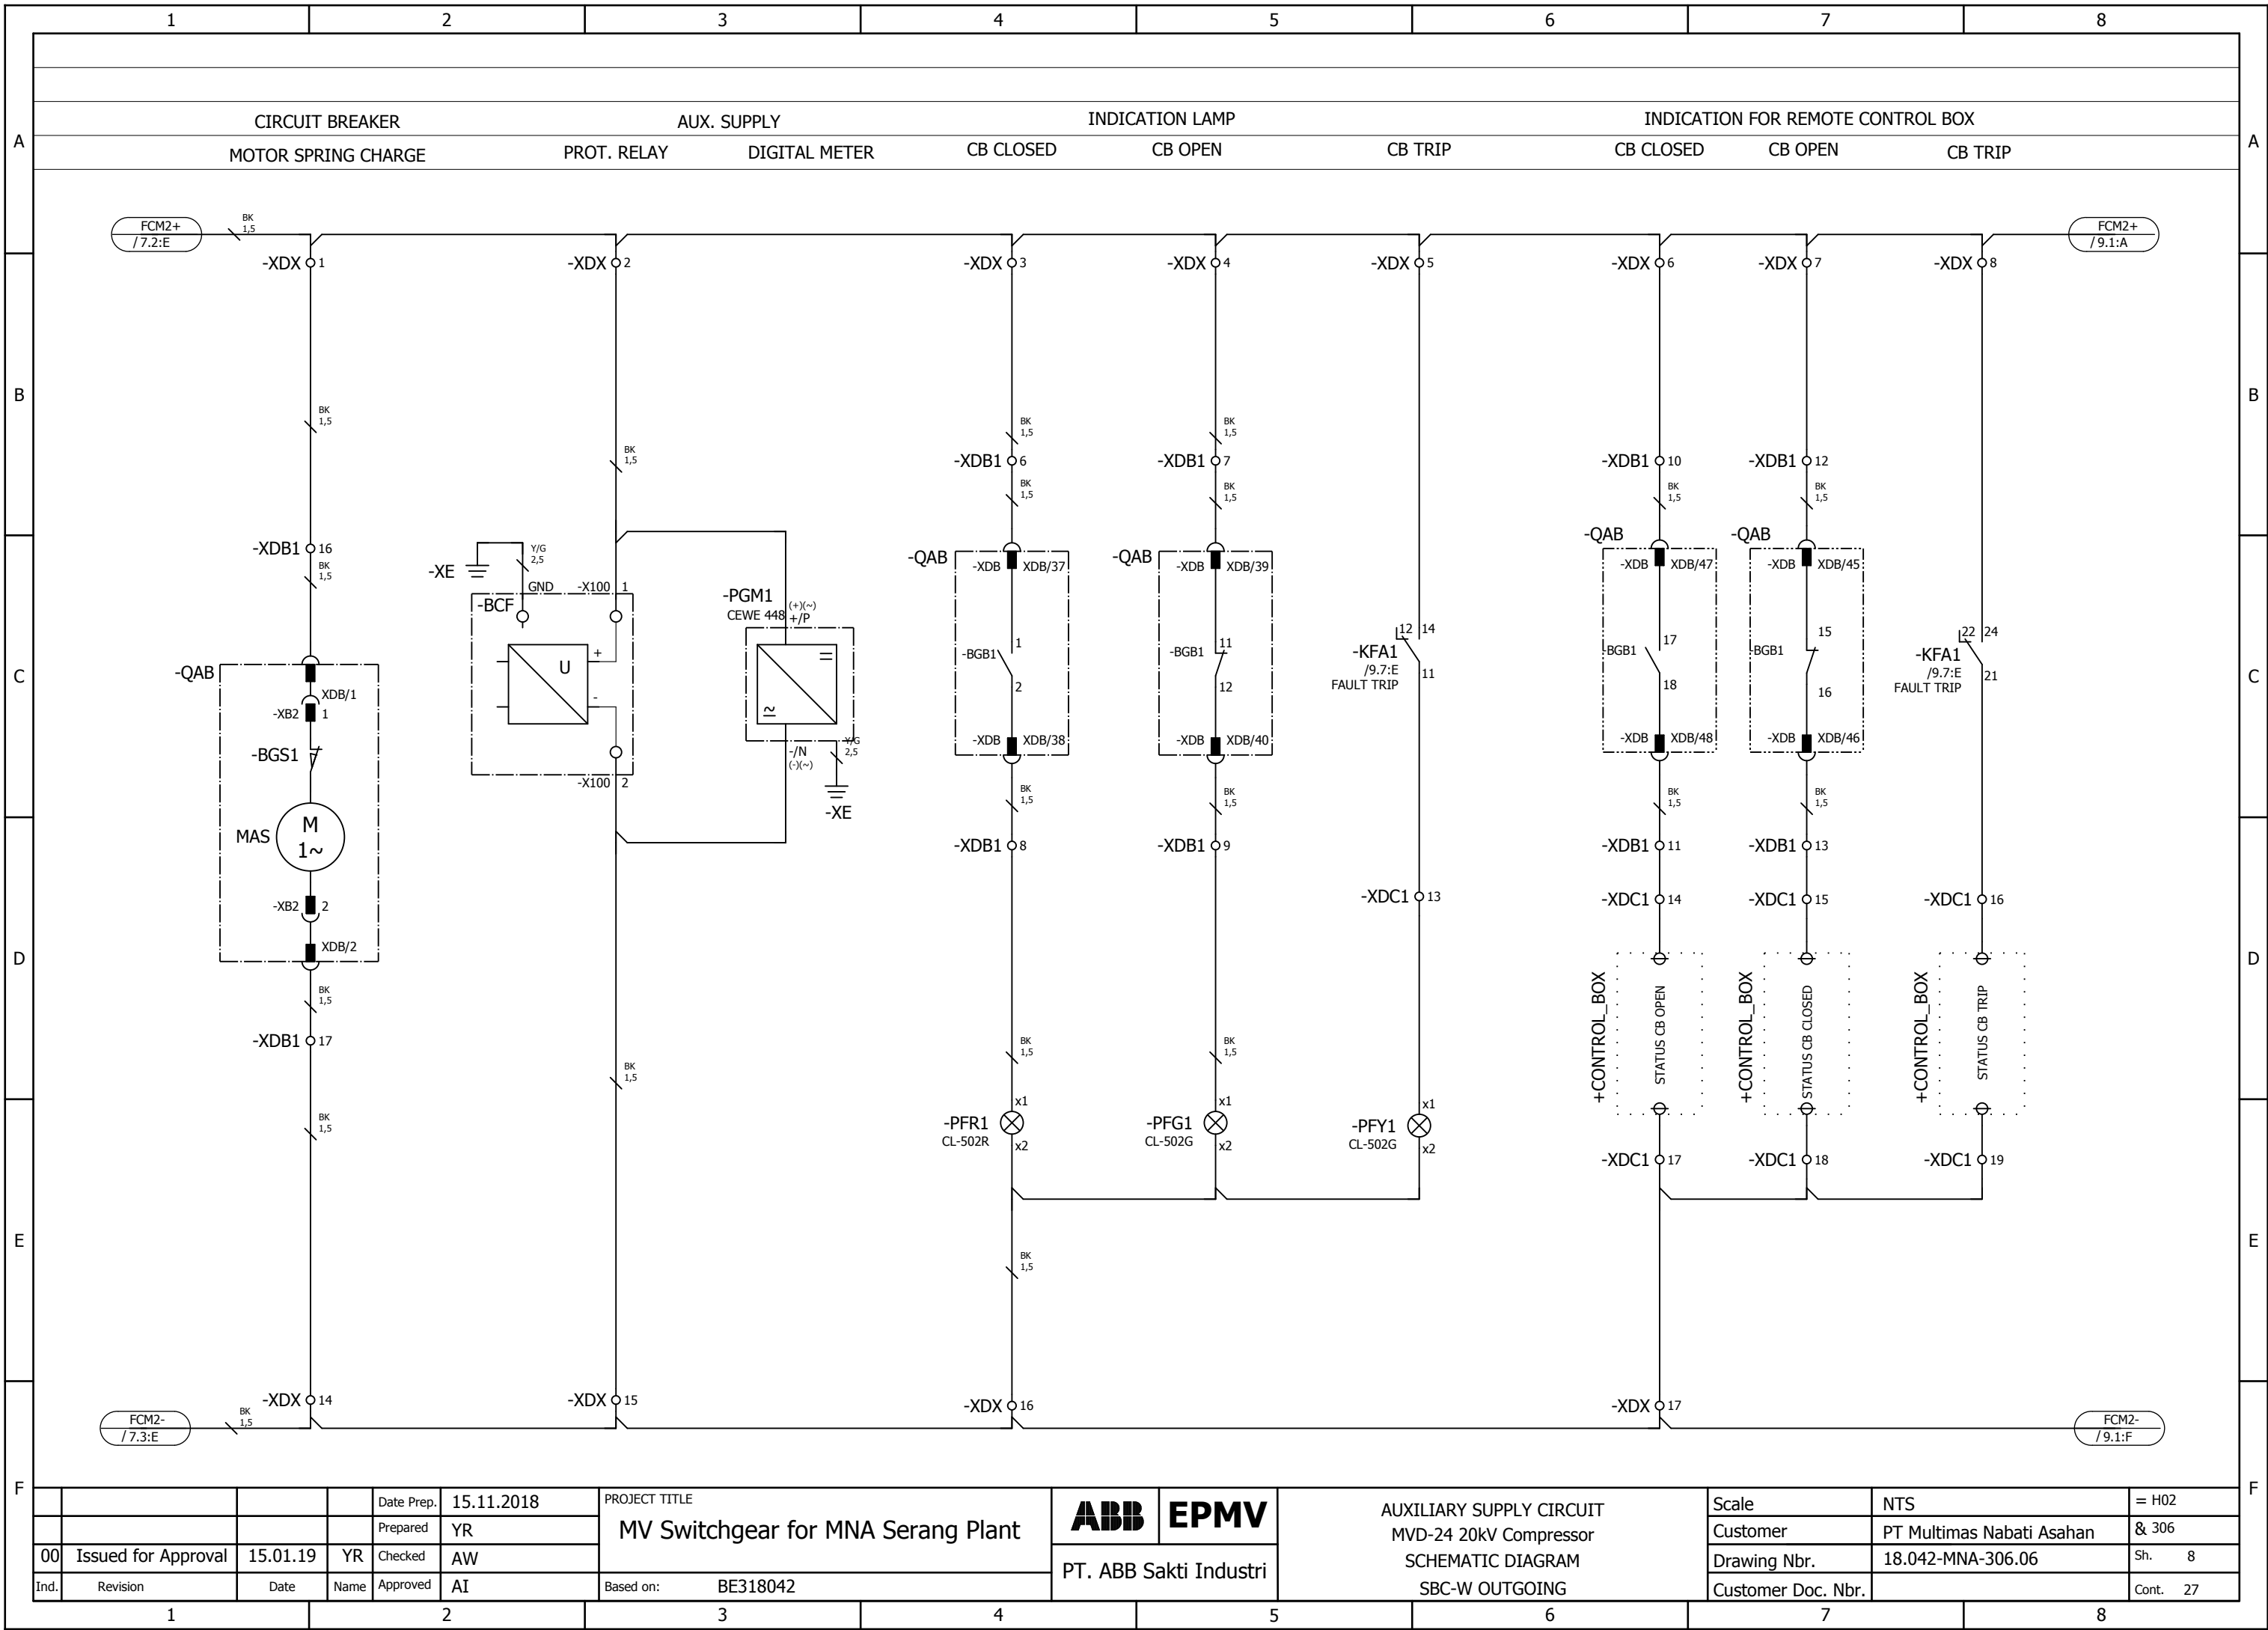


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

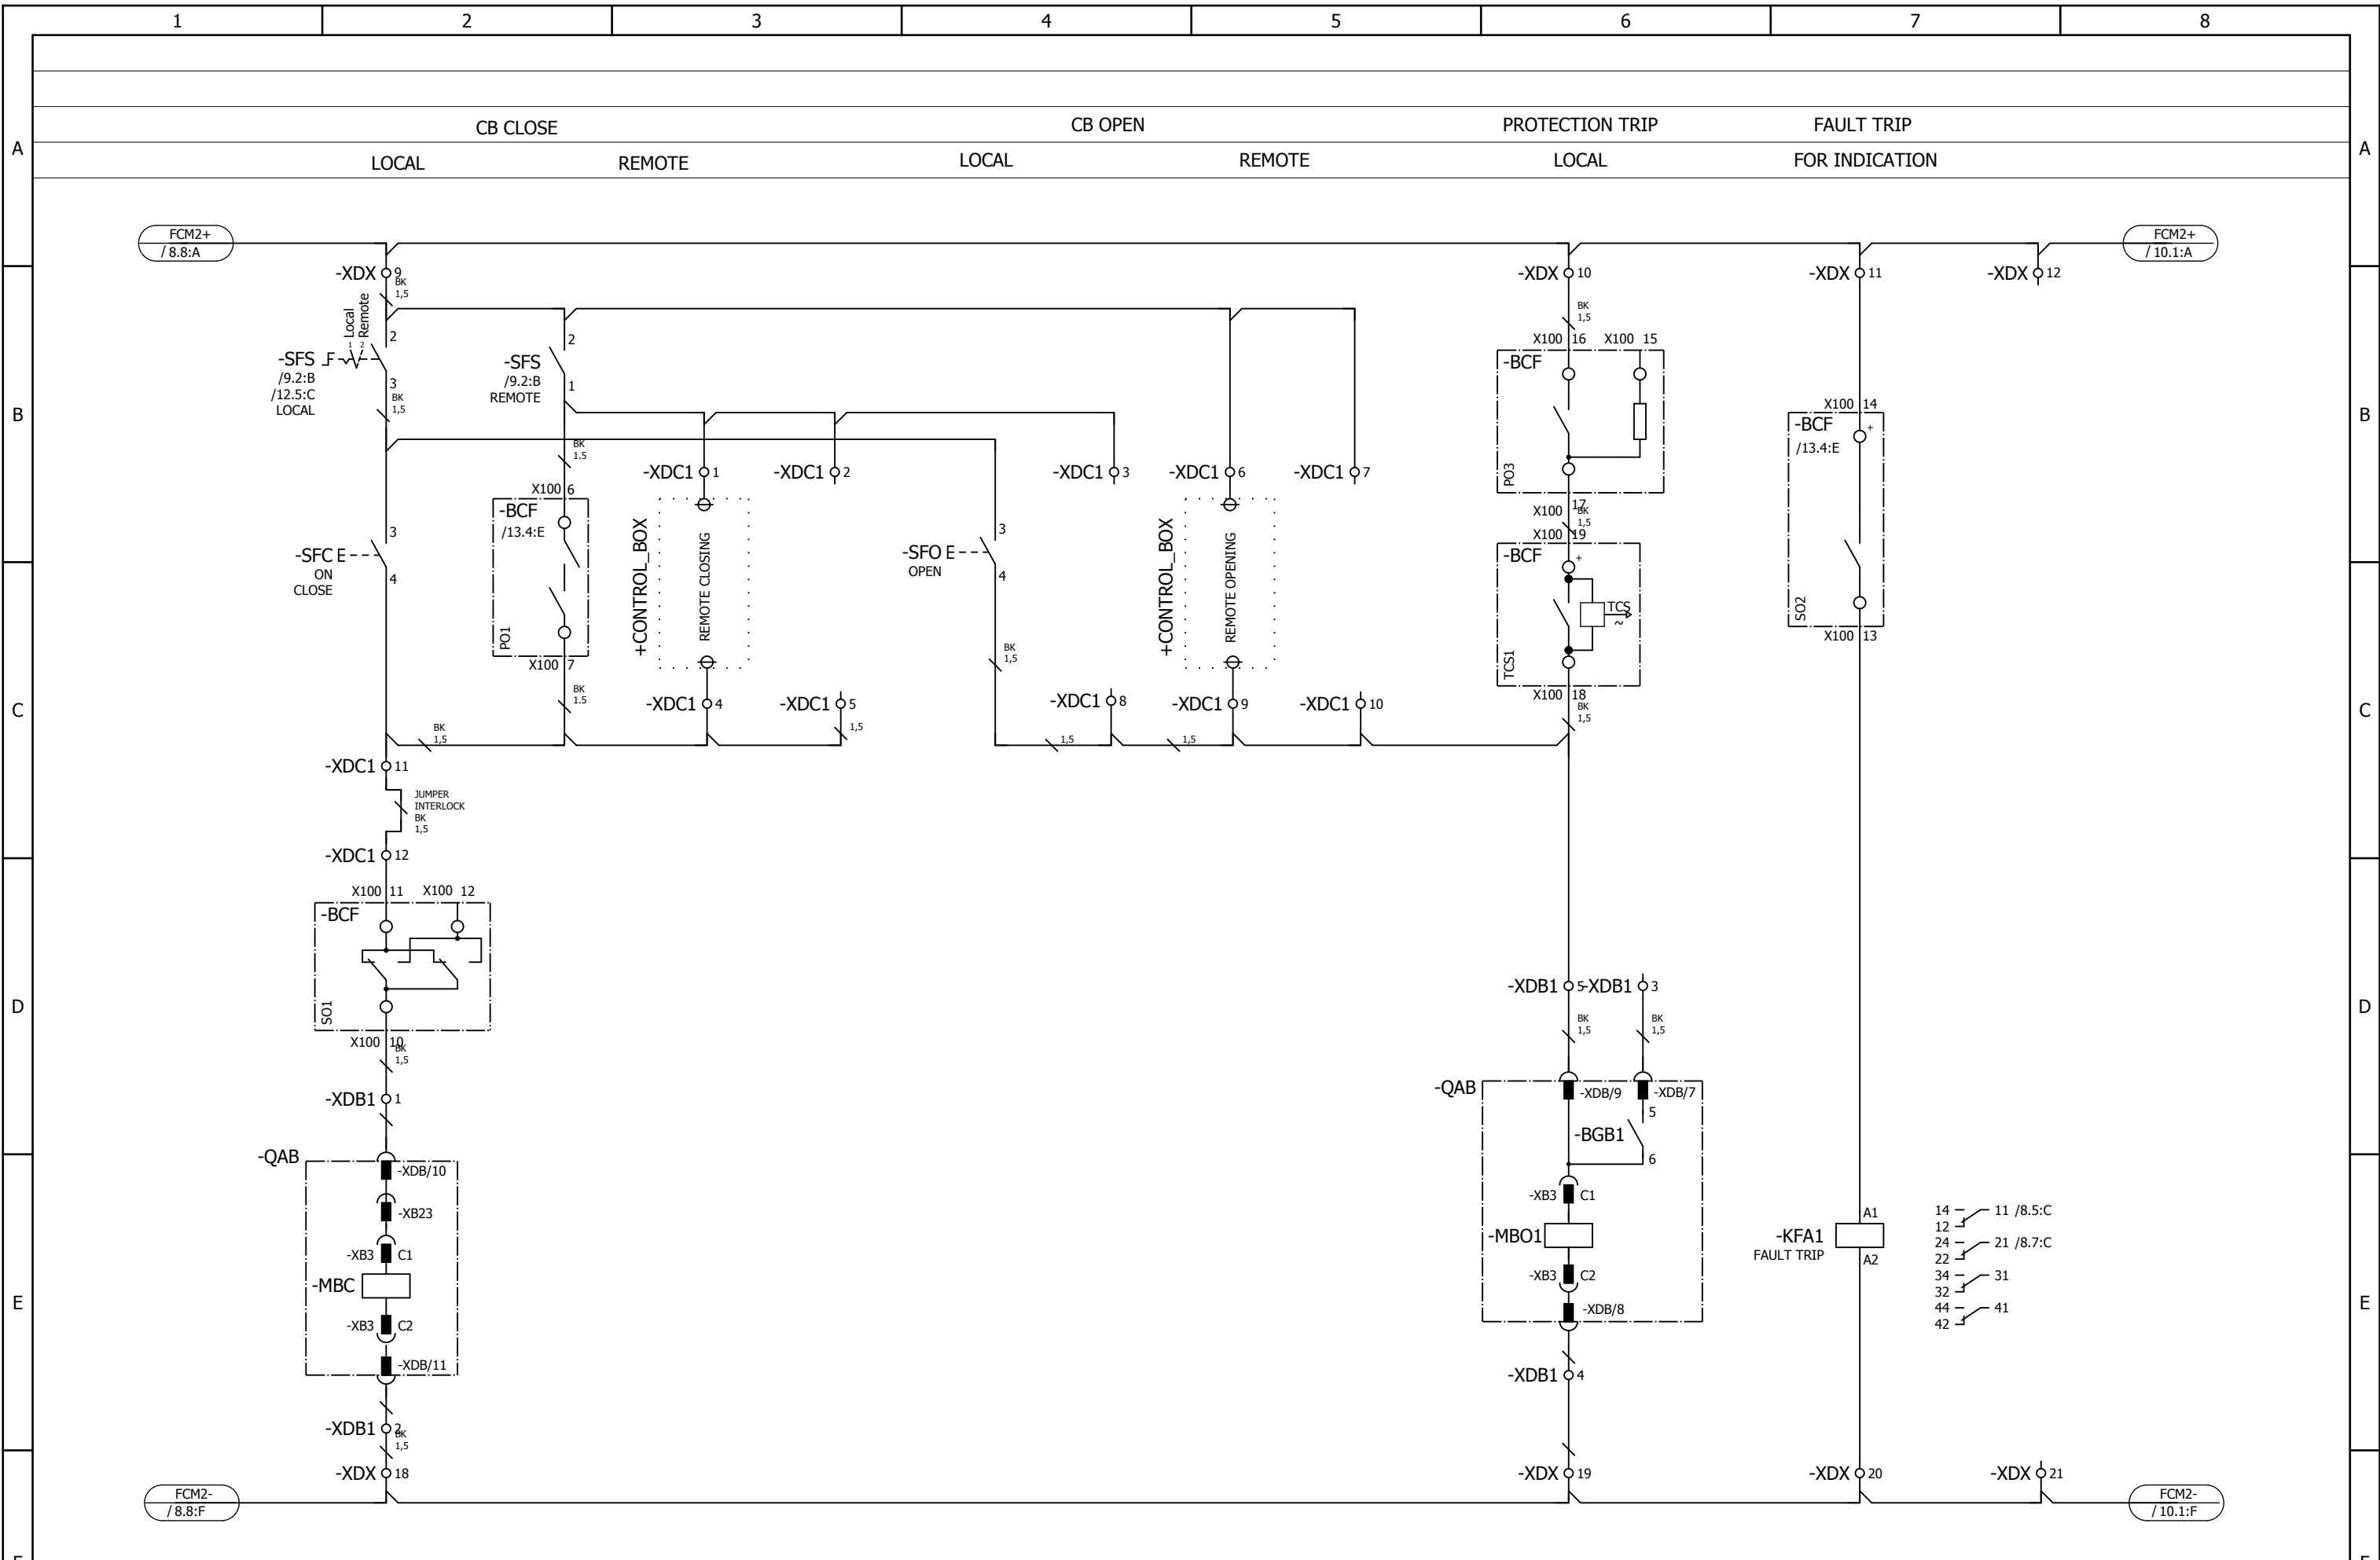

		Date Prep.		15.11.2018		PROJECT TITLE		ABB EPMV		CIRCUIT BREAKER CONTROL		Scale	NTS	= H02
		Prepared		YR		MV Switchgear for MNA Serang Plant				MVD-24 20kV Compressor		Customer	PT Multimas Nabati Asahan	& 306
00	Issued for Approval	15.01.19	YR	Checked	AW			PT. ABB Sakti Industri		SCHEMATIC DIAGRAM		Drawing Nbr.	18.042-MNA-306.06	Sh. 9
Ind.	Revision	Date	Name	Approved	AI	Based on: BE318042				SBC-W OUTGOING		Customer Doc. Nbr.		Cont. 27


				Date Prep.	15.11.2018	PROJECT TITLE MV Switchgear for MNA Serang Plant	ABB	EPMV	AUXILIARY MOTOR & RELAY MVD-24 20kV Compressor SCHEMATIC DIAGRAM SBC-W OUTGOING	Scale	NTS	= H02
				Prepared	YR					Customer	PT Multimas Nabati Asahan	& 306
00	Issued for Approval	15.01.19	YR	Checked	AW		Drawing Nbr.	18.042-MNA-306.06		Sh. 10		
Ind.	Revision	Date	Name	Approved	AI	Based on:	BE318042	Customer Doc. Nbr.			Cont. 27	
							PT. ABB Sakti Industri					

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

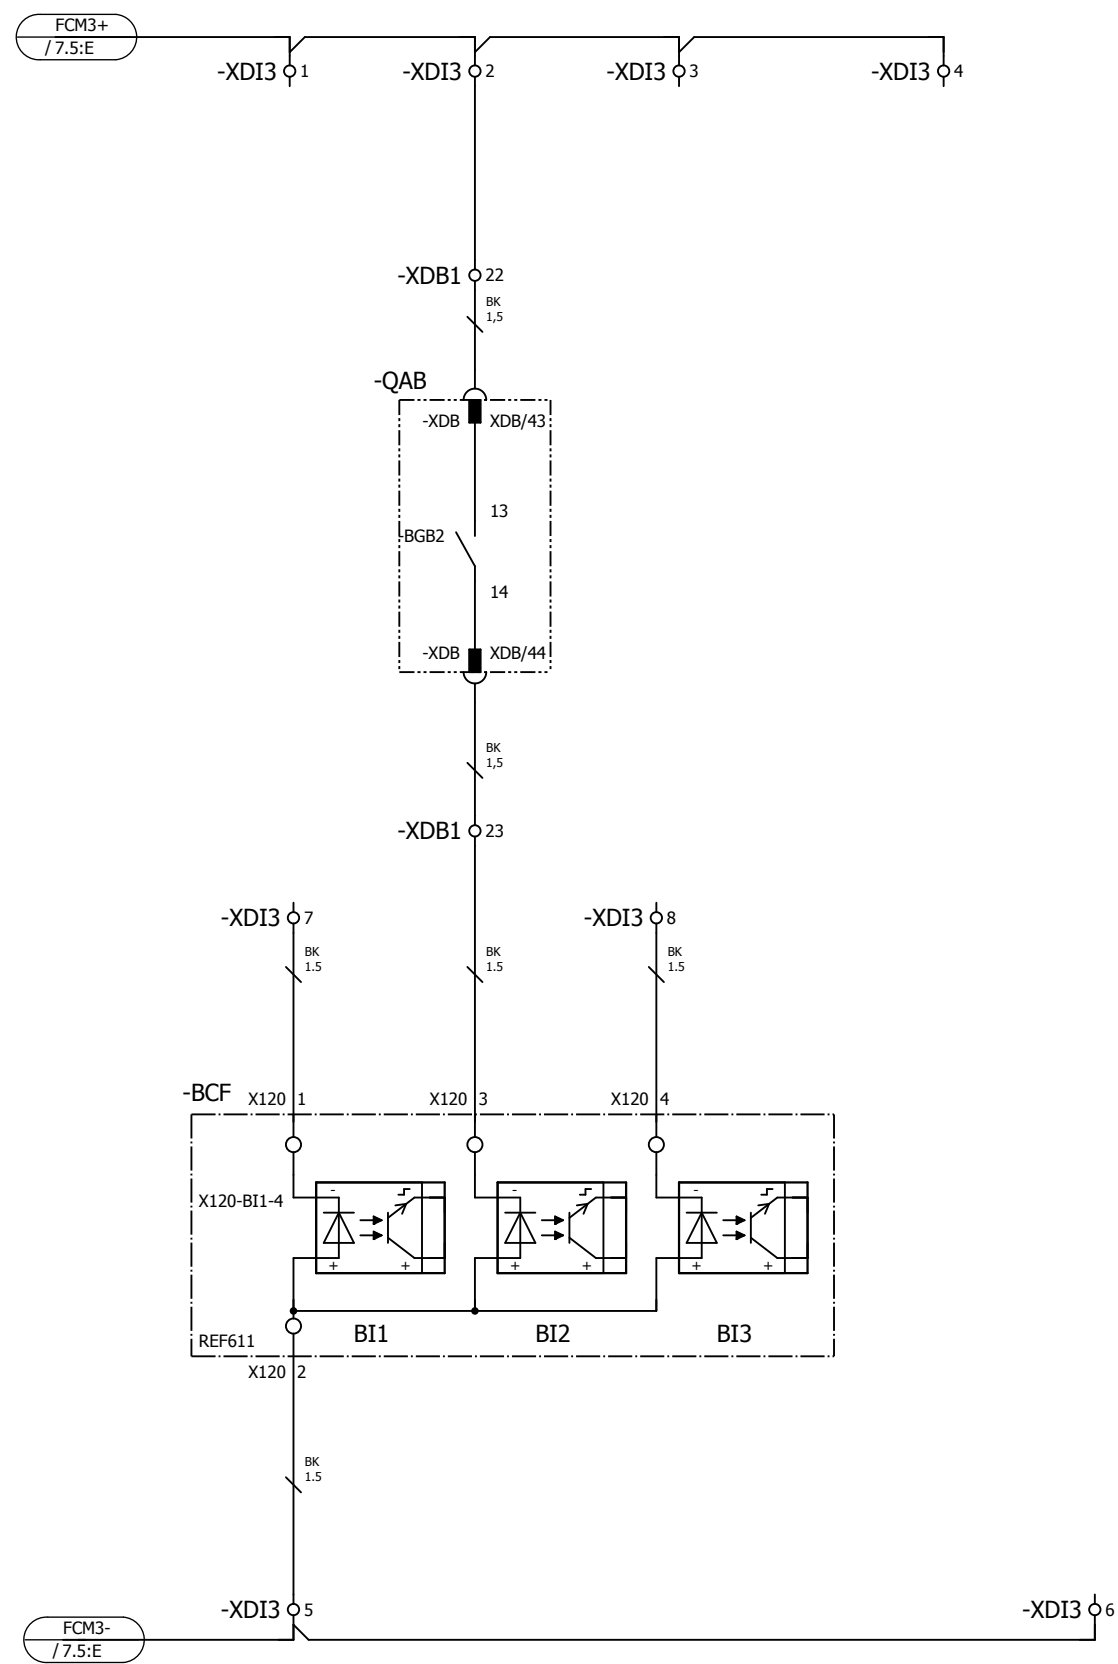


				Date Prep.	15.11.2018	PROJECT TITLE MV Switchgear for MNA Serang Plant	ABB	EPMV	DIGITAL INPUT/OUTPUT RELAY MVD-24 20kV Compressor SCHEMATIC DIAGRAM SBC-W OUTGOING	Scale	NTS	= H02
				Prepared	YR					Customer	PT Multimas Nabati Asahan	& 306
00	Issued for Approval	15.01.19	YR	Checked	AW					Drawing Nbr.	18.042-MNA-306.06	Sh. 11
Ind.	Revision	Date	Name	Approved	AI	Based on:	BE318042	Customer Doc. Nbr.			Cont. 27	
						PT. ABB Sakti Industri						


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

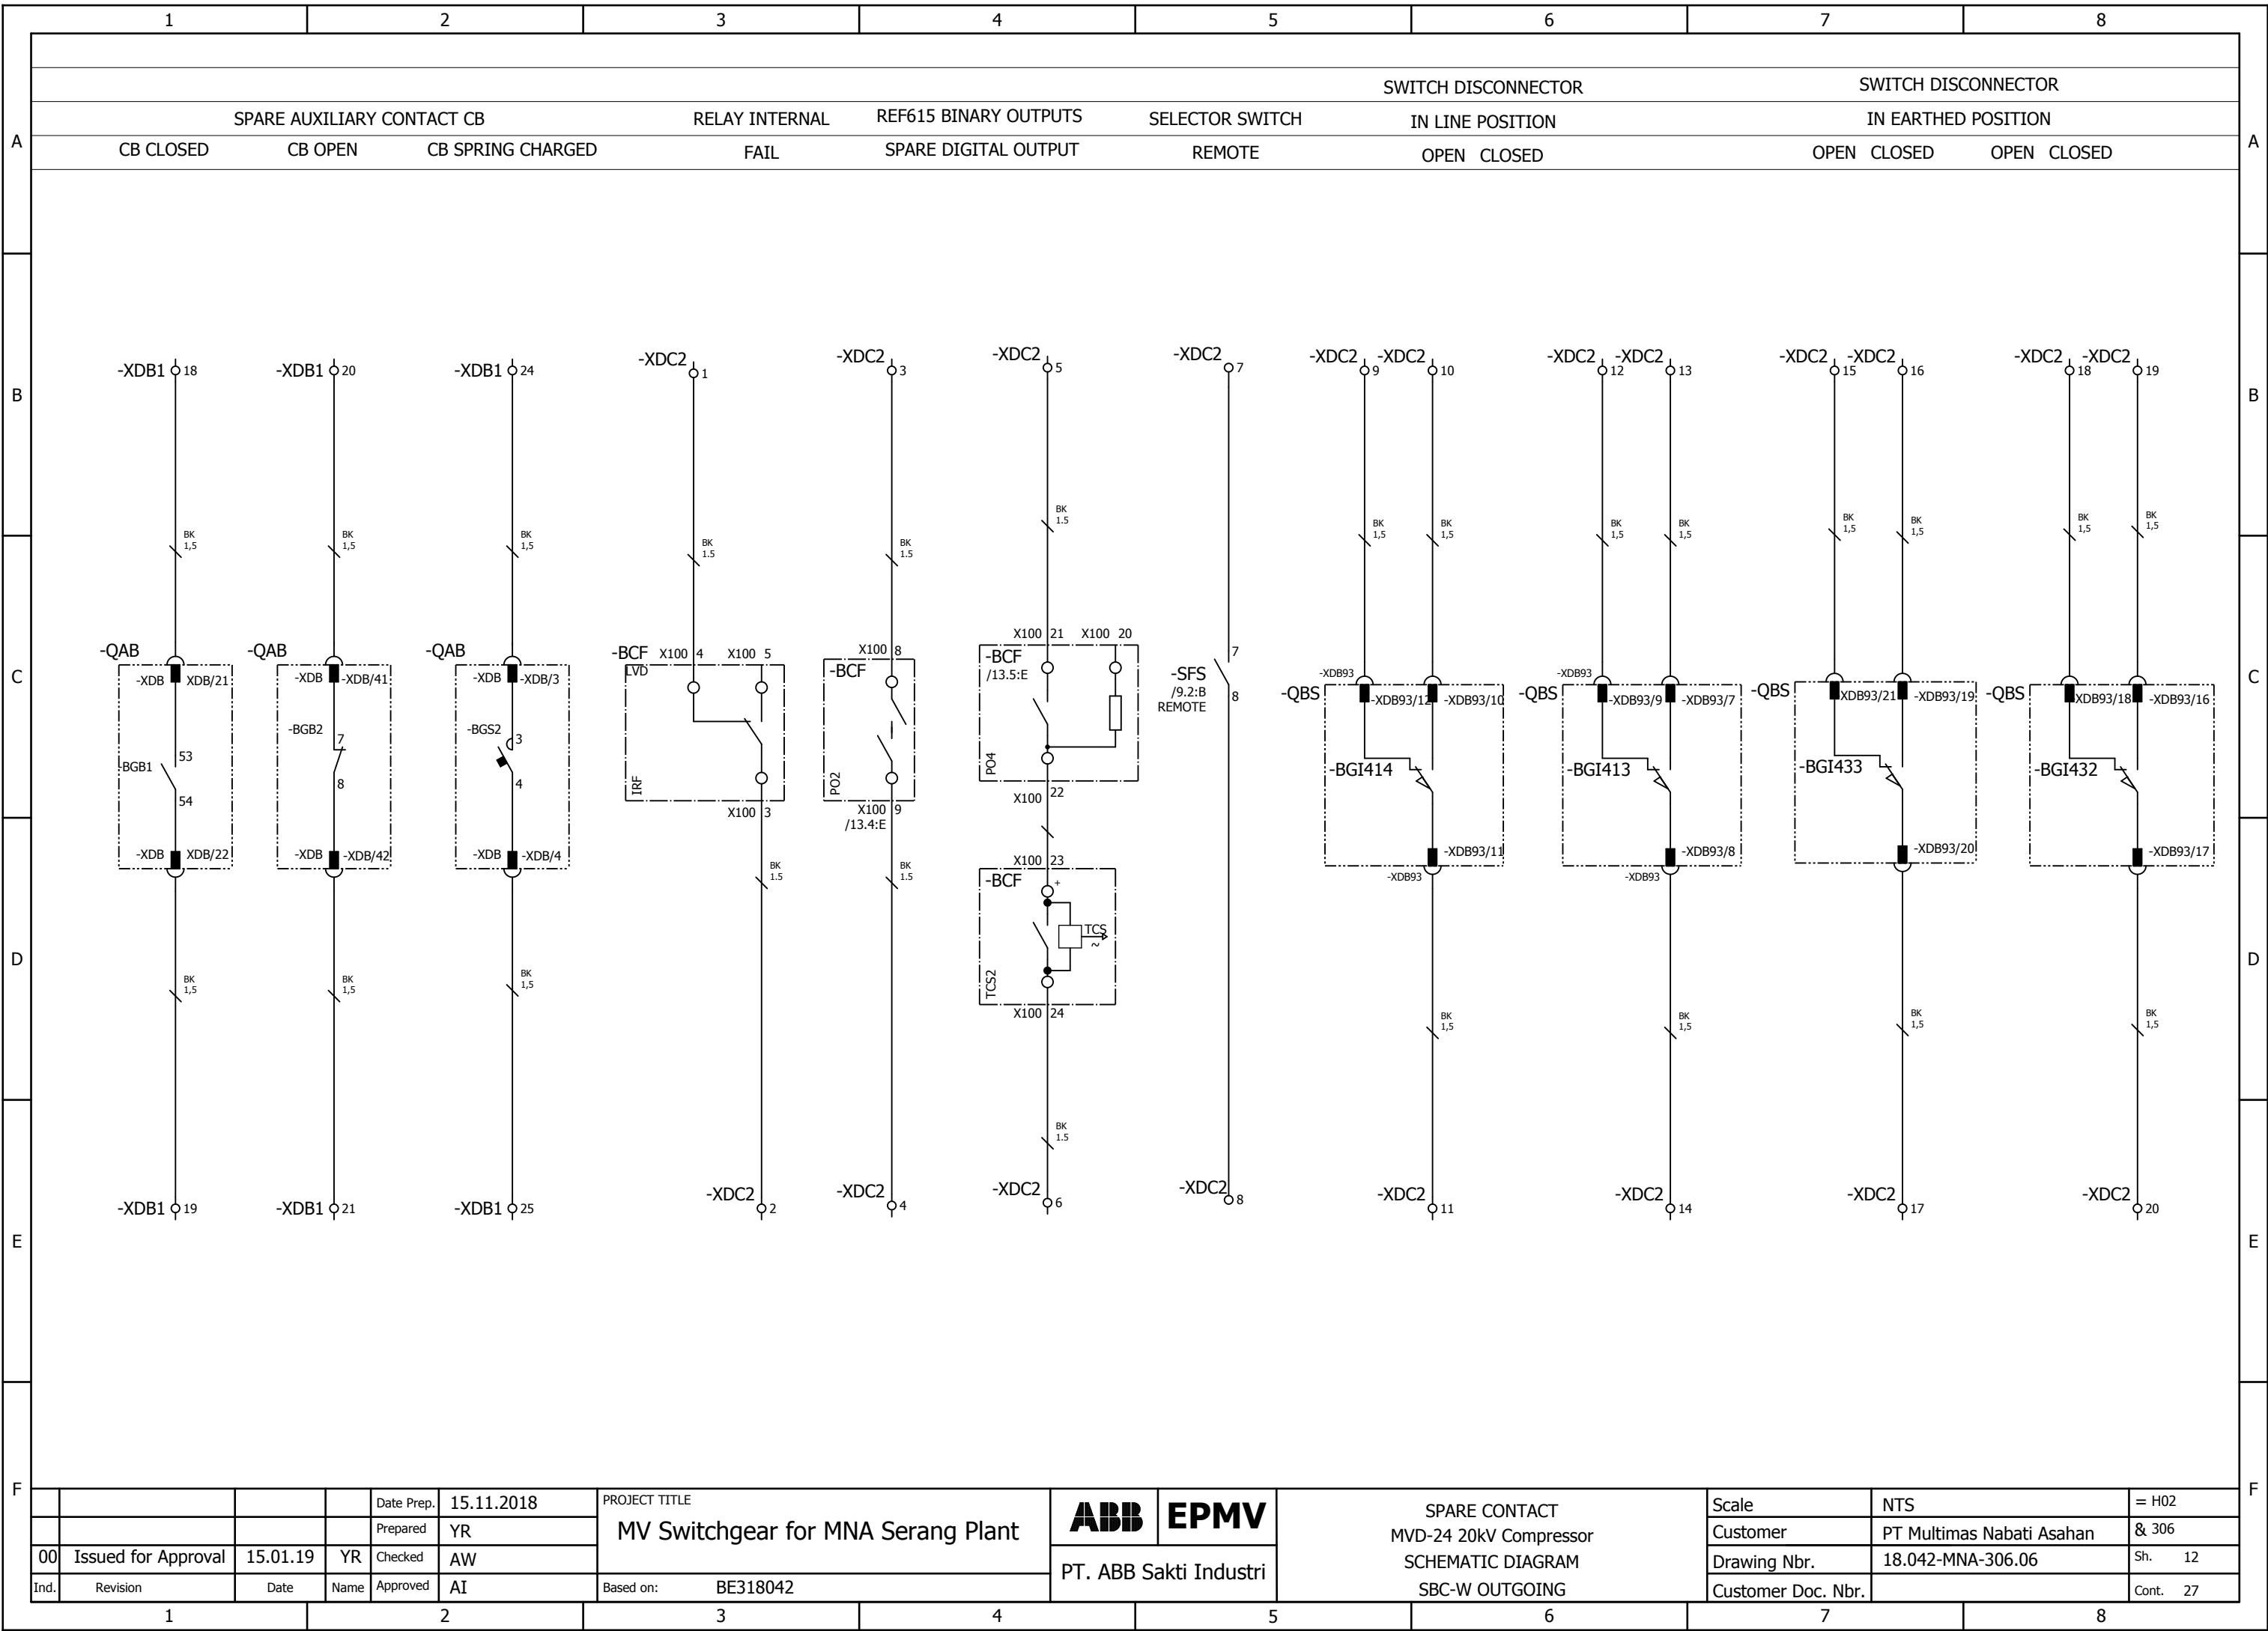

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

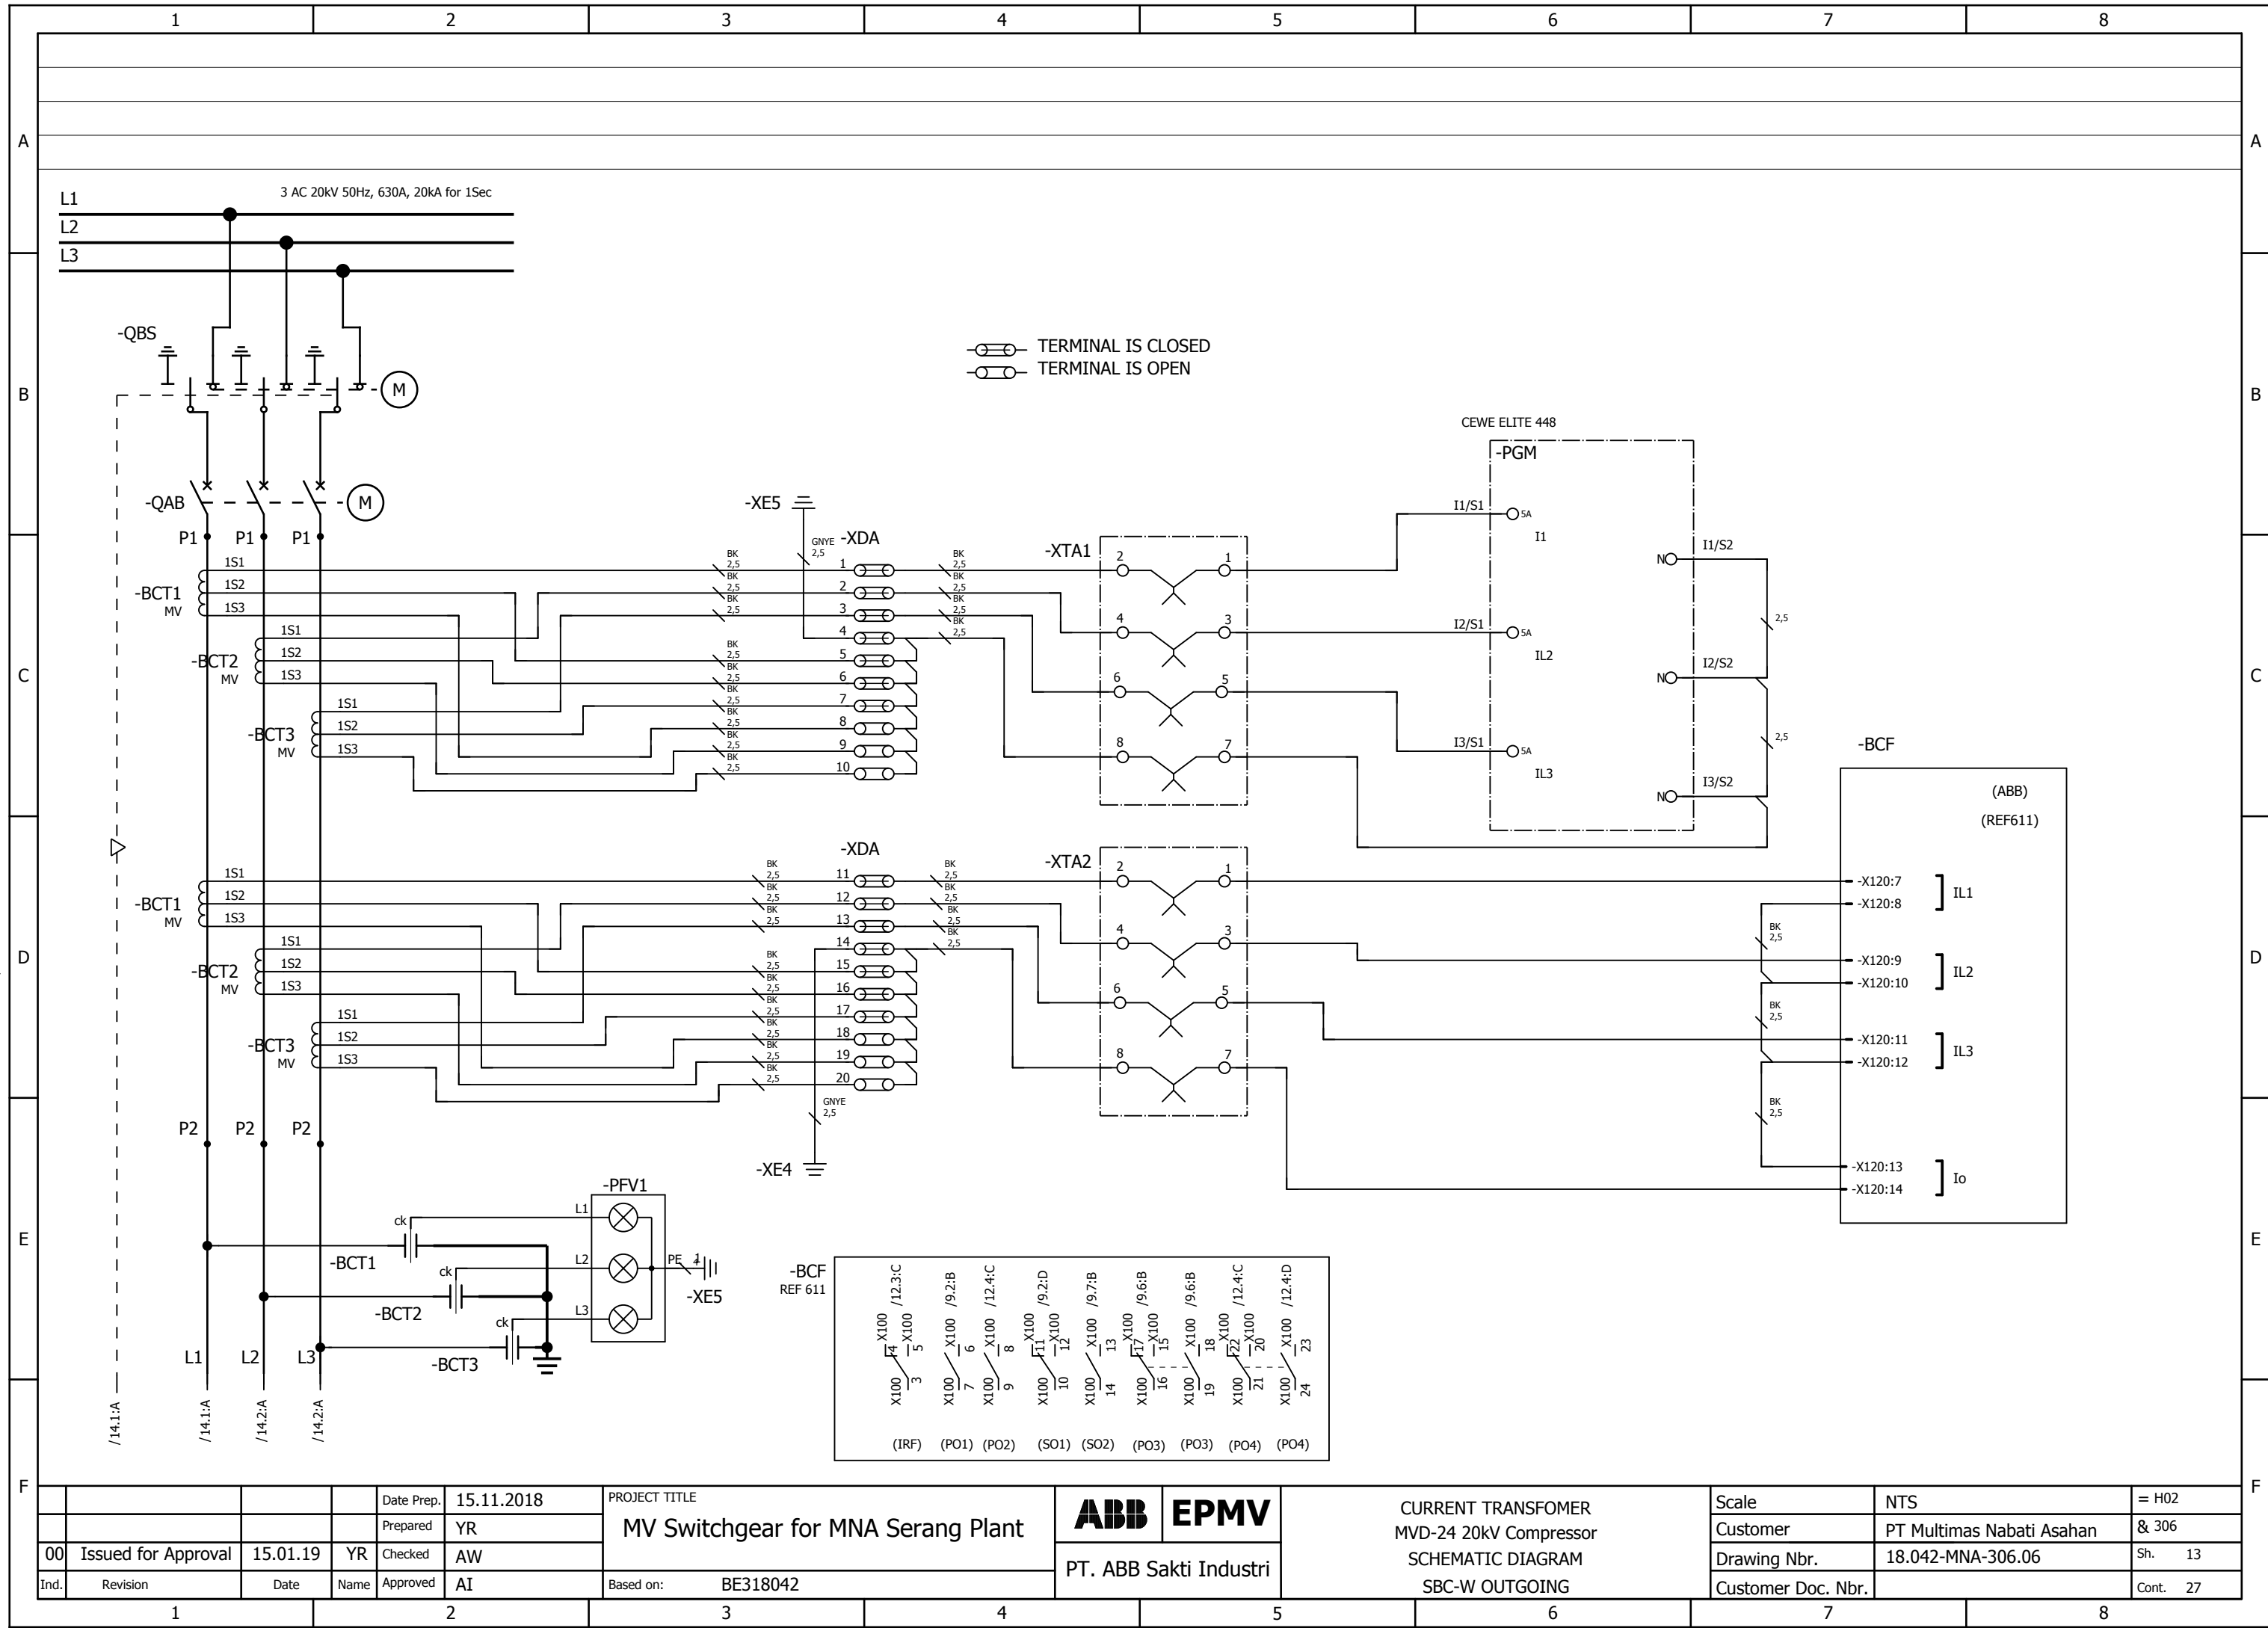


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

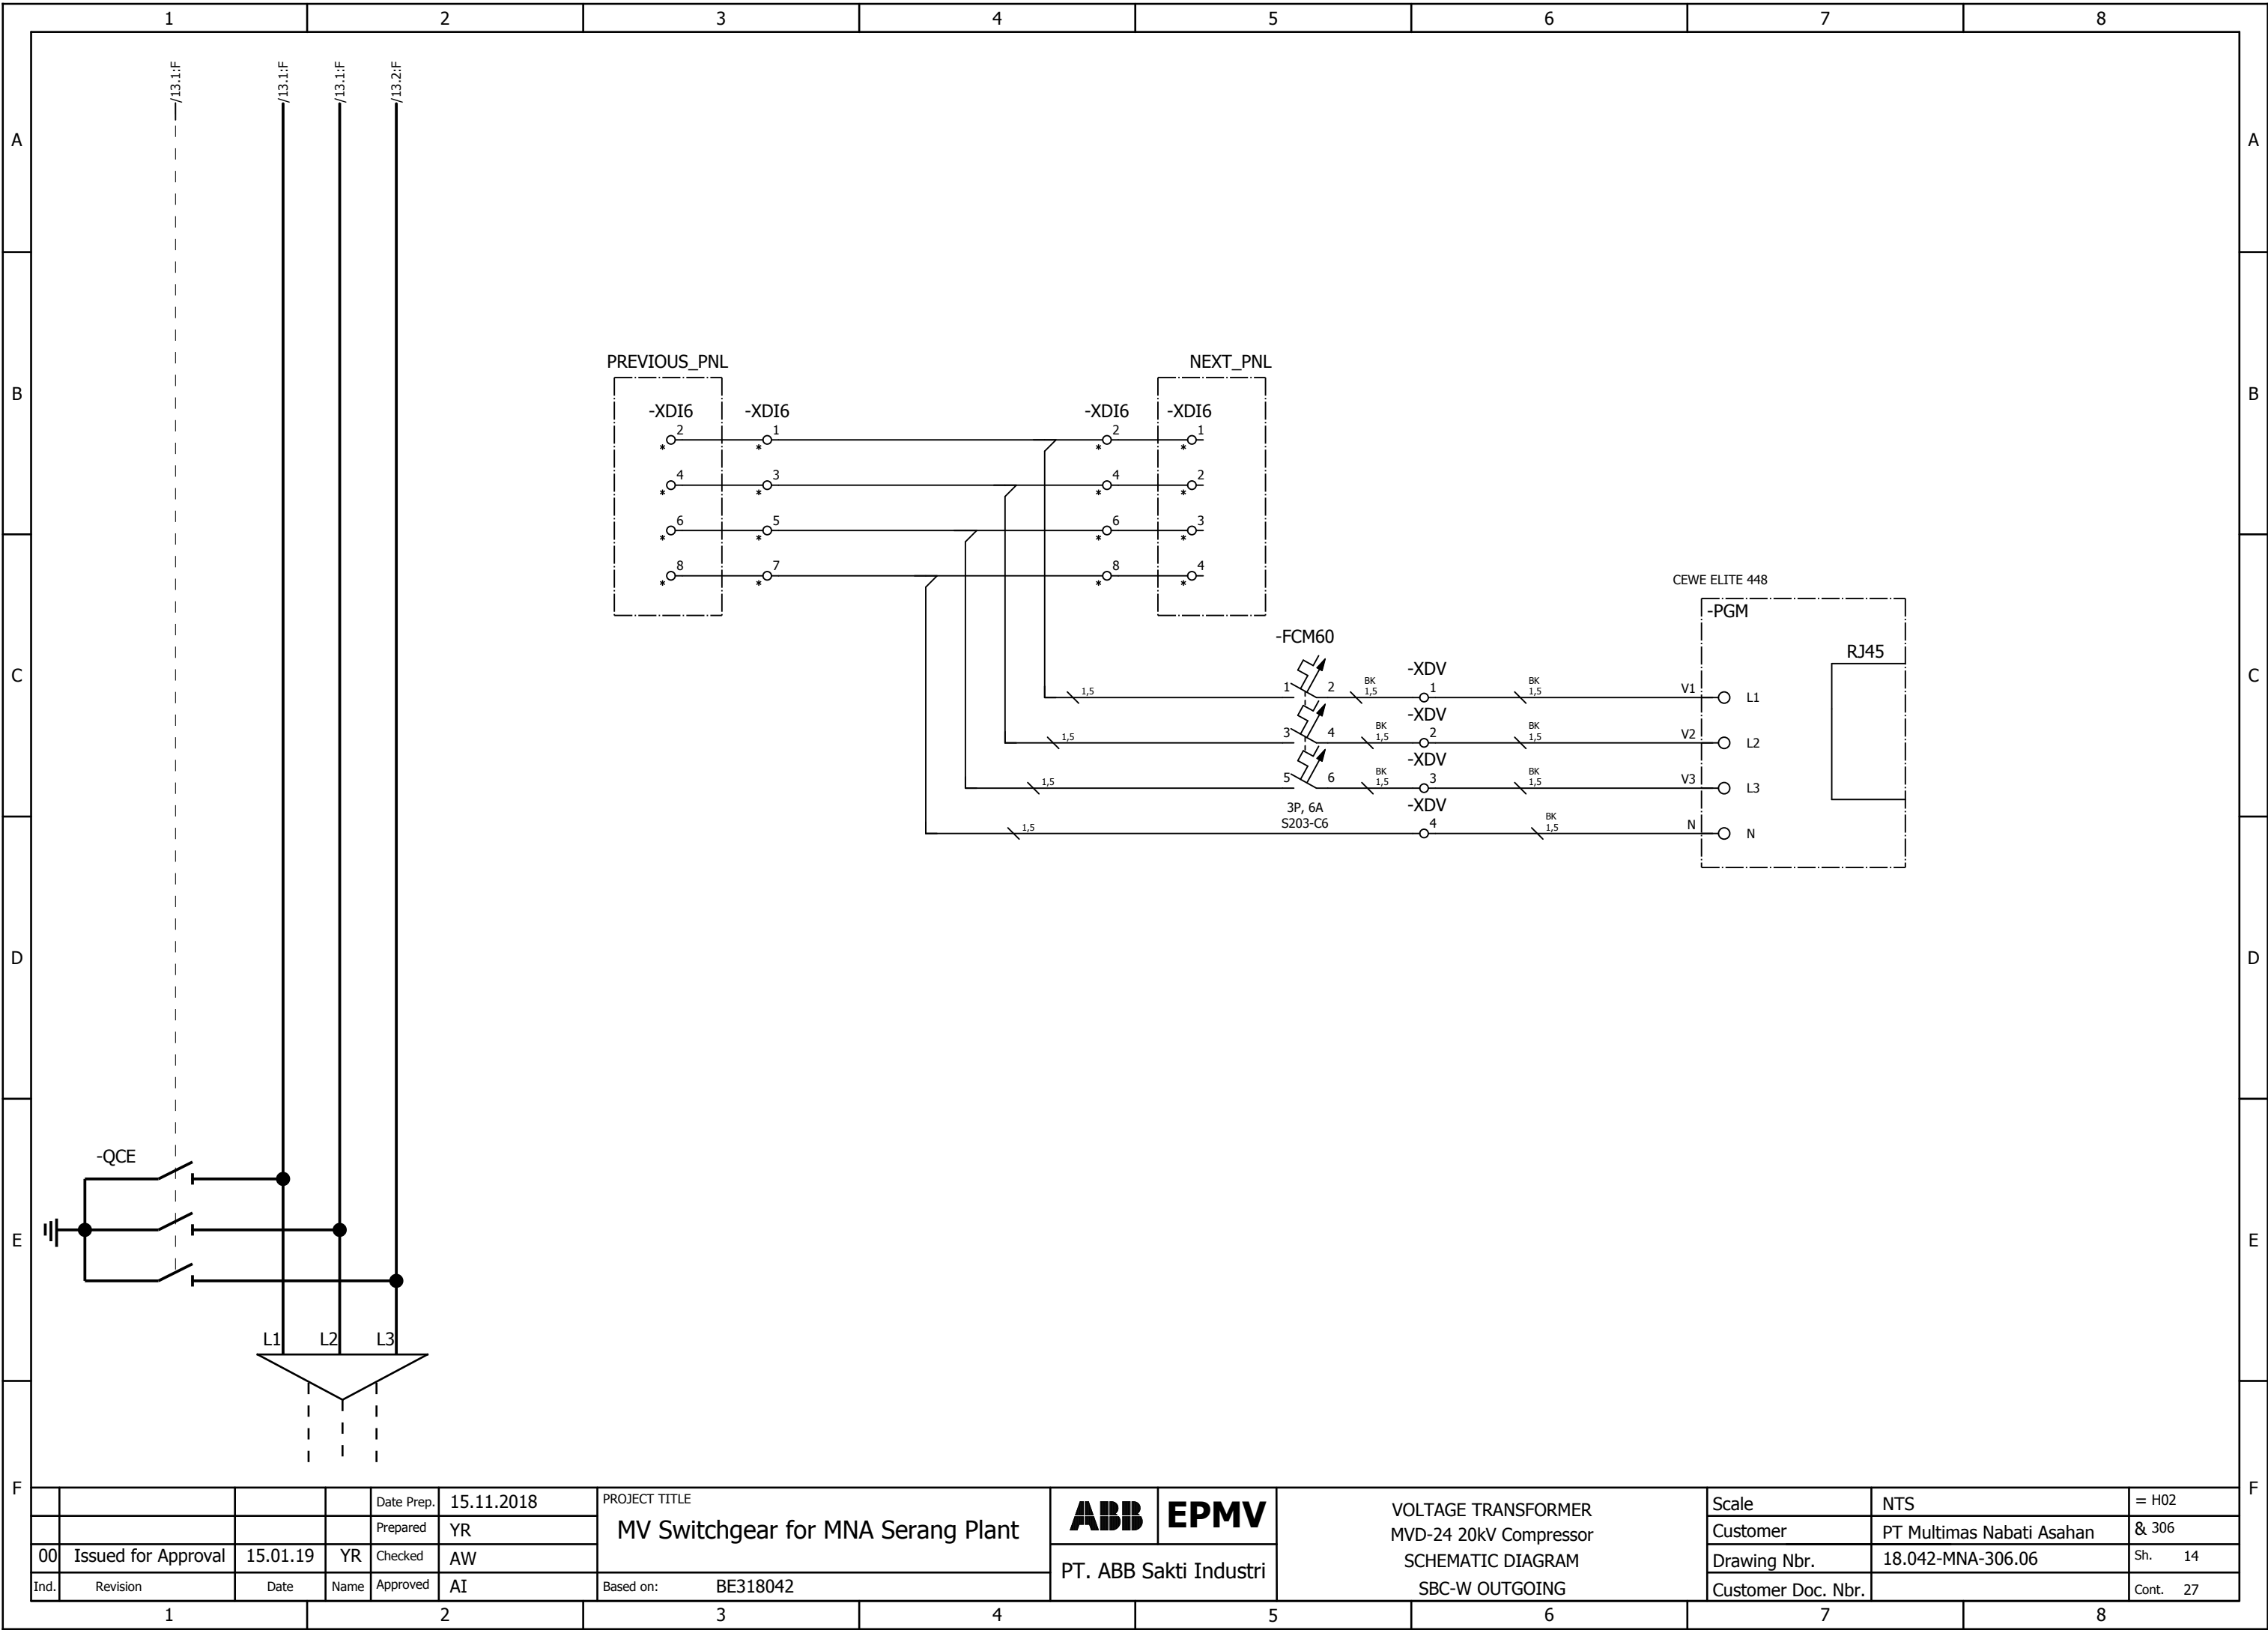

00	Issued for Approval	15.01.19	YR	Date Prep.	15.11.2018	PROJECT TITLE	MV Switchgear for MNA Serang Plant	Based on:	BE318042	ABB	EPMV	VOLTAGE TRANSFORMER MVD-24 20kV Compressor SCHEMATIC DIAGRAM SBC-W OUTGOING	Scale	NTS	= H02
				Prepared	YR								Customer	PT Multimas Nabati Asahan	& 306
				Checked	AW								Drawing Nbr.	18.042-MNA-306.06	Sh. 14
				Approved	AI								Customer Doc. Nbr.		Cont. 27

No.	EQUIPMENT DESCRIPTION	ENGRAVING
1	-SFS (LOCAL-OFF-REMOTE SELECTOR SWITCH, K&N)	-SFS, LOCAL-OFF-REMOTE
2	-SFC (PUSH BUTTON CB CLOSE, GREEN, ABB)	-SFC, CB CLOSE
3	-SFO (PUSH BUTTON CB OPEN, RED, ABB)	-SFO, CB OPEN
4	-PFY1 (LAMP INDICATION FOR CB TRIP, YELLOW, ABB)	-PFY1, CB TRIP
5	-PFR1 (LAMP INDICATION FOR CB CLOSE, RED, ABB)	-PFR1, CB CLOSE
6	-PFG1 (LAMP INDICATION FOR CB OPEN, GREEN, ABB)	-PFG1, CB OPEN
7	-PGJ (DIGITAL MEASUREMENT, CEWE 448)	-PGJ, DIGITAL MEASUREMENT
8	-BCF (FEEDER PROTECTION RELAY, REF615J, ABB)	-BCF, RELAY PROTECTION
9	-XTA1, XTA2 (TEST BLOCK , YONGSUNG)	-XTA, CURRENT TEST BLOCK

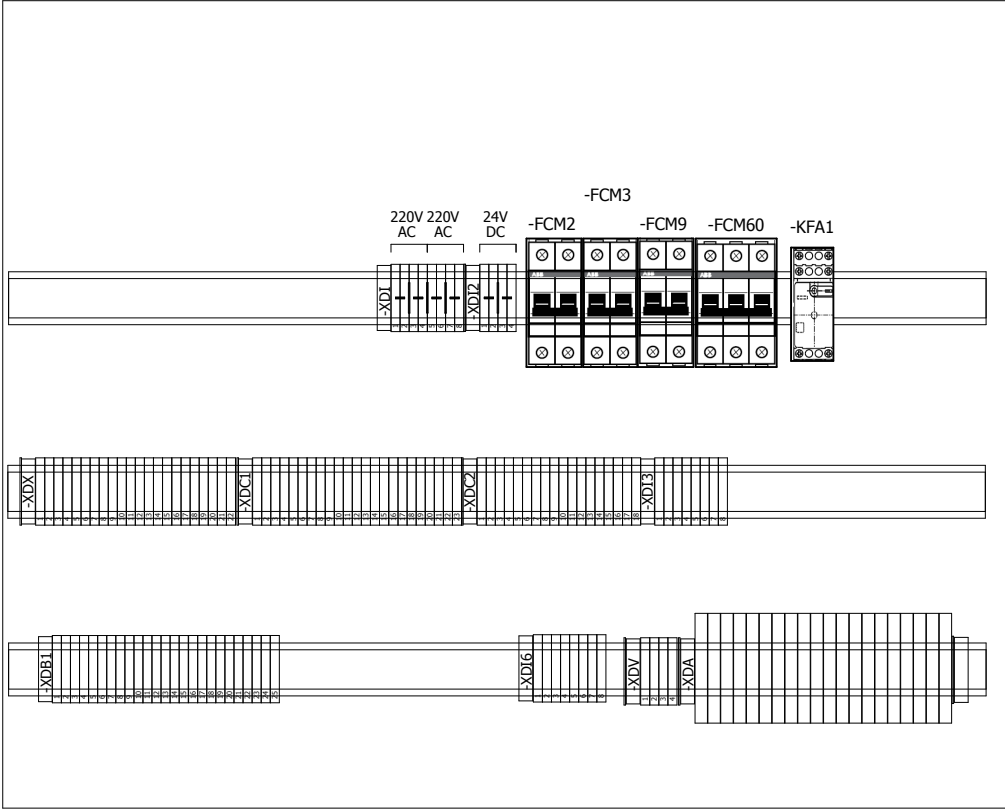[illegible]

				Date Prep.	15.11.2018	PROJECT TITLE MV Switchgear for MNA Serang Plant	ABB	EPMV	LV BOX LAYOUT MVD-24 20kV Compressor SCHEMATIC DIAGRAM SBC-W OUTGOING	Scale	NTS	= H02
				Prepared	YR							Customer
00	Issued for Approval	15.01.19	YR	Checked	AW					Drawing Nbr.	18.042-MNA-306.06	Sh. 16
Ind.	Revision	Date	Name	Approved	AI	Based on: BE318042	PT. ABB Sakti Industri			Customer Doc. Nbr.		Cont. 27

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

	1	2	3	4	5	6	7	8
A	Summarized parts list							IDABB_F02_005-IDABB
								Carry over: 0.00
B	TAG ID		DESCRIPTION		MANUFACTUR/BRAND	PART NUMBER	QUANTITY	REMARKS
	-BCF		Feeder Management Relay REF611HBAABC1NN11G		ABB	REF611HBAABC1NN11G	1	/8.2:C
B	-EB		HEATER 230VAC, 50W		SANYANG	CDXN010033P0009	1	/7.6:E
	-FCM2		MCB S202-C10 MCB. 2P, 10A		ABB	2CDS252001R0104	1	/7.2:C
	-FCM3;-FCM9		MCB S202-C6 MCB. 2P, 6A		ABB	2CDS252001R0064	2	/7.5:C;/7.6:C
	-FCM60		MCB S203-C6 MCB. 3P, 6A		ABB	2CDS253001R0064	1	/14.5:C
C	-KFA1		Auxiliary Relay 230AC 4COS		PHOENIX	1YRA3DL266230001	1	/9.7:E
	-PFG1		PILOT LIGHT GREEN #CL-523G#230VAC CL-523G		ABB	1SFA619402R5232	1	/8.5:E
	-PFR1		PILOT LIGHT RED #CL-523R#230VAC CL-523R		ABB	1SFA619402R5231	1	/8.4:E
	-PFY1		PILOT LIGHT YELLOW #CL-523Y#230VAC CL-523Y		ABB	1SFA619402R5233	1	/8.6:E
	-PGM1		POWER METER CEWE 448 Class : 0.5s; CT Input : 1A; VT Input : 57.7-240V (L-N); Aux. Voltage: 80-300VAC/DC		CEWE	1YRA4EA0350001	1	/8.3:C
D	-SFC		PUSH BUTTON, YW1B-M1E10-G GREEN COLOUR		IDEC	1YRA3DA14700001	1	/9.2:B
	-SFO		PUSH BUTTON, YW1B-M1E10-R RED COLOUR		IDEC	1YRA3DA14700002	1	/9.4:B
	-SFS		LOCAL/REMOTE Selector Switch Type : S0-CA10-A723-600-E; 4NC (for LOCAL Position) & 4NO (for REMOTE Position)		K&N	1YRA3DA17940011	1	/9.2:B
	-XTA1;-XTA2		Current Test Block Rated Current : 10A, 250V; Mounting : Flush Mounting		YONGSUNG	YSCTT-04C	2	/13.4:C;/13.4:D
E								
F								

[illegible]

F										E										D										C										B										A									

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]

F				E		D		C		B		A	
								==MVD-24=H02+-XDX					
REMARK		CABLE		EQUIPMENT		Wire No		Terminal number		TYPE		WIRE NO.	
BK 1,5 mm²				-XDB1:16				● 1		PT 2.5			
BK 1,5 mm²				-BCF:-X100:1				● 2		PT 2.5		-FCM2:2	
BK 1,5 mm²				-XDB1:6				● 3		PT 2.5			
BK 1,5 mm²				-XDB1:7				● 4		PT 2.5			
				-KFA1:14				● 5		PT 2.5			
				-XDB1:10				● 6		PT 2.5			
				-XDB1:12				● 7		PT 2.5			
				-KFA1:24				● 8		PT 2.5			
BK 1,5 mm²				-SFS:2				● 9		PT 2.5			
BK 1,5 mm²				-BCF:X100:16				● 10		PT 2.5			
				-BCF:X100:14				● 11		PT 2.5			
								● 12		PT 2.5			
BK 2,5 mm²				-QBS-KFU-XDB97:16				● 13		PT 2.5			
BK 1,5 mm²				-FCM2:4				● 14		PT 2.5		-XDB1:17	
								● 15		PT 2.5		-BCF:-X100:2	
								● 16		PT 2.5		-PFR1:X2	
								● 17		PT 2.5		-XDC1:17	
								● 18		PT 2.5		-XDB1:2	
								● 19		PT 2.5		-XDB1:4	
								● 20		PT 2.5		-KFA1:A2	
								● 21		PT 2.5			
								● 22		PT 2.5		-QBS-KFU-XDB97:17	