


End User:	PT WILMAR NABATI INDONESIA
Customer:	PT WILMAR NABATI INDONESIA
P.O No.:	8102039980 / 8102039732 / 8102049029/ 8102087188 / 8102086755
Project Name:	WILMAR SURABAYA FA/SN/TOH EXPANSION/ BD3/PFAD


SYSTEM CONFIGURATION
WSNABATI-D01-001

CUSTOMER APPROVAL					
APPROVED BY:			DATE:		
	FOR INFORMATION ONLY			APPROVED WITH COMMENTS PROCEED WITH PURCHASING/FABRICATION	
	APPROVED WITH NO COMMENTS PROCEED WITH PURCHASING/FABRICATION			DO NOT PROCEED WITH PURCHASING/FABIRICATION	
5	5-10-2012	SN & TOH expansion	Yip	Yong	Yong
4	16-08-2012	PFAD updated	Yip	Yong	Yong
3	29-07-2012	BD3 updated	Yip	Yong	Yong
2	31-10-2011	FAL	HAFIZ	Rashida	Rashida
1	05-08-2011	ME#2 Expansion	HAFIZ	YONG	YONG
0	11-04-2011	Issue for Approval	HAFIZ	YONG	YONG
REV	DATE	DESCRIPTION	PREPARED	CHECKED	APPROVED


Revision History	
Rev No.	Description
0	Issue for Approval
1	ME#2 EXPANSION
2	FAL
3	BD3 updated
4	PFAD updated
5	SN & TOH expansion

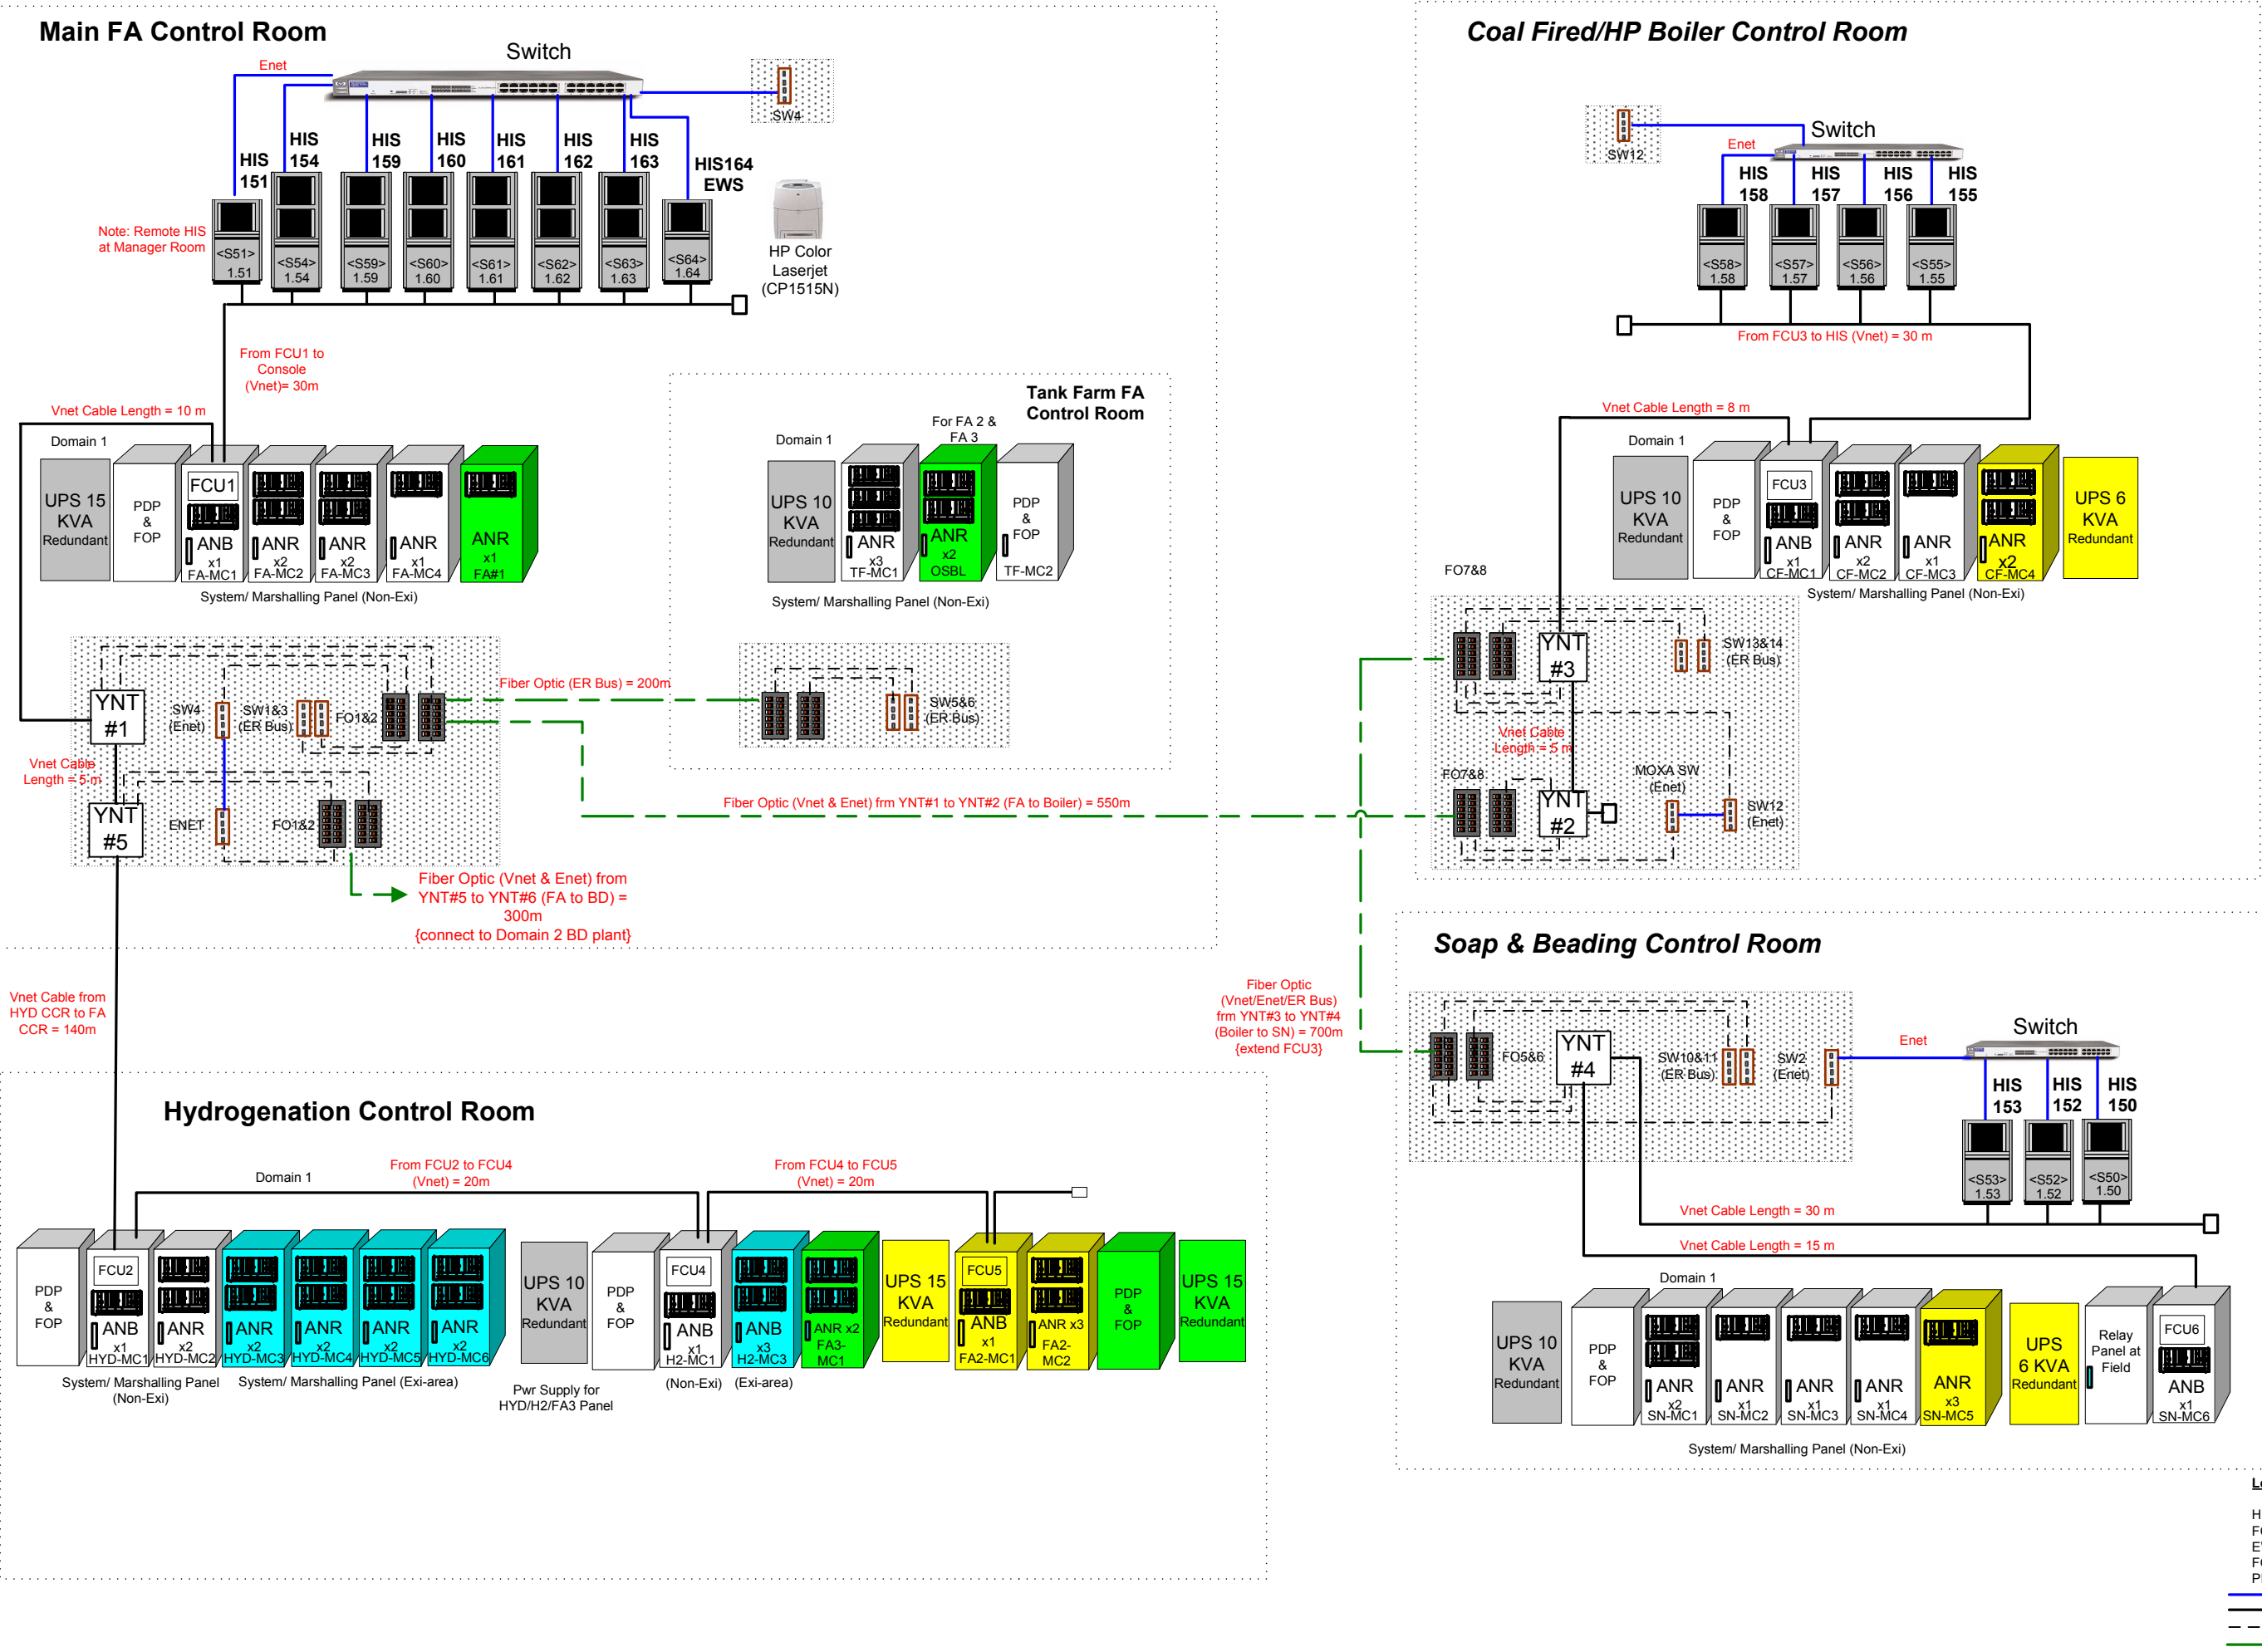

BD Central Control Room

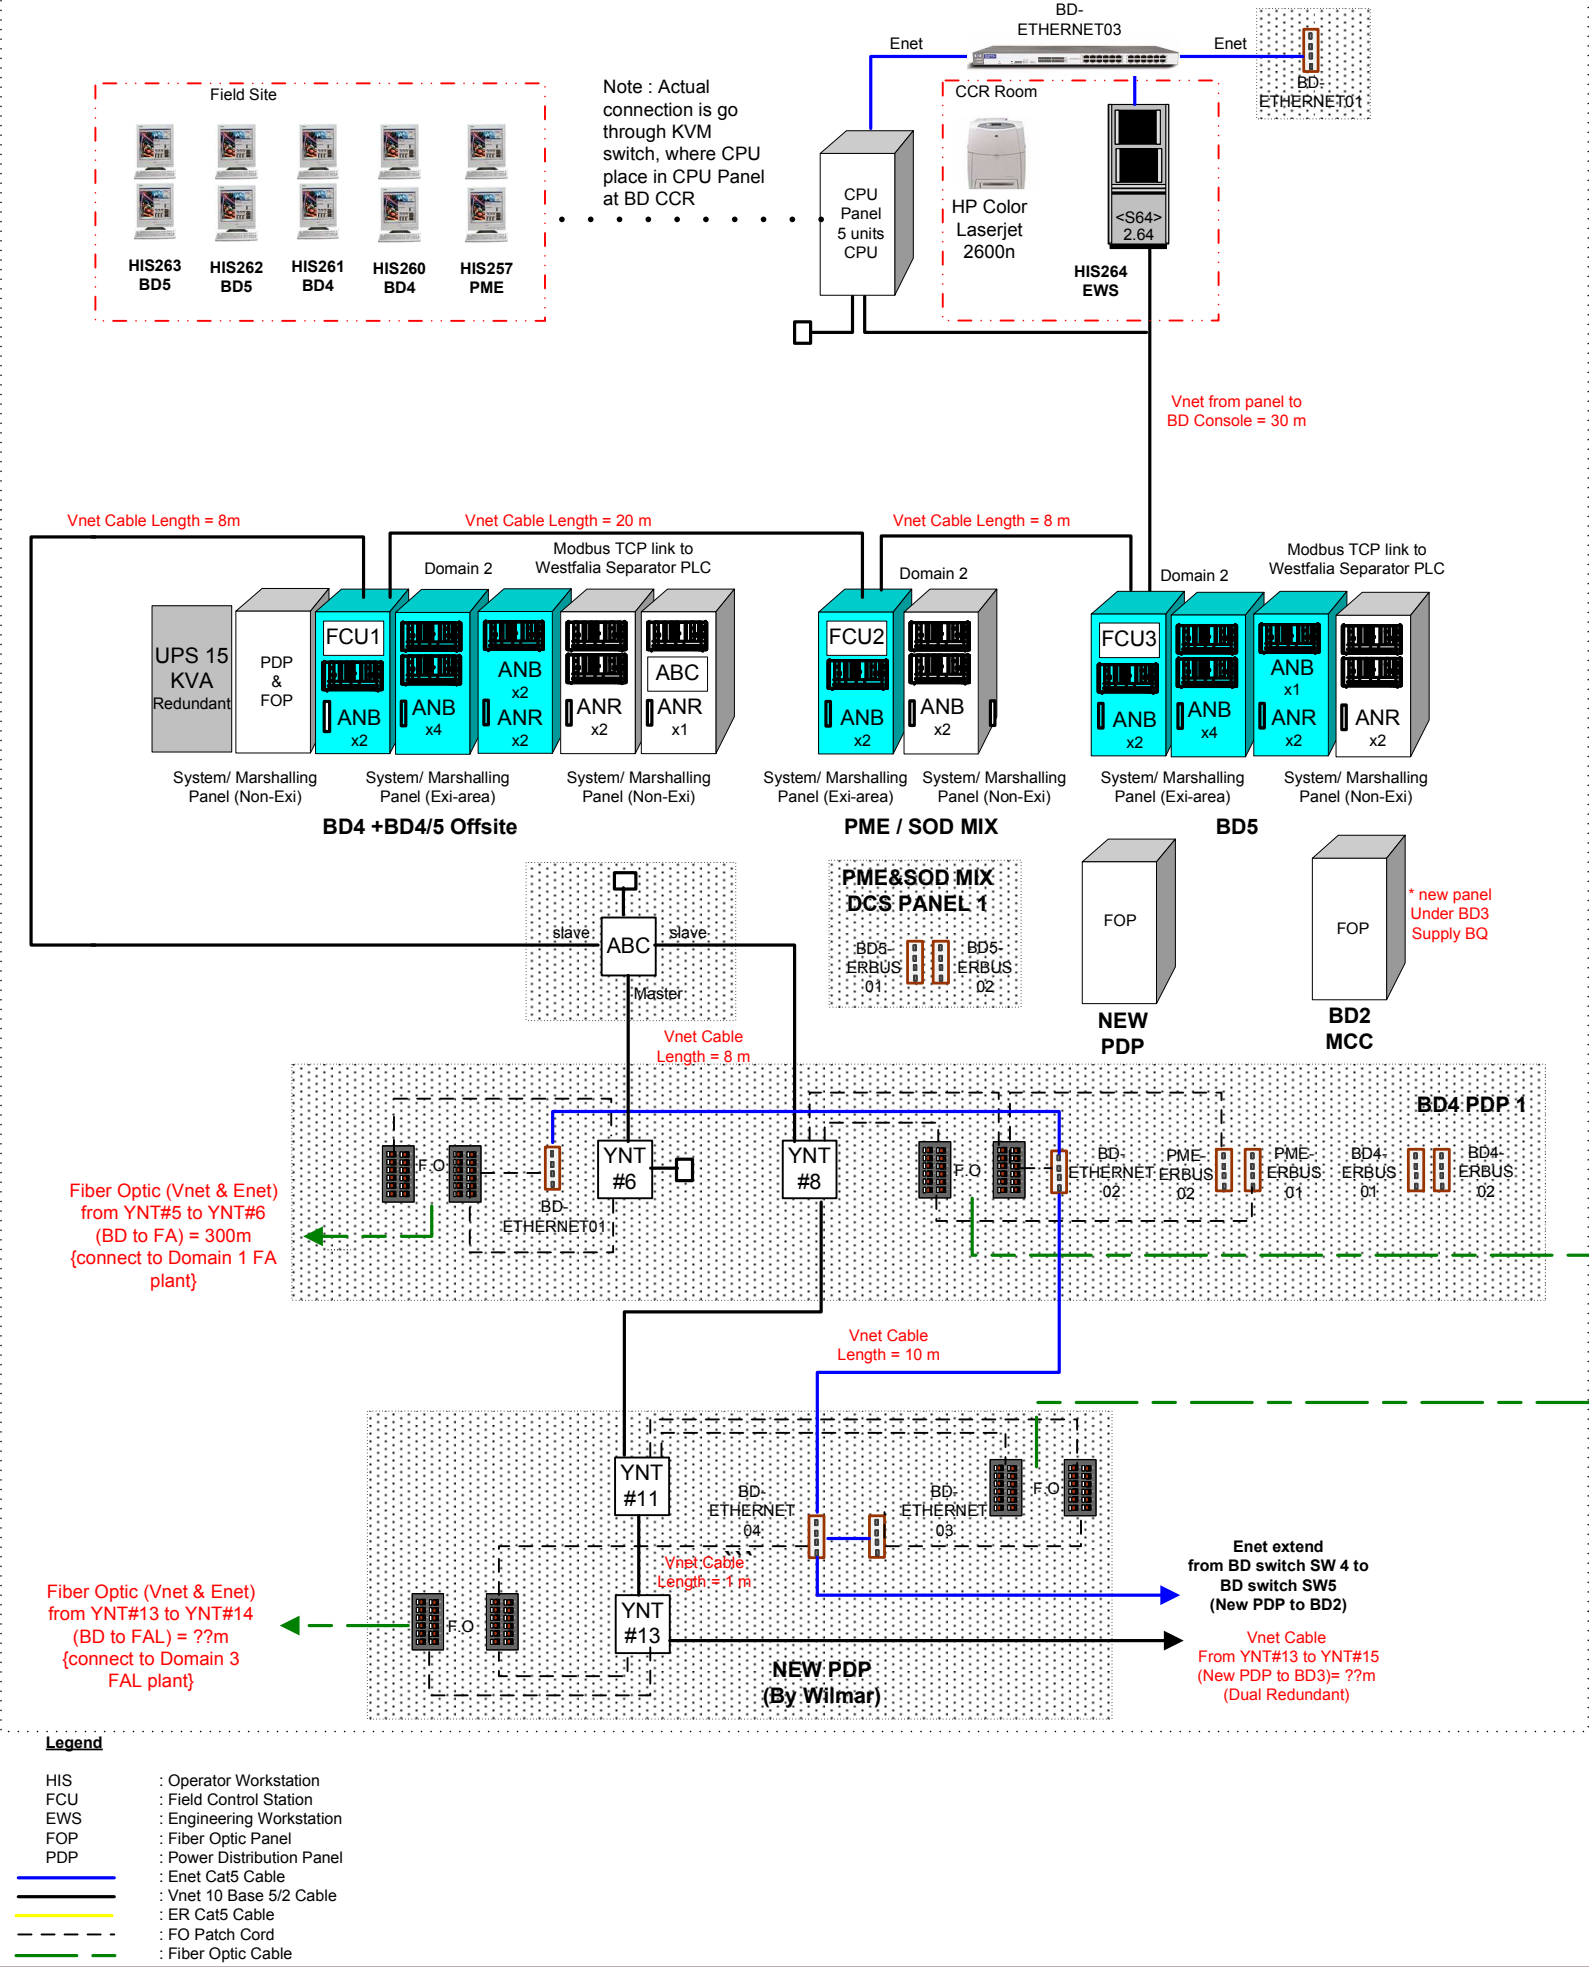


MES Central Control Room

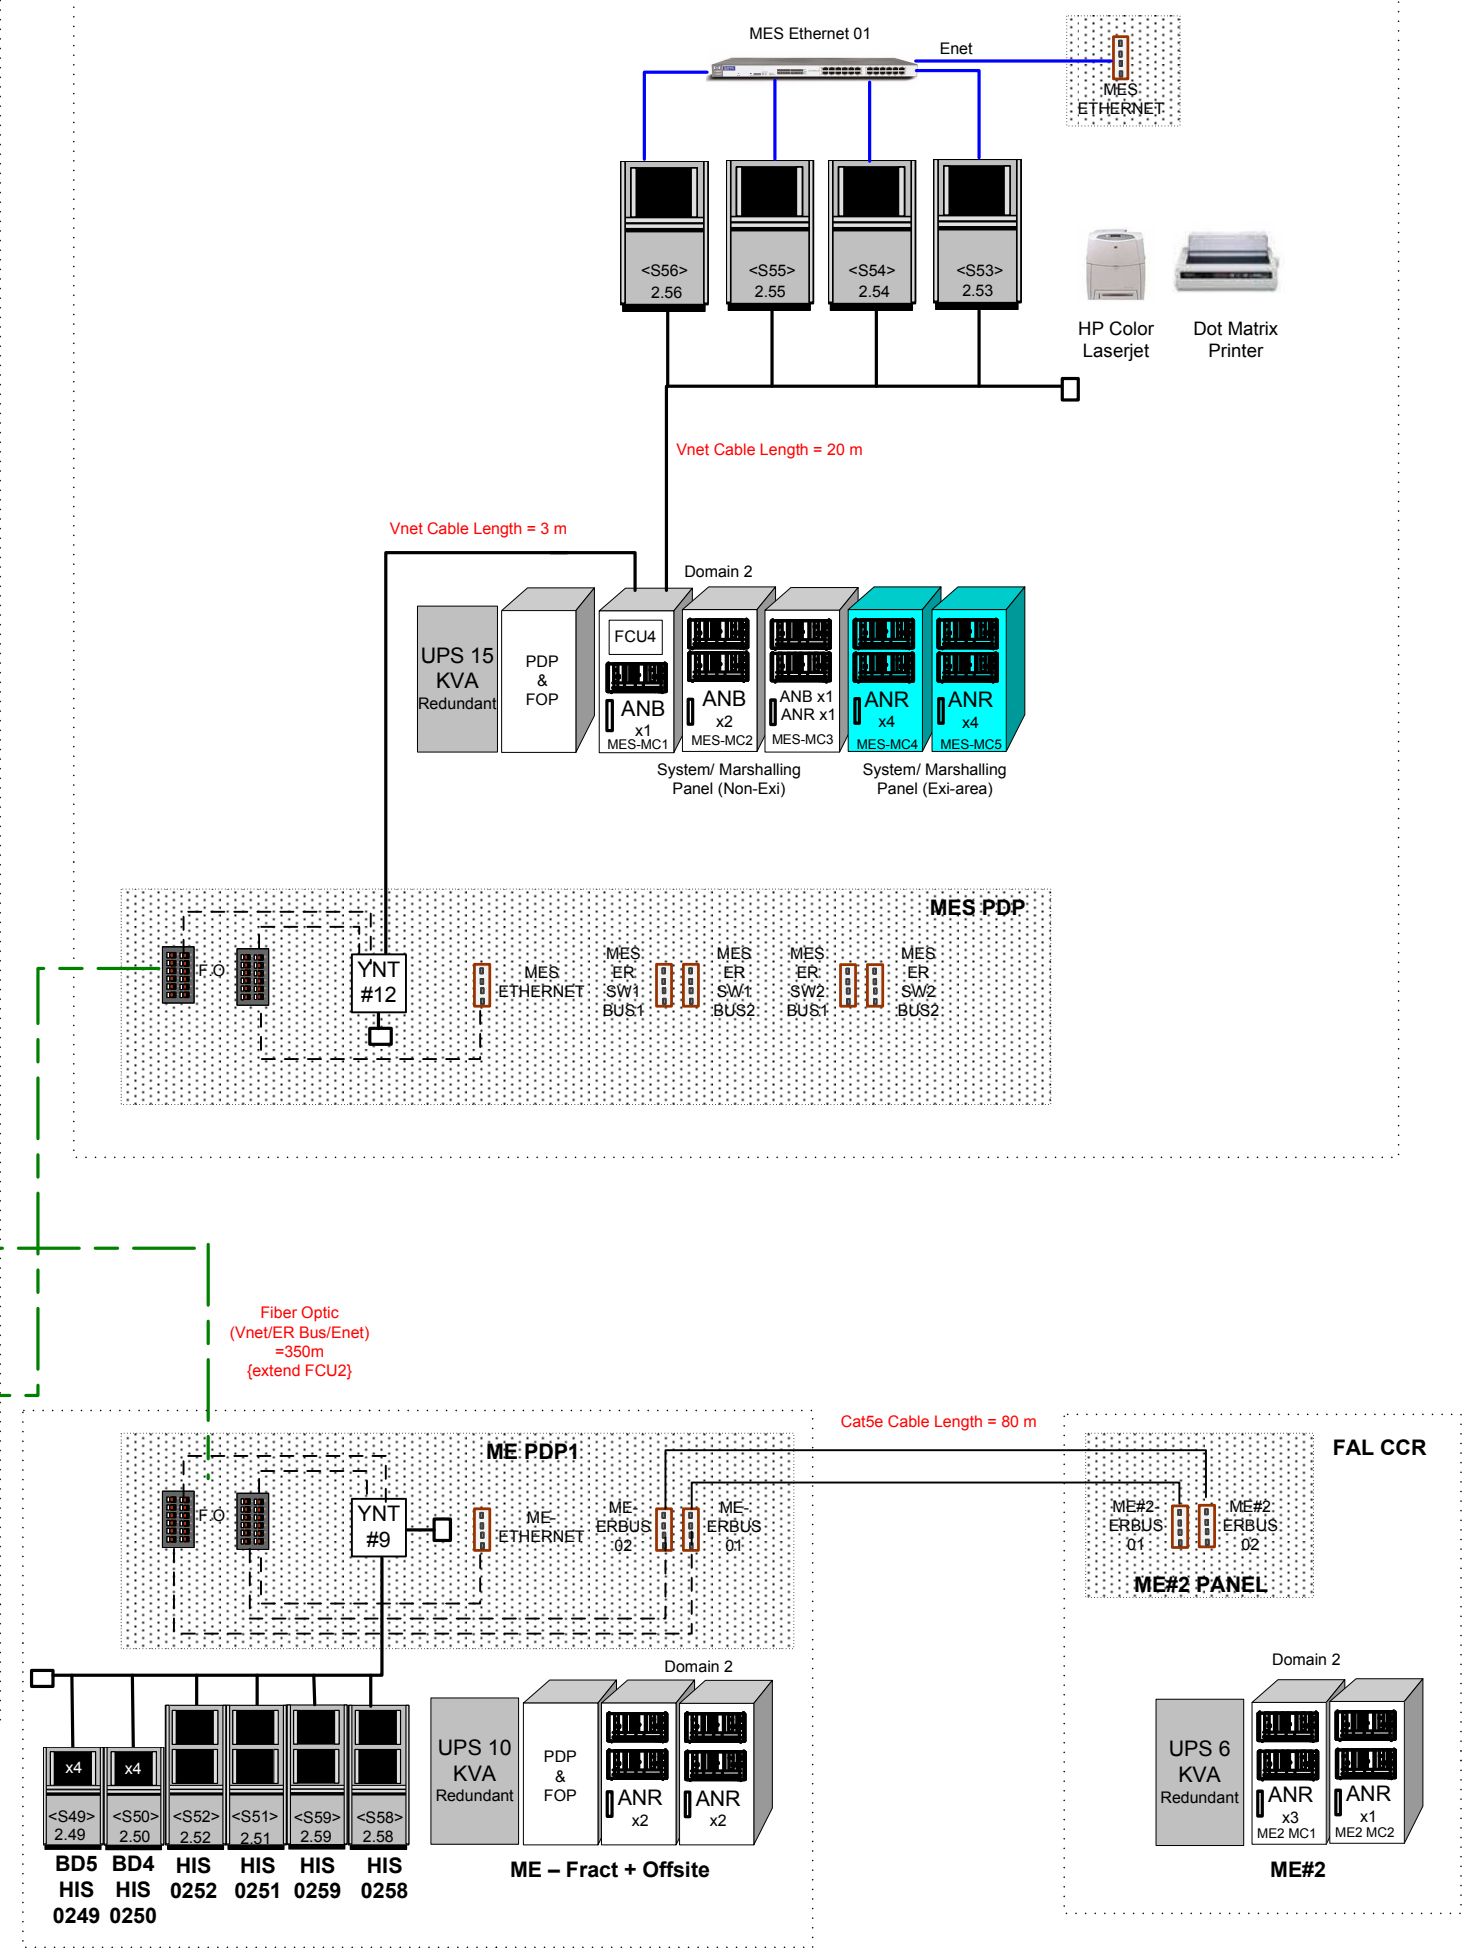





Domain 2

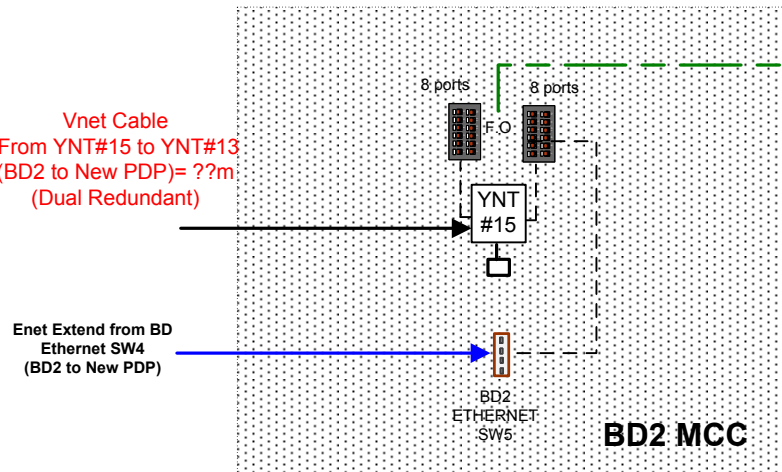

* new panel
Under BD3
Supply BQ

BD#3 Central Control Room


Domain 5

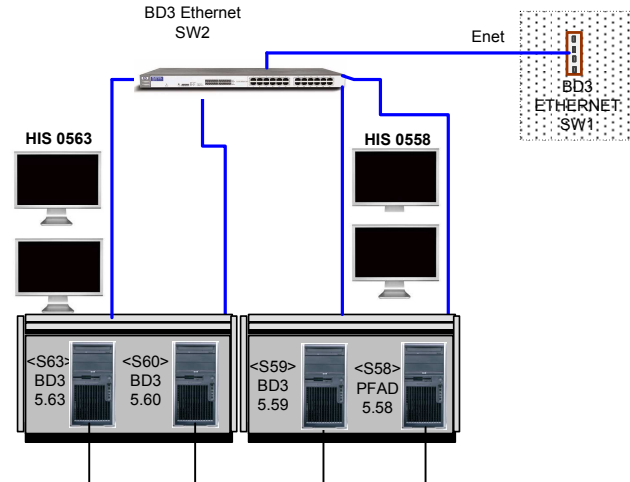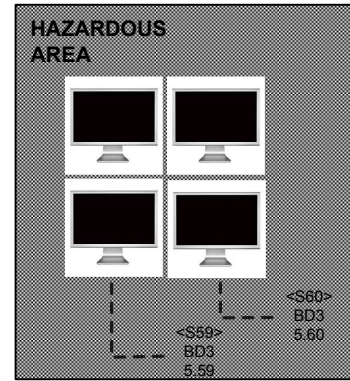

Vnet Cable Length = 3 m
(Redundant)

Vnet Cable Length = 20 m
(Redundant)


Fiber Optic (Vnet/Enet)
=?m (Dual)

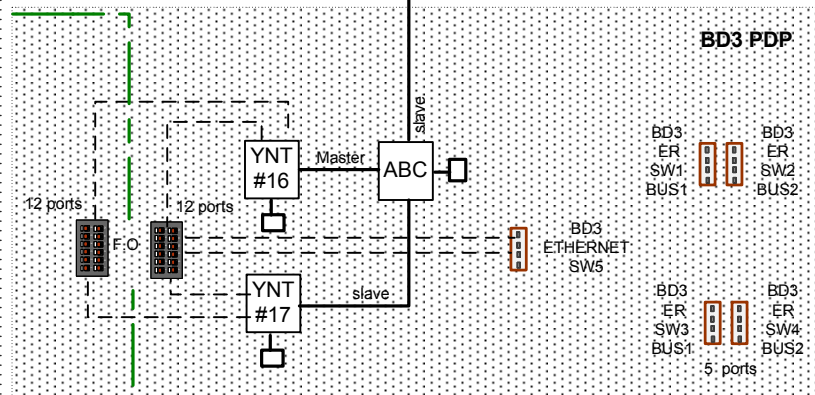

Fiber Optic (Vnet/Enet)
=?m (Dual)
Extend to PFAD

Vnet Cable Length = 3 m
(Dual Redundant)

Vnet Cable Length = 40 M
(Dual Redundant)

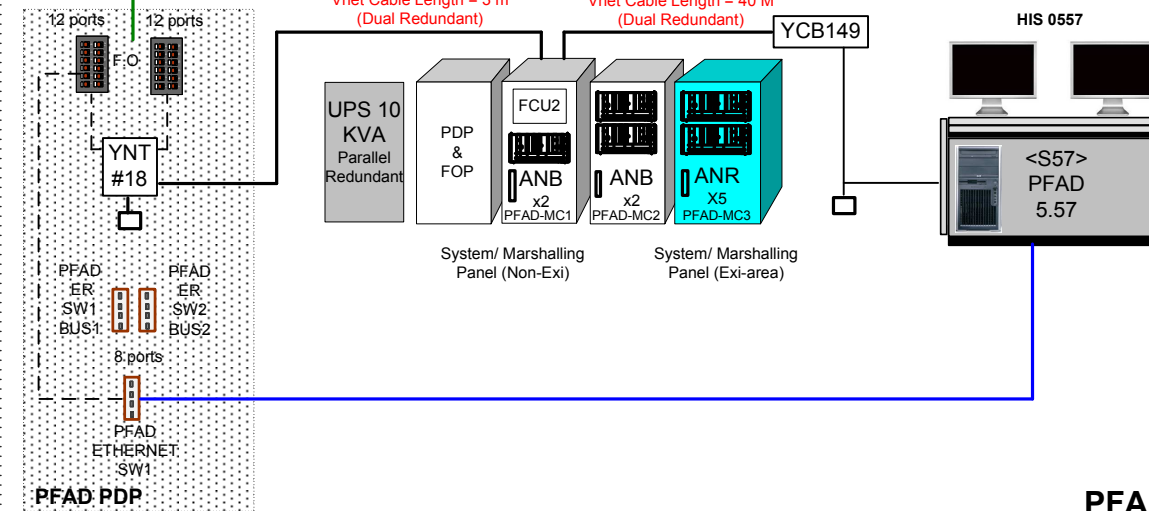

PFAD MCC

Legend

- HIS : Operator Workstation
- FCU : Field Control Station
- EWS : Engineering Workstation
- FOP : Fiber Optic Panel
- PDP : Power Distribution Panel
- Enet Cat5 Cable
- Vnet 10 Base 5/2 Cable
- FO Patch Cord
- Fiber Optic Cable