




CAPASITOR BANK  
12 X 80KVAR 525VOLT

REGULATOR 12 STEP

|                                          |  |                                                   |  |                 |  |                        |  |                        |  |                       |  |                       |  |
|------------------------------------------|--|---------------------------------------------------|--|-----------------|--|------------------------|--|------------------------|--|-----------------------|--|-----------------------|--|
| Customer :<br>PT. MULTIMAS NABATI ASAHAN |  | Judd :<br>PFC-20A (Boiler #1)                     |  | Revisi :<br>-   |  | Tanggal :<br>9 Juli 19 |  | Digambar Oleh :<br>DJS |  | Diperiksa Oleh :<br>- |  | Disetujui Oleh :<br>- |  |
| Nama Proyek :<br>MNA - 01 - 1814         |  | 12 STEP X 80KVAR 525V (CT 4000/5A)                |  | -               |  | -                      |  | -                      |  | -                     |  | -                     |  |
| No. Doc. :<br>PRD 15-01-19 B1            |  | No. Dwg. :<br>DWG 15-01-19 B1                     |  | Dimensi :<br>mm |  | Skala :<br>-           |  | NTS                    |  | -                     |  | -                     |  |
| PT. ANDALAS CITRA ELEKTRINDO             |  | Toleransi Dimensi Panel Free Standing :<br>+/- 1% |  | -               |  | -                      |  | -                      |  | -                     |  | -                     |  |
|                                          |  | Toleransi Dimensi Panel Wall Mounting :<br>+/- 2% |  | -               |  | -                      |  | -                      |  | -                     |  | -                     |  |
|                                          |  |                                                   |  |                 |  |                        |  |                        |  |                       |  | Halaman :<br>1/3      |  |

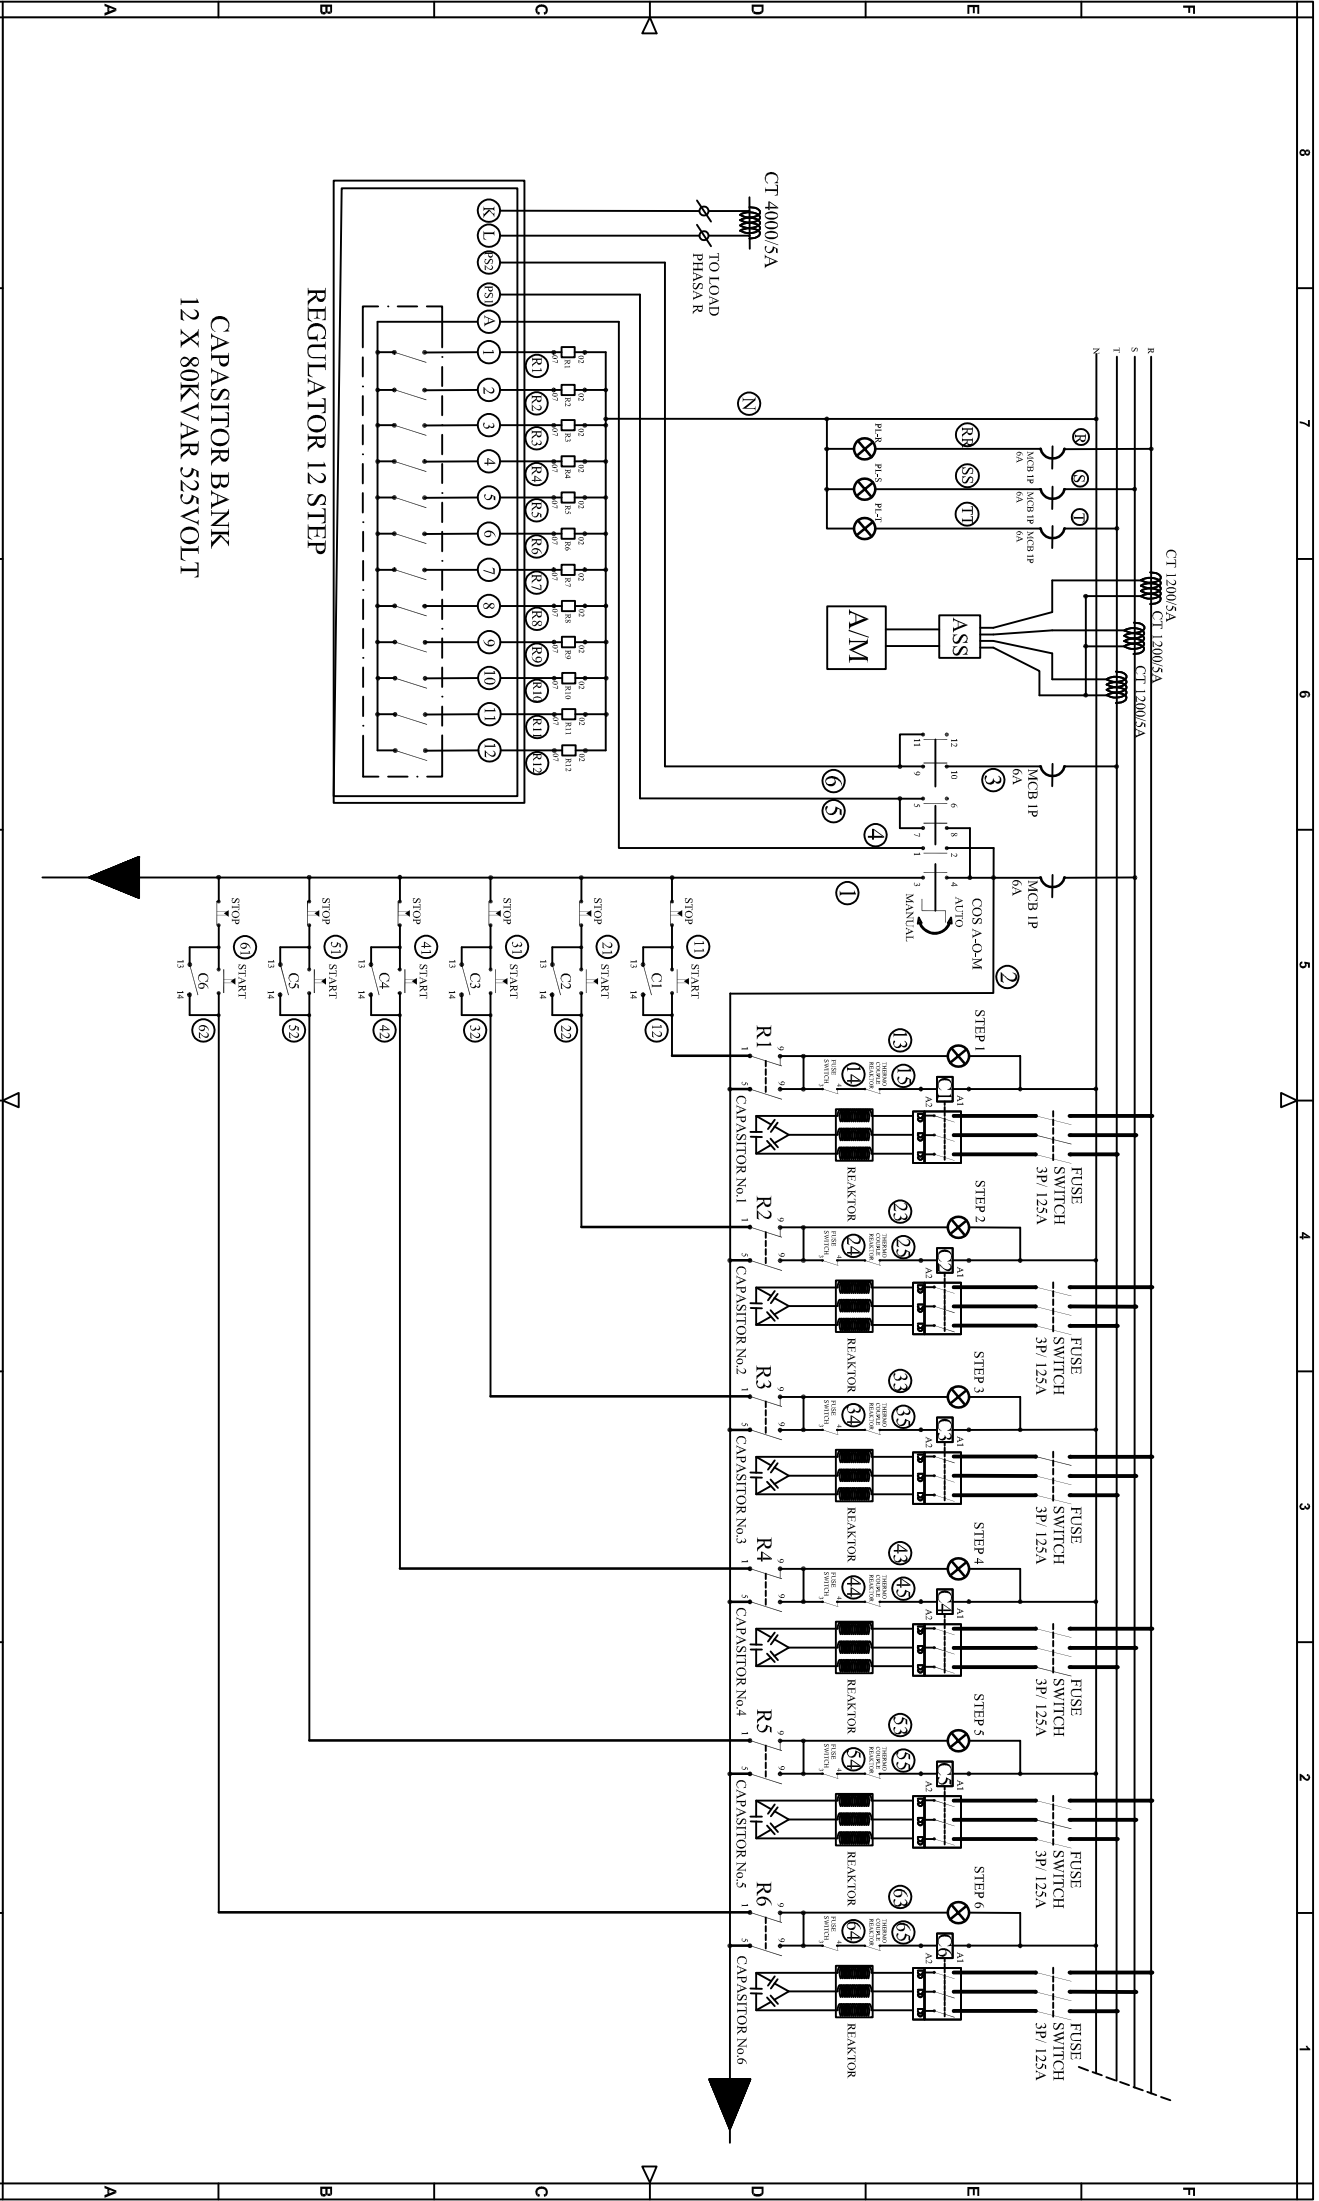