

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

1		2		3		4		5		6		7		8							
A																					
B																					
C																					
D																					
E																					
F																					
UniSec Medium Voltage Switchgear PT MULTIMAS NABATI ASAHAN MVD-25 & MVD-26 20kV Centralized Panel Room MNA SCHEMATIC DIAGRAM SBS-W BUS TIE H08																					
				Date Prep.		15.11.2018		PROJECT TITLE				COVER SHEET		Scale		NTS		= H08			
				Prepared		YR		MV Switchgear for MNA Serang Plant				ABB EPMV		MVD-25 & MVD-26 20kV Centralized Panel Room MNA		Customer		PT Multimas Nabati Asahan & 307			
00		Issued for Approval		15.01.19		YR		Checked		AW		PT. ABB Sakti Industri				SCHEMATIC DIAGRAM		Drawing Nbr.		18.042-MNA-307.07 Sh. 1	
Ind.		Revision		Date		Name		Approved		AI		Based on: BE318042				SBS-W BUS TIE		Customer Doc. Nbr.		Cont. 27	
1		2		3		4		5		6		7		8							

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

A	-MAE	MOTOR FOR ELECTRICAL OPERATION OF EARTHING SWITCH -QCE	-QBH	MANUAL CIRCUIT-BREAKERS
	-MAE1	MOTOR FOR ELECTRICAL OPERATION OF EARTHING SWITCH -QCE1 OR -QCE2	-QBL	LINKS
	-MAE8	MOTOR FOR ELECTRICAL OPERATION OF EARTHING SWITCH -QCE SUPPLIED TOGETHER WITH SWITCH-DISCONNECTOR -QBS	-QBM	MINIATURE SWITCH-DISCONNECTORS
	-MAS	MOTOR FOR CIRCUIT-BREAKER SPRINGS CHARGING	-QBS	SWITCH-DISCONNECTORS
	-MAT	MOTOR FOR ELECTRICAL OPERATION OF TRUCK RACKING-IN/OUT	-QBT	TRUCK
	-MBC	CLOSING RELEASE OF CIRCUIT-BREAKER	-QCA	EARTHING SWITCH FOR ELIMINATION OF INTERNAL ARCING
	-MBC4	CLOSING RELEASE OF SWITCH-DISCONNECTOR -QBS	-QCE	EARTHING SWITCH
	-MBO1	FIRST OPENING RELEASE OF CIRCUIT-BREAKER	-QCE1	EARTHING SWITCH OF BUSBARS (SINGLE BUSBAR SYSTEM) OR OF FRONT BUSBARS (DOUBLE BUSBAR SYSTEM)
B	-MBO2	SECOND OPENING RELEASE OF CIRCUIT-BREAKER	-QCE2	EARTHING SWITCH OF REAR BUSBARS (DOUBLE BUSBAR SYSTEM)
	-MBO3	OPENING SOLENOID FOR OVERCURRENT RELEASE OF CIRCUIT-BREAKER OR INDIRECT OVERCURRENT RELEASE ON CIRCUIT-BREAKER	-QQ	CLUTCHES
	-MBO4	OPENING RELEASE OF SWITCH-DISCONNECTOR -QBS	-RAA	ANTIFERRORESONANCE RESISTOR
	-MBU	UNDERVOLTAGE RELEASE OF CIRCUIT-BREAKER	-RAD	DIODES
	-PFB	BLUE SIGNAL LAMPS	-RAI	INDUCTORS
	-PFF	FLAG RELAYS	-RAR	RESISTORS
	-PFG	GREEN SIGNAL LAMPS	-RF	FILTERS
	-PFR	RED SIGNAL LAMPS	-RLE1	ELECTROMECHANICAL LOCK PREVENTING CIRCUIT-BREAKER CLOSING
C	-PFS	SHORT CIRCUIT INDICATORS	-RLE2	ELECTROMECHANICAL LOCK PREVENTING TRUCK RACKING-IN/OUT
	-PFV	VOLTAGE INDICATORS	-RLE3	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR CLOSING OPERATION OF EARTHING SWITCH -QCE
	-PFV1	VOLTAGE INDICATORS ON FEEDER SIDE	-RLE4	ELECTROMECHANICAL LOCK PREVENTING THE DOOR OPENING OPERATION
	-PFV2	VOLTAGE INDICATORS ON BUSBAR SIDE	-RLE5	ELECTROMECHANICAL LOCK PREVENTING OPERATION OF DISCONNECTOR -QBD
	-PFW	WHITE SIGNAL LAMPS	-RLE6	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR CLOSING OPERATION OF DISCONNECTOR -QBD1
	-PFX	CROSS INDICATORS, ELECTROMECHANICAL INDICATORS	-RLE7	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR CLOSING OPERATION OF DISCONNECTOR -QBD2
	-PFY	YELLOW SIGNAL LAMPS	-RLE8	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR CLOSING OPERATION OF EARTHING SWITCH -QCE1 OR -QCE2
	-PGA	AMMETERS	-RLE9	ELECTROMECHANICAL LOCK PREVENTING OPERATION OF SWITCH-DISCONNECTOR -QBS
D	-PGC	COUNTERS	-RLE11	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR OPERATION OF DISCONNECTOR -QBD4
	-PGF	FREQUENCYMETERS	-RLE12	ELECTROMECHANICAL LOCK PREVENTING INSERTION OF LEVER FOR OPERATION OF DISCONNECTOR -QBD5
	-PGH	HOURMETERS	-SFA	AMMETRIC SWITCHES
	-PGI	PROTECTION AND CONTROL UNIT: HUMAN MACHINE INTERFACE	-SFC	CONTROL SWITCHES, CLOSING PUSH-BUTTONS
	-PGI1	HUMAN MACHINE INTERFACE OF ELECTRONIC CONTROLLED CIRCUIT-BREAKER (ON CIRCUIT-BREAKER)	-SFL	LOCKING CONTACTS
	-PGI2	HUMAN MACHINE INTERFACE FOR ELECTRONIC CONTROLLED CIRCUIT-BREAKER (ON SWITCHGEAR)	-SFO	OPENING PUSH-BUTTONS
	-PGJ	ACTIVE ENERGY METERS	-SFR	RESET PUSH-BUTTONS
	-PGK	REACTIVE ENERGY METERS	-SFS	SELECTOR SWITCHES
E	-PGM	MULTIFUNCTION INDICATORS	-SFT	TEST PUSH-BUTTONS
	-PGP	POWER-FACTOR METERS	-SFU	UNLOCKING PUSH-BUTTONS
	-PGQ	VARMETERS	-SFV	VOLTMETRIC SWITCHES
	-PGS	SYNCHRONOSCOPES	-TA	POWER TRANSFORMERS
	-PGV	VOLTMETERS	-TB	CONVERTER
	-PGW	WATTMETERS	-TB1	RECTIFIER FOR FIRST OPENING RELEASE
	-PJ	ACOUSTICAL SIGNAL DEVICES (BELLS, SIRENS)	-TB2	RECTIFIER FOR SECOND OPENING RELEASE
	-QAB	CIRCUIT-BREAKERS	-TB3	RECTIFIER FOR CLOSING RELEASE
F	-QAC	CONTACTORS (FOR POWER)	-TB4	RECTIFIER FOR ELECTROMECHANICAL LOCK PREVENTING CIRCUIT-BREAKER CLOSING
	-QBD	DISCONNECTORS	-TB5	RECTIFIER FOR ELECTROMECHANICAL LOCK PREVENTING TRUCK RACKING-IN/OUT
	-QBD1	FRONT BUSBAR DISCONNECTORS (DOUBLE BUSBAR SYSTEM)	-TB6	RECTIFIER FOR UNDERVOLTAGE RELEASE
	-QBD2	REAR BUSBAR DISCONNECTORS (DOUBLE BUSBAR SYSTEM)	-TB7	ERECTIFIER FOR INDIRECT OVERCURRENT RELEASE ON CIRCUIT-BREAKER
	-QBD3	FEEDER DISCONNECTORS (DOUBLE BUSBAR SYSTEM)		
	-QBD4	TWO-WAY DISCONNECTOR		
	-QBD5	TWO-WAY DISCONNECTOR ON BUSBAR RISER		


				Date Prep.	15.11.2018	PROJECT TITLE		ABB	EPMV	REFERENCE DESIGNATIONS	Scale	NTS	= H08
				Prepared	YR	MV Switchgear for MNA Serang Plant					MVD-25 & MVD-26 20kV Centralized Panel Room MNA	Customer	PT Multimas Nabati Asahan
00	Issued for Approval	15.01.19	YR	Checked	AW			PT. ABB Sakti Industri		SCHEMATIC DIAGRAM	Drawing Nbr.	18.042-MNA-307.07	Sh. 5
Ind.	Revision	Date	Name	Approved	AI	Based on: BE318042				SBS-W BUS TIE	Customer Doc. Nbr.		Cont. 27

1	2	3	4	5	6	7	8
---	---	---	---	---	---	---	---


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

A	-TFA	ACTIVE POWER TRANSDUCERS	-XDI1	TERMINAL BLOCK FOR INTERCONNECTIONS OF CONTROL CIRCUITS	A														
	-TFC	CURRENT TRANSDUCERS		-XDI2		TERMINAL BLOCK FOR INTERCONNECTIONS OF CIRCUITS OF MOTOR FOR CIRCUIT-BREAKER SPRINGS CHARGING													
B	-TFF	FREQUENCY TRANSDUCERS	-XDI3	TERMINAL BLOCK FOR INTERCONNECTIONS OF CIRCUITS OF MOTOR FOR SWITCH-DISCONNECTOR OPERATION	B														
	-TFJ	ACTIVE ENERGY TRANSDUCERS	-XDI4	TERMINAL BLOCK FOR INTERCONNECTIONS OF A.C. AUXILIARY CIRCUITS															
	-TFK	REACTIVE ENERGY TRANSDUCERS	-XDI6	TERMINAL BLOCK FOR INTERCONNECTION (CONNECTION BETWEEN PANELS) OF VOLTAGE CIRCUITS															
	-TFM	MULTIFUNCTION TRANSDUCERS	-XDI7	TERMINAL BLOCK FOR INTERCONNECTION OF MOD-BUS															
	-TFP	POWER-FACTOR TRANSDUCERS	-XDI8	TERMINAL BLOCK FOR INTERCONNECTIONS OF CURRENT CIRCUITS															
	-TFQ	REACTIVE POWER TRANSDUCERS	-XDI9	TERMINAL BLOCK FOR SPECIAL USE															
	-TFS	SIGNAL CONVERTERS	-XDJ	TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF DISCONNECTORS -QBD															
	-TFV	VOLTAGE TRANSDUCERS	-XDJ1	TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF SWITCH-DISCONNECTOR -QBS															
	-WA	BUSBARS	-XDM	SEALABLE TERMINAL BLOCK FOR MEASUREMENT															
	-WBC	POWER CABLES	-XDS	CURRENT SOCKETS															
C	-WE	EARTHING CABLES FOR L.V. INSTRUMENT COMPARTMENT.	-XDT	TERMINAL BLOCK FOR POSITION CONTACTS OF TRUCK AND OF CONNECTOR -XDB	C														
	-WGC	CONTROL CABLES	-XDU	CONNECTOR FOR ISOLATION OF CIRCUITS OF LOWER VOLTAGE TRANSFORMER TRUCK															
	-WGS	COMMUNICATION CABLES (SHIELDED TWISTED PAIRS)	-XDU1	TERMINAL BLOCK FOR CIRCUITS OF LOWER VOLTAGE TRANSFORMER TRUCK															
	-WH	OPTICAL FIBRES	-XDV	TERMINAL BLOCK FOR CIRCUITS OF VOLTAGE TRANSFORMERS															
	-XDA	TERMINAL BLOCK FOR CIRCUITS OF CURRENT TRANSFORMERS	-XDV1	CONNECTOR FOR CIRCUITS OF VOLTAGE TRANSFORMERS LOCATED ON PHASE L1															
	-XDA1	CONNECTOR FOR CIRCUITS OF CURRENT TRANSFORMERS LOCATED ON PHASE L1	-XDV2	CONNECTOR FOR CIRCUITS OF VOLTAGE TRANSFORMERS LOCATED ON PHASE L2															
	-XDA2	CONNECTOR FOR CIRCUITS OF CURRENT TRANSFORMERS LOCATED ON PHASE L2	-XDV3	CONNECTOR FOR CIRCUITS OF VOLTAGE TRANSFORMERS LOCATED ON PHASE L3															
	-XDA3	CONNECTOR FOR CIRCUITS OF CURRENT TRANSFORMERS LOCATED ON PHASE L3	-XDV4	CONNECTOR FOR CIRCUITS OF ANTIFERRORESONANCE RESISTOR															
	-XDA5	CONNECTOR FOR CIRCUITS OF NEUTRAL (RESIDUAL) CURRENT TRANSFORMER	-XDX	SUPPORT TERMINAL BLOCK															
	-XDB	CONNECTOR FOR ISOLATION OF CIRCUIT-BREAKER (OR UPPER VOLTAGE TRANSFORMER TRUCK) AUXILIARY CIRCUITS	-XE1	EARTHING TERMINAL BLOCKS FOR LV COMPARTMENT, LEFT SIDE															
D	-XDB1	CONNECTOR FOR AUXILIARY CIRCUITS OF CIRCUIT-BREAKER (OR UPPER VOLTAGE TRANSFORMER TRUCK)	-XE2	EARTHING TERMINAL BLOCKS FOR LV COMPARTMENT, RIGHT SIDE	D														
	-XDB2	CONNECTOR FOR ADDITIONAL AUXILIARY CIRCUITS OF CIRCUIT-BREAKER	-XE5	EARTHING TERMINAL BLOCKS FOR MV COMPARTMENT, VOLTAGE INDICATOR SIDE															
	-XDB10...-XDB89	CONNECTOR FOR CIRCUIT-BREAKER INTERNAL CIRCUITS	-XE6	EARTHING TERMINAL BLOCKS FOR MV COMPARTMENT, REAR BOTTOM SIDE															
	-XDB7	CONNECTOR FOR TRUCK POSITION CONTACTS	-XE7	EARTHING TERMINAL BLOCKS FOR MV COMPARTMENT, LEFT SIDE															
	-XDB91	CONNECTOR FOR OPENING RELEASE CIRCUITS OF SWITCH-DISCONNECTOR	-XE8	EARTHING TERMINAL BLOCKS FOR MV COMPARTMENT, FRONT BOTTOM SIDE															
	-XDB92	CONNECTOR FOR CLOSING RELEASE CIRCUITS OF SWITCH-DISCONNECTOR	-XE9	EARTHING TERMINAL BLOCK FOR TRANSFORMERS IN BUSBAR COMPARTMENT															
	-XDB93	CONNECTOR FOR POSITION SWITCHES OF SWITCH-DISCONNECTOR																	
	-XDB95	CONNECTOR FOR CIRCUITS OF EARTHING SWITCH LOCKING MAGNET																	
	-XDC	CUSTOMER TERMINAL BLOCK																	
	-XDC1	CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF CIRCUIT BREAKER																	
E	-XDC2	CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF SWITCH-DISCONNECTOR			E														
	-XDC3	CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF PROTECTION RELAY AND MULTIFUNCTION UNIT																	
	-XDC4	CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF VOLTAGE TRANSFORMERS																	
	-XDC5	CUSTOMER TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF MINIATURE CIRCUIT BREAKER																	
	-XDE	TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF EARTHING SWITCH -QCE																	
	-XDE1	TERMINAL BLOCK FOR INTERNAL CIRCUITS OF EARTHING SWITCH -QCE																	
	-XDE2	TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF EARTHING SWITCH -QCE1 OR -QCE2																	
	-XDE3	TERMINAL BLOCK FOR INTERNAL CIRCUITS OF EARTHING SWITCH -QCE1 OR -QCE2																	
	-XDF	TERMINAL BLOCK FOR AUXILIARY CIRCUITS OF FORCED COOLING VENTILATORS																	
	-XDF1	CONNECTOR FOR ISOLATION OF CIRCUITS OF FRONT VENTILATOR																	
F	-XDF2	CONNECTOR FOR REAR VENTILATOR CIRCUITS			F														
	-XDF3	CONNECTOR FOR FRONT VENTILATOR CIRCUITS																	
	-XDH	TERMINAL BLOCK FOR VARIOUS CIRCUITS (HEATERS, POSITION SWITCHES DETECTING INTERNAL ARCING, ETC.)																	
	-XDI	TERMINAL BLOCK FOR INTERCONNECTION (CONNECTION BETWEEN PANELS)																	
1		2		3		4		5		6		7		8					
				Date Prep. 15.11.2018		PROJECT TITLE MV Switchgear for MNA Serang Plant		ABB EPMV		REFERENCE DESIGNATIONS MVD-25 & MVD-26 20kV Centralized Panel Room MNA		Scale		NTS		= H08			
				Prepared YR								Customer		PT Multimas Nabati Asahan		& 307			
00		Issued for Approval		15.01.19		YR		Checked AW		PT. ABB Sakti Industri		SCHEMATIC DIAGRAM		Drawing Nbr.		18.042-MNA-307.07		Sh. 6	
Ind.		Revision		Date		Name		Approved AI				Based on: BE318042		SBS-W BUS TIE		Customer Doc. Nbr.			
1		2		3		4		5		6		7		8					


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

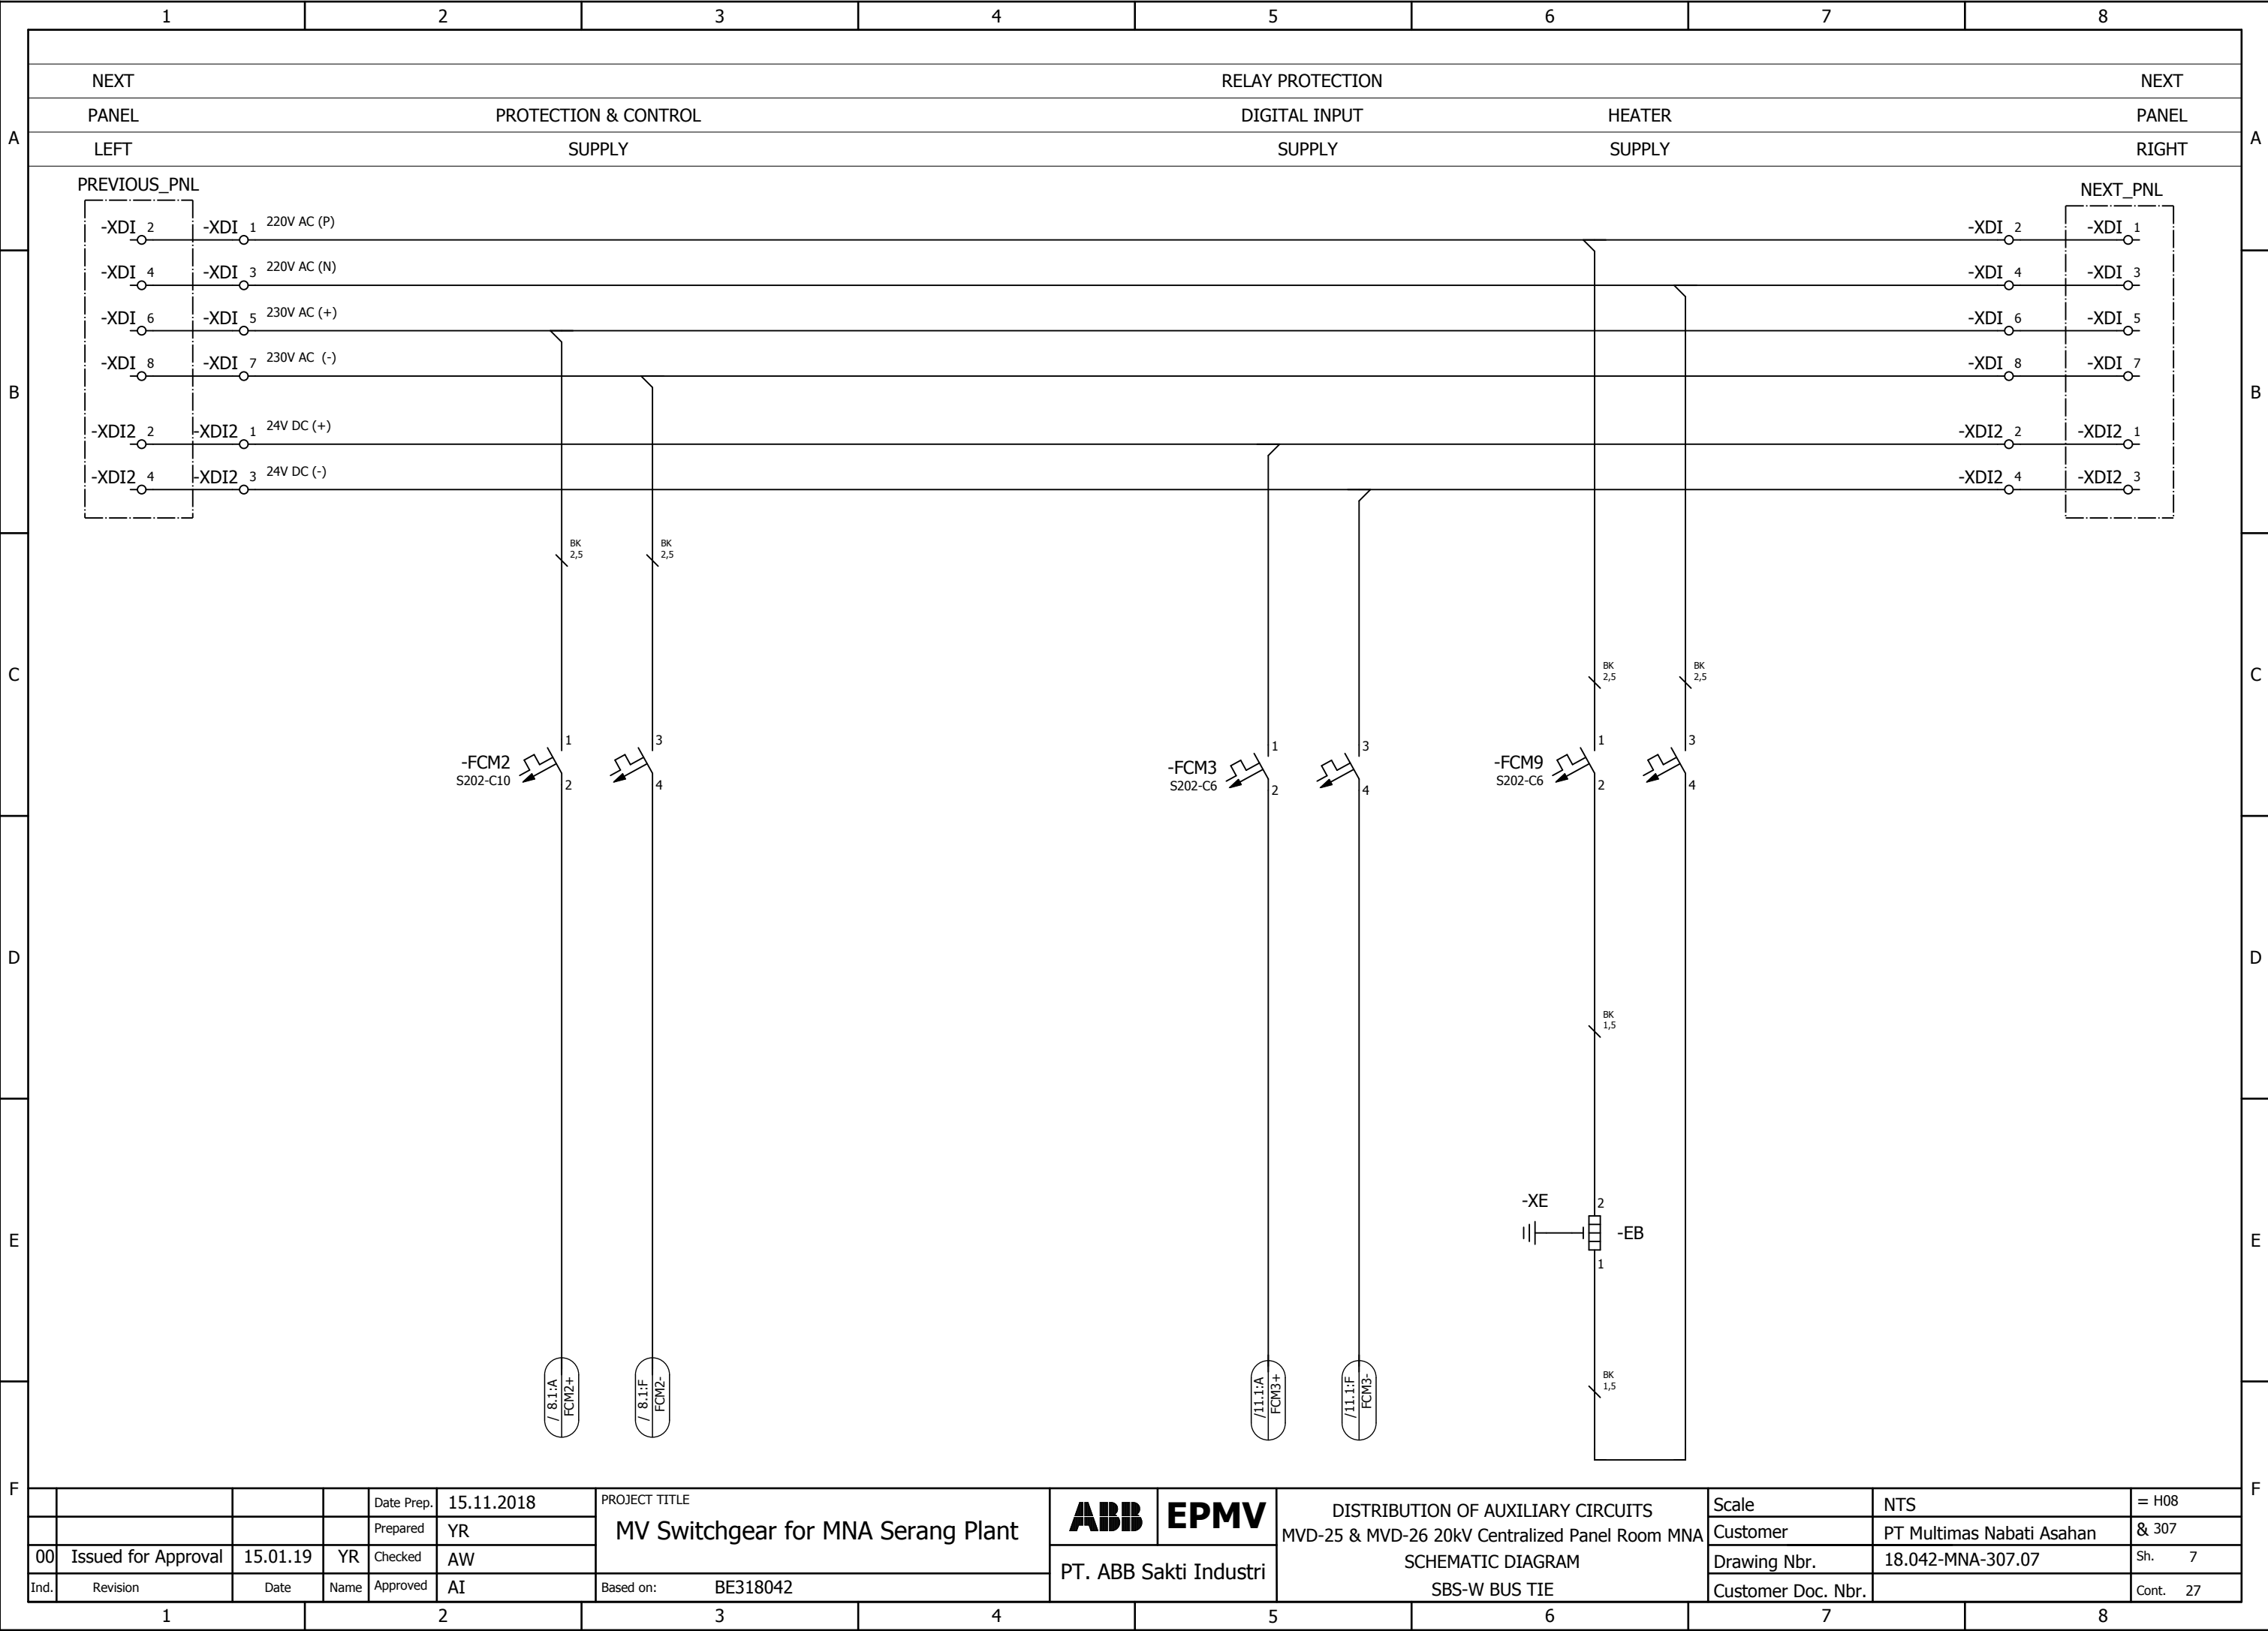


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

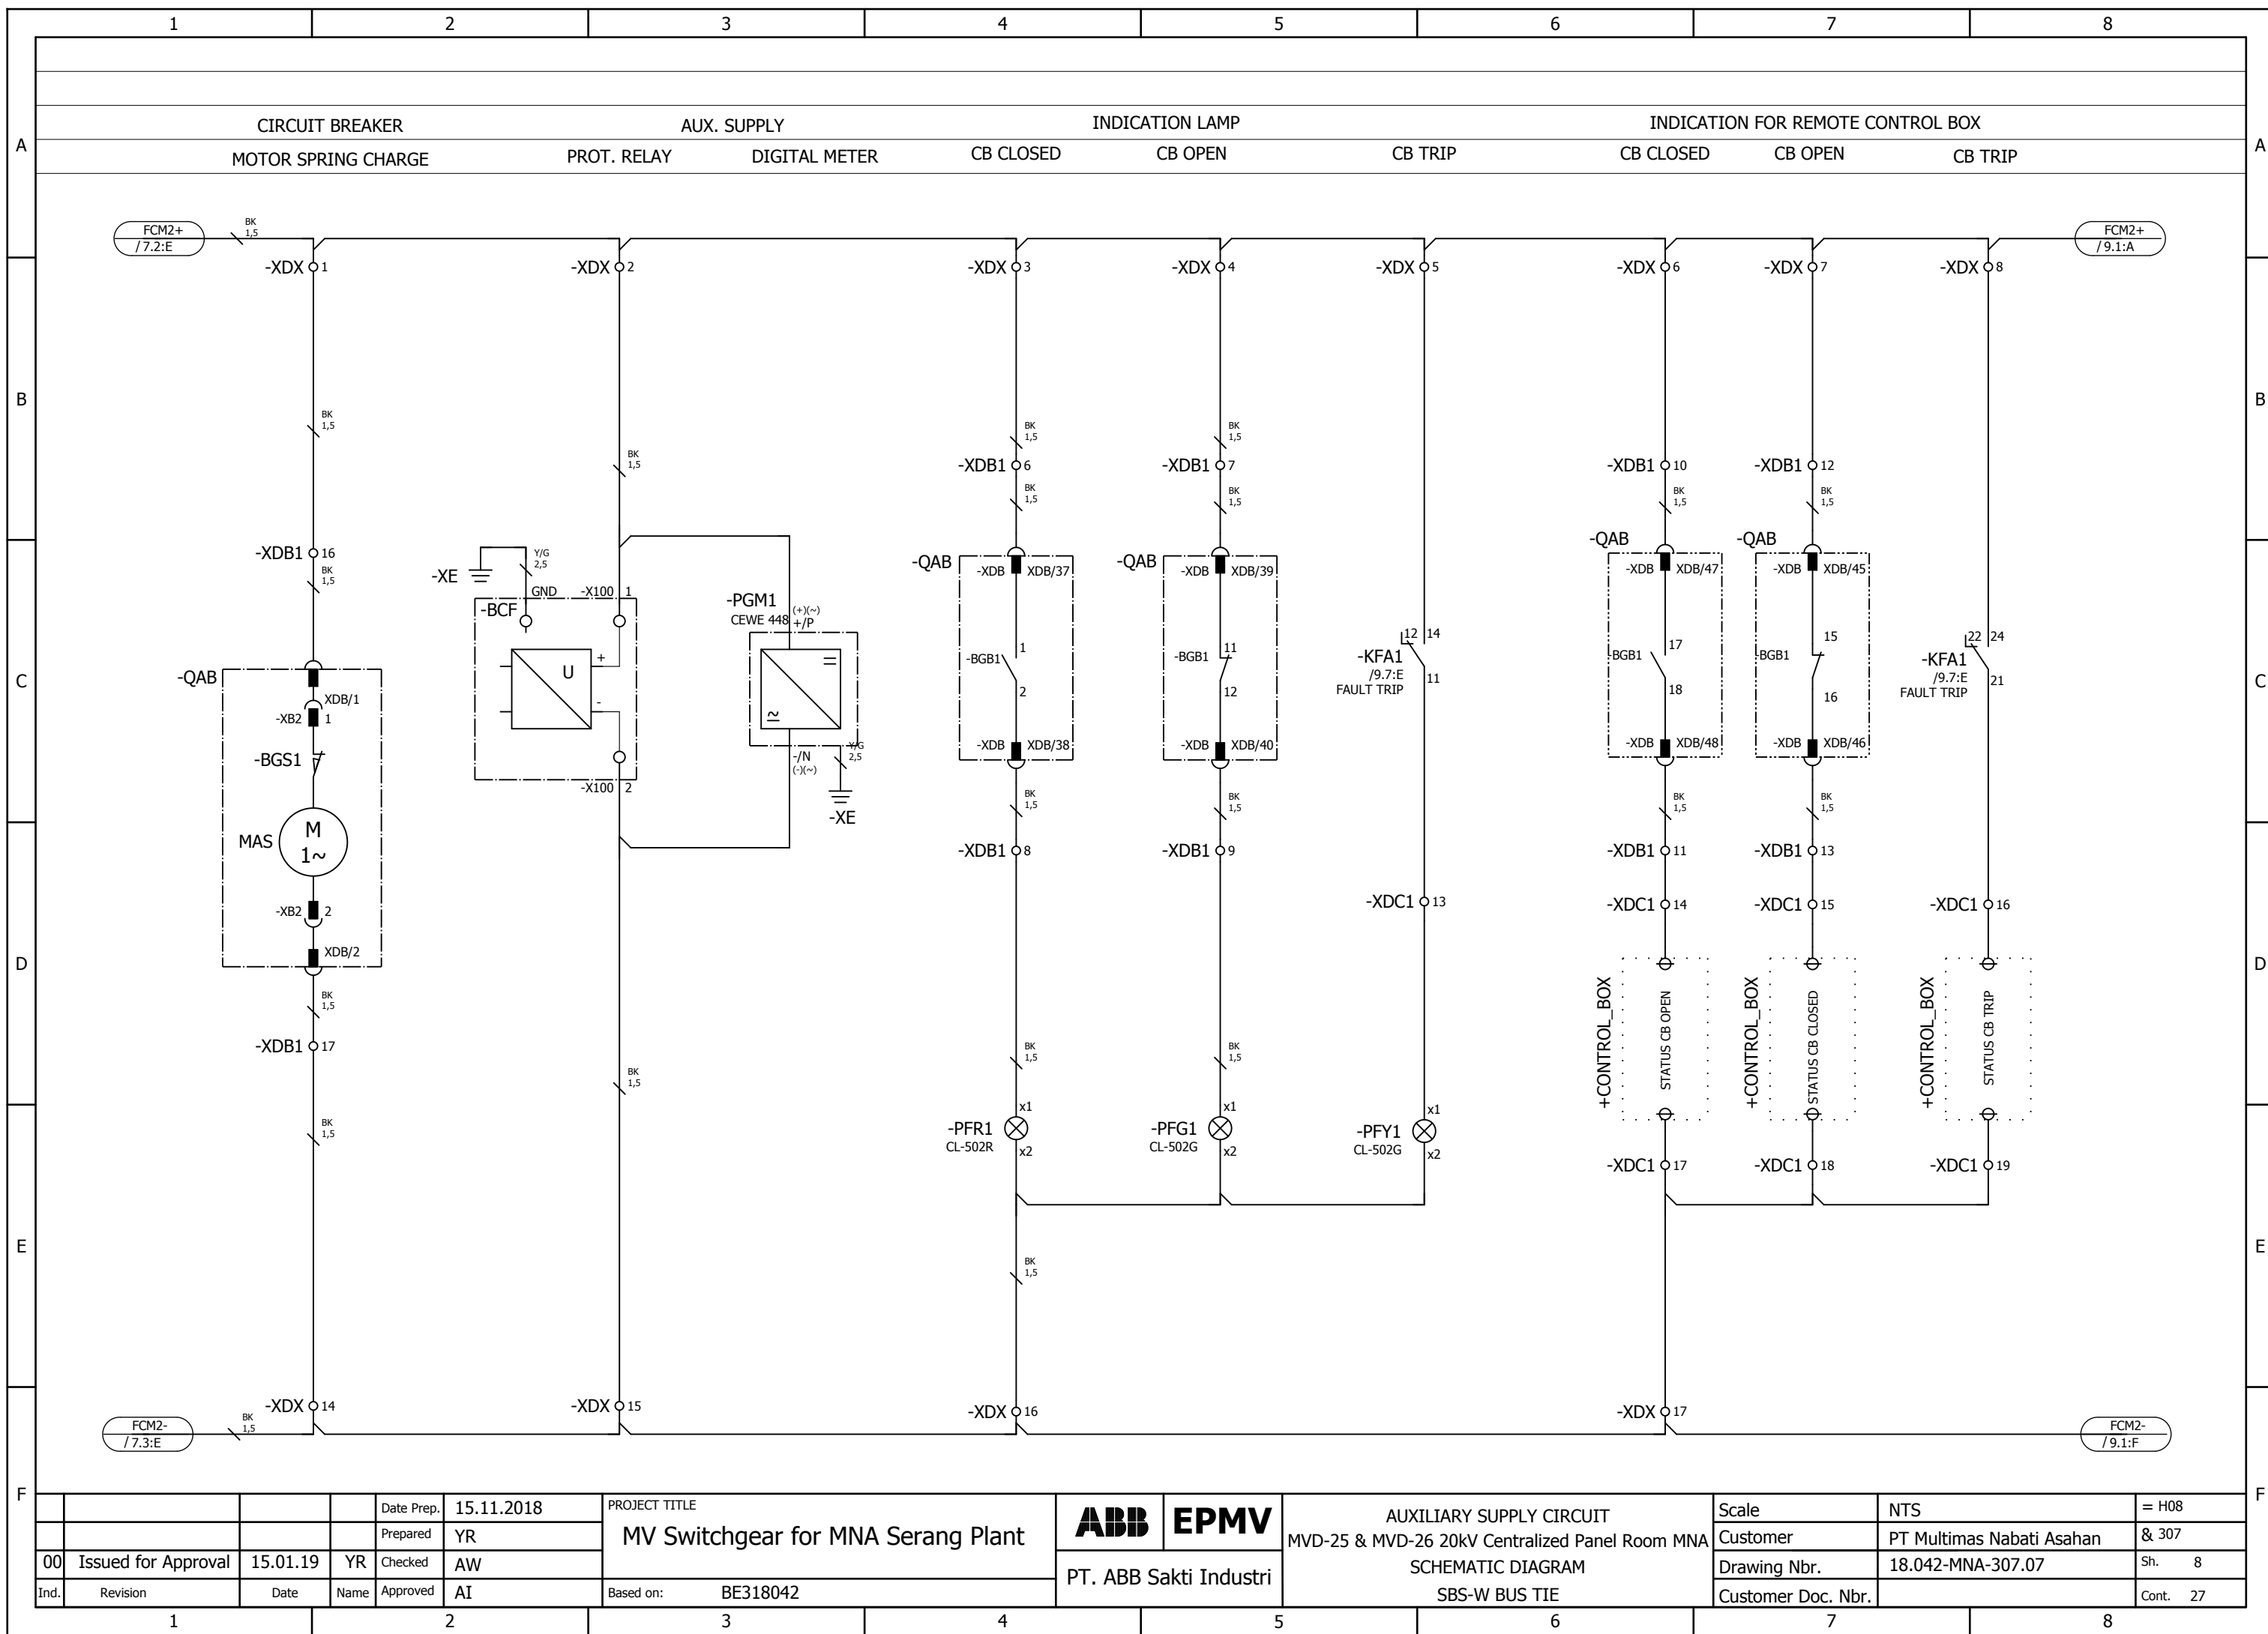

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

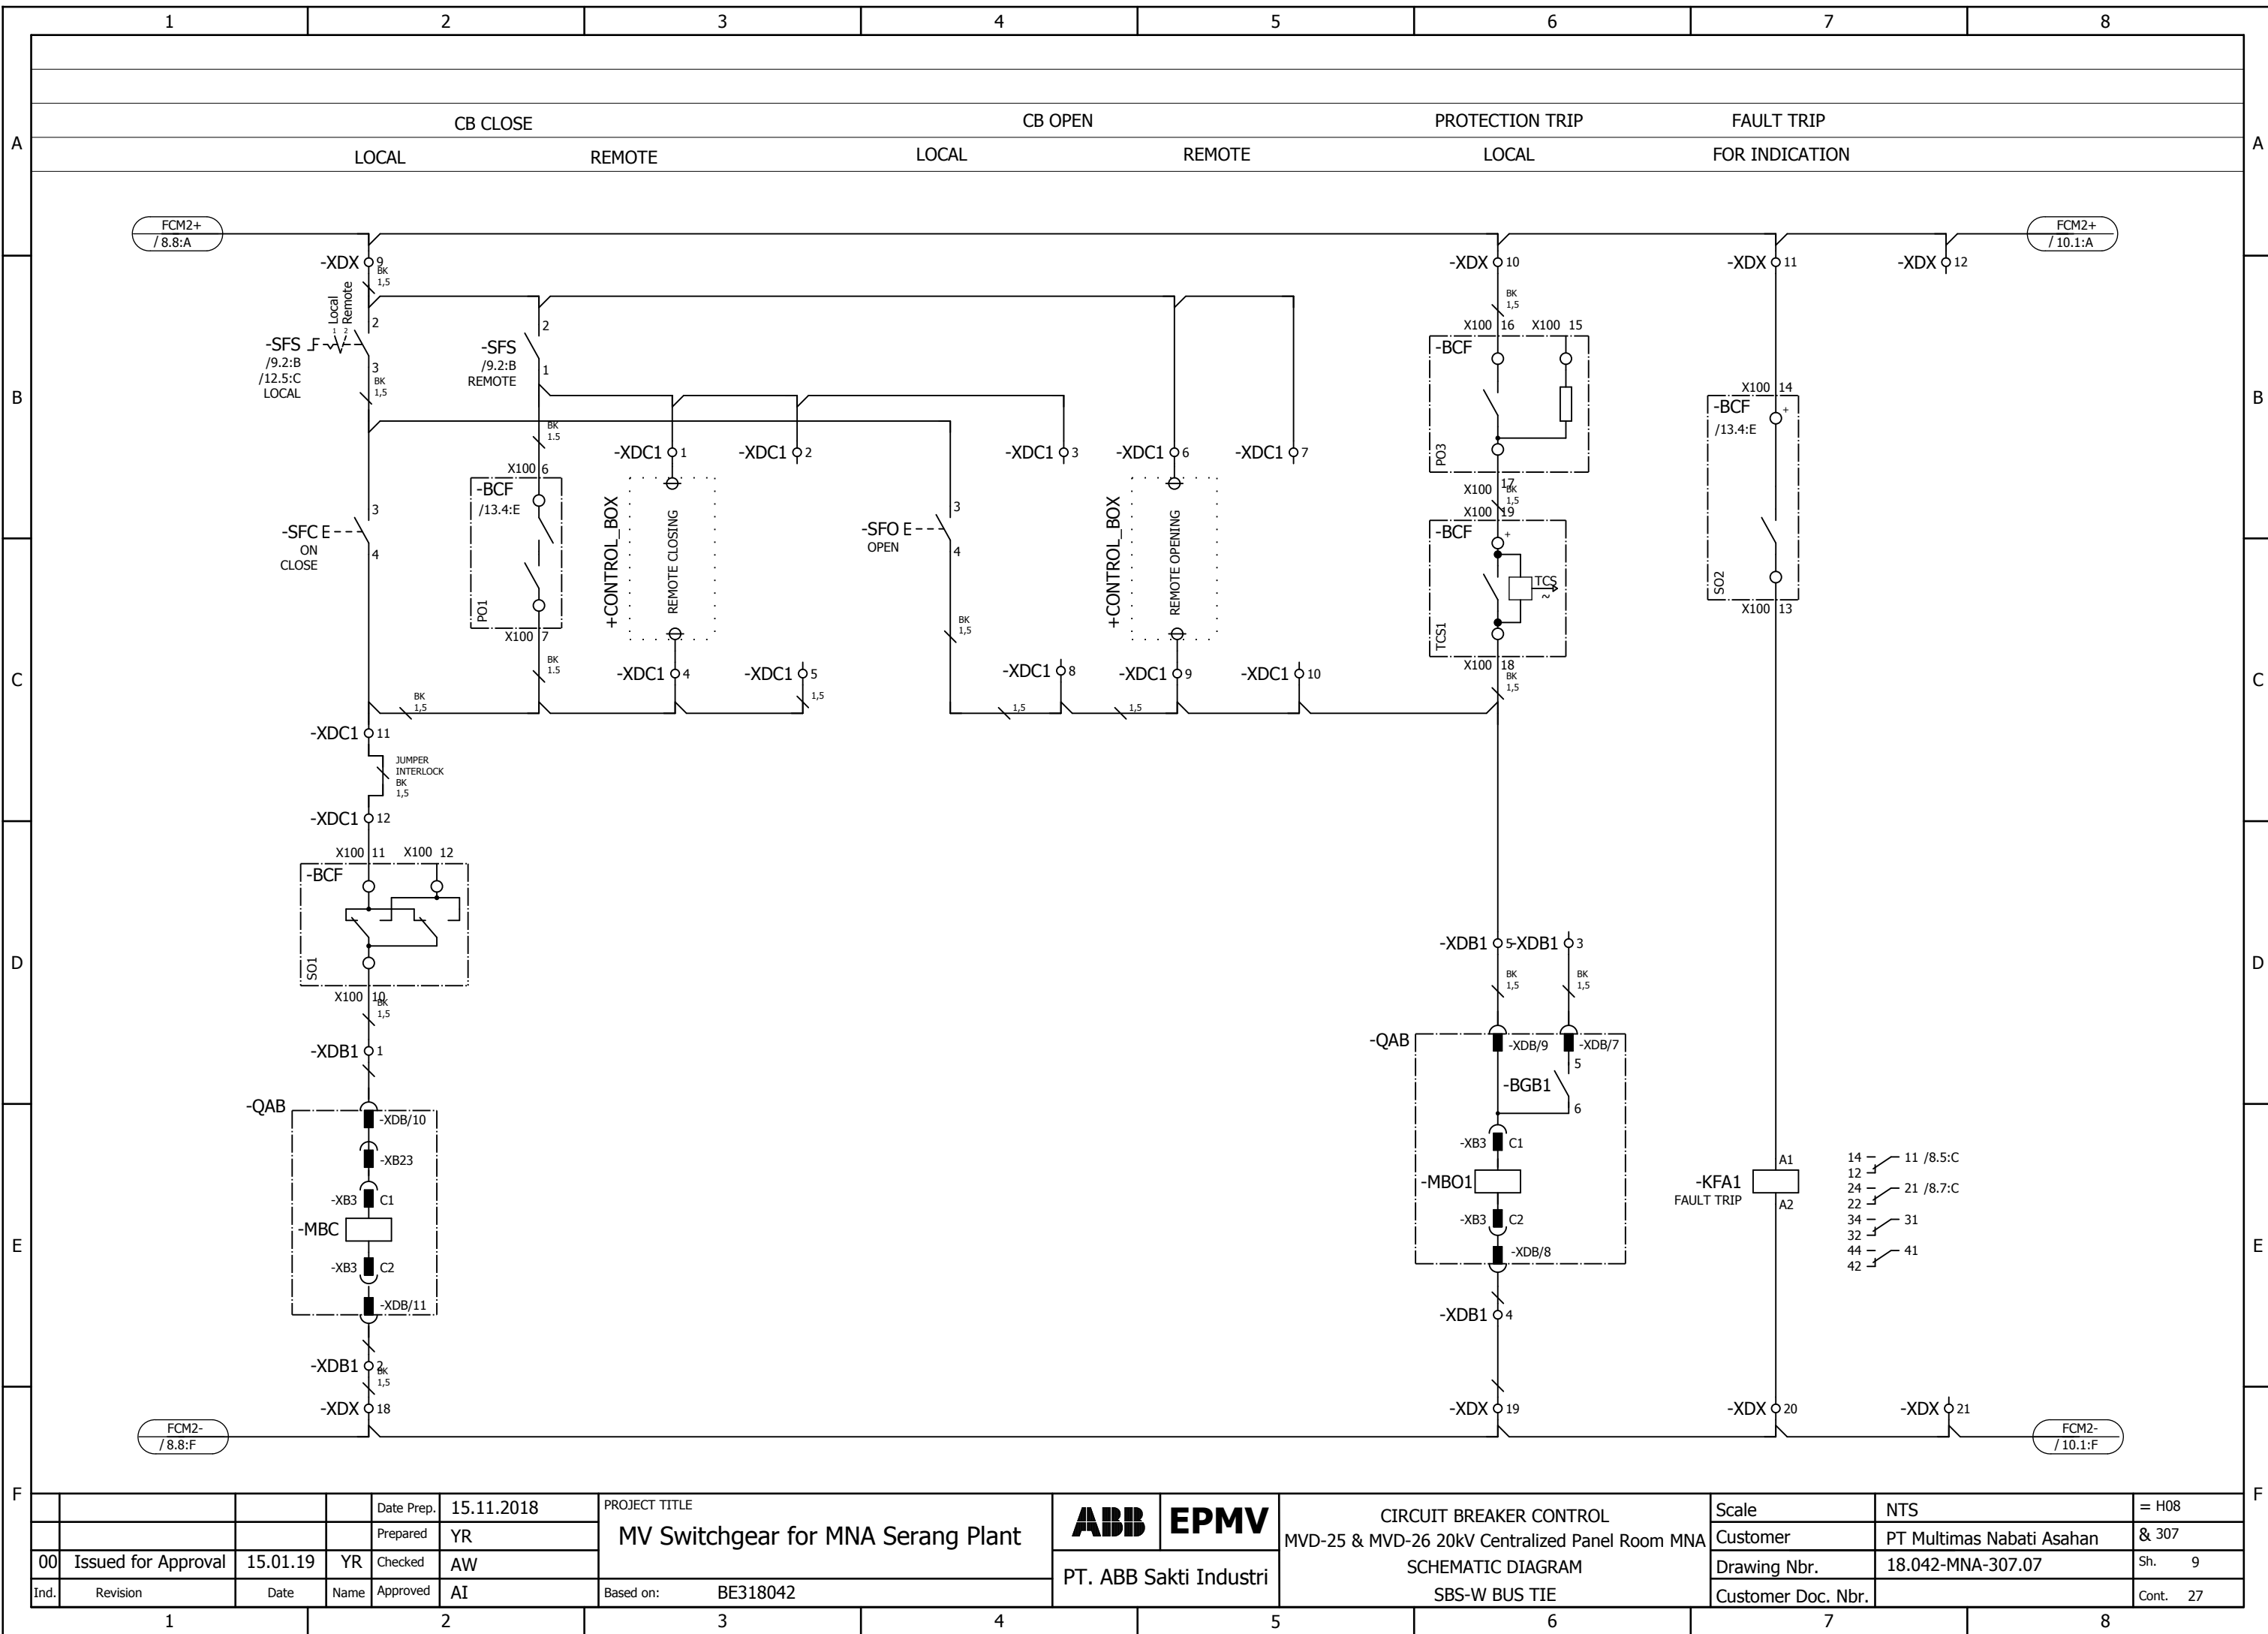


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

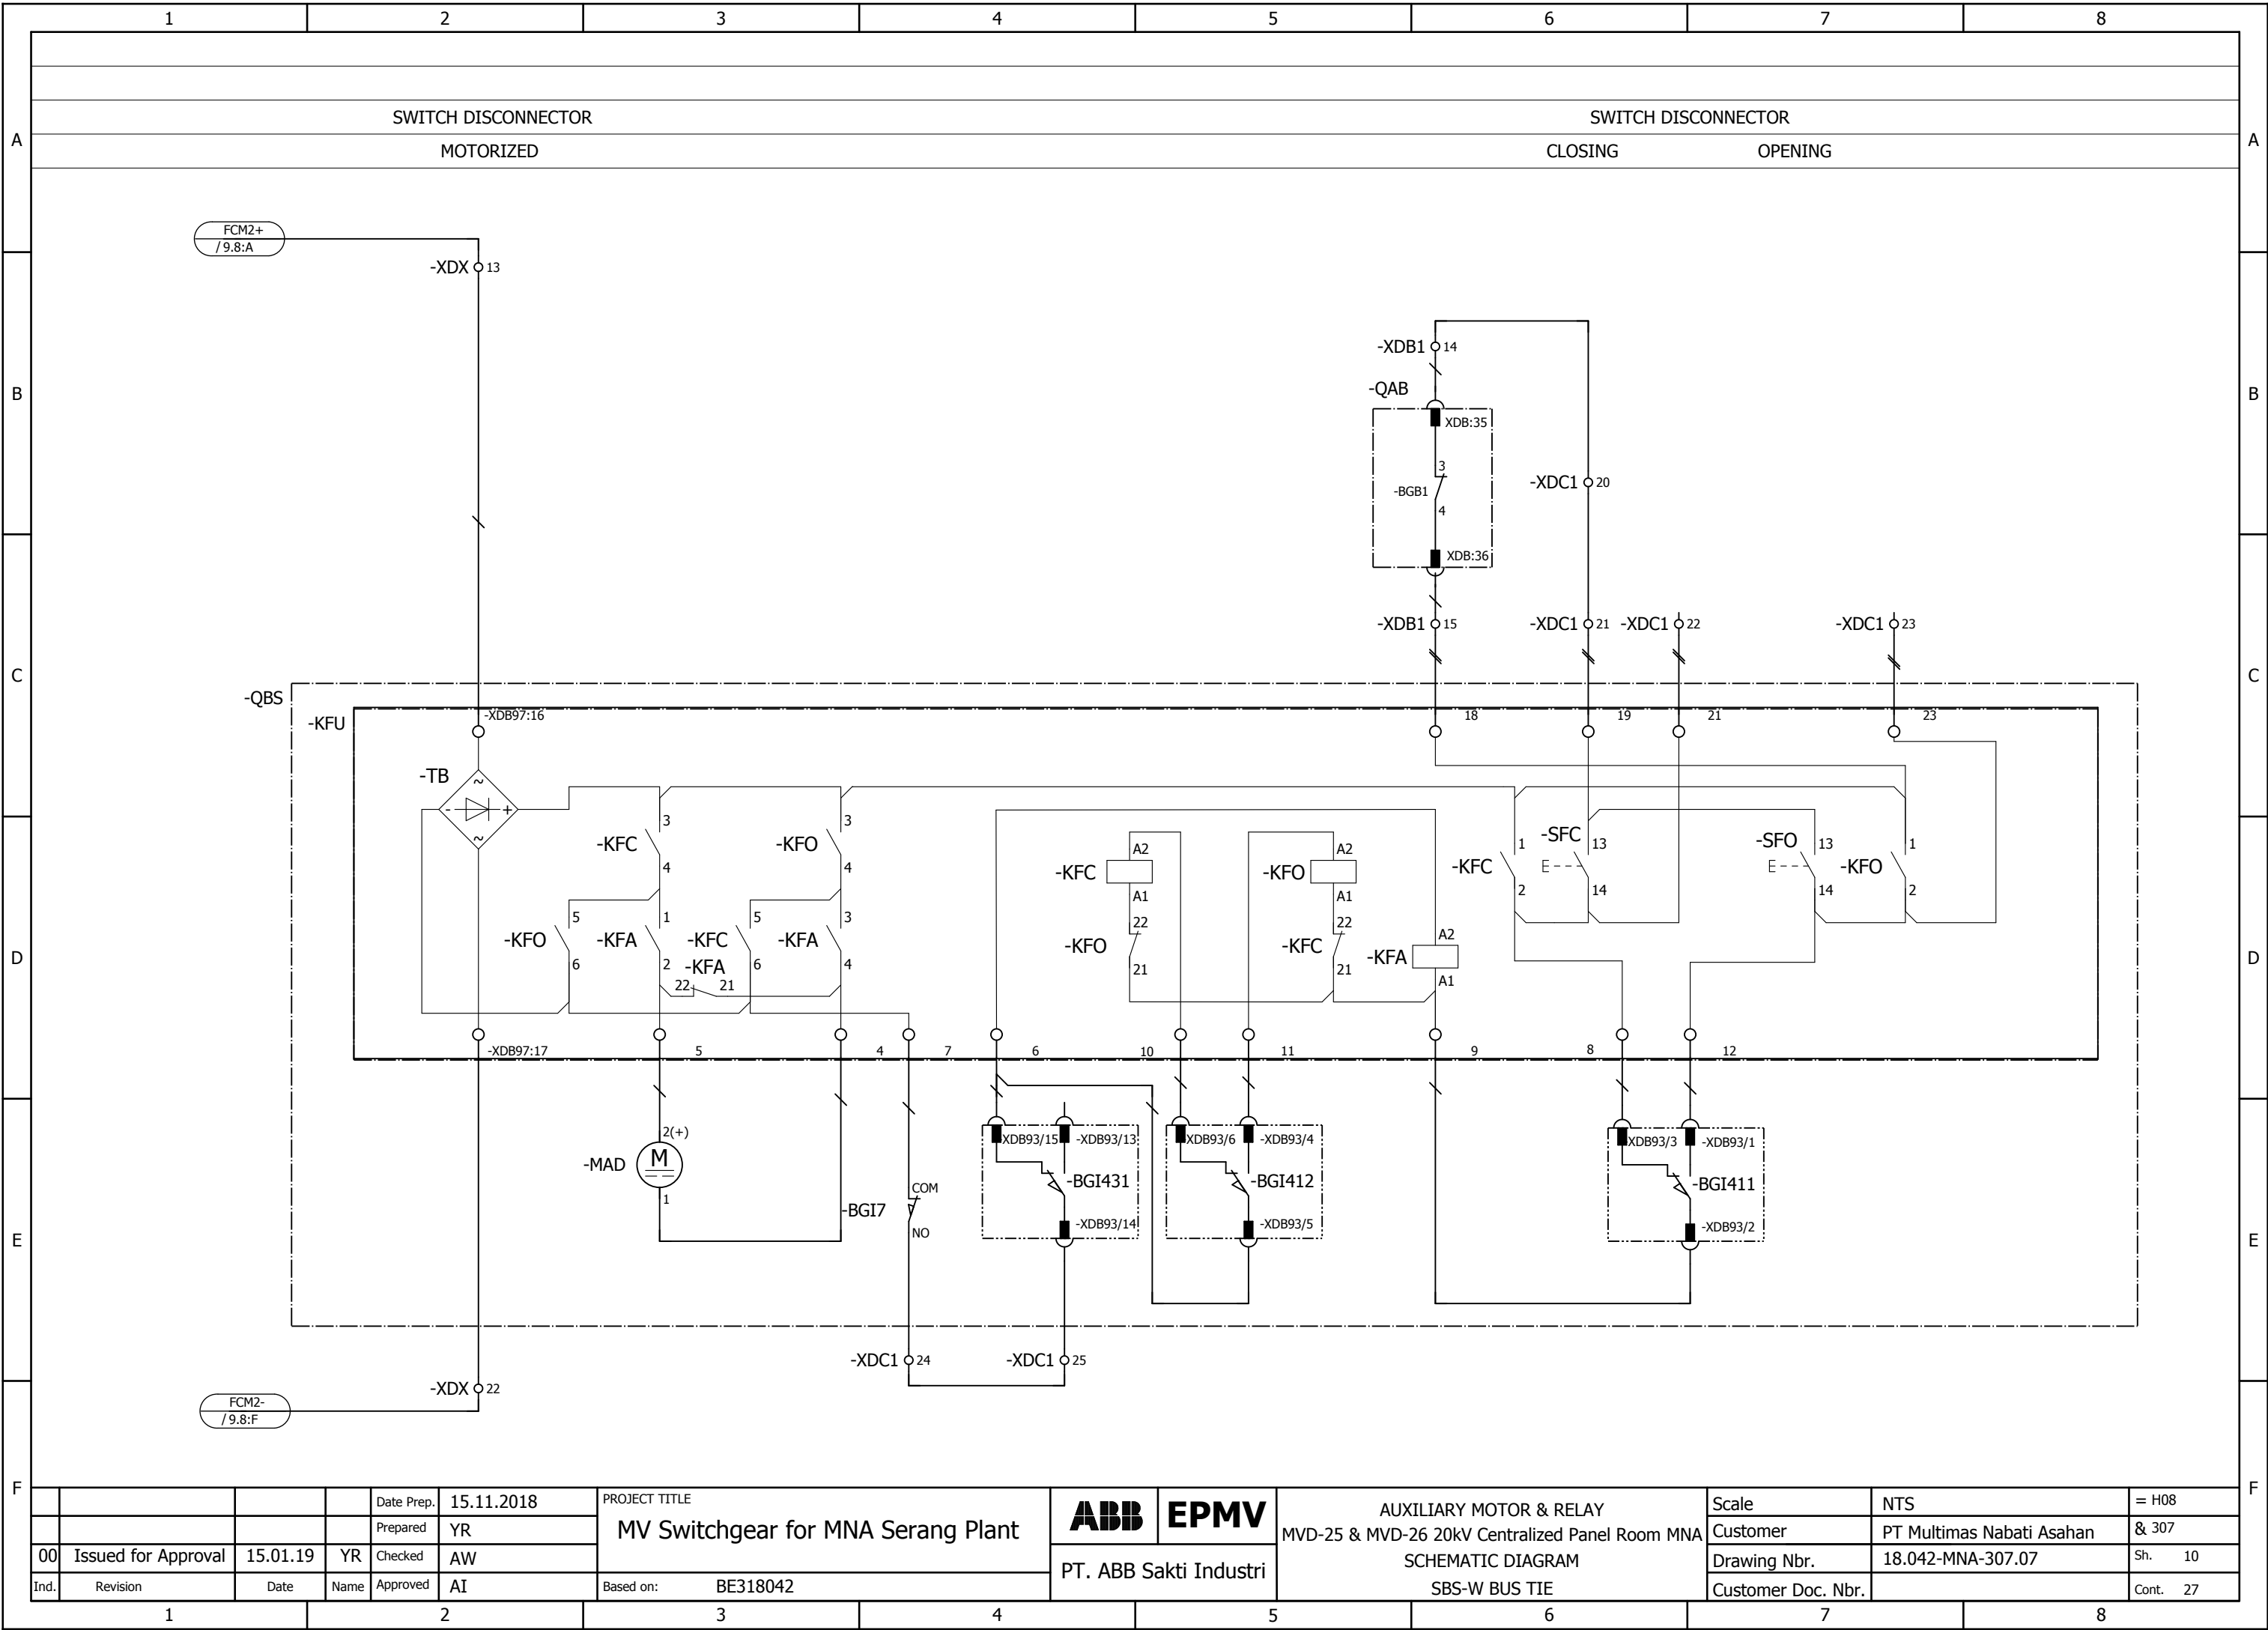


00		Issued for Approval	15.01.19	YR	Checked	AW	PROJECT TITLE	MV Switchgear for MNA Serang Plant	ABB EPMV	AUXILIARY MOTOR & RELAY MVD-25 & MVD-26 20kV Centralized Panel Room MNA SCHEMATIC DIAGRAM SBS-W BUS TIE	Scale	NTS	= H08
Ind.		Revision	Date	Name	Approved	AI					Customer	PT Multimas Nabati Asahan	& 307
							Based on:	BE318042	PT. ABB Sakti Industri		Drawing Nbr.	18.042-MNA-307.07	Sh. 10
											Customer Doc. Nbr.		Cont. 27

				Date Prep.	15.11.2018	PROJECT TITLE MV Switchgear for MNA Serang Plant	ABB	EPMV	DIGITAL INPUT/OUTPUT RELAY MVD-25 & MVD-26 20kV Centralized Panel Room MNA SCHEMATIC DIAGRAM SBS-W BUS TIE	Scale	NTS	= H08
				Prepared	YR					Customer	PT Multimas Nabati Asahan	& 307
00	Issued for Approval	15.01.19	YR	Checked	AW		PT. ABB Sakti Industri	Drawing Nbr.		18.042-MNA-307.07	Sh. 11	
Ind.	Revision	Date	Name	Approved	AI			Based on: BE318042		Customer Doc. Nbr.		Cont. 27

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

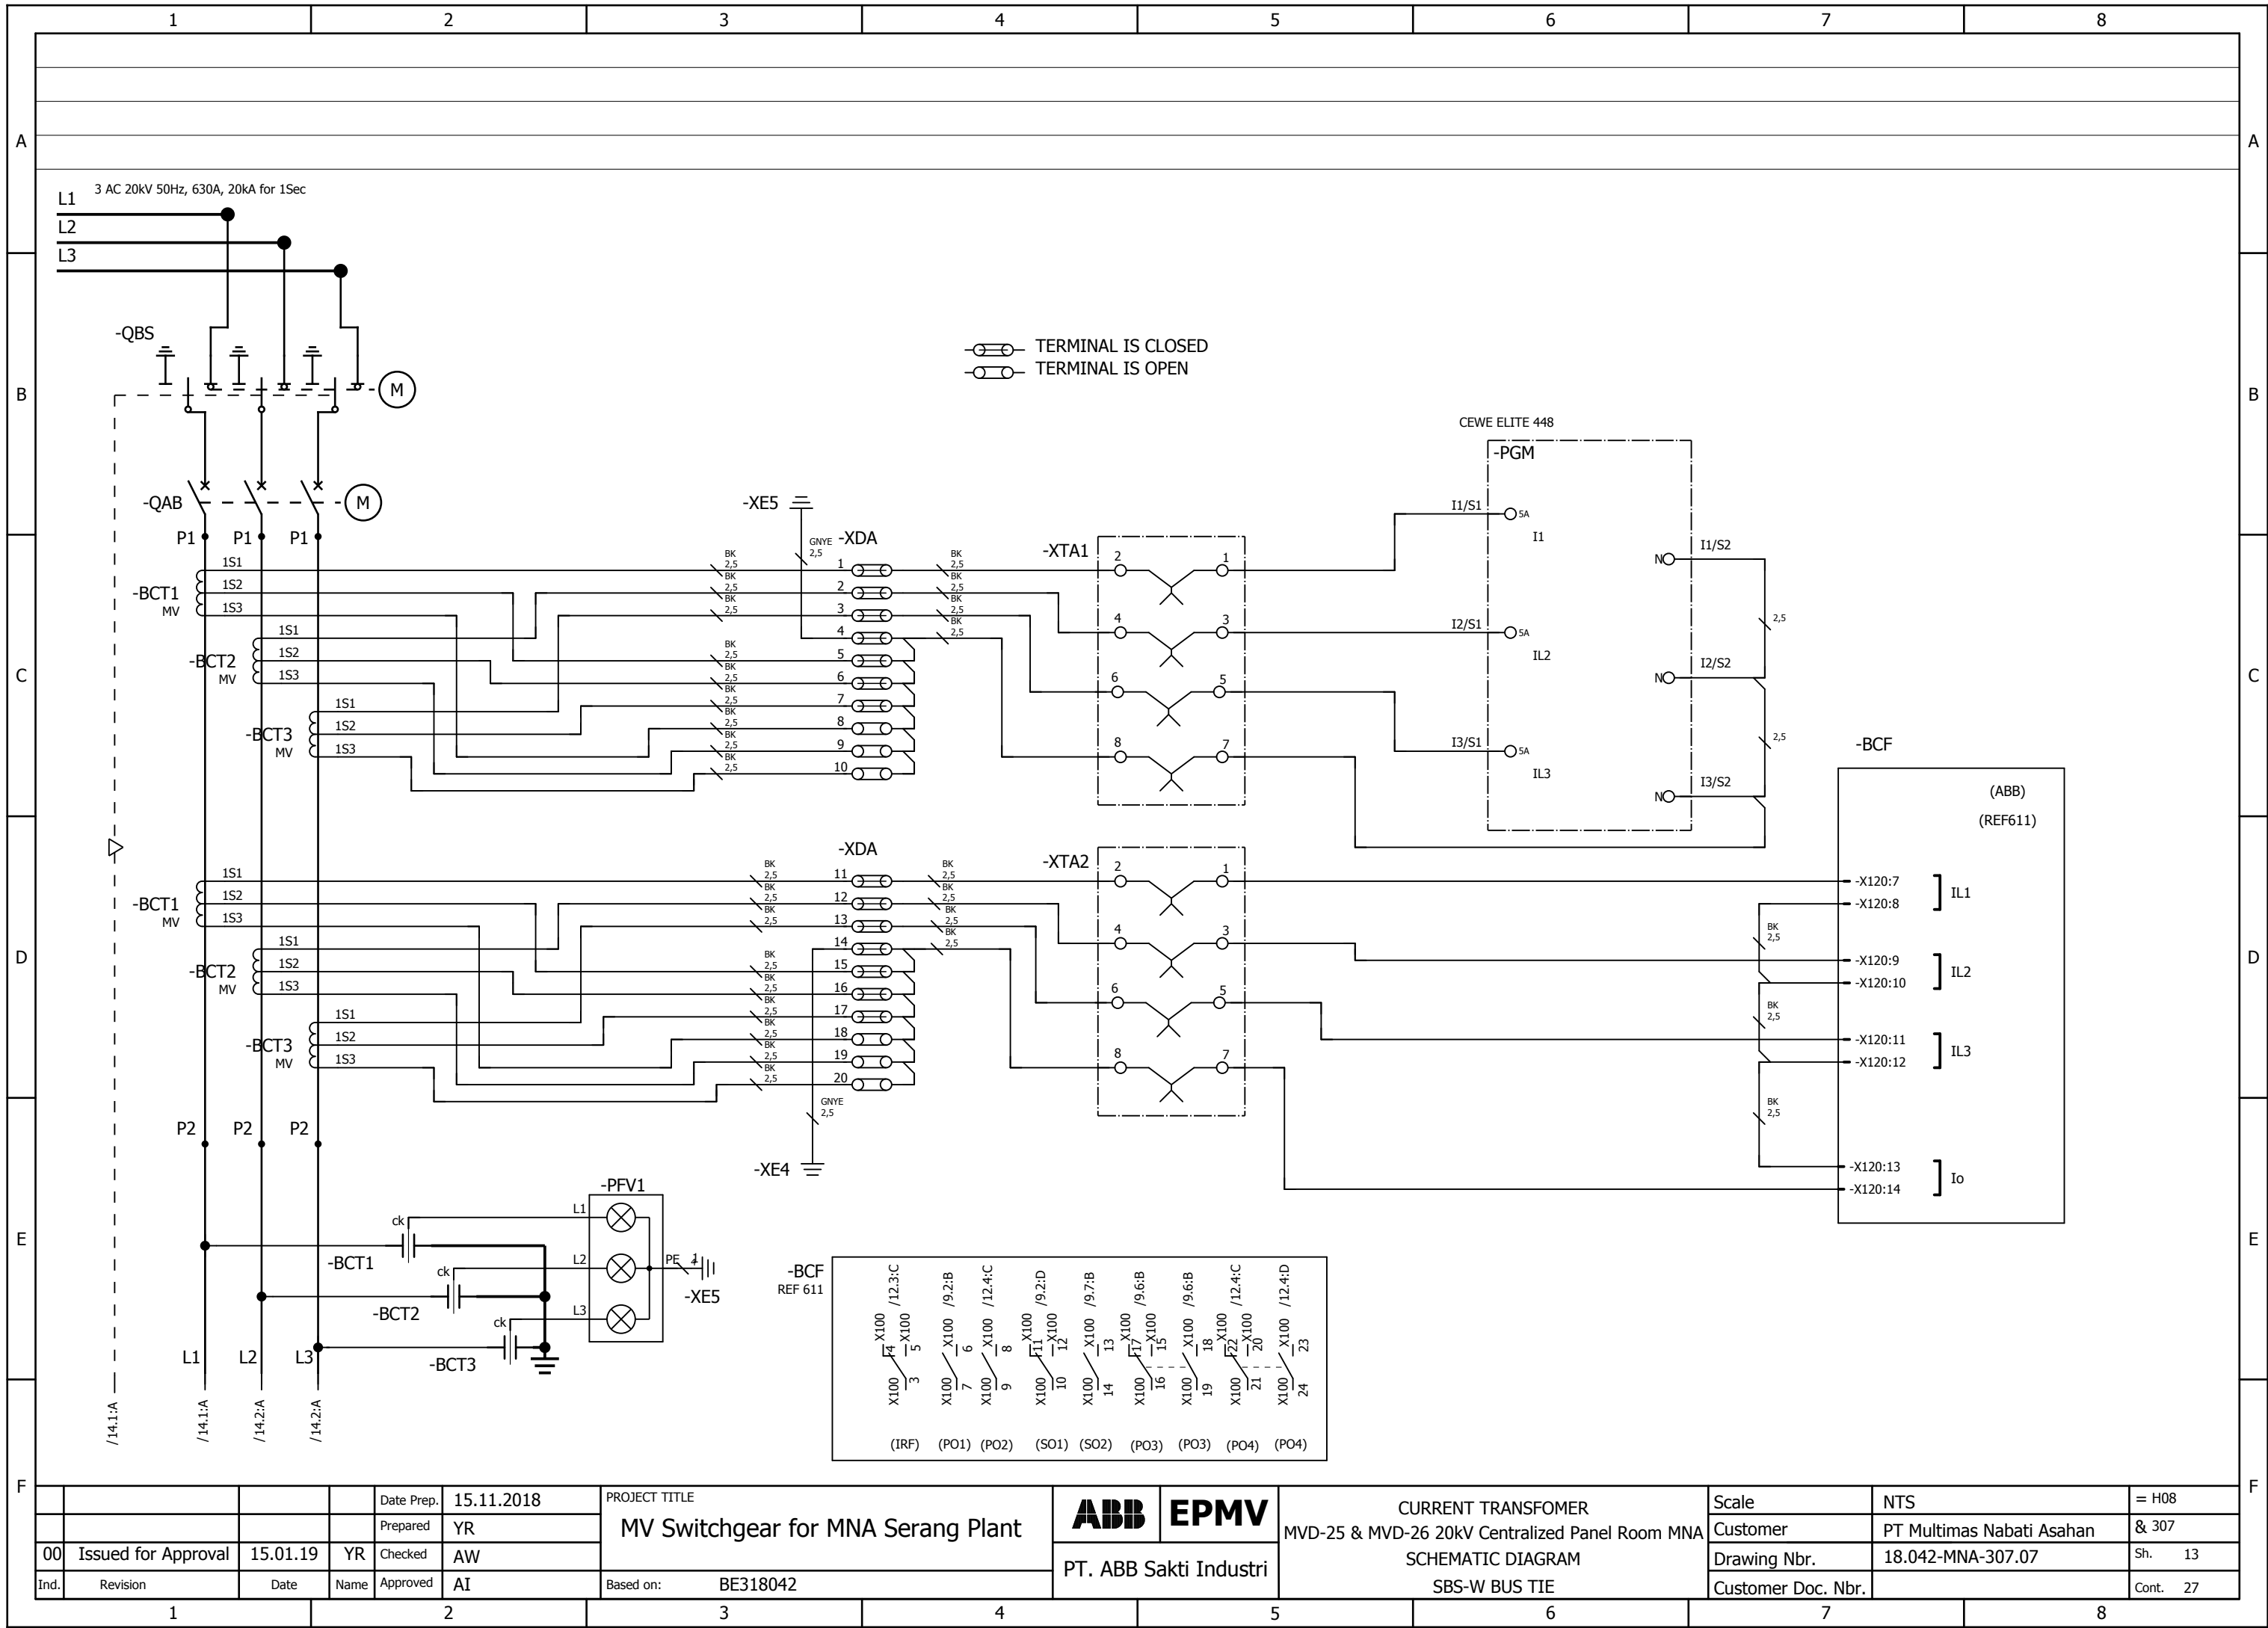


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

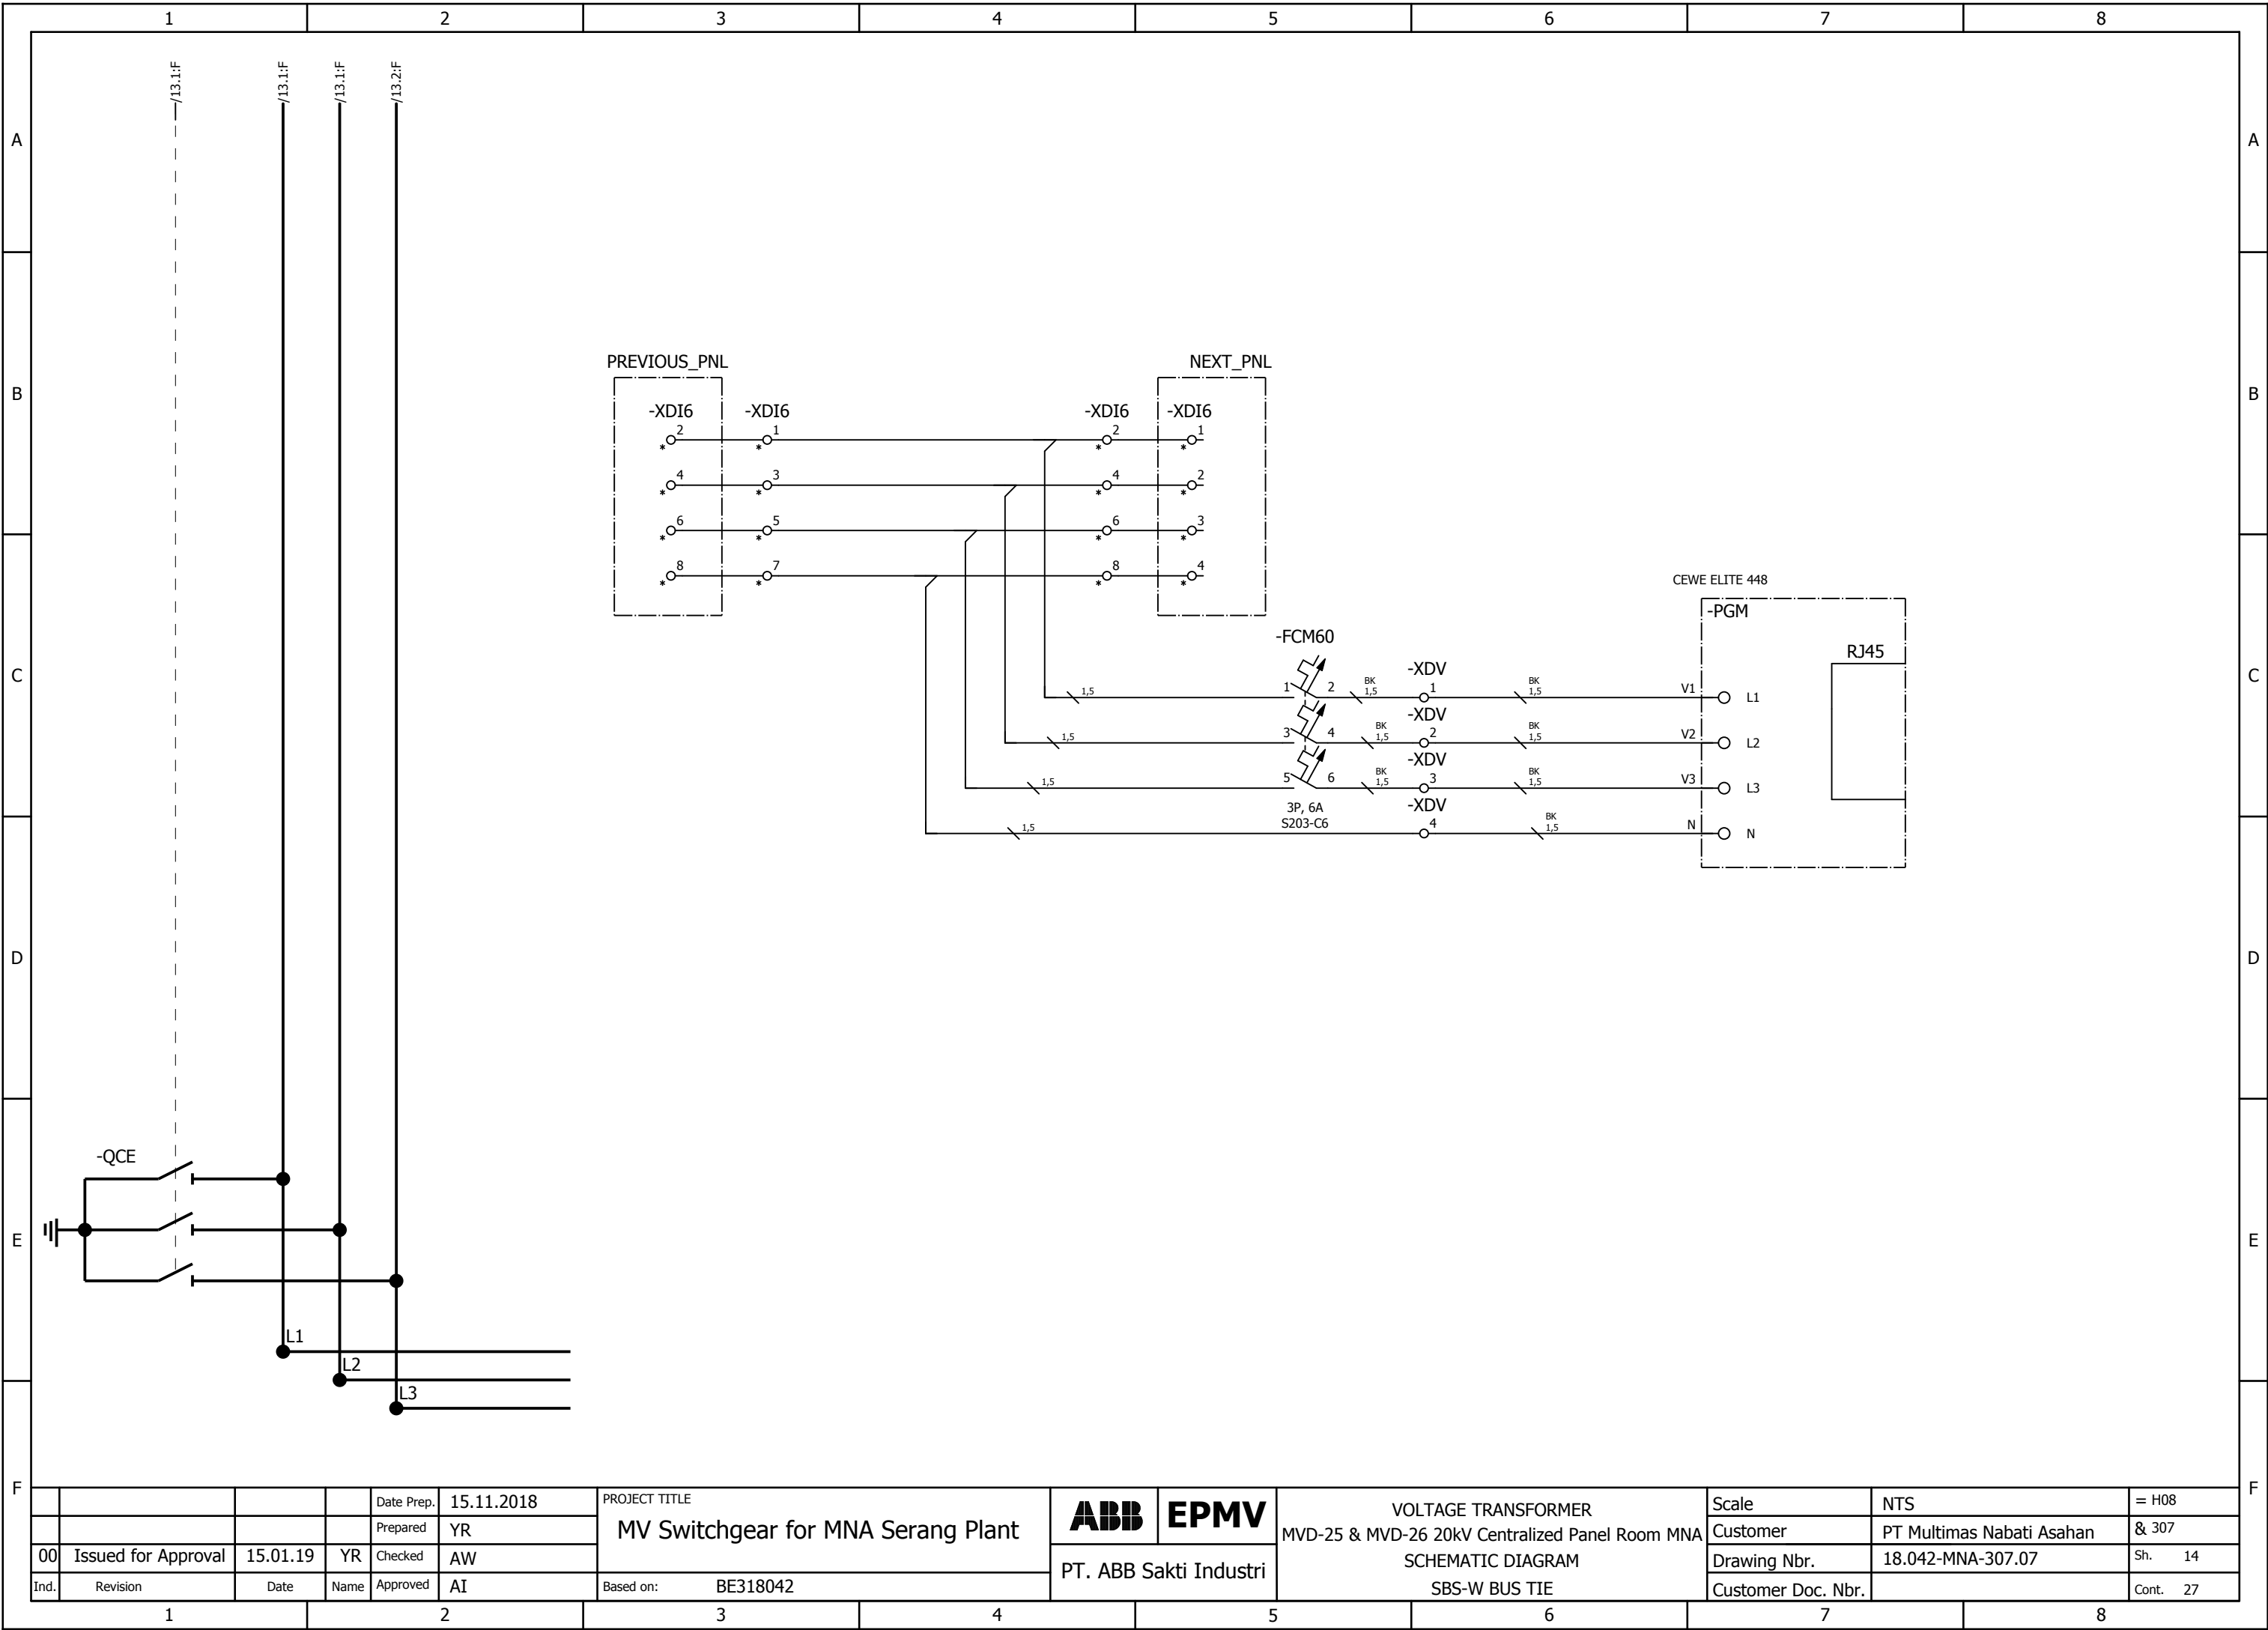

				Date Prep.	15.11.2018	PROJECT TITLE MV Switchgear for MNA Serang Plant	ABB	EPMV	VOLTAGE TRANSFORMER MVD-25 & MVD-26 20kV Centralized Panel Room MNA SCHEMATIC DIAGRAM SBS-W BUS TIE	Scale	NTS	= H08
				Prepared	YR					Customer	PT Multimas Nabati Asahan	& 307
00	Issued for Approval	15.01.19	YR	Checked	AW		PT. ABB Sakti Industri	Drawing Nbr.		18.042-MNA-307.07	Sh.	14
Ind.	Revision	Date	Name	Approved	AI	Based on: BE318042				Customer Doc. Nbr.		Cont. 27

No.	EQUIPMENT DESCRIPTION	ENGRAVING
1	-SFS (LOCAL-OFF-REMOTE SELECTOR SWITCH, K&N)	-SFS, LOCAL-OFF-REMOTE
2	-SFC (PUSH BUTTON CB CLOSE, GREEN, ABB)	-SFC, CB CLOSE
3	-SFO (PUSH BUTTON CB OPEN, RED, ABB)	-SFO, CB OPEN
4	-PFY1 (LAMP INDICATION FOR CB TRIP, YELLOW, ABB)	-PFY1, CB TRIP
5	-PFR1 (LAMP INDICATION FOR CB CLOSE, RED, ABB)	-PFR1, CB CLOSE
6	-PFG1 (LAMP INDICATION FOR CB OPEN, GREEN, ABB)	-PFG1, CB OPEN
7	-PGJ (DIGITAL MEASUREMENT, CEWE 448)	-PGJ, DIGITAL MEASUREMENT
8	-BCF (FEEDER PROTECTION RELAY, REF615J, ABB)	-BCF, RELAY PROTECTION
9	-XTA1, XTA2 (TEST BLOCK , YONGSUNG)	-XTA, CURRENT TEST BLOCK

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

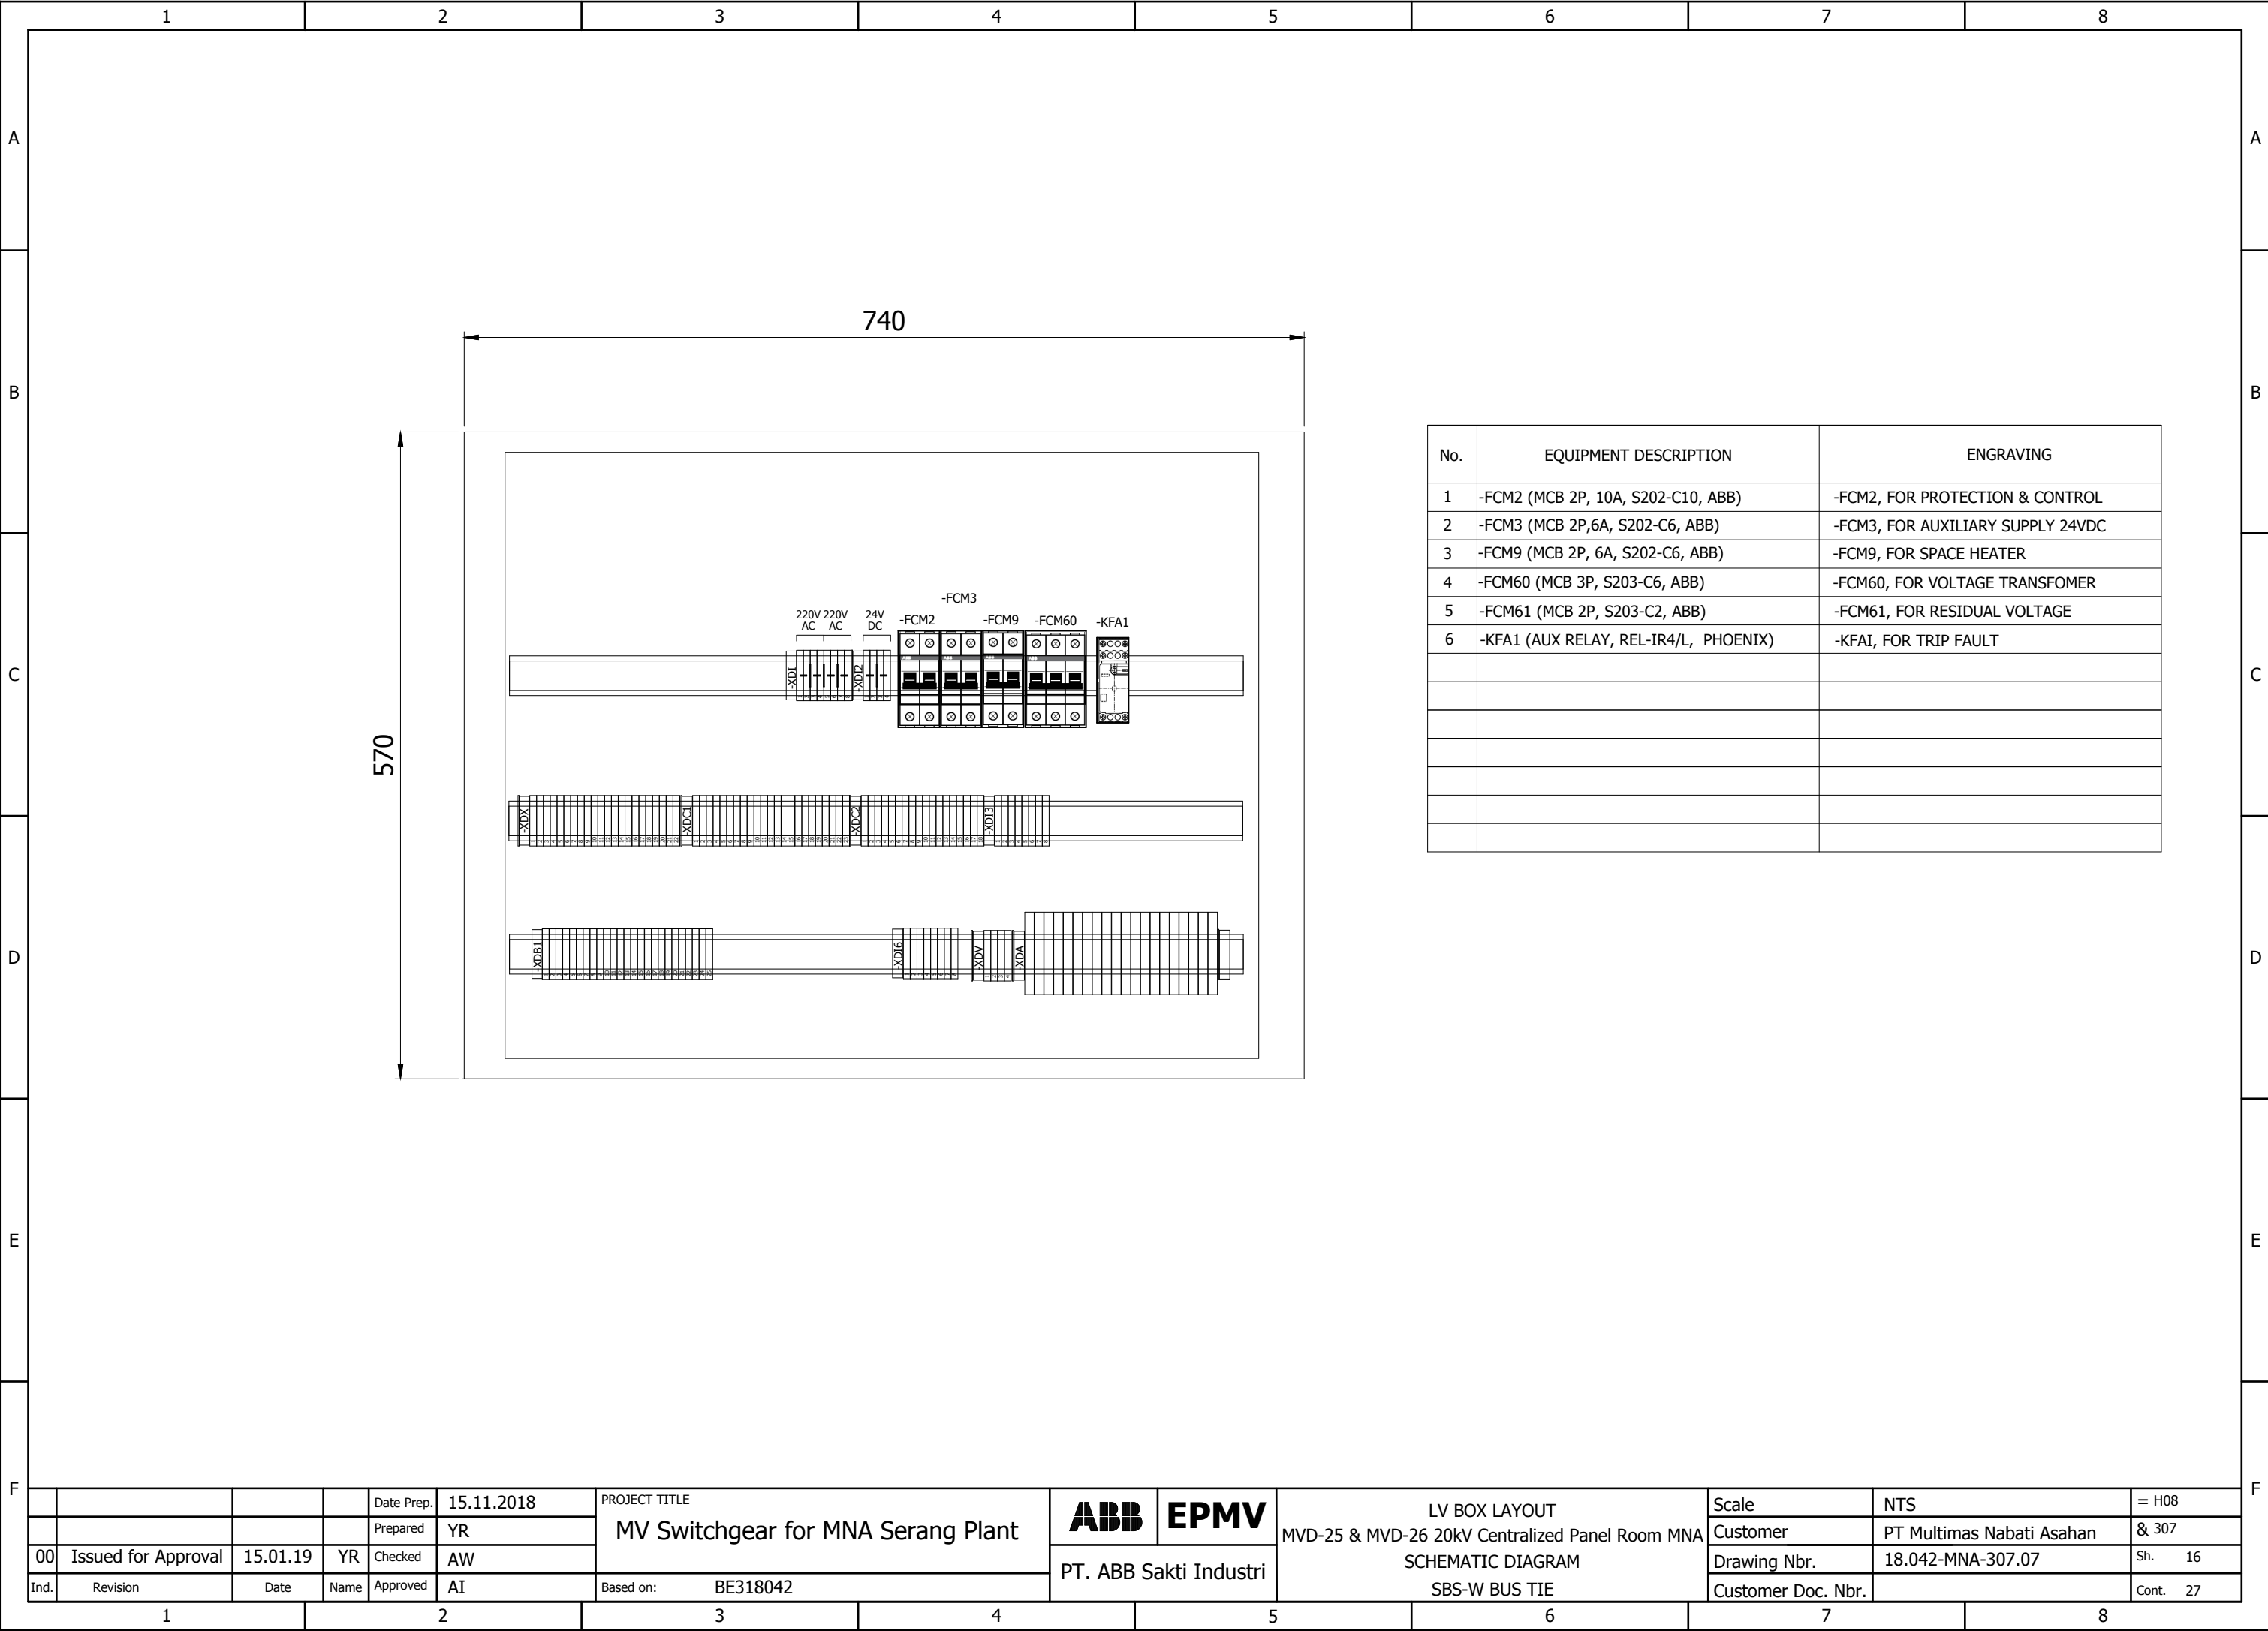

				Date Prep.	15.11.2018	PROJECT TITLE		ABB EPMV PT. ABB Sakti Industri	LV BOX LAYOUT MVD-25 & MVD-26 20kV Centralized Panel Room MNA SCHEMATIC DIAGRAM SBS-W BUS TIE	Scale	NTS	= H08
				Prepared	YR	MV Switchgear for MNA Serang Plant				Customer	PT Multimas Nabati Asahan	& 307
00	Issued for Approval	15.01.19	YR	Checked	AW					Drawing Nbr.	18.042-MNA-307.07	Sh. 16
Ind.	Revision	Date	Name	Approved	AI	Based on:	BE318042			Customer Doc. Nbr.		Cont. 27

1

2

3

4

5

6

7

8

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

	1	2	3	4	5	6	7	8			
A	Summarized parts list										
	IDABB_F02_005-IDABB										
	Carry over: 0.00										
	TAG ID		DESCRIPTION		MANUFACTUR/BRAND	PART NUMBER	QUANTITY	REMARKS			
	-BCF		Feeder Management Relay REF611HBAABC1NN11G		ABB	REF611HBAABC1NN11G	1	/8.2:C			
	-EB		HEATER 230VAC, 50W		SANYANG	CDXN010033P0009	1	/7.6:E			
	-FCM2		MCB S202-C10 MCB. 2P, 10A		ABB	2CDS252001R0104	1	/7.2:C			
	-FCM3;-FCM9		MCB S202-C6 MCB. 2P, 6A		ABB	2CDS252001R0064	2	/7.5:C;/7.6:C			
	-FCM60		MCB S203-C6 MCB. 3P, 6A		ABB	2CDS253001R0064	1	/14.5:C			
	-KFA1		Auxiliary Relay 230AC 4COS		PHOENIX	1YRA3DL266230001	1	/9.7:E			
	-PFG1		PILOT LIGHT GREEN #CL-523G#230VAC CL-523G		ABB	1SFA619402R5232	1	/8.5:E			
	-PFR1		PILOT LIGHT RED #CL-523R#230VAC CL-523R		ABB	1SFA619402R5231	1	/8.4:E			
	-PFY1		PILOT LIGHT YELLOW #CL-523Y#230VAC CL-523Y		ABB	1SFA619402R5233	1	/8.6:E			
	-PGM1		POWER METER CEWE 448 Class : 0.5s; CT Input : 1A; VT Input : 57.7-240V (L-N); Aux. Voltage: 80-300VAC/DC		CEWE	1YRA4EA0350001	1	/8.3:C			
	B	-SFC		PUSH BUTTON, YW1B-M1E10-G GREEN COLOUR		IDEC	1YRA3DA14700001	1	/9.2:B		
-SFO		PUSH BUTTON, YW1B-M1E10-R RED COLOUR		IDEC	1YRA3DA14700002	1	/9.4:B				
-SFS		LOCAL/REMOTE Selector Switch Type : S0-CA10-A723-600-E; 4NC (for LOCAL Position) & 4NO (for REMOTE Position)		K&N	1YRA3DA17940011	1	/9.2:B				
-XTA1;-XTA2		Current Test Block Rated Current : 10A, 250V; Mounting : Flush Mounting		YONGSUNG	YSCTT-04C	2	/13.4:C;/13.4:D				
C											
D											
E											
F											
				PROJECT TITLE		PART LIST		Scale	NTS	= H08	
				MV Switchgear for MNA Serang Plant		MVD-25 & MVD-26 20kV Centralized Panel Room MNA		Customer	PT Multimas Nabati Asahan	& 307	
00		Issued for Approval	15.01.19	YR	Checked	AW	SCHEMATIC DIAGRAM		Drawing Nbr.	18.042-MNA-307.07	Sh. 17
Ind.		Revision	Date	Name	Approved	AI	SBS-W BUS TIE		Customer Doc. Nbr.		Cont. 27
1		2		3		4		5		6	
7		8									

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]

F										D	C	B	A						
==MVD-25_MVD-26=H08+-XDX										REMARK	CABLE	EQUIPMENT	WIRE NO.	TYPE	Terminal number	Wire No	EQUIPMENT	CABLE	REMARK
										BK 1,5 mm²	-XDB1:16	-XDB1:16	PT 2.5	1			-FCM2:2	BK 1,5 mm²	
		BK 1,5 mm²	-BCF:-X100:1		PT 2.5	2													
		BK 1,5 mm²	-XDB1:6		PT 2.5	3													
		BK 1,5 mm²	-XDB1:7		PT 2.5	4													
			-KFA1:14		PT 2.5	5													
			-XDB1:10		PT 2.5	6													
			-XDB1:12		PT 2.5	7													
			-KFA1:24		PT 2.5	8													
		BK 1,5 mm²	-SFS:2		PT 2.5	9													
		BK 1,5 mm²	-BCF:X100:16		PT 2.5	10													
			-BCF:X100:14		PT 2.5	11													
					PT 2.5	12													
		BK 2,5 mm²	-QBS-KFU-XDB97:16		PT 2.5	13													
		BK 1,5 mm²	-FCM2:4		PT 2.5	14											BK 1,5 mm²		
					PT 2.5	15											BK 1,5 mm²		
					PT 2.5	16											BK 1,5 mm²		
					PT 2.5	17													
					PT 2.5	18											BK 1,5 mm²		
					PT 2.5	19											BK 1,5 mm²		
					PT 2.5	20													
					PT 2.5	21													
					PT 2.5	22													