

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
														Lower	Upper	LL		L	H	HH				
		0202	ADV151-P	5-5-1	5	5	1	LAH1701S	LAH1701	17D01 Drier Lvl Hi	17D01 Drier	Lvl Hi	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-2	5	5	2	LAH1702S	LAH1702	17F01 Dist. Lvl Hi	17F01 Dist.	Lvl Hi	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-3	5	5	3	LAH1703S	LAH1703	17F03 Res. Rec Lvl Hi	17F03 Res.	Rec Lvl Hi	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-4	5	5	4	LAH1704S	LAH1704	17F04 Light End Lvl Hi	17F04 Light	End Lvl Hi	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-5	5	5	5	LAL1705S	LAL1705	17F05Hotwell Lvl Lo	17F05Hotwell	Lvl Lo	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-6	5	5	6	LAL1706S	LAL1706	17P19-40- 16B10	17P19-40-	16B10	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-7	5	5	7	LAL1707S	LAL1707	17P15-40- 16B10	17P15-40-	16B10	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-8	5	5	8	LAL1708S	LAL1708	17P34-100- 16B10	17P34-100-	16B10	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-9	5	5	9	KV1701OI	KV1701	17E08 Steam Gen Conduc.	17E08 Steam	Gen Conduc.	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-10	5	5	10	KV1701CI	KV1701				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-11	5	5	11	KV1702OI	KV1702	17E09 Steam Gen Conduc.	17E09 Steam	Gen Conduc.	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-12	5	5	12	KV1702CI	KV1702				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-13	5	5	13	KV1703OI	KV1703	Vacuum Sys Act. Valve	Vacuum Sys	Act. Valve	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-14	5	5	14	KV1703CI	KV1703				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-15	5	5	15	17G02ASTI	17G02A	ME Circ Pump A	ME Circ Pump	A	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-16	5	5	16	17G02ATRI	17G02A				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-17	5	5	17	17G02BSTI	17G02B	ME Circ Pump B	ME Circ Pump	B	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-18	5	5	18	17G02BTRI	17G02B				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-19	5	5	19	17G03ASTI	17G03A	ME Transfer Pump A	ME Transfer	Pump A	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-20	5	5	20	17G03ATRI	17G03A				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-21	5	5	21	17G03BSTI	17G03B	ME Transfer Pump B	ME Transfer	Pump B	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-22	5	5	22	17G03BTRI	17G03B				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-23	5	5	23	17G04ASTI	17G04A	FFE Circ. Pump A	FFE Circ.	Pump A	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-24	5	5	24	17G04ATRI	17G04A				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-25	5	5	25	17G04BSTI	17G04B	FFE Circ. Pump B	FFE Circ.	Pump B	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-26	5	5	26	17G04BTRI	17G04B				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-27	5	5	27	17G05ASTI	17G05A	Transfer Pump A	Transfer	Pump A	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-28	5	5	28	17G05ATRI	17G05A				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-29	5	5	29	17G05BSTI	17G05B	Transfer Pump B	Transfer	Pump B	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-30	5	5	30	17G05BTRI	17G05B				DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-31	5	5	31	17G06ASTI	17G06A	FFE Circ. Pump A	FFE Circ.	Pump A	DI	NIS							ME-Fract			
		0202	ADV151-P	5-5-32	5	5	32	17G06ATRI	17G06A				DI	NIS							ME-Fract			
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
														Lower	Upper	LL		L	H	HH				
		0202	ADV151-P	5-6-1	5	6	1	17G06BSTI	17G06B	FFE Circ. Pump B	FFE Circ.	Pump B	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-2	5	6	2	17G06BTRI	17G06B				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-3	5	6	3	17G06CSTI	17G06C	FFE Circ. Pump C	FFE Circ.	Pump C	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-4	5	6	4	Broken	Broken				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-5	5	6	5	17G07ASTI	17G07A	FFE Circ. Pump A	FFE Circ.	Pump A	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-6	5	6	6	17G07ATRI	17G07A				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-7	5	6	7	17G07BSTI	17G07B	FFE Circ. Pump B	FFE Circ.	Pump B	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-8	5	6	8	17G07BTRI	17G07B				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-9	5	6	9	17G10STI	17G10	Top Fraction Pump	Top Fraction	Pump	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-10	5	6	10	17G10TRI	17G10				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-11	5	6	11	17G11STI	17G11	SideFraction I Pump	SideFraction	I Pump	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-12	5	6	12	17G11TRI	17G11				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-13	5	6	13	17G12STI	17G12	SideFraction II Pump	SideFraction	II Pump	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-14	5	6	14	17G12TRI	17G12				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-15	5	6	15	17G15STI	17G15	Distillate Pump	Distillate	Pump	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-16	5	6	16	17G15TRI	17G15				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-17	5	6	17	17G17STI	17G17	Residue Pump	Residue Pump		DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-18	5	6	18	17G17TRI	17G17				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-19	5	6	19	17G18STI	17G18	Light End Pump	Light End	Pump	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-20	5	6	20	17G18TRI	17G18				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-21	5	6	21	17G20STI	17G20	Preheater	Preheater		DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-22	5	6	22	17G20TRI	17G20				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-23	5	6	23	17G21STI	17G21	FFE Circ. Pump	FFE Circ.	Pump	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-24	5	6	24	17G21TRI	17G21				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-25	5	6	25	17G22ASTI	17G22A	FFE Circ. Pump A	FFE Circ.	Pump A	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-26	5	6	26	17G22ATRI	17G22A				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-27	5	6	27	17G22BSTI	17G22B	FFE Circ. Pump B	FFE Circ.	Pump B	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-28	5	6	28	17G22BTRI	17G22B				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-29	5	6	29	17G23STI	17G23	FFE Circ. Pump	FFE Circ.	Pump	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-30	5	6	30	17G23TRI	17G23				DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-31	5	6	31	17G30STI	17G30	WCT Circ. Pump	WCT Circ.	Pump	DI	NIS							ME-Fract			
		0202	ADV151-P	5-6-32	5	6	32	17G30TRI	17G30				DI	NIS							ME-Fract			

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
															Lower	Upper		LL	L	H	HH			
		0202	ADV151-P	5-7-1	5	7	1	17G35STI	17G35	Inline Pump	Inline Pump		DI	NIS							ME-Fract			
		0202	ADV151-P	5-7-2	5	7	2	17G35TRI	17G35				DI	NIS							ME-Fract			
		0202	ADV151-P	5-7-3	5	7	3	17G36STI	17G36	Inline Pump	Inline Pump		DI	NIS							ME-Fract			
		0202	ADV151-P	5-7-4	5	7	4	17G36TRI	17G36				DI	NIS							ME-Fract			
		0202	ADV151-P	5-7-5	5	7	5	17G37STI	17G37	Inline Pump	Inline Pump		DI	NIS							ME-Fract			
		0202	ADV151-P	5-7-6	5	7	6	17G37TRI	17G37				DI	NIS							ME-Fract			
		0202	ADV151-P	5-7-7	5	7	7	17G54STI	17G54	Vacuum Ring Pump	Vacuum Ring	Pump	DI	NIS							ME-Fract			
		0202	ADV151-P	5-7-8	5	7	8	17G54TRI	17G54				DI	NIS							ME-Fract			
		0202	ADV151-P	5-7-9	5	7	9	AG901700STI	AG901700				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-10	5	7	10	AG901700TRI	AG901700				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-11	5	7	11	AG901701STI	AG901701				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-12	5	7	12	AG901701TRI	AG901701				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-13	5	7	13	AG901702STI	AG901702				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-14	5	7	14	AG901702TRI	AG901702				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-15	5	7	15	AG901703STI	AG901703				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-16	5	7	16	AG901703TRI	AG901703				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-17	5	7	17	AG901704STI	AG901704				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-18	5	7	18	AG901704TRI	AG901704				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-19	5	7	19	AG901705STI	AG901705				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-20	5	7	20	AG901705TRI	AG901705				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-21	5	7	21	AG901706STI	AG901706				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-22	5	7	22	AG901706TRI	AG901706				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-23	5	7	23	AG901707STI	AG901707				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-24	5	7	24	AG901707TRI	AG901707				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-25	5	7	25	AG901708STI	AG901708				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-26	5	7	26	AG901708TRI	AG901708				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-27	5	7	27	AG901709STI	AG901709				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-28	5	7	28	AG901709TRI	AG901709				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-29	5	7	29	AG901710STI	AG901710				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-30	5	7	30	AG901710TRI	AG901710				DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-31	5	7	31	PU901700ASTI	PU901700A	CME	CME		DI	NIS							ME-TF1			
		0202	ADV151-P	5-7-32	5	7	32	PU901700ATRI	PU901700A				DI	NIS							ME-TF1			
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
															Lower	Upper		LL	L	H	HH			
		0202	ADV151-P	6-5-1	6	5	1	PU901700BSTI	PU901700B	CME	CME		DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-2	6	5	2	PU901700BTRI	PU901700B				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-3	6	5	3	PU901701STI	PU901701	Light/Mix ME	Light/Mix ME		DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-4	6	5	4	PU901701TRI	PU901701				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-5	6	5	5	PU901703STI	PU901703	8/10 ME	8/10 ME		DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-6	6	5	6	PU901703TRI	PU901703				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-7	6	5	7	PU901705STI	PU901705	12/14 ME	12/14 ME		DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-8	6	5	8	PU901705TRI	PU901705				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-9	6	5	9	PU901708STI	PU901708	C16/18 ME	C16/18 ME		DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-10	6	5	10	PU901708TRI	PU901708				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-11	6	5	11	PU901710STI	PU901710	Heavy ME	Heavy ME		DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-12	6	5	12	PU901710TRI	PU901710				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-13	6	5	13	PU901711STI	PU901711	ME residue	ME residue		DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-14	6	5	14	PU901711TRI	PU901711				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-15	6	5	15	VS1721OI	VS1721				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-16	6	5	16	VS1721CI					DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-17	6	5	17	VS1722OI	VS1722				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-18	6	5	18	VS1722CI					DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-19	6	5	19	VS1723OI	VS1723				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-20	6	5	20	VS1723CI					DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-21	6	5	21	VS1731OI	VS1731				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-22	6	5	22	VS1731CI					DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-23	6	5	23	VS1732OI	VS1732				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-24	6	5	24	VS1732CI					DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-25	6	5	25	VS1741OI	VS1741				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-26	6	5	26	VS1741CI					DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-27	6	5	27	VS1742OI	VS1742				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-28	6	5	28	VS1742CI					DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-29	6	5	29	VS1751OI	VS1751				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-30	6	5	30	VS1751CI					DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-31	6	5	31	VS1752OI	VS1752				DI	NIS							ME-TF1			
		0202	ADV151-P	6-5-32	6	5	32	VS1752CI					DI	NIS							ME-TF1			

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description				IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
															Lower	Upper	LL		L	H	HH				
		0202	ADV151-P	6-6-1	6	6	1	AG91909ASTI	AG91909A					DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-2	6	6	2	AG91909ATRI						DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-3	6	6	3	AG91909BSTI	AG91909B					DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-4	6	6	4	AG91909BTRI						DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-5	6	6	5	AG91910ASTI	AG91910A					DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-6	6	6	6	AG91910ATRI						DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-7	6	6	7	AG91910BSTI	AG91910B					DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-8	6	6	8	AG91910BTRI						DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-9	6	6	9	PU91909ASTI	PU91909A	C8/10 ME Export	C8/10 ME	Export		DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-10	6	6	10	PU91909ATRI						DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-11	6	6	11	AG91911ASTI	AG91911A					DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-12	6	6	12	AG91911ATRI						DI	NIS							ME-TF2			
		0202	ADV151-P	6-6-13	6	6	13	AG91911BSTI	AG91911B					DI	NIS							ME-TF3			
		0202	ADV151-P	6-6-14	6	6	14	AG91911BTRI						DI	NIS							ME-TF3			
		0202	ADV151-P	6-6-15	6	6	15	AG91912ASTI	AG91912A					DI	NIS							ME-TF3			
		0202	ADV151-P	6-6-16	6	6	16	AG91912ATRI						DI	NIS							ME-TF3			
		0202	ADV151-P	6-6-17	6	6	17	AG91912BSTI	AG91912B					DI	NIS							ME-TF3			
		0202	ADV151-P	6-6-18	6	6	18	AG91912BTRI						DI	NIS							ME-TF3			
		0202	ADV151-P	6-6-19	6	6	19	AG91913ASTI	AG91913A					DI	NIS							ME-TF4			
		0202	ADV151-P	6-6-20	6	6	20	AG91913ATRI						DI	NIS							ME-TF4			
		0202	ADV151-P	6-6-21	6	6	21	AG91913BSTI	AG91913B					DI	NIS							ME-TF4			
		0202	ADV151-P	6-6-22	6	6	22	AG91913BTRI						DI	NIS							ME-TF4			
		0202	ADV151-P	6-6-23	6	6	23	AG91914ASTI	AG91914A					DI	NIS							ME-TF4			
		0202	ADV151-P	6-6-24	6	6	24	AG91914ATRI						DI	NIS							ME-TF4			
		0202	ADV151-P	6-6-25	6	6	25	AG91914BSTI	AG91914B					DI	NIS							ME-TF4			
		0202	ADV151-P	6-6-26	6	6	26	AG91914BTRI						DI	NIS							ME-TF4			
		0202	ADV151-P	6-6-27	6	6	27	SPARE						DI	NIS										
		0202	ADV151-P	6-6-28	6	6	28	SPARE						DI	NIS										
		0202	ADV151-P	6-6-29	6	6	29	SPARE						DI	NIS										
		0202	ADV151-P	6-6-30	6	6	30	SPARE						DI	NIS										
		0202	ADV151-P	6-6-31	6	6	31	SPARE						DI	NIS										
		0202	ADV151-P	6-6-32	6	6	32	SPARE						DI	NIS										
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description				IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
																Lower	Upper		LL	L	H	HH			
		0202	ADV151-P	8-4-1	8	4	1	LS250WW1S	LS250WW1					DI	NIS								ME-UT-WWT		
		0202	ADV151-P	8-4-2	8	4	2	LS250WW2S	LS250WW2					DI	NIS								ME-UT-WWT		
		0202	ADV151-P	8-4-3	8	4	3	LS250WW3S	LS250WW3					DI	NIS								ME-UT-WWT		
		0202	ADV151-P	8-4-4	8	4	4	PU250WW1STI	PU250WW1	waste water from ME plt	waste water	from ME plt		DI	NIS								ME-UT-WWT		
		0202	ADV151-P	8-4-5	8	4	5	PU250WW1TRI	PU250WW1					DI	NIS								ME-UT-WWT		
		0202	ADV151-P	8-4-6	8	4	6	PU250WW2STI	PU250WW2	waste water from ME TF	waste water	from ME TF		DI	NIS								ME-UT-WWT		
		0202	ADV151-P	8-4-7	8	4	7	PU250WW2TRI	PU250WW2					DI	NIS								ME-UT-WWT		
		0202	ADV151-P	8-4-8	8	4	8	PU250WW3STI	PU250WW3	waste water from ME Export TF	waste water	from ME Expo		DI	NIS								ME-UT-WWT		
		0202	ADV151-P	8-4-9	8	4	9	PU250WW3TRI	PU250WW3					DI	NIS								ME-UT-WWT		
		0202	ADV151-P	8-4-10	8	4	10	PU2500ASTI	PU2500A	T.water to C.Tower	T.water to	C.Tower		DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-11	8	4	11	PU2500ATRI	PU2500A					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-12	8	4	12	PU2500BSTI	PU2500B	T.water to C.Tower	T.water to	C.Tower		DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-13	8	4	13	PU2500BTRI	PU2500B					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-14	8	4	14	PU2501ASTI	PU2501A	DI water	DI water			DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-15	8	4	15	PU2501ATRI	PU2501A					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-16	8	4	16	PU2501BSTI	PU2501B	DI water	DI water			DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-17	8	4	17	PU2501BTRI	PU2501B					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-18	8	4	18	PU2502ASTI	PU2502A	DI water	DI water			DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-19	8	4	19	PU2502ATRI	PU2502A					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-20	8	4	20	PU2502BSTI	PU2502B	DI water	DI water			DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-21	8	4	21	PU2502BTRI	PU2502B					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-22	8	4	22	PU2503ASTI	PU2503A	Fd to 17D00 Dearator	Fd to 17D00	Dearator		DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-23	8	4	23	PU2503ATRI	PU2503A					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-24	8	4	24	PU2503BSTI	PU2503B	Fd to 17D02 Dearator	Fd to 17D02	Dearator		DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-25	8	4	25	PU2503BTRI	PU2503B					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-26	8	4	26	PU17D00ASTI	PU17D00A	D'ratorDI to Plt 116 Stm Gen	D'ratorDI to	Plt 116 Stm		DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-27	8	4	27	PU17D00ATRI	PU17D00A					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-28	8	4	28	PU17D00BSTI	PU17D00B	D'ratorDI to Plt 116 Stm Gen	D'ratorDI to	Plt 116 Stm		DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-29	8	4	29	PU17D00BTRI	PU17D00B					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-30	8	4	30	LSL250CWS	LSL250CW					DI	NIS								ME-UT-DIW		
		0202	ADV151-P	8-4-31	8	4	31	LSH1750S	LSH1750S					DI	NIS										
		0202	ADV151-P	8-4-32	8	4	32	SPARE						DI	NIS										

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
														Lower	Upper	LL		L	H	HH				
		0202	ADV151-P	8-5-1	8	5	1	LSHA117F07S	LSHA117F07				DI	NIS							ME-UT-TOH			
		0202	ADV151-P	8-5-2	8	5	2	LSLA117F08S	LSLA117F08				DI	NIS							ME-UT-TOH			
		0202	ADV151-P	8-5-3	8	5	3	LSLA150CT04S	LSLA150CT04				DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-4	8	5	4	FN150CT04ASTI	FN150CT04A				DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-5	8	5	5	FN150CT04ATRI					DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-6	8	5	6	FN150CT04BSTI	FN150CT04B				DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-7	8	5	7	FN150CT04BTRI					DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-8	8	5	8	PU150CCW9STI	PU150CCW9				DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-9	8	5	9	PU150CCW9TRI					DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-10	8	5	10	PU150CCW10STI	PU150CCW10				DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-11	8	5	11	PU150CCW10TRI					DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-12	8	5	12	SV150CT04OI	SV150CT04				DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-13	8	5	13	SV150CT04CI					DI	NIS							ME-UT-CCW			
		0202	ADV151-P	8-5-14	8	5	14	PU117F07STI	PU1117F07				DI	NIS							ME-UT-TOH			
		0202	ADV151-P	8-5-15	8	5	15	PU117F07TRI					DI	NIS							ME-UT-TOH			
		0202	ADV151-P	8-5-16	8	5	16	17G50STI	17G50				DI	NIS							ME-Fract			
		0202	ADV151-P	8-5-17	8	5	17	17G50TRI					DI	NIS							ME-Fract			
		0202	ADV151-P	8-5-18	8	5	18	PU91909BSTI	PU91909B	C8/10 ME Export	C8/10 ME	Export	DI	NIS							ME-TF2			
		0202	ADV151-P	8-5-19	8	5	19	PU91909BTRI					DI	NIS										
		0202	ADV151-P	8-5-20	8	5	20	SPARE					DI	NIS										
		0202	ADV151-P	8-5-21	8	5	21	SPARE					DI	NIS										
		0202	ADV151-P	8-5-22	8	5	22	SPARE					DI	NIS										
		0202	ADV151-P	8-5-23	8	5	23	17G06CTRI	17G06C	FFE Circ. Pump C	FFE Circ.	Pump C	DI	NIS										
		0202	ADV151-P	8-5-24	8	5	24	SPARE					DI	NIS										
		0202	ADV151-P	8-5-25	8	5	25	SPARE					DI	NIS										
		0202	ADV151-P	8-5-26	8	5	26	SPARE					DI	NIS										
		0202	ADV151-P	8-5-27	8	5	27	SPARE					DI	NIS										
		0202	ADV151-P	8-5-28	8	5	28	SPARE					DI	NIS										
		0202	ADV151-P	8-5-29	8	5	29	SPARE					DI	NIS										
		0202	ADV151-P	8-5-30	8	5	30	SPARE					DI	NIS										
		0202	ADV151-P	8-5-31	8	5	31	SPARE					DI	NIS										
		0202	ADV151-P	8-5-32	8	5	32	SPARE					DI	NIS										
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
															Lower	Upper		LL	L	H	HH			
		0202	ADV151-P	8-6-1	8	6	1	SPARE					DI	NIS										
		0202	ADV151-P	8-6-2	8	6	2	SPARE					DI	NIS										
		0202	ADV151-P	8-6-3	8	6	3	SPARE					DI	NIS										
		0202	ADV151-P	8-6-4	8	6	4	SPARE					DI	NIS										
		0202	ADV151-P	8-6-5	8	6	5	SPARE					DI	NIS										
		0202	ADV151-P	8-6-6	8	6	6	SPARE					DI	NIS										
		0202	ADV151-P	8-6-7	8	6	7	SPARE					DI	NIS										
		0202	ADV151-P	8-6-8	8	6	8	SPARE					DI	NIS										
		0202	ADV151-P	8-6-9	8	6	9	SPARE					DI	NIS										
		0202	ADV151-P	8-6-10	8	6	10	SPARE					DI	NIS										
		0202	ADV151-P	8-6-11	8	6	11	SPARE					DI	NIS										
		0202	ADV151-P	8-6-12	8	6	12	SPARE					DI	NIS										
		0202	ADV151-P	8-6-13	8	6	13	SPARE					DI	NIS										
		0202	ADV151-P	8-6-14	8	6	14	SPARE					DI	NIS										
		0202	ADV151-P	8-6-15	8	6	15	SPARE					DI	NIS										
		0202	ADV151-P	8-6-16	8	6	16	SPARE					DI	NIS										
		0202	ADV151-P	8-6-17	8	6	17	SPARE					DI	NIS										
		0202	ADV151-P	8-6-18	8	6	18	SPARE					DI	NIS										
		0202	ADV151-P	8-6-19	8	6	19	SPARE					DI	NIS										
		0202	ADV151-P	8-6-20	8	6	20	SPARE					DI	NIS										
		0202	ADV151-P	8-6-21	8	6	21	SPARE					DI	NIS										
		0202	ADV151-P	8-6-22	8	6	22	SPARE					DI	NIS										
		0202	ADV151-P	8-6-23	8	6	23	SPARE					DI	NIS										
		0202	ADV151-P	8-6-24	8	6	24	SPARE					DI	NIS										
		0202	ADV151-P	8-6-25	8	6	25	SPARE					DI	NIS										
		0202	ADV151-P	8-6-26	8	6	26	SPARE					DI	NIS										
		0202	ADV151-P	8-6-27	8	6	27	SPARE					DI	NIS										
		0202	ADV151-P	8-6-28	8	6	28	SPARE					DI	NIS										
		0202	ADV151-P	8-6-29	8	6	29	SPARE					DI	NIS										
		0202	ADV151-P	8-6-30	8	6	30	SPARE					DI	NIS										
		0202	ADV151-P	8-6-31	8	6	31	SPARE					DI	NIS										
		0202	ADV151-P	8-6-32	8	6	32	SPARE					DI	NIS										

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description		Service Description	IO Type		Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	comment
																		LL	L	H	HH			
		0202	ADV551-P	7-3-1	7	3	1	KV1701O	KV1701	17E08 Steam generator conductivity actuator valve	17E08 Steam generator co	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-2	7	3	2	KV1702O	KV1702	17E09 Steam generator conductivity actuator valve	17E09 Steam generator co	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-3	7	3	3	KV1703O	KV1703	Vacumm system actuator valve	Vacumm syste m actuator v	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-4	7	3	4	17G02AO	17G2A	ME Circulation pump A	ME Circulati on pump A	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-5	7	3	5	17G02BO	17G2B	ME Circulation pump B	ME Circulati on pump B	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-6	7	3	6	17G03AO	17G3A	ME Transfer pump A	ME Transfer pump A	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-7	7	3	7	17G03BO	17G3B	ME Transfer pump B	ME Transfer pump B	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-8	7	3	8	17G04AO	17G4A	FFE circulation pump A	FFE circulat ion pump A	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-9	7	3	9	17G04BO	17G4B	FFE circulation pump B	FFE circulat ion pump B	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-10	7	3	10	17G05AO	17G5A	Transfer pump A	Transfer pum p A	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-11	7	3	11	17G05BO	17G5B	Transfer pump B	Transfer pum p B	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-12	7	3	12	17G06AO	17G6A	FFE circulation pump A	FFE circulat ion pump A	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-13	7	3	13	17G06BO	17G6B	FFE circulation pump B	FFE circulat ion pump B	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-14	7	3	14	17G06CO	17G6C	FFE circulation pump C	FFE circulat ion pump C	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-15	7	3	15	17G07AO	17G7A	FFE circulation pump A	FFE circulat ion pump A	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-16	7	3	16	17G07BO	17G7B	FFE circulation pump B	FFE circulat ion pump B	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-17	7	3	17	17G10O	17G10	Top fraction pump	Top fraction pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-18	7	3	18	17G11O	17G11	Side fration I pump	Side fration I pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-19	7	3	19	17G12O	17G12	Side fration II pump	Side fration II pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-20	7	3	20	17G15O	17G15	Distillate pump	Distillate p ump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-21	7	3	21	17G17O	17G17	Residue pump	Residue pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-22	7	3	22	17G18O	17G18	Light end pump	Light end pu mp	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-23	7	3	23	17G20O	17G20	Preheater	Preheater	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-24	7	3	24	17G21O	17G21	FFE circulation pump	FFE circulat ion pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-25	7	3	25	17G22AO	17G22A	FFE circulation pump A	FFE circulat ion pump A	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-26	7	3	26	17G22BO	17G22B	FFE circulation pump B	FFE circulat ion pump B	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-27	7	3	27	17G23O	17G23	FFE circulation pump	FFE circulat ion pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-28	7	3	28	17G30O	17G30	WCT circulation pump	WCT circulat ion pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-29	7	3	29	17G35O	17G35	Inline pump	Inline pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-30	7	3	30	17G36O	17G36	Inline pump	Inline pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-31	7	3	31	17G37O	17G37	Inline pump	Inline pump	DO	NIS								ME-Fract			
		0202	ADV551-P	7-3-32	7	3	32	17G54O	17G54	Vacuum ring pump	Vacuum ring pump	DO	NIS								ME-Fract			
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description	Service Description		IO Type		Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	comment
		0202	ADV551-P	7-4-1	7	4	1	AG901700O	AG901700			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-2	7	4	2	AG901701O	AG901701			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-3	7	4	3	AG901702O	AG901702			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-4	7	4	4	AG901703O	AG901703			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-5	7	4	5	AG901704O	AG901704			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-6	7	4	6	AG901705O	AG901705			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-7	7	4	7	AG901706O	AG901706			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-8	7	4	8	AG901707O	AG901707			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-9	7	4	9	AG901708O	AG901708			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-10	7	4	10	AG901709O	AG901709			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-11	7	4	11	AG901710O	AG901710			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-12	7	4	12	PU901700AO	PU901700A			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-13	7	4	13	PU901700BO	PU901700B			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-14	7	4	14	PU901701O	PU901701			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-15	7	4	15	PU901703O	PU901703			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-16	7	4	16	PU901705O	PU901705			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-17	7	4	17	PU901708O	PU901708			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-18	7	4	18	PU901710O	PU901710			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-19	7	4	19	PU901711O	PU901711			DO	NIS								ME-TF1			
		0202	ADV551-P	7-4-20	7	4	20	AG91909AO	AG91909A			DO	NIS								ME-TF2			
		0202	ADV551-P	7-4-21	7	4	21	AG91909BO	AG91909B			DO	NIS								ME-TF2			
		0202	ADV551-P	7-4-22	7	4	22	AG91910AO	AG91910A			DO	NIS								ME-TF2			
		0202	ADV551-P	7-4-23	7	4	23	AG91910BO	AG91910B			DO	NIS								ME-TF2			
		0202	ADV551-P	7-4-24	7	4	24	PU91909AO	PU91909A			DO	NIS								ME-TF2			
		0202	ADV551-P	7-4-25	7	4	25	AG91911AO	AG91911A			DO	NIS								ME-TF3			
		0202	ADV551-P	7-4-26	7	4	26	AG91911BO	AG91911B			DO	NIS								ME-TF3			
		0202	ADV551-P	7-4-27	7	4	27	AG91912AO	AG91912A			DO	NIS								ME-TF3			
		0202	ADV551-P	7-4-28	7	4	28	AG91912BO	AG91912B			DO	NIS								ME-TF3			
		0202	ADV551-P	7-4-29	7	4	29	AG91913AO	AG91913A			DO	NIS								ME-TF4			
		0202	ADV551-P	7-4-30	7	4	30	AG91913BO	AG91913B			DO	NIS								ME-TF4			
		0202	ADV551-P	7-4-31	7	4	31	AG91914AO	AG91914A			DO	NIS								ME-TF4			
		0202	ADV551-P	7-4-32	7	4	32	AG91914BO	AG91914B			DO	NIS								ME-TF4			
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description	Service Description		IO Type		Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	comment
		0202	ADV551-P	7-5-1	7	5	1	PU250WW1O	PU250WW1			DO	NIS								ME-UT-WWT			
		0202	ADV551-P	7-5-2	7	5	2	PU250WW2O	PU250WW2			DO	NIS								ME-UT-WWT			
		0202	ADV551-P	7-5-3	7	5	3	PU250WW3O	PU250WW3			DO	NIS								ME-UT-WWT			
		0202	ADV551-P	7-5-4	7	5	4	PU2500AO	PU2500A			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-5	7	5	5	PU2500BO	PU2500B			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-6	7	5	6	PU2501AO	PU2501A			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-7	7	5	7	PU2501BO	PU2501B			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-8	7	5	8	PU2502AO	PU2502A			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-9	7	5	9	PU2502BO	PU2502B			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-10	7	5	10	PU2503AO	PU2503A			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-11	7	5	11	PU2503BO	PU2503B			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-12	7	5	12	PU17D00AO	PU17D00A			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-13	7	5	13	PU17D00BO	PU17D00B			DO	NIS								ME-UT-DIW			
		0202	ADV551-P	7-5-14	7	5	14	FN150CT04AO	FN150CT04A			DO	NIS								ME-UT-CCW			

[illegible]

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description	Service Description		IO Type	Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	comment
												Lower		Upper	LL		L	H	HH				
		0202	ADV551-P	7-6-1	7	6	1	SPARE					DO	NIS									
		0202	ADV551-P	7-6-2	7	6	2	SPARE					DO	NIS									
		0202	ADV551-P	7-6-3	7	6	3	SPARE					DO	NIS									
		0202	ADV551-P	7-6-4	7	6	4	SPARE					DO	NIS									
		0202	ADV551-P	7-6-5	7	6	5	SPARE					DO	NIS									
		0202	ADV551-P	7-6-6	7	6	6	SPARE					DO	NIS									
		0202	ADV551-P	7-6-7	7	6	7	SPARE					DO	NIS									
		0202	ADV551-P	7-6-8	7	6	8	SPARE					DO	NIS									
		0202	ADV551-P	7-6-9	7	6	9	SPARE					DO	NIS									
		0202	ADV551-P	7-6-10	7	6	10	SPARE					DO	NIS									
		0202	ADV551-P	7-6-11	7	6	11	SPARE					DO	NIS									
		0202	ADV551-P	7-6-12	7	6	12	SPARE					DO	NIS									
		0202	ADV551-P	7-6-13	7	6	13	SPARE					DO	NIS									
		0202	ADV551-P	7-6-14	7	6	14	SPARE					DO	NIS									
		0202	ADV551-P	7-6-15	7	6	15	SPARE					DO	NIS									
		0202	ADV551-P	7-6-16	7	6	16	SPARE					DO	NIS									
		0202	ADV551-P	7-6-17	7	6	17	SPARE					DO	NIS									
		0202	ADV551-P	7-6-18	7	6	18	SPARE					DO	NIS									
		0202	ADV551-P	7-6-19	7	6	19	SPARE					DO	NIS									
		0202	ADV551-P	7-6-20	7	6	20	SPARE					DO	NIS									
		0202	ADV551-P	7-6-21	7	6	21	SPARE					DO	NIS									
		0202	ADV551-P	7-6-22	7	6	22	SPARE					DO	NIS									
		0202	ADV551-P	7-6-23	7	6	23	SPARE					DO	NIS									
		0202	ADV551-P	7-6-24	7	6	24	SPARE					DO	NIS									
		0202	ADV551-P	7-6-25	7	6	25	SPARE					DO	NIS									
		0202	ADV551-P	7-6-26	7	6	26	SPARE					DO	NIS									
		0202	ADV551-P	7-6-27	7	6	27	SPARE					DO	NIS									
		0202	ADV551-P	7-6-28	7	6	28	SPARE					DO	NIS									
		0202	ADV551-P	7-6-29	7	6	29	SPARE					DO	NIS									
		0202	ADV551-P	7-6-30	7	6	30	SPARE					DO	NIS									
		0202	ADV551-P	7-6-31	7	6	31	SPARE					DO	NIS									
		0202	ADV551-P	7-6-32	7	6	32	SPARE					DO	NIS									

FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	Comment	
													Lower	Upper		LL	L	H	HH				
0202	AAI143-H	5-1-1	5	1	1	FT1701	FIRC1701	%%FT1701	Crude ME to 17D02 Flow	Crude ME to	17D02 Flow	AI	NIS	0,0	26000,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-2	5	1	2	FT1702	FIR1702	%%FT1702	Distillate to TF Flow	Distillate	to TF Flow	AI	NIS	0,0	7000,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-3	5	1	3	FT1703	FIRC1703	%%FT1703	Fraction 2 to TF Flow	Fraction 2	to TF Flow	AI	NIS	0,0	14500,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-4	5	1	4	FT1704	FIR1704	%%FT1704	17D02 Frac. Col 1 reflux	17D02 Frac.	Col 1 reflux	AI	NIS	0,0	7500,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-5	5	1	5	FT1705	FIRC1705	%%FT1705	Side Frac. 1 to TF Flow	Side Frac. 1	to TF Flow	AI	NIS	0,0	2200,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-6	5	1	6	FT1706	FIRC1706	%%FT1706	Top Frac. 1 to TF Flow	Top Frac. 1	to TF Flow	AI	NIS	0,0	100,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-7	5	1	7	FT1707	FIR1707	%%FT1707	17D03 Frac. Col 2 reflux	17D03 Frac.	Col 2 reflux	AI	NIS	0,0	24000,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-8	5	1	8	FT1708	FIR1708	%%FT1708	Feed to Col 17D03 Flow	Feed to Col	17D03 Flow	AI	NIS	0,0	23500,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-9	5	1	9	FT1709	FIRC1709	%%FT1709	17D04 Dist. Col reflux	17D04 Dist.	Col reflux	AI	NIS	0,0	7000,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-10	5	1	10	FT1710	FIR1710	%%FT1710	Feed to Col 17D04 Flow	Feed to Col	17D04 Flow	AI	NIS	0,0	3700,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-11	5	1	11	FT1711	FIR1711	%%FT1711	Residue From 17F03 Flow	Residue From	17F03 Flow	AI	NIS	0,0	500,0	kg/hr					ME-Fract		
0202	AAI143-H	5-1-12	5	1	12	LT1701	LIRC1701	%%LT1701	17D01 Drier Lvl Trans	17D01 Drier	Lvl Trans	AI	NIS	0,0	100,0	%					ME-Fract		
0202	AAI143-H	5-1-13	5	1	13	LT1702	LIRC1702	%%LT1702	17D02 Frac. Col 1 Lvl	17D02 Frac.	Col 1 Lvl	AI	NIS	0,0	100,0	%					ME-Fract		
0202	AAI143-H	5-1-14	5	1	14	LT1703	LIRC1703	%%LT1703	17E08 Steam Gen Lvl	17E08 Steam	Gen Lvl	AI	NIS	0,0	100,0	%					ME-Fract		
0202	AAI143-H	5-1-15	5	1	15	LT1704	LIRC1704	%%LT1704	17D03 Frac. Col 2 Lvl	17D03 Frac.	Col 2 Lvl	AI	NIS	0,0	100,0	%					ME-Fract		
0202	AAI143-H	5-1-16	5	1	16	LT1705	LIRC1705	%%LT1705	17F01 Dist. Lvl	17F01 Dist.	Lvl	AI	NIS	0,0	100,0	%					ME-Fract		
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	Comment	
													Lower	Upper		LL	L	H	HH				
0202	AAI143-H	5-2-1	5	2	1	LT1706	LIRC1706	%%LT1706	17E09 Steam Gen Lvl	17E09 Steam	Gen Lvl	AI	NIS	0,0	100,0	%					ME-Fract		
0202	AAI143-H	5-2-2	5	2	2	LT1707	LIRC1707	%%LT1707	17F03 Res. Receiver Lvl	17F03 Res.	Receiver Lvl	AI	NIS	0,0	100,0	%					ME-Fract		
0202	AAI143-H	5-2-3	5	2	3	LT1708	LIRC1708	%%LT1708	17F04 Light End Receiver	17F04 Light	End Receiver	AI	NIS	0,0	100,0	%					ME-Fract		
0202	AAI143-H	5-2-4	5	2	4	PT1701	PIRC1701	%%PT1701	17D02 Frac. Col 1 Pres.	17D02 Frac.	Col 1 Pres.	AI	NIS	0,0	200,0	mbarA					ME-Fract		
0202	AAI143-H	5-2-5	5	2	5	PT1702	PIR1702	%%PT1702	17D02 Frac. Col 1 Pres.	17D02 Frac.	Col 1 Pres.	AI	NIS	0,0	200,0	mbarA					ME-Fract		
0202	AAI143-H	5-2-6	5	2	6	PT1703	PIRC1703	%%PT1703	17D03 Frac. Col 2 Pres.	17D03 Frac.	Col 2 Pres.	AI	NIS	0,0	100,0	mbarA					ME-Fract		
0202	AAI143-H	5-2-7	5	2	7	PT1704	PIR1704	%%PT1704	17D03 Frac. Col 2 Pres.	17D03 Frac.	Col 2 Pres.	AI	NIS	0,0	100,0	mbarA					ME-Fract		
0202	AAI143-H	5-2-8	5	2	8	PT1705	PIR1705	%%PT1705	17D04 Dist. Col Pres.	17D04 Dist.	Col Pres.	AI	NIS	0,0	100,0	mbarA					ME-Fract		
0202	AAI143-H	5-2-9	5	2	9	PT1706	PIR1706	%%PT1706	17D04 Dist. Col Pres.	17D04 Dist.	Col Pres.	AI	NIS	0,0	100,0	mbarA					ME-Fract		
0202	AAI143-H	5-2-10	5	2	10	PT1707	PIR1707	%%PT1707	Pres. Mon at Vacuum Sys	Pres. Mon at	Vacuum Sys	AI	NIS	0,0	400,0	mbarA					ME-Fract		
0202	AAI143-H	5-2-11	5	2	11	TT1701	TIRC1701	%%TT1701	17D01 Drier Temp. Trans	17D01 Drier	Temp. Trans	AI	NIS	0,0	200,0	°C					ME-Fract		
0202	AAI143-H	5-2-12	5	2	12	TT1702	TIRC1702	%%TT1702	17D02 Frac. Col 1 Feed	17D02 Frac.	Col 1 Feed	AI	NIS	0,0	300,0	°C					ME-Fract		
0202	AAI143-H	5-2-13	5	2	13	TT1703	TIRC1703	%%TT1703	17E07 Cool Wtr Temp	17E07 Cool	Wtr Temp	AI	NIS	0,0	100,0	°C					ME-Fract		
0202	AAI143-H	5-2-14	5	2	14	TT1704	TIR1704	%%TT1704	17E07 ME Cond. Temp	17E07 ME	Cond. Temp	AI	NIS	0,0	200,0	°C					ME-Fract		
0202	AAI143-H	5-2-15	5	2	15	TT1705	TIR1705	%%TT1705	17D02 Frac. Col 1 Temp	17D02 Frac.	Col 1 Temp	AI	NIS	0,0	200,0	°C					ME-Fract		
0202	AAI143-H	5-2-16	5	2	16	TT1706	TIR1706	%%TT1706	17D02 Frac. Col 1 Temp	17D02 Frac.	Col 1 Temp	AI	NIS	0,0	200,0	°C					ME-Fract		
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	Comment	
													Lower	Upper		LL	L	H	HH				
0202	AAI143-H	5-3-1	5	3	1	TT1707	TIR1707	%%TT1707	17D02 Frac. Col 1 Temp	17D02 Frac.	Col 1 Temp	AI	NIS	0,0	300,0	°C					ME-Fract		
0202	AAI143-H	5-3-2	5	3	2	TT1708	TIRC1708	%%TT1708	17E03 Fall Film Evap.	17E03 Fall	Film Evap.	AI	NIS	0,0	400,0	°C					ME-Fract		
0202	AAI143-H	5-3-3	5	3	3	TT1709	TIR1709	%%TT1709	17D02 Frac. Col 1 Temp	17D02 Frac.	Col 1 Temp	AI	NIS	0,0	300,0	°C					ME-Fract		
0202	AAI143-H	5-3-4	5	3	4	TT1710	TIRC1710	%%TT1710	17E11 Final cond. Temp	17E11 Final	cond. Temp	AI	NIS	0,0	100,0	°C					ME-Fract		
0202	AAI143-H	5-3-5	5	3	5	TT1711	TIR1711	%%TT1711	17E08 ME cond. Temp	17E08 ME	cond. Temp	AI	NIS	0,0	300,0	°C					ME-Fract		
0202	AAI143-H	5-3-6																					

0202	AAI143-H	6-2-14	6	2	14	TT901711	TI901711	%%TT901711	Residue	Residue		AI	NIS	0,0	150,0	°C					ME-TF1		
------	----------	--------	---	---	----	----------	----------	------------	---------	---------	--	----	-----	-----	-------	----	--	--	--	--	--------	--	--

0202	AAI143-H	6-2-15	6	2	15	LT91909	LI91909	%%LT91909	ME C8/10	ME C8/10		AI	NIS							ME-TF2		
0202	AAI143-H	6-2-16	6	2	16	LT91910	LI91910	%%LT91910	ME C8/10	ME C8/10		AI	NIS							ME-TF2		
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	Comment
													Lower	Upper		LL	L	H	HH			
0202	AAI143-H	6-3-1	6	3	1	TT91909	TI91909	%%TT91909	ME C8/10	ME C8/10		AI	NIS	0,0	150,0	°C					ME-TF2	
0202	AAI143-H	6-3-2	6	3	2	TT91910	TI91910	%%TT91910	ME C8/10	ME C8/10		AI	NIS	0,0	150,0	°C					ME-TF2	
0202	AAI143-H	6-3-3	6	3	3	LT91911	LI91911	%%LT91911	ME 12-14	ME 12-14		AI	NIS							ME-TF3		
0202	AAI143-H	6-3-4	6	3	4	LT91912	LI91912	%%LT91912	ME 12-14	ME 12-14		AI	NIS							ME-TF3		
0202	AAI143-H	6-3-5	6	3	5	TT91911	TI91911	%%TT91911	ME 12-14	ME 12-14		AI	NIS	0,0	150,0	°C					ME-TF3	
0202	AAI143-H	6-3-6	6	3	6	TT91912	TI91912	%%TT91912	ME 12-14	ME 12-14		AI	NIS	0,0	150,0	°C					ME-TF3	
0202	AAI143-H	6-3-7	6	3	7	LT91913	LI91913	%%LT91913	ME 16-18	ME 16-18		AI	NIS							ME-TF4		
0202	AAI143-H	6-3-8	6	3	8	LT91914	LI91914	%%LT91914	ME 16-18	ME 16-18		AI	NIS							ME-TF4		
0202	AAI143-H	6-3-9	6	3	9	TT91913	TI91913	%%TT91913	ME 16-18	ME 16-18		AI	NIS	0,0	150,0	°C					ME-TF4	
0202	AAI143-H	6-3-10	6	3	10	TT91914	TI91914	%%TT91914	ME 16-18	ME 16-18		AI	NIS	0,0	150,0	°C					ME-TF4	
0202	AAI143-H	6-3-11	6	3	11	TT150CT04S	TI150CT04S	%%TT150CT04S	Clean CW Outlet Temp	Clean CW Outlet Temp		AI	NIS	0,0	150,0	°C					ME-UT-CCW	
0202	AAI143-H	6-3-12	6	3	12	TT150CT04R	TI150CT04R	%%TT150CT04R	Clean CW Inlet Temp	Clean CW Inlet Temp		AI	NIS	0,0	150,0	°C					ME-UT-CCW	
0202	AAI143-H	6-3-13	6	3	13	PT150CT04	PI150CT04	%%PT150CT04	150CCW9/10 pump disch.	150CCW9/10 pump disch.		AI	NIS	0,0	15,0	barg					ME-UT-CCW	
0202	AAI143-H	6-3-14	6	3	14	FT150CT04	FI150CT04	%%FT150CT04	Make up CW in 150CT04	Make up CW in 150CT04		AI	NIS	0,0	40,0	m3/h					ME-UT-CCW	
0202	AAI143-H	6-3-15	6	3	15	VIPU150CCW9	VPU150CCW9PVI	%%VIPU150CCW9				AI	NIS									
0202	AAI143-H	6-3-16	6	3	16	VIPU150CCW10	VPU150CCW10PVI	%%VIPU150CCW10				AI	NIS									
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	Comment
													Lower	Upper		LL	L	H	HH			
0202	AAI143-H	7-1-1	7	1	1	PT250AR3	PI250AR3	%%PT250AR3				AI	NIS	0,00	20,00	barg					ME-UT-AIR	
0202	AAI143-H	7-1-2	7	1	2	PT250AR4	PI250AR4	%%PT250AR4	Comp Air to ME & BD	Comp Air to ME & BD		AI	NIS	0,00	20,00	barg					ME-UT-AIR	
0202	AAI143-H	7-1-3	7	1	3	PT250AR5	PI250AR5	%%PT250AR5	Comp Air to ME Plt & TF	Comp Air to ME Plt & TF		AI	NIS	0,00	20,00	barg					ME-UT-AIR	
0202	AAI143-H	7-1-4	7	1	4	PT250AR6	PI250AR6	%%PT250AR6	Comp Air to BD Plt & TF	Comp Air to BD Plt & TF		AI	NIS	0,00	20,00	barg					ME-UT-AIR	
0202	AAI143-H	7-1-5	7	1	5	PT250N1	PI250N1	%%PT250N1	N2 to ME Plt & TF	N2 to ME Plt & TF		AI	NIS	0,00	20,00	barg					ME-UT-AIR	
0202	AAI143-H	7-1-6	7	1	6	PT250N2	PI250N2	%%PT250N2	N2 to BD Plt 4 & 5	N2 to BD Plt 4 & 5		AI	NIS	0,00	20,00	barg					ME-UT-AIR	
0202	AAI143-H	7-1-7	7	1	7	PT250N3	PI250N3	%%PT250N3	N2 to BD TF	N2 to BD TF		AI	NIS	0,00	20,00	barg					ME-UT-AIR	
0202	AAI143-H	7-1-8	7	1	8	PT250N4	PI250N4	%%PT250N4	N2 to ME Export TF	N2 to ME Export TF		AI	NIS	0,00	20,00	barg					ME-UT-AIR	
0202	AAI143-H	7-1-9	7	1	9	LT250DW	LI250DW	%%LT250DW	DIwater	DIwater		AI	NIS								ME-UT-DIW	
0202	AAI143-H	7-1-10	7	1	10	LT17D00	LIC17D00	%%LT17D00	Deaerator Level	Deaerator Level		AI	NIS								ME-UT-DIW	
0202	AAI143-H	7-1-11	7	1	11	TT17D00	TIC17D00	%%TT17D00	Deaerator Temp	Deaerator Temp		AI	NIS	0,0	150,0	°C					ME-UT-DIW	
0202	AAI143-H	7-1-12	7	1	12	TT250TOH-S	TI250TOH-S	%%TT250TOH-S	Thermal oil temp	Thermal oil temp		AI	NIS	0,0	350,0	°C					ME-UT-TOH	
0202	AAI143-H	7-1-13	7	1	13	TT250TOH-R	TI250TOH-R	%%TT250TOH-R	Thermal oil temp	Thermal oil temp		AI	NIS	0,0	350,0	°C					ME-UT-TOH	
0202	AAI143-H	7-1-14	7	1	14	PT250TOH-S	PI250TOH-S	%%PT250TOH-S	Hot oil temp Supply	Hot oil temp Supply		AI	NIS	0,00	15,00	barg					ME-UT-TOH	
0202	AAI143-H	7-1-15	7	1	15	PT250TOH-R	PI250TOH-R	%%PT250TOH-R	Hot oil temp Return	Hot oil temp Return		AI	NIS	0,00	15,00	barg					ME-UT-TOH	
0202	AAI143-H	7-1-16	7	1	16	SPARE						AI	NIS									
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	Comment
													Lower	Upper		LL	L	H	HH			
0202	AAI143-H	7-2-1	7	2	1	PT290S001	PIC290S001	%%PT290S001	LP steam to ME Plt & TF	LP steam to ME Plt & TF		AI	NIS	0,00	10,00	barg					ME-UT-STEAM	
0202	AAI143-H	7-2-2	7	2	2	FT290S001	FI290S001	%%FT290S001	LP steam to ME Plt	LP steam to ME Plt		AI	NIS	0	5000	Kg/h					ME-UT-STEAM	
0202	AAI143-H	7-2-3	7	2	3	FT290S002	FI290S002	%%FT290S002	LP steam to ME Export TF	LP steam to ME Export TF		AI	NIS	0	5000	Kg/h					ME-UT-STEAM	
0202	AAI143-H	7-2-4	7	2	4	FT290S003	FI290S003	%%FT290S003	LP steam to ME TF T.Heat	LP steam to ME TF T.Heat		AI	NIS	0	5000	Kg/h					ME-UT-STEAM	
0202	AAI143-H	7-2-5	7	2	5	VIFN150CT04B	VFN150CT04BPVI	%%VIFN150CT04B				AI	NIS									
0202	AAI143-H	7-2-6	7	2	6	VIFN150CT04A	VFN150CT04APVI	%%VIFN150CT04A		</												

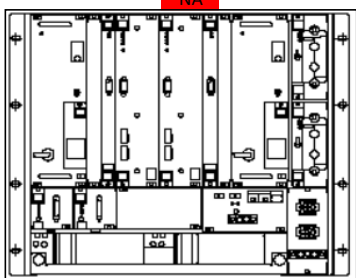
[illegible]

FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	Comment
													Lower	Upper	LL		L	H	HH				
0202	AAI543-H	5-4-1	5	4	1	FV1701	FIRC1701	%FV1701	Crude methylester to 17D02 column flow control valve	Crude methyl	ester to 17D	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-2	5	4	2	FV1703	FIRC1703	%FV1703	Fration 2 to tankfarm flow control valve	Fration 2 to	tankfarm fl	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-3	5	4	3	FV1705	FIRC1705	%FV1705	Side fraction 1 to tankfarm flow control valve	Side fractio	n 1 to tankf	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-4	5	4	4	FV1706	FIRC1706	%FV1706	Top fraction 1 to tankfarm flow control valve	Top fraction	1 to tankfa	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-5	5	4	5	FV1709	FIRC1709	%FV1709	17D04 Distillate column reflux flow control valve	17D04 Distil	late column	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-6	5	4	6	LV1701	LIRC1701	%LHV1701	17D01 Drier level control valve	17D01 Drier	level contro	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-7	5	4	7	LV1702	LIRC1702	%LHV1702	17D02 Frac. Column 1 level control valve	17D02 Frac.	Column 1 lev	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-8	5	4	8	LV1703	LIRC1703	%LHV1703	17E08 Steam generator level control valve	17E08 Steam	generator le	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-9	5	4	9	LV1704	LIRC1704	%LHV1704	17D03-CMD Frac. Column 2 level control valve	17D03-CMD Fr	ac. Column 2	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-10	5	4	10	LV1705	LIRC1705	%LHV1705	17F01 Distillate level control valve	17F01 Distil	late level c	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-11	5	4	11	LV1706	LIRC1706	%LHV1706	17E09 Steam generator level control valve	17E09 Steam	generator le	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-12	5	4	12	LV1707	LIRC1707	%LHV1707	17F03-CMD Residue receiver level control valve	17F03-CMD Re	sidue receiv	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-13	5	4	13	LV1708	LIRC1708	%LHV1708	17F04 Light end receiver level control valve	17F04 Light	end receiver	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-14	5	4	14	PV1701	PIRC1701	%PV1701	17D02 Frac. Column 1 Pressure control valve (Top)	17D02 Frac.	Column 1 Pre	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-15	5	4	15	PV1703	PIRC1703	%PV1703	17D03-CMD Frac. Column 2 Pressure control valve (Top)	17D03-CMD Fr	ac. Column 2	AO	NIS							ME-Fract			
0202	AAI543-H	5-4-16	5	4	16	TV1701	TIRC1701	%TV1701	17D01 Drier temperature control valve	17D01 Drier	temperature	AO	NIS							ME-Fract			
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	Comment
													Lower	Upper	LL		L	H	HH				
0202	AAI543-H	6-4-1	6	4	1	TV1702	TIRC1702	%TV1702	17D02 Frac. Column 1 feed temperature control valve	17D02 Frac.	Column 1 fee	AO	NIS							ME-Fract			
0202	AAI543-H	6-4-2	6	4	2	TV1703	TIRC1703	%TV1703	17E07 Cooling water temperature control valve	17E07 Coolin	g water temp	AO	NIS							ME-Fract			
0202	AAI543-H	6-4-3	6	4	3	TV1708	TIRC1708	%TV1708	17E03-CMD Falling film evaporator tamperature control valve	17E03-CMD Fa	lling film e	AO	NIS							ME-Fract			
0202	AAI543-H	6-4-4	6	4	4	TV1710	TIRC1710	%TV1710	17E11 Final conenser temperature control valve	17E11 Final	conenser tem	AO	NIS							ME-Fract			
0202	AAI543-H	6-4-5	6	4	5	TV1715A	TIRC1715A	%TV1715A	17E04A Falling film evaporator temperature control valve	17E04A Falli	ng film evap	AO	NIS							ME-Fract			
0202	AAI543-H	6-4-6	6	4	6	TV1715B	TIRC1715B	%TV1715B	17E04B Falling film evaporator temperature control valve	17E04B Falli	ng film evap	AO	NIS							ME-Fract			
0202	AAI543-H	6-4-7	6	4	7	TV1717	TIRC1717	%TV1717	17E12 Final conenser temperature control valve	17E12 Final	conenser tem	AO	NIS							ME-Fract			
0202	AAI543-H	6-4-8	6	4	8	TV1721	TIRC1721	%TV1721	17E05 Falling film evaporator tamperature control valve	17E05 Fallin	g film evapo	AO	NIS							ME-Fract			
0202	AAI543-H	6-4-9	6	4	9	TV1723	TIRC1723	%TV1723	17E30 Tempered cooling water temperature control valve	17E30 Temper	ed cooling w	AO	NIS							ME-Fract			
0202	AAI543-H	6-4-10	6	4	10	PRV290S001	PIC290S001	%PRV290S001	3 barg LP steam to ME Frac Pit and TF	3 barg LP st	eam to ME Fr	AO	NIS							ME-UT-STEAM			
0202	AAI543-H	6-4-11	6	4	11	LCV17D00	LIC17D00	%LCV17D00				AO	NIS							ME-UT-DIW			
0202	AAI543-H	6-4-12	6	4	12	TCV17D00	TIC17D00	%TCV17D00				AO	NIS							ME-UT-DIW			
0202	AAI543-H	6-4-13	6	4	13	VOPU150CCW9	VPU150CCW9	%VOPU150CCW9				AO	NIS										
0202	AAI543-H	6-4-14	6	4	14	VOPU150CCW10	VPU150CCW10	%VOPU150CCW10				AO	NIS										
0202	AAI543-H	6-4-15	6	4	15	VOFN150CT04B	VFN150CT04B	%VOFN150CT04B				AO	NIS										
0202	AAI543-H	6-4-16	6	4	16	VOFN150CT04A	VFN150CT04A	%VOFN150CT04A				AO	NIS										
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Plant	Remarks	Comment
													Lower	Upper	LL		L	H	HH				
0202	AAI543-H	8-3-1	8	3	1	SPARE						AO	NIS										
0202	AAI543-H	8-3-2	8	3	2	SPARE						AO	NIS										
0202	AAI543-H	8-3-3	8	3	3	SPARE						AO	NIS										
0202	AAI543-H	8-3-4	8	3	4	SPARE						AO	NIS										
0202	AAI543-H	8-3-5	8	3	5	SPARE						AO	NIS										
0202	AAI543-H	8-3-6	8	3	6	SPARE						AO	NIS										
0202	AAI543-H	8-3-7	8	3	7	SPARE						AO	NIS										
0202	AAI543-H	8-3-8	8	3	8	SPARE						AO	NIS										
0202	AAI543-H	8-3-9	8	3	9	SPARE						AO	NIS										
0202	AAI543-H	8-3-10	8	3	10	SPARE						AO	NIS										
0202	AAI543-H	8-3-11	8	3	11	SPARE						AO	NIS										
0202	AAI543-H	8-3-12	8	3	12	SPARE						AO	NIS										
0202	AAI543-H	8-3-13	8	3	13	SPARE						AO	NIS										
0202	AAI543-H	8-3-14	8	3	14	SPARE						AO	NIS										
0202	AAI543-H	8-3-15	8	3	15	SPARE						AO	NIS										
0202	AAI543-H	8-3-16	8	3	16	SPARE						AO	NIS										

SYSTEM PANEL 1

AFG30D

FCS0202

[illegible][illegible]

100

ANB10D-2

96

IS Cabinet

SYSTEM PANEL 2

PME & SOD MIXING-MC2

[illegible]

NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
ADV451	ADV451	ADV451	ADV451	ADV451	ADV451	ADV451	ADV451	ADV451	ADV451
B1	EB402	EB402	EB402	EB402	EB402	EB402	EB402	EB402	EB402
B2									
P1									
P2									

83

ANB10D-4

2

NIS Cabinet

SYSTEM PANEL 1

ME-MC1

ME-MC1

P2	
P1	
B2	
B1	
ADVC01	NA
ADV151	0
ADV151	0
ADV151	0
AA1543	1
AA143	2
AA143	2
AA143	2

P2
P1
B2
B1
ADVCO1
ADVCO1
ADV151
ADV151
AAI543
AAI143
AAI143
AAI143

ANR11D-5

83

ANR11D-6

87

NIS Cabinet

SYSTEM PANEL 2

ME-MC2

ME-MC2

P2	0	NA
P1	0	
B2	0	
B1	0	
ADVOC1	0	
ADVOC1	0	
ADVOC1	0	
ADV551	0	
ADV551	0	
ADV551	0	
ADV551	0	
AA143	22	
AA143	22	

p2
p1
B2
B1
ADVCO1
ADVC01
ADV151
ADV151
ADV151
AAI543
AAI143
AAI143

ANR11D-7

44

ANR11D-8

61

NIS Cabinet

BD4 Portion

	Non-Intrinsically Safe (IS) IO				Intrinsically Safe (IS) IO			
	DI	DO	AI	AO	DI	DO	AI	AO
inside	144	58	28	28	93	33	136	44
offsite	49	16	30	4	4	0	20	0
total	193	74	58	32	97	33	156	44
Total + 20% spare	232	89	70	38	116	40	187	53
Provided (based on Yokogawa BOM)	224	96	48	32	48	0	208	56
balance	-8	7	-22	-6	-68	-40	21	3

Card Module	ADV151	ADV551	AAI143	AAI543	ASD143	ASD533	ASI133	ASI533
Propose additional card			2	1	4	5		
Channel per module	32	32	16	16	16	8	8	8
Required (after deduct I/O point provided)	0	0	22	6	68	40	0	0

BD5 Portion

	Non-Intrinsically Safe (IS) IO				Intrinsically Safe (IS) IO			
	DI	DO	AI	AO	DI	DO	AI	AO
inside	109	44	21	21	86	33	119	42
offsite	21	9	3	3	0	0	0	0
total	130	53	24	24	91	33	131	42
Total + 20% spare	156	64	29	29	109	40	157	50
Provided (based on Yokogawa BOM)	160	64	32	32	48	0	176	56
balance	4	0	3	3	-61	-40	19	6

Card Module	ADV151	ADV551	AAI143	AAI543	ASD143	ASD533	ASI133	ASI533
propose additonal card					4	5		
Channel per module	32	32	16	16	16	8	8	8
Required (after deduct I/O point provided)	0	0	0	0	55	40	0	0

ME Portion

	Non-Intrinsically Safe (IS) IO			
	DI	DO	AI	AO
TF	86	34	36	0
Utility	52	23	31	6
ME-FRACT	72	32	54	25
total	210	89	121	31
Total + 20% spare	252	107	145	37
Provided (Based on Yokogawa BOM)	160	96	128	32
balance	-92	-11	-17	-5

Card Module	ADV151 ADV551 AAI143 AAI543			
propose additional card	3	1	2	1
Channel per module	32	32	16	16
required (after deduct I/O point provided)	92	11	17	5

PME, Sod Mix, Utility 2

	Non-Intrinsically Safe (IS) IO				Intrinsically Safe (IS) IO			
	DI	DO	AI	AO	DI	DO	AI	AO
PME Cool	73	32	25	6	0	0	0	0
Sod Mix	14	7	0	0	60	27	14	0
Utility 2	3	1	2	0	0	0	0	0
PME Filter	8	0	5	1	0	0	0	0
total	98	40	32	7	60	27	14	0
Total + 20% spare	118	48	38	8	72	32	17	0
Provided (based on Yokogawa BOM)	0	0	0	0	0	0	0	0
balance	-118	-48	-38	-8	-72	-32	-17	0

Card Module	ADV151 ADV551 AAI143 AAI543 ASD143 ASD533 ASI133 ASI533							
Propose additional card	4	2	3	1	5	4	3	
Channel per module	32	32	16	16	16	8	8	8
Required (after deduct I/O point provided)	118	48	38	8	72	32	17	0

Signal Type :			Cabinet No : 				
---------------	--	--	--	--	--	--	--

Signal Type :			Cabinet No : <				
---------------	--	--	---	--	--	--	--

Signal Type :			Cabinet No :					FCS0202									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC											RTD	AI	AO	DI	DO
HSC	RTD																
AI	AO																
DI	DO																
IS	NIS																
HART	NON HART																
ME FRACT + OFFSITE (MC1)					SYSTEM I/O												
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model							
				TB1-065	TT1707	A1	1	5	3	AAI143							
				TB1-066		B1											
				TB1-067	TT1708	A2	2	5	3	AAI143							
				TB1-068		B2											
				TB1-069	TT1709	A3	3	5	3	AAI143							
				TB1-070		B3											
				TB1-071	TT1710	A4	4	5	3	AAI143							
				TB1-072		B4											
				TB1-073	TT1711	A5	5	5	3	AAI143							
				TB1-074		B5											
				TB1-075	TT1712	A6	6	5	3	AAI143							
				TB1-076		B6											
				TB1-077	TT1713	A7	7	5	3	AAI143							
				TB1-078		B7											
				TB1-079	TT1714	A8	8	5	3	AAI143							
				TB1-080		B8											
				TB1-081	TT1715A	A9	9	5	3	AAI143							
				TB1-082		B9											
				TB1-083	TT1715B	A10	10	5	3	AAI143							
				TB1-084		B10											
				TB1-085	TT1716A	A11	11	5	3	AAI143							
				TB1-086		B11											
				TB1-087	TT1716B	A12	12	5	3	AAI143							
				TB1-088		B12											
				TB1-089	TT1717	A13	13	5	3	AAI143							
				TB1-090		B13											
				TB1-091	TT1718	A14	14	5	3	AAI143							
				TB1-092		B14											
				TB1-093	TT1719	A15	15	5	3	AAI143							
				TB1-094		B15											
				TB1-095	TT1720	A16	16	5	3	AAI143							
				TB1-096		B16											
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.						
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT		21-AI						
		CH.	DATE						TITLE		SHT. NO.						
		HARINAH	15/01/09						ME FRACT + OFFSITE		21						
FILENAME		APP.	DATE						DOC. NO.		CONTD						
ME FRACT + OFFSITE		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WPMEGLY-D32-003	22						

Signal Type :			Cabinet No :					FCS0202									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC											RTD	AI	AO	DI	DO
HSC	RTD																
AI	AO																
DI	DO																
IS	NIS																
HART	NON HART																
ME FRACT + OFFSITE (MC1)					SYSTEM I/O												
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model							
				TB1-097	TT1721	A1	1	6	1	AAI143							
				TB1-098		B1											
				TB1-099	TT1722	A2	2	6	1	AAI143							
				TB1-100		B2											
				TB1-101	TT1723	A3	3	6	1	AAI143							
				TB1-102		B3											
				TB1-103	TT1724	A4	4	6	1	AAI143							
				TB1-104		B4											
				TB1-105	QT1701	A5	5	6	1	AAI143							
				TB1-106		B5											
				TB1-107	QT1702	A6	6	6	1	AAI143							
				TB1-108		B6											
				TB1-109	LT901700	A7	7	6	1	AAI143							
				TB1-110		B7											
				TB1-111	LT901701	A8	8	6	1	AAI143							
				TB1-112		B8											
				TB1-113	LT901702	A9	9	6	1	AAI143							
				TB1-114		B9											
				TB1-115	LT901703	A10	10	6	1	AAI143							
				TB1-116		B10											
				TB1-117	LT901704	A11	11	6	1	AAI143							
				TB1-118		B11											
				TB1-119	LT901705	A12	12	6	1	AAI143							
				TB1-120		B12											
				TB1-121	LT901706	A13	13	6	1	AAI143							
				TB1-122		B13											
				TB1-123	LT901707	A14	14	6	1	AAI143							
				TB1-124		B14											
				TB1-125	LT901708	A15	15	6	1	AAI143							
				TB1-126		B15											
				TB1-127	LT901709	A16	16	6	1	AAI143							
				TB1-128		B16											
		GENERAL DESCRIPTION		DR.	DATE					PROJECT NAME			DWG. NO.				
Panel Wiring Drawing		DILA	15/01/09					WILMAR SURABAYA BD & ME PROJECT			22-AI						
		CH.	DATE					TITLE			SHT. NO.						
		HARINAH	15/01/09					ME FRACT + OFFSITE			22						
FILENAME		APP.	DATE					DOC. NO.			CONTD						
ME FRACT + OFFSITE		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WPMEGLY-D32-003	23						

Signal Type :			Cabinet No :					FCS0202									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC											RTD	AI	AO	DI	DO
HSC	RTD																
AI	AO																
DI	DO																
IS	NIS																
HART	NON HART																
			ME FRACT + OFFSITE (MC1)					SYSTEM I/O									
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model							
				TB1-129	LT901710	A1	1	6	2	AAI143							
				TB1-130		B1											
				TB1-131	LT901711	A2	2	6	2	AAI143							
				TB1-132		B2											
				TB1-133	TT901700	A3	3	6	2	AAI143							
				TB1-134		B3											
				TB1-135	TT901701	A4	4	6	2	AAI143							
				TB1-136		B4											
				TB1-137	TT901702	A5	5	6	2	AAI143							
				TB1-138		B5											
				TB1-139	TT901703	A6	6	6	2	AAI143							
				TB1-140		B6											
				TB1-141	TT901704	A7	7	6	2	AAI143							
				TB1-142		B7											
				TB1-143	TT901705	A8	8	6	2	AAI143							
				TB1-144		B8											
				TB1-145	TT901706	A9	9	6	2	AAI143							
				TB1-146		B9											
				TB1-147	TT901707	A10	10	6	2	AAI143							
				TB1-148		B10											
				TB1-149	TT901708	A11	11	6	2	AAI143							
				TB1-150		B11											
				TB1-151	TT901709	A12	12	6	2	AAI143							
				TB1-152		B12											
				TB1-153	TT901710	A13	13	6	2	AAI143							
				TB1-154		B13											
				TB1-155	TT901711	A14	14	6	2	AAI143							
				TB1-156		B14											
				TB1-157	LT91909	A15	15	6	2	AAI143							
				TB1-158		B15											
				TB1-159	LT91910	A16	16	6	2	AAI143							
				TB1-160		B16											
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.						
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT		23-AI						
		CH.	DATE						TITLE		SHT. NO.						
		HARINAH	15/01/09						ME FRACT + OFFSITE		23						
FILENAME		APP.	DATE						DOC. NO.		CONTD						
ME FRACT + OFFSITE		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WPMEGLY-D32-003	24						

Signal Type :			Cabinet No :																			
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC1)					FCS0202				
HSC	RTD																					
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
								SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model												
				TB1-161	TT91909	A1	1	6	3	AAI143												
				TB1-162		B1																
				TB1-163	TT91910	A2	2	6	3	AAI143												
				TB1-164		B2																
				TB1-165	LT91911	A3	3	6	3	AAI143												
				TB1-166		B3																
				TB1-167	LT91912	A4	4	6	3	AAI143												
				TB1-168		B4																
				TB1-169	TT91911	A5	5	6	3	AAI143												
				TB1-170		B5																
				TB1-171	TT91912	A6	6	6	3	AAI143												
				TB1-172		B6																
				TB1-173	LT91913	A7	7	6	3	AAI143												
				TB1-174		B7																
				TB1-175	LT91914	A8	8	6	3	AAI143												
				TB1-176		B8																
				TB1-177	TT91913	A9	9	6	3	AAI143												
				TB1-178		B9																
				TB1-179	TT91914	A10	10	6	3	AAI143												
				TB1-180		B10																
				TB1-181	TT150CT04S	A11	11	6	3	AAI143												
				TB1-182		B11																
				TB1-183	TT150CT04R	A12	12	6	3	AAI143												
				TB1-184		B12																
				TB1-185	PT150CT04	A13	13	6	3	AAI143												
				TB1-186		B13																
				TB1-187	FT150CT04	A14	14	6	3	AAI143												
				TB1-188		B14																
				TB1-189	VIPU150CCW9	A15	15	6	3	AAI143												
				TB1-190		B15																
				TB1-191	VIPU150CCW10	A16	16	6	3	AAI143												
				TB1-192		B16																

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	24-AI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	24
FILENAME	APP.	DATE							DOC. NO.	CONTD
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WPMEGLY-D32-003	25

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC1)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC													
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model					
				TB2-001	FV1701	A1	1	5	4	AAI543					
				TB2-002		B1									
				TB2-003	FV1703	A2	2	5	4	AAI543					
				TB2-004		B2									
				TB2-005	FV1705	A3	3	5	4	AAI543					
				TB2-006		B3									
				TB2-007	FV1706	A4	4	5	4	AAI543					
				TB2-008		B4									
				TB2-009	FV1709	A5	5	5	4	AAI543					
				TB2-010		B5									
				TB2-011	LV1701	A6	6	5	4	AAI543					
				TB2-012		B6									
				TB2-013	LV1702	A7	7	5	4	AAI543					
				TB2-014		B7									
				TB2-015	LV1703	A8	8	5	4	AAI543					
				TB2-016		B8									
				TB2-017	LV1704	A9	9	5	4	AAI543					
				TB2-018		B9									
				TB2-019	LV1705	A10	10	5	4	AAI543					
				TB2-020		B10									
				TB2-021	LV1706	A11	11	5	4	AAI543					
				TB2-022		B11									
				TB2-023	LV1707	A12	12	5	4	AAI543					
				TB2-024		B12									
				TB2-025	LV1708	A13	13	5	4	AAI543					
				TB2-026		B13									
				TB2-027	PV1701	A14	14	5	4	AAI543					
				TB2-028		B14									
				TB2-029	PV1703	A15	15	5	4	AAI543					
				TB2-030		B15									
				TB2-031	TV1701	A16	16	5	4	AAI543					
				TB2-032		B16									
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.				
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT		25-AO				
		CH.	DATE						TITLE		SHT. NO.				
		HARINAH	15/01/09						ME FRACT + OFFSITE		25				
FILENAME		APP.	DATE						DOC. NO.		CONTD				
ME FRACT + OFFSITE		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003		26			

Signal Type :				Cabinet No :				FCS0202									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>													HSC	RTD	AI	AO	DI
HSC	RTD																
AI	AO																
DI	DO																
IS	NIS																
HART	NON HART																
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model							
				TB2-033	TV1702	A1	1	6	4	AAI543							
				TB2-034		B1											
				TB2-035	TV1703	A2	2	6	4	AAI543							
				TB2-036		B2											
				TB2-037	TV1708	A3	3	6	4	AAI543							
				TB2-038		B3											
				TB2-039	TV1710	A4	4	6	4	AAI543							
				TB2-040		B4											
				TB2-041	TV1715A	A5	5	6	4	AAI543							
				TB2-042		B5											
				TB2-043	TV1715B	A6	6	6	4	AAI543							
				TB2-044		B6											
				TB2-045	TV1717	A7	7	6	4	AAI543							
				TB2-046		B7											
				TB2-047	TV1721	A8	8	6	4	AAI543							
				TB2-048		B8											
				TB2-049	TV1723	A9	9	6	4	AAI543							
				TB2-050		B9											
				TB2-051	PRV290S001	A10	10	6	4	AAI543							
				TB2-052		B10											
				TB2-053	LCV17D00	A11	11	6	4	AAI543							
				TB2-054		B11											
				TB2-055	TCV17D00	A12	12	6	4	AAI543							
				TB2-056		B12											
				TB2-057	VOPU150CCW9	A13	13	6	4	AAI543							
				TB2-058		B13											
				TB2-059	VOPU150CCW10	A14	14	6	4	AAI543							
				TB2-060		B14											
				TB2-061	VOFN150CT04B	A15	15	6	4	AAI543							
				TB2-062		B15											
				TB2-063	VOFN150CT04A	A16	16	6	4	AAI543							
				TB2-064		B16											

 GENERAL DESCRIPTION | | | | DR. | DATE | | | | | | | PROJECT NAME | | DWG. NO. || Panel Wiring Drawing | | | | DILA | 15/01/09 | | | | | | | | | WILMAR SURABAYA BD & ME PROJECT | | 26-AO |
CH.	DATE									TITLE		SHT. NO.				
				HARINAH	15/01/09									ME FRACT + OFFSITE		26
FILENAME				APP.	DATE									DOC. NO.		CONTD
ME FRACT + OFFSITE				JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY			WSBDME-D32-003		27

Signal Type :			Cabinet No :					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>												
HSC	RTD											
AI	AO											
DI	DO											
IS	NIS											
HART	NON HART											
			ME FRACT + OFFSITE (MC1)									
			MCB3-1									
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-1		24VDC-1		SYSTEM I/O				
				TB		Tag No.		Term.	Channel	Node	Slot	Model
				TB3-001				A1	1	5	5	ADV151
				TB3-002		LAH1701S		A17				
				TB3-003				A2	2	5	5	ADV151
				TB3-004		LAH1702S		A17				
				TB3-005				A3	3	5	5	ADV151
				TB3-006		LAH1703S		A17				
				TB3-007				A4	4	5	5	ADV151
				TB3-008		LAH1704S		A17				
				TB3-009				A5	5	5	5	ADV151
				TB3-010		LAL1705S		A17				
				TB3-011				A6	6	5	5	ADV151
				TB3-012		LAL1706S		A17				
				TB3-013				A7	7	5	5	ADV151
				TB3-014		LAL1707S		A17				
				TB3-015				A8	8	5	5	ADV151
				TB3-016		LAL1708S		A17				
				TB3-017				A9	9	5	5	ADV151
				TB3-018		KV1701OI		A17				
				TB3-019				A10	10	5	5	ADV151
				TB3-020		KV1701CI		A17				
				TB3-021				A11	11	5	5	ADV151
				TB3-022		KV1702OI		A17				
				TB3-023				A12	12	5	5	ADV151
				TB3-024		KV1702CI		A17				
				TB3-025				A13	13	5	5	ADV151
				TB3-026		KV1703OI		A17				
				TB3-027				A14	14	5	5	ADV151
				TB3-028		KV1703CI		A17				
				TB3-029				A15	15	5	5	ADV151
				TB3-030		17G02ASTI		A17				
				TB3-031				A16	16	5	5	ADV151
				TB3-032		17G02ATRI		A17				

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	27-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	27
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	28

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC1)					FCS0202									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>											HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE			CROSS WIRING TB	CROSS WIRE NO.	0VDC-1	24VDC-1	SYSTEM I/O													
					TB	</														

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC1)			FCS0202						
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>												HSC	RTD	AI	AO
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-2			SYSTEM I/O									
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-2	24VDC-2	TB	Tag No.	Term.	Channel	Node	Slot	Model			
				TB3-065			17G06BSTI	A1	1	5	6	ADV151			
				TB3-066			A17								
				TB3-067			17G06BTRI	A2	2	5	6	ADV151			
				TB3-068			A17								
				TB3-069			17G06CSTI	A3	3	5	6	ADV151			
				TB3-070			A17								
				TB3-071			Broken	A4	4	5	6	ADV151			
				TB3-072			A17								
				TB3-073			17G07ASTI	A5	5	5	6	ADV151			
				TB3-074			A17								
				TB3-075			17G07ATRI	A6	6	5	6	ADV151			
				TB3-076			A17								
				TB3-077			17G07BSTI	A7	7	5	6	ADV151			
				TB3-078			A17								
				TB3-079			17G07BTRI	A8	8	5	6	ADV151			
				TB3-080			A17								
				TB3-081			17G10STI	A9	9	5	6	ADV151			
				TB3-082			A17								
				TB3-083			17G10TRI	A10	10	5	6	ADV151			
				TB3-084			A17								
				TB3-085			17G11STI	A11	11	5	6	ADV151			
				TB3-086			A17								
				TB3-087			17G11TRI	A12	12	5	6	ADV151			
				TB3-088			A17								
				TB3-089			17G12STI	A13	13	5	6	ADV151			
				TB3-090			A17								
				TB3-091			17G12TRI	A14	14	5	6	ADV151			
				TB3-092			A17								
				TB3-093			17G15STI	A15	15	5	6	ADV151			
				TB3-094			A17								
				TB3-095			17G15TRI	A16	16	5	6	ADV151			
				TB3-096			A17								

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	29-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	29
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	30

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	29-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	29
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDM-E-D32-003	30

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC1)			FCS0202						
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>														HSC	RTD
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-2			SYSTEM I/O									
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-2	24VDC-2	TB	Tag No.	Term.	Channel	Node	Slot	Model			
				TB3-097			17G17STI	B1	17	5	6	ADV151			
				TB3-098				B17							
				TB3-099			17G17TRI	B2	18	5	6	ADV151			
				TB3-100				B17							
				TB3-101			17G18STI	B3	19	5	6	ADV151			
				TB3-102				B17							
				TB3-103			17G18TRI	B4	20	5	6	ADV151			
				TB3-104				B17							
				TB3-105			17G20STI	B5	21	5	6	ADV151			
				TB3-106				B17							
				TB3-107			17G20TRI	B6	22	5	6	ADV151			
				TB3-108				B17							
				TB3-109			17G21STI	B7	23	5	6	ADV151			
				TB3-110				B17							
				TB3-111			17G21TRI	B8	24	5	6	ADV151			
				TB3-112				B17							
				TB3-113			17G22ASTI	B9	25	5	6	ADV151			
				TB3-114				B17							
				TB3-115			17G22ATRI	B10	26	5	6	ADV151			
				TB3-116				B17							
				TB3-117			17G22BSTI	B11	27	5	6	ADV151			
				TB3-118				B17							
				TB3-119			17G22BTRI	B12	28	5	6	ADV151			
				TB3-120				B17							
				TB3-121			17G23STI	A13	29	5	6	ADV151			
				TB3-122				B17							
				TB3-123			17G23TRI	B14	30	5	6	ADV151			
				TB3-124				B17							
		TB3-125			17G30STI	B15	31	5	6	ADV151					
		TB3-126				B17									
		TB3-127			17G30TRI	B16	32	5	6	ADV151					
		TB3-128				B17									

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.	
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT		30-DI	
CH.	DATE						TITLE		SHT. NO.			
		HARINAH	15/01/09						ME FRACT + OFFSITE		30	
FILENAME		APP.	DATE						DOC. NO.		CONTD	
ME FRACT + OFFSITE		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003		31

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC1)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>															
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-3					SYSTEM I/O							
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-3		24VDC-3		Term.	Channel	Node	Slot	Model			
				TB	Tag No.										
				TB3-129	17G35STI			A1	1	5	7	ADV151			
				TB3-130				A17							
				TB3-131	17G35TRI			A2	2	5	7	ADV151			
				TB3-132				A17							
				TB3-133	17G36STI			A3	3	5	7	ADV151			
				TB3-134				A17							
				TB3-135	17G36TRI			A4	4	5	7	ADV151			
				TB3-136				A17							
				TB3-137	17G37STI			A5	5	5	7	ADV151			
				TB3-138				A17							
				TB3-139	17G37TRI			A6	6	5	7	ADV151			
				TB3-140				A17							
				TB3-141	17G54STI			A7	7	5	7	ADV151			
				TB3-142				A17							
				TB3-143	17G54TRI			A8	8	5	7	ADV151			
				TB3-144				A17							
				TB3-145	AG901700STI			A9	9	5	7	ADV151			
				TB3-146				A17							
				TB3-147	AG901700TRI			A10	10	5	7	ADV151			
				TB3-148				A17							
				TB3-149	AG901701STI			A11	11	5	7	ADV151			
				TB3-150				A17							
				TB3-151	AG901701TRI			A12	12	5	7	ADV151			
				TB3-152				A17							
				TB3-153	AG901702STI			A13	13	5	7	ADV151			
				TB3-154				A17							
				TB3-155	AG901702TRI			A14	14	5	7	ADV151			
				TB3-156				A17							
				TB3-157	AG901703STI			A15	15	5	7	ADV151			
				TB3-158				A17							
				TB3-159	AG901703TRI			A16	16	5	7	ADV151			
				TB3-160				A17							

GENERAL DESCRIPTION		DR.	DATE							PROJECT NAME		DWG. NO.
Panel Wiring Drawing		DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT		31-DI
		CH.	DATE							TITLE		SHT. NO.
		HARINAH	15/01/09							ME FRACT + OFFSITE		31
FILENAME	APP.	DATE								DOC. NO.		CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY		WSBDME-D32-003		32

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	DATE							PROJECT NAME	DWG. NO.
	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	31-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	31
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	32

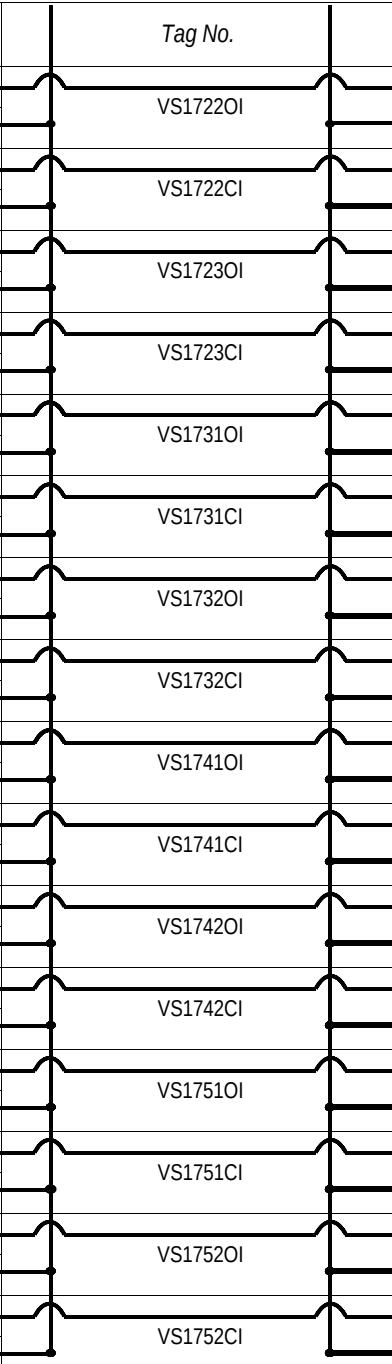
Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC1)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>															
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-3					SYSTEM I/O							
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-3		24VDC-3									
				TB	Tag No.		Term.	Channel	Node	Slot	Model				
				TB3-161	AG901704STI		B1	17	5	7	ADV151				
				TB3-162			B17								
				TB3-163	AG901704TRI		B2	18	5	7	ADV151				
				TB3-164			B17								
				TB3-165	AG901705STI		B3	19	5	7	ADV151				
				TB3-166			B17								
				TB3-167	AG901705TRI		B4	20	5	7	ADV151				
				TB3-168			B17								
				TB3-169	AG901706STI		B5	21	5	7	ADV151				
				TB3-170			B17								
				TB3-171	AG901706TRI		B6	22	5	7	ADV151				
				TB3-172			B17								
				TB3-173	AG901707STI		B7	23	5	7	ADV151				
				TB3-174			B17								
				TB3-175	AG901707TRI		B8	24	5	7	ADV151				
				TB3-176			B17								
				TB3-177	AG901708STI		B9	25	5	7	ADV151				
				TB3-178			B17								
				TB3-179	AG901708TRI		B10	26	5	7	ADV151				
				TB3-180			B17								
				TB3-181	AG901709STI		B11	27	5	7	ADV151				
				TB3-182			B17								
				TB3-183	AG901709TRI		B12	28	5	7	ADV151				
				TB3-184			B17								
				TB3-185	AG901710STI		A13	29	5	7	ADV151				
				TB3-186			B17								
				TB3-187	AG901710TRI		B14	30	5	7	ADV151				
				TB3-188			B17								
				TB3-189	PU901700ASTI		B15	31	5	7	ADV151				
				TB3-190			B17								
				TB3-191	PU901700ATRI		B16	32	5	7	ADV151				
				TB3-192			B17								

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	32-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	32
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	33

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	DATE							PROJECT NAME	DWG. NO.
	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	32-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	32
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	33

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC1)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>															
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-4					SYSTEM I/O							
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-4		24VDC-4									
				TB	Tag No.		Term.	Channel	Node	Slot	Model				
				TB3-193	PU901700BSTI		A1	1	6	5	ADV151				
				TB3-194			A17								
				TB3-195	PU901700BTRI		A2	2	6	5	ADV151				
				TB3-196			A17								
				TB3-197	PU901701STI		A3	3	6	5	ADV151				
				TB3-198			A17								
				TB3-199	PU901701TRI		A4	4	6	5	ADV151				
				TB3-200			A17								
				TB3-201	PU901703STI		A5	5	6	5	ADV151				
				TB3-202			A17								
				TB3-203	PU901703TRI		A6	6	6	5	ADV151				
				TB3-204			A17								
				TB3-205	PU901705STI		A7	7	6	5	ADV151				
				TB3-206			A17								
				TB3-207	PU901705TRI		A8	8	6	5	ADV151				
				TB3-208			A17								
				TB3-209	PU901708STI		A9	9	6	5	ADV151				
				TB3-210			A17								
				TB3-211	PU901708TRI		A10	10	6	5	ADV151				
				TB3-212			A17								
				TB3-213	PU901710STI		A11	11	6	5	ADV151				
				TB3-214			A17								
				TB3-215	PU901710TRI		A12	12	6	5	ADV151				
				TB3-216			A17								
		TB3-217	PU901711STI		A13	13	6	5	ADV151						
		TB3-218			A17										
		TB3-219	PU901711TRI		A14	14	6	5	ADV151						
		TB3-220			A17										
		TB3-221	VS1721OI		A15	15	6	5	ADV151						
		TB3-222			A17										
		TB3-223	VS1721CI		A16	16	6	5	ADV151						
		TB3-224			A17										

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	33-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	33
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	34

Signal Type :				Cabinet No :																		
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>				HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC1)				FCS0202				
HSC	RTD																					
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
				MCB3-4				SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-4	24VDC-4																	
				TB		Term.	Channel	Node	Slot	Model												
				TB3-225	VS1722OI	B1	17	6	5	ADV151												
				TB3-226		B17																
				TB3-227	VS1722CI	B2	18	6	5	ADV151												
				TB3-228		B17																
				TB3-229	VS1723OI	B3	19	6	5	ADV151												
				TB3-230		B17																
				TB3-231	VS1723CI	B4	20	6	5	ADV151												
				TB3-232		B17																
				TB3-233	VS1731OI	B5	21	6	5	ADV151												
				TB3-234		B17																
				TB3-235	VS1731CI	B6	22	6	5	ADV151												
				TB3-236		B17																
				TB3-237	VS1732OI	B7	23	6	5	ADV151												
				TB3-238		B17																
				TB3-239	VS1732CI	B8	24	6	5	ADV151												
				TB3-240		B17																
				TB3-241	VS1741OI	B9	25	6	5	ADV151												
				TB3-242		B17																
				TB3-243	VS1741CI	B10	26	6	5	ADV151												
				TB3-244		B17																
				TB3-245	VS1742OI	B11	27	6	5	ADV151												
				TB3-246		B17																
				TB3-247	VS1742CI	B12	28	6	5	ADV151												
				TB3-248		B17																
				TB3-249	VS1751OI	A13	29	6	5	ADV151												
				TB3-250		B17																
				TB3-251	VS1751CI	B14	30	6	5	ADV151												
				TB3-252		B17																
				TB3-253	VS1752OI	B15	31	6	5	ADV151												
				TB3-254		B17																
				TB3-255	VS1752CI	B16	32	6	5	ADV151												
				TB3-256		B17																

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT		34-DI
CH.	DATE						TITLE		SHT. NO.		
		HARINAH	15/01/09						ME FRACT + OFFSITE		34
FILENAME		APP.	DATE						DOC. NO.		CONT'D
ME FRACT + OFFSITE		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	
										35	

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC1)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>															
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-5					SYSTEM I/O							
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-5	24VDC-5										
				TB	Tag No.	Term.	Channel	Node	Slot	Model					
				TB4-001	AG91909ASTI	A1	1	6	6	ADV151					
				TB4-002		A17									
				TB4-003	AG91909ATRI	A2	2	6	6	ADV151					
				TB4-004		A17									
				TB4-005	AG91909BSTI	A3	3	6	6	ADV151					
				TB4-006		A17									
				TB4-007	AG91909BTRI	A4	4	6	6	ADV151					
				TB4-008		A17									
				TB4-009	AG91910ASTI	A5	5	6	6	ADV151					
				TB4-010		A17									
				TB4-011	AG91910ATRI	A6	6	6	6	ADV151					
				TB4-012		A17									
				TB4-013	AG91910BSTI	A7	7	6	6	ADV151					
				TB4-014		A17									
				TB4-015	AG91910BTRI	A8	8	6	6	ADV151					
				TB4-016		A17									
				TB4-017	PU91909ASTI	A9	9	6	6	ADV151					
				TB4-018		A17									
				TB4-019	PU91909ATRI	A10	10	6	6	ADV151					
				TB4-020		A17									
				TB4-021	AG91911ASTI	A11	11	6	6	ADV151					
				TB4-022		A17									
				TB4-023	AG91911ATRI	A12	12	6	6	ADV151					
				TB4-024		A17									
				TB4-025	AG91911BSTI	A13	13	6	6	ADV151					
				TB4-026		A17									
				TB4-027	AG91911BTRI	A14	14	6	6	ADV151					
				TB4-028		A17									
				TB4-029	AG91912ASTI	A15	15	6	6	ADV151					
				TB4-030		A17									
				TB4-031	AG91912ATRI	A16	16	6	6	ADV151					
				TB4-032		A17									

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	35-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	35
FILENAME	APP.	DATE						DOC. NO.		CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	36

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	35-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	35
FILENAME	APP.	DATE							DOC. NO.	CONTD
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	36

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC1)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>															
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-5					SYSTEM I/O							
			0VDC-5					24VDC-5							
FIELD CABLE			CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.			Term.	Channel	Node	Slot	Model		
					TB4-033	AG91912BSTI			B1	17	6	6	ADV151		
					TB4-034				B17						
					TB4-035	AG91912BTTRI			B2	18	6	6	ADV151		
					TB4-036				B17						
					TB4-037	AG91913ASTI			B3	19	6	6	ADV151		
					TB4-038				B17						
					TB4-039	AG91913ATRI			B4	20	6	6	ADV151		
					TB4-040				B17						
					TB4-041	AG91913BSTI			B5	21	6	6	ADV151		
					TB4-042				B17						
					TB4-043	AG91913BTTRI			B6	22	6	6	ADV151		
					TB4-044				B17						
					TB4-045	AG91914ASTI			B7	23	6	6	ADV151		
					TB4-046				B17						
					TB4-047	AG91914ATRI			B8	24	6	6	ADV151		
					TB4-048				B17						
					TB4-049	AG91914BSTI			B9	25	6	6	ADV151		
					TB4-050				B17						
					TB4-051	AG91914BTTRI			B10	26	6	6	ADV151		
					TB4-052				B17						
					TB4-053	SPARE			B11	27	6	6	ADV151		
					TB4-054				B17						
					TB4-055	SPARE			B12	28	6	6	ADV151		
					TB4-056				B17						
					TB4-057	SPARE			A13	29	6	6	ADV151		
					TB4-058				B17						
					TB4-059	SPARE			B14	30	6	6	ADV151		
					TB4-060				B17						
					TB4-061	SPARE			B15	31	6	6	ADV151		
					TB4-062				B17						
					TB4-063	SPARE			B16	32	6	6	ADV151		
					TB4-064				B17						

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	36-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	36
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	37

Signal Type :			Cabinet No :			FCS0202									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>											HSC	RTD	AI	AO	DI
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			ME FRACT + OFFSITE (MC2)												
			MCB3-6			SYSTEM I/O									
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-6	24VDC-6										
				TB	Tag No.	Term.	Channel	Node	Slot	Model					
				TB4-065	LS250WW1S	A1	1	8	4	ADV151					
				TB4-066		A17									
				TB4-067	LS250WW2S	A2	2	8	4	ADV151					
				TB4-068		A17									
				TB4-069	LS250WW3S	A3	3	8	4	ADV151					
				TB4-070		A17									
				TB4-071	PU250WW1STI	A4	4	8	4	ADV151					
				TB4-072		A17									
				TB4-073	PU250WW1TRI	A5	5	8	4	ADV151					
				TB4-074		A17									
				TB4-075	PU250WW2STI	A6	6	8	4	ADV151					
				TB4-076		A17									
				TB4-077	PU250WW2TRI	A7	7	8	4	ADV151					
				TB4-078		A17									
				TB4-079	PU250WW3STI	A8	8	8	4	ADV151					
				TB4-080		A17									
				TB4-081	PU250WW3TRI	A9	9	8	4	ADV151					
				TB4-082		A17									
				TB4-083	PU2500ASTI	A10	10	8	4	ADV151					
				TB4-084		A17									
				TB4-085	PU2500ATRI	A11	11	8	4	ADV151					
				TB4-086		A17									
				TB4-087	PU2500BSTI	A12	12	8	4	ADV151					
				TB4-088		A17									
				TB4-089	PU2500BTRI	A13	13	8	4	ADV151					
				TB4-090		A17									
				TB4-091	PU2501ASTI	A14	14	8	4	ADV151					
				TB4-092		A17									
				TB4-093	PU2501ATRI	A15	15	8	4	ADV151					
				TB4-094		A17									
				TB4-095	PU2501BSTI	A16	16	8	4	ADV151					
				TB4-096		A17									

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	37-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	37
FILENAME	APP.	DATE							DOC. NO.	CONTD
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	38

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC2)					FCS0202									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>											HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE			CROSS WIRING TB	CROSS WIRE NO.	0VDC-6	24VDC-6	SYSTEM I/O													
					TB	</														

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC2)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>															
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-7					SYSTEM I/O							
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-7		24VDC-7		Term.	Channel	Node	Slot	Model			
				TB	Tag No.										
				TB4-129	LSHA117F07S			A1	1	8	5	ADV151			
				TB4-130				A17							
				TB4-131	LSLA117F08S			A2	2	8	5	ADV151			
				TB4-132				A17							
				TB4-133	LSLA150CT04S			A3	3	8	5	ADV151			
				TB4-134				A17							
				TB4-135	FN150CT04ASTI			A4	4	8	5	ADV151			
				TB4-136				A17							
				TB4-137	FN150CT04ATRI			A5	5	8	5	ADV151			
				TB4-138				A17							
				TB4-139	FN150CT04BSTI			A6	6	8	5	ADV151			
				TB4-140				A17							
				TB4-141	FN150CT04BTRI			A7	7	8	5	ADV151			
				TB4-142				A17							
				TB4-143	PU150CCW9STI			A8	8	8	5	ADV151			
				TB4-144				A17							
				TB4-145	PU150CCW9TRI			A9	9	8	5	ADV151			
				TB4-146				A17							
				TB4-147	PU150CCW10STI			A10	10	8	5	ADV151			
				TB4-148				A17							
				TB4-149	PU150CCW10TRI			A11	11	8	5	ADV151			
				TB4-150				A17							
				TB4-151	SV150CT04OI			A12	12	8	5	ADV151			
				TB4-152				A17							
				TB4-153	SV150CT04CI			A13	13	8	5	ADV151			
				TB4-154				A17							
				TB4-155	PU117F07STI			A14	14	8	5	ADV151			
				TB4-156				A17							
				TB4-157	PU117F07TRI			A15	15	8	5	ADV151			
				TB4-158				A17							
				TB4-159	17G50STI			A16	16	8	5	ADV151			
				TB4-160				A17							

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT		39-DI
		CH.	DATE						TITLE		SHT. NO.
		HARINAH	15/01/09						ME FRACT + OFFSITE		39
FILENAME	APP.	DATE							DOC. NO.		CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003		40

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	39-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	39
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	40

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC2)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>															
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-7					SYSTEM I/O							
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-7		24VDC-7		Term.	Channel	Node	Slot	Model			
				TB	Tag No.										
				TB4-161	17G50TRI			B1	17	8	5	ADV151			
				TB4-162				B17							
				TB4-163	PU91909BSTI			B2	18	8	5	ADV151			
				TB4-164				B17							
				TB4-165	PU91909BTRI			B3	19	8	5	ADV151			
				TB4-166				B17							
				TB4-167	SPARE			B4	20	8	5	ADV151			
				TB4-168				B17							
				TB4-169	SPARE			B5	21	8	5	ADV151			
				TB4-170				B17							
				TB4-171	SPARE			B6	22	8	5	ADV151			
				TB4-172				B17							
				TB4-173	17G06CTRI			B7	23	8	5	ADV151			
				TB4-174				B17							
				TB4-175	SPARE			B8	24	8	5	ADV151			
				TB4-176				B17							
				TB4-177	SPARE			B9	25	8	5	ADV151			
				TB4-178				B17							
				TB4-179	SPARE			B10	26	8	5	ADV151			
				TB4-180				B17							
				TB4-181	SPARE			B11	27	8	5	ADV151			
				TB4-182				B17							
				TB4-183	SPARE			B12	28	8	5	ADV151			
				TB4-184				B17							
				TB4-185	SPARE			A13	29	8	5	ADV151			
				TB4-186				B17							
				TB4-187	SPARE			B14	30	8	5	ADV151			
				TB4-188				B17							
				TB4-189	SPARE			B15	31	8	5	ADV151			
				TB4-190				B17							
				TB4-191	SPARE			B16	32	8	5	ADV151			
				TB4-192				B17							

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	40-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	40
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	41

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	DATE							PROJECT NAME	DWG. NO.
	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	40-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	40
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	41

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC2)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>															
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-8					SYSTEM I/O							
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-8		24VDC-8		Term.	Channel	Node	Slot	Model			
				TB	Tag No.										
				TB4-193	SPARE		A1	1	8	6	ADV151				
				TB4-194			A17								
				TB4-195	SPARE		A2	2	8	6	ADV151				
				TB4-196			A17								
				TB4-197	SPARE		A3	3	8	6	ADV151				
				TB4-198			A17								
				TB4-199	SPARE		A4	4	8	6	ADV151				
				TB4-200			A17								
				TB4-201	SPARE		A5	5	8	6	ADV151				
				TB4-202			A17								
				TB4-203	SPARE		A6	6	8	6	ADV151				
				TB4-204			A17								
				TB4-205	SPARE		A7	7	8	6	ADV151				
				TB4-206			A17								
				TB4-207	SPARE		A8	8	8	6	ADV151				
				TB4-208			A17								
				TB4-209	SPARE		A9	9	8	6	ADV151				
				TB4-210			A17								
				TB4-211	SPARE		A10	10	8	6	ADV151				
				TB4-212			A17								
				TB4-213	SPARE		A11	11	8	6	ADV151				
				TB4-214			A17								
				TB4-215	SPARE		A12	12	8	6	ADV151				
				TB4-216			A17								
				TB4-217	SPARE		A13	13	8	6	ADV151				
				TB4-218			A17								
				TB4-219	SPARE		A14	14	8	6	ADV151				
				TB4-220			A17								
				TB4-221	SPARE		A15	15	8	6	ADV151				
				TB4-222			A17								
				TB4-223	SPARE		A16	16	8	6	ADV151				
				TB4-224			A17								

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	41-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	41
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	42

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	DATE							PROJECT NAME	DWG. NO.
	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	41-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	41
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	42

Signal Type :			Cabinet No :			ME FRACT + OFFSITE (MC2)					FCS0202				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>															
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
			MCB3-8					SYSTEM I/O							
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-8	24VDC-8	Term.	Channel	Node	Slot	Model					
				TB4-225	SPARE	B1	17	8	6	ADV151					
				TB4-226		B17									
				TB4-227	SPARE	B2	18	8	6	ADV151					
				TB4-228		B17									
				TB4-229	SPARE	B3	19	8	6	ADV151					
				TB4-230		B17									
				TB4-231	SPARE	B4	20	8	6	ADV151					
				TB4-232		B17									
				TB4-233	SPARE	B5	21	8	6	ADV151					
				TB4-234		B17									
				TB4-235	SPARE	B6	22	8	6	ADV151					
				TB4-236		B17									
				TB4-237	SPARE	B7	23	8	6	ADV151					
				TB4-238		B17									
				TB4-239	SPARE	B8	24	8	6	ADV151					
				TB4-240		B17									
				TB4-241	SPARE	B9	25	8	6	ADV151					
				TB4-242		B17									
				TB4-243	SPARE	B10	26	8	6	ADV151					
				TB4-244		B17									
				TB4-245	SPARE	B11	27	8	6	ADV151					
				TB4-246		B17									
				TB4-247	SPARE	B12	28	8	6	ADV151					
				TB4-248		B17									
				TB4-249	SPARE	A13	29	8	6	ADV151					
				TB4-250		B17									
				TB4-251	SPARE	B14	30	8	6	ADV151					
				TB4-252		B17									
				TB4-253	SPARE	B15	31	8	6	ADV151					
				TB4-254		B17									
				TB4-255	SPARE	B16	32	8	6	ADV151					
				TB4-256		B17									

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	42-DI
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	42
FILENAME	APP.	DATE							DOC. NO.	CONT'D
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	43

Signal Type :			Cabinet No :					FCS0202									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC											RTD	AI	AO	DI	DO
HSC	RTD																
AI	AO																
DI	DO																
IS	NIS																
HART	NON HART																
ME FRACT + OFFSITE (MC2)					SYSTEM I/O												
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model							
				TB5-001	PT250AR3	A1	1	7	1	AAI143							
				TB5-002		B1											
				TB5-003	PT250AR4	A2	2	7	1	AAI143							
				TB5-004		B2											
				TB5-005	PT250AR5	A3	3	7	1	AAI143							
				TB5-006		B3											
				TB5-007	PT250AR6	A4	4	7	1	AAI143							
				TB5-008		B4											
				TB5-009	PT250N1	A5	5	7	1	AAI143							
				TB5-010		B5											
				TB5-011	PT250N2	A6	6	7	1	AAI143							
				TB5-012		B6											
				TB5-013	PT250N3	A7	7	7	1	AAI143							
				TB5-014		B7											
				TB5-015	PT250N4	A8	8	7	1	AAI143							
				TB5-016		B8											
				TB5-017	LT250DW	A9	9	7	1	AAI143							
				TB5-018		B9											
				TB5-019	LT17D00	A10	10	7	1	AAI143							
				TB5-020		B10											
				TB5-021	TT17D00	A11	11	7	1	AAI143							
				TB5-022		B11											
				TB5-023	TT250TOH-S	A12	12	7	1	AAI143							
				TB5-024		B12											
				TB5-025	TT250TOH-R	A13	13	7	1	AAI143							
				TB5-026		B13											
				TB5-027	PT250TOH-S	A14	14	7	1	AAI143							
				TB5-028		B14											
				TB5-029	PT250TOH-R	A15	15	7	1	AAI143							
				TB5-030		B15											
				TB5-031	SPARE	A16	16	7	1	AAI143							
				TB5-032		B16											
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.						
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT		43-AI						
		CH.	DATE						TITLE		SHT. NO.						
		HARINAH	15/01/09						ME FRACT + OFFSITE		43						
FILENAME		APP.	DATE						DOC. NO.		CONTD						
ME FRACT + OFFSITE		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WPMEGLY-D32-003	44						

Signal Type :			Cabinet No :					FCS0202														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>													HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART
HSC	RTD																					
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
SYSTEM I/O																						
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model												
				TB5-033	PT290S001	A1	1	7	2	AAI143												
				TB5-034		B1																
				TB5-035	FT290S001	A2	2	7	2	AAI143												
				TB5-036		B2																
				TB5-037	FT290S002	A3	3	7	2	AAI143												
				TB5-038		B3																
				TB5-039	FT290S003	A4	4	7	2	AAI143												
				TB5-040		B4																
				TB5-041	VIFN150CT04B	A5	5	7	2	AAI143												
				TB5-042		B5																
				TB5-043	VIFN150CT04A	A6	6	7	2	AAI143												
				TB5-044		B6																
				TB5-045	SPARE	A7	7	7	2	AAI143												
				TB5-046		B7																
				TB5-047	SPARE	A8	8	7	2	AAI143												
				TB5-048		B8																
				TB5-049	SPARE	A9	9	7	2	AAI143												
				TB5-050		B9																
				TB5-051	SPARE	A10	10	7	2	AAI143												
				TB5-052		B10																
				TB5-053	SPARE	A11	11	7	2	AAI143												
				TB5-054		B11																
				TB5-055	SPARE	A12	12	7	2	AAI143												
				TB5-056		B12																
				TB5-057	SPARE	A13	13	7	2	AAI143												
				TB5-058		B13																
				TB5-059	SPARE	A14	14	7	2	AAI143												
				TB5-060		B14																
				TB5-061	SPARE	A15	15	7	2	AAI143												
				TB5-062		B15																
				TB5-063	SPARE	A16	16	7	2	AAI143												
				TB5-064		B16																
		GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.									
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT		44-AI											
		CH.	DATE						TITLE		SHT. NO.											
		HARINAH	15/01/09						ME FRACT + OFFSITE		44											
FILENAME		APP.	DATE						DOC. NO.		CONTD											
ME FRACT + OFFSITE		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WPMEGLY-D32-003	45											

Signal Type :			Cabinet No :			FCS0202									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>											HSC	RTD	AI	AO	DI
HSC	RTD														
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														
ME FRACT + OFFSITE (MC2)			SYSTEM I/O												
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model					
				TB5-065	SPARE	A1	1	8	1	AAI143					
				TB5-066		B1									
				TB5-067	SPARE	A2	2	8	1	AAI143					
				TB5-068		B2									
				TB5-069	SPARE	A3	3	8	1	AAI143					
				TB5-070		B3									
				TB5-071	SPARE	A4	4	8	1	AAI143					
				TB5-072		B4									
				TB5-073	SPARE	A5	5	8	1	AAI143					
				TB5-074		B5									
				TB5-075	SPARE	A6	6	8	1	AAI143					
				TB5-076		B6									
				TB5-077	SPARE	A7	7	8	1	AAI143					
				TB5-078		B7									
				TB5-079	SPARE	A8	8	8	1	AAI143					
				TB5-080		B8									
				TB5-081	SPARE	A9	9	8	1	AAI143					
				TB5-082		B9									
				TB5-083	SPARE	A10	10	8	1	AAI143					
				TB5-084		B10									
				TB5-085	SPARE	A11	11	8	1	AAI143					
				TB5-086		B11									
				TB5-087	SPARE	A12	12	8	1	AAI143					
				TB5-088		B12									
				TB5-089	SPARE	A13	13	8	1	AAI143					
				TB5-090		B13									
				TB5-091	SPARE	A14	14	8	1	AAI143					
				TB5-092		B14									
		TB5-093	SPARE	A15	15	8	1	AAI143							
		TB5-094		B15											
		TB5-095	SPARE	A16	16	8	1	AAI143							
		TB5-096		B16											
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.				
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT		45-AI				
		CH.	DATE						TITLE		SHT. NO.				
		HARINAH	15/01/09						ME FRACT + OFFSITE		45				
FILENAME		APP.	DATE						DOC. NO.		CONTD				
ME FRACT + OFFSITE		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WPMEGLY-D32-003					
										46					

YOKOGAWA 

Signal Type :			Cabinet No : <				
---------------	--	--	---	--	--	--	--

Signal Type :				Cabinet No :																	
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>				HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC1)				FCS0202			
HSC	RTD																				
AI	AO																				
DI	DO																				
IS	NIS																				
HART	NON HART																				
								SYSTEM I/O													
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model											
				TB6-001	SPARE	A1	1	8	3	AAI543											
				TB6-002		B1															
				TB6-003	SPARE	A2	2	8	3	AAI543											
				TB6-004		B2															
				TB6-005	SPARE	A3	3	8	3	AAI543											
				TB6-006		B3															
				TB6-007	SPARE	A4	4	8	3	AAI543											
				TB6-008		B4															
				TB6-009	SPARE	A5	5	8	3	AAI543											
				TB6-010		B5															
				TB6-011	SPARE	A6	6	8	3	AAI543											
				TB6-012		B6															
				TB6-013	SPARE	A7	7	8	3	AAI543											
				TB6-014		B7															
				TB6-015	SPARE	A8	8	8	3	AAI543											
				TB6-016		B8															
				TB6-017	SPARE	A9	9	8	3	AAI543											
				TB6-018		B9															
				TB6-019	SPARE	A10	10	8	3	AAI543											
				TB6-020		B10															
				TB6-021	SPARE	A11	11	8	3	AAI543											
				TB6-022		B11															
				TB6-023	SPARE	A12	12	8	3	AAI543											
				TB6-024		B12															
				TB6-025	SPARE	A13	13	8	3	AAI543											
				TB6-026		B13															
				TB6-027	SPARE	A14	14	8	3	AAI543											
				TB6-028		B14															
				TB6-029	SPARE	A15	15	8	3	AAI543											
				TB6-030		B15															
				TB6-031	SPARE	A16	16	8	3	AAI543											
				TB6-032		B16															

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	47-AO
	CH.	DATE							TITLE	SHT. NO.
	HARINAH	15/01/09							ME FRACT + OFFSITE	47
FILENAME	APP.	DATE							DOC. NO.	CONTD
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	48

Signal Type :			Cabinet No. :										FCS0202														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC2)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
			MCB3-13		24VDC-13		24VDC-9		MCB3-9		OVDC-9																
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB				IP-R		Tag No.	Term.	Channel	NODE	SLOT	MODEL												
			TB7-001		14			R1-1	A2	KV1701O	A1	1	7	3	ADV551												
			TB7-002		11				A1																		
			TB7-003		14			R1-2	A2	KV1702O	A2	2	7	3	ADV551												
			TB7-004		11				A1																		
			TB7-005		14			R1-3	A2	KV1703O	A3	3	7	3	ADV551												
			TB7-006		11				A1																		
			TB7-007		14			R1-4	A2	17G02AO	A4	4	7	3	ADV551												
			TB7-008		11				A1																		
			TB7-009		14			R1-5	A2	17G02BO	A5	5	7	3	ADV551												
			TB7-010		11				A1																		
			TB7-011		14			R1-6	A2	17G03AO	A6	6	7	3	ADV551												
			TB7-012		11				A1																		
			TB7-013		14			R1-7	A2	17G03BO	A7	7	7	3	ADV551												
			TB7-014		11				A1																		
			TB7-015		14			R1-8	A2	17G04AO	A8	8	7	3	ADV551												
			TB7-016		11				A1																		
			TB7-017		14			R1-9	A2	17G04BO	A9	9	7	3	ADV551												
			TB7-018		11				A1																		
			TB7-019		14			R1-10	A2	17G05AO	A10	10	7	3	ADV551												
			TB7-020		11				A1																		
			TB7-021		14			R1-11	A2	17G05BO	A11	11	7	3	ADV551												
			TB7-022		11				A1																		
			TB7-023		14			R1-12	A2	17G06AO	A12	12	7	3	ADV551												
			TB7-024		11				A1																		
			TB7-025		14			A13	A2	17G06BO	A13	13	7	3	ADV551												
			TB7-026		11				A1																		
			TB7-027		14			R1-14	A2	17G06CO	A14	14	7	3	ADV551												
			TB7-028		11				A1																		
			TB7-029		14			R1-15	A2	17G07AO	A15	15	7	3	ADV551												
			TB7-030		11				A1																		
			TB7-031		14			R1-16	A2	17G07BO	A16	16	7	3	ADV551												
			TB7-032		11				A1																		
											A17	-	7	3	ADV551												
											A18	+															

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	48-DO
	CH.	DATE							TITLE	SHT NO
	HARINAH	15/01/09							ME FRACT + OFFSITE	48
FILENAME	APP.	DATE							DOC. NO.	CONT NO
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	48

GENERAL DESCRIPTION	DR.	DATE						PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT	48-DO
	CH.	DATE						TITLE	SHT NO
	HARINAH	15/01/09						ME FRACT + OFFSITE	48
FILENAME	APP.	DATE						DOC. NO.	CONT NO
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003
									49

Signal Type :			Cabinet No :										FCS0202														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC2)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
			MCB3-13					MCB3-9																			
			OVDC-13		24VDC-13		24VDC-9		OVDC-9																		
FIELD CABLE			CROSS WIRING TB	CROSS WIRE NO.	TB			IP-R		Tag No.	Term.	Channel	NODE	SLOT	MODEL												
					TB7-033			14	R1-17	A2		B1	17	7	3	ADV551											
					TB7-034			11		A1																	
					TB7-035			14	R1-18	A2		B2	18	7	3	ADV551											
					TB7-036			11		A1																	
					TB7-037			14	R1-19	A2		B3	19	7	3	ADV551											
					TB7-038			11		A1																	
					TB7-039			14	R1-20	A2		B4	20	7	3	ADV551											
					TB7-040			11		A1																	
					TB7-041			14	R1-21	A2		B5	21	7	3	ADV551											
					TB7-042			11		A1																	
					TB7-043			14	R1-22	A2		B6	22	7	3	ADV551											
					TB7-044			11		A1																	
					TB7-045			14	R1-23	A2		B7	23	7	3	ADV551											
					TB7-046			11		A1																	
					TB7-047			14	R1-24	A2		B8	24	7	3	ADV551											
					TB7-048			11		A1																	
					TB7-049			14	R1-25	A2		B9	25	7	3	ADV551											
					TB7-050			11		A1																	
					TB7-051			14	R1-26	A2		B10	26	7	3	ADV551											
					TB7-052			11		A1																	
					TB7-053			14	R1-27	A2		B11	27	7	3	ADV551											
					TB7-054			11		A1																	
					TB7-055			14	R1-28	A2		B12	28	7	3	ADV551											
					TB7-056			11		A1																	
					TB7-057			14	A13	A2		B13	29	7	3	ADV551											
					TB7-058			11		A1																	
					TB7-059			14	R1-30	A2		B14	30	7	3	ADV551											
					TB7-060			11		A1																	
					TB7-061			14	R1-31	A2		B15	31	7	3	ADV551											
					TB7-062			11		A1																	
					TB7-063			14	R1-32	A2		B16	32	7	3	ADV551											
					TB7-064			11		A1																	
												B17	-	7	3	ADV551											
												B18	+														

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	49-DO
	CH.	DATE						TITLE		SHT NO
	HARINAH	15/01/09						ME FRACT + OFFSITE	49	
FILENAME	APP.	DATE						DOC. NO.	CONT NO	
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	5

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME	DWG. NO.
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT	49-DO
		CH.	DATE						TITLE	SHT NO
		HARINAH	15/01/09						ME FRACT + OFFSITE	49
FILENAME		APP.	DATE						DOC. NO.	CONT NO
ME FRACT + OFFSIT		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	50
									WSBDME-D32-003	

Signal Type :			Cabinet No :										FCS0202														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC2)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	MCB3-14					MCB3-10																			
			OVDC-14		24VDC-14				24VDC-10		OVDC-10																
			TB				IP-R			Tag No.		Term.	Channel	NODE	SLOT	MODEL											
			TB7-065			14	R2-1	A2		AG901700O		A1	1	7	4	ADV551											
			TB7-066			11		A1																			
			TB7-067			14	R2-2	A2		AG901701O		A2	2	7	4	ADV551											
			TB7-068			11		A1																			
			TB7-069			14	R2-3	A2		AG901702O		A3	3	7	4	ADV551											
			TB7-070			11		A1																			
			TB7-071			14	R2-4	A2		AG901703O		A4	4	7	4	ADV551											
			TB7-072			11		A1																			
			TB7-073			14	R2-5	A2		AG901704O		A5	5	7	4	ADV551											
			TB7-074			11		A1																			
			TB7-075			14	R2-6	A2		AG901705O		A6	6	7	4	ADV551											
			TB7-076			11		A1																			
			TB7-077			14	R2-7	A2		AG901706O		A7	7	7	4	ADV551											
			TB7-078			11		A1																			
			TB7-079			14	R2-8	A2		AG901707O		A8	8	7	4	ADV551											
			TB7-080			11		A1																			
			TB7-081			14	R2-9	A2		AG901708O		A9	9	7	4	ADV551											
			TB7-082			11		A1																			
			TB7-083			14	R2-10	A2		AG901709O		A10	10	7	4	ADV551											
			TB7-084			11		A1																			
			TB7-085			14	R2-11	A2		AG901710O		A11	11	7	4	ADV551											
			TB7-086			11		A1																			
			TB7-087			14	R2-12	A2		PU901700AO		A12	12	7	4	ADV551											
			TB7-088			11		A1																			
			TB7-089			14	A13	A2		PU901700BO		A13	13	7	4	ADV551											
			TB7-090			11		A1																			
			TB7-091			14	R2-14	A2		PU901701O		A14	14	7	4	ADV551											
			TB7-092			11		A1																			
			TB7-093			14	R2-15	A2		PU901703O		A15	15	7	4	ADV551											
			TB7-094			11		A1																			
			TB7-095			14	R2-16	A2		PU901705O		A16	16	7	4	ADV551											
			TB7-096			11		A1																			
												A17	-	7	4	ADV551											
												A18	+														

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	50-DO
	CH.	DATE							TITLE	SHT NO
	HARINAH	15/01/09							ME FRACT + OFFSITE	50
FILENAME	APP.	DATE							DOC. NO.	CONT NO
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	5

GENERAL DESCRIPTION	DR.	DATE						PROJECT NAME	DWG. NO.	
Panel Wiring Drawing	DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT	50-DO	
	CH.	DATE						TITLE	SHT NO	
	HARINAH	15/01/09						ME FRACT + OFFSITE	50	
FILENAME	APP.	DATE						DOC. NO.	CONT NO	
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	51

Signal Type :			Cabinet No. :										FCS0202														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC2)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	MCB3-14					MCB3-10																			
			OVDC-14		24VDC-14		24VDC-10		OVDC-10																		
			TB				IP-R		Tag No.	Term.	Channel	NODE	SLOT	MODEL													
			TB7-097			14	R2-17	A2	PU901708O	B1	17	7	4	ADV551													
			TB7-098			11		A1																			
			TB7-099			14	R2-18	A2	PU901710O	B2	18	7	4	ADV551													
			TB7-100			11		A1																			
			TB7-101			14	R2-19	A2	PU901711O	B3	19	7	4	ADV551													
			TB7-102			11		A1																			
			TB7-103			14	R2-20	A2	AG91909AO	B4	20	7	4	ADV551													
			TB7-104			11		A1																			
			TB7-105			14	R2-21	A2	AG91909BO	B5	21	7	4	ADV551													
			TB7-106			11		A1																			
			TB7-107			14	R2-22	A2	AG91910AO	B6	22	7	4	ADV551													
			TB7-108			11		A1																			
			TB7-109			14	R2-23	A2	AG91910BO	B7	23	7	4	ADV551													
			TB7-110			11		A1																			
			TB7-111			14	R2-24	A2	PU91909AO	B8	24	7	4	ADV551													
			TB7-112			11		A1																			
			TB7-113			14	R2-25	A2	AG91911AO	B9	25	7	4	ADV551													
			TB7-114			11		A1																			
			TB7-115			14	R2-26	A2	AG91911BO	B10	26	7	4	ADV551													
			TB7-116			11		A1																			
			TB7-117			14	R2-27	A2	AG91912AO	B11	27	7	4	ADV551													
			TB7-118			11		A1																			
			TB7-119			14	R2-28	A2	AG91912BO	B12	28	7	4	ADV551													
			TB7-120			11		A1																			
			TB7-121			14	A13	A2	AG91913AO	B13	29	7	4	ADV551													
			TB7-122			11		A1																			
			TB7-123			14	R2-30	A2	AG91913BO	B14	30	7	4	ADV551													
			TB7-124			11		A1																			
			TB7-125			14	R2-31	A2	AG91914AO	B15	31	7	4	ADV551													
			TB7-126			11		A1																			
			TB7-127			14	R2-32	A2	AG91914BO	B16	32	7	4	ADV551													
			TB7-128			11		A1																			
										B17	-	7	4	ADV551													
										B18	+																

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	51-DO
	CH.	DATE							TITLE	SHT NO
	HARINAH	15/01/09							ME FRACT + OFFSITE	51
FILENAME	APP.	DATE							DOC. NO.	CONT NO
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	5

GENERAL DESCRIPTION		DR.	DATE					PROJECT NAME		DWG. NO.
Panel Wiring Drawing		DILA	15/01/09					WILMAR SURABAYA BD & ME PROJECT		51-DO
		CH.	DATE					TITLE		SHT NO
		HARINAH	15/01/09					ME FRACT + OFFSITE		51
FILENAME		APP.	DATE					DOC. NO.		CONT NO
ME FRACT + OFFSIT		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	52

Signal Type :			Cabinet No :										FCS0202														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC2)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	MCB3-15		24VDC-15		24VDC-11		MCB3-11		OVDC-11		Term.	Channel	NODE	SLOT	MODEL									
				TB				IP-R			Tag No.																
				TB7-129			14	R3-1	A2		PU250WW1O	A1	1	7	5	ADV551											
				TB7-130			11		A1																		
				TB7-131			14	R3-2	A2		PU250WW2O	A2	2	7	5	ADV551											
				TB7-132			11		A1																		
				TB7-133			14	R3-3	A2		PU250WW3O	A3	3	7	5	ADV551											
				TB7-134			11		A1																		
				TB7-135			14	R3-4	A2		PU2500AO	A4	4	7	5	ADV551											
				TB7-136			11		A1																		
				TB7-137			14	R3-5	A2		PU2500BO	A5	5	7	5	ADV551											
				TB7-138			11		A1																		
				TB7-139			14	R3-6	A2		PU2501AO	A6	6	7	5	ADV551											
				TB7-140			11		A1																		
				TB7-141			14	R3-7	A2		PU2501BO	A7	7	7	5	ADV551											
				TB7-142			11		A1																		
				TB7-143			14	R3-8	A2		PU2502AO	A8	8	7	5	ADV551											
				TB7-144			11		A1																		
				TB7-145			14	R3-9	A2		PU2502BO	A9	9	7	5	ADV551											
				TB7-146			11		A1																		
				TB7-147			14	R3-10	A2		PU2503AO	A10	10	7	5	ADV551											
				TB7-148			11		A1																		
				TB7-149			14	R3-11	A2		PU2503BO	A11	11	7	5	ADV551											
				TB7-150			11		A1																		
				TB7-151			14	R3-12	A2		PU17D00AO	A12	12	7	5	ADV551											
				TB7-152			11		A1																		
				TB7-153			14	R3-13	A2		PU17D00BO	A13	13	7	5	ADV551											
				TB7-154			11		A1																		
				TB7-155			14	R3-14	A2		FN150CT04AO	A14	14	7	5	ADV551											
				TB7-156			11		A1																		
				TB7-157			14	R3-15	A2		FN150CT04BO	A15	15	7	5	ADV551											
				TB7-158			11		A1																		
				TB7-159			14	R3-16	A2		PU150CCW9O	A16	16	7	5	ADV551											
				TB7-160			11		A1				A17	-	7	5	ADV551										
												A18	+														

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	52-DO
	CH.	DATE							TITLE	SHT NO
	HARINAH	15/01/09							ME FRACT + OFFSITE	52
FILENAME	APP.	DATE							DOC. NO.	CONT NO
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	5

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME	DWG. NO.
Panel Wiring Drawing		DILA	15/01/09						WILMAR SURABAYA BD & ME PROJECT	52-DO
		CH.	DATE						TITLE	SHT NO
		HARINAH	15/01/09						ME FRACT + OFFSITE	52
FILENAME	APP.	DATE						DOC. NO.		CONT NO
ME FRACT + OFFSIT	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	53

Signal Type :			Cabinet No :										FCS0202														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC2)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	MCB3-15					MCB3-11																			
			OVDC-15		24VDC-15		24VDC-11		OVDC-11																		
			TB				IP-R		Tag No.		Term.	Channel	NODE	SLOT	MODEL												
			TB7-161			14	R3-17	A2	PU150CCW100		B1	17	7	5	ADV551												
			TB7-162			11		A1																			
			TB7-163			14	R3-18	A2	SV150CT040		B2	18	7	5	ADV551												
			TB7-164			11		A1																			
			TB7-165			14	R3-19	A2	PU117F070		B3	19	7	5	ADV551												
			TB7-166			11		A1																			
			TB7-167			14	R3-20	A2	17G500		B4	20	7	5	ADV551												
			TB7-168			11		A1																			
			TB7-169			14	R3-21	A2	PU91909BO		B5	21	7	5	ADV551												
			TB7-170			11		A1																			
			TB7-171			14	R3-22	A2	FCS0202ALMSW		B6	22	7	5	ADV551												
			TB7-172			11		A1																			
			TB7-173			14	R3-23	A2	SPARE		B7	23	7	5	ADV551												
			TB7-174			11		A1																			
			TB7-175			14	R3-24	A2	SPARE		B8	24	7	5	ADV551												
			TB7-176			11		A1																			
			TB7-177			14	R3-25	A2	SPARE		B9	25	7	5	ADV551												
			TB7-178			11		A1																			
			TB7-179			14	R3-26	A2	SPARE		B10	26	7	5	ADV551												
			TB7-180			11		A1																			
			TB7-181			14	R3-27	A2	SPARE		B11	27	7	5	ADV551												
			TB7-182			11		A1																			
			TB7-183			14	R3-28	A2	SPARE		B12	28	7	5	ADV551												
			TB7-184			11		A1																			
			TB7-185			14	R3-29	A2	SPARE		B13	29	7	5	ADV551												
			TB7-186			11		A1																			
			TB7-187			14	R3-30	A2	SPARE		B14	30	7	5	ADV551												
			TB7-188			11		A1																			
			TB7-189			14	R3-31	A2	SPARE		B15	31	7	5	ADV551												
			TB7-190			11		A1																			
			TB7-191			14	R3-32	A2	SPARE		B16	32	7	5	ADV551												
			TB7-192			11		A1																			
											B17	-	7	5	ADV551												
											B18	+															

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT	53-DO
	CH.	DATE							TITLE	SHT NO
	HARINAH	15/01/09							ME FRACT + OFFSITE	53
FILENAME	APP.	DATE							DOC. NO.	CONT NO
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003	5

GENERAL DESCRIPTION		DR.	DATE					PROJECT NAME		DWG. NO.
Panel Wiring Drawing		DILA	15/01/09					WILMAR SURABAYA BD & ME PROJECT		53-DO
		CH.	DATE					TITLE		SHT NO
		HARINAH	15/01/09					ME FRACT + OFFSITE		53
FILENAME		APP.	DATE					DOC. NO.		CONT NO
ME FRACT + OFFSIT		JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	54

Signal Type :			Cabinet No. : ME FRACT + OFFSITE (MC2)										FCS0202														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>													HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART					
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	MCB3-16										MCB3-12													
				OVDC-16					24VDC-16					24VDC-12					OVDC-12								
				TB						IP-R					Tag No.					Term.	Channel	NODE	SLOT	MODEL			
				TB7-193						14	R2-1	A2						A1	1	7	6	ADV551					
				TB7-194						11		A1															
				TB7-195						14	R2-2	A2						A2	2	7	6	ADV551					
				TB7-196						11		A1															
				TB7-197						14	R2-3	A2						A3	3	7	6	ADV551					
				TB7-198						11		A1															
				TB7-199						14	R2-4	A2						A4	4	7	6	ADV551					
				TB7-200						11		A1															
				TB7-201						14	R2-5	A2						A5	5	7	6	ADV551					
				TB7-202						11		A1															
				TB7-203						14	R2-6	A2						A6	6	7	6	ADV551					
				TB7-204						11		A1															
				TB7-205						14	R2-7	A2						A7	7	7	6	ADV551					
				TB7-206						11		A1															
				TB7-207						14	R2-8	A2						A8	8	7	6	ADV551					
				TB7-208						11		A1															
				TB7-209						14	R2-9	A2						A9	9	7	6	ADV551					
				TB7-210						11		A1															
				TB7-211						14	R2-10	A2						A10	10	7	6	ADV551					
				TB7-212						11		A1															
				TB7-213						14	R2-11	A2						A11	11	7	6	ADV551					
				TB7-214						11		A1															
				TB7-215						14	R2-12	A2						A12	12	7	6	ADV551					
				TB7-216						11		A1															
				TB7-217						14	A13	A2						A13	13	7	6	ADV551					
				TB7-218						11		A1															
				TB7-219						14	R2-14	A2						A14	14	7	6	ADV551					
				TB7-220						11		A1															
				TB7-221						14	R2-15	A2						A15	15	7	6	ADV551					
				TB7-222						11		A1															
				TB7-223						14	R2-16	A2						A16	16	7	6	ADV551					
				TB7-224						11		A1															
																		A17	-	7	6	ADV551					
																		A18	+								

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME		DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT		54-DO
	CH.	DATE							TITLE		SHT NO
	HARINAH	15/01/09							ME FRACT + OFFSITE		54
FILENAME	APP.	DATE							DOC. NO.		CONT NO
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003		55

Signal Type :			Cabinet No :										FCS0202														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	ME FRACT + OFFSITE (MC2)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	MCB3-16					MCB3-12																			
			OVDC-16		24VDC-16			24VDC-12		OVDC-12																	
			TB				IP-R			Tag No.		Term.	Channel	NODE	SLOT	MODEL											
			TB7-225			14	R2-17	A2		B1	17	7	6	ADV551													
			TB7-226			11		A1																			
			TB7-227			14	R2-18	A2		B2	18	7	6	ADV551													
			TB7-228			11		A1																			
			TB7-229			14	R2-19	A2		B3	19	7	6	ADV551													
			TB7-230			11		A1																			
			TB7-231			14	R2-20	A2		B4	20	7	6	ADV551													
			TB7-232			11		A1																			
			TB7-233			14	R2-21	A2		B5	21	7	6	ADV551													
			TB7-234			11		A1																			
			TB7-235			14	R2-22	A2		B6	22	7	6	ADV551													
			TB7-236			11		A1																			
			TB7-237			14	R2-23	A2		B7	23	7	6	ADV551													
			TB7-238			11		A1																			
			TB7-239			14	R2-24	A2		B8	24	7	6	ADV551													
			TB7-240			11		A1																			
			TB7-241			14	R2-25	A2		B9	25	7	6	ADV551													
			TB7-242			11		A1																			
			TB7-243			14	R2-26	A2		B10	26	7	6	ADV551													
			TB7-244			11		A1																			
			TB7-245			14	R2-27	A2		B11	27	7	6	ADV551													
			TB7-246			11		A1																			
			TB7-247			14	R2-28	A2		B12	28	7	6	ADV551													
			TB7-248			11		A1																			
			TB7-249			14	A13	A2		B13	29	7	6	ADV551													
			TB7-250			11		A1																			
			TB7-251			14	R2-30	A2		B14	30	7	6	ADV551													
			TB7-252			11		A1																			
			TB7-253			14	R2-31	A2		B15	31	7	6	ADV551													
			TB7-254			11		A1																			
			TB7-255			14	R2-32	A2		B16	32	7	6	ADV551													
			TB7-256			11		A1																			
											B17	-	7	6	ADV551												
											B18	+															

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME		DWG. NO.
Panel Wiring Drawing	DILA	15/01/09							WILMAR SURABAYA BD & ME PROJECT		55-DO
	CH.	DATE							TITLE		SHT NO
	HARINAH	15/01/09							ME FRACT + OFFSITE		55
FILENAME	APP.	DATE							DOC. NO.		CONT NO
ME FRACT + OFFSITE	JENNY	15/01/09	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSBDME-D32-003		