

FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks											
													Lower	Upper		LL	L	H	HH														
0101	AAI143-S	1-1-1	1	1	1	FT11102	FIR11102	%%FT11102	CRUDE OIL FEED	CRUDE OIL	FEED	AI	NIS	0	23000	Kg/Hr							External power										
0101	AAI143-S	1-1-2	1	1	2	FT11202	FIR11202	%%FT11202	HCL 112F01 TO 112D06	HCL 112F01	TO 112D06	AI	NIS	0.00	20.00	Kg/Hr							External power										
0101	AAI143-S	1-1-3	1	1	3	FT11303	FIR11303	%%FT11303	GLY WTR 113G02 TO TKFRM	GLY WTR 113G	02 TO TKFRM	AI	NIS	0.0	400.0	Kg/Hr							External power										
0101	AAI143-S	1-1-4	1	1	4	FT11403	FIRC11403	%%FT11403	DISTILL REFL TO 114D02	DISTILL REFL	TO 114D02	AI	NIS	0	1500	Kg/Hr							External power										
0101	AAI143-S	1-1-5	1	1	5	FT11404	FIR11404	%%FT11404	DISTILL 1 TO BLEACHER	DISTILL 1 TO	BLEACHER	AI	NIS	0	5500	Kg/Hr							External power										
0101	AAI143-S	1-1-6	1	1	6	FT11405	FIR11405	%%FT11405	DISTILL 2 TO TKFRM	DISTILL 2 TO	TKFRM	AI	NIS	0	3500	Kg/Hr							External power										
0101	AAI143-S	1-1-7	1	1	7	FT11406	FIR11406	%%FT11406	COOL DISTIL FOR 114D02	COOL DISTIL	FOR 114D02	AI	NIS	0	82000	Kg/Hr							External power										
0101	AAI143-S	1-1-8	1	1	8	FT11601	FIRC11601	%%FT11601	FA FEED	FA FEED		AI	NIS	0	23000	Kg/Hr							External power										
0101	AAI143-S	1-1-9	1	1	9	FT11602	FIR11602	%%FT11602	DISTILL DISCHRG TO TKFRM	DISTILL DISC	HRG TO TKFRM	AI	NIS	0	20000	Kg/Hr							External power										
0101	AAI143-S	1-1-10	1	1	10	FT11603	FIRC11603	%%FT11603	SIDE FRAC 1 DISCHRG	SIDE FRAC 1	DISCHRG	AI	NIS	0	7000	Kg/Hr							External power										
0101	AAI143-S	1-1-11	1	1	11	FT11604	FIRC11604	%%FT11604	TOP FRAC 1 DISCHRG	TOP FRAC 1	DISCHRG	AI	NIS	0.0	300.0	Kg/Hr																	
0101	AAI143-S	1-1-12	1	1	12	FT11901	FI11901	%%FT11901	LP STEAM TO PLANT HEADER	LP STEAM TO	PLANT HEADER	AI	NIS																				
0101	AAI143-S	1-1-13	1	1	13	FT11902	FI11902	%%FT11902	LP STEAM TO PLANT HEADER	LP STEAM TO	PLANT HEADER	AI	NIS																				
0101	AAI143-S	1-1-14	1	1	14	FT11903	FI11903	%%FT11903	LP STEAM TO PLANT HEADER	LP STEAM TO	PLANT HEADER	AI	NIS																				
0101	AAI143-S	1-1-15	1	1	15	FT11904	FI11904	%%FT11904	LP STEAM TO PLANT HEADER	LP STEAM TO	PLANT HEADER	AI	NIS																				
0101	AAI143-S	1-1-16	1	1	16	LT11901	LIC11901	%%LT11901	119F02 LVL TRANSMITER	119F02 LVL	TRANSMITER	AI	NIS																				
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks											
													Lower	Upper		LL	L	H	HH														
0101	AAI143-S	1-2-1	1	2	1	FT11101	FI11101	%%FT11101	HI PRESS IN STM 64 BarA	HI PRESS IN	STM 64 BarA	AI	NIS	0	3000	Kg/Hr																	
0101	AAI143-S	1-2-2	1	2	2	FT11103	FIC11103	%%FT11103	GLY WTR FD > FLSH VESS	GLY WTR FD >	FLSH VESS	AI	NIS	0	18000	Kg/Hr																	
0101	AAI143-S	1-2-3	1	2	3	FT11104	FI11104	%%FT11104	PROCESS WTR FEED	PROCESS WTR	FEED	AI	NIS	0	14000	Kg/Hr																	
0101	AAI143-S	1-2-4	1	2	4	FT11105	FI11105	%%FT11105	FA TO TKFRM	FA TO TKFRM		AI	NIS	0	20000	Kg/Hr																	
0101	AAI143-S	1-2-5	1	2	5	LT11101	LIC11101	%%LT11101	111D07 LVL CTRL	111D07 LVL	CTRL	AI	NIS	0.0	100.0	%																	
0101	AAI143-S	1-2-6	1	2	6	LT11102	LIC11102	%%LT11102	111D01 Tx	111D01 Tx		AI	NIS	0.0	100.0	%																	
0101	AAI143-S	1-2-7	1	2	7	LT11103	LIC11103	%%LT11103	111D09 LVL CTRL	111D09 LVL	CTRL	AI	NIS	0.0	100.0	%																	
0101	AAI143-S	1-2-8	1	2	8	LT11104	LIC11104	%%LT11104	111D03 LVL CTRL	111D03 LVL	CTRL	AI	NIS	0.0	100.0	%																	
0101	AAI143-S	1-2-9	1	2	9	LT11105	LIC11105	%%LT11105	111D08 LVL CTRL	111D08 LVL	CTRL	AI	NIS	0.0	100.0	%																	
0101	AAI143-S	1-2-10	1	2	10	LT11106	LIC11106	%%LT11106	111D12 LVL CTRL	111D12 LVL	CTRL	AI	NIS	0.0	100.0	%																	
0101	AAI143-S	1-2-11	1	2	11	LT11107	LIC11107	%%LT11107	111F02 LVL CTRL	111F02 LVL	CTRL	AI	NIS	0.0	100.0	%																	
0101	AAI143-S	1-2-12	1	2	12	PT11101	PI11101	%%PT11101	HI PRESS STM INLET	HI PRESS STM	INLET	AI	NIS	0.00	80.00	BarG																	
0101	AAI143-S	1-2-13	1	2	13	PT11102	PIC11102	%%PT11102	111D01 PRESS CTRL	111D01 PRESS	CTRL	AI	NIS	0.00	80.00	BarG																	
0101	AAI143-S	1-2-14	1	2	14	PT11103	PI11103	%%PT11103	111D03 PRESS Tx	111D03 PRESS	Tx	AI	NIS	-1.000	2.000	BarG																	
0101	AAI143-S	1-2-15	1	2	15	PT11104	PI11104	%%PT11104	VACUUM SET PRESS	VACUUM	SET PRESS	AI	NIS	0.0	400.0	mbarA																	
0101	AAI143-S	1-2-16	1	2	16	TT11101	TIC11101	%%TT11101	111D07 TEMP CTRL	111D07 TEMP	CTRL	AI	NIS	0.0	200.0	°C																	
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks											
													Lower	Upper		LL	L	H	HH														
0101	AAI143-S	1-3-1	1	3	1	TT11102	TI11102	%%TT11102	CRD OIL IN SPLIT COL	CRD OIL IN	SPLIT COL	AI	NIS	0.0	200.0	°C																	
0101	AAI143-S	1-3-2	1	3	2	TT11103	TIC11103	%%TT11103	SPLIT COLUM TOP	SPLIT COLUM	TOP	AI	NIS	0.0	300.0	°C																	
0101	AAI143-S	1-3-3	1	3	3	TT11104	TIC11104	%%TT11104	SPLIT COLUM CENTER	SPLIT COLUM	CENTER	AI	NIS	0.0	300.0	°C																	
0101	AAI143-S	1-3-4	1	3	4	TT11105	TIC11105	%%TT11105	SPLIT COLUM CENTER	SPLIT COLUM	CENTER	AI	NIS	0.0	300.0	°C																	
0101	AAI143-S	1-3-5	1	3	5	TT11106	TIC11106	%%TT11106	SPLIT COLUM BTM	SPLIT COLUM	BTM	AI	NIS	0.0	300.0	°C																	
0101	AAI143-S	1-3-6	1	3	6	TT11107	TI11107	%%TT11107	CRD FA DISCH FRM 111D01	CRD FA DISCH	FRM 111D01	AI	NIS	0.0	300.0	°C																	
0101	AAI143-S	1-3-7	1	3	7	TT11108	TI11108	%%TT11108	SPLIT COLUM PROCESS WTR	SPLIT COLUM	PROCESS WTR	AI	NIS	0.0	200.0	°C																	
0101	AAI143-S	1-3-8	1	3	8	TT11109	TI11109	%%TT11109	GLY WTR. DISCH 111D01	GLY WTR.	DISCH 111D01	AI	NIS	0.0	300.0	°C																	
0101	AAI143-S	1-3-9	1	3	9	TT11110	TIC11110	%%TT11110	DEGASSER 111D09	DEGASSER	111D09	AI	NIS	0.0	200.0	°C																	
0101	AAI143-S	1-3-10	1	3	10	TT11111	TI11111	%%TT11111	FA FLSH VESTO FA DRIER	FA FLSH VES	TO FA DRIER	AI	NIS	0.0	200.0	°C																	
0101	AAI143-S	1-3-11	1	3	11	TT11113	TI11113	%%TT11113	FLASH VAPOUR	FLASH VAPOUR		AI	NIS	0.0	200.0	°C																	
0101	AAI143-S	1-3-12	1	3	12	TT11114	TI11114	%%TT11114	VAPOUR STAGE1 Tx	VAPOUR STAGE	1 Tx																						

FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks
													Lower	Upper		LL	L	H	HH			
0101	AAI143-S	3-1-1	3	1	1	FT11401	FICQ11401	%%FT11401	GLY WTR FD FRM TKFRM	GLY WTR FD	FRM TKFRM	AI	NIS	0.000	8.000	T/Hr						
0101	AAI143-S	3-1-2	3	1	2	FT11402	FIC11402	%%FT11402	MID PRESS STM TO REBOI	MID PRESS	STM TO REBOI	AI	NIS	0	5500	Kg/Hr						
0101	AAI143-S	3-1-3	3	1	3	LT11401	LIC11401	%%LT11401	114F01 LVL CTRL	114F01 LVL	CTRL	AI	NIS	0.0	100.0	%						
0101	AAI143-S	3-1-4	3	1	4	LT11402	LI11402	%%LT11402	114D02 LVL Tx	114D02 LVL	Tx	AI	NIS	0.0	100.0	%						
0101	AAI143-S	3-1-5	3	1	5	PT11401	PI11401	%%PT11401	114D01 PRESS Tx	114D01	PRESS Tx	AI	NIS	0	1000	mbarA						
0101	AAI143-S	3-1-6	3	1	6	PT11402	PIC11402	%%PT11402	MID PRESS STM TO REBOI	MID PRESS	STM TO REBOI	AI	NIS	0.00	25.00	BarG						
0101	AAI143-S	3-1-7	3	1	7	PT11403	PI11403	%%PT11403	114D02 TOP PRESS Tx	114D02 TOP	PRESS Tx	AI	NIS	0.00	50.00	mbarA						
0101	AAI143-S	3-1-8	3	1	8	PT11404	PI11404	%%PT11404	114D02 BTM PRESS Tx	114D02 BTM	PRESS Tx	AI	NIS	0.00	50.00	mbarA						
0101	AAI143-S	3-1-9	3	1	9	PT11405	PI11405	%%PT11405	114D03A PRESS Tx	114D03A	PRESS Tx	AI	NIS	0.00	50.00	mbarA						
0101	AAI143-S	3-1-10	3	1	10	PT11406	PI11406	%%PT11406	114D03B PRESS Tx	114D03B	PRESS Tx	AI	NIS	0.00	50.00	mbarA						
0101	AAI143-S	3-1-11	3	1	11	PT11407	PI11407	%%PT11407	PRE VACUUM Tx	PRE VACUUM	Tx	AI	NIS	0.0	500.0	mbarA						
0101	AAI143-S	3-1-12	3	1	12	TT11401	TI11401	%%TT11401	114D01 TEMP Tx	114D01 TEMP	Tx	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-1-13	3	1	13	TT11402	TI11402	%%TT11402	114F01 TEMP Tx	114F01 TEMP	Tx	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-1-14	3	1	14	TT11403	TIC11403	%%TT11403	DISTILLATE1 DISCH>BLEACH	DISTILLATE1	DISCH>BLEACH	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-1-15	3	1	15	TT11404	TI11404	%%TT11404	114D02 TEMP Tx	114D02 TEMP	Tx	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-1-16	3	1	16	TT11405	TI11405	%%TT11405	114D02 TEMP Tx	114D02 TEMP	Tx	AI	NIS	0.0	200.0	°C						
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks
													Lower	Upper		LL	L	H	HH			
0101	AAI143-S	3-2-1	3	2	1	TT11406	TI11406	%%TT11406	114D02 TEMP Tx	114D02 TEMP	Tx	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-2-2	3	2	2	TT11407	TI11407	%%TT11407	114D02 TEMP Tx	114D02 TEMP	Tx	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-2-3	3	2	3	TT11408	TI11408	%%TT11408	114D02 TEMP Tx	114D02 TEMP	Tx	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-2-4	3	2	4	TT11409	TI11409	%%TT11409	114D03A TEMP Tx	114D03A	TEMP Tx	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-2-5	3	2	5	TT11410	TI11410	%%TT11410	114D03B TEMP Tx	114D03B	TEMP Tx	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-2-6	3	2	6	TT11411	TIC11411	%%TT11411	114D02 TEMP CTRL	114D02 TEMP	CTRL	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-2-7	3	2	7	TT11412	TI11412	%%TT11412	COND. TAIL PIPE Tx	COND. TAIL	PIPE Tx	AI	NIS	0.0	200.0	°C						
0101	AAI143-S	3-2-8	3	2	8	TT11413	TI11413	%%TT11413	CW CIRC. TEMP Tx	CW CIRC.	TEMP Tx	AI	NIS	0.0	100.0	°C						
0101	AAI143-S	3-2-9	3	2	9	TT11414	TIC11414	%%TT11414	TCW TEMP CTRL	TCW TEMP	CTRL	AI	NIS	0.0	100.0	°C						
0101	AAI143-S	3-2-10	3	2	10	LT11501	LIC11501	%%LT11501	115F08 LVL CTRL	115F08 LVL	CTRL	AI	NIS	0.0	100.0	%						
0101	AAI143-S	3-2-11	3	2	11	TT11501	TIC11501	%%TT11501	GLY DISTIL1>TKFRM TEMP	GLY DISTIL1>	TKFRM TEMP	AI	NIS	0.0	100.0	°C						
0101	AAI143-S	3-2-12	3	2	12	VT114G55	VFD114G55	%%VT114G55	PUMP 114G55 VFD	PUMP 114G55	VFD	AI	NIS									
0101	AAI143-S	3-2-13	3	2	13	VT114G02	VFD114G02	%%VT114G02	PUMP 114G02 VFD	PUMP 114G02	VFD	AI	NIS									
0101	AAI143-S	3-2-14	3	2	14	SPARE	SPARE					AI	NIS									
0101	AAI143-S	3-2-15	3	2	15	SPARE	SPARE					AI	NIS									
0101	AAI143-S	3-2-16	3	2	16	SPARE	SPARE					AI	NIS									
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks
													Lower	Upper		LL	L	H	HH			
0101	AAI143-S	4-1-1	4	1	1	FT11605	FI11605	%%FT11605	116D02 FLOWTx	116D02 FLOW	Tx	AI	NIS	0	1100	Kg/Hr						
0101	AAI143-S	4-1-2	4	1	2	FT11606	FIC11606	%%FT11606	DISTILL RCYCFLOW Tx	DISTILL RCYC	FLOW Tx	AI	NIS	0	6300	Kg/Hr						
0101	AAI143-S	4-1-3	4	1	3	FT11607	FI11607	%%FT11607	116D02 TO 116D04 FLOW	116D02 TO	116D04 FLOW	AI	NIS	0	20000	Kg/Hr						
0101	AAI143-S	4-1-4	4	1	4	FT11608	FI11608	%%FT11608	RSDUE DISCH FLOW Tx	RSDUE DISCH	FLOW Tx	AI	NIS	0.0	600.0	Kg/Hr						
0101	AAI143-S	4-1-5	4	1	5	FT11609	FI11609	%%FT11609	H.E DISCHRG FLOW Tx	H.E DISCHRG	FLOW Tx	AI	NIS									

0101	AAI143-S	5-1-1	5	1	1	PT90S001	PI90S001	%%PT90S001	HP STM FRM HP BOILER	HP STM FRM	HP BOILER	AI	NIS				°C													
0101	AAI143-S	5-1-2	5	1	2	PT150CT01	PI150CT01	%%PT150CT01	CWT TO MAIN PLANT	CWT TO MAIN	PLANT	AI	NIS																	
0101	AAI143-S	5-1-3	5	1	3	FT90S001	F190S001	%%FT90S001	70 BARG HP STEAMORIFICE	70 BARG HP	STEAMORIFICE	AI	NIS																	
0101	AAI143-S	5-1-4	5	1	4	FT90S002	F190S002	%%FT90S002	15 BAR STEAMVORTEX	15 BAR STEAM	VORTEX	AI	NIS																	
0101	AAI143-S	5-1-5	5	1	5	FT90S003	F190S003	%%FT90S003	15 BAR STEAMVORTEX	15 BAR STEAM	VORTEX	AI	NIS																	
0101	AAI143-S	5-1-6	5	1	6	FT90S004	F190S004	%%FT90S004	LP STEAM TO PLANTORIFICE	LP STEAM TO	PLANTORIFICE	AI	NIS																	
0101	AAI143-S	5-1-7	5	1	7	FT90S005	F190S005	%%FT90S005	3 BAR STEAM ORIFACE	3 BAR STEAM	ORIFACE	AI	NIS																	
0101	AAI143-S	5-1-8	5	1	8	FT90S006	F190S006	%%FT90S006	LP STEAM TO TANKFARMVORTEX	LP STEAM TO	TANKFARMVORT	AI	NIS																	
0101	AAI143-S	5-1-9	5	1	9	TT150CT01S	TI150CT01S	%%TT150CT01S	CLEAN CW OUTLET TEMP S	CLEAN CW OUT	LET TEMP S	AI	NIS																	
0101	AAI143-S	5-1-10	5	1	10	TT150CT01R	TI150CT01R	%%TT150CT01R	CLEAN CW RTN TEMP	CLEAN CW	RTN TEMP	AI	NIS																	
0101	AAI143-S	5-1-11	5	1	11	FT150CT01	FI150CT01	%%FT150CT01	TO FA PLANT-CITY WATER	TO FA PLANT-	CITY WATER	AI	NIS																	
0101	AAI143-S	5-1-12	5	1	12	LT11D00	LIC11D00	%%LT11D00	11D00 DI DEARATOR	11D00 DI	DEARATOR	AI	NIS																	
0101	AAI143-S	5-1-13	5	1	13	TT11D00	TIC11D00	%%TT11D00	11D00 D'TOR TEMP	11D00 D'TOR	TEMP	AI	NIS																	
0101	AAI143-S	5-1-14	5	1	14	FT90S007	F190S007	%%FT90S007	FLOW STEAM SECTION 112	FLOW STEAM S	ECTION 112	AI	NIS																	
0101	AAI143-S	5-1-15	5	1	15	PT90S009	PT90S009					AI	NIS																	
0101	AAI143-S	5-1-16	5	1	16	FT90S009	FT90S009					AI	NIS																	
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks								
																Lower	Upper	LL	L							H	HH			
0101	AAI143-S	6-1-1	6	1	1	VFD50HWA	VFD50HWA	%%VFD50HWA	PU 50HW A VFD DRIVE	PU 50HW A VF	D DRIVE	AI	NIS	0	15200	mm														
0101	AAI143-S	6-1-2	6	1	2	VFD50HWB	VFD50HWB	%%VFD50HWB	PU 50HW B VFD DRIVE	PU 50HW B VF	D DRIVE	AI	NIS	0.0	150.0	°C														
0101	AAI143-S	6-1-3	6	1	3	LT901101	LI901101	%%LT901101	T901101 HPS LVL Tx	T901101 HPS	LVL Tx	AI	NIS	0	15200	mm														
0101	AAI143-S	6-1-4	6	1	4	LT901102	LI901102	%%LT901102	T901102 RPS LVL Tx	T901102 RPS	LVL Tx	AI	NIS	0	15200	mm														
0101	AAI143-S	6-1-5	6	1	5	LT901103	LI901103	%%LT901103	T901103 CPS FA LVL Tx	T901103 CPS	FA LVL Tx	AI	NIS	0	15200	mm														
0101	AAI143-S	6-1-6	6	1	6	LT901104	LI901104	%%LT901104	T901104 CPS FA LVL Tx	T901104 CPS	FA LVL Tx	AI	NIS	0	15200	mm														
0101	AAI143-S	6-1-7	6	1	7	LT901106	LI901106	%%LT901106	T901106 PRS WTR LVL Tx	T901106 PRS	WTR LVL Tx	AI	NIS	0	15200	mm														
0101	AAI143-S	6-1-8	6	1	8	LT901107	LI901107	%%LT901107	T901107 RAW S.WTR LVL Tx	T901107 RAW	S.WTR LVL Tx	AI	NIS	0	15200	mm														
0101	AAI143-S	6-1-9	6	1	9	TT901101	TI901101	%%TT901101	T901101 HPS TEMP Tx	T901101 HPS	TEMP Tx	AI	NIS	0.0	150.0	°C														
0101	AAI143-S	6-1-10	6	1	10	TT901102	TI901102	%%TT901102	T901102 RPS TEMP Tx	T901102 RPS	TEMP Tx	AI	NIS	0.0	150.0	°C														
0101	AAI143-S	6-1-11	6	1	11	TT901103	TI901103	%%TT901103	T901103 CPS FA TEMP Tx	T901103 CPS	FA TEMP Tx	AI	NIS	0.0	150.0	°C														
0101	AAI143-S	6-1-12	6	1	12	TT901104	TI901104	%%TT901104	T901104 CPS FA TEMP Tx	T901104 CPS	FA TEMP Tx	AI	NIS	0.0	150.0	°C													No lo/hi range	
0101	AAI143-S	6-1-13	6	1	13	VFD91901	VFD91901	%%VFD91901				AI	NIS	0.0	150.0	°C														
0101	AAI143-S	6-1-14	6	1	14	TT901106	TI901106	%%TT901106	T901106 PRS WTR TEMP Tx	T901106 PRS	WTR TEMP Tx	AI	NIS	0.0	150.0	°C														
0101	AAI143-S	6-1-15	6	1	15	TT901107	TI901107	%%TT901107	T901107 RAW S.WTR TMP Tx	T901107 RAW	S.WTR TMP Tx	AI	NIS	0.0	150.0	°C														
0101	AAI143-S	6-1-16	6	1	16	VFD91903	VFD91903	%%VFD91903				AI	NIS																	

FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks	
													Lower	Upper		LL	L	H	HH				
0101	AAI143-S	6-2-1	6	2	1	LT901201	LI901201	%%LT901201	T901201 PRE TR S.WTR LVL	T901201 PRE	TR S.WTR LVL	AI	NIS	0	15200	mm							
0101	AAI143-S	6-2-2	6	2	2	LT901202	LI901202	%%LT901202	T901202 SKIMFAT LVL Tx	T901202 SKIM	FAT LVL Tx	AI	NIS	0	9100	mm							
0101	AAI143-S	6-2-3	6	2	3	TT901201	TI901201	%%TT901201	T901201 PRE TRET SWT WTR	T901201 PRE	TRET SWT WTR	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	6-2-4	6	2	4	TT901202	TI901202	%%TT901202	T901202 SKIMFAT TEMP Tx	T901202 SKIM	FAT TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	6-2-5	6	2	5	VFD91905	VFD91905	%%VFD91905				AI	NIS										
0101	AAI143-S	6-2-6	6	2	6	LT901300	LI901300	%%LT901300	T901300 BD CGLY LVL Tx	T901300 BD	CGLY LVL Tx	AI	NIS	0	?	mm							
0101	AAI143-S	6-2-7	6	2	7	LT901301	LI901301	%%LT901301	T901301 CRUD GLY LVL	T901301	CRUD GLY LVL	AI	NIS	0	15200	mm							
0101	AAI143-S	6-2-8	6	2	8	TT901300	TI901300	%%TT901300	T901300 BLCHCRUD GLY	T901300 BLCH	CRUD GLY	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	6-2-9	6	2	9	TT901301	TI901301	%%TT901301	T901301 CRUDGLY TEMP Tx	T901301 CRUD	GLY TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	6-2-10	6	2	10	SPARE	SPARE					AI	NIS										
0101	AAI143-S	6-2-11	6	2	11	LT901401	LI901401	%%LT901401	T901401 BLCH GLY LVL	T901401	BLCH GLY LVL	AI	NIS	0	15200	mm							
0101	AAI143-S	6-2-12	6	2	12	LT901402	LI901402	%%LT901402	T901402 BLCH GLY LVL	T901402	BLCH GLY LVL	AI	NIS	0	15200	mm							
0101	AAI143-S	6-2-13	6	2	13	TT901401	TI901401	%%TT901401	T901401 BLCHGLY TEMP Tx	T901401 BLCH	GLY TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	6-2-14	6	2	14	TT901402	TI901402	%%TT901402	T901402 BLCHGLY TEMP Tx	T901402 BLCH	GLY TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	6-2-15	6	2	15	SPARE	SPARE					AI	NIS										
0101	AAI143-S	6-2-16	6	2	16	SPARE	SPARE					AI	NIS										
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks	
		Lower											Upper	LL		L	H	HH					
0101	AAI143-S	6-3-1	6	3	1	LT901600	LI901600	%%LT901600	T901600 CPS FA LVL Tx	T901600 CPS	FA LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-2	6	3	2	LT901601	LI901601	%%LT901601	T901601 C16 LVL Tx	T901601 C16	LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-3	6	3	3	LT901602	LI901602	%%LT901602	T901602 C16 LVL Tx	T901602 C16	LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-4	6	3	4	LT901603	LI901603	%%LT901603	T901603 C16 LVL Tx	T901603 C16	LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-5	6	3	5	LT901604	LI901604	%%LT901604	T901604 C18 LVL Tx	T901604 C18	LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-6	6	3	6	LT901605	LI901605	%%LT901605	T901605 C18 LVL Tx	T901605 C18	LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-7	6	3	7	LT901606	LI901606	%%LT901606	T901606 C18 LVL Tx	T901606 C18	LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-8	6	3	8	LT901607	LI901607	%%LT901607	T901607 MIC FA LVL Tx	T901607 MIC	FA LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-9	6	3	9	LT901608	LI901608	%%LT901608	T901608 C6 LVL Tx	T901608 C6	LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-10	6	3	10	LT901609	LI901609	%%LT901609	T901609 H.E LVL Tx	T901609 H.E	LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-11	6	3	11	LT901610	LI901610	%%LT901610	T901610 BLNDTK LVL Tx	T901610 BLND	TK LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-12	6	3	12	LT901611	LI901611	%%LT901611	T901611 PS RSDUE LVL Tx	T901611 PS	RSDUE LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-13	6	3	13	LT901612	LI901612	%%LT901612	T901612 WST FA LVL Tx	T901612 WST	FA LVL Tx	AI	NIS	0	15200	mm							
0101	AAI143-S	6-3-14	6	3	14	VT150CT01A	VFD150CT01A	%%VT150CT01A	VFD FOR FN150CT01A	VFD FOR	FN150CT01A	AI	NIS									Added 21/04/09	
0101	AAI143-S	6-3-15	6	3	15	VT150CT01B	VFD150CT01B	%%VT150CT01B	VFD FOR FN150CT01B	VFD FOR	FN150CT01B	AI	NIS									Added 21/04/10	
0101	AAI143-S	6-3-16	6	3	16	VT150CT01C	VFD150CT01C	%%VT150CT01C	VFD FOR FN150CT01C	VFD FOR	FN150CT01C	AI	NIS									Added 21/04/11	
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks	Comment
		Lower											Upper	LL		L	H	HH					
0101	AAI143-S	7-1-1	7	1	1	TT901600	TI901600	%%TT901600	T901600 CPS FA TEMP Tx	T901600 CPS	FA TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	7-1-2	7	1	2	TT901601	TI901601	%%TT901601	T901601 C16 TEMP Tx	T901601 C16	TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	7-1-3	7	1	3	TT901602	TI901602	%%TT901602	T901602 C16 TEMP Tx	T901602 C16	TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	7-1-4	7	1	4	TT901603	TI901603	%%TT901603	T901603 C16 TEMP Tx	T901603 C16	TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	7-1-5	7	1	5	TT901604	TI901604	%%TT901604	T901604 C18 TEMP Tx	T901604 C18	TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	7-1-6	7	1	6	TT901605	TI901605	%%TT901605	T901605 C18 TEMP Tx	T901605 C18	TEMP Tx	AI	NIS	0.0	150.0	°C							
0101	AAI143-S	7-1-7	7	1	7	TT901606	TI901606	%%TT901606	T901606 C18 TEMP Tx	T901606 C18	TEMP Tx	AI	NIS	0.0	150.0	°C						</	

FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Plant		Remarks	Comment
														Lower	Upper		LL	L	H	HH				
0101	AAI143-S	8-2-1	8	2	1	LT901105	LI901105	%%LT901105	T901105DI WATER	T901105DI	WATER	AI	NIS											
0101	AAI143-S	8-2-2	8	2	2	SPARE	SPARE					AI	NIS											
0101	AAI143-S	8-2-3	8	2	3	SPARE	SPARE					AI	NIS											
0101	AAI143-S	8-2-4	8	2	4	SPARE	SPARE		HOT OIL TEMPSUPPLY	HOT OIL TEMP	SUPPLY	AI	NIS										shift to hydrogenation (NIS)	
0101	AAI143-S	8-2-5	8	2	5	SPARE	SPARE		HOT OIL TEMPRETURN	HOT OIL TEMP	RETURN	AI	NIS											
0101	AAI143-S	8-2-6	8	2	6	SPARE	SPARE		CFTOH THERML OIL TEMP	CFTOH THERML	OIL TEMP	AI	NIS										shift to hydrogenation (NIS)	
0101	AAI143-S	8-2-7	8	2	7	SPARE	SPARE		T50HW THERML OIL TEMP	T50HW THERML	OIL TEMP	AI	NIS											
0101	AAI143-S	8-2-8	8	2	8	SPARE	SPARE		LP STEAM TO PLANT HEADER	LP STEAM TO	PLANT HEADER	AI	NIS											
0101	AAI143-S	8-2-9	8	2	9	SPARE	SPARE		LP STEAM TO PLANT HEADER	LP STEAM TO	PLANT HEADER	AI	NIS											
0101	AAI143-S	8-2-10	8	2	10	SPARE	SPARE		LP STEAM TO PLANT HEADER	LP STEAM TO	PLANT HEADER	AI	NIS											
0101	AAI143-S	8-2-11	8	2	11	SPARE	SPARE		LP STEAM TO PLANT HEADER	LP STEAM TO	PLANT HEADER	AI	NIS											
0101	AAI143-S	8-2-12	8	2	12	LT250HW	LI250HW	%%LT250HW	T250HW HW TK LEVEL	T250HW HW TK	LEVEL	AI	NIS										Added 21/04/09	
0101	AAI143-S	8-2-13	8	2	13	TT250HW	TI250HW	%%TT250HW	T250HW HOT WTR TNK TMP	T250HW HOT	WTR TNK TM	AI	NIS										Added 21/04/09	
0101	AAI143-S	8-2-14	8	2	14	PT11901	PI11901	%%PT11901	3 barg LP STM > PLANT	3 barg LP	STM > PLANT	AI	NIS											
0101	AAI143-S	8-2-15	8	2	15	PT90CA	PI90CA	%%PT90CA	MAIN COMPR AIR	MAIN COMPR A	IR	AI	NIS											
0101	AAI143-S	8-2-16	8	2	16	PT90CAT	PI90CAT	%%PT90CAT	COMPR. AIR SPLY>TKF	COMPR. AIR	SPLY>TKF	AI	NIS											
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Plant		Remarks	Comment
														Lower	Upper		LL	L	H	HH				
0101	AAI143-S	8-3-1	8	3	1	PI90NT	PI90NT	%%PI90NT	N2 EXPORT TKFRM	N2 EXPORT TK	FRM	AI	NIS											
0101	AAI143-S	8-3-2	8	3	2	SPARE	SPARE					AI	NIS											
0101	AAI143-S	8-3-3	8	3	3	SPARE	SPARE					AI	NIS											
0101	AAI143-S	8-3-4	8	3	4	SPARE	SPARE					AI	NIS										Added 21/04/09	
0101	AAI143-S	8-3-5	8	3	5	SPARE	SPARE					AI	NIS											
0101	AAI143-S	8-3-6	8	3	6	SPARE	SPARE					AI	NIS										Added 21/04/09	
0101	AAI143-S	8-3-7	8	3	7	SPARE	SPARE					AI	NIS											
0101	AAI143-S	8-3-8	8	3	8	SPARE	SPARE					AI	NIS										Added 21/04/09	
0101	AAI143-S	8-3-9	8	3	9	SPARE	SPARE					AI	NIS										Added 21/04/09	
0101	AAI143-S	8-3-10	8	3	10	SPARE	SPARE					AI	NIS	0	15000	Kg/Hr								
0101	AAI143-S	8-3-11	8	3	11	SPARE	SPARE					AI	NIS	0										
0101	AAI143-S	8-3-12	8	3	12	SPARE	SPARE					AI	NIS	0.00	40.00	m3/h								
0101	AAI143-S	8-3-13	8	3	13	SPARE	SPARE					AI	NIS	0.00	40.00	m3/h								
0101	AAI143-S	8-3-14	8	3	14	SPARE	SPARE					AI	NIS	0	6000	Kg/Hr								
0101	AAI143-S	8-3-15	8	3	15	SPARE	SPARE					AI	NIS	0	15000	Kg/Hr								
0101	AAI143-S	8-3-16	8	3	16	SPARE	SPARE					AI	NIS	0	4000	Kg/Hr								
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Plant		Remarks	Comment
														Lower	Upper		LL	L	H	HH				
0102	ASI133-S	7-7-1	7	7	1	LT901801	LI901801	%%LT901801	T901801 HY FEED LVL Tx	T901801 HY	FEED LVL Tx	AI	IS	0	15200	mm								
0102	ASI133-S	7-7-2	7	7	2	LT901802	LI901802	%%LT901802	T901802 HY FA LVL Tx	T901802 HY	FA LVL Tx	AI	IS	0	15200	mm								
0102	ASI133-S	7-7-3	7	7	3	LT901803	LI901803	%%LT901803	T901803 HY FA LVL Tx	T901803 HY	FA LVL Tx	AI	IS	0	15200	mm								
0102	ASI133-S	7-7-4	7	7	4	LT901804	LI901804	%%LT901804	T901804 HY FD LVL Tx	T901804 HY	FD LVL Tx	AI	IS	0	15200	mm								
0102	ASI133-S	7-7-5	7	7	5	LT901805	LI901805	%%LT901805	T901805 HY FA LVL Tx	T901805 HY	FA LVL Tx	AI	IS	0	15200	mm								
0102	ASI133-S	7-7-6	7	7	6	LT901806	LI901806	%%LT901806	T901806 HY FA LVL Tx	T901806 HY	FA LVL Tx	AI	IS	0	15200	mm								
0101	AAI143-S	7-7-7	7	7	7	SPARE						AI	NIS	0.00	40.00	m3/h							shift from NIS (8-3-6) to IS	
0102	ASI133-S	7-7-8	7	7	8	SPARE						AI	IS	0.00	20.00	BarG							shift to hydrogenation (NIS) shift to hydrogenation (NIS)	
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Plant		Remarks	Comment
														Lower	Upper		LL	L	H	HH				
0102	ASI133-S	7-8-1	7	8	1	TT901801	TI901801	%%TT901801	T901801 HY FD TEMP Tx	T901801 HY	FEED LVL Tx	AI	IS	0.0	150.0	°C								
0102	ASI133-S	7-8-2	7	8	2	TT901802	TI901802	%%TT901802	T901802 HY FA TEMP Tx	T901802 HY	FA LVL Tx	AI	IS	0.0	150.0	°C								
0102	ASI133-S	7-8-3	7	8	3	TT901803	TI901803	%%TT901803	T901803 HY FA TEMP Tx	T901803 HY	FA LVL Tx	AI	IS	0.0	150.0	°C								
0102	ASI133-S	7-8-4	7	8	4	TT901804	TI901804	%%TT901804	T901804 HY FD TEMP Tx	T901804 HY	FD LVL Tx	AI	IS	0.0	150.0	°C								
0102	ASI133-S	7-8-5	7	8	5	TT901805	TI901805	%%TT901805	T901805 HY FA TEMP Tx	T901805 HY	FA LVL Tx	AI	IS	0.0	150.0	°C								
0102	ASI133-S	7-8-6	7	8	6	TT901806	TI901806	%%TT901806	T901806 HY FA TEMP Tx	T901806 HY	FA LVL Tx	AI	IS	0.0	150.0	°C								
0101	AAI143-S	8-8-7	8	8	7	SPARE			CLEAN CW OUTLET TEMP	CLEAN CW	OUTLET TEMP	AI	NIS	0	6000	Kg/Hr							shift from NIS (8-3-13) to IS	
0101	AAI143-S	8-8-8	8	8	8	SPARE			CLEAN CW RTN TEMP	CLEAN CW RTN	TEMP	AI	NIS	0	4000	Kg/Hr							shift from NIS (8-3-14) to IS	
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Plant		Remarks	Comment
														Lower	Upper		LL	L	H	HH				
0101	AAI143-S	9-1-1	9	1	1	FT21401	FIC21401	%%FT21401				AI	NIS								GLY			
0101	AAI143-S	9-1-2	9	1	2	FT21402	FIC21402	%%FT21402				AI	NIS								GLY			
0101	AAI143-S	9-1-3	9	1	3	FT21401A	FR21401	%%FT21401A				AI	NIS											

0101	AAI143-S	9-2-15	9	2	15	TT21481	TR21481	%TT21481				AI	NIS							GLY			
0101	AAI143-S	9-2-16	9	2	16	TT21482	TR21482	%TT21482				AI	NIS							GLY			
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type	Range		Eng Units	Alarm & Trip Setting				Plant		Remarks	Comment
			Lower	Upper	LL								L	H		HH							
0101	AAI143-S	9-3-1	9	3	1	TT21483	TR21483	%TT21483				AI	NIS							GLY			
0101	AAI143-S	9-3-2	9	3	2	TT250CT01R	TI250CT01R	%TT250CT01				AI	NIS							GLY			
0101	AAI143-S	9-3-3	9	3	3	FT250CT01	FI250CT01	%FT250CT01				AI	NIS							GLY			
0101	AAI143-S	9-3-4	9	3	4	TT250CT01S	TI250CT01S	%TT250CT01				AI	NIS							GLY			
0101	AAI143-S	9-3-5	9	3	5	FT21410	FIC21410	%FT21410				AI	NIS							GLY			
0101	AAI143-S	9-3-6	9	3	6	VI214SC10	VFD214SC10	%VI214SC10				AI	NIS							GLY			
0101	AAI143-S	9-3-7	9	3	7	VI214G10	VFD214G10	%VI214G10				AI	NIS							GLY			
0101	AAI143-S	9-3-8	9	3	8	AMP115D07	AMP115D07	%AMP115D07				AI	NIS							GLY			
0101	AAI143-S	9-3-9	9	3	9	AMP115D08	AMP115D08	%AMP115D08				AI	NIS							GLY			
0101	AAI143-S	9-3-10	9	3	10	VI214G06	VFD214G06	%VI214G06				AI	NIS							GLY			
0101	AAI143-S	9-3-11	9	3	11	VI214G07	VFD214G07	%VI214G07				AI	NIS							GLY			
0101	AAI143-S	9-3-12	9	3	12	VIFN250CT01A	VFD214G07	%VIFN250CT				AI	NIS							GLY			
0101	AAI143-S	9-3-13	9	3	13	VIFN250CT01B	VFD214G07	%VIFN250CT0				AI	NIS							GLY			
0101	AAI143-S	9-3-14	9	3	14	VIPU250CCW01	VFD214G07	%VIPU250CCW				AI	NIS							GLY			
0101	AAI143-S	9-3-15	9	3	15	VIPU250CCW02	VFD214G07	%VIPU250CCW				AI	NIS							GLY			
0101	AAI143-S	9-3-16	9	3	16	VIPU250CCW03	VFD214G07	%VIPU250CCW				AI	NIS							GLY			

TANKFARM & UTILITY SPARE (NIS)=8

TANKFARM & UTILITY SPARE (IS)=3

** NOTE : PLS DO NOT CONFUSE, WE CHANGE 150CT02 TO 150CT03

FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
														Lower	Upper		LL	L	H	HH	
0101	AAI543-S	2-3-1	2	3	1	FV11103	FIC11103	%%FV11103				AO	NIS								
0101	AAI543-S	2-3-2	2	3	2	LV11101	LIC11101	%%LV11101				AO	NIS								
0101	AAI543-S	2-3-3	2	3	3	LV11103	LIC11103	%%LV11103				AO	NIS								
0101	AAI543-S	2-3-4	2	3	4	LV11104	LIC11104	%%LV11104				AO	NIS								
0101	AAI543-S	2-3-5	2	3	5	LV11105	LIC11105	%%LV11105				AO	NIS								
0101	AAI543-S	2-3-6	2	3	6	LV11106	LIC11106	%%LV11106				AO	NIS								
0101	AAI543-S	2-3-7	2	3	7	LV11107	LIC11107	%%LV11107				AO	NIS								
0101	AAI543-S	2-3-8	2	3	8	PV11102	PIC11102	%%PV11102				AO	NIS								
0101	AAI543-S	2-3-9	2	3	9	TV11101	TIC11101	%%TV11101				AO	NIS								
0101	AAI543-S	2-3-10	2	3	10	TV11106	TIC11106	%%TV11106				AO	NIS								
0101	AAI543-S	2-3-11	2	3	11	TV11105	TIC11105	%%TV11105				AO	NIS								
0101	AAI543-S	2-3-12	2	3	12	TV11104	TIC11104	%%TV11104				AO	NIS								
0101	AAI543-S	2-3-13	2	3	13	TV11103	TIC11103	%%TV11103				AO	NIS								
0101	AAI543-S	2-3-14	2	3	14	TV11110	TIC11110	%%TV11110				AO	NIS								
0101	AAI543-S	2-3-15	2	3	15	LV11D00	LIC11D00	%%LV11D00				AO	NIS								
0101	AAI543-S	2-3-16	2	3	16	TV11D00	TIC11D00	%%TV11D00				AO	NIS								
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
														Lower	Upper		LL	L	H	HH	
0101	AAI543-S	2-4-1	2	4	1	VFD111G01	VFD111G01	%%VFD111G01	FREQ. INVER TO 111G01	FREQ. INVER	TO 111G01	AO	NIS								
0101	AAI543-S	2-4-2	2	4	2	VFD111G02	VFD111G02	%%VFD111G02	FREQ. INVER TO 111G02	FREQ. INVER	TO 111G02	AO	NIS								
0101	AAI543-S	2-4-3	2	4	3	VFD111G03	VFD111G03	%%VFD111G03	FREQ. INVER TO 111G03	FREQ. INVER	TO 111G03	AO	NIS								
0101	AAI543-S	2-4-4	2	4	4	LIC11901	LIC11901	%%LIC11901	119F02 LVL CONTROL	119F02 LVL	CONTROL	AO	NIS								
0101	AAI543-S	2-4-5	2	4	5	VFD114G02	VFD114G02	%%VFD114G02	PUMP 114G02 VFD	PUMP 114G02	VFD	AO	NIS								
0101	AAI543-S	2-4-6	2	4	6	VFD114G55	VFD114G55	%%VFD114G55	PUMP 114G55 VFD	PUMP 114G55	VFD	AO	NIS								
0101	AAI543-S	2-4-7	2	4	7	SPARE	SPARE					AO	NIS								
0101	AAI543-S	2-4-8	2	4	8	SPARE	SPARE					AO	NIS								
0101	AAI543-S	2-4-9	2	4	9	SPARE	SPARE					AO	NIS								
0101	AAI543-S	2-4-10	2	4	10	SPARE	SPARE					AO	NIS								
0101	AAI543-S	2-4-11	2	4	11	SPARE	SPARE					AO	NIS								
0101	AAI543-S	2-4-12	2	4	12	SPARE	SPARE					AO	NIS								
0101	AAI543-S	2-4-13	2	4	13	SPARE	SPARE					AO	NIS								
0101	AAI543-S	2-4-14	2	4	14	SPARE	SPARE					AO	NIS								
0101	AAI543-S	2-4-15	2	4	15	SPARE	SPARE					AO	NIS								
0101	AAI543-S	2-4-16	2	4	16	SPARE	SPARE					AO	NIS								
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
														Lower	Upper		LL	L	H	HH	
0101	AAI543-S	3-3-1	3	3	1	LV11203	LIC11203	%%LV11203	112F03 LVL CTRL	112F03 LVL	CTRL	AO	NIS								
0101	AAI543-S	3-3-2	3	3	2	TV11201	TIC11201	%%TV11201	112E01 TO 112D06 TEMP	112E01 TO	112D06 TEMP	AO	NIS								
0101	AAI543-S	3-3-3	3	3	3	FV11302	FIC11302	%%FV11302	TKFRM GLY WTR > 113E01	TKFRM GLY	WTR > 113E01	AO	NIS								
0101	AAI543-S	3-3-4	3	3	4	LV11301	LIC11301	%%LV11301	113F02 LVL CTRL	113F02 LVL	CTRL	AO	NIS								
0101	AAI543-S	3-3-5	3	3	5	LV11302	LIC11302	%%LV11302	113F01 LVL CTRL	113F01 LVL	CTRL	AO	NIS								
0101	AAI543-S	3-3-6	3	3	6	PV11301	PIC11301	%%PV11301	STM PRESS. CTRL	STM PRESS.	CTRL	AO	NIS								
0101	AAI543-S	3-3-7	3	3	7	FV11401	FICQ11401	%%FV11401	GLY WTR FD FRM TKFRM	GLY WTR FD	FRM TKFRM	AO	NIS								
0101	AAI543-S	3-3-8	3	3	8	FV11403	FIC11403	%%FV11403	DISTILL REFL TO 114D02	DISTILL REFL	TO 114D02	AO	NIS								
0101	AAI543-S	3-3-9	3	3	9	LV11401	LIC11401	%%LV11401	114F01 LVL CTRL	114F01 LVL	CTRL	AO	NIS								
0101	AAI543-S	3-3-10	3	3	10	PV11402	PIC11402	%%PV11402	MID PRESS STM TO REBOI	MID PRESS	STM TO REBOI	AO	NIS								
0101	AAI543-S	3-3-11	3	3	11	TV11403	TIC11403	%%TV11403	DISTILLATE1 DISCH>BLEACH	DISTILLATE1	DISCH>BLEACH	AO	NIS								
0101	AAI543-S	3-3-12	3	3	12	TV11411	TIC11411	%%TV11411	114D02 TEMP CTRL	114D02 TEMP	CTRL	AO	NIS								
0101	AAI543-S	3-3-13	3	3	13	TV11414	TIC11414	%%TV11414	TCW TEMP CTRL	TCW TEMP	CTRL	AO	NIS								
0101	AAI543-S	3-3-14	3	3	14	LV11501	LIC11501	%%LV11501	115F08 LVL CTRL	115F08 LVL	CTRL	AO	NIS								
0101	AAI543-S	3-3-15	3	3	15	TV11501	TIC11501	%%TV11501	GLY DISTIL1>TKFRM TEMP	GLY DISTIL1>	TKFRM TEMP	AO	NIS								
0101	AAI543-S	3-3-16	3	3	16	SPARE	SPARE					AO	NIS								
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
														Lower	Upper		LL	L	H	HH	
0101	AAI543-S	3-4-1	3	4	1	FV11601	FIC11601	%%FV11601	FA FEED	FA FEED		AO	NIS								
0101	AAI543-S	3-4-2	3	4	2	FV11603	FIC11603	%%FV11603	SIDE FRAC 1 DISCHRG	SIDE FRAC 1	DISCHRG	AO	NIS								
0101	AAI543-S	3-4-3	3	4	3	FV11604	FIC11604	%%FV11604	TOP FRAC 1 DISCHRG	TOP FRAC 1	DISCHRG	AO	NIS								
0101	AAI543-S	3-4-4	3	4	4	FV11															

FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
														Lower	Upper		LL	L	H	HH	
0101	AAI543-S	5-2-1	5	2	1	SPARE						AO	NIS								
0101	AAI543-S	5-2-2	5	2	2	SPARE						AO	NIS								
0101	AAI543-S	5-2-3	5	2	3	SPARE						AO	NIS								
0101	AAI543-S	5-2-4	5	2	4	SPARE						AO	NIS								
0101	AAI543-S	5-2-5	5	2	5	SPARE						AO	NIS								
0101	AAI543-S	5-2-6	5	2	6	SPARE						AO	NIS								
0101	AAI543-S	5-2-7	5	2	7	SPARE						AO	NIS								
0101	AAI543-S	5-2-8	5	2	8	SPARE						AO	NIS								
0101	AAI543-S	5-2-9	5	2	9	SPARE						AO	NIS								
0101	AAI543-S	5-2-10	5	2	10	SPARE						AO	NIS								
0101	AAI543-S	5-2-11	5	2	11	SPARE						AO	NIS								
0101	AAI543-S	5-2-12	5	2	12	SPARE						AO	NIS								
0101	AAI543-S	5-2-13	5	2	13	SPARE						AO	NIS								
0101	AAI543-S	5-2-14	5	2	14	SPARE						AO	NIS								
0101	AAI543-S	5-2-15	5	2	15	SPARE						AO	NIS								
0101	AAI543-S	5-2-16	5	2	16	SPARE						AO	NIS								
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
														Lower	Upper		LL	L	H	HH	
0101	AAI543-S	7-3-1	7	3	1	VV150HWA	VFD50HWA	%%VV150HWA	VFD FOR PU 50HW A	VFD FOR PU 5	0HW A	AO	NIS								
0101	AAI543-S	7-3-2	7	3	2	VV150HWB	VFD50HWB	%%VV150HWB	VFD FOR PU 50HW B	VFD FOR PU 5	0HW B	AO	NIS								
0101	AAI543-S	7-3-3	7	3	3	VV91901	VFD91901	%%VV91901	VFD FOR P91901	VFD FOR P919	01	AO	NIS								
0101	AAI543-S	7-3-4	7	3	4	VV150CT01A	VFD150CT01A	%%VV150CT01A	VFD FOR FN150CT01A	VFD FOR	FN150CT01A	AO	NIS								
0101	AAI543-S	7-3-5	7	3	5	VV150CT01B	VFD150CT01B	%%VV150CT01B	VFD FOR FN150CT01B	VFD FOR	FN150CT01B	AO	NIS								
0101	AAI543-S	7-3-6	7	3	6	VV150CT01C	VFD150CT01C	%%VV150CT01C	VFD FOR FN150CT01C	VFD FOR	FN150CT01C	AO	NIS								
0101	AAI543-S	7-3-7	7	3	7	VV150CT01D	VFD150CT01D	%%VV150CT01D	VFD FOR FN150CT01D	VFD FOR	FN150CT01D	AO	NIS								
0101	AAI543-S	7-3-8	7	3	8	VV150CCW1	VFD150CCW1	%%VV150CCW1	VFD FOR PU150CCW1	VFD FOR	PU150CCW1	AO	NIS								
0101	AAI543-S	7-3-9	7	3	9	VV150CCW2	VFD150CCW2	%%VV150CCW2	VFD FOR PU150CCW2	VFD FOR	PU150CCW2	AO	NIS								
0101	AAI543-S	7-3-10	7	3	10	VV150CCW3	VFD150CCW3	%%VV150CCW3	VFD FOR PU150CCW3	VFD FOR	PU150CCW3	AO	NIS								
0101	AAI543-S	7-3-11	7	3	11	VV150CCW4	VFD150CCW4	%%VV150CCW4	VFD FOR PU150CCW4	VFD FOR	PU150CCW4	AO	NIS								
0101	AAI543-S	7-3-12	7	3	12	VV91903	VFD91903	%%VV91903	VFD FOR P91903	VFD FOR P919	03	AO	NIS								
0101	AAI543-S	7-3-13	7	3	13	VV91905	VFD91905	%%VV91905	VFD FOR P91905	VFD FOR P919	05	AO	NIS								
0101	AAI543-S	7-3-14	7	3	14	RUSAK	RUSAK					AO	NIS								
0101	AAI543-S	7-3-15	7	3	15	RUSAK	RUSAK					AO	NIS								
0101	AAI543-S	7-3-16	7	3	16	RUSAK	RUSAK					AO	NIS								
FCU	Module					Source Tag	DCS Tag	IO Assigned Tag	Service Description			IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
														Lower	Upper		LL	L	H	HH	
0101	AAI543-S	9-4-1	9	4	1	FCV21401	FIC21401	%%FCV21401				AO	NIS								
0101	AAI543-S	9-4-2	9	4	2	FCV21402	FIC21402	%%FCV21402				AO	NIS								
0101	AAI543-S	9-4-3	9	4	3	LCV21401	LIC21401	%%LCV21401				AO	NIS								
0101	AAI543-S	9-4-4	9	4	4	LCV21403	LIC21403	%%LCV21403				AO	NIS								
0101	AAI543-S	9-4-5	9	4	5	LCV21504	LIC21504	%%LCV21504				AO	NIS								
0101	AAI543-S	9-4-6	9	4	6	PCV21401	PIC21401	%%PCV21401				AO	NIS								
0101	AAI543-S	9-4-7	9	4	7	TCV21401	TIC21401	%%TCV21401				AO	NIS								
0101	AAI543-S	9-4-8	9	4	8	TCV21402	TIC21402	%%TCV21402				AO	NIS								
0101	AAI543-S	9-4-9	9	4	9	TCV21403	TIC21403	%%TCV21403				AO	NIS								
0101	AAI543-S	9-4-10	9	4	10	TCV21404	TIC21404	%%TCV21404				AO	NIS								
0101	AAI543-S	9-4-11	9	4	11	TCV21414	TIC21414	%%TCV21414				AO	NIS								
0101	AAI543-S	9-4-12	9	4	12	TCV21505	TIC21505	%%TCV21505				AO	NIS								
0101	AAI543-S	9-4-13	9	4	13	PCV21403	PCV21403	%%PCV21403				AO	NIS								
0101	AAI543-S	9-4-14	9	4	14	VV214G08	VFD214G08	%%VV214G08				AO	NIS								
0101	AAI543-S	9-4-15	9	4	15	VV214G06	VFD214G06	%%VV214G06				AO	NIS								
0101	AAI543-S	9-4-16	9	4	16	VV214G07	VFD214G07	%%VV214G07				AO	NIS								

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks
															Lower	Upper		LL	L	H	HH		
		0101	ADV151-P	2-5-1	2	5	1	LAH11101S	LAH11101	111D07 LVL SW HI	111D07 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-2	2	5	2	LAH11102S	LAH11102	111D09 LVL SW HI	111D09 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-3	2	5	3	LAH11103S	LAH11103	111D02 LVL SW HI	111D02 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-4	2	5	4	LAH11104S	LAH11104	111D03 LVL SW HI	111D03 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-5	2	5	5	LAH11105S	LAH11105	111D08 LVL SW HI	111D08 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-6	2	5	6	LAH11201S	LAH11201	112D02 LVL SW HI	112D02 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-7	2	5	7	LAH11202S	LAH11202	112D03 LVL SW HI	112D03 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-8	2	5	8	PAH11207S	PAH11207	112P14-50-16H10 PRESS HI	112P14-50-16	H10 PRESS HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-9	2	5	9	LAH11401S	LAH11401	114D01 LVL SW HI	114D01 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-10	2	5	10	LAH11402S	LAH11402	114F01 LVL SW HI	114F01 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-11	2	5	11	LSAH11403S	LAH11403	114F02 LVL SW HI	114F02 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-12	2	5	12	LSAL11404S	LAL11404	114F02 LVL SW LO	114F02 LVL	SW LO	DI	NIS								HYD	
		0101	ADV151-P	2-5-13	2	5	13	LAL11405S	LAL11405	114F03 LVL SW LO	114F03 LVL	SW LO	DI	NIS								HYD	
		0101	ADV151-P	2-5-14	2	5	14	LAH11501S	LAH11501	115D10 LVL SW HI	115D10 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-15	2	5	15	PAH11509S	PAH11509	115P05-50-16H10 PRESS HI	115P05-50-16	H10 PRESS HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-16	2	5	16	LSAH11601S	LAH11601	116D01 LVL SW HI	116D01 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-17	2	5	17	LAL11602S	LAL11602	SPP1647 LVL SW LO	SPP1647 LVL	SW LO	DI	NIS								HYD	
		0101	ADV151-P	2-5-18	2	5	18	LAH11603S	LAH11603	116F01 LVL SW HI	116F01 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-19	2	5	19	LAH11604S	LAH11604	116F03 LVL SW HI	116F03 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-20	2	5	20	LAH11605S	LAH11605	116F02 LVL SW HI	116F02 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-21	2	5	21	LAH11606S	LAH11606	116F04 LVL SW HI	116F04 LVL	SW HI	DI	NIS								HYD	
		0101	ADV151-P	2-5-22	2	5	22	LAL11607S	LAL11607	116F05 LVL SW LO	116F05 LVL	SW LO	DI	NIS								HYD	
		0101	ADV151-P	2-5-23	2	5	23	FCS0101PSU1S	FC0101PU1	FCS0101 PSU 1 FAIL	FCS0101	PSU 1 FAIL	DI	NIS									
		0101	ADV151-P	2-5-24	2	5	24	FCS0101PSU2S	FC0101PU2	FCS0101 PSU 2 FAIL	FCS0101	PSU 2 FAIL	DI	NIS									
		0101	ADV151-P	2-5-25	2	5	25	LS50WW2S	L50WW2	WW MAIN PLANT SUMP	WW MAIN	PLANT SUMP	DI	NIS									
		0101	ADV151-P	2-5-26	2	5	26	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	2-5-27	2	5	27	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	2-5-28	2	5	28	SV150CT01OI	SV150CT01				DI	NIS									
		0101	ADV151-P	2-5-29	2	5	29	SV150CT01CI	SV150CT01				DI	NIS									
		0101	ADV151-P	2-5-30	2	5	30	LAH11901S	LAH11901				DI	NIS									
		0101	ADV151-P	2-5-31	2	5	31	LSAL11902S	LAL11902				DI	NIS									
		0101	ADV151-P	2-5-32	2	5	32	SPARE	SPARE				DI	NIS									
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks
															Lower	Upper		LL	L	H	HH		
		0101	ADV151-P	2-6-1	2	6	1	NV11101OI	NV11101	HP STM INLET VLV	HP STM INLET	VLV	DI	NIS								HYD	
		0101	ADV151-P	2-6-2	2	6	2	NV11101CI	NV11101	HP STM INLET VLV	HP STM INLET	VLV	DI	NIS								HYD	
		0101	ADV151-P	2-6-3	2	6	3	NV11102OI	NV11102	HP STM OUTLET VLV	HP STM	OUTLET VLV	DI	NIS								HYD	
		0101	ADV151-P	2-6-4	2	6	4	NV11102CI	NV11102	HP STM OUTLET VLV	HP STM	OUTLET VLV	DI	NIS								HYD	
		0101	ADV151-P	2-6-5	2	6	5	KV11401OI	KV11401	RE'DUE DISCH TO 114D03A	RE'DUE DISCH	TO 114D03A	DI	NIS								HYD	
		0101	ADV151-P	2-6-6	2	6	6	KV11401CI	KV11401	RE'DUE DISCH TO 114D03A	RE'DUE DISCH	TO 114D03A	DI	NIS								HYD	
		0101	ADV151-P	2-6-7	2	6	7	KV11402OI	KV11402	DISTILL 2 DISCHRG	DISTILL 2	DISCHRG	DI	NIS								HYD	
		0101	ADV151-P	2-6-8	2	6	8	KV11402CI	KV11402	DISTILL 2 DISCHRG	DISTILL 2	DISCHRG	DI	NIS								HYD	
		0101	ADV151-P	2-6-9	2	6	9	KV11601OI	KV11601	CONDUCT. BLODWN ACT	CONDUCT.	BLODWN ACT	DI	NIS								HYD	
		0101	ADV151-P	2-6-10	2	6	10	KV11601CI	KV11601	CONDUCT. BLODWN ACT	CONDUCT.	BLODWN ACT	DI	NIS								HYD	
		0101	ADV151-P	2-6-11	2	6	11	KV11602OI	KV11602	CONDUCT. BLODWN ACT	CONDUCT.	BLODWN ACT	DI	NIS								HYD	
		0101	ADV151-P	2-6-12	2	6	12	KV11602CI	KV11602	CONDUCT. BLODWN ACT	CONDUCT.	BLODWN ACT	DI	NIS									
		0101	ADV151-P	2-6-13	2	6	13	LAL15001LS	LAL15001LS	EXPANTION TANK	EXPANTION	TANK	DI	NIS									
		0101	ADV151-P	2-6-14	2	6	14	LSLA116F07S	LSLA116F07	116F07 LVL SW LO	116F07 LVL	SW LO	DI	NIS									
		0101	ADV151-P	2-6-15	2	6	15	LSHA116F07S	LSHA116F07	116F07 LVL SW HI	116F07 LVL	SW HI	DI	NIS									
		0101	ADV151-P	2-6-16	2	6	16	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	2-6-17	2	6	17	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	2-6-18	2	6	18	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	2-6-19	2	6	19	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	2-6-20	2	6	20	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	2-6-21	2	6	21	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	2-6-22	2	6	22	116G1															

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks
															Lower	Upper		LL	L	H	HH		
		0101	ADV151-P	3-5-1	3	5	1	111G01STI	111G01	CRUDE OIL HP PUMP	CRUDE OIL HP	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-2	3	5	2	111G01TRI	111G01	CRUDE OIL HP PUMP	CRUDE OIL HP	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-3	3	5	3	111G02STI	111G02	PROCESS WTR HP PUMP	PROCESS WTR	HP PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-4	3	5	4	111G02TRI	111G02	PROCESS WTR HP PUMP	PROCESS WTR	HP PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-5	3	5	5	111G03STI	111G03	CRUDE OIL HP PUMP-STDBY	CRUDE OIL HP	PUMP-STDBY	DI	NIS								HYD	
		0101	ADV151-P	3-5-6	3	5	6	111G03TRI	111G03	CRUDE OIL HP PUMP-STDBY	CRUDE OIL HP	PUMP-STDBY	DI	NIS								HYD	
		0101	ADV151-P	3-5-7	3	5	7	111G04STI	111G04	CRUDE OIL CIRC. PUMP	CRUDE OIL	CIRC. PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-8	3	5	8	111G04TRI	111G04	CRUDE OIL CIRC. PUMP	CRUDE OIL	CIRC. PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-9	3	5	9	111G05STI	111G05	FA PUMP	FA PUMP		DI	NIS								HYD	
		0101	ADV151-P	3-5-10	3	5	10	111G05TRI	111G05	FA PUMP	FA PUMP		DI	NIS								HYD	
		0101	ADV151-P	3-5-11	3	5	11	111G07STI	111G07	FA PUMP	FA PUMP		DI	NIS								HYD	
		0101	ADV151-P	3-5-12	3	5	12	111G07TRI	111G07	FA PUMP	FA PUMP		DI	NIS								HYD	
		0101	ADV151-P	3-5-13	3	5	13	111G08STI	111G08	GLY. WTR PUMP	GLY. WTR	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-14	3	5	14	111G08TRI	111G08	GLY. WTR PUMP	GLY. WTR	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-15	3	5	15	111G09STI	111G09	INLINE BOOSTER PUMP	INLINE	BOOSTER PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-16	3	5	16	111G09TRI	111G09	INLINE BOOSTER PUMP	INLINE	BOOSTER PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-17	3	5	17	111G55STI	111G55	WTR. CIRC. PUMP	WTR. CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-18	3	5	18	111G55TRI	111G55	WTR. CIRC. PUMP	WTR. CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-19	3	5	19	112G01STI	112G01	HCL DOSING PUMP	HCL DOSING	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-20	3	5	20	112G01TRI	112G01	HCL DOSING PUMP	DISCHARGE	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-21	3	5	21	112G02STI	112G02	DISCHARGE PUMP	DISCHARGE	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-22	3	5	22	112G02TRI	112G02	DISCHARGE PUMP	DISCHARGE	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-23	3	5	23	112G03STI	112G03	FILTER PUMP	FILTER PUMP		DI	NIS								HYD	
		0101	ADV151-P	3-5-24	3	5	24	112G03TRI	112G03	FILTER PUMP	FILTER PUMP		DI	NIS								HYD	
		0101	ADV151-P	3-5-25	3	5	25	112G06ASTI	112G06A	SCREW CONVY A	SCREW CONVY	A	DI	NIS								HYD	
		0101	ADV151-P	3-5-26	3	5	26	112G06ATRI	112G06A	SCREW CONVY A	SCREW CONVY	A	DI	NIS								HYD	
		0101	ADV151-P	3-5-27	3	5	27	112G06BSTI	112G06B	SCREW CONVY A	SCREW CONVY	A	DI	NIS								HYD	
		0101	ADV151-P	3-5-28	3	5	28	112G06BTRI	112G06B	SCREW CONVY A	SCREW CONVY	A	DI	NIS								HYD	
		0101	ADV151-P	3-5-29	3	5	29	112G08STI	112G08	CIRCULATION PUMP	CIRCULATION	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-30	3	5	30	112G08TRI	112G08	CIRCULATION PUMP	CIRCULATION	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-5-31	3	5	31	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	3-5-32	3	5	32	SPARE	SPARE				DI	NIS									
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks
															Lower	Upper		LL	L	H	HH		
		0101	ADV151-P	3-6-1	3	6	1	113G02STI	113G02	GLY. WTR PUMP	GLY. WTR	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-2	3	6	2	113G02TRI	113G02	GLY. WTR PUMP	GLY. WTR	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-3	3	6	3	113G03STI	113G03	CONDENDSTE PUMP	CONDENDSTE	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-4	3	6	4	113G03TRI	113G03	CONDENDSTE PUMP	CONDENDSTE	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-5	3	6	5	113G55STI	113G55	WTR. CIRC. PUMP	WTR. CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-6	3	6	6	113G55TRI	113G55	WTR. CIRC. PUMP	WTR. CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-7	3	6	7	SPARE	SPARE				DI	NIS								HYD	
		0101	ADV151-P	3-6-8	3	6	8	SPARE	SPARE				DI	NIS								HYD	
		0101	ADV151-P	3-6-9	3	6	9	114G55STI	114G55	CIRCULATION PUMP	CIRCULATION	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-10	3	6	10	114G55TRI	114G55	CIRCULATION PUMP			DI	NIS								HYD	
		0101	ADV151-P	3-6-11	3	6	11	114G03STI	114G03	COOL DISTIL PUMP	COOL DISTIL	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-12	3	6	12	114G03TRI	114G03	COOL DISTIL PUMP			DI	NIS								HYD	
		0101	ADV151-P	3-6-13	3	6	13	114G04STI	114G04	DISTILL 1 PUMP	DISTILL 1	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-14	3	6	14	114G04TRI	114G04	DISTILL 1 PUMP	#REF!	#REF!	DI	NIS								HYD	
		0101	ADV151-P	3-6-15	3	6	15	114G05STI	114G05	DISTILL 2 PUMP	DISTILL 2	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-16	3	6	16	114G05TRI	114G05	DISTILL 2 PUMP			DI	NIS								HYD	
		0101	ADV151-P	3-6-17	3	6	17	114G07STI	114G07	DISTILL 3 PUMP	DISTILL 3	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-18	3	6	18	114G07TRI	114G07	DISTILL 3 PUMP	DISTILL 3	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-19	3	6	19	114G10STI	114G10	DISCHARGE PUMP	DISCHARGE	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-20	3	6	20	114G10TRI	114G10	DISCHARGE PUMP	DISCHARGE	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-21	3	6	21	114G30STI	114G30	WCT CIRC. PUMP	WCT CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-22	3	6	22	114G30TRI	114G30	WCT CIRC. PUMP	WCT CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-23	3	6	23	114G02STI	114G02	WCC CIRC. PUMP	WCC CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-24	3	6	24	114G02TRI	114G02	WCC CIRC. PUMP	WCC CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-25	3	6	25	SPARE	SPARE				DI	NIS								HYD	
		0101	ADV151-P	3-6-26	3	6	26	SPARE	SPARE				DI	NIS								HYD	
		0101	ADV151-P	3-6-27	3	6	27	115G09STI	115G09	GLY. DISTIL DISCH PUMP	GLY. DISTIL	DISCH PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-28	3	6	28	115G09TRI	115G09	GLY. DISTIL DISCH PUMP	GLY. DISTIL	DISCH PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-29	3	6	29	115G14STI	115G14	WTR. CIRC. PUMP	WTR. CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-30	3	6	30	115G14TRI	115G14	WTR. CIRC. PUMP	WTR. CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	3-6-31	3	6	31	SPARE	SPARE				DI	NIS									
		0101	ADV151-P	3-6-32	3	6	32	SPARE	SPARE				DI	NIS									

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks
															Lower	Upper		LL	L	H	HH		
		0101	ADV151-P	4-5-1	4	5	1	116G02STI	116G02	CIRCULATION PUMP	CIRCULATION	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-2	4	5	2	116G02TRI	116G02	CIRCULATION PUMP	CIRCULATION	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-3	4	5	3	116G03STI	116G03	TRANSFER PUMP	TRANSFER	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-4	4	5	4	116G03TRI	116G03	TRANSFER PUMP	TRANSFER	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-5	4	5	5	116G06STI	116G06	116E05 CIRC PUMP	116E05 CIRC	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-6	4	5	6	116G06TRI	116G06	116E05 CIRC PUMP	116E05 CIRC	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-7	4	5	7	116G10STI	116G10	TOP FRAC 1 PUMP	TOP FRAC 1	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-8	4	5	8	116G10TRI	116G10	TOP FRAC 1 PUMP	#REF!	#REF!	DI	NIS								HYD	
		0101	ADV151-P	4-5-9	4	5	9	116G11STI	116G11	SIDE FRAC 1 PUMP	SIDE FRAC 1	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-10	4	5	10	116G11TRI	116G11	SIDE FRAC 1 PUMP	SIDE FRAC 1	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-11	4	5	11	116G15STI	116G15	DISTILL PUMP	DISTILL PUMP		DI	NIS								HYD	
		0101	ADV151-P	4-5-12	4	5	12	116G15TRI	116G15	DISTILL PUMP	DISTILL PUMP		DI	NIS								HYD	
		0101	ADV151-P	4-5-13	4	5	13	116G16STI	116G16	H.E PUMP	H.E PUMP		DI	NIS								HYD	
		0101	ADV151-P	4-5-14	4	5	14	116G16TRI	116G16	H.E PUMP	H.E PUMP		DI	NIS								HYD	
		0101	ADV151-P	4-5-15	4	5	15	116G17STI	116G17	RESIDUE PUMP	RESIDUE PUMP		DI	NIS								HYD	
		0101	ADV151-P	4-5-16	4	5	16	116G17TRI	116G17	RESIDUE PUMP	RESIDUE PUMP		DI	NIS								HYD	
		0101	ADV151-P	4-5-17	4	5	17	116G18STI	116G18	L.E PUMP	L.E PUMP		DI	NIS								HYD	
		0101	ADV151-P	4-5-18	4	5	18	116G18TRI	116G18	L.E PUMP	L.E PUMP		DI	NIS								HYD	
		0101	ADV151-P	4-5-19	4	5	19	116G20STI	116G20	116E02 CIRC PUMP	116E02 CIRC	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-20	4	5	20	116G20TRI	116G20	116E02 CIRC PUMP	116E02 CIRC	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-21	4	5	21	116G21ASTI	116G21A	116E03A CIRC. PUMP	116E03A	CIRC. PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-22	4	5	22	116G21ATRI	116G21A	116E03A CIRC. PUMP	116E03A	CIRC. PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-23	4	5	23	116G21BSTI	116G21B	116E03B CIRC. PUMP	116E03B	CIRC. PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-24	4	5	24	116G21BTRI	116G21B	116E03B CIRC. PUMP	116E03B	CIRC. PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-25	4	5	25	116G23STI	116G23	116E05 CIRC PUMP	116E05 CIRC	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-26	4	5	26	116G23TRI	116G23	116E05 CIRC PUMP	116E05 CIRC	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-27	4	5	27	116G24STI	116G24	116D05 CIRC PUMP	116D05 CIRC	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-28	4	5	28	116G24TRI	116G24	116D05 CIRC PUMP	116D05 CIRC	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-29	4	5	29	116G30STI	116G30	TCW CIRC. PUMP	TCW CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-30	4	5	30	116G30TRI	116G30	TCW CIRC. PUMP	TCW CIRC.	PUMP	DI	NIS								HYD	
		0101	ADV151-P	4-5-31	4	5	31	116G35STI	116G35	116E10 INLINE PUMP	116E10	INLINE PUMP	DI	NIS									
		0101	ADV151-P	4-5-32	4	5	32	116G35TRI	116G35	116E10 INLINE PUMP	116E10	INLINE PUMP	DI	NIS									
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks
															Lower	Upper		LL	L	H	HH		
		0101	ADV151-P	6-4-1	6	4	1	AG901101STI	AG901101	T901101 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-2	6	4	2	AG901101TRI	AG901101	T901101 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-3	6	4	3	AG901102STI	AG901102	T901102 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-4	6	4	4	AG901102TRI	AG901102	T901102 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-5	6	4	5	AG901103STI	AG901103	T901103 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-6	6	4	6	AG901103TRI	AG901103	T901103 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-7	6	4	7	AG901104STI	AG901104	T901104 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-8	6	4	8	AG901104TRI	AG901104	T901104 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-9	6	4	9	SPARE	SPARE				DI	NIS								TKF	
		0101	ADV151-P	6-4-10	6	4	10			SPARE	SPARE				DI	NIS							
		0101	ADV151-P	6-4-11	6	4	11	AG901600STI	AG901600	T901600 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-12	6	4	12	AG901600TRI	AG901600	T901600 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-13	6	4	13	AG901601STI	AG901601	T901601 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-14	6	4	14	AG901601TRI	AG901601	T901601 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-15	6	4	15	AG901602STI	AG901602	T901602 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-16	6	4	16	AG901602TRI	AG901602	T901602 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-17	6	4	17	AG901603STI	AG901603	T901603 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-18	6	4	18	AG901603TRI	AG901603	T901603 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-19	6	4	19	AG901604STI	AG901604	T901604 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-20	6	4	20	AG901604TRI	AG901604	T901604 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-21	6	4	21	AG901605STI	AG901605	T901605 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-22	6	4	22	AG901605TRI	AG901605	T901605 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-23	6	4	23	AG901606STI	AG901606	T901606 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-24	6	4	24	AG901606TRI	AG901606	T901606 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-25	6	4	25	AG901607STI	AG901607	T901607 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-26	6	4	26	AG901607TRI	AG901607	T901607 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-27	6	4	27	AG901608STI	AG901608	T901608 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-28	6	4	28	AG901608TRI	AG901608	T901608 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-29	6	4	29	AG901609STI	AG901609	T901609 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-30	6	4	30	AG901609TRI	AG901609	T901609 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-31	6	4	31	AG901610STI	AG901610	T901610 AGITATOR MTR			DI	NIS								TKF	
		0101	ADV151-P	6-4-32	6	4	32	AG901610TRI	AG901610	T901610 AGITATOR MTR			DI	NIS								TKF	

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag				IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	
															Lower	Upper		LL	L	H	HH			
		0101	ADV151-P	6-5-1	6	5	1	AG901801STI	AG901801	T901801	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-2	6	5	2	AG901801TRI	AG901801	T901801	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-3	6	5	3	AG901802STI	AG901802	T901802	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-4	6	5	4	AG901802TRI	AG901802	T901802	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-5	6	5	5	AG901803STI	AG901803	T901803	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-6	6	5	6	AG901803TRI	AG901803	T901803	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-7	6	5	7	AG901804STI	AG901804	T901804	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-8	6	5	8	AG901804TRI	AG901804	T901804	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-9	6	5	9	AG901805STI	AG901805	T901805	AGITATOR MTRI		DI	NIS							TKF			
		0101	ADV151-P	6-5-10	6	5	10	AG901805TRI	AG901805	T901805	AGITATOR MTRI		DI	NIS							TKF			
		0101	ADV151-P	6-5-11	6	5	11	AG901806STI	AG901806	T901806	AGITATOR MTRI		DI	NIS							TKF			
		0101	ADV151-P	6-5-12	6	5	12	AG901806TRI	AG901806	T901806	AGITATOR MTRI		DI	NIS							TKF			
		0101	ADV151-P	6-5-13	6	5	13	SPARE	SPARE			DI	NIS								TKF			
		0101	ADV151-P	6-5-14	6	5	14					SPARE	SPARE			DI	NIS							TKF
		0101	ADV151-P	6-5-15	6	5	15	AG91901ASTI	AG91901A	T91901A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-16	6	5	16	AG91901ATRI	AG91901A	T91901A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-17	6	5	17	AG91901BSTI	AG91901B	T91901B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-18	6	5	18	AG91901BTRI	AG91901B	T91901B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-19	6	5	19	AG91902ASTI	AG91902A	T91902A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-20	6	5	20	AG91902ATRI	AG91902A	T91902A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-21	6	5	21	AG91902BSTI	AG91902B	T91902B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-22	6	5	22	AG91902BTRI	AG91902B	T91902B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-23	6	5	23	AG91903ASTI	AG91903A	T91903A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-24	6	5	24	AG91903ATRI	AG91903A	T91903A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-25	6	5	25	AG91903BSTI	AG91903B	T91903B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-26	6	5	26	AG91903BTRI	AG91903B	T91903B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-27	6	5	27	AG91904ASTI	AG91904A	T91904A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-28	6	5	28	AG91904ATRI	AG91904A	T91904A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-29	6	5	29	AG91904BSTI	AG91904B	T91904B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-30	6	5	30	AG91904BTRI	AG91904B	T91904B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-5-31	6	5	31	SPARE				DI	NIS								TKF			
		0101	ADV151-P	6-5-32	6	5	32					SPARE				DI	NIS							TKF
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
		0101	ADV151-P	6-6-1	6	6	1	AG91907ASTI	AG91907A	T91907A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-6-2	6	6	2	AG91907ATRI	AG91907A	T91907A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-6-3	6	6	3	AG91907BSTI	AG91907B	T91907B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-6-4	6	6	4	AG91907BTRI	AG91907B	T91907B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-6-5	6	6	5	AG91908ASTI	AG91908A	T91908A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-6-6	6	6	6	AG91908ATRI	AG91908A	T91908A	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-6-7	6	6	7	AG91908BSTI	AG91908B	T91908B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-6-8	6	6	8	AG91908BTRI	AG91908B	T91908B	AGITATOR MTR		DI	NIS							TKF			
		0101	ADV151-P	6-6-9	6	6	9	SPARE	SPARE			DI	NIS											
		0101	ADV151-P	6-6-10	6	6	10	PU250HW1STI	PU250HW1	T250HW DISCHARGE PUMP 1		DI	NIS								Added 21/04/09			
		0101	ADV151-P	6-6-11	6	6	11	PU250HW1TRI	PU250HW1	T250HW DISCHARGE PUMP 1		DI	NIS								Added 21/04/09			
		0101	ADV151-P	6-6-12	6	6	12	PU250HW2STI	PU250HW2	T250HW DISCHARGE PUMP 2		DI	NIS								Added 21/04/09			
		0101	ADV151-P	6-6-13	6	6	13	PU250HW2TRI	PU250HW2	T250HW DISCHARGE PUMP 2		DI	NIS								Added 21/04/09			
		0101	ADV151-P	6-6-14	6	6	14	PU250HW3STI	PU250HW3	T250HW DISCHARGE PUMP 3		DI	NIS								Added 21/04/09			
		0101	ADV151-P	6-6-15	6	6	15	PU250HW3TRI	PU250HW3	T250HW DISCHARGE PUMP 3		DI	NIS								Added 21/04/09			
		0101	ADV151-P	6-6-16	6	6	16	PU250HW4STI	PU250HW4	T250HW DISCHARGE PUMP 4		DI	NIS								Added 21/04/09			
		0101	ADV151-P	6-6-17	6	6	17	PU250HW4TRI	PU250HW4	T250HW DISCHARGE PUMP 4		DI	NIS								Added 21/04/09			
		0101	ADV151-P	6-6-18	6	6	18	SPARE	SPARE			DI	NIS								Added 23/04/09			
		0101	ADV151-P	6-6-19	6	6	19	SPARE	SPARE			DI	NIS								Added 23/04/09			
		0101	ADV151-P	6-6-20	6	6	20	SPARE	SPARE			DI	NIS								Added 16/06/09			
		0101	ADV151-P	6-6-21	6	6	21	SPARE	SPARE			DI	NIS								Added 16/06/09			
		0101	ADV151-P	6-6-22	6	6	22	SPARE	SPARE			DI	NIS											
		0101	ADV151-P	6-6-23	6	6	23	SPARE	SPARE			DI	NIS											
		0101	ADV151-P	6-6-24	6	6	24	SPARE	SPARE			DI	NIS								Added 23/04/09			
		0101	ADV151-P	6-6-25	6	6	25	SPARE	SPARE			DI	NIS								Added 23/04/09			
		0101	ADV151-P	6-6-26	6	6	26	SPARE	SPARE			DI	NIS								Added 23/04/09			
		0101	ADV151-P	6-6-27	6	6	27	SPARE	SPARE			DI	NIS								Added 23/04/09			
		0101	ADV151-P	6-6-28	6	6	28	LSL119F02S	LSL119F02S			DI	NIS											
		0101	ADV151-P	6-6-29	6	6	29	LSH119F02S	LSH119F02S			DI	NIS											
		0101	ADV151-P	6-6-30	6	6	30	LS15LS	LS15LS	6M LVL MAIN PLANT LO SW	6M LVL MAIN	PLANT LO SW	DI	NIS							TKF			
		0101	ADV151-P	6-6-31	6	6	31	SPARE	SPARE			DI	NIS								TKF			
		0101	ADV151-P	6-6-32	6	6	32	SPARE	SPARE			DI	NIS								TKF			

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting					Plant	Remarks
															Lower	Upper		LL	L	H	HH			
		0101	ADV151-P	6-8-1	6	8	1	SV1401OI	SV1401	DISCHARGE FRM 114/115A	DISCHARGE	FRM 114/115A	DI	NIS										
		0101	ADV151-P	6-8-2	6	8	2	SV1401CI	SV1401	DISCHARGE FRM 114/115A	DISCHARGE	FRM 114/115A	DI	NIS										
		0101	ADV151-P	6-8-3	6	8	3	SV1402OI	SV1402	DISCHARGE FRM 114/115B	DISCHARGE	FRM 114/115B	DI	NIS										
		0101	ADV151-P	6-8-4	6	8	4	SV1402CI	SV1402	DISCHARGE FRM 114/115B	DISCHARGE	FRM 114/115B	DI	NIS										
		0101	ADV151-P	6-8-5	6	8	5	SV1403OI	SV1403	VALVE TO T901402	VALVE TO	T901402	DI	NIS										
		0101	ADV151-P	6-8-6	6	8	6	SV1403CI	SV1403	VALVE TO T901402	VALVE TO	T901402	DI	NIS										
		0101	ADV151-P	6-8-7	6	8	7	SV1404OI	SV1404	VALVE TO T901401	VALVE TO	T901401	DI	NIS										
		0101	ADV151-P	6-8-8	6	8	8	SV1404CI	SV1404	VALVE TO T901401	VALVE TO	T901401	DI	NIS										
		0101	ADV151-P	6-8-9	6	8	9	VS1631OI	VS1631				DI	NIS										
		0101	ADV151-P	6-8-10	6	8	10	VS1631CI	VS1631				DI	NIS										
		0101	ADV151-P	6-8-11	6	8	11	VS1632OI	VS1632				DI	NIS										
		0101	ADV151-P	6-8-12	6	8	12	VS1632CI	VS1632				DI	NIS										
		0101	ADV151-P	6-8-13	6	8	13	VS1633OI	VS1633				DI	NIS										
		0101	ADV151-P	6-8-14	6	8	14	VS1633CI	VS1633				DI	NIS										
		0101	ADV151-P	6-8-15	6	8	15	VS1621OI	VS1621				DI	NIS										
		0101	ADV151-P	6-8-16	6	8	16	VS1621CI	VS1621				DI	NIS										
		0101	ADV151-P	6-8-17	6	8	17	VS1622OI	VS1622				DI	NIS										
		0101	ADV151-P	6-8-18	6	8	18	VS1622CI	VS1622				DI	NIS										
		0101	ADV151-P	6-8-19	6	8	19	VS1623OI	VS1623				DI	NIS										
		0101	ADV151-P	6-8-20	6	8	20	VS1623CI	VS1623				DI	NIS										
		0101	ADV151-P	6-8-21	6	8	21	VS2401OI	VS2401				DI	NIS										
		0101	ADV151-P	6-8-22	6	8	22	VS2401CI	VS2401				DI	NIS										
		0101	ADV151-P	6-8-23	6	8	23	VS2402OI	VS2402				DI	NIS										
		0101	ADV151-P	6-8-24	6	8	24	VS2402CI	VS2402				DI	NIS										
		0101	ADV151-P	6-8-25	6	8	25	VS2403OI	VS2403				DI	NIS										
		0101	ADV151-P	6-8-26	6	8	26	VS2403CI	VS2403				DI	NIS										
		0101	ADV151-P	6-8-27	6	8	27	VS2404OI	VS2404				DI	NIS										
		0101	ADV151-P	6-8-28	6	8	28	VS2404CI	VS2404				DI	NIS										
		0101	ADV151-P	6-8-29	6	8	29	SPARE	SPARE				DI	NIS										
		0101	ADV151-P	6-8-30	6	8	30	SPARE	SPARE				DI	NIS										
		0101	ADV151-P	6-8-31	6	8	31	SPARE	SPARE				DI	NIS										
		0101	ADV151-P	6-8-32	6	8	32	SPARE	SPARE				DI	NIS										
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting					Plant	Remarks
															Lower	Upper		LL	L	H	HH			
		0101	ADV151-P	7-4-1	7	4	1	P901100ASTI	P901100A	CPO/PKO /RBDST			DI	NIS								TKF		
		0101	ADV151-P	7-4-2	7	4	2	P901100ATRI	P901100A	CPO/PKO /RBDST			DI	NIS								TKF		
		0101	ADV151-P	7-4-3	7	4	3	P901100BSTI	P901100B	CPO/PKO /RBDST			DI	NIS								TKF		
		0101	ADV151-P	7-4-4	7	4	4	P901100BTRI	P901100B	CPO/PKO /RBDST			DI	NIS								TKF		
		0101	ADV151-P	7-4-5	7	4	5	P901100CSTI	P901100C	ProcessWater			DI	NIS								TKF		
		0101	ADV151-P	7-4-6	7	4	6	P901100CTRI	P901100C	ProcessWater			DI	NIS								TKF		
		0101	ADV151-P	7-4-7	7	4	7	P901100DSTI	P901100D	ProcessWater			DI	NIS								TKF		
		0101	ADV151-P	7-4-8	7	4	8	P901100DTRI	P901100D	ProcessWater			DI	NIS								TKF		
		0101	ADV151-P	7-4-9	7	4	9	P901103STI	P901103	Crude FA to T901801			DI	NIS								TKF		
		0101	ADV151-P	7-4-10	7	4	10	P901103TRI	P901103	Crude FA to T901801			DI	NIS								TKF		
		0101	ADV151-P	7-4-11	7	4	11	P901200STI	P901200	Gly Water			DI	NIS								TKF		
		0101	ADV151-P	7-4-12	7	4	12	P901200TRI	P901200	Gly Water			DI	NIS								TKF		
		0101	ADV151-P	7-4-13	7	4	13	P901202STI	P901202	Skim Fat/Gly water			DI	NIS								TKF		
		0101	ADV151-P	7-4-14	7	4	14	P901202TRI	P901202	Skim Fat/Gly water			DI	NIS								TKF		
		0101	ADV151-P	7-4-15	7	4	15	P901300STI	P901300	Pretreated Gly Water			DI	NIS								TKF		
		0101	ADV151-P	7-4-16	7	4	16	P901300TRI	P901300	Pretreated Gly Water			DI	NIS								TKF		
		0101	ADV151-P	7-4-17	7	4	17	P901400ASTI	P901400A	Crude Gly			DI	NIS								TKF		
		0101	ADV151-P	7-4-18	7	4	18	P901400ATRI	P901400A	Crude Gly			DI	NIS								TKF		
		0101	ADV151-P	7-4-19	7	4	19	P901400BSTI	P901400B	Crude Gly			DI	NIS								TKF		
		0101	ADV151-P	7-4-20	7	4	20	P901400BTRI	P901400B	Crude Gly			DI	NIS								TKF		
		0101	ADV151-P	7-4-21	7	4	21	P901401STI	P901401	Bleached Glycerine			DI	NIS								TKF		
		0101	ADV151-P	7-4-22	7	4	22	P901401TRI	P901401	Bleached Glycerine			DI	NIS								TKF		
		0101	ADV151-P	7-4-23	7	4	23	P901600ASTI	P901600A	Crude FA			DI	NIS								TKF		
		0101	ADV151-P	7-4-24	7	4	24	P901600ATRI	P901600A	Crude FA			DI	NIS								TKF		
		0101	ADV151-P	7-4-25	7	4	25	P901600BSTI	P901600B	Crude FA			DI	NIS								TKF		
		0101	ADV151-P	7-4-26	7	4	26	P901600BTRI	P901600B	Crude FA			DI	NIS								TKF		
		0101	ADV151-P	7-4-27	7	4	27	P901601STI	P901601	FA C16 Export Tank			DI	NIS								TKF		
		0101	ADV151-P	7-4-28	7	4	28	P901601TRI	P901601	FA C16 Export Tank			DI	NIS								TKF		
		0101	ADV151-P	7-4-29	7	4	29	P901604STI	P901604	FA C18 Export Tank			DI	NIS								TKF		
		0101	ADV151-P	7-4-30	7	4	30	P901604TRI	P901604	FA C18 Export Tank			DI	NIS								TKF		
		0101	ADV151-P	7-4-31	7	4	31	P901607STI	P901607	Mixed Fatty Acid			DI	NIS								TKF		
		0101	ADV151-P	7-4-32	7	4	32	P901607TRI	P901607	Mixed Fatty Acid			DI	NIS								TKF		

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	
															Lower	Upper		LL	L	H	HH			
		0101	ADV151-P	7-5-1	7	5	1	P901608STI	P901608	C6			DI	NIS								TKF		
		0101	ADV151-P	7-5-2	7	5	2	P901608TRI	P901608	C6			DI	NIS								TKF		
		0101	ADV151-P	7-5-3	7	5	3	P901609STI	P901609	Fatty Acid Heavy Ends			DI	NIS								TKF		
		0101	ADV151-P	7-5-4	7	5	4	P901609TRI	P901609	Fatty Acid Heavy Ends			DI	NIS								TKF		
		0101	ADV151-P	7-5-5	7	5	5	P901611STI	P901611	Residue FA			DI	NIS								TKF		
		0101	ADV151-P	7-5-6	7	5	6	P901611TRI	P901611	Residue FA			DI	NIS								TKF		
		0101	ADV151-P	7-5-7	7	5	7	P901612STI	P901612	Waste Fatty Acid			DI	NIS								TKF		
		0101	ADV151-P	7-5-8	7	5	8	P901612TRI	P901612	Waste Fatty Acid			DI	NIS								TKF		
		0101	ADV151-P	7-5-9	7	5	9	P9018002STI	P9018002	H FA Transfer			DI	NIS								TKF		
		0101	ADV151-P	7-5-10	7	5	10	P9018002TRI	P9018002	H FA Transfer			DI	NIS								TKF		
		0101	ADV151-P	7-5-11	7	5	11	P9018005STI	P9018005	H FA Transfer			DI	NIS								TKF		
		0101	ADV151-P	7-5-12	7	5	12	P9018005TRI	P9018005	H FA Transfer			DI	NIS								TKF		
		0101	ADV151-P	7-5-13	7	5	13	P901800ASTI	P901800A	Crude FA Feed			DI	NIS								TKF		
		0101	ADV151-P	7-5-14	7	5	14	P901800ATRI	P901800A	Crude FA Feed			DI	NIS								TKF		
		0101	ADV151-P	7-5-15	7	5	15	P901800BSTI	P901800B	Crude FA Feed std by			DI	NIS								TKF		
		0101	ADV151-P	7-5-16	7	5	16	P901800BTRI	P901800B	Crude FA Feed std by			DI	NIS								TKF		
		0101	ADV151-P	7-5-17	7	5	17	P901804ASTI	P901804A	Crude FA			DI	NIS								TKF		
		0101	ADV151-P	7-5-18	7	5	18	P901804ATRI	P901804A	Crude FA			DI	NIS								TKF		
		0101	ADV151-P	7-5-19	7	5	19	P901804BSTI	P901804B	Crude FA feed std by			DI	NIS								TKF		
		0101	ADV151-P	7-5-20	7	5	20	P901804BTRI	P901804B	Crude FA feed std by			DI	NIS								TKF		
	160	0101	ADV151-P	7-5-21	7	5	21	P91901STI	P91901	C16Fatty Acid Export			DI	NIS								TKF		
		0101	ADV151-P	7-5-22	7	5	22	P91901TRI	P91901	C16Fatty Acid Export			DI	NIS								TKF		
		0101	ADV151-P	7-5-23	7	5	23	P91903STI	P91903	C18Fatty Acid Export			DI	NIS								TKF		
		0101	ADV151-P	7-5-24	7	5	24	P91903TRI	P91903	C18Fatty Acid Export			DI	NIS								TKF		
		0101	ADV151-P	7-5-25	7	5	25	P91905STI	P91905	Bleached Gly Export			DI	NIS								TKF		
		0101	ADV151-P	7-5-26	7	5	26	P91905TRI	P91905	Bleached Gly Export			DI	NIS								TKF		
		0101	ADV151-P	7-5-27	7	5	27	P91907STI	P91907	HPS Export			DI	NIS								TKF		
		0101	ADV151-P	7-5-28	7	5	28	P91907TRI	P91907	HPS Export			DI	NIS								TKF		
		0101	ADV151-P	7-5-29	7	5	29	P119G08STI	P119G08	CONDENSATE TANK PUMP			DI	NIS								Added 21/04/09		
		0101	ADV151-P	7-5-30	7	5	30	P119G08TRI	P119G08	CONDENSATE TANK PUMP			DI	NIS								Added 21/04/09		
		0101	ADV151-P	7-5-31	7	5	31	SPARE	SPARE				DI	NIS								Added 23/04/09		
		0101	ADV151-P	7-5-32	7	5	32	SPARE	SPARE				DI	NIS										
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment	
														Lower	Upper		LL	L	H	HH				
		0101	ADV151-P	8-4-1	8	4	1	150AD01STI	150AD01	Air Drier			DI	NIS								UTY		
		0101	ADV151-P	8-4-2	8	4	2	150AD01TRI	150AD01	Air Drier			DI	NIS								UTY		
		0101	ADV151-P	8-4-3	8	4	3	150AD02STI	150AD02	Air Drier			DI	NIS								UTY		
		0101	ADV151-P	8-4-4	8	4	4	150AD02TRI	150AD02	Air Drier			DI	NIS								UTY		
		0101	ADV151-P	8-4-5	8	4	5	150N2G1STI	150N2G1	N2 Generator			DI	NIS								UTY		
		0101	ADV151-P	8-4-6	8	4	6	150N2G1TRI	150N2G1	N2 Generator			DI	NIS								UTY		
		0101	ADV151-P	8-4-7	8	4	7	FN150CT01ASTI	FN150CT01A	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-8	8	4	8	FN150CT01ATRI	FN150CT01A	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-9	8	4	9	FN150CT01BSTI	FN150CT01B	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-10	8	4	10	FN150CT01BTRI	FN150CT01B	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-11	8	4	11	FN150CT01CSTI	FN150CT01C	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-12	8	4	12	FN150CT01CTRI	FN150CT01C	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-13	8	4	13	FN150CT01DSTI	FN150CT01D	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-14	8	4	14	FN150CT01DTRI	FN150CT01D	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-15	8	4	15	FN150CT01ESTI	FN150CT01E	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-16	8	4	16	FN150CT01ETRI	FN150CT01E	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-17	8	4	17	FN150CT01FSTI	FN150CT01F	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-18	8	4	18	FN150CT01FTRI	FN150CT01F	CoolingTower 150CT01 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-19	8	4	19	FN150CT02BSTI	FN150CT02B	CoolingTower 150CT02 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-20	8	4	20	FN150CT02BTRI	FN150CT02B	CoolingTower 150CT02 Fan			DI	NIS								UTY		
		0101	ADV151-P	8-4-21	8	4	21	SPARE	SPARE				DI	NIS								UTY	shift to hydrogenation (NIS)	
		0101	ADV151-P	8-4-22	8	4	22	SPARE	SPARE				DI	NIS								UTY	shift to hydrogenation (NIS)	
		0101	ADV151-P	8-4-23	8	4	23	SPARE	SPARE				DI	NIS								UTY	shift to hydrogenation (NIS)	
		0101	ADV151-P	8-4-24	8	4	24	SPARE	SPARE				DI	NIS								UTY	shift to hydrogenation (NIS)	
		0101	ADV151-P	8-4-25	8	4	25	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-4-26	8	4	26	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-4-27	8	4	27	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-4-28	8	4	28	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-4-29	8	4	29	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-4-30	8	4	30	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-4-31	8	4	31	SPARE	SPARE				DI	NIS										
		0101	ADV151-P	8-4-32	8	4	32	SPARE	SPARE				DI	NIS										



Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
															Lower	Upper		LL	L	H	HH			
		0101	ADV151-P	8-5-1	8	5	1	PU11D00ASTI	PU11D00A				DI	NIS								UTY		
		0101	ADV151-P	8-5-2	8	5	2	PU11D00ATRI	PU11D00A				DI	NIS								UTY		
		0101	ADV151-P	8-5-3	8	5	3	PU11D00BSTI	PU11D00B				DI	NIS								UTY		
		0101	ADV151-P	8-5-4	8	5	4	PU11D00BTRI	PU11D00B				DI	NIS								UTY		
		0101	ADV151-P	8-5-5	8	5	5	PU15001ASTI	PU15001A				DI	NIS								UTY		
		0101	ADV151-P	8-5-6	8	5	6	PU15001ATRI	PU15001A				DI	NIS								UTY		
		0101	ADV151-P	8-5-7	8	5	7	PU15001BSTI	PU15001B				DI	NIS								UTY		
		0101	ADV151-P	8-5-8	8	5	8	PU15001BTRI	PU15001B				DI	NIS								UTY		
		0101	ADV151-P	8-5-9	8	5	9	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-5-10	8	5	10	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-5-11	8	5	11	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-5-12	8	5	12	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-5-13	8	5	13	PU1501ASTI	PU1501A				DI	NIS								UTY		
		0101	ADV151-P	8-5-14	8	5	14	PU1501ATRI	PU1501A				DI	NIS								UTY		
		0101	ADV151-P	8-5-15	8	5	15	PU1501BSTI	PU1501B				DI	NIS								UTY		
		0101	ADV151-P	8-5-16	8	5	16	PU1501BTRI	PU1501B				DI	NIS								UTY		
		0101	ADV151-P	8-5-17	8	5	17	PU1501CSTI	PU1501C	NBK DI plant toCarbonwsh			DI	NIS								UTY		
		0101	ADV151-P	8-5-18	8	5	18	PU1501CTRI	PU1501C	NBK DI plant toCarbonwsh			DI	NIS								UTY		
		0101	ADV151-P	8-5-19	8	5	19	PU1501DSTI	PU1501D	T901105 to hydrolisis p			DI	NIS								UTY		
		0101	ADV151-P	8-5-20	8	5	20	PU1501DTRI	PU1501D	T901105 to hydrolisis p			DI	NIS								UTY		
		0101	ADV151-P	8-5-21	8	5	21	PU1501ESTI	PU1501E	T901105 to hydrolisis p			DI	NIS								UTY		
		0101	ADV151-P	8-5-22	8	5	22	PU1501ETRI	PU1501E	T901105 to hydrolisis p			DI	NIS								UTY		
		0101	ADV151-P	8-5-23	8	5	23	PU1502ASTI	PU1502A	Feed to Dea-rator 11D00			DI	NIS								UTY		
		0101	ADV151-P	8-5-24	8	5	24	PU1502ATRI	PU1502A	Feed to Dea-rator 11D00			DI	NIS								UTY		
		0101	ADV151-P	8-5-25	8	5	25	PU1502BSTI	PU1502B	Feed to Dea-rator 11D00			DI	NIS								UTY		
		0101	ADV151-P	8-5-26	8	5	26	PU1502BTRI	PU1502B	Feed to Dea-rator 11D00			DI	NIS								UTY		
		0101	ADV151-P	8-5-27	8	5	27	SPARE	SPARE				DI	NIS								UTY		
		0101	ADV151-P	8-5-28	8	5	28	LS50WW1AS					DI	NIS								UTY		
		0101	ADV151-P	8-5-29	8	5	29	LS50WW1BS					DI	NIS								UTY		
		0101	ADV151-P	8-5-30	8	5	30	SPARE					DI	NIS								UTY	IS TYPE	shift to hydrogenation (NIS)
		0101	ADV151-P	8-5-31	8	5	31	SPARE					DI	NIS										
		0101	ADV151-P	8-5-32	8	5	32	SPARE					DI	NIS										
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			IO Type		Range		Eng Units	ALRM & TRP Setting				Plant	Remarks	Comment
															Lower	Upper		LL	L	H	HH			
		0101	ADV151-P	8-6-1	8	6	1	PU150CCW1STI	PU150CCW1	190CT01TO P1-11~16/18&10	190CT01TO P1	-11~16/18&10	DI	NIS								UTY		
		0101	ADV151-P	8-6-2	8	6	2	PU150CCW1TRI	PU150CCW1	190CT01TO P1-11~16/18&10	190CT01TO P1	-11~16/18&10	DI	NIS								UTY		
		0101	ADV151-P	8-6-3	8	6	3	PU150CCW2STI	PU150CCW2	190CT01TO P1-11~16/18&10	190CT01TO P1	-11~16/18&10	DI	NIS								UTY		
		0101	ADV151-P	8-6-4	8	6	4	PU150CCW2TRI	PU150CCW2	190CT01TO P1-11~16/18&10	190CT01TO P1	-11~16/18&10	DI	NIS								UTY		
		0101	ADV151-P	8-6-5	8	6	5	PU150CCW3STI	PU150CCW3	190CT01TO P1-11~16/18&10	190CT01TO P1	-11~16/18&10	DI	NIS								UTY		
		0101	ADV151-P	8-6-6	8	6	6	PU150CCW3TRI	PU150CCW3	190CT01TO P1-11~16/18&10	190CT01TO P1	-11~16/18&10	DI	NIS								UTY		
		0101	ADV151-P	8-6-7	8	6	7	PU150CCW4STI	PU150CCW4	190CT01TO P1-11~16/18&10	190CT01TO P1	-11~16/18&10	DI	NIS								UTY		
		0101	ADV151-P	8-6-8	8	6	8	PU150CCW4TRI	PU150CCW4	190CT01TO P1-11~16/18&10	190CT01TO P1	-11~16/18&10	DI	NIS								UTY		
		0101	ADV151-P	8-6-9	8	6	9	PU150CCW4FF	PU150CCW4	190CT01TO P1-11~16/18&10	190CT01TO P1	-11~16/18&10	DI	NIS								UTY		shift to hydrogenation (NIS)
		0101	ADV151-P	8-6-10	8	6	10	SPARE	SPARE				DI	NIS								UTY		shift to hydrogenation (NIS)
		0101	ADV151-P	8-6-11	8	6	11	SPARE	SPARE				DI	NIS								UTY		shift to hydrogenation (NIS)
		0101	ADV151-P	8-6-12	8	6	12	SPARE	SPARE				DI	NIS								UTY		shift to hydrogenation (NIS)
		0101	ADV151-P	8-6-13	8	6	13	SPARE	SPARE				DI	NIS								UTY		shift to hydrogenation (NIS)
		0101	ADV151-P	8-6-14	8	6	14	SPARE	SPARE				DI	NIS								UTY		shift to hydrogenation (NIS)
		0101	ADV151-P	8-6-15	8	6	15	SPARE	SPARE				DI	NIS								UTY		shift to hydrogenation (NIS)
		0101	ADV151-P	8-6-16	8	6	16	SPARE	SPARE				DI	NIS								UTY		shift to hydrogenation (NIS)
		0101	ADV151-P	8-6-17	8	6	17	PU50HWASTI	PU50HWA	T90 HW HT TO S. TK HEAT	T90 HW HT TO	S. TK HEAT	DI	NIS								UTY	TAGGING CHANGE FRM PU50A TO PU50HWA	
		0101	ADV151-P	8-6-18	8	6	18	PU50HWATRI	PU50HWA	T90 HW HT TO S. TK HEAT	T90 HW HT TO	S. TK HEAT	DI	NIS								UTY		
		0101	ADV151-P	8-6-19	8	6	19	PU50HWBSTI	PU50HWB	T90 HW HT TO S. TK HEAT	T90 HW HT TO	S. TK HEAT	DI	NIS								UTY	TAGGING CHANGE FRM PU50B TO PU50HWB	
		0101	ADV151-P	8-6-20	8	6	20	PU50HWBTRI	PU50HWB	T90 HW HT TO S. TK HEAT	T90 HW HT TO	S. TK HEAT	DI	NIS								UTY		
		0101	ADV151-P	8-6-21	8	6	21	PU50HWCSTI	PU50HWC	T90HW TO BH COND TK	T90HW TO BH	COND TK	DI	NIS								UTY	TAGGING CHANGE FRM PU50C TO PU50HWC	
		0101	ADV151-P	8-6-22	8	6	22	PU50HWCTRI	PU50H															

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description	Service Description		IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
															Lower	Upper		LL	L	H	HH	
		0101	ADV551-P	2-7-1	2	7	1	NV11101O	NV11101				DO	NIS								
		0101	ADV551-P	2-7-2	2	7	2	NV11102O	NV11102				DO	NIS								
		0101	ADV551-P	2-7-3	2	7	3	KV11401O	KV11401				DO	NIS								
		0101	ADV551-P	2-7-4	2	7	4	KV11402O	KV11402				DO	NIS								
		0101	ADV551-P	2-7-5	2	7	5	KV11601O	KV11601				DO	NIS								
		0101	ADV551-P	2-7-6	2	7	6	KV11602O	KV11602				DO	NIS								
		0101	ADV551-P	2-7-7	2	7	7	SPARE	SPARE				DO	NIS								
		0101	ADV551-P	2-7-8	2	7	8	SPARE	SPARE				DO	NIS								
		0101	ADV551-P	2-7-9	2	7	9	111G01O	111G01				DO	NIS								
		0101	ADV551-P	2-7-10	2	7	10	111G02O	111G02				DO	NIS								
		0101	ADV551-P	2-7-11	2	7	11	111G03O	111G03				DO	NIS								
		0101	ADV551-P	2-7-12	2	7	12	111G04O	111G04				DO	NIS								
		0101	ADV551-P	2-7-13	2	7	13	111G05O	111G05				DO	NIS								
		0101	ADV551-P	2-7-14	2	7	14	111G07O	111G07				DO	NIS								
		0101	ADV551-P	2-7-15	2	7	15	111G08O	111G08				DO	NIS								
		0101	ADV551-P	2-7-16	2	7	16	111G09O	111G09				DO	NIS								
		0101	ADV551-P	2-7-17	2	7	17	111G55O	111G55				DO	NIS								
		0101	ADV551-P	2-7-18	2	7	18	112G01O	112G01				DO	NIS								
		0101	ADV551-P	2-7-19	2	7	19	112G02O	112G02				DO	NIS								
		0101	ADV551-P	2-7-20	2	7	20	112G03O	112G03				DO	NIS								
		0101	ADV551-P	2-7-21	2	7	21	112G06AO	112G06A				DO	NIS								
		0101	ADV551-P	2-7-22	2	7	22	112G06BO	112G06B				DO	NIS								
		0101	ADV551-P	2-7-23	2	7	23	112G08O	112G08				DO	NIS								
		0101	ADV551-P	2-7-24	2	7	24	SPARE	SPARE				DO	NIS								
		0101	ADV551-P	2-7-25	2	7	25	SPARE	SPARE				DO	NIS								
		0101	ADV551-P	2-7-26	2	7	26	113G02O	113G02				DO	NIS								
		0101	ADV551-P	2-7-27	2	7	27	113G03O	113G03				DO	NIS								
		0101	ADV551-P	2-7-28	2	7	28	113G55O	113G55				DO	NIS								
		0101	ADV551-P	2-7-29	2	7	29	SPARE	SPARE				DO	NIS								
		0101	ADV551-P	2-7-30	2	7	30	SPARE	SPARE				DO	NIS								
		0101	ADV551-P	2-7-31	2	7	31	115G09O	115G09				DO	NIS								
		0101	ADV551-P	2-7-32	2	7	32	115G14O	115G14				DO	NIS								
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description	Service Description		IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
		0101	ADV551-P	3-7-1	3	7	1	114G55O	114G02				DO	NIS								
		0101	ADV551-P	3-7-2	3	7	2	114G03O	114G03				DO	NIS								
		0101	ADV551-P	3-7-3	3	7	3	114G04O	114G04				DO	NIS								
		0101	ADV551-P	3-7-4	3	7	4	114G05O	114G05				DO	NIS								
		0101	ADV551-P	3-7-5	3	7	5	114G07O	114G07				DO	NIS								
		0101	ADV551-P	3-7-6	3	7	6	114G10O	114G10				DO	NIS								
		0101	ADV551-P	3-7-7	3	7	7	114G30O	114G30				DO	NIS								
		0101	ADV551-P	3-7-8	3	7	8	114G02O	114G02O				DO	NIS								
		0101	ADV551-P	3-7-9	3	7	9	SPARE	SPARE				DO	NIS								
		0101	ADV551-P	3-7-10	3	7	10	116G07O	116G07				DO	NIS								
		0101	ADV551-P	3-7-11	3	7	11	116G02O	116G02				DO	NIS								
		0101	ADV551-P	3-7-12	3	7	12	116G03O	116G03				DO	NIS								
		0101	ADV551-P	3-7-13	3	7	13	116G06O	116G06				DO	NIS								
		0101	ADV551-P	3-7-14	3	7	14	116G10O	116G10				DO	NIS								
		0101	ADV551-P	3-7-15	3	7	15	116G11O	116G11				DO	NIS								
		0101	ADV551-P	3-7-16	3	7	16	116G15O	116G15				DO	NIS								
		0101	ADV551-P	3-7-17	3	7	17	116G16O	116G16				DO	NIS								
		0101	ADV551-P	3-7-18	3	7	18	116G17O	116G17				DO	NIS								
		0101	ADV551-P	3-7-19	3	7	19	116G18O	116G18				DO	NIS								
		0101	ADV551-P	3-7-20	3	7	20	116G20O	116G20				DO	NIS								
		0101	ADV551-P	3-7-21	3	7	21	116G21AO	116G21A				DO	NIS								
		0101	ADV551-P	3-7-22	3	7	22	116G21BO	116G21B				DO	NIS								
		0101	ADV551-P	3-7-23	3	7	23	116G23O	116G23				DO	NIS								
		0101	ADV551-P	3-7-24	3	7	24	116G24O	116G24				DO	NIS								
		0101	ADV551-P	3-7-25	3	7	25	116G30O	116G30				DO	NIS								
		0101	ADV551-P	3-7-26	3	7	26	116G35O	116G35				DO	NIS								
		0101	ADV551-P	3-7-27	3	7	27	116G37O	116G37				DO	NIS								
		0101	ADV551-P	3-7-28	3	7	28	116G55O	116G55				DO	NIS								
		0101	ADV551-P	3-7-29	3	7	29	116G38O	116G38				DO	NIS								
		0101	ADV551-P	3-7-30	3	7	30	SV150CT01OO	SV150CT01				DO	NIS								
		0101	ADV551-P	3-7-31	3	7	31	SV150CT01CO	SV150CT01				DO	NIS								
		0101	ADV551-P	3-7-32	3	7	32	119G08O	119G08				DO	NIS								

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description		Service Description		IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
		0101	ADV551-P	6-7-1	6	7	1	AG901101O	AG901101	T901101	AGITATOR MTR	T901101	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-2	6	7	2	AG901102O	AG901102	T901102	AGITATOR MTR	T901102	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-3	6	7	3	AG901103O	AG901103	T901103	AGITATOR MTR	T901103	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-4	6	7	4	AG901104O	AG901104	T901104	AGITATOR MTR	T901104	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-5	6	7	5	AG901600O	AG901600	T901600	AGITATOR MTR	T901600	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-6	6	7	6	AG901601O	AG901601	T901601	AGITATOR MTR	T901601	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-7	6	7	7	AG901602O	AG901602	T901602	AGITATOR MTR	T901602	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-8	6	7	8	AG901603O	AG901603	T901603	AGITATOR MTR	T901603	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-9	6	7	9	AG901604O	AG901604	T901604	AGITATOR MTR	T901604	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-10	6	7	10	AG901605O	AG901605	T901605	AGITATOR MTR	T901605	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-11	6	7	11	AG901606O	AG901606	T901606	AGITATOR MTR	T901606	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-12	6	7	12	AG901607O	AG901607	T901607	AGITATOR MTR	T901607	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-13	6	7	13	AG901608O	AG901608	T901608	AGITATOR MTR	T901608	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-14	6	7	14	AG901609O	AG901609	T901609	AGITATOR MTR	T901609	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-15	6	7	15	AG901610O	AG901610	T901610	AGITATOR MTR	T901610	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-16	6	7	16	AG901801O	AG901801	T901801	AGITATOR MTR	T901801	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-17	6	7	17	AG901802O	AG901802	T901802	AGITATOR MTR	T901802	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-18	6	7	18	AG901803O	AG901803	T901803	AGITATOR MTR	T901803	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-19	6	7	19	AG901804O	AG901804	T901804	AGITATOR MTR	T901804	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-20	6	7	20	AG901805O	AG901805	T901805	AGITATOR MTR	T901805	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-21	6	7	21	AG901806O	AG901806	T901806	AGITATOR MTR	T901806	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-22	6	7	22	AG91901AO	AG91901A	T91901A	AGITATOR MTR	T91901A	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-23	6	7	23	AG91901BO	AG91901B	T91901B	AGITATOR MTR	T91901B	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-24	6	7	24	AG91902AO	AG91902A	T91902A	AGITATOR MTR	T91902A	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-25	6	7	25	AG91902BO	AG91902B	T91902B	AGITATOR MTR	T91902B	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-26	6	7	26	AG91903AO	AG91903A	T91903A	AGITATOR MTR	T91903A	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-27	6	7	27	AG91903BO	AG91903B	T91903B	AGITATOR MTR	T91903B	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-28	6	7	28	AG91904AO	AG91904A	T91904A	AGITATOR MTR	T91904A	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-29	6	7	29	AG91904BO	AG91904B	T91904B	AGITATOR MTR	T91904B	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-30	6	7	30	AG91907AO	AG91907A	T91907A	AGITATOR MTR	T91907A	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-31	6	7	31	AG91907BO	AG91907B	T91907B	AGITATOR MTR	T91907B	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	6-7-32	6	7	32	AG91908AO	AG91908A	T91908A	AGITATOR MTR	T91908A	AGITATOR MTR	DO	NIS								
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description		Service Description		IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks
		0101	ADV551-P	7-6-1	7	6	1	AG91908BO	AG91908B	T91908B	AGITATOR MTR	T91908B	AGITATOR MTR	DO	NIS								
		0101	ADV551-P	7-6-2	7	6	2	P119G08O	P119G08	CONDENSATE	TANK PUMP	CONDENSATE	TANK PUMP	DO	NIS								Added 22/04/09
		0101	ADV551-P	7-6-3	7	6	3	P901100AO	P901100A	CPO/PKO	/RBDST	CPO/PKO	/RBDST	DO	NIS								
		0101	ADV551-P	7-6-4	7	6	4	P901100BO	P901100B	CPO/PKO	/RBDST	CPO/PKO	/RBDST	DO	NIS								
		0101	ADV551-P	7-6-5	7	6	5	P901100CO	P901100C	ProcessWater		ProcessWater		DO	NIS								
		0101	ADV551-P	7-6-6	7	6	6	P901100DO	P901100D	ProcessWater		ProcessWater		DO	NIS								
		0101	ADV551-P	7-6-7	7	6	7	P901103O	P901103	Crude FA to T901801		Crude FA to	T901801	DO	NIS								
		0101	ADV551-P	7-6-8	7	6	8	P901200O	P901200	Gly Water		Gly Water		DO	NIS								
		0101	ADV551-P	7-6-9	7	6	9	P901202O	P901202	Skim Fat/Gly water		Skim Fat/Gly	water	DO	NIS								
		0101	ADV551-P	7-6-10	7	6	10	P901300O	P901300	Pretreated Gly Water		Pretreated	Gly Water	DO	NIS								
		0101	ADV551-P	7-6-11	7	6	11	P901400AO	P901400A					DO	NIS								
		0101	ADV551-P	7-6-12	7	6	12	P901400BO	P901400B	Crude Gly		Crude Gly		DO	NIS								
		0101	ADV551-P	7-6-13	7	6	13	P901401O	P901401	Bleached Glycerine		Bleached	Glycerine	DO	NIS								
		0101	ADV551-P	7-6-14	7	6	14	P901600AO	P901600A	Crude FA		Crude FA		DO	NIS								
		0101	ADV551-P	7-6-15	7	6	15	P901600BO	P901600B	Crude FA		Crude FA		DO	NIS								
		0101	ADV551-P	7-6-16	7	6	16	P901800AO	P901800A	Crude FA Feed		Crude FA	Feed	DO	NIS								
		0101	ADV551-P	7-6-17	7	6	17	P901800BO	P901800B	Crude FA Feed std by		Crude FA	Feed std by	DO	NIS								
		0101	ADV551-P	7-6-18	7	6	18	P9018002O	P9018002	H FA Transfer		H FA	Transfer	DO	NIS								
		0101	ADV551-P	7-6-19	7	6	19	P901804AO	P901804A	Crude FA		Crude FA		DO	NIS								
		0101	ADV551-P	7-6-20	7	6	20	P901804BO	P901804B	Crude FA feed std by		Crude FA	feed std by	DO	NIS								
		0101	ADV551-P	7-6-21	7	6	21	P9018005O	P9018005	H FA Transfer		H FA	Transfer	DO	NIS								
		0101	ADV551-P	7-6-22	7	6	22	P91901O	P91901	C16Fatty Acid Export		C16Fatty	Acid Export	DO	NIS								
		0101	ADV551-P	7-6-23	7	6	23	P91903O	P91903	C18Fatty Acid Export		C18Fatty	Acid Export	DO	NIS								
		0101	ADV551-P	7-6-24	7	6	24	P91905O	P91905	Bleached Gly Export		Bleached Gly	Export	DO	NIS								
		0101	ADV551-P	7-6-25	7	6	25	P91907O	P91907	HPS Export		HPS Export		DO	NIS								
		0101	ADV551-P	7-6-26	7	6	26	P901601O	P901601	FA C16 Export Tank		FA C16	Export Tank	DO	NIS								
		0101	ADV551-P	7-6-27	7	6	27	P901604O	P901604	FA C18 Export Tank		FA C18	Export Tank	DO	NIS								
		0101	ADV551-P	7-6-28	7	6	28	P901607O	P901607	Mixed Fatty Acid		Mixed Fatty	Acid	DO	NIS								
		0101	ADV551-P	7-6-29	7	6	29	P901608O	P901608	C6		C6		DO	NIS								
		0101	ADV551-P	7-6-30	7	6	30	P901609O	P901609	Fatty Acid Heavy Ends		Fatty Acid	Heavy Ends	DO	NIS								
		0101	ADV551-P	7-6-31	7	6	31	P901611O	P901611	Residue FA		Residue FA		DO	NIS								
		0101	ADV551-P	7-6-32	7	6	32	P901612O	P901612	Waste Fatty Acid		Waste Fatty	Acid	DO	NIS								

Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			Service Description		IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks	Comment
																	Lower	Upper		LL	L	H	HH		
		0101	ADV551-P	8-7-1	8	7	1	150AD01O	150AD01	Air Drier	Air Drier			DO	NIS										
		0101	ADV551-P	8-7-2	8	7	2	150AD02O	150AD02	Air Drier	Air Drier			DO	NIS										
		0101	ADV551-P	8-7-3	8	7	3	150N2G1O	150N2G1	N2 Generator	N2 Generator			DO	NIS										
		0101	ADV551-P	8-7-4	8	7	4	SPARE	SPARE					DO	NIS										
		0101	ADV551-P	8-7-5	8	7	5	FN150CT01AO	FN150CT01A	CoolingTower 150CT01 Fan	CoolingTower	150CT01 Fan	DO	NIS											
		0101	ADV551-P	8-7-6	8	7	6	FN150CT01BO	FN150CT01B	CoolingTower 150CT01 Fan	CoolingTower	150CT01 Fan	DO	NIS											
		0101	ADV551-P	8-7-7	8	7	7	FN150CT01CO	FN150CT01C	CoolingTower 150CT01 Fan	CoolingTower	150CT01 Fan	DO	NIS											
		0101	ADV551-P	8-7-8	8	7	8	FN150CT01DO	FN150CT01D	CoolingTower 150CT01 Fan	CoolingTower	150CT01 Fan	DO	NIS											
		0101	ADV551-P	8-7-9	8	7	9	FN150CT01EO	FN150CT01E	CoolingTower 150CT01 Fan	CoolingTower	150CT01 Fan	DO	NIS											
		0101	ADV551-P	8-7-10	8	7	10	FN150CT01FO	FN150CT01F	CoolingTower 150CT01 Fan	CoolingTower	150CT01 Fan	DO	NIS											
		0101	ADV551-P	8-7-11	8	7	11	SPARE	SPARE				DO	NIS								shift to hydrogenation (NIS)			
		0101	ADV551-P	8-7-12	8	7	12	FN150CT02BO	FN150CT02B	CoolingTower 150CT02 Fan	CoolingTower	150CT02 Fan	DO	NIS											
		0101	ADV551-P	8-7-13	8	7	13	SPARE	SPARE				DO	NIS								shift to hydrogenation (NIS)			
		0101	ADV551-P	8-7-14	8	7	14	PU150CCW1O	PU150CCW1	Clean Cooling Water	Clean Cooling	Water	DO	NIS											
		0101	ADV551-P	8-7-15	8	7	15	PU150CCW2O	PU150CCW2	Clean Cooling Water	Clean Cooling	Water	DO	NIS											
		0101	ADV551-P	8-7-16	8	7	16	PU150CCW3O	PU150CCW3	Clean Cooling Water	Clean Cooling	Water	DO	NIS											
		0101	ADV551-P	8-7-17	8	7	17	PU150CCW4O	PU150CCW4	Clean Cooling Water	Clean Cooling	Water	DO	NIS											
		0101	ADV551-P	8-7-18	8	7	18	SPARE	SPARE				DO	NIS								shift to hydrogenation (NIS)			
		0101	ADV551-P	8-7-19	8	7	19	SPARE	SPARE				DO	NIS								shift to hydrogenation (NIS)			
		0101	ADV551-P	8-7-20	8	7	20	SPARE	SPARE				DO	NIS								shift to hydrogenation (NIS)			
		0101	ADV551-P	8-7-21	8	7	21	SPARE	SPARE				DO	NIS								shift to hydrogenation (NIS)			
		0101	ADV551-P	8-7-22	8	7	22	PU15001AO	PU15001A	Canned pump CCw	Canned pump	CCw	DO	NIS											
		0101	ADV551-P	8-7-23	8	7	23	PU15001BO	PU15001B	Canned pump CCW	Canned pump	CCW	DO	NIS											
		0101	ADV551-P	8-7-24	8	7	24	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-7-25	8	7	25	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-7-26	8	7	26	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-7-27	8	7	27	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-7-28	8	7	28	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-7-29	8	7	29	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-7-30	8	7	30	SPARE	SPARE				DO	NIS								ADDED			
		0101	ADV551-P	8-7-31	8	7	31	SPARE	SPARE				DO	NIS								ADDED			
		0101	ADV551-P	8-7-32	8	7	32	SPARE	SPARE				DO	NIS								ADDED			
Cabinet Location	JB Location	FCU	Module					Source Tag	DCS Tag	Service Description			Service Description		IO Type		Range		Eng Units	Alarm & Trip Setting				Remarks	Comment
		0101	ADV551-P	8-8-1	8	8	1	PU50HWA0	PU50HWA	Hot Water	Hot Water			DO	NIS								22/04/09 TAG CHANGE FRM PU50A TO PU50HWA		
		0101	ADV551-P	8-8-2	8	8	2	PU50HWB0	PU50HWB	Hot Water	Hot Water			DO	NIS								22/04/09 TAG CHANGE FRM PU50B TO PU50HWB		
		0101	ADV551-P	8-8-3	8	8	3	PU50HWC0	PU50HWC	Hot codensate Return	Hot codensat	e Return	DO	NIS									22/04/09 TAG CHANGE FRM PU50C TO PU50HWC		
		0101	ADV551-P	8-8-4	8	8	4	PU50HWD0	PU50HWD	Hot codensate Return	Hot codensat	e Return	DO	NIS									22/04/09 TAG CHANGE FRM PU50D TO PU50HWD		
		0101	ADV551-P	8-8-5	8	8	5	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-8-6	8	8	6	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-8-7	8	8	7	PU50WW1AO	PU50WW1A	Ww trans Tk Farm(main)	Ww trans Tk	Farm(main)	DO	NIS											
		0101	ADV551-P	8-8-8	8	8	8	PU50WW1BO	PU50WW1B	Ww transTk Farm (export)	Ww transTk F	arm (export)	DO	NIS											
		0101	ADV551-P	8-8-9	8	8	9	PU50WW2O	PU50WW2	Ww transfer Main Plant	Ww transfer	Main Plant	DO	NIS											
		0101	ADV551-P	8-8-10	8	8	10	SPARE	SPARE				DO	NIS									shift to hydrogenation (NIS)		
		0101	ADV551-P	8-8-11	8	8	11	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-8-12	8	8	12	PU11D00AO	PU11D00A	D*ratorDI to Plt 116 Stm Gen	D*ratorDI to	Plt 116 Stm	DO	NIS											
		0101	ADV551-P	8-8-13	8	8	13	PU11D00BO	PU11D00B	D*ratorDI to Plt 116 Stm Gen	D*ratorDI to	Plt 116 Stm	DO	NIS											
		0101	ADV551-P	8-8-14	8	8	14	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-8-15	8	8	15	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-8-16	8	8	16	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-8-17	8	8	17	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-8-18	8	8	18	PU1501AO	PU1501A	BKR DI plant to T901105	BKR DI plant	to T901105	DO	NIS											
		0101	ADV551-P	8-8-19	8	8	19	PU1501BO	PU1501B	BKR DI plant to T901105	BKR DI plant	to T901105	DO	NIS											
		0101	ADV551-P	8-8-20	8	8	20	PU1501CO	PU1501C	NBK DI plant toCarbonwsh	NBK DI plant	toCarbonwsh	DO	NIS											
		0101	ADV551-P	8-8-21	8	8	21	PU1501DO	PU1501D	T901105 to hydrolisis p	T901105 to	hydrolisis p	DO	NIS											
		0101	ADV551-P	8-8-22	8	8	22	PU1501EO	PU1501E	T901105 to hydrolisis p	T901105 to	hydrolisis p	DO	NIS											
		0101	ADV551-P	8-8-23	8	8	23	SPARE	SPARE				DO	NIS											
		0101	ADV551-P	8-8-24	8	8	24	SPARE	SPARE				DO	NIS											

[illegible]

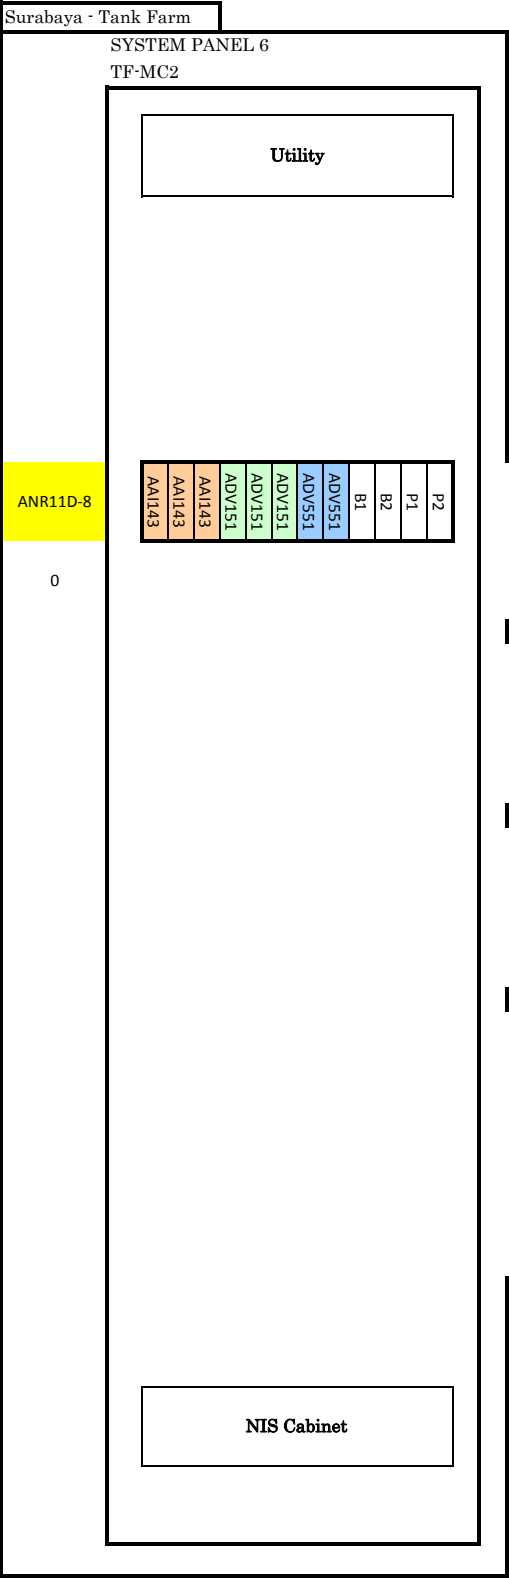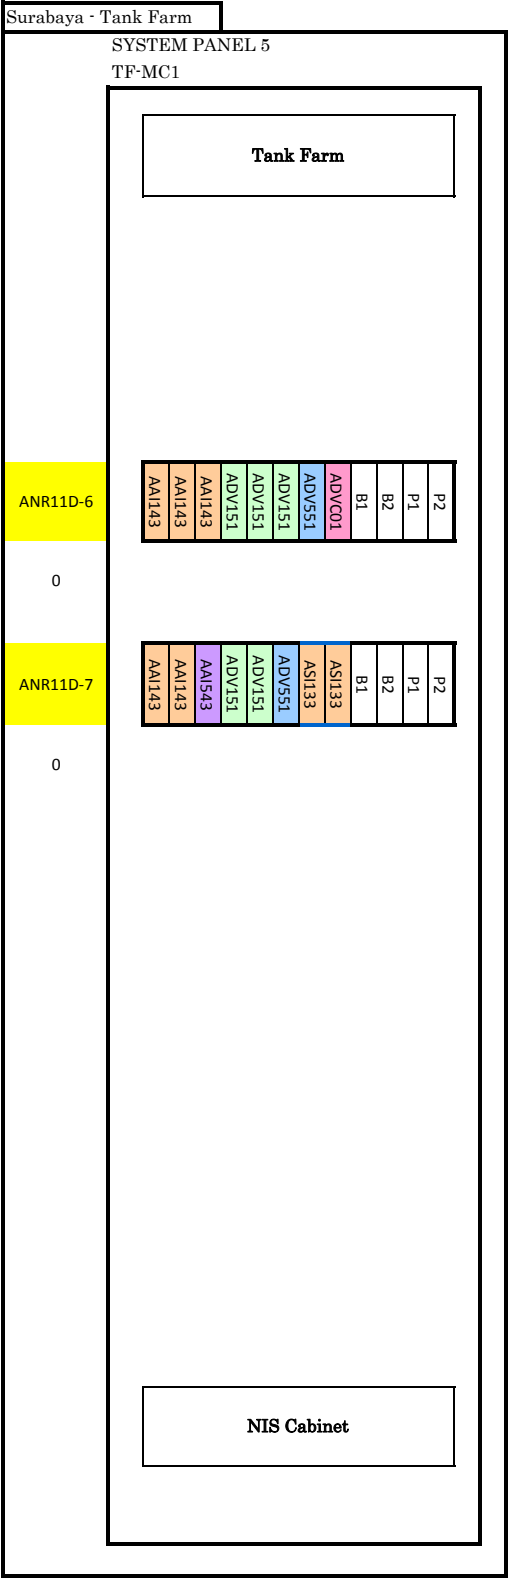

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC1)			FCU-0101				
			HSC	RTD																
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model										
				TB1-001	FT11102	A1	1	1	1	AAI143										
				TB1-002		B1														
				TB1-003	FT11202	A2	2	1	1	AAI143										
				TB1-004		B2														
				TB1-005	FT11303	A3	3	1	1	AAI143										
				TB1-006		B3														
				TB1-007	FT11403	A4	4	1	1	AAI143										
				TB1-008		B4														
				TB1-009	FT11404	A5	5	1	1	AAI143										
				TB1-010		B5														
				TB1-011	FT11405	A6	6	1	1	AAI143										
				TB1-012		B6														
				TB1-013	FT11406	A7	7	1	1	AAI143										
				TB1-014		B7														
				TB1-015	FT11601	A8	8	1	1	AAI143										
				TB1-016		B8														
				TB1-017	FT11602	A9	9	1	1	AAI143										
				TB1-018		B9														
				TB1-019	FT11603	A10	10	1	1	AAI143										
				TB1-020		B10														
				TB1-021	FT11604	A11	11	1	1	AAI143										
				TB1-022		B11														
				TB1-023	FT11901	A12	12	1	1	AAI143										
				TB1-024		B12														
				TB1-025	FT11902	A13	13	1	1	AAI143										
				TB1-026		B13														
				TB1-027	FT11903	A14	14	1	1	AAI143										
				TB1-028		B14														
				TB1-029	FT11904	A15	15	1	1	AAI143										
				TB1-030		B15														
				TB1-031	LT11901	A16	16	1	1	AAI143										
				TB1-032		B16														
GENERAL DESCRIPTION Panel Wiring Drawing		DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.							
		CH.	IENA	DATE	24/10/08							WILMAR SURABAYA FA PROJECT	29-AI							
												TITLE	SHT. NO.							
FILENAME		APP.	TEOH	DATE	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONTD							
FA-PANEL						REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	30							

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC1)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
									SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model													
				TB1-033	FT11101	A1	1	1	2	AAI143													
				TB1-034		B1																	
				TB1-035	FT11103	A2	2	1	2	AAI143													
				TB1-036		B2																	
				TB1-037	FT11104	A3	3	1	2	AAI143													
				TB1-038		B3																	
				TB1-039	FT11105	A4	4	1	2	AAI143													
				TB1-040		B4																	
				TB1-041	LT11101	A5	5	1	2	AAI143													
				TB1-042		B5																	
				TB1-043	LT11102	A6	6	1	2	AAI143													
				TB1-044		B6																	
				TB1-045	LT11103	A7	7	1	2	AAI143													
				TB1-046		B7																	
				TB1-047	LT11104	A8	8	1	2	AAI143													
				TB1-048		B8																	
				TB1-049	LT11105	A9	9	1	2	AAI143													
				TB1-050		B9																	
				TB1-051	LT11106	A10	10	1	2	AAI143													
				TB1-052		B10																	
				TB1-053	LT11107	A11	11	1	2	AAI143													
				TB1-054		B11																	
				TB1-055	PT11101	A12	12	1	2	AAI143													
				TB1-056		B12																	
				TB1-057	PT11102	A13	13	1	2	AAI143													
				TB1-058		B13																	
				TB1-059	PT11103	A14	14	1	2	AAI143													
				TB1-060		B14																	
				TB1-061	PT11104	A15	15	1	2	AAI143													
				TB1-062		B15																	
				TB1-063	TT11101	A16	16	1	2	AAI143													
				TB1-064		B16																	

GENERAL DESCRIPTION Panel Wiring Drawing	DR. SHAM	DATE 24/10/08							PROJECT NAME WILMAR SURABAYA FA PROJECT	DWG. NO. 30-AI
	CH. IENA	DATE 24/10/08							TITLE FA-MC PANEL (MC1)	SHT. NO. 30
FILENAME FA-PANEL	APP. TEOH	DATE 24/10/08	0 REV.	FIRST ISSUE DESCRIPTION	24/10/08 DATE	SHAM DRAWN BY	IENA CHECK BY	TEOH APPR. BY	DOC. NO. WSFA-D32-002	CONTD 31

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : 				
			HSC	RTD													
			AI	AO													
			DI	DO													
			IS	NIS													
HART	NON HART																

Signal Type :			Cabinet No :										FCU-0101														
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC1)														
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
			MCB3-7					MCB3-9					SYSTEM I/O														
			OVDC-7					24VDC-7					24VDC-9					OVDC-9									
FIELD CABLE			CROSS WIRING TB	CROSS WIRE NO.	TB					IP-R			Tag No.			Term.	Channel	NODE	SLOT	MODEL							
					TB2-001					14	R1-1		A2	NV111010			A1	1	2	7	ADV551						
					TB2-002					11			A1														
					TB2-003					14	R1-2		A2	NV111020			A2	2	2	7	ADV551						
					TB2-004					11			A1														
					TB2-005					14	R1-3		A2	KV114010			A3	3	2	7	ADV551						
					TB2-006					11			A1														
					TB2-007					14	R1-4		A2	KV114020			A4	4	2	7	ADV551						
					TB2-008					11			A1														
					TB2-009					14	R1-5		A2	KV116010			A5	5	2	7	ADV551						
					TB2-010					11			A1														
					TB2-011					14	R1-6		A2	KV116020			A6	6	2	7	ADV551						
					TB2-012					11			A1														
					TB2-013					14	R1-7		A2	SPARE			A7	7	2	7	ADV551						
					TB2-014					11			A1														
					TB2-015					14	R1-8		A2	SPARE			A8	8	2	7	ADV551						
					TB2-016					11			A1														
					TB2-017					14	R1-9		A2	111G010			A9	9	2	7	ADV551						
					TB2-018					11			A1														
					TB2-019					14	R1-10		A2	111G020			A10	10	2	7	ADV551						
					TB2-020					11			A1														
					TB2-021					14	R1-11		A2	111G030			A11	11	2	7	ADV551						
					TB2-022					11			A1														
					TB2-023					14	R1-12		A2	111G040			A12	12	2	7	ADV551						
					TB2-024					11			A1														
					TB2-025					14	R1-13		A2	111G050			A13	13	2	7	ADV551						
					TB2-026					11			A1														
					TB2-027					14	R1-14		A2	111G070			A14	14	2	7	ADV551						
					TB2-028					11			A1														
					TB2-029					14	R1-15		A2	111G080			A15	15	2	7	ADV551						
					TB2-030					11			A1														
					TB2-031					14	R1-16		A2	111G090			A16	16	2	7	ADV551						
					TB2-032					11			A1														
																	A17	-	2	7	ADV551						
																	A18	+									

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME					DWG. NO.
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT					32-DO
		CH.	DATE						TITLE					SHT NO
		IENA	24/10/08						FA-MC PANEL (MC1)					32
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.					CONT NO
FA-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002					33

Signal Type :			Cabinet No :	FA-MC PANEL (MC1)										FCU-0101									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC												RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	OVDC-7		24VDC-7		24VDC-9		OVDC-9		Term.	Channel	NODE	SLOT	MODEL							
		TB			IP-R		Tag No.																
				TB2-033				14	R1-17	A2	111G550		B1	17	2	7	ADV551						
				TB2-034				11		A1													
				TB2-035				14	R1-18	A2	112G010		B2	18	2	7	ADV551						
				TB2-036				11		A1													
				TB2-037				14	R1-19	A2	112G020		B3	19	2	7	ADV551						
				TB2-038				11		A1													
				TB2-039				14	R1-20	A2	112G030		B4	20	2	7	ADV551						
				TB2-040				11		A1													
				TB2-041				14	R1-21	A2	112G06AO		B5	21	2	7	ADV551						
				TB2-042				11		A1													
				TB2-043				14	R1-22	A2	112G06BO		B6	22	2	7	ADV551						
				TB2-044				11		A1													
				TB2-045				14	R1-23	A2	112G080		B7	23	2	7	ADV551						
				TB2-046				11		A1													
				TB2-047				14	R1-24	A2	SPARE		B8	24	2	7	ADV551						
				TB2-048				11		A1													
				TB2-049				14	R1-25	A2	SPARE		B9	25	2	7	ADV551						
				TB2-050				11		A1													
				TB2-051				14	R1-26	A2	113G020		B10	26	2	7	ADV551						
				TB2-052				11		A1													
				TB2-053				14	R1-27	A2	113G030		B11	27	2	7	ADV551						
				TB2-054				11		A1													
				TB2-055				14	R1-28	A2	113G550		B12	28	2	7	ADV551						
				TB2-056				11		A1													
				TB2-057				14	R1-29	A2	SPARE		B13	29	2	7	ADV551						
				TB2-058				11		A1													
				TB2-059				14	R1-30	A2	SPARE		B14	30	2	7	ADV551						
				TB2-060				11		A1													
				TB2-061				14	R1-31	A2	115G090		B15	31	2	7	ADV551						
				TB2-062				11		A1													
				TB2-063				14	R1-32	A2	115G140		B16	32	2	7	ADV551						
				TB2-064				11		A1													
											B17	-	2	7	ADV551								
											B18	+											

GENERAL DESCRIPTION		DR.	DATE							PROJECT NAME					DWG. NO.	
Panel Wiring Drawing		SHAM	24/10/08							WILMAR SURABAYA FA PROJECT					33-DO	
		CH.	DATE							TITLE					SHT NO	
		IENA	24/10/08							FA-MC PANEL (MC1)					33	
FILENAME		APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.					CONT NO	
FA-PANEL		TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002					34	

Signal Type :			Cabinet No :	FA-MC PANEL (MC1)										FCU-0101									
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC												RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						

FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	OVDC-8		24VDC-8		24VDC-10		OVDC-10						
				TB			IP-R		Tag No.		Term	Channel	NODE	SLOT	MODEL	
				TB2-065			14	R2-1	A2	114G550	A1	1	3	7	ADV551	
				TB2-066			11		A1							
				TB2-067			14	R2-2	A2	114G030	A2	2	3	7	ADV551	
				TB2-068			11		A1							
				TB2-069			14	R2-3	A2	114G040	A3	3	3	7	ADV551	
				TB2-070			11		A1							
				TB2-071			14	R2-4	A2	114G050	A4	4	3	7	ADV551	
				TB2-072			11		A1							
				TB2-073			14	R2-5	A2	114G070	A5	5	3	7	ADV551	
				TB2-074			11		A1							
				TB2-075			14	R2-6	A2	114G100	A6	6	3	7	ADV551	
				TB2-076			11		A1							
				TB2-077			14	R2-7	A2	114G300	A7	7	3	7	ADV551	
				TB2-078			11		A1							
				TB2-079			14	R2-8	A2	114G020	A8	8	3	7	ADV551	
				TB2-080			11		A1							
				TB2-081			14	R2-9	A2	SPARE	A9	9	3	7	ADV551	
				TB2-082			11		A1							
				TB2-083			14	R2-10	A2	116G070	A10	10	3	7	ADV551	
				TB2-084			11		A1							
				TB2-085			14	R2-11	A2	116G020	A11	11	3	7	ADV551	
				TB2-086			11		A1							
				TB2-087			14	R2-12	A2	116G030	A12	12	3	7	ADV551	
				TB2-088			11		A1							
				TB2-089			14	R2-13	A2	116G060	A13	13	3	7	ADV551	
				TB2-090			11		A1							
				TB2-091			14	R2-14	A2	116G100	A14	14	3	7	ADV551	
				TB2-092			11		A1							
				TB2-093			14	R2-15	A2	116G110	A15	15	3	7	ADV551	
				TB2-094			11		A1							
				TB2-095			14	R2-16	A2	116G150	A16	16	3	7	ADV551	
				TB2-096			11		A1							
												A17	-	3	7	ADV551
												A18	+			

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME					DWG. NO.	
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT					34-DO	
		CH.	DATE						TITLE					SHT NO	
		IENA	24/10/08						FA-MC PANEL (MC1)					34	
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.					CONT NO	
FA-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002					35	

Signal Type :			Cabinet No :										FCU-0101														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC1)														
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
			MCB3-8					MCB3-10					SYSTEM I/O														
			OVDC-8		24VDC-8			24VDC-10		OVDC-10																	
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB				IP-R		Tag No.			Term.	Channel	NODE	SLOT	MODEL										
				TB2-097				14	R2-17	A2	116G160			B1	17	3	7	ADV551									
				TB2-098				11		A1																	
				TB2-099				14	R2-18	A2	116G170			B2	18	3	7	ADV551									
				TB2-100				11		A1																	
				TB2-101				14	R2-19	A2	116G180			B3	19	3	7	ADV551									
				TB2-102				11		A1																	
				TB2-103				14	R2-20	A2	116G200			B4	20	3	7	ADV551									
				TB2-104				11		A1																	
				TB2-105				14	R2-21	A2	116G21AO			B5	21	3	7	ADV551									
				TB2-106				11		A1																	
				TB2-107				14	R2-22	A2	116G21BO			B6	22	3	7	ADV551									
				TB2-108				11		A1																	
				TB2-109				14	R2-23	A2	116G230			B7	23	3	7	ADV551									
				TB2-110				11		A1																	
				TB2-111				14	R2-24	A2	116G240			B8	24	3	7	ADV551									
				TB2-112				11		A1																	
				TB2-113				14	R2-25	A2	116G300			B9	25	3	7	ADV551									
				TB2-114				11		A1																	
				TB2-115				14	R2-26	A2	116G350			B10	26	3	7	ADV551									
				TB2-116				11		A1																	
				TB2-117				14	R2-27	A2	116G370			B11	27	3	7	ADV551									
				TB2-118				11		A1																	
				TB2-119				14	R2-28	A2	116G550			B12	28	3	7	ADV551									
				TB2-120				11		A1																	
				TB2-121				14	R2-29	A2	116G380			B13	29	3	7	ADV551									
				TB2-122				11		A1																	
				TB2-123				14	R2-30	A2	SV150CT0100			B14	30	3	7	ADV551									
				TB2-124				11		A1																	
				TB2-125				14	R2-31	A2	SV150CT01CO			B15	31	3	7	ADV551									
				TB2-126				11		A1																	
				TB2-127				14	R2-32	A2	119G080			B16	32	3	7	ADV551									
				TB2-128				11		A1																	
																			B17	-	3	7	ADV551				
																	B18	+									

GENERAL DESCRIPTION		DR.	DATE							PROJECT NAME					DWG. NO.	
Panel Wiring Drawing		SHAM	24/10/08							WILMAR SURABAYA FA PROJECT					35-DO	
		CH.	DATE							TITLE					SHT NO	
		IENA	24/10/08							FA-MC PANEL (MC1)					35	
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.					CONT NO		
FA-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002					36		

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC2)			FCU-0101				
			HSC	RTD																
			AI	AO																
			DI	DO																
			IS	NIS																
HART	NON HART																			
SYSTEM I/O																				
					FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model					
				TB3-001	FT111G01	A1	1	2	1	AAI143										
				TB3-002		B1														
				TB3-003	FT111G02	A2	2	2	1	AAI143										
				TB3-004		B2														
				TB3-005	FT111G03	A3	3	2	1	AAI143										
				TB3-006		B3														
				TB3-007	TT90S001	A4	4	2	1	AAI143										
				TB3-008		B4														
				TB3-009	PT19831	A5	5	2	1	AAI143										
				TB3-010		B5														
				TB3-011	TT19831	A6	6	2	1	AAI143										
				TB3-012		B6														
				TB3-013	FT11201	A7	7	2	1	AAI143										
				TB3-014		B7														
				TB3-015	FT11203	A8	8	2	1	AAI143										
				TB3-016		B8														
				TB3-017	LT11201	A9	9	2	1	AAI143										
				TB3-018		B9														
				TB3-019	LT11202	A10	10	2	1	AAI143										
				TB3-020		B10														
				TB3-021	LT11203	A11	11	2	1	AAI143										
				TB3-022		B11														
				TB3-023	LT11204	A12	12	2	1	AAI143										
				TB3-024		B12														
				TB3-025	TT11201	A13	13	2	1	AAI143										
				TB3-026		B13														
				TB3-027	PT19830	A14	14	2	1	AAI143										
				TB3-028		B14														
				TB3-029	TT19830	A15	15	2	1	AAI143										
				TB3-030		B15														
				TB3-031	PT214XE01	A16	16	2	1	AAI143										
				TB3-032		B16														
GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.							
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT		36-AI							
											TITLE		SHT. NO.							
											FA-MC PANEL (MC2)		36							
FILENAME		APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONTD							
FA-PANEL						REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	37							

Signal Type :						Cabinet No : FA-MC PANEL (MC2)					FCU-0101								
											HSC		RTD		SYSTEM I/O				
											AI		AO						
											DI		DO						
IS		NIS																	
HART		NON HART																	
FIELD CABLE			CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model								
					TB3-033	FT11301	A1	1	2	2	AAI143								
					TB3-034		B1												
					TB3-035	FT11302	A2	2	2	2	AAI143								
					TB3-036		B2												
					TB3-037	LT11301	A3	3	2	2	AAI143								
					TB3-038		B3												
					TB3-039	LT11302	A4	4	2	2	AAI143								
					TB3-040		B4												
					TB3-041	PT11301	A5	5	2	2	AAI143								
					TB3-042		B5												
					TB3-043	PT11302	A6	6	2	2	AAI143								
					TB3-044		B6												
					TB3-045	TT11301	A7	7	2	2	AAI143								
					TB3-046		B7												
					TB3-047	TT11302	A8	8	2	2	AAI143								
					TB3-048		B8												
					TB3-049	TT11303	A9	9	2	2	AAI143								
					TB3-050		B9												
					TB3-051	TT11304	A10	10	2	2	AAI143								
					TB3-052		B10												
					TB3-053	TT11305	A11	11	2	2	AAI143								
					TB3-054		B11												
					TB3-055	TT11306	A12	12	2	2	AAI143								
					TB3-056		B12												
					TB3-057	TT11308	A13	13	2	2	AAI143								
					TB3-058		B13												
					TB3-059	SPARE	A14	14	2	2	AAI143								
					TB3-060		B14												
					TB3-061	SPARE	A15	15	2	2	AAI143								
					TB3-062		B15												
					TB3-063	SPARE	A16	16	2	2	AAI143								
					TB3-064		B16												
GENERAL DESCRIPTION			DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.					
Panel Wiring Drawing			CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT		37-AI					
													TITLE		SHT. NO.				
													FA-MC PANEL (MC2)		37				
FILENAME			APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONTD				
FA-PANEL													WSFA-D32-002		38				

Signal Type :				Cabinet No :																		
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>				HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC2)				FCU-0101				
HSC	RTD																					
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
								SYSTEM I/O														
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model													
			TB3-065	FT11401	A1	1	3	1	AAI143													
			TB3-066		B1																	
			TB3-067	FT11402	A2	2	3	1	AAI143													
			TB3-068		B2																	
			TB3-069	LT11401	A3	3	3	1	AAI143													
			TB3-070		B3																	
			TB3-071	LT11402	A4	4	3	1	AAI143													
			TB3-072		B4																	
			TB3-073	PT11401	A5	5	3	1	AAI143													
			TB3-074		B5																	
			TB3-075	PT11402	A6	6	3	1	AAI143													
			TB3-076		B6																	
			TB3-077	PT11403	A7	7	3	1	AAI143													
			TB3-078		B7																	
			TB3-079	PT11404	A8	8	3	1	AAI143													
			TB3-080		B8																	
			TB3-081	PT11405	A9	9	3	1	AAI143													
			TB3-082		B9																	
			TB3-083	PT11406	A10	10	3	1	AAI143													
			TB3-084		B10																	
			TB3-085	PT11407	A11	11	3	1	AAI143													
			TB3-086		B11																	
			TB3-087	TT11401	A12	12	3	1	AAI143													
			TB3-088		B12																	
			TB3-089	TT11402	A13	13	3	1	AAI143													
			TB3-090		B13																	
			TB3-091	TT11403	A14	14	3	1	AAI143													
			TB3-092		B14																	
			TB3-093	TT11404	A15	15	3	1	AAI143													
			TB3-094		B15																	
			TB3-095	TT11405	A16	16	3	1	AAI143													
			TB3-096		B16																	

GENERAL DESCRIPTION Panel Wiring Drawing	DR. SHAM	DATE 24/10/08							PROJECT NAME WILMAR SURABAYA FA PROJECT	DWG. NO. 38-AI
	CH. IENA	DATE 24/10/08							TITLE FA-MC PANEL (MC2)	SHT. NO. 38
FILENAME FA-PANEL	APP. TEOH	DATE 24/10/08	0 REV.	FIRST ISSUE DESCRIPTION	24/10/08 DATE	SHAM DRAWN BY	IENA CHECK BY	TEOH APPR. BY	DOC. NO. WSFA-D32-002	CONTD 39

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC2)					FCU-0101				
			HSC	RTD																		
			AI	AO																		
			DI	DO																		
			IS	NIS																		
HART	NON HART																					
			SYSTEM I/O																			
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model												
				TB3-097	TT11406	A1	1	3	2	AAI143												
				TB3-098		B1																
				TB3-099	TT11407	A2	2	3	2	AAI143												
				TB3-100		B2																
				TB3-101	TT11408	A3	3	3	2	AAI143												
				TB3-102		B3																
				TB3-103	TT11409	A4	4	3	2	AAI143												
				TB3-104		B4																
				TB3-105	TT11410	A5	5	3	2	AAI143												
				TB3-106		B5																
				TB3-107	TT11411	A6	6	3	2	AAI143												
				TB3-108		B6																
				TB3-109	TT11412	A7	7	3	2	AAI143												
				TB3-110		B7																
				TB3-111	TT11413	A8	8	3	2	AAI143												
				TB3-112		B8																
				TB3-113	TT11414	A9	9	3	2	AAI143												
				TB3-114		B9																
				TB3-115	LT11501	A10	10	3	2	AAI143												
				TB3-116		B10																
				TB3-117	TT11501	A11	11	3	2	AAI143												
				TB3-118		B11																
				TB3-119	VT114G55	A12	12	3	2	AAI143												
				TB3-120		B12																
				TB3-121	VT114G02	A13	13	3	2	AAI143												
				TB3-122		B13																
				TB3-123	SPARE	A14	14	3	2	AAI143												
				TB3-124		B14																
		TB3-125	SPARE	A15	15	3	2	AAI143														
		TB3-126		B15																		
		TB3-127	SPARE	A16	16	3	2	AAI143														
		TB3-128		B16																		

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08							PROJECT NAME	DWG. NO.
											WILMAR SURABAYA FA PROJECT	39-AI
	CH.	IENA	DATE	24/10/08							TITLE	SHT. NO.
											FA-MC PANEL (MC2)	39
FILENAME	APP.	TEOH	DATE	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONTD
FA-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	40

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART			Cabinet No : FA-MC PANEL (MC2)					FCU-0101				
			HSC	RTD																				
			AI	AO																				
			DI	DO																				
			IS	NIS																				
HART	NON HART																							
SYSTEM I/O																								
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model														
				TB4-001	FV11103	A1	1	2	3	AAI543														
				TB4-002		B1																		
				TB4-003	LV11101	A2	2	2	3	AAI543														
				TB4-004		B2																		
				TB4-005	LV11103	A3	3	2	3	AAI543														
				TB4-006		B3																		
				TB4-007	LV11104	A4	4	2	3	AAI543														
				TB4-008		B4																		
				TB4-009	LV11105	A5	5	2	3	AAI543														
				TB4-010		B5																		
				TB4-011	LV11106	A6	6	2	3	AAI543														
				TB4-012		B6																		
				TB4-013	LV11107	A7	7	2	3	AAI543														
				TB4-014		B7																		
				TB4-015	PV11102	A8	8	2	3	AAI543														
				TB4-016		B8																		
				TB4-017	TV11101	A9	9	2	3	AAI543														
				TB4-018		B9																		
				TB4-019	TV11106	A10	10	2	3	AAI543														
				TB4-020		B10																		
				TB4-021	TV11105	A11	11	2	3	AAI543														
				TB4-022		B11																		
				TB4-023	TV11104	A12	12	2	3	AAI543														
				TB4-024		B12																		
				TB4-025	TV11103	A13	13	2	3	AAI543														
				TB4-026		B13																		
				TB4-027	TV11110	A14	14	2	3	AAI543														
				TB4-028		B14																		
				TB4-029	LV11D00	A15	15	2	3	AAI543														
				TB4-030		B15																		
				TB4-031	TV11D00	A16	16	2	3	AAI543														
				TB4-032		B16																		

GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT		40-AO
											TITLE		SHT. NO.
											FA-MC PANEL (MC2)		40
FILENAME		APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
FA-PANEL						REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	41

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC2)			FCU-0101					
			HSC	RTD																	
			AI	AO																	
			DI	DO																	
			IS	NIS																	
HART	NON HART																				
SYSTEM I/O																					
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model											
				TB4-033	VFD111G01	A1	1	2	4	AAI543											
				TB4-034		B1															
				TB4-035	VFD111G02	A2	2	2	4	AAI543											
				TB4-036		B2															
				TB4-037	VFD111G03	A3	3	2	4	AAI543											
				TB4-038		B3															
				TB4-039	LIC11901	A4	4	2	4	AAI543											
				TB4-040		B4															
				TB4-041	VFD114G02	A5	5	2	4	AAI543											
				TB4-042		B5															
				TB4-043	VFD114G55	A6	6	2	4	AAI543											
				TB4-044		B6															
				TB4-045	SPARE	A7	7	2	4	AAI543											
				TB4-046		B7															
				TB4-047	SPARE	A8	8	2	4	AAI543											
				TB4-048		B8															
				TB4-049	SPARE	A9	9	2	4	AAI543											
				TB4-050		B9															
				TB4-051	SPARE	A10	10	2	4	AAI543											
				TB4-052		B10															
				TB4-053	SPARE	A11	11	2	4	AAI543											
				TB4-054		B11															
				TB4-055	SPARE	A12	12	2	4	AAI543											
				TB4-056		B12															
				TB4-057	SPARE	A13	13	2	4	AAI543											
				TB4-058		B13															
				TB4-059	SPARE	A14	14	2	4	AAI543											
				TB4-060		B14															
				TB4-061	SPARE	A15	15	2	4	AAI543											
				TB4-062		B15															
				TB4-063	SPARE	A16	16	2	4	AAI543											
				TB4-064		B16															

 | | | | | | | | | | | | | | | | |----------------------|--|------|------|------|----------|--------------|-------------|----------|----------|----------|----------|----------------------------|--|----------| | GENERAL DESCRIPTION | | DR. | SHAM | DATE | 24/10/08 | | | | | | | PROJECT NAME | | DWG. NO. | | Panel Wiring Drawing | | CH. | IENA | DATE | 24/10/08 | | | | | | | WILMAR SURABAYA FA PROJECT | | 41-AO | | | | | | | | | | | | | | TITLE | | SHT. NO. | | | | | | | | | | | | | | FA-MC PANEL (MC2) | | 41 | | FILENAME | | APP. | TEOH | DATE | 24/10/08 | <div>0</div> | FIRST ISSUE | 24/10/08 | SHAM | IENA | TEOH | DOC. NO. | | CONT'D | | FA-PANEL | | | | | | REV. | DESCRIPTION | DATE | DRAWN BY | CHECK BY | APPR. BY | WSFA-D32-002 | | 42 | | | | | | | | | | | | |

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC2)					FCU-0101				
			HSC	RTD																		
			AI	AO																		
			DI	DO																		
			IS	NIS																		
HART	NON HART																					
SYSTEM I/O																						
					FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model							
				TB4-065	LV11203	A1	1	3	3	AAI543												
				TB4-066		B1																
				TB4-067	TV11201	A2	2	3	3	AAI543												
				TB4-068		B2																
				TB4-069	FV11302	A3	3	3	3	AAI543												
				TB4-070		B3																
				TB4-071	LV11301	A4	4	3	3	AAI543												
				TB4-072		B4																
				TB4-073	LV11302	A5	5	3	3	AAI543												
				TB4-074		B5																
				TB4-075	PV11301	A6	6	3	3	AAI543												
				TB4-076		B6																
				TB4-077	FV11401	A7	7	3	3	AAI543												
				TB4-078		B7																
				TB4-079	FV11403	A8	8	3	3	AAI543												
				TB4-080		B8																
				TB4-081	LV11401	A9	9	3	3	AAI543												
				TB4-082		B9																
				TB4-083	PV11402	A10	10	3	3	AAI543												
				TB4-084		B10																
				TB4-085	TV11403	A11	11	3	3	AAI543												
				TB4-086		B11																
				TB4-087	TV11411	A12	12	3	3	AAI543												
				TB4-088		B12																
				TB4-089	TV11414	A13	13	3	3	AAI543												
				TB4-090		B13																
		TB4-091	LV11501	A14	14	3	3	AAI543														
		TB4-092		B14																		
		TB4-093	TV11501	A15	15	3	3	AAI543														
		TB4-094		B15																		
		TB4-095	SPARE	A16	16	3	3	AAI543														
		TB4-096		B16																		
GENERAL DESCRIPTION		DR.	DATE							PROJECT NAME		DWG. NO.										
Panel Wiring Drawing		SHAM	24/10/08							WILMAR SURABAYA FA PROJECT		42-AO										
		CH.	DATE							TITLE		SHT. NO.										
		IENA	24/10/08							FA-MC PANEL (MC2)		42										
FILENAME		APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONTD										
FA-PANEL		TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		43										

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : <	
			HSC	RTD										
			AI	AO										
			DI	DO										
			IS	NIS										
HART	NON HART													

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC2) MCB3-1 0VDC-124VDC-1					FCU-0101				
			HSC	RTD																		
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model												
				TB5-001	LAH11101S	A1	1	2	5	ADV151												
				TB5-002		A17																
				TB5-003	LAH11102S	A2	2	2	5	ADV151												
				TB5-004		A17																
				TB5-005	LAH11103S	A3	3	2	5	ADV151												
				TB5-006		A17																
				TB5-007	LAH11104S	A4	4	2	5	ADV151												
				TB5-008		A17																
				TB5-009	LAH11105S	A5	5	2	5	ADV151												
				TB5-010		A17																
				TB5-011	LAH11201S	A6	6	2	5	ADV151												
				TB5-012		A17																
				TB5-013	LAH11202S	A7	7	2	5	ADV151												
				TB5-014		A17																
				TB5-015	PAH11207S	A8	8	2	5	ADV151												
				TB5-016		A17																
				TB5-017	LAH11401S	A9	9	2	5	ADV151												
				TB5-018		A17																
				TB5-019	LAH11402S	A10	10	2	5	ADV151												
				TB5-020		A17																
				TB5-021	LSAH11403S	A11	11	2	5	ADV151												
				TB5-022		A17																
				TB5-023	LSAL11404S	A12	12	2	5	ADV151												
				TB5-024		A17																
				TB5-025	LAL11405S	A13	13	2	5	ADV151												
				TB5-026		A17																
				TB5-027	LAH11501S	A14	14	2	5	ADV151												
				TB5-028		A17																
				TB5-029	PAH11509S	A15	15	2	5	ADV151												
				TB5-030		A17																
				TB5-031	LSAH11601S	A16	16	2	5	ADV151												
				TB5-032		A17																

 | | | | | | | | | | | | | | | |---|------|------|------|----------|------|-------------|----------|----------|----------|----------|---------------------------|--|----------| | GENERAL DESCRIPTION
Panel Wiring Drawing | DR. | SHAM | DATE | 24/10/08 | | | | | | | PROJECT NAME | | DWG. NO. | | | | | | | | | | | | | WILMAR SURABAY FA PROJECT | | 44-DI | | | CH. | IENA | DATE | 24/10/08 | | | | | | | TITLE | | SHT. NO. | | | | | | | | | | | | | FA-MC PANEL(MC2) | | 44 | | FILENAME
FA-PANEL | APP. | TEOH | DATE | 24/10/08 | 0 | FIRST ISSUE | 24/10/08 | SHAM | IENA | TEOH | DOC. NO. | | CONT'D | | | | | | | REV. | DESCRIPTION | DATE | DRAWN BY | CHECK BY | APPR. BY | WSFA-D32-002 | | 45 | | | | | | | | | | | | | | |

Signal Type :			Cabinet No :																			
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC2)						FCU-0101			
HSC	RTD																					
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
			MCB3-1																			
			0VDC-1 24VDC-1						SYSTEM I/O													
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model											
				TB5-033	LAL11602S		B1	17	2	5	ADV151											
				TB5-034			B17															
				TB5-035	LAH11603S		B2	18	2	5	ADV151											
				TB5-036			B17															
				TB5-037	LAH11604S		B3	19	2	5	ADV151											
				TB5-038			B17															
				TB5-039	LAH11605S		B4	20	2	5	ADV151											
				TB5-040			B17															
				TB5-041	LAH11606S		B5	21	2	5	ADV151											
				TB5-042			B17															
				TB5-043	LAL11607S		B6	22	2	5	ADV151											
				TB5-044			B17															
				TB5-045	FCS0101PSU1S		B7	23	2	5	ADV151											
				TB5-046			B17															
				TB5-047	FCS0101PSU2S		B8	24	2	5	ADV151											
				TB5-048			B17															
				TB5-049	LS50WW2S		B9	25	2	5	ADV151											
				TB5-050			B17															
				TB5-051	SPARE		B10	26	2	5	ADV151											
				TB5-052			B17															
				TB5-053	SPARE		B11	27	2	5	ADV151											
				TB5-054			B17															
				TB5-055	SV150CT01OI		B12	28	2	5	ADV151											
				TB5-056			B17															
				TB5-057	SV150CT01CI		B13	29	2	5	ADV151											
				TB5-058			B17															
				TB5-059	LAH11901S		B14	30	2	5	ADV151											
				TB5-060			B17															
				TB5-061	LSAL11902S		B15	31	2	5	ADV151											
				TB5-062			B17															
				TB5-063	SPARE		B16	32	2	5	ADV151											
				TB5-064			B17															

GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08					PROJECT NAME		DWG. NO.
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08					WILMAR SURABAY FA PROJECT		45-DI
TITLE		SHT. NO.										
										FA-MC PANEL(MC2)		45
FILENAME	APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
FA-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	46

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC2) MCB3-2 0VDC-224VDC-2					FCU-0101				
			HSC	RTD																		
			AI	AO																		
			DI	DO																		
			IS	NIS																		
HART	NON HART																					
SYSTEM I/O																						
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model												
				TB5-065	NV11101OI	A1	1	2	6	ADV151												
				TB5-066		A17																
				TB5-067	NV11101CI	A2	2	2	6	ADV151												
				TB5-068		A17																
				TB5-069	NV11102OI	A3	3	2	6	ADV151												
				TB5-070		A17																
				TB5-071	NV11102CI	A4	4	2	6	ADV151												
				TB5-072		A17																
				TB5-073	KV11401OI	A5	5	2	6	ADV151												
				TB5-074		A17																
				TB5-075	KV11401CI	A6	6	2	6	ADV151												
				TB5-076		A17																
				TB5-077	KV11402OI	A7	7	2	6	ADV151												
				TB5-078		A17																
				TB5-079	KV11402CI	A8	8	2	6	ADV151												
				TB5-080		A17																
				TB5-081	KV11601OI	A9	9	2	6	ADV151												
				TB5-082		A17																
				TB5-083	KV11601CI	A10	10	2	6	ADV151												
				TB5-084		A17																
				TB5-085	KV11602OI	A11	11	2	6	ADV151												
				TB5-086		A17																
				TB5-087	KV11602CI	A12	12	2	6	ADV151												
				TB5-088		A17																
				TB5-089	LAL15001LS	A13	13	2	6	ADV151												
				TB5-090		A17																
				TB5-091	LSLA116F07S	A14	14	2	6	ADV151												
				TB5-092		A17																
				TB5-093	LSHA116F07S	A15	15	2	6	ADV151												
				TB5-094		A17																
				TB5-095	SPARE	A16	16	2	6	ADV151												
				TB5-096		A17																

 | | | | | | | | | | | | | | | |--|------|------|------|----------|--------------|-------------|----------|----------|----------|----------|---------------------------|-------|----------| | GENERAL DESCRIPTION

Panel Wiring

Drawing | DR. | SHAM | DATE | 24/10/08 | | | | | | | PROJECT NAME | | DWG. NO. | | | | | | | | | | | | | WILMAR SURABAY FA PROJECT | | 46-DI | | | CH. | IENA | DATE | 24/10/08 | | | | | | | | TITLE | | | FILENAME | APP. | TEOH | DATE | 24/10/08 | <div>0</div> | FIRST ISSUE | 24/10/08 | SHAM | IENA | TEOH | DOC. NO. | | CONT'D | | FA-PANEL | | | | | REV. | DESCRIPTION | DATE | DRAWN BY | CHECK BY | APPR. BY | WSFA-D32-002 | | 47 | | | | | | | | | | | | | | |

Signal Type :			Cabinet No :																			
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC2)					FCU-0101				
HSC	RTD																					
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
			MCB3-2																			
			0VDC-2 24VDC-2					SYSTEM I/O														
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model													
			TB5-097	SPARE	B1	17	2	6	ADV151													
			TB5-098		B17																	
			TB5-099	SPARE	B2	18	2	6	ADV151													
			TB5-100		B17																	
			TB5-101	SPARE	B3	19	2	6	ADV151													
			TB5-102		B17																	
			TB5-103	SPARE	B4	20	2	6	ADV151													
			TB5-104		B17																	
			TB5-105	SPARE	B5	21	2	6	ADV151													
			TB5-106		B17																	
			TB5-107	116G07STI	B6	22	2	6	ADV151													
			TB5-108		B17																	
			TB5-109	116G07TRI	B7	23	2	6	ADV151													
			TB5-110		B17																	
			TB5-111	119G08STI	B8	24	2	6	ADV151													
			TB5-112		B17																	
			TB5-113	119G08TRI	B9	25	2	6	ADV151													
			TB5-114		B17																	
			TB5-115	SPARE	B10	26	2	6	ADV151													
			TB5-116		B17																	
			TB5-117	116G37STI	B11	27	2	6	ADV151													
			TB5-118		B17																	
			TB5-119	116G37TRI	B12	28	2	6	ADV151													
			TB5-120		B17																	
			TB5-121	116G38STI	B13	29	2	6	ADV151													
			TB5-122		B17																	
			TB5-123	116G38TRI	B14	30	2	6	ADV151													
			TB5-124		B17																	
		TB5-125	116G55STI	B15	31	2	6	ADV151														
		TB5-126		B17																		
		TB5-127	116G55TRI	B16	32	2	6	ADV151														
		TB5-128		B17																		

GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08					PROJECT NAME		DWG. NO.
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08					WILMAR SURABAY FA PROJECT		47-DI
FILENAME		APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	SHT. NO.
FA-PANEL						REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	47
										FA-MC PANEL(MC2)		CONT'D
										WSFA-D32-002		48

Signal Type :			Cabinet No :																			
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC2)					FCU-0101				
HSC	RTD																					
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
			MCB3-3																			
			0VDC-3 24VDC-3					SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model											
				TB5-129	111G01STI		A1	1	3	5	ADV151											
				TB5-130			A17															
				TB5-131	111G01TRI		A2	2	3	5	ADV151											
				TB5-132			A17															
				TB5-133	111G02STI		A3	3	3	5	ADV151											
				TB5-134			A17															
				TB5-135	111G02TRI		A4	4	3	5	ADV151											
				TB5-136			A17															
				TB5-137	111G03STI		A5	5	3	5	ADV151											
				TB5-138			A17															
				TB5-139	111G03TRI		A6	6	3	5	ADV151											
				TB5-140			A17															
				TB5-141	111G04STI		A7	7	3	5	ADV151											
				TB5-142			A17															
				TB5-143	111G04TRI		A8	8	3	5	ADV151											
				TB5-144			A17															
				TB5-145	111G05STI		A9	9	3	5	ADV151											
				TB5-146			A17															
				TB5-147	111G05TRI		A10	10	3	5	ADV151											
				TB5-148			A17															
				TB5-149	111G07STI		A11	11	3	5	ADV151											
				TB5-150			A17															
				TB5-151	111G07TRI		A12	12	3	5	ADV151											
				TB5-152			A17															
				TB5-153	111G08STI		A13	13	3	5	ADV151											
				TB5-154			A17															
				TB5-155	111G08TRI		A14	14	3	5	ADV151											
				TB5-156			A17															
				TB5-157	111G09STI		A15	15	3	5	ADV151											
				TB5-158			A17															
				TB5-159	111G09TRI		A16	16	3	5	ADV151											
				TB5-160			A17															
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.											
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAY FA PROJECT		48-DI											
		CH.	IENA	24/10/08					TITLE		SHT. NO.											
									FA-MC PANEL(MC2)		48											
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D											
FA-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		49											

Signal Type :			Cabinet No :																			
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC2)					FCU-0101				
HSC	RTD																					
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
			MCB3-3																			
			0VDC-3 24VDC-3					SYSTEM I/O														
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model													
			TB5-161	111G55STI	B1	17	3	5	ADV151													
			TB5-162		B17																	
			TB5-163	111G55TRI	B2	18	3	5	ADV151													
			TB5-164		B17																	
			TB5-165	112G01STI	B3	19	3	5	ADV151													
			TB5-166		B17																	
			TB5-167	112G01TRI	B4	20	3	5	ADV151													
			TB5-168		B17																	
			TB5-169	112G02STI	B5	21	3	5	ADV151													
			TB5-170		B17																	
			TB5-171	112G02TRI	B6	22	3	5	ADV151													
			TB5-172		B17																	
			TB5-173	112G03STI	B7	23	3	5	ADV151													
			TB5-174		B17																	
			TB5-175	112G03TRI	B8	24	3	5	ADV151													
			TB5-176		B17																	
			TB5-177	112G06ASTI	B9	25	3	5	ADV151													
			TB5-178		B17																	
			TB5-179	112G06ATRI	B10	26	3	5	ADV151													
			TB5-180		B17																	
			TB5-181	112G06BSTI	B11	27	3	5	ADV151													
			TB5-182		B17																	
			TB5-183	112G06BTRI	B12	28	3	5	ADV151													
			TB5-184		B17																	
			TB5-185	112G08STI	B13	29	3	5	ADV151													
			TB5-186		B17																	
			TB5-187	112G08TRI	B14	30	3	5	ADV151													
			TB5-188		B17																	
		TB5-189	SPARE	B15	31	3	5	ADV151														
		TB5-190		B17																		
		TB5-191	SPARE	B16	32	3	5	ADV151														
		TB5-192		B17																		

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08						PROJECT NAME	WILMAR SURABAY FA PROJECT	DWG. NO.	49-DI	
	CH.	IENA	DATE	24/10/08						TITLE	FA-MC PANEL(MC2)	SHT. NO.	49	
FILENAME	APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	WSFA-D32-002	CONT'D	50
FA-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY				

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC2) MCB3-4 0VDC-424VDC-4					FCU-0101				
			HSC	RTD																		
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
SYSTEM I/O																						
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model											
				TB5-193	113G02STI		A1	1	3	6	ADV151											
				TB5-194			A17															
				TB5-195	113G02TRI		A2	2	3	6	ADV151											
				TB5-196			A17															
				TB5-197	113G03STI		A3	3	3	6	ADV151											
				TB5-198			A17															
				TB5-199	113G03TRI		A4	4	3	6	ADV151											
				TB5-200			A17															
				TB5-201	113G55STI		A5	5	3	6	ADV151											
				TB5-202			A17															
				TB5-203	113G55TRI		A6	6	3	6	ADV151											
				TB5-204			A17															
				TB5-205	SPARE		A7	7	3	6	ADV151											
				TB5-206			A17															
				TB5-207	SPARE		A8	8	3	6	ADV151											
				TB5-208			A17															
				TB5-209	114G55STI		A9	9	3	6	ADV151											
				TB5-210			A17															
				TB5-211	114G55TRI		A10	10	3	6	ADV151											
				TB5-212			A17															
				TB5-213	114G03STI		A11	11	3	6	ADV151											
				TB5-214			A17															
				TB5-215	114G03TRI		A12	12	3	6	ADV151											
				TB5-216			A17															
		TB5-217	114G04STI		A13	13	3	6	ADV151													
		TB5-218			A17																	
		TB5-219	114G04TRI		A14	14	3	6	ADV151													
		TB5-220			A17																	
		TB5-221	114G05STI		A15	15	3	6	ADV151													
		TB5-222			A17																	
		TB5-223	114G05TRI		A16	16	3	6	ADV151													
		TB5-224			A17																	

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.
										WILMAR SURABAYA FA PROJECT		50-DI
	CH.	IENA	DATE	24/10/08						TITLE		SHT. NO.
										FA-MC PANEL(MC2)		50
FILENAME FA-PANEL	APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	51

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC2) MCB3-4 0VDC-4 24VDC-4			FCU-0101 SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model											
			TB5-225	114G07STI	B1	17	3	6	ADV151											
			TB5-226		B17															
			TB5-227	114G07TRI	B2	18	3	6	ADV151											
			TB5-228		B17															
			TB5-229	114G10STI	B3	19	3	6	ADV151											
			TB5-230		B17															
			TB5-231	114G10TRI	B4	20	3	6	ADV151											
			TB5-232		B17															
			TB5-233	114G30STI	B5	21	3	6	ADV151											
			TB5-234		B17															
			TB5-235	114G30TRI	B6	22	3	6	ADV151											
			TB5-236		B17															
			TB5-237	114G02STI	B7	23	3	6	ADV151											
			TB5-238		B17															
			TB5-239	114G02TRI	B8	24	3	6	ADV151											
			TB5-240		B17															
			TB5-241	SPARE	B9	25	3	6	ADV151											
			TB5-242		B17															
			TB5-243	SPARE	B10	26	3	6	ADV151											
			TB5-244		B17															
			TB5-245	115G09STI	B11	27	3	6	ADV151											
			TB5-246		B17															
			TB5-247	115G09TRI	B12	28	3	6	ADV151											
			TB5-248		B17															
			TB5-249	115G14STI	B13	29	3	6	ADV151											
			TB5-250		B17															
			TB5-251	115G14TRI	B14	30	3	6	ADV151											
			TB5-252		B17															
			TB5-253	SPARE	B15	31	3	6	ADV151											
			TB5-254		B17															
		TB5-255	SPARE	B16	32	3	6	ADV151												
		TB5-256		B17																
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME	DWG. NO.										
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT	51-DI										
		CH.	IENA	DATE						TITLE	SHT. NO.									
			24/10/08						FA-MC PANEL(MC2)	51										
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D										
FA-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	52										

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC3)			FCU-0101 SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model											
			TB6-001	FT11605	A1	1	4	1	AAI143											
			TB6-002		B1															
			TB6-003	FT11606	A2	2	4	1	AAI143											
			TB6-004		B2															
			TB6-005	FT11607	A3	3	4	1	AAI143											
			TB6-006		B3															
			TB6-007	FT11608	A4	4	4	1	AAI143											
			TB6-008		B4															
			TB6-009	FT11609	A5	5	4	1	AAI143											
			TB6-010		B5															
			TB6-011	FT11610	A6	6	4	1	AAI143											
			TB6-012		B6															
			TB6-013	LT11601	A7	7	4	1	AAI143											
			TB6-014		B7															
			TB6-015	LT11602	A8	8	4	1	AAI143											
			TB6-016		B8															
			TB6-017	LT11603	A9	9	4	1	AAI143											
			TB6-018		B9															
			TB6-019	LT11604	A10	10	4	1	AAI143											
			TB6-020		B10															
			TB6-021	LT11605	A11	11	4	1	AAI143											
			TB6-022		B11															
			TB6-023	LT11106	A12	12	4	1	AAI143											
			TB6-024		B12															
			TB6-025	LT11607	A13	13	4	1	AAI143											
			TB6-026		B13															
			TB6-027	LT11608	A14	14	4	1	AAI143											
			TB6-028		B14															
			TB6-029	LT11609	A15	15	4	1	AAI143											
			TB6-030		B15															
			TB6-031	PT250CT01	A16	16	4	1	AAI143											
			TB6-032		B16															
GENERAL DESCRIPTION Panel Wiring Drawing	DR. SHAM	DATE 24/10/08							PROJECT NAME WILMAR SURABAYA FA PROJECT	DWG. NO. 52-AI										
	CH. IENA	DATE 24/10/08							TITLE FA-MC PANEL (MC3)	SHT. NO. 52										
FILENAME FA-PANEL	APP. TEOH	DATE 24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO. WSFA-D32-002	CONTD 53										
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY												

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC3)				FCU-0101				
HSC	RTD																				
AI	AO																				
DI	DO																				
IS	NIS																				
HART	NON HART																				
				SYSTEM I/O																	
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model												
			TB6-033	PT11601	A1	1	4	2	AAI143												
			TB6-034		B1																
			TB6-035	PT11602	A2	2	4	2	AAI143												
			TB6-036		B2																
			TB6-037	PT11603	A3	3	4	2	AAI143												
			TB6-038		B3																
			TB6-039	PT11604	A4	4	4	2	AAI143												
			TB6-040		B4																
			TB6-041	PT11605	A5	5	4	2	AAI143												
			TB6-042		B5																
			TB6-043	PT11606	A6	6	4	2	AAI143												
			TB6-044		B6																
			TB6-045	TT11601	A7	7	4	2	AAI143												
			TB6-046		B7																
			TB6-047	TT11602	A8	8	4	2	AAI143												
			TB6-048		B8																
			TB6-049	TT11603	A9	9	4	2	AAI143												
			TB6-050		B9																
			TB6-051	TT11604	A10	10	4	2	AAI143												
			TB6-052		B10																
			TB6-053	TT11605	A11	11	4	2	AAI143												
			TB6-054		B11																
			TB6-055	TT11606	A12	12	4	2	AAI143												
			TB6-056		B12																
			TB6-057	TT11608	A13	13	4	2	AAI143												
			TB6-058		B13																
			TB6-059	TT11609	A14	14	4	2	AAI143												
			TB6-060		B14																
			TB6-061	TT11610	A15	15	4	2	AAI143												
			TB6-062		B15																
			TB6-063	TT11611	A16	16	4	2	AAI143												
			TB6-064		B16																
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.										
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		53-AI										
		CH.	DATE						TITLE		SHT. NO.										
		IENA	24/10/08						FA-MC PANEL (MC3)		53										
FILENAME	APP.	DATE		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D										
FA-PANEL	TEOH	24/10/08		REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		54									

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC3)				FCU-0101				
HSC	RTD																				
AI	AO																				
DI	DO																				
IS	NIS																				
HART	NON HART																				
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	SYSTEM I/O																	
				TB	Tag No.	Term.	Channel	Node	Slot	Model											
				TB6-065	TT11612	A1	1	4	3	AAI143											
				TB6-066		B1															
				TB6-067	TT11613	A2	2	4	3	AAI143											
				TB6-068		B2															
				TB6-069	TT11614	A3	3	4	3	AAI143											
				TB6-070		B3															
				TB6-071	TT11615	A4	4	4	3	AAI143											
				TB6-072		B4															
				TB6-073	TT11616	A5	5	4	3	AAI143											
				TB6-074		B5															
				TB6-075	TT11617	A6	6	4	3	AAI143											
				TB6-076		B6															
				TB6-077	TT11618	A7	7	4	3	AAI143											
				TB6-078		B7															
				TB6-079	TT11619	A8	8	4	3	AAI143											
				TB6-080		B8															
				TB6-081	TT11620	A9	9	4	3	AAI143											
				TB6-082		B9															
				TB6-083	TT11621	A10	10	4	3	AAI143											
				TB6-084		B10															
				TB6-085	TT11622	A11	11	4	3	AAI143											
				TB6-086		B11															
				TB6-087	QT11601	A12	12	4	3	AAI143											
				TB6-088		B12															
				TB6-089	QT11602	A13	13	4	3	AAI143											
				TB6-090		B13															
				TB6-091	PT90S002	A14	14	4	3	AAI143											
				TB6-092		B14															
				TB6-093	PT90S004	A15	15	4	3	AAI143											
				TB6-094		B15															
				TB6-095	PR21404	A16	16	4	3	AAI143											
				TB6-096		B16															

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		54-AI
		CH.	DATE						TITLE		SHT. NO.
		IENA	24/10/08						FA-MC PANEL (MC3)		54
FILENAME	APP.	DATE		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D
FA-PANEL	TEOH	24/10/08		REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC3)					FCU-0101				
			HSC	RTD																		
			AI	AO																		
			DI	DO																		
			IS	NIS																		
HART	NON HART																					
SYSTEM I/O																						
					FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model							
				TB6-097	PT90S001	A1	1	5	1	AAI143												
				TB6-098		B1																
				TB6-099	PT150CT01	A2	2	5	1	AAI143												
				TB6-100		B2																
				TB6-101	FT90S001	A3	3	5	1	AAI143												
				TB6-102		B3																
				TB6-103	FT90S002	A4	4	5	1	AAI143												
				TB6-104		B4																
				TB6-105	FT90S003	A5	5	5	1	AAI143												
				TB6-106		B5																
				TB6-107	FT90S004	A6	6	5	1	AAI143												
				TB6-108		B6																
				TB6-109	FT90S005	A7	7	5	1	AAI143												
				TB6-110		B7																
				TB6-111	FT90S006	A8	8	5	1	AAI143												
				TB6-112		B8																
				TB6-113	TT150CT01S	A9	9	5	1	AAI143												
				TB6-114		B9																
				TB6-115	TT150CT01R	A10	10	5	1	AAI143												
				TB6-116		B10																
				TB6-117	FT150CT01	A11	11	5	1	AAI143												
				TB6-118		B11																
				TB6-119	LT11D00	A12	12	5	1	AAI143												
				TB6-120		B12																
				TB6-121	TT11D00	A13	13	5	1	AAI143												
				TB6-122		B13																
				TB6-123	FT90S007	A14	14	5	1	AAI143												
				TB6-124		B14																
		TB6-125	PT90S009	A15	15	5	1	AAI143														
		TB6-126		B15																		
		TB6-127	FT90S009	A16	16	5	1	AAI143														
		TB6-128		B16																		
GENERAL DESCRIPTION		DR.	DATE							PROJECT NAME		DWG. NO.										
Panel Wiring Drawing		SHAM	24/10/08							WILMAR SURABAYA FA PROJECT		55-AI										
		CH.	DATE							TITLE		SHT. NO.										
		IENA	24/10/08							FA-MC PANEL (MC3)		55										
FILENAME	APP.	DATE		0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D										
FA-PANEL	TEOH	24/10/08		REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		56										

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC3)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
			MCB3-5																				
			0VDC-5 24VDC-5						SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model												
				TB7-001	116G02STI		A1	1	4	5	ADV151												
			TB7-002	A17																			
				TB7-003	116G02TRI		A2	2	4	5	ADV151												
			TB7-004	A17																			
				TB7-005	116G03STI		A3	3	4	5	ADV151												
			TB7-006	A17																			
				TB7-007	116G03TRI		A4	4	4	5	ADV151												
			TB7-008	A17																			
				TB7-009	116G06STI		A5	5	4	5	ADV151												
			TB7-010	A17																			
				TB7-011	116G06TRI		A6	6	4	5	ADV151												
			TB7-012	A17																			
				TB7-013	116G10STI		A7	7	4	5	ADV151												
			TB7-014	A17																			
				TB7-015	116G10TRI		A8	8	4	5	ADV151												
			TB7-016	A17																			
				TB7-017	116G11STI		A9	9	4	5	ADV151												
			TB7-018	A17																			
				TB7-019	116G11TRI		A10	10	4	5	ADV151												
			TB7-020	A17																			
				TB7-021	116G15STI		A11	11	4	5	ADV151												
			TB7-022	A17																			
				TB7-023	116G15TRI		A12	12	4	5	ADV151												
			TB7-024	A17																			
				TB7-025	116G16STI		A13	13	4	5	ADV151												
			TB7-026	A17																			
				TB7-027	116G16TRI		A14	14	4	5	ADV151												
			TB7-028	A17																			
				TB7-029	116G17STI		A15	15	4	5	ADV151												
			TB7-030	A17																			
				TB7-031	116G17TRI		A16	16	4	5	ADV151												
			TB7-032	A17																			
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.												
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		56-DI												
		CH.	IENA	DATE					TITLE		SHT. NO.												
			24/10/08						FA-MC PANEL (MC3)		56												
FILENAME		APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D											
FA-PANEL		TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		57											

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC1)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
			MCB3-5																				
			0VDC-5 24VDC-5						SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.			Term.	Channel	Node	Slot	Model											
				TB7-033	116G18STI			B1	17	4	5	ADV151											
				TB7-034				B17															
				TB7-035	116G18TRI			B2	18	4	5	ADV151											
				TB7-036				B17															
				TB7-037	116G20STI			B3	19	4	5	ADV151											
				TB7-038				B17															
				TB7-039	116G20TRI			B4	20	4	5	ADV151											
				TB7-040				B17															
				TB7-041	116G21ASTI			B5	21	4	5	ADV151											
				TB7-042				B17															
				TB7-043	116G21ATRI			B6	22	4	5	ADV151											
				TB7-044				B17															
				TB7-045	116G21BSTI			B7	23	4	5	ADV151											
				TB7-046				B17															
				TB7-047	116G21BTRI			B8	24	4	5	ADV151											
				TB7-048				B17															
				TB7-049	116G23STI			B9	25	4	5	ADV151											
				TB7-050				B17															
				TB7-051	116G23TRI			B10	26	4	5	ADV151											
				TB7-052				B17															
				TB7-053	116G24STI			B11	27	4	5	ADV151											
				TB7-054				B17															
				TB7-055	116G24TRI			B12	28	4	5	ADV151											
				TB7-056				B17															
				TB7-057	116G30STI			B13	29	4	5	ADV151											
				TB7-058				B17															
				TB7-059	116G30TRI			B14	30	4	5	ADV151											
				TB7-060				B17															
				TB7-061	116G35STI			B15	31	4	5	ADV151											
				TB7-062				B17															
				TB7-063	116G35TRI			B16	32	4	5	ADV151											
				TB7-064				B17															

GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08					PROJECT NAME		DWG. NO.
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08					WILMAR SURABAYA FA PROJECT		57-DI
FILENAME		APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	TITLE
FA-PANEL						REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	FA-MC PANEL (MC3)
												WSFA-D32-002
												57
												58

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : 		
			HSC	RTD											
			AI	AO											
			DI	DO											
			IS	NIS											
HART	NON HART														

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC3)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
									SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model													
				TB8-033	SPARE	A1	1	5	2	AAI543													
				TB8-034		B1																	
				TB8-035	SPARE	A2	2	5	2	AAI543													
				TB8-036		B2																	
				TB8-037	SPARE	A3	3	5	2	AAI543													
				TB8-038		B3																	
				TB8-039	SPARE	A4	4	5	2	AAI543													
				TB8-040		B4																	
				TB8-041	SPARE	A5	5	5	2	AAI543													
				TB8-042		B5																	
				TB8-043	SPARE	A6	6	5	2	AAI543													
				TB8-044		B6																	
				TB8-045	SPARE	A7	7	5	2	AAI543													
				TB8-046		B7																	
				TB8-047	SPARE	A8	8	5	2	AAI543													
				TB8-048		B8																	
				TB8-049	SPARE	A9	9	5	2	AAI543													
				TB8-050		B9																	
				TB8-051	SPARE	A10	10	5	2	AAI543													
				TB8-052		B10																	
				TB8-053	SPARE	A11	11	5	2	AAI543													
				TB8-054		B11																	
				TB8-055	SPARE	A12	12	5	2	AAI543													
				TB8-056		B12																	
				TB8-057	SPARE	A13	13	5	2	AAI543													
				TB8-058		B13																	
				TB8-059	SPARE	A14	14	5	2	AAI543													
				TB8-060		B14																	
				TB8-061	SPARE	A15	15	5	2	AAI543													
				TB8-062		B15																	
				TB8-063	SPARE	A16	16	5	2	AAI543													
				TB8-064		B16																	
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.												
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		59-AO												
		CH.	DATE						TITLE		SHT. NO.												
		IENA	24/10/08						FA-MC PANEL (MC3)		59												
FILENAME		APP.	DATE						DOC. NO.		CONTD												
FA-PANEL		TEOH	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	WSFA-D32-002		60											
				REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY														

Signal Type :			Cabinet No :	TF-MC PANEL (MC1)										FCU-0101																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC												RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART		SYSTEM I/O																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																										
HSC	RTD																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																	
AI	AO																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																	
DI	DO																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																	
IS	NIS																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																	
HART	NON HART																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																	
																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																		</

Signal Type :			Cabinet No :		TF-MC PANEL (MC1)										FCU-0101				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC													RTD	AI	AO	DI	DO
HSC	RTD																		
AI	AO																		
DI	DO																		
IS	NIS																		
HART	NON HART																		
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	MCB6-9		24VDC-9		24VDC-13		OVDC-13		Term.	Channel	NODE	SLOT	MODEL			
				TB12-033			14	R6-17	A2	AG901802O		B1	17	6	7	ADV551			
				TB12-034			11		A1										
				TB12-035			14	R6-18	A2	AG901803O		B2	18	6	7	ADV551			
				TB12-036			11		A1										
				TB12-037			14	R6-19	A2	AG901804O		B3	19	6	7	ADV551			
				TB12-038			11		A1										
				TB12-039			14	R6-20	A2	AG901805O		B4	20	6	7	ADV551			
				TB12-040			11		A1										
				TB12-041			14	R6-21	A2	AG901806O		B5	21	6	7	ADV551			
				TB12-042			11		A1										
				TB12-043			14	R6-22	A2	AG91901AO		B6	22	6	7	ADV551			
				TB12-044			11		A1										
				TB12-045			14	R6-23	A2	AG91901BO		B7	23	6	7	ADV551			
				TB12-046			11		A1										
				TB12-047			14	R6-24	A2	AG91902AO		B8	24	6	7	ADV551			
				TB12-048			11		A1										
				TB12-049			14	R6-25	A2	AG91902BO		B9	25	6	7	ADV551			
				TB12-050			11		A1										
				TB12-051			14	R6-26	A2	AG91903AO		B10	26	6	7	ADV551			
				TB12-052			11		A1										
				TB12-053			14	R6-27	A2	AG91903BO		B11	27	6	7	ADV551			
				TB12-054			11		A1										
				TB12-055			14	R6-28	A2	AG91904AO		B12	28	6	7	ADV551			
				TB12-056			11		A1										
				TB12-057			14	R6-29	A2	AG91904BO		B13	29	6	7	ADV551			
				TB12-058			11		A1										
				TB12-059			14	R6-30	A2	AG91907AO		B14	30	6	7	ADV551			
				TB12-060			11		A1										
				TB12-061			14	R6-31	A2	AG91907BO		B15	31	6	7	ADV551			
				TB12-062			11		A1										
				TB12-063			14	R6-32	A2	AG91908AO		B16	32	6	7	ADV551			
				TB12-064			11		A1										
														B17	-	6	7	ADV551	
														B18	+				

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME					DWG. NO.	
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT					61-DO	
		CH.	DATE						TITLE					SHT NO	
		IENA	24/10/08						TF-MC PANEL (MC1)					61	
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.					CONT NO	
FA-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002					62	

Signal Type :			Cabinet No :										FCU-0101														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC1)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
MCB6-10																											

Signal Type :		Cabinet No :										FCU-0101														
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>		HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC1)										SYSTEM I/O				
HSC	RTD																									
AI	AO																									
DI	DO																									
IS	NIS																									
HART	NON HART																									
		MCB6-10					MCB6-14																			
		OVDC-10					24VDC-10					24VDC-14					OVDC-14									
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB				IP-R		Tag No.		Term.	Channel	NODE	SLOT	MODEL										
				TB13-033				14	R3-17	A2	P901800BO	B1	17	7	6	ADV551										
				TB13-034				11		A1																
				TB13-035				14	R3-18	A2	P9018002O	B2	18	7	6	ADV551										
				TB13-036				11		A1																
				TB13-037				14	R3-19	A2	P901804AO	B3	19	7	6	ADV551										
				TB13-038				11		A1																
				TB13-039				14	R3-20	A2	P901804BO	B4	20	7	6	ADV551										
				TB13-040				11		A1																
				TB13-041				14	R3-21	A2	P9018005O	B5	21	7	6	ADV551										
				TB13-042				11		A1																
				TB13-043				14	R3-22	A2	P91901O	B6	22	7	6	ADV551										
				TB13-044				11		A1																
				TB13-045				14	R3-23	A2	P91903O	B7	23	7	6	ADV551										
				TB13-046				11		A1																
				TB13-047				14	R3-24	A2	P91905O	B8	24	7	6	ADV551										
				TB13-048				11		A1																
				TB13-049				14	R3-25	A2	P91907O	B9	25	7	6	ADV551										
				TB13-050				11		A1																
				TB13-051				14	R3-26	A2	P901601O	B10	26	7	6	ADV551										
				TB13-052				11		A1																
				TB13-053				14	R3-27	A2	P901604O	B11	27	7	6	ADV551										
				TB13-054				11		A1																
				TB13-055				14	R3-28	A2	P901607O	B12	28	7	6	ADV551										
				TB13-056				11		A1																
				TB13-057				14	R3-29	A2	P901608O	B13	29	7	6	ADV551										
				TB13-058				11		A1																
				TB13-059				14	R3-30	A2	P901609O	B14	30	7	6	ADV551										
				TB13-060				11		A1																
				TB13-061				14	R3-31	A2	P901611O	B15	31	7	6	ADV551										
				TB13-062				11		A1																
				TB13-063				14	R3-32	A2	P901612O	B16	32	7	6	ADV551										
				TB13-064				11		A1																
												B17	-	7	6	ADV551										
												B18	+													

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		63-DO
		CH.	DATE						TITLE		SHT NO
		IENA	24/10/08						TF-MC PANEL (MC1)		63
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT NO
TF-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		64

Signal Type :			Cabinet No :										FCU-0101														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC1)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
			MCB6-11		24VDC-11		24VDC-15		OVDC-15																		
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB			IP-R		Tag No.		Term.	Channel	NODE	SLOT	MODEL													
			TB13-065			14	R4-1	A2	150AD01O	A1	1	8	7	ADV551													
			TB13-066			11		A1																			
			TB13-067			14	R4-2	A2	150AD02O	A2	2	8	7	ADV551													
			TB13-068			11		A1																			
			TB13-069			14	R4-3	A2	150N2G1O	A3	3	8	7	ADV551													
			TB13-070			11		A1																			
			TB13-071			14	R4-4	A2	SPARE	A4	4	8	7	ADV551													
			TB13-072			11		A1																			
			TB13-073			14	R4-5	A2	FN150CT01AO	A5	5	8	7	ADV551													
			TB13-074			11		A1																			
			TB13-075			14	R4-6	A2	FN150CT01BO	A6	6	8	7	ADV551													
			TB13-076			11		A1																			
			TB13-077			14	R4-7	A2	FN150CT01CO	A7	7	8	7	ADV551													
			TB13-078			11		A1																			
			TB13-079			14	R4-8	A2	FN150CT01DO	A8	8	8	7	ADV551													
			TB13-080			11		A1																			
			TB13-081			14	R4-9	A2	FN150CT01EO	A9	9	8	7	ADV551													
			TB13-082			11		A1																			
			TB13-083			14	R4-10	A2	FN150CT01FO	A10	10	8	7	ADV551													
			TB13-084			11		A1																			
			TB13-085			14	R4-11	A2	SPARE	A11	11	8	7	ADV551													
			TB13-086			11		A1																			
			TB13-087			14	R4-12	A2	FN150CT02BO	A12	12	8	7	ADV551													
			TB13-088			11		A1																			
			TB13-089			14	R4-13	A2	SPARE	A13	13	8	7	ADV551													
			TB13-090			11		A1																			
			TB13-091			14	R4-14	A2	PU150CCW1O	A14	14	8	7	ADV551													
			TB13-092			11		A1																			
			TB13-093			14	R4-15	A2	PU150CCW2O	A15	15	8	7	ADV551													
			TB13-094			11		A1																			
			TB13-095			14	R4-16	A2	PU150CCW3O	A16	16	8	7	ADV551													
			TB13-096			11		A1																			
										A17	-	8	7	ADV551													
										A18	+																

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	SHAM	24/10/08							WILMAR SURABAYA FA PROJECT	64-DO
	CH.	DATE							TITLE	SHT NO
	IENA	24/10/08							TF-MC PANEL (MC1)	64
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT NO
TF-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	65

Signal Type :			Cabinet No :										FCU-0101														
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC1)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
			MCB6-11					MCB6-15																			
			OVDC-11		24VDC-11			24VDC-15			OVDC-15																
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB				IP-R		Tag No.		Term.	Channel	NODE	SLOT	MODEL											
			TB13-097				14	R4-17	A2	PU150CCW40		B1	17	8	7	ADV551											
			TB13-098				11		A1																		
			TB13-099				14	R4-18	A2	SPARE		B2	18	8	7	ADV551											
			TB13-100				11		A1																		
			TB13-101				14	R4-19	A2	SPARE		B3	19	8	7	ADV551											
			TB13-102				11		A1																		
			TB13-103				14	R4-20	A2	SPARE		B4	20	8	7	ADV551											
			TB13-104				11		A1																		
			TB13-105				14	R4-21	A2	SPARE		B5	21	8	7	ADV551											
			TB13-106				11		A1																		
			TB13-107				14	R4-22	A2	PU15001AO		B6	22	8	7	ADV551											
			TB13-108				11		A1																		
			TB13-109				14	R4-23	A2	PU15001BO		B7	23	8	7	ADV551											
			TB13-110				11		A1																		
			TB13-111				14	R4-24	A2	SPARE		B8	24	8	7	ADV551											
			TB13-112				11		A1																		
			TB13-113				14	R4-25	A2	SPARE		B9	25	8	7	ADV551											
			TB13-114				11		A1																		
			TB13-115				14	R4-26	A2	SPARE		B10	26	8	7	ADV551											
			TB13-116				11		A1																		
			TB13-117				14	R4-27	A2	SPARE		B11	27	8	7	ADV551											
			TB13-118				11		A1																		
			TB13-119				14	R4-28	A2	SPARE		B12	28	8	7	ADV551											
			TB13-120				11		A1																		
			TB13-121				14	R4-29	A2	SPARE		B13	29	8	7	ADV551											
			TB13-122				11		A1																		
			TB13-123				14	R4-30	A2	SPARE		B14	30	8	7	ADV551											
			TB13-124				11		A1																		
			TB13-125				14	R4-31	A2	SPARE		B15	31	8	7	ADV551											
			TB13-126				11		A1																		
			TB13-127				14	R4-32	A2	SPARE		B16	32	8	7	ADV551											
			TB13-128				11		A1																		
												B17	-	8	7	ADV551											
												B18	+														

GENERAL DESCRIPTION	DR.	DATE							PROJECT NAME	DWG. NO.
Panel Wiring Drawing	SHAM	24/10/08							WILMAR SURABAYA FA PROJECT	65-DO
	CH.	DATE							TITLE	SHT NO
	IENA	24/10/08							TF-MC PANEL (MC1)	65
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT NO
TF-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	66

Signal Type :			Cabinet No :		TF-MC PANEL (MC1)							FCU-0101								
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC										RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
				MCB6-12		MCB6-16														
				OVDC-12		24VDC-12		24VDC-16		OVDC-16										
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB			IP-R		Tag No.		Term.	Channel	NODE	SLOT	MODEL					
				TB13-129			14	R5-1	A2	PU50HWA0	A1	1	8	8	ADV551					
				TB13-130			11		A1											
				TB13-131			14	R5-2	A2	PU50HWB0	A2	2	8	8	ADV551					
				TB13-132			11		A1											
				TB13-133			14	R5-3	A2	PU50HWC0	A3	3	8	8	ADV551					
				TB13-134			11		A1											
				TB13-135			14	R5-4	A2	PU50HWD0	A4	4	8	8	ADV551					
				TB13-136			11		A1											
				TB13-137			14	R5-5	A2	SPARE	A5	5	8	8	ADV551					
				TB13-138			11		A1											
				TB13-139			14	R5-6	A2	SPARE	A6	6	8	8	ADV551					
				TB13-140			11		A1											
				TB13-141			14	R5-7	A2	PU50WW1A0	A7	7	8	8	ADV551					
				TB13-142			11		A1											
				TB13-143			14	R5-8	A2	PU50WW1B0	A8	8	8	8	ADV551					
				TB13-144			11		A1											
				TB13-145			14	R5-9	A2	PU50WW20	A9	9	8	8	ADV551					
				TB13-146			11		A1											
				TB13-147			14	R5-10	A2	SPARE	A10	10	8	8	ADV551					
				TB13-148			11		A1											
				TB13-149			14	R5-11	A2	SPARE	A11	11	8	8	ADV551					
				TB13-150			11		A1											
				TB13-151			14	R5-12	A2	PU11D00A0	A12	12	8	8	ADV551					
				TB13-152			11		A1											
				TB13-153			14	R5-13	A2	PU11D00B0	A13	13	8	8	ADV551					
				TB13-154			11		A1											
				TB13-155			14	R5-14	A2	SPARE	A14	14	8	8	ADV551					
				TB13-156			11		A1											
				TB13-157			14	R5-15	A2	SPARE	A15	15	8	8	ADV551					
				TB13-158			11		A1											
				TB13-159			14	R5-16	A2	SPARE	A16	16	8	8	ADV551					
				TB13-160			11		A1											
												A17	-	8	8	ADV551				
												A18	+							

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME					DWG. NO.
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT					66-DO
		CH.	DATE						TITLE					SHT NO
		IENA	24/10/08						TF-MC PANEL (MC1)					66
FILENAME	APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.					CONT NO
TF-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002					67

Signal Type :			Cabinet No :		TF-MC PANEL (MC1)										FCU-0101				
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC													RTD	AI	AO	DI	DO
HSC	RTD																		
AI	AO																		
DI	DO																		
IS	NIS																		
HART	NON HART																		

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART			Cabinet No :					FCU-0101				
			HSC	RTD																				
AI	AO																							
DI	DO																							
IS	NIS																							
HART	NON HART																							
					TF-MC PANEL (MC1)																			
					MCB6-1																			
					0VDC-1 24VDC-1					SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model													
			TB14-001	AG901101STI		A1	1	6	4	ADV151														
			TB14-002			A17																		
			TB14-003	AG901101TRI		A2	2	6	4	ADV151														
			TB14-004			A17																		
			TB14-005	AG901102STI		A3	3	6	4	ADV151														
			TB14-006			A17																		
			TB14-007	AG901102TRI		A4	4	6	4	ADV151														
			TB14-008			A17																		
			TB14-009	AG901103STI		A5	5	6	4	ADV151														
			TB14-010			A17																		
			TB14-011	AG901103TRI		A6	6	6	4	ADV151														
			TB14-012			A17																		
			TB14-013	AG901104STI		A7	7	6	4	ADV151														
			TB14-014			A17																		
			TB14-015	AG901104TRI		A8	8	6	4	ADV151														
			TB14-016			A17																		
			TB14-017	SPARE		A9	9	6	4	ADV151														
			TB14-018			A17																		
			TB14-019	SPARE		A10	10	6	4	ADV151														
			TB14-020			A17																		
			TB14-021	AG901600STI		A11	11	6	4	ADV151														
			TB14-022			A17																		
			TB14-023	AG901600TRI		A12	12	6	4	ADV151														
			TB14-024			A17																		
			TB14-025	AG901601STI		A13	13	6	4	ADV151														
			TB14-026			A17																		
			TB14-027	AG901601TRI		A14	14	6	4	ADV151														
			TB14-028			A17																		
			TB14-029	AG901602STI		A15	15	6	4	ADV151														
			TB14-030			A17																		
			TB14-031	AG901602TRI		A16	16	6	4	ADV151														
			TB14-032			A17																		

														GENERAL DESCRIPTION Panel Wiring Drawing		DR. SHAM	DATE 24/10/08							PROJECT NAME		DWG. NO.	
CH. IENA	DATE 24/10/08							WILMAR SURABAYA FA PROJECT		68-DI																	
FILENAME TF-PANEL		APP. TEOH	DATE 24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	TITLE		SHT. NO.															
REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	TF-MC PANEL (MC1)		68																			
										DOC. NO.		CONT'D															
										WSFA-D32-002		69															

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC1)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
			MCB6-1																				
			0VDC-1 24VDC-1						SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model												
				TB14-033	AG901603STI		B1	17	6	4	ADV151												
				TB14-034			B17																
				TB14-035	AG901603TRI		B2	18	6	4	ADV151												
				TB14-036			B17																
				TB14-037	AG901604STI		B3	19	6	4	ADV151												
				TB14-038			B17																
				TB14-039	AG901604TRI		B4	20	6	4	ADV151												
				TB14-040			B17																
				TB14-041	AG901605STI		B5	21	6	4	ADV151												
				TB14-042			B17																
				TB14-043	AG901605TRI		B6	22	6	4	ADV151												
				TB14-044			B17																
				TB14-045	AG901606STI		B7	23	6	4	ADV151												
				TB14-046			B17																
				TB14-047	AG901606TRI		B8	24	6	4	ADV151												
				TB14-048			B17																
				TB14-049	AG901607STI		B9	25	6	4	ADV151												
				TB14-050			B17																
				TB14-051	AG901607TRI		B10	26	6	4	ADV151												
				TB14-052			B17																
				TB14-053	AG901608STI		B11	27	6	4	ADV151												
				TB14-054			B17																
				TB14-055	AG901608TRI		B12	28	6	4	ADV151												
				TB14-056			B17																
				TB14-057	AG901609STI		B13	29	6	4	ADV151												
				TB14-058			B17																
				TB14-059	AG901609TRI		B14	30	6	4	ADV151												
				TB14-060			B17																
				TB14-061	AG901610STI		B15	31	6	4	ADV151												
				TB14-062			B17																
				TB14-063	AG901610TRI		B16	32	6	4	ADV151												
				TB14-064			B17																

GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08					PROJECT NAME		DWG. NO.
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08					WILMAR SURABAYA FA PROJECT		69-DI
										TITLE		SHT. NO.
										TF-MC PANEL (MC1)		69
FILENAME	APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
TF-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	70

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : <		
			HSC	RTD											
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : TF-MC PANEL (MC1) MCB6-2 0VDC-224VDC-2				FCU-0101				
			HSC	RTD																	
			AI	AO																	
			DI	DO																	
			IS	NIS																	
HART	NON HART																				
SYSTEM I/O																					
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model											
				TB14-097	AG91901BSTI	B1	17	6	5	ADV151											
				TB14-098		B17															
				TB14-099	AG91901BTRI	B2	18	6	5	ADV151											
				TB14-100		B17															
				TB14-101	AG91902ASTI	B3	19	6	5	ADV151											
				TB14-102		B17															
				TB14-103	AG91902ATRI	B4	20	6	5	ADV151											
				TB14-104		B17															
				TB14-105	AG91902BSTI	B5	21	6	5	ADV151											
				TB14-106		B17															
				TB14-107	AG91902BTRI	B6	22	6	5	ADV151											
				TB14-108		B17															
				TB14-109	AG91903ASTI	B7	23	6	5	ADV151											
				TB14-110		B17															
				TB14-111	AG91903ATRI	B8	24	6	5	ADV151											
				TB14-112		B17															
				TB14-113	AG91903BSTI	B9	25	6	5	ADV151											
				TB14-114		B17															
				TB14-115	AG91903BTRI	B10	26	6	5	ADV151											
				TB14-116		B17															
				TB14-117	AG91904ASTI	B11	27	6	5	ADV151											
				TB14-118		B17															
				TB14-119	AG91904ATRI	B12	28	6	5	ADV151											
				TB14-120		B17															
				TB14-121	AG91904BSTI	B13	29	6	5	ADV151											
				TB14-122		B17															
				TB14-123	AG91904BTRI	B14	30	6	5	ADV151											
				TB14-124		B17															
				TB14-125	SPARE	B15	31	6	5	ADV151											
				TB14-126		B17															
				TB14-127	SPARE	B16	32	6	5	ADV151											
				TB14-128		B17															

GENERAL DESCRIPTION Panel Wiring Drawing	DR. SHAM	DATE 24/10/08							PROJECT NAME WILMAR SURABAYA FA PROJECT	DWG. NO. 71-DI
	CH. IENA	DATE 24/10/08							TITLE TF-MC PANEL (MC1)	SHT. NO. 71
	FILENAME TF-PANEL	APP. TEOH	DATE 24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO. WSFA-D32-002
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY		

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC1)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
			MCB6-3																				
			0VDC-3 24VDC-3						SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model													
				TB14-129	AG91907ASTI	A1	1	6	6	ADV151													
				TB14-130		A17																	
				TB14-131	AG91907ATRI	A2	2	6	6	ADV151													
				TB14-132		A17																	
				TB14-133	AG91907BSTI	A3	3	6	6	ADV151													
				TB14-134		A17																	
				TB14-135	AG91907BTRI	A4	4	6	6	ADV151													
				TB14-136		A17																	
				TB14-137	AG91908ASTI	A5	5	6	6	ADV151													
				TB14-138		A17																	
				TB14-139	AG91908ATRI	A6	6	6	6	ADV151													
				TB14-140		A17																	
				TB14-141	AG91908BSTI	A7	7	6	6	ADV151													
				TB14-142		A17																	
				TB14-143	AG91908BTRI	A8	8	6	6	ADV151													
				TB14-144		A17																	
				TB14-145	SPARE	A9	9	6	6	ADV151													
				TB14-146		A17																	
				TB14-147	PU250HW1STI	A10	10	6	6	ADV151													
				TB14-148		A17																	
				TB14-149	PU250HW1TRI	A11	11	6	6	ADV151													
				TB14-150		A17																	
				TB14-151	PU250HW2STI	A12	12	6	6	ADV151													
				TB14-152		A17																	
				TB14-153	PU250HW2TRI	A13	13	6	6	ADV151													
				TB14-154		A17																	
				TB14-155	PU250HW3STI	A14	14	6	6	ADV151													
				TB14-156		A17																	
				TB14-157	PU250HW3TRI	A15	15	6	6	ADV151													
				TB14-158		A17																	
				TB14-159	PU250HW4STI	A16	16	6	6	ADV151													
				TB14-160		A17																	

GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08						PROJECT NAME	DWG. NO.
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT	72-DI
FILENAME		APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	SHT. NO.
TF-PANEL						REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	72
										DOC. NO.		CONT'D
										WSFA-D32-002		73

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC1) MCB6-3 0VDC-3 24VDC-3						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.			SYSTEM I/O																	
				TB	Tag No.	Term.	Channel	Node	Slot	Model													
				TB14-161	PU250HW4TRI	B1	17	6	6	ADV151													
				TB14-162		B17																	
				TB14-163	SPARE	B2	18	6	6	ADV151													
				TB14-164		B17																	
				TB14-165	SPARE	B3	19	6	6	ADV151													
				TB14-166		B17																	
				TB14-167	SPARE	B4	20	6	6	ADV151													
				TB14-168		B17																	
				TB14-169	SPARE	B5	21	6	6	ADV151													
				TB14-170		B17																	
				TB14-171	SPARE	B6	22	6	6	ADV151													
				TB14-172		B17																	
				TB14-173	SPARE	B7	23	6	6	ADV151													
				TB14-174		B17																	
				TB14-175	SPARE	B8	24	6	6	ADV151													
				TB14-176		B17																	
				TB14-177	SPARE	B9	25	6	6	ADV151													
				TB14-178		B17																	
				TB14-179	SPARE	B10	26	6	6	ADV151													
				TB14-180		B17																	
				TB14-181	SPARE	B11	27	6	6	ADV151													
				TB14-182		B17																	
				TB14-183	LSL119F02S	B12	28	6	6	ADV151													
				TB14-184		B17																	
				TB14-185	LSH119F02S	B13	29	6	6	ADV151													
				TB14-186		B17																	
				TB14-187	LS15LS	B14	30	6	6	ADV151													
				TB14-188		B17																	
				TB14-189	SPARE	B15	31	6	6	ADV151													
				TB14-190		B17																	
				TB14-191	SPARE	B16	32	6	6	ADV151													
				TB14-192		B17																	
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.												
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		73-DI												
		CH.	IENA	DATE						TITLE		SHT. NO.											
			24/10/08						TF-MC PANEL (MC1)		73												
FILENAME	APP.	DATE							DOC. NO.	CONT'D													
TF-PANEL	TEOH	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	WSFA-D32-002	74													
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY															

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC1) MCB6-4 0VDC-4 24VDC-4						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.			SYSTEM I/O																	
				TB	Tag No.	Term.	Channel	Node	Slot	Model													
				TB14-193	P901100ASTI	A1	1	7	4	ADV151													
				TB14-194		A17																	
				TB14-195	P901100ATRI	A2	2	7	4	ADV151													
				TB14-196		A17																	
				TB14-197	P901100BSTI	A3	3	7	4	ADV151													
				TB14-198		A17																	
				TB14-199	P901100BTRI	A4	4	7	4	ADV151													
				TB14-200		A17																	
				TB14-201	P901100CSTI	A5	5	7	4	ADV151													
				TB14-202		A17																	
				TB14-203	P901100CTRI	A6	6	7	4	ADV151													
				TB14-204		A17																	
				TB14-205	P901100DSTI	A7	7	7	4	ADV151													
				TB14-206		A17																	
				TB14-207	P901100DTRI	A8	8	7	4	ADV151													
				TB14-208		A17																	
				TB14-209	P901103STI	A9	9	7	4	ADV151													
				TB14-210		A17																	
				TB14-211	P901103TRI	A10	10	7	4	ADV151													
				TB14-212		A17																	
				TB14-213	P901200STI	A11	11	7	4	ADV151													
				TB14-214		A17																	
				TB14-215	P901200TRI	A12	12	7	4	ADV151													
				TB14-216		A17																	
		TB14-217	P901202STI	A13	13	7	4	ADV151															
		TB14-218		A17																			
		TB14-219	P901202TRI	A14	14	7	4	ADV151															
		TB14-220		A17																			
		TB14-221	P901300STI	A15	15	7	4	ADV151															
		TB14-222		A17																			
		TB14-223	P901300TRI	A16	16	7	4	ADV151															
		TB14-224		A17																			

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08						PROJECT NAME	DWG. NO.
	CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT	74-DI
FILENAME TF-PANEL	APP.	TEOH	DATE	24/10/08						TITLE	SHT. NO.
										TF-MC PANEL (MC1)	74
										DOC. NO.	CONT'D
										WSFA-D32-002	75

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : TF-MC PANEL (MC1) MCB6-4 0VDC-424VDC-4					FCU-0101				
			HSC	RTD																		
			AI	AO																		
			DI	DO																		
			IS	NIS																		
HART	NON HART																					
SYSTEM I/O																						
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model												
				TB14-225	P901400ASTI	B1	17	7	4	ADV151												
				TB14-226		B17																
				TB14-227	P901400ATRI	B2	18	7	4	ADV151												
				TB14-228		B17																
				TB14-229	P901400BSTI	B3	19	7	4	ADV151												
				TB14-230		B17																
				TB14-231	P901400BTRI	B4	20	7	4	ADV151												
				TB14-232		B17																
				TB14-233	P901401STI	B5	21	7	4	ADV151												
				TB14-234		B17																
				TB14-235	P901401TRI	B6	22	7	4	ADV151												
				TB14-236		B17																
				TB14-237	P901600ASTI	B7	23	7	4	ADV151												
				TB14-238		B17																
				TB14-239	P901600ATRI	B8	24	7	4	ADV151												
				TB14-240		B17																
				TB14-241	P901600BSTI	B9	25	7	4	ADV151												
				TB14-242		B17																
				TB14-243	P901600BTRI	B10	26	7	4	ADV151												
				TB14-244		B17																
				TB14-245	P901601STI	B11	27	7	4	ADV151												
				TB14-246		B17																
				TB14-247	P901601TRI	B12	28	7	4	ADV151												
				TB14-248		B17																
				TB14-249	P901604STI	B13	29	7	4	ADV151												
				TB14-250		B17																
		TB14-251	P901604TRI	B14	30	7	4	ADV151														
		TB14-252		B17																		
		TB14-253	P901607STI	B15	31	7	4	ADV151														
		TB14-254		B17																		
		TB14-255	P901607TRI	B16	32	7	4	ADV151														
		TB14-256		B17																		

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08						PROJECT NAME	DWG. NO.	
										WILMAR SURABAYA FA PROJECT	75-DI	
	CH.	IENA	DATE	24/10/08						TITLE	SHT. NO.	
									TF-MC PANEL (MC1)	75		
FILENAME	APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
TF-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	76

Signal Type :			Cabinet No :																			
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC2)					FCU-0101				
HSC	RTD																					
AI	AO																					
DI	DO																					
IS	NIS																					
HART	NON HART																					
			MCB6-5																			
			0VDC-5 24VDC-5					SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model												
				TB15-001	P901608STI	A1	1	7	5	ADV151												
				TB15-002		A17																
				TB15-003	P901608TRI	A2	2	7	5	ADV151												
				TB15-004		A17																
				TB15-005	P901609STI	A3	3	7	5	ADV151												
				TB15-006		A17																
				TB15-007	P901609TRI	A4	4	7	5	ADV151												
				TB15-008		A17																
				TB15-009	P901611STI	A5	5	7	5	ADV151												
				TB15-010		A17																
				TB15-011	P901611TRI	A6	6	7	5	ADV151												
				TB15-012		A17																
				TB15-013	P901612STI	A7	7	7	5	ADV151												
				TB15-014		A17																
				TB15-015	P901612TRI	A8	8	7	5	ADV151												
				TB15-016		A17																
				TB15-017	P9018002STI	A9	9	7	5	ADV151												
				TB15-018		A17																
				TB15-019	P9018002TRI	A10	10	7	5	ADV151												
				TB15-020		A17																
				TB15-021	P9018005STI	A11	11	7	5	ADV151												
				TB15-022		A17																
				TB15-023	P9018005TRI	A12	12	7	5	ADV151												
				TB15-024		A17																
				TB15-025	P901800ASTI	A13	13	7	5	ADV151												
				TB15-026		A17																
				TB15-027	P901800ATRI	A14	14	7	5	ADV151												
				TB15-028		A17																
				TB15-029	P901800BSTI	A15	15	7	5	ADV151												
				TB15-030		A17																
				TB15-031	P901800BTRI	A16	16	7	5	ADV151												
				TB15-032		A17																
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.											
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		76-DI											
		CH.	IENA	DATE						TITLE		SHT. NO.										
			24/10/08						TF-MC PANEL (MC2)		76											
FILENAME	APP.	DATE			FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D											
TF-PANEL	TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	77												

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC2) MCB6-5 0VDC-5 24VDC-5						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.			SYSTEM I/O																	
				TB	Tag No.	Term.	Channel	Node	Slot	Model													
				TB15-033	P901804ASTI	B1	17	7	5	ADV151													
				TB15-034		B17																	
				TB15-035	P901804ATRI	B2	18	7	5	ADV151													
				TB15-036		B17																	
				TB15-037	P901804BSTI	B3	19	7	5	ADV151													
				TB15-038		B17																	
				TB15-039	P901804BTRI	B4	20	7	5	ADV151													
				TB15-040		B17																	
				TB15-041	P91901STI	B5	21	7	5	ADV151													
				TB15-042		B17																	
				TB15-043	P91901TRI	B6	22	7	5	ADV151													
				TB15-044		B17																	
				TB15-045	P91903STI	B7	23	7	5	ADV151													
				TB15-046		B17																	
				TB15-047	P91903TRI	B8	24	7	5	ADV151													
				TB15-048		B17																	
				TB15-049	P91905STI	B9	25	7	5	ADV151													
				TB15-050		B17																	
				TB15-051	P91905TRI	B10	26	7	5	ADV151													
				TB15-052		B17																	
				TB15-053	P91907STI	B11	27	7	5	ADV151													
				TB15-054		B17																	
				TB15-055	P91907TRI	B12	28	7	5	ADV151													
				TB15-056		B17																	
				TB15-057	P119G08STI	B13	29	7	5	ADV151													
				TB15-058		B17																	
				TB15-059	P119G08TRI	B14	30	7	5	ADV151													
				TB15-060		B17																	
				TB15-061	SPARE	B15	31	7	5	ADV151													
				TB15-062		B17																	
				TB15-063	SPARE	B16	32	7	5	ADV151													
				TB15-064		B17																	
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.												
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		77-DI												
		CH.	DATE						TITLE		SHT. NO.												
		IENA	24/10/08						TF-MC PANEL (MC2)		77												
FILENAME	APP.	DATE							DOC. NO.	CONT'D													
TF-PANEL	TEOH	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	WSFA-D32-002	78													
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY															

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART			Cabinet No :					FCU-0101				
			HSC	RTD																				
AI	AO																							
DI	DO																							
IS	NIS																							
HART	NON HART																							
			TF-MC PANEL (MC2)																					
			MCB6-6																					
			0VDC-6 24VDC-6					SYSTEM I/O																
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model													
				TB15-065	150AD01STI		A1	1	8	4	ADV151													
				TB15-066			A17																	
				TB15-067	150AD01TRI		A2	2	8	4	ADV151													
				TB15-068			A17																	
				TB15-069	150AD02STI		A3	3	8	4	ADV151													
				TB15-070			A17																	
				TB15-071	150AD02TRI		A4	4	8	4	ADV151													
				TB15-072			A17																	
				TB15-073	150N2G1STI		A5	5	8	4	ADV151													
				TB15-074			A17																	
				TB15-075	150N2G1TRI		A6	6	8	4	ADV151													
				TB15-076			A17																	
				TB15-077	FN150CT01ASTI		A7	7	8	4	ADV151													
				TB15-078			A17																	
				TB15-079	FN150CT01ATRI		A8	8	8	4	ADV151													
				TB15-080			A17																	
				TB15-081	FN150CT01BSTI		A9	9	8	4	ADV151													
				TB15-082			A17																	
				TB15-083	FN150CT01BTRI		A10	10	8	4	ADV151													
				TB15-084			A17																	
				TB15-085	FN150CT01CSTI		A11	11	8	4	ADV151													
				TB15-086			A17																	
				TB15-087	FN150CT01CTRI		A12	12	8	4	ADV151													
				TB15-088			A17																	
				TB15-089	FN150CT01DSTI		A13	13	8	4	ADV151													
				TB15-090			A17																	
				TB15-091	FN150CT01DTRI		A14	14	8	4	ADV151													
				TB15-092			A17																	
				TB15-093	FN150CT01ESTI		A15	15	8	4	ADV151													
				TB15-094			A17																	
				TB15-095	FN150CT01ETRI		A16	16	8	4	ADV151													
				TB15-096			A17																	

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08							PROJECT NAME	DWG. NO.
											WILMAR SURABAYA FA PROJECT	78-DI
	CH.	IENA	DATE	24/10/08							TITLE	SHT. NO.
											TF-MC PANEL (MC2)	78
FILENAME	APP.	TEOH	DATE	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
TF-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	79

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : TF-MC PANEL (MC2) MCB6-6 0VDC-6 24VDC-6			FCU-0101 SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model											
			TB15-097	FN150CT01FSTI	B1	17	8	4	ADV151											
			TB15-098		B17															
			TB15-099	FN150CT01FTRI	B2	18	8	4	ADV151											
			TB15-100		B17															
			TB15-101	FN150CT02BSTI	B3	19	8	4	ADV151											
			TB15-102		B17															
			TB15-103	FN150CT02BTRI	B4	20	8	4	ADV151											
			TB15-104		B17															
			TB15-105	SPARE	B5	21	8	4	ADV151											
			TB15-106		B17															
			TB15-107	SPARE	B6	22	8	4	ADV151											
			TB15-108		B17															
			TB15-109	SPARE	B7	23	8	4	ADV151											
			TB15-110		B17															
			TB15-111	SPARE	B8	24	8	4	ADV151											
			TB15-112		B17															
			TB15-113	SPARE	B9	25	8	4	ADV151											
			TB15-114		B17															
			TB15-115	SPARE	B10	26	8	4	ADV151											
			TB15-116		B17															
			TB15-117	SPARE	B11	27	8	4	ADV151											
			TB15-118		B17															
			TB15-119	SPARE	B12	28	8	4	ADV151											
			TB15-120		B17															
			TB15-121	SPARE	B13	29	8	4	ADV151											
			TB15-122		B17															
			TB15-123	SPARE	B14	30	8	4	ADV151											
			TB15-124		B17															
		TB15-125	SPARE	B15	31	8	4	ADV151												
		TB15-126		B17																
		TB15-127	SPARE	B16	32	8	4	ADV151												
		TB15-128		B17																

GENERAL DESCRIPTION Panel Wiring Drawing	DR. SHAM	DATE 24/10/08							PROJECT NAME WILMAR SURABAYA FA PROJECT	DWG. NO. 79-DI
	CH. IENA	DATE 24/10/08							TITLE TF-MC PANEL (MC2)	SHT. NO. 79
FILENAME TF-PANEL	APP. TEOH	DATE 24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO. WSFA-D32-002	CONT'D 80
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY		

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : <table><tr><td colspan="2">TF-MC PANEL (MC2)</td></tr><tr><td>MCB6-7</td><td></td></tr><tr><td>0VDC-7</td><td>24VDC-7</td></tr></table>		TF-MC PANEL (MC2)		MCB6-7		0VDC-7	24VDC-7	FCU-0101				
			HSC	RTD																					
AI	AO																								
DI	DO																								
IS	NIS																								
HART	NON HART																								
TF-MC PANEL (MC2)																									
MCB6-7																									
0VDC-7	24VDC-7																								
SYSTEM I/O																									
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model															
				TB15-129	PU11D00ASTI	A1	1	8	5	ADV151															
				TB15-130		A17																			
				TB15-131	PU11D00ATRI	A2	2	8	5	ADV151															
				TB15-132		A17																			
				TB15-133	PU11D00BSTI	A3	3	8	5	ADV151															
				TB15-134		A17																			
				TB15-135	PU11D00BTRI	A4	4	8	5	ADV151															
				TB15-136		A17																			
				TB15-137	PU15001ASTI	A5	5	8	5	ADV151															
				TB15-138		A17																			
				TB15-139	PU15001ATRI	A6	6	8	5	ADV151															
				TB15-140		A17																			
				TB15-141	PU15001BSTI	A7	7	8	5	ADV151															
				TB15-142		A17																			
				TB15-143	PU15001BTRI	A8	8	8	5	ADV151															
				TB15-144		A17																			
				TB15-145	SPARE	A9	9	8	5	ADV151															
				TB15-146		A17																			
				TB15-147	SPARE	A10	10	8	5	ADV151															
				TB15-148		A17																			
				TB15-149	SPARE	A11	11	8	5	ADV151															
				TB15-150		A17																			
				TB15-151	SPARE	A12	12	8	5	ADV151															
				TB15-152		A17																			
				TB15-153	PU1501ASTI	A13	13	8	5	ADV151															
				TB15-154		A17																			
				TB15-155	PU1501ATRI	A14	14	8	5	ADV151															
				TB15-156		A17																			
				TB15-157	PU1501BSTI	A15	15	8	5	ADV151															
				TB15-158		A17																			
				TB15-159	PU1501BTRI	A16	16	8	5	ADV151															
				TB15-160		A17																			

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08						PROJECT NAME	DWG. NO.	
										WILMAR SURABAYA FA PROJECT	80-DI	
	CH.	IENA	DATE	24/10/08						TITLE	SHT. NO.	
										TF-MC PANEL (MC2)	80	
FILENAME	APP.	TEOH	DATE	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
TF-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	81

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : TF-MC PANEL (MC2) MCB6-7 0VDC-7 24VDC-7			FCU-0101 SYSTEM I/O		
HSC	RTD																	
AI	AO																	
DI	DO																	
IS	NIS																	
HART	NON HART																	
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model									
			TB15-161	PU1501CSTI	B1	17	8	5	ADV151									
			TB15-162		B17													
			TB15-163	PU1501CTRI	B2	18	8	5	ADV151									
			TB15-164		B17													
			TB15-165	PU1501DSTI	B3	19	8	5	ADV151									
			TB15-166		B17													
			TB15-167	PU1501DTRI	B4	20	8	5	ADV151									
			TB15-168		B17													
			TB15-169	PU1501ESTI	B5	21	8	5	ADV151									
			TB15-170		B17													
			TB15-171	PU1501ETRI	B6	22	8	5	ADV151									
			TB15-172		B17													
			TB15-173	PU1502ASTI	B7	23	8	5	ADV151									
			TB15-174		B17													
			TB15-175	PU1502ATRI	B8	24	8	5	ADV151									
			TB15-176		B17													
			TB15-177	PU1502BSTI	B9	25	8	5	ADV151									
			TB15-178		B17													
			TB15-179	PU1502BTRI	B10	26	8	5	ADV151									
			TB15-180		B17													
			TB15-181	SPARE	B11	27	8	5	ADV151									
			TB15-182		B17													
			TB15-183	LS50WW1AS	B12	28	8	5	ADV151									
			TB15-184		B17													
		TB15-185	LS50WW1BS	B13	29	8	5	ADV151										
		TB15-186		B17														
		TB15-187	SPARE	B14	30	8	5	ADV151										
		TB15-188		B17														
		TB15-189	SPARE	B15	31	8	5	ADV151										
		TB15-190		B17														
		TB15-191	SPARE	B16	32	8	5	ADV151										
		TB15-192		B17														

GENERAL DESCRIPTION Panel Wiring Drawing	DR. SHAM	DATE 24/10/08							PROJECT NAME WILMAR SURABAYA FA PROJECT	DWG. NO. 81-DI
	CH. IENA	DATE 24/10/08							TITLE TF-MC PANEL (MC2)	SHT. NO. 81
FILENAME TF-PANEL	APP. TEOH	DATE 24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO. WSFA-D32-002	CONT'D 82
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY		

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC2)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
			MCB6-8																				
			0VDC-8 24VDC-8						SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model												
				TB15-193	PU150CCW1STI		A1	1	8	6	ADV151												
				TB15-194			A17																
				TB15-195	PU150CCW1TRI		A2	2	8	6	ADV151												
				TB15-196			A17																
				TB15-197	PU150CCW2STI		A3	3	8	6	ADV151												
				TB15-198			A17																
				TB15-199	PU150CCW2TRI		A4	4	8	6	ADV151												
				TB15-200			A17																
				TB15-201	SPARE		A5	5	8	6	ADV151												
				TB15-202			A17																
				TB15-203	SPARE		A6	6	8	6	ADV151												
				TB15-204			A17																
				TB15-205	PU150CCW4STI		A7	7	8	6	ADV151												
				TB15-206			A17																
				TB15-207	PU150CCW4TRI		A8	8	8	6	ADV151												
				TB15-208			A17																
				TB15-209	PU150CCW4FF		A9	9	8	6	ADV151												
				TB15-210			A17																
				TB15-211	PU150CCW3STI		A10	10	8	6	ADV151												
				TB15-212			A17																
				TB15-213	PU150CCW3TRI		A11	11	8	6	ADV151												
				TB15-214			A17																
				TB15-215	SPARE		A12	12	8	6	ADV151												
				TB15-216			A17																
				TB15-217	SPARE		A13	13	8	6	ADV151												
				TB15-218			A17																
				TB15-219	SPARE		A14	14	8	6	ADV151												
				TB15-220			A17																
				TB15-221	SPARE		A15	15	8	6	ADV151												
				TB15-222			A17																
				TB15-223	SPARE		A16	16	8	6	ADV151												
				TB15-224			A17																
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.												
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		82-DI												
		CH.	IENA	DATE					TITLE		SHT. NO.												
			24/10/08						TF-MC PANEL (MC2)		82												
FILENAME	APP.	DATE							DOC. NO.		CONT'D												
TF-PANEL	TEOH	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	WSFA-D32-002		83												
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY															

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No :		TF-MC PANEL (MC2)					FCU-0101				
			HSC	RTD																				
AI	AO																							
DI	DO																							
IS	NIS																							
HART	NON HART																							
MCB6-8																								
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	0VDC-8		24VDC-8		SYSTEM I/O																
				TB	Tag No.	Term.	Channel	Node	Slot	Model														
				TB15-225	PU50HWASTI	B1	17	8	6	ADV151														
				TB15-226		B17																		
				TB15-227	PU50HWATRI	B2	18	8	6	ADV151														
				TB15-228		B17																		
				TB15-229	PU50HWBSTI	B3	19	8	6	ADV151														
				TB15-230		B17																		
				TB15-231	PU50HWBTRI	B4	20	8	6	ADV151														
				TB15-232		B17																		
				TB15-233	PU50HWCSTI	B5	21	8	6	ADV151														
				TB15-234		B17																		
				TB15-235	PU50HWCTRI	B6	22	8	6	ADV151														
				TB15-236		B17																		
				TB15-237	PU50HWDSTI	B7	23	8	6	ADV151														
				TB15-238		B17																		
				TB15-239	PU50HWDTRI	B8	24	8	6	ADV151														
				TB15-240		B17																		
				TB15-241	PU50WW1ASTI	B9	25	8	6	ADV151														
				TB15-242		B17																		
				TB15-243	PU50WW1ATRI	B10	26	8	6	ADV151														
				TB15-244		B17																		
				TB15-245	PU50WW1BSTI	B11	27	8	6	ADV151														
				TB15-246		B17																		
				TB15-247	PU50WW1BTRI	B12	28	8	6	ADV151														
				TB15-248		B17																		
				TB15-249	PU50WW2STI	B13	29	8	6	ADV151														
				TB15-250		B17																		
				TB15-251	PU50WW2TRI	B14	30	8	6	ADV151														
				TB15-252		B17																		
				TB15-253	SPARE	B15	31	8	6	ADV151														
				TB15-254		B17																		
				TB15-255	SPARE	B16	32	8	6	ADV151														
				TB15-256		B17																		

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08							PROJECT NAME	DWG. NO.
											WILMAR SURABAYA FA PROJECT	83-DI
	CH.	IENA	DATE	24/10/08							TITLE	SHT. NO.
										TF-MC PANEL (MC2)	83	
FILENAME	APP.	TEOH	DATE	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
TF-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	84

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : TF-MC PANEL (MC2)			FCU-0101 SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model											
			TB16-001	VFD50HWA	A1	1	6	1	AAI143											
			TB16-002		B1															
			TB16-003	VFD50HWA	A2	2	6	1	AAI143											
			TB16-004		B2															
			TB16-005	LT901101	A3	3	6	1	AAI143											
			TB16-006		B3															
			TB16-007	LT901102	A4	4	6	1	AAI143											
			TB16-008		B4															
			TB16-009	LT901103	A5	5	6	1	AAI143											
			TB16-010		B5															
			TB16-011	LT901104	A6	6	6	1	AAI143											
			TB16-012		B6															
			TB16-013	LT901106	A7	7	6	1	AAI143											
			TB16-014		B7															
			TB16-015	LT901107	A8	8	6	1	AAI143											
			TB16-016		B8															
			TB16-017	TT901101	A9	9	6	1	AAI143											
			TB16-018		B9															
			TB16-019	TT901102	A10	10	6	1	AAI143											
			TB16-020		B10															
			TB16-021	TT901103	A11	11	6	1	AAI143											
			TB16-022		B11															
			TB16-023	TT901104	A12	12	6	1	AAI143											
			TB16-024		B12															
			TB16-025	VFD91901	A13	13	6	1	AAI143											
			TB16-026		B13															
			TB16-027	TT901106	A14	14	6	1	AAI143											
			TB16-028		B14															
			TB16-029	TT901107	A15	15	6	1	AAI143											
			TB16-030		B15															
			TB16-031	VFD91903	A16	16	6	1	AAI143											
			TB16-032		B16															

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.
										WILMAR SURABAYA FA PROJECT		84-AI
	CH.	IENA	DATE	24/10/08						TITLE		SHT. NO.
										TF-MC PANEL (MC2)		84
FILENAME	APP.	TEOH	DATE	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
TF-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	85

Signal Type :			Cabinet No :		TF-MC PANEL (MC2)		FCU-0101													
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC					RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model										
				TB16-033	LT901201	A1	1	6	2	AAI143										
				TB16-034		B1														
				TB16-035	LT901202	A2	2	6	2	AAI143										
				TB16-036		B2														
				TB16-037	TT901201	A3	3	6	2	AAI143										
				TB16-038		B3														
				TB16-039	TT901202	A4	4	6	2	AAI143										
				TB16-040		B4														
				TB16-041	VFD91905	A5	5	6	2	AAI143										
				TB16-042		B5														
				TB16-043	LT901300	A6	6	6	2	AAI143										
				TB16-044		B6														
				TB16-045	LT901301	A7	7	6	2	AAI143										
				TB16-046		B7														
				TB16-047	TT901300	A8	8	6	2	AAI143										
				TB16-048		B8														
				TB16-049	TT901301	A9	9	6	2	AAI143										
				TB16-050		B9														
				TB16-051	SPARE	A10	10	6	2	AAI143										
				TB16-052		B10														
				TB16-053	LT901401	A11	11	6	2	AAI143										
				TB16-054		B11														
				TB16-055	LT901402	A12	12	6	2	AAI143										
				TB16-056		B12														
				TB16-057	TT901401	A13	13	6	2	AAI143										
				TB16-058		B13														
				TB16-059	TT901402	A14	14	6	2	AAI143										
				TB16-060		B14														
				TB16-061	SPARE	A15	15	6	2	AAI143										
				TB16-062		B15														
				TB16-063	SPARE	A16	16	6	2	AAI143										
				TB16-064		B16														

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.
										WILMAR SURABAYA FA PROJECT	85-AI	
	CH.	IENA	DATE	24/10/08							TITLE	SHT. NO.
										TF-MC PANEL (MC2)	85	
FILENAME	APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
TF-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	86

YOKOGAWA

Signal Type :			Cabinet No :		TF-MC PANEL (MC2)		FCU-0101													
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC					RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model										
				TB16-065	LT901600	A1	1	6	3	AAI143										
				TB16-066		B1														
				TB16-067	LT901601	A2	2	6	3	AAI143										
				TB16-068		B2														
				TB16-069	LT901602	A3	3	6	3	AAI143										
				TB16-070		B3														
				TB16-071	LT901603	A4	4	6	3	AAI143										
				TB16-072		B4														
				TB16-073	LT901604	A5	5	6	3	AAI143										
				TB16-074		B5														
				TB16-075	LT901605	A6	6	6	3	AAI143										
				TB16-076		B6														
				TB16-077	LT901606	A7	7	6	3	AAI143										
				TB16-078		B7														
				TB16-079	LT901607	A8	8	6	3	AAI143										
				TB16-080		B8														
				TB16-081	LT901608	A9	9	6	3	AAI143										
				TB16-082		B9														
				TB16-083	LT901609	A10	10	6	3	AAI143										
				TB16-084		B10														
				TB16-085	LT901610	A11	11	6	3	AAI143										
				TB16-086		B11														
				TB16-087	LT901611	A12	12	6	3	AAI143										
				TB16-088		B12														
				TB16-089	LT901612	A13	13	6	3	AAI143										
				TB16-090		B13														
				TB16-091	VT150CT01A	A14	14	6	3	AAI143										
				TB16-092		B14														
				TB16-093	VT150CT01B	A15	15	6	3	AAI143										
				TB16-094		B15														
				TB16-095	VT150CT01C	A16	16	6	3	AAI143										
				TB16-096		B16														
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.									
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		86-AI									
		CH.	DATE						TITLE		SHT. NO.									
		IENA	24/10/08						TF-MC PANEL (MC2)		86									
FILENAME	APP.	DATE		0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D								
TF-PANEL	TEOH	24/10/08		REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		87								

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : <	
			HSC	RTD										
			AI	AO										
			DI	DO										
			IS	NIS										
HART	NON HART													

Signal Type :			Cabinet No :		TF-MC PANEL (MC2)		FCU-0101													
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC					RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model										
				TB16-129	LT91901	A1	1	7	2	AAI143										
				TB16-130		B1														
				TB16-131	LT91902	A2	2	7	2	AAI143										
				TB16-132		B2														
				TB16-133	LT91903	A3	3	7	2	AAI143										
				TB16-134		B3														
				TB16-135	LT91904	A4	4	7	2	AAI143										
				TB16-136		B4														
				TB16-137	LT91905	A5	5	7	2	AAI143										
				TB16-138		B5														
				TB16-139	SPARE	A6	6	7	2	AAI143										
				TB16-140		B6														
				TB16-141	LT91907	A7	7	7	2	AAI143										
				TB16-142		B7														
				TB16-143	LT91908	A8	8	7	2	AAI143										
				TB16-144		B8														
				TB16-145	VT150CCW1	A9	9	7	2	AAI143										
				TB16-146		B9														
				TB16-147	VT150CCW2	A10	10	7	2	AAI143										
				TB16-148		B10														
				TB16-149	VT150CCW3	A11	11	7	2	AAI143										
				TB16-150		B11														
				TB16-151	VT150CCW4	A12	12	7	2	AAI143										
				TB16-152		B12														
				TB16-153	SPARE	A13	13	7	2	AAI143										
				TB16-154		B13														
				TB16-155	SPARE	A14	14	7	2	AAI143										
				TB16-156		B14														
				TB16-157	SPARE	A15	15	7	2	AAI143										
				TB16-158		B15														
				TB16-159	SPARE	A16	16	7	2	AAI143										
				TB16-160		B16														
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.									
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		88-AI									
		CH.	DATE						TITLE		SHT. NO.									
		IENA	24/10/08						TF-MC PANEL (MC2)		88									
FILENAME	APP.	DATE		0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D								
TF-PANEL	TEOH	24/10/08		REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		89								

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : 	
			HSC	RTD										
			AI	AO										
			DI	DO										
			IS	NIS										
HART	NON HART													

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : TF-MC PANEL (MC2)		FCU-0101 SYSTEM I/O				
HSC	RTD																		
AI	AO																		
DI	DO																		
IS	NIS																		
HART	NON HART																		
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model										
			TB16-193	LT901105	A1	1	8	2	AAI143										
			TB16-194		B1														
			TB16-195	SPARE	A2	2	8	2	AAI143										
			TB16-196		B2														
			TB16-197	SPARE	A3	3	8	2	AAI143										
			TB16-198		B3														
			TB16-199	SPARE	A4	4	8	2	AAI143										
			TB16-200		B4														
			TB16-201	SPARE	A5	5	8	2	AAI143										
			TB16-202		B5														
			TB16-203	SPARE	A6	6	8	2	AAI143										
			TB16-204		B6														
			TB16-205	SPARE	A7	7	8	2	AAI143										
			TB16-206		B7														
			TB16-207	SPARE	A8	8	8	2	AAI143										
			TB16-208		B8														
			TB16-209	SPARE	A9	9	8	2	AAI143										
			TB16-210		B9														
			TB16-211	SPARE	A10	10	8	2	AAI143										
			TB16-212		B10														
			TB16-213	SPARE	A11	11	8	2	AAI143										
			TB16-214		B11														
			TB16-215	LT250HW	A12	12	8	2	AAI143										
			TB16-216		B12														
			TB16-217	TT250HW	A13	13	8	2	AAI143										
			TB16-218		B13														
			TB16-219	PT11901	A14	14	8	2	AAI143										
			TB16-220		B14														
			TB16-221	PT90CA	A15	15	8	2	AAI143										
			TB16-222		B15														
			TB16-223	PT90CAT	A16	16	8	2	AAI143										
			TB16-224		B16														

GENERAL DESCRIPTION Panel Wiring Drawing	DR. SHAM	DATE 24/10/08							PROJECT NAME WILMAR SURABAYA FA PROJECT	DWG. NO. 90-AI
	CH. IENA	DATE 24/10/08							TITLE TF-MC PANEL (MC2)	SHT. NO. 90
FILENAME TF-PANEL	APP. TEOH	DATE 24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO. WSFA-D32-002	CONT'D 91
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY		

Signal Type :			Cabinet No :		TF-MC PANEL (MC2)		FCU-0101													
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC					RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model										
				TB16-225	PI90NT	A1	1	8	3	AAI143										
				TB16-226		B1														
				TB16-227	SPARE	A2	2	8	3	AAI143										
				TB16-228		B2														
				TB16-229	SPARE	A3	3	8	3	AAI143										
				TB16-230		B3														
				TB16-231	SPARE	A4	4	8	3	AAI143										
				TB16-232		B4														
				TB16-233	SPARE	A5	5	8	3	AAI143										
				TB16-234		B5														
				TB16-235	SPARE	A6	6	8	3	AAI143										
				TB16-236		B6														
				TB16-237	SPARE	A7	7	8	3	AAI143										
				TB16-238		B7														
				TB16-239	SPARE	A8	8	8	3	AAI143										
				TB16-240		B8														
				TB16-241	SPARE	A9	9	8	3	AAI143										
				TB16-242		B9														
				TB16-243	SPARE	A10	10	8	3	AAI143										
				TB16-244		B10														
				TB16-245	SPARE	A11	11	8	3	AAI143										
				TB16-246		B11														
				TB16-247	SPARE	A12	12	8	3	AAI143										
				TB16-248		B12														
				TB16-249	SPARE	A13	13	8	3	AAI143										
				TB16-250		B13														
				TB16-251	SPARE	A14	14	8	3	AAI143										
				TB16-252		B14														
				TB16-253	SPARE	A15	15	8	3	AAI143										
				TB16-254		B15														
				TB16-255	SPARE	A16	16	8	3	AAI143										
				TB16-256		B16														
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME		DWG. NO.									
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT		91-AI									
		CH.	IENA	DATE	24/10/08					TITLE		SHT. NO.								
									TF-MC PANEL (MC2)		91									
FILENAME		APP.	DATE	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D								
TF-PANEL		TEOH	24/10/08	REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		92								

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : 				
			HSC	RTD													
			AI	AO													
			DI	DO													
			IS	NIS													
HART	NON HART																

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : <		
			HSC	RTD											
AI	AO														
DI	DO														
IS	NIS														
HART	NON HART														

Signal Type :			Cabinet No :		TF-MC PANEL (MC2)		FCU-0101													
<table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>		HSC					RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model										
				TB18-017	TT901801	A1	1	7	8	ASI133										
				TB18-018		B1														
				TB18-019	TT901802	A2	2	7	8	ASI133										
				TB18-020		B2														
				TB18-021	TT901803	A3	3	7	8	ASI133										
				TB18-022		B3														
				TB18-023	TT901804	A4	4	7	8	ASI133										
				TB18-024		B4														
				TB18-025	TT901805	A5	5	7	8	ASI133										
				TB18-026		B5														
				TB18-027	TT901806	A6	6	7	8	ASI133										
				TB18-028		B6														
				TB18-029	SPARE	A7	7	7	8	ASI133										
				TB18-030		B7														
				TB18-031	SPARE	A8	8	7	8	ASI133										
				TB18-032		B8														

GENERAL DESCRIPTION Panel Wiring Drawing	DR. SHAM	DATE 24/10/08							PROJECT NAME	DWG. NO.
	CH. IENA	DATE 24/10/08							WILMAR SURABAYA FA PROJECT	94-AI
									TITLE TF-MC PANEL (MC2)	SHT. NO. 94
FILENAME TF-PANEL	APP. TEOH	DATE 24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	95

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : TF-MC PANEL (MC1) MCB6-19 0VDC-19 24VDC-19			FCU-0101 SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model											
			TB19-001	SV1401OI	A1	1	6	8	ADV151											
			TB19-002		A17															
			TB19-003	SV1401CI	A2	2	6	8	ADV151											
			TB19-004		A17															
			TB19-005	SV1402OI	A3	3	6	8	ADV151											
			TB19-006		A17															
			TB19-007	SV1402CI	A4	4	6	8	ADV151											
			TB19-008		A17															
			TB19-009	SV1403OI	A5	5	6	8	ADV151											
			TB19-010		A17															
			TB19-011	SV1403CI	A6	6	6	8	ADV151											
			TB19-012		A17															
			TB19-013	SV1404OI	A7	7	6	8	ADV151											
			TB19-014		A17															
			TB19-015	SV1404CI	A8	8	6	8	ADV151											
			TB19-016		A17															
			TB19-017	VS1631OI	A9	9	6	8	ADV151											
			TB19-018		A17															
			TB19-019	VS1631CI	A10	10	6	8	ADV151											
			TB19-020		A17															
			TB19-021	VS1632OI	A11	11	6	8	ADV151											
			TB19-022		A17															
			TB19-023	VS1632CI	A12	12	6	8	ADV151											
			TB19-024		A17															
			TB19-025	VS1633OI	A13	13	6	8	ADV151											
			TB19-026		A17															
			TB19-027	VS1633CI	A14	14	6	8	ADV151											
			TB19-028		A17															
			TB19-029	VS1621OI	A15	15	6	8	ADV151											
			TB19-030		A17															
			TB19-031	VS1621CI	A16	16	6	8	ADV151											
			TB19-032		A17															
GENERAL DESCRIPTION	DR.	SHAM	DATE	24/10/08						PROJECT NAME	DWG. NO.									
Panel Wiring Drawing	CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT	95-DI									
										TITLE	SHT. NO.									
FILENAME	APP.	TEOH	DATE	24/10/08						FA-MC PANEL (MC3)	95									
FA-PANEL										DOC. NO.	CONT'D									
										WSFA-D32-002	96									

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	TF-MC PANEL (MC1)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
			MCB6-19																				
			0VDC-19 24VDC-19						SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model												
				TB19-033	VS1622OI		B1	17	6	8	ADV151												
				TB19-034			B17																
				TB19-035	VS1622CI		B2	18	6	8	ADV151												
				TB19-036			B17																
				TB19-037	VS1623OI		B3	19	6	8	ADV151												
				TB19-038			B17																
				TB19-039	VS1623CI		B4	20	6	8	ADV151												
				TB19-040			B17																
				TB19-041	VS2401OI		B5	21	6	8	ADV151												
				TB19-042			B17																
				TB19-043	VS2401CI		B6	22	6	8	ADV151												
				TB19-044			B17																
				TB19-045	VS2402OI		B7	23	6	8	ADV151												
				TB19-046			B17																
				TB19-047	VS2402CI		B8	24	6	8	ADV151												
				TB19-048			B17																
				TB19-049	VS2403OI		B9	25	6	8	ADV151												
				TB19-050			B17																
				TB19-051	VS2403CI		B10	26	6	8	ADV151												
				TB19-052			B17																
				TB19-053	VS2404OI		B11	27	6	8	ADV151												
				TB19-054			B17																
				TB19-055	VS2404CI		B12	28	6	8	ADV151												
				TB19-056			B17																
				TB19-057	SPARE		B13	29	6	8	ADV151												
				TB19-058			B17																
				TB19-059	SPARE		B14	30	6	8	ADV151												
				TB19-060			B17																
				TB19-061	SPARE		B15	31	6	8	ADV151												
				TB19-062			B17																
				TB19-063	SPARE		B16	32	6	8	ADV151												
				TB19-064			B17																
GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.										
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT		96-DI										
												TITLE	SHT. NO.										
												FA-MC PANEL (MC3)	96										
FILENAME	APP.	TEOH	DATE	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D										
FA-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		97										

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC4)				FCU-0101				
HSC	RTD																				
AI	AO																				
DI	DO																				
IS	NIS																				
HART	NON HART																				
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	SYSTEM I/O																	
				TB	Tag No.	Term.	Channel	Node	Slot	Model											
				TB9-001	FT21401	A1	1	9	1	AAI143											
				TB9-002		B1															
				TB9-003	FT21402	A2	2	9	1	AAI143											
				TB9-004		B2															
				TB9-005	FT21401A	A3	3	9	1	AAI143											
				TB9-006		B3															
				TB9-007	FT21403	A4	4	9	1	AAI143											
				TB9-008		B4															
				TB9-009	FT21405	A5	5	9	1	AAI143											
				TB9-010		B5															
				TB9-011	VI214G08	A6	6	9	1	AAI143											
				TB9-012		B6															
				TB9-013	LT21401	A7	7	9	1	AAI143											
				TB9-014		B7															
				TB9-015	LT21402	A8	8	9	1	AAI143											
				TB9-016		B8															
				TB9-017	LT21403	A9	9	9	1	AAI143											
				TB9-018		B9															
				TB9-019	LT21504	A10	10	9	1	AAI143											
				TB9-020		B10															
				TB9-021	PT21401	A11	11	9	1	AAI143											
				TB9-022		B11															
				TB9-023	PT21401A	A12	12	9	1	AAI143											
				TB9-024		B12															
				TB9-025	PT21402	A13	13	9	1	AAI143											
				TB9-026		B13															
				TB9-027	PT21403	A14	14	9	1	AAI143											
				TB9-028		B14															
				TB9-029	PT21411	A15	15	9	1	AAI143											
				TB9-030		B15															
				TB9-031	PT21412	A16	16	9	1	AAI143											
				TB9-032		B16															

GENERAL DESCRIPTION Panel Wiring Drawing	DR.	SHAM	DATE	24/10/08						PROJECT NAME	DWG. NO.
										WILMAR SURABAYA FA PROJECT	97-AI
	CH.	IENA	DATE	24/10/08						TITLE	SHT. NO.
										FA-MC PANEL (MC4)	97
FILENAME	APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.
TF-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	CONT'D
											WSFA-D32-002
											98

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART			Cabinet No : FA-MC PANEL (MC4)					FCU-0101				
			HSC	RTD																				
			AI	AO																				
			DI	DO																				
			IS	NIS																				
HART	NON HART																							
SYSTEM I/O																								
					FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model									
				TB9-033	TT21401	A1	1	9	2	AAI143														
				TB9-034		B1																		
				TB9-035	TT21402	A2	2	9	2	AAI143														
				TB9-036		B2																		
				TB9-037	TT21403	A3	3	9	2	AAI143														
				TB9-038		B3																		
				TB9-039	TT21404	A4	4	9	2	AAI143														
				TB9-040		B4																		
				TB9-041	TT21505	A5	5	9	2	AAI143														
				TB9-042		B5																		
				TB9-043	TT21401A	A6	6	9	2	AAI143														
				TB9-044		B6																		
				TB9-045	TT21402A	A7	7	9	2	AAI143														
				TB9-046		B7																		
				TB9-047	TT21403A	A8	8	9	2	AAI143														
				TB9-048		B8																		
				TB9-049	TT21404A	A9	9	9	2	AAI143														
				TB9-050		B9																		
				TB9-051	TT21405	A10	10	9	2	AAI143														
				TB9-052		B10																		
				TB9-053	TT21411	A11	11	9	2	AAI143														
				TB9-054		B11																		
				TB9-055	TT21412	A12	12	9	2	AAI143														
				TB9-056		B12																		
				TB9-057	TT21413	A13	13	9	2	AAI143														
				TB9-058		B13																		
				TB9-059	TT21414	A14	14	9	2	AAI143														
				TB9-060		B14																		
				TB9-061	TT21481	A15	15	9	2	AAI143														
				TB9-062		B15																		
				TB9-063	TT21482	A16	16	9	2	AAI143														
				TB9-064		B16																		

GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08							PROJECT NAME		DWG. NO.
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08							WILMAR SURABAYA FA PROJECT		98-AI
						TITLE		SHT. NO.						
												FA-MC PANEL (MC4)		98
FILENAME		APP.	TEOH	DATE	24/10/08	0	FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.		CONT'D
TF-PANEL						REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002		99

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART			Cabinet No : FA-MC PANEL (MC4)					FCU-0101				
			HSC	RTD																				
			AI	AO																				
			DI	DO																				
			IS	NIS																				
HART	NON HART																							
SYSTEM I/O																								
					FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model									
				TB9-65	TT21483	A1	1	9	3	AAI143														
				TB9-66		B1																		
								TB9-67	TT250CT01R	A2	2	9	3	AAI143										
TB9-68	B2																							
				TB9-69	FT250CT01	A3	3	9	3	AAI143														
				TB9-70		B3																		
				TB9-71	TT250CT01S	A4	4	9	3	AAI143														
				TB9-72		B4																		
				TB9-73	FT21410	A5	5	9	3	AAI143														
				TB9-74		B5																		
				TB9-75	VI214SC10	A6	6	9	3	AAI143														
				TB9-76		B6																		
				TB9-77	VI214G10	A7	7	9	3	AAI143														
				TB9-78		B7																		
				TB9-79	AMP115D07	A8	8	9	3	AAI143														
				TB9-80		B8																		
				TB9-81	AMP115D08	A9	9	9	3	AAI143														
				TB9-82		B9																		
				TB9-83	VI214G06	A10	10	9	3	AAI143														
				TB9-84		B10																		
				TB9-85	VI214G07	A11	11	9	3	AAI143														
				TB9-86		B11																		
				TB9-87	VIFN250CT01A	A12	12	9	3	AAI143														
				TB9-88		B12																		
				TB9-89	VIFN250CT01B	A13	13	9	3	AAI143														
				TB9-90		B13																		
				TB9-91	VIPU250CCW01	A14	14	9	3	AAI143														
				TB9-92		B14																		
				TB9-93	VIPU250CCW02	A15	15	9	3	AAI143														
				TB9-94		B15																		
				TB9-95	VIPU250CCW03	A16	16	9	3	AAI143														
				TB9-96		B16																		

 GENERAL DESCRIPTION | | | | | | | | | | | | DR. | | SHAM | | DATE | | 24/10/08 | | | | | | | | | | | | PROJECT NAME | | DWG. NO. | || Panel Wiring Drawing | | | | | | | | | | | | CH. | | IENA | | DATE | | 24/10/08 | | | | | | | | | | | | WILMAR SURABAYA FA PROJECT | | 99-AI | |
|
																										TITLE		SHT. NO.							
																										FA-MC PANEL (MC4)		99							
FILENAME												APP.		TEOH		DATE		24/10/08		0		FIRST ISSUE		24/10/08		SHAM		IENA		TEOH		DOC. NO.		CONT'D	
TF-PANEL																		REV.		DESCRIPTION		DATE		DRAWN BY		CHECK BY		APPR. BY		WSFA-D32-002		100			

Signal Type : <table><tr><td>HSC</td><td>RTD</td></tr><tr><td>AI</td><td>AO</td></tr><tr><td>DI</td><td>DO</td></tr><tr><td>IS</td><td>NIS</td></tr><tr><td>HART</td><td>NON HART</td></tr></table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : 	
			HSC	RTD										
			AI	AO										
			DI	DO										
			IS	NIS										
HART	NON HART													

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC4)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
			MCB3-14																				
			0VDC-14 24VDC-14						SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model												
				TB11-001	LAH21401S		A1	1	9	5	ADV151												
			TB11-002	A17																			
				TB11-003	LAH21402S		A2	2	9	5	ADV151												
			TB11-004	A17																			
				TB11-005	LAL21404S		A3	3	9	5	ADV151												
			TB11-006	A17																			
				TB11-007	LAH21404S		A4	4	9	5	ADV151												
			TB11-008	A17																			
				TB11-009	LAL21405S		A5	5	9	5	ADV151												
			TB11-010	A17																			
				TB11-011	LAH21505S		A6	6	9	5	ADV151												
			TB11-012	A17																			
				TB11-013	LAH21506S		A7	7	9	5	ADV151												
			TB11-014	A17																			
				TB11-015	PAH21502S		A8	8	9	5	ADV151												
			TB11-016	A17																			
				TB11-017	214G01-RN		A9	9	9	5	ADV151												
			TB11-018	A17																			
				TB11-019	214G01-TR		A10	10	9	5	ADV151												
			TB11-020	A17																			
				TB11-021	214G02-RN		A11	11	9	5	ADV151												
			TB11-022	A17																			
				TB11-023	214G02-TR		A12	12	9	5	ADV151												
			TB11-024	A17																			
				TB11-025	214G03-RN		A13	13	9	5	ADV151												
			TB11-026	A17																			
				TB11-027	214G03-TR		A14	14	9	5	ADV151												
			TB11-028	A17																			
				TB11-029	214G04-RN		A15	15	9	5	ADV151												
			TB11-030	A17																			
				TB11-031	214G04-TR		A16	16	9	5	ADV151												
			TB11-032	A17																			
GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.										
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT		101-DI										
FILENAME		APP.	TEOH	DATE	24/10/08						TITLE		SHT. NO.										
FA-PANEL											FA-MC PANEL (MC4)		101										
											DOC. NO.		CONT'D										
											WSFA-D32-002		102										

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC4)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
			MCB3-14																				
			0VDC-14 24VDC-14						SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model												
				TB11-033	214G05-RN		B1	17	9	5	ADV151												
				TB11-034			B17																
				TB11-035	214G05-TR		B2	18	9	5	ADV151												
				TB11-036			B17																
				TB11-037	214G06-RN		B3	19	9	5	ADV151												
				TB11-038			B17																
				TB11-039	214G06-TR		B4	20	9	5	ADV151												
				TB11-040			B17																
				TB11-041	214G07-RN		B5	21	9	5	ADV151												
				TB11-042			B17																
				TB11-043	214G07-TR		B6	22	9	5	ADV151												
				TB11-044			B17																
				TB11-045	214G08-RN		B7	23	9	5	ADV151												
				TB11-046			B17																
				TB11-047	214G08-TR		B8	24	9	5	ADV151												
				TB11-048			B17																
				TB11-049	214G10-RN		B9	25	9	5	ADV151												
				TB11-050			B17																
				TB11-051	214G10-TR		B10	26	9	5	ADV151												
				TB11-052			B17																
				TB11-053	214G14-RN		B11	27	9	5	ADV151												
				TB11-054			B17																
				TB11-055	214G14-TR		B12	28	9	5	ADV151												
				TB11-056			B17																
				TB11-057	214SC10-RN		B13	29	9	5	ADV151												
				TB11-058			B17																
				TB11-059	214SC10-TR		B14	30	9	5	ADV151												
				TB11-060			B17																
				TB11-061	215G51-RN		B15	31	9	5	ADV151												
				TB11-062			B17																
				TB11-063	215G51-TR		B16	32	9	5	ADV151												
				TB11-064			B17																

GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08						PROJECT NAME	DWG. NO.
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT	102-DI
											TITLE	SHT. NO.
											FA-MC PANEL (MC4)	102
FILENAME	APP.	TEOH	DATE	24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO.	CONT'D
FA-PANEL					REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY	WSFA-D32-002	103

Signal Type : <table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	Cabinet No : FA-MC PANEL (MC4) MCB3-15 0VDC-15 24VDC-15			FCU-0101 SYSTEM I/O				
HSC	RTD																			
AI	AO																			
DI	DO																			
IS	NIS																			
HART	NON HART																			
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.	Term.	Channel	Node	Slot	Model											
			TB11-065	215G52-RN	A1	1	9	6	ADV151											
			TB11-066		A17															
			TB11-067	215G52-TR	A2	2	9	6	ADV151											
			TB11-068		A17															
			TB11-069	SV250CT01OI	A3	3	9	6	ADV151											
			TB11-070		A17															
			TB11-071	SV250CT01CI	A4	4	9	6	ADV151											
			TB11-072		A17															
			TB11-073	FN250CT01CSTI	A5	5	9	6	ADV151											
			TB11-074		A17															
			TB11-075	FN250CT01CTRI	A6	6	9	6	ADV151											
			TB11-076		A17															
			TB11-077	FN250CT01BSTI	A7	7	9	6	ADV151											
			TB11-078		A17															
			TB11-079	FN250CT01BTRI	A8	8	9	6	ADV151											
			TB11-080		A17															
			TB11-081	FN250CT01ASTI	A9	9	9	6	ADV151											
			TB11-082		A17															
			TB11-083	FN250CT01ATRI	A10	10	9	6	ADV151											
			TB11-084		A17															
			TB11-085	PU250CCW01STI	A11	11	9	6	ADV151											
			TB11-086		A17															
			TB11-087	PU250CCW01TRI	A12	12	9	6	ADV151											
			TB11-088		A17															
			TB11-089	PU250CCW02STI	A13	13	9	6	ADV151											
			TB11-090		A17															
			TB11-091	PU250CCW02TRI	A14	14	9	6	ADV151											
			TB11-092		A17															
			TB11-093	PU250CCW03STI	A15	15	9	6	ADV151											
			TB11-094		A17															
		TB11-095	PU250CCW03TRI	A16	16	9	6	ADV151												
		TB11-096		A17																
GENERAL DESCRIPTION Panel Wiring Drawing	DR. SHAM	DATE 24/10/08							PROJECT NAME WILMAR SURABAYA FA PROJECT	DWG. NO. 103-DI										
	CH. IENA	DATE 24/10/08							TITLE FA-MC PANEL (MC4)	SHT. NO. 103										
FILENAME FA-PANEL	APP. TEOH	DATE 24/10/08		FIRST ISSUE	24/10/08	SHAM	IENA	TEOH	DOC. NO. WSFA-D32-002	CONT'D 104										
			REV.	DESCRIPTION	DATE	DRAWN BY	CHECK BY	APPR. BY												

Signal Type :			Cabinet No :																				
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC4)						FCU-0101				
HSC	RTD																						
AI	AO																						
DI	DO																						
IS	NIS																						
HART	NON HART																						
			MCB3-15																				
			0VDC-15 24VDC-15						SYSTEM I/O														
FIELD CABLE		CROSS WIRING TB	CROSS WIRE NO.	TB	Tag No.		Term.	Channel	Node	Slot	Model												
				TB11-097	LSLA250CT01S		B1	17	9	6	ADV151												
				TB11-098			B17																
				TB11-099	LS50WW4S		B2	18	9	6	ADV151												
				TB11-100			B17																
				TB11-101	SPARE		B3	19	9	6	ADV151												
				TB11-102			B17																
				TB11-103	SPARE		B4	20	9	6	ADV151												
				TB11-104			B17																
				TB11-105	SPARE		B5	21	9	6	ADV151												
				TB11-106			B17																
				TB11-107	SPARE		B6	22	9	6	ADV151												
				TB11-108			B17																
				TB11-109	SPARE		B7	23	9	6	ADV151												
				TB11-110			B17																
				TB11-111	SPARE		B8	24	9	6	ADV151												
				TB11-112			B17																
				TB11-113	SPARE		B9	25	9	6	ADV151												
				TB11-114			B17																
				TB11-115	SPARE		B10	26	9	6	ADV151												
				TB11-116			B17																
				TB11-117	SPARE		B11	27	9	6	ADV151												
				TB11-118			B17																
				TB11-119	SPARE		B12	28	9	6	ADV151												
				TB11-120			B17																
				TB11-121	SPARE		B13	29	9	6	ADV151												
				TB11-122			B17																
				TB11-123	SPARE		B14	30	9	6	ADV151												
				TB11-124			B17																
		TB11-125	SPARE		B15	31	9	6	ADV151														
		TB11-126			B17																		
		TB11-127	SPARE		B16	32	9	6	ADV151														
		TB11-128			B17																		
GENERAL DESCRIPTION		DR.	SHAM	DATE	24/10/08						PROJECT NAME		DWG. NO.										
Panel Wiring Drawing		CH.	IENA	DATE	24/10/08						WILMAR SURABAYA FA PROJECT		104-DI										
FILENAME		APP.	TEOH	DATE	24/10/08						TITLE		SHT. NO.										
FA-PANEL											FA-MC PANEL (MC4)		104										
											DOC. NO.		CONT'D										
											WSFA-D32-002		105										

Signal Type :			Cabinet No :										FCU-0101														
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC4)										SYSTEM I/O				
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
			MCB3-16					MCB3-17																			
			OVDC-16					24VDC-16					24VDC-17														
			OVDC-17																								
FIELD CABLE	CROSS WIRING TB	CROSS WIRE NO.	TB					IP-R		Tag No.	Term.	Channel	NODE	SLOT	MODEL												
			TB12-001					14		A2	A1																
			TB12-002					11	R7-1	A1		1	9	7	ADV551												
			TB12-003					14		A2	A2																
			TB12-004					11	R7-2	A1		2	9	7	ADV551												
			TB12-005					14		A2	A3																
			TB12-006					11	R7-3	A1		3	9	7	ADV551												
			TB12-007					14		A2	A4																
			TB12-008					11	R7-4	A1		4	9	7	ADV551												
			TB12-009					14		A2	A5																
			TB12-010					11	R7-5	A1		5	9	7	ADV551												
			TB12-011					14		A2	A6																
			TB12-012					11	R7-6	A1		6	9	7	ADV551												
			TB12-013					14		A2	A7																
			TB12-014					11	R7-7	A1		7	9	7	ADV551												
			TB12-015					14		A2	A8																
			TB12-016					11	R7-8	A1		8	9	7	ADV551												
			TB12-017					14		A2	A9																
			TB12-018					11	R7-9	A1		9	9	7	ADV551												
			TB12-019					14		A2	A10																
			TB12-020					11	R7-10	A1		10	9	7	ADV551												
			TB12-021					14		A2	A11																
			TB12-022					11	R7-11	A1		11	9	7	ADV551												
			TB12-023					14		A2	A12																
			TB12-024					11	R7-12	A1		12	9	7	ADV551												
			TB12-025					14		A2	A13																
			TB12-026					11	R7-13	A1		13	9	7	ADV551												
			TB12-027					14		A2	A14																
			TB12-028					11	R7-14	A1		14	9	7	ADV551												
			TB12-029					14		A2	A15																
			TB12-030					11	R7-15	A1		15	9	7	ADV551												
			TB12-031					14		A2	A16																
			TB12-032					11	R7-16	A1		16	9	7	ADV551												
											A17	-															
											A18	+															
GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME					DWG. NO.													
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT					105-DO													
		CH.	DATE						TITLE					SHT NO													
		IENA	24/10/08						FA-MC PANEL (MC4)					105													
FILENAME		APP.	DATE	REV.	FIRST ISSUE	DATE	DRAWN BY	CHECK BY	APPR. BY	DOC. NO.					CONT NO												
TF-PANEL		TEOH	24/10/08			24/10/08	SHAM	IENA	TEOH	WSFA-D32-002					106												

Signal Type :			Cabinet No :										FCU-0101														
<table border="1"> <tr><td>HSC</td><td>RTD</td></tr> <tr><td>AI</td><td>AO</td></tr> <tr><td>DI</td><td>DO</td></tr> <tr><td>IS</td><td>NIS</td></tr> <tr><td>HART</td><td>NON HART</td></tr> </table>			HSC	RTD	AI	AO	DI	DO	IS	NIS	HART	NON HART	FA-MC PANEL (MC4)														
HSC	RTD																										
AI	AO																										
DI	DO																										
IS	NIS																										
HART	NON HART																										
			MCB3-16					MCB3-17					SYSTEM I/O														
			OVDC-16					24VDC-16					24VDC-17					OVDC-17									
FIELD CABLE			CROSS WIRING TB	CROSS WIRE NO.	TB				IP-R		Tag No.		Term.	Channel	NODE	SLOT	MODEL										
					TB12-033				14	R7-17	A2	FN250CT01AO	B1	17	9	7	ADV551										
					TB12-034				11		A1																
					TB12-035				14	R7-18	A2	PU250CCW01O	B2	18	9	7	ADV551										
					TB12-036				11		A1																
					TB12-037				14	R7-19	A2	PU250CCW02O	B3	19	9	7	ADV551										
					TB12-038				11		A1																
					TB12-039				14	R7-20	A2	PU250CCW03O	B4	20	9	7	ADV551										
					TB12-040				11		A1																
					TB12-041				14	R7-21	A2	SPARE	B5	21	9	7	ADV551										
					TB12-042				11		A1																
					TB12-043				14	R7-22	A2	SPARE	B6	22	9	7	ADV551										
					TB12-044				11		A1																
					TB12-045				14	R7-23	A2	SPARE	B7	23	9	7	ADV551										
					TB12-046				11		A1																
					TB12-047				14	R7-24	A2	SPARE	B8	24	9	7	ADV551										
					TB12-048				11		A1																
					TB12-049				14	R7-25	A2	SPARE	B9	25	9	7	ADV551										
					TB12-050				11		A1																
					TB12-051				14	R7-26	A2	SPARE	B10	26	9	7	ADV551										
					TB12-052				11		A1																
					TB12-053				14	R7-27	A2	SPARE	B11	27	9	7	ADV551										
					TB12-054				11		A1																
					TB12-055				14	R7-28	A2	SPARE	B12	28	9	7	ADV551										
					TB12-056				11		A1																
					TB12-057				14	R7-29	A2	SPARE	B13	29	9	7	ADV551										
					TB12-058				11		A1																
					TB12-059				14	R7-30	A2	SPARE	B14	30	9	7	ADV551										
					TB12-060				11		A1																
					TB12-061				14	R7-31	A2	SPARE	B15	31	9	7	ADV551										
					TB12-062				11		A1																
					TB12-063				14	R7-32	A2	SPARE	B16	32	9	7	ADV551										
					TB12-064				11		A1																
													B17	-	9	7	ADV551										
													B18	+													

GENERAL DESCRIPTION		DR.	DATE						PROJECT NAME				DWG. NO.
Panel Wiring Drawing		SHAM	24/10/08						WILMAR SURABAYA FA PROJECT				106-DO
		CH.	DATE						TITLE				SHT NO
		IENA	24/10/08						FA-MC PANEL (MC4)				106
FILENAME	APP.	DATE	REV.	FIRST ISSUE	DATE	DRAWN BY	CHECK BY	APPR. BY	DOC. NO.				CONT NO
TF-PANEL	TEOH	24/10/08			24/10/08	SHAM	IENA	TEOH	WSFA-D32-002				-