


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

1	2	3	4	5	6	7	8								
A								A							
B								B							
C	UniSec Medium Voltage Switchgear PT MULTIMAS NABATI ASAHAN MVD-10&MVD-11 20kV Centralized MVD Room SCHEMATIC DIAGRAM DRC BUS PT H08							C							
D								D							
E								E							
F								F							
				Date Prep.	15.11.2018	PROJECT TITLE		ABB	EPMV	COVER SHEET	Scale		= H08		
				Prepared	YR	MV Switchgear for MNA Serang Plant					PT. ABB Sakti Industri	MVD-10&MVD-11 20kV Centralized MVD Room	Customer	PT Multimas Nabati Asahan	& 308
00	Issued for Approval	04.01.19	YR	Checked	AW			Based on: BE318042	SCHEMATIC DIAGRAM				Drawing Nbr.	IDUNISEC-BE318042-301	Sh. 1
Ind.	Revision	Date	Name	Approved	AI					DRC BUS PT	Customer Doc. Nbr.			Cont. 16	
1		2		3		4		5			6		7		8


WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

	1	2	3	4	5	6	7	8							
A	SHEET INDEX								A						
B	PAGE		PAGE NAME			REVISION			B						
	==MVD-10_MVD-11=H08&308/1		COVER SHEET			00									
	==MVD-10_MVD-11=H08&308/2		Index of Sheet			00									
	==MVD-10_MVD-11=H08&308/3		REFERENCE DESIGNATIONS			00									
	==MVD-10_MVD-11=H08&308/4		REFERENCE DESIGNATIONS			00									
	==MVD-10_MVD-11=H08&308/5		REFERENCE DESIGNATIONS			00									
	==MVD-10_MVD-11=H08&308/6		REFERENCE DESIGNATIONS			00									
	==MVD-10_MVD-11=H08&308/7		DISTRIBUTION OF AUXILIARY CIRCUITS			00									
	==MVD-10_MVD-11=H08&308/8		MAIN CIRCUITS			00									
	==MVD-10_MVD-11=H08&308/9		LV DOOR LAYOUT			00									
	==MVD-10_MVD-11=H08&308/10		LV BOX LAYOUT			00									
	==MVD-10_MVD-11=H08&308/11		PART LIST			00									
	==MVD-10_MVD-11=H08&308/12		Terminal diagram ==MVD-10_MVD-11=H08+-XDI												
	==MVD-10_MVD-11=H08&308/13		Terminal diagram ==MVD-10_MVD-11=H08+-XDI2												
	==MVD-10_MVD-11=H08&308/14		Terminal diagram ==MVD-10_MVD-11=H08+-XDI6												
	==MVD-10_MVD-11=H08&308/15		Terminal diagram ==MVD-10_MVD-11=H08+-XDV												
C	==MVD-10_MVD-11=H08&308/16		Terminal diagram ==MVD-10_MVD-11=H08+-XDX						C						
D									D						
E									E						
F					Date Prep.	15.11.2018	PROJECT TITLE		ABB	EPMV	Index of Sheet MVD-10&MVD-11 20kV Centralized MVD Room SCHEMATIC DIAGRAM DRC BUS PT	Scale		= H08	F
					Prepared	YR	MV Switchgear for MNA Serang Plant					Customer	PT Multimas Nabati Asahan	& 308	
00	Issued for Approval	04.01.19	YR	Checked	AW			PT. ABB Sakti Industri	Drawing Nbr.	IDUNISEC-BE318042-301		Sh.	2		
Ind.	Revision	Date	Name	Approved	AI	Based on: BE318042			Customer Doc. Nbr.		Cont.	16			
	1	2	3	4	5	6	7	8							

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

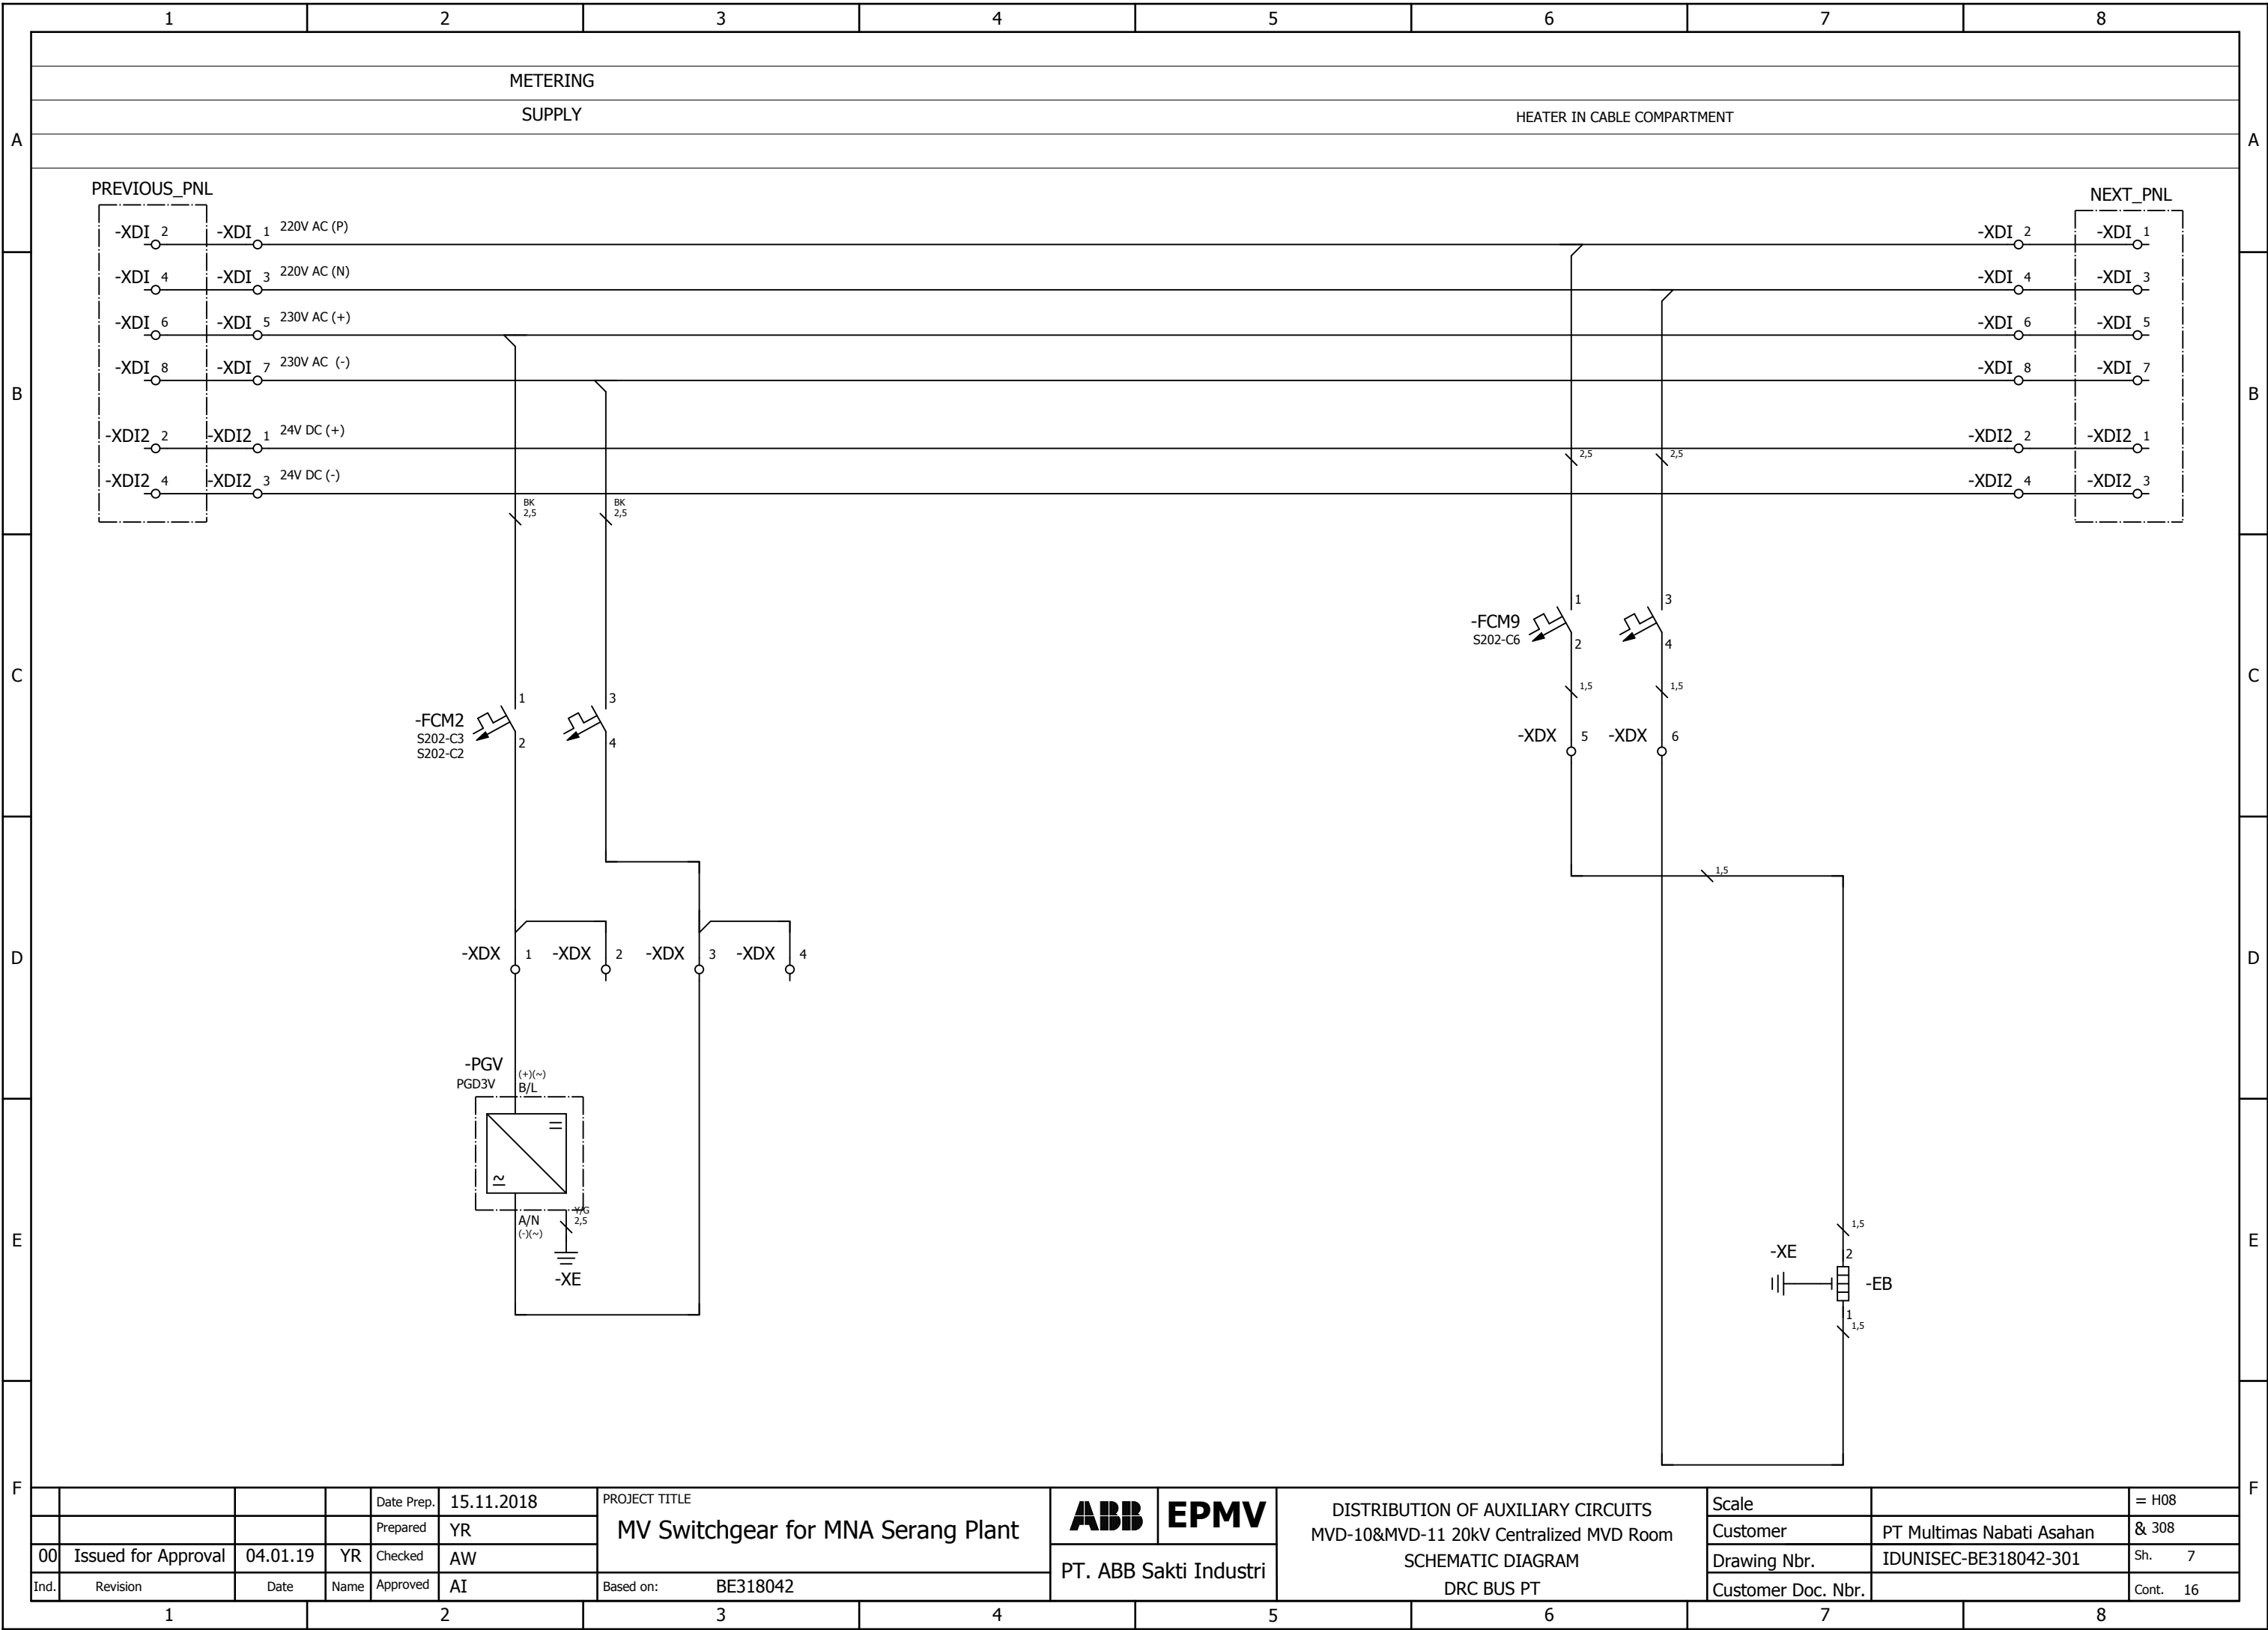



WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

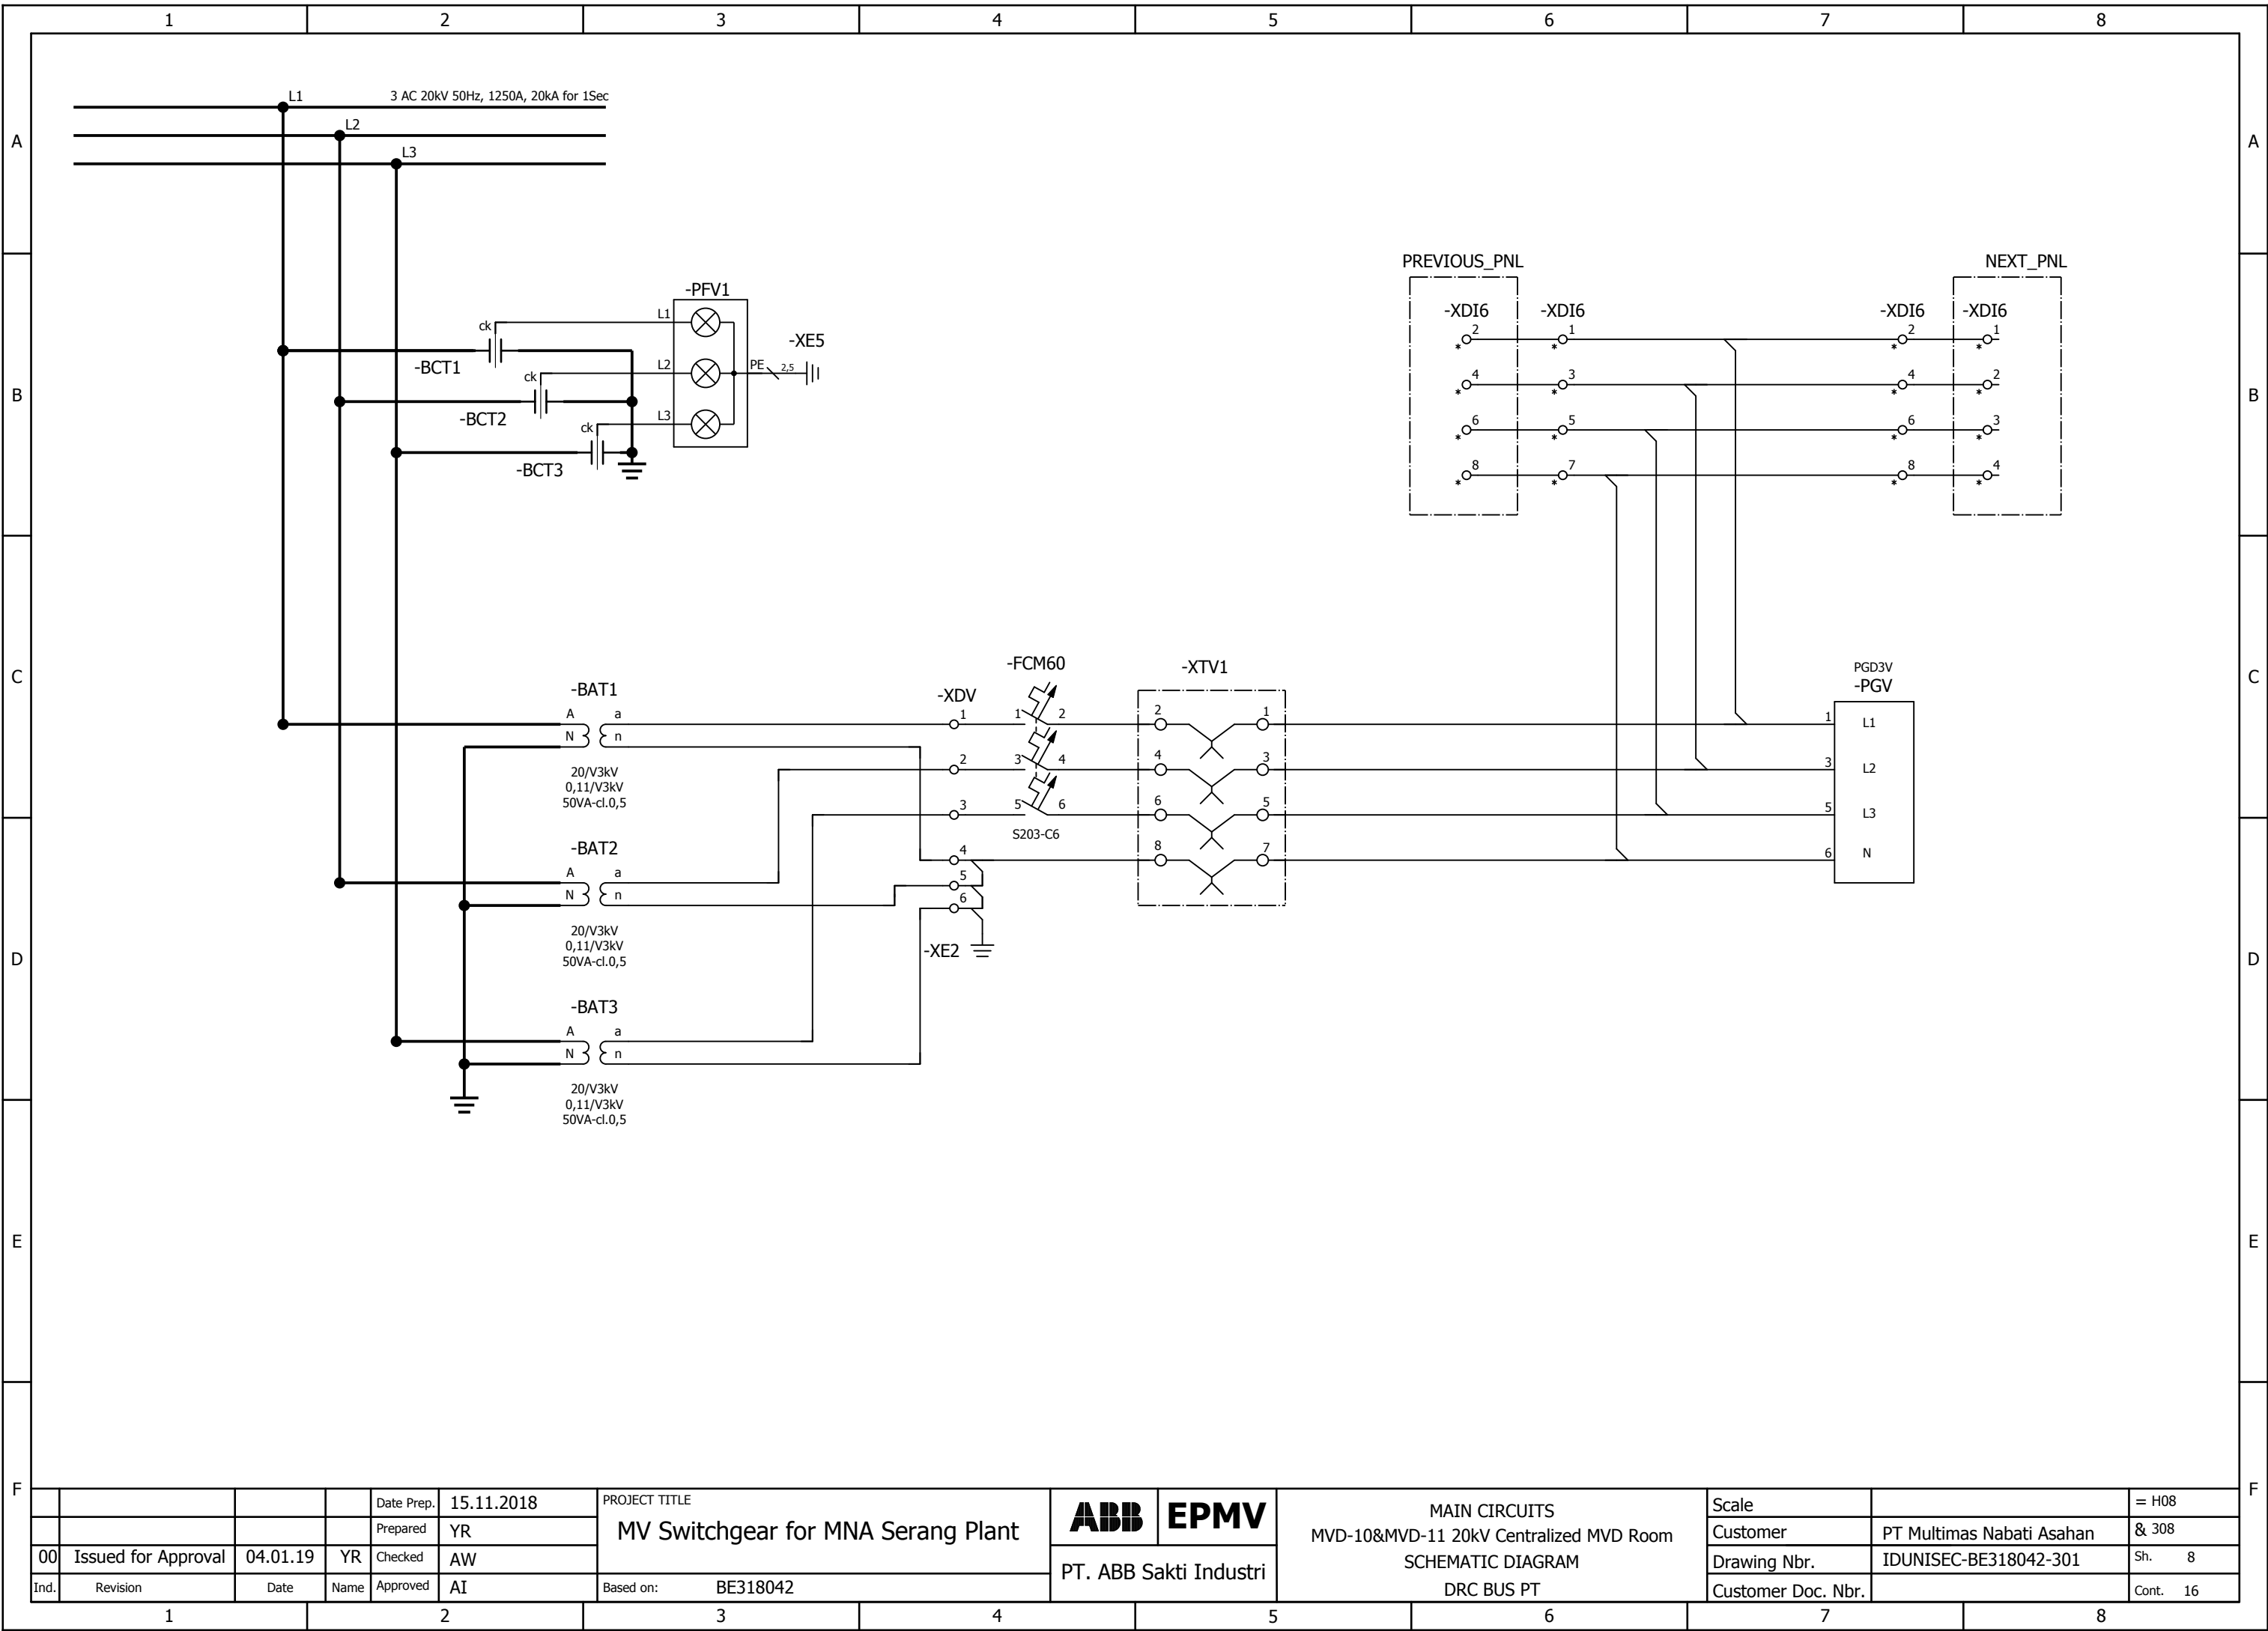

				Date Prep.	15.11.2018	PROJECT TITLE MV Switchgear for MNA Serang Plant	ABB	EPMV	MAIN CIRCUITS MVD-10&MVD-11 20kV Centralized MVD Room SCHEMATIC DIAGRAM DRC BUS PT	Scale		= H08
				Prepared	YR					Customer	PT Multimas Nabati Asahan	& 308
00	Issued for Approval	04.01.19	YR	Checked	AW		Drawing Nbr.	IDUNISEC-BE318042-301		Sh. 8		
Ind.	Revision	Date	Name	Approved	AI	Based on:	BE318042	PT. ABB Sakti Industri		Customer Doc. Nbr.		Cont. 16

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

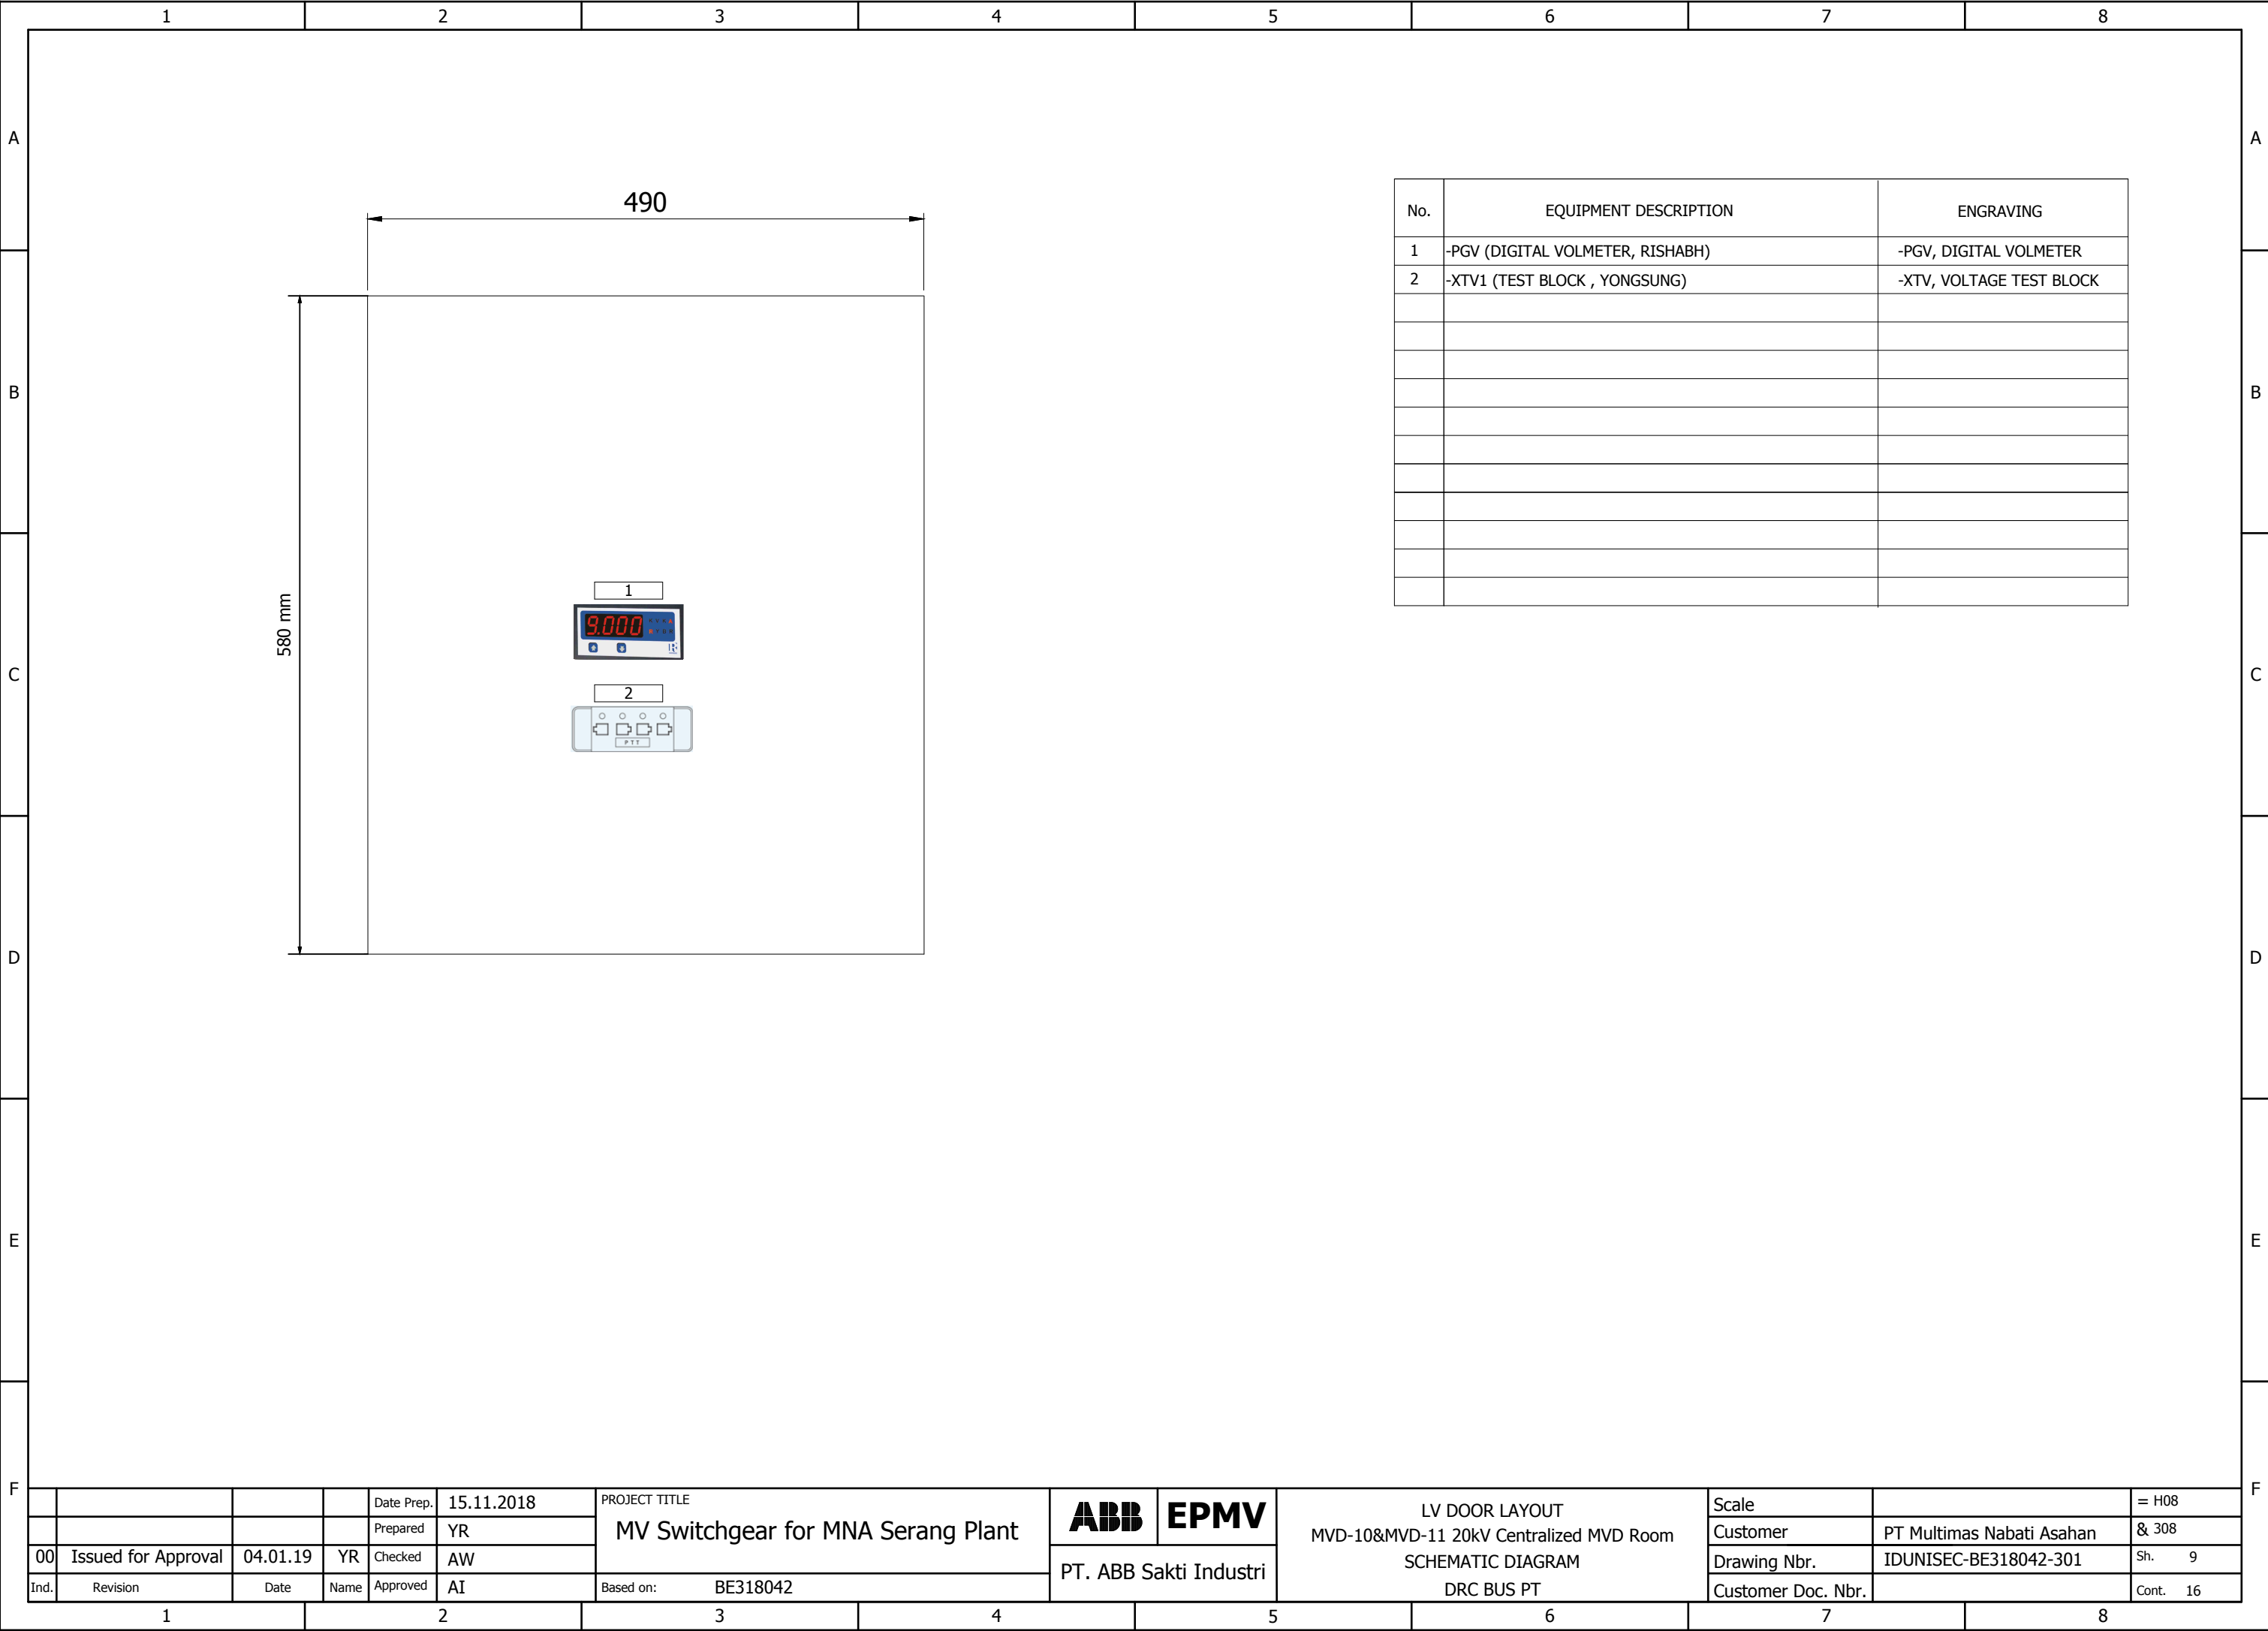

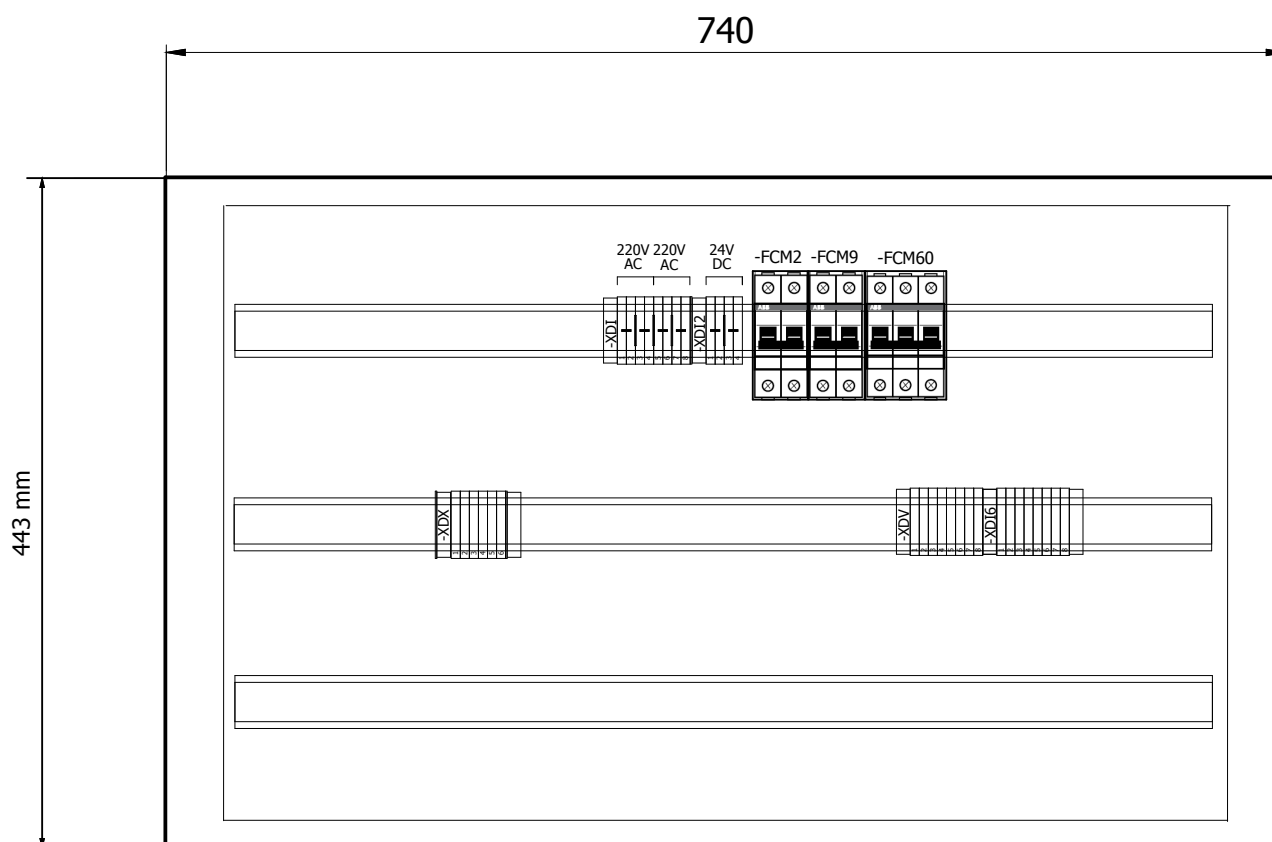[illegible]

				Date Prep.	15.11.2018	PROJECT TITLE MV Switchgear for MNA Serang Plant	 	LV BOX LAYOUT MVD-10&MVD-11 20kV Centralized MVD Room SCHEMATIC DIAGRAM DRC BUS PT	Scale		= H08
				Prepared	YR				Customer	PT Multimas Nabati Asahan	& 308
00	Issued for Approval	04.01.19	YR	Checked	AW				Drawing Nbr.	IDUNISEC-BE318042-301	Sh. 10
Ind.	Revision	Date	Name	Approved	AI	Customer Doc. Nbr.			Cont. 16		
Based on: BE318042						PT. ABB Sakti Industri					

WE RESERVE ALL RIGHTS IN THIS DOCUMENT AND IN THE INFORMATION CONTAINED THEREIN. REPRODUCTION, USE OR DISCLOSURE TO THIRD PARTIES WITHOUT EXPRESS AUTHORITY IS STRICTLY FORBIDDEN.

1		2		3		4		5		6		7		8		
Summarized parts list															IDABB_F02_005-IDABB	
															Carry over: 0.00	
TAG ID		DESCRIPTION					MANUFACTUR/BRAND		PART NUMBER		QUANTITY		REMARKS			
-EB		HEATER 230VAC, 50W					SANYANG		CDXN010033P0009		1		/7.7:E			
-FCM2		MCB S202-C2 MCB. 2P, 2A					ABB		2CDS252001R0024		1		/7.2:C			
-FCM9		MCB S202-C6 MCB. 2P, 6A					ABB		2CDS252001R0064		1		/7.6:C			
-FCM60		MCB S203-C6 MCB. 3P, 6A					ABB		2CDS253001R0064		1		/8.4:C			
-PGV		Digital AC Voltmeter Model : DPM PGD3V, 48 X 96 MM					RISHABH		DPM PGD3V		1		/7.2:D			
-XTV1		Voltage Test Block Rated Current : 10A, 250V; Mounting : Flush Mounting					YONGSUNG		YSPTT-04C		1		/8.5:C			

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]