

power supply	:	3x380V/50Hz
control voltage	:	220V
signal voltage	:	220V / 24V
standard	:	CENELEC HD 384 / EN 50156-1 (VDE 0100) (VDE 0116)
system of protection	:	IP54



Gekakonus®

Internet: www.gekakonus.net

E-mail: info@gekakonus.net

Phone +49 (0) 721 / 94374-0

Fax +49 (0) 721 / 9437444



wiring diagram

customer : 

part of plant : NUK-HP-3500

drawing no. : 10-9841

cabinet : 1000x1400x400mm WHD

1		2		3	4	5	6	7	8
	boiler	type		sheet	name of sheet		date	special memo	
A	NUK-HP	3500		0	cover 1		19.02.2018		
	NUK-HP	3500		0A	cover 2		19.02.2018		
	NUK-HP	3500		0B	table of contents		19.02.2018		
	NUK-HP	3500		0C	table of contents		19.02.2018		
	NUK-HP	3500		A1	part list		19.02.2018		
	NUK-HP	3500		A2	part list		19.02.2018		
B	NUK-HP	3500		A3	part list		19.02.2018		
	NUK-HP	3500		B	arrangement drawing mounting plate		19.02.2018		
	NUK-HP	3500		C	arrangement drawing panel door		19.02.2018		
	NUK-HP	3500		1	feeding		19.02.2018		
	NUK-HP	3500		2	emergency stop		19.02.2018		
	NUK-HP	3500		3	primary circuit		19.02.2018		
	NUK-HP	3500		4	primary circuit		19.02.2018		
	NUK-HP	3500		5	pump control		19.02.2018		
	NUK-HP	3500		6	burner motor control		19.02.2018		
	NUK-HP	3500		7	cooling air fan, preheater control		19.02.2018		
C	NUK-HP	3500		8	SPS-LOGO control		19.02.2018		
	NUK-HP	3500		9	safety circuit		19.02.2018		
	NUK-HP	3500		10	safety circuit		19.02.2018		
	NUK-HP	3500		11	safety circuit		19.02.2018		
	NUK-HP	3500		12	safety circuit		19.02.2018		
	NUK-HP	3500		13	safety circuit		19.02.2018		
	NUK-HP	3500		14	safety circuit		19.02.2018		
	NUK-HP	3500		15	safety circuit		19.02.2018		
	NUK-HP	3500		16	digital inputs LOGO-SPS		19.02.2018		
	NUK-HP	3500		17	digital outputs LOGO-SPS		19.02.2018		
D	NUK-HP	3500		18	switch board fan		19.02.2018		
	NUK-HP	3500		19	burner control		19.02.2018		
	NUK-HP	3500		20	burner control		19.02.2018		
	NUK-HP	3500		21	burner control		19.02.2018		
	NUK-HP	3500		22	burner control		19.02.2018		
	NUK-HP	3500		23	burner control		19.02.2018		
	NUK-HP	3500		24	burner control		19.02.2018		
	NUK-HP	3500		25	burner control		19.02.2018		
	NUK-HP	3500		26	burner control		19.02.2018		
	NUK-HP	3500		27	burner control		19.02.2018		
E	NUK-HP	3500		28	burner control		19.02.2018		
	NUK-HP	3500		29	burner control		19.02.2018		
	NUK-HP	3500		30	burner control		19.02.2018		
	NUK-HP	3500		31	burner control		19.02.2018		
	NUK-HP	3500		32	burner control		19.02.2018		
	NUK-HP	3500		33	burner control		19.02.2018		
	NUK-HP	3500		34	burner control		19.02.2018		
	NUK-HP	3500		35	burner control		19.02.2018		
	NUK-HP	3500		36	messages		19.02.2018		
	NUK-HP	3500		37	pot. free cont.		19.02.2018		
F	NUK-HP	3500		38	control voltage 24VDC		19.02.2018		
	NUK-HP	3500		39	spare		19.02.2018		
	NUK-HP	3500		40	connection diagram -XP,-X1,-X2,-X3		19.02.2018		
alteration		date	Name	Norm	substitute through	substitute for	origin	10-9841	
								sheet 0B	
								53 Bl.	

1		2		3	4	5	6	7	8
boiler		type		sheet	name of sheet		date	special memo	
A	NUK-HP	3500		41	connection diagram -X4,-X6,-XL,-XN		19.02.2018		
	NUK-HP	3500		42	connection diagram -XS4,-XS5,-XS6,-XS7,-XS8,-XS9		19.02.2018		
	NUK-HP	3500		43	connection diagram -XS4,-XS5,-XS6		19.02.2018		
	NUK-HP	3500		44	connection diagram -XS7,-XS8,-XS9,-XS10		19.02.2018		
B									
C									
D									
E									
F									

date		04.04.2018						wiring diagram SES-18-3875 NUK-HP 3500 95bar table of contents				10-9841		sheet 0C 53 Bl.		
proc.		E.H.														
rev.																
alteration	date	Name	Norm	substitute through	substitute for	origin										

part list

equipment identifier	item no.	class	manufacturer	Typ	comment	refer to	
-A82	299310	A	SI	6ED1052-1FB00-0BA8	SIEMENS-LOGO	/8.B2	
-A84	299313	A	SI	6ED1055-1FB00-0BA1	SIEMENS-LOGO Erw.8DI/8DA	/8.B4	
-A85	299312	A	SI	6ED1055-1MA00-0BA0	SIEMENS-LOGO Erw.	/8.B5	
-A87	299314	A	SI	6ED1055-4MH00-0BA0	LOGO-08-Text Display	/8.B7	
-A191	0330000500	A	WE	W-FM 100	combustion manager	/19.A1	
-A213	0330000502	A	WE	ABE	comb.manager indication-/operation unit	/21.D3	
-F13	0040003200	F	FI	7P.23.8.275.1020	surge protection device	/1.D3	
-F14	0040000451	F	KM	FAZ-S2/1	capacity breaker control voltage	/1.E3	
-F14.1	0040000451	F	KM	FAZ-S2/1	capacity breaker control voltage	/1.E4	
-F15	0040000454	F	KM	FAZ-S6/1	capacity breaker control voltage	/1.E4	
-F15.1	0040000453	F	KM	FAZ-S4/1	capacity breaker control voltage	/1.E5	
-F16	0040000454	F	KM	FAZ-S6/1	capacity breaker control voltage	/1.C6	
-F17	0040000451	F	KM	FAZ-S2/1	capacity breaker control voltage	/1.C7	
-F17.1	0040000451	F	KM	FAZ-S2/1	capacity breaker control voltage	/1.C7	
-F100	123207	F	GE	NRS 1-50	water level limiter	/11.B2	
-F182	400004	F	RIT	SK 3110.00	temperature controller switch board fan	/18.A2	
-G385	299000	G	IS	SNT-A36	power supply	/38.A4	
-H27	0040001330	H	KM	M22-L-G	signal lamp	/2.D7	
-H56	0040001310	H	KM	M22-L-R	signal lamp	/5.D6	
-H74	0040001310	H	KM	M22-L-R	signal lamp	/7.D4	
-H76	0040001330	H	KM	M22-L-G	signal lamp	/7.D6	
-H177	0230000102	H	WER	118 068 28,230V	hooter	/17.D7	
-H247	0040001310	H	KM	M22-L-R	signal lamp	/24.E7	
-H248	0040001310	H	KM	M22-L-R	signal lamp	/24.E8	
-H254	0040001330	H	KM	M22-L-G	signal lamp	/25.D4	
-H291	0040001330	H	KM	M22-L-G	signal lamp	/29.D1	
-H293	0040001330	H	KM	M22-L-G	signal lamp	/29.D3	
-H367	0040001330	H	KM	M22-L-G	signal lamp	/36.D7	
-H368	0040001320	H	KM	M22-L-Y	signal lamp	/36.D8	
-K23	0030000133	K	ZA	SR3D AC/DC24V	emergency-stop relay	/2.C2	
-K24	0041000016	K	KM	DILA-22,24VDC	auxiliary relay	/2.E4	
-K25	0030000020	K	ABB	NF31E-11,24VDC	auxiliary relay	/2.E5	
-K26	0040003051	K	FI	55.32 8 230 00 40	auxiliary relay	/2.D6	
-K53	0041000030	K	KM	DILM9-10	main contactor	/5.E3	

comments :

part list


equipment identifier	item no.	class	manufacturer	Typ	comment	refer to	
-K62	0041000034	K	KM	DILM17-10	main contactor	/6.E2	
-K63	0040000047	K	KM	ETR4-51-A	timing relay	/6.E3	
-K64	0041000032	K	KM	DILM12-10	main contactor	/6.E4	
-K65	0041000032	K	KM	DILM12-10	main contactor	/6.E5	
-K72	0041000030	K	KM	DILM9-10	main contactor	/7.E2	
-K73	0040003056	K	FI	55.34 8 230 50 40	auxiliary relay	/7.E3	
-K75	0041000034	K	KM	DILM17-10	main contactor	/7.E5	
-K77	0041000034	K	KM	DILM17-10	main contactor	/7.E7	
-K97	0041000003	K	KM	DILA-22	auxiliary relay	/9.E7	
-K98	0030000022	K	ABB	NF22E-13	auxiliary relay	/9.E8	
-K103	0041000003	K	KM	DILA-22	auxiliary relay	/10.D3	
-K104	0030000022	K	ABB	NF22E-13	auxiliary relay	/10.D4	
-K127	0041000003	K	KM	DILA-22	auxiliary relay	/12.E7	
-K128	0030000022	K	ABB	NF22E-13	auxiliary relay	/12.E8	
-K135	0040003054	K	FI	55.32 9 024 00 40	auxiliary relay	/13.E5	
-K147	0041000002	K	KM	DILA-31	auxiliary relay	/14.E7	
-K148	0030000022	K	ABB	NF22E-13	auxiliary relay	/14.E8	
-K152	0030000002	K	ABB	N 31E	auxiliary relay	/15.D2	
-K154	0040003051	K	FI	55.32 8 230 00 40	auxiliary relay	/15.D4	
-K176	0040003051	K	FI	55.32 8 230 00 40	auxiliary relay	/17.D6	
-K195	0030000021	K	ABB	NF31E-13	auxiliary relay	/19.E5	
-K197	0040003056	K	FI	55.34 8 230 50 40	auxiliary relay	/19.E7	
-K246	0040003051	K	FI	55.32 8 230 00 40	auxiliary relay	/24.E5	
-K251	0040003051	K	FI	55.32 8 230 00 40	auxiliary relay	/25.D1	
-K252	0050000300	K	SI	3RT2023-1AP	main contactor	/25.D2	
-K252	0050001004	K	SI	3RT2926-2PA01	timing unit cut in delayed	/25.D2	
-K254	0041000030	K	KM	DILM9-10	main contactor	/25.D4	
-K292	0040003056	K	FI	55.34 8 230 50 40	auxiliary relay	/29.E2	
-K293	0040003056	K	FI	55.34 8 230 50 40	auxiliary relay	/29.E3	
-K324	0040003051	K	FI	55.32 8 230 00 40	auxiliary relay	/32.E4	
-K352	0040003051	K	FI	55.32 8 230 00 40	auxiliary relay	/35.D2	
-K354	0040003051	K	FI	55.32 8 230 00 40	auxiliary relay	/35.D4	
-K356	0040003051	K	FI	55.32 8 230 00 40	auxiliary relay	/35.D6	
-K362	0030000022	K	ABB	NF22E-13	auxiliary relay	/36.D2	


comments :


part list


[illegible]


comments :

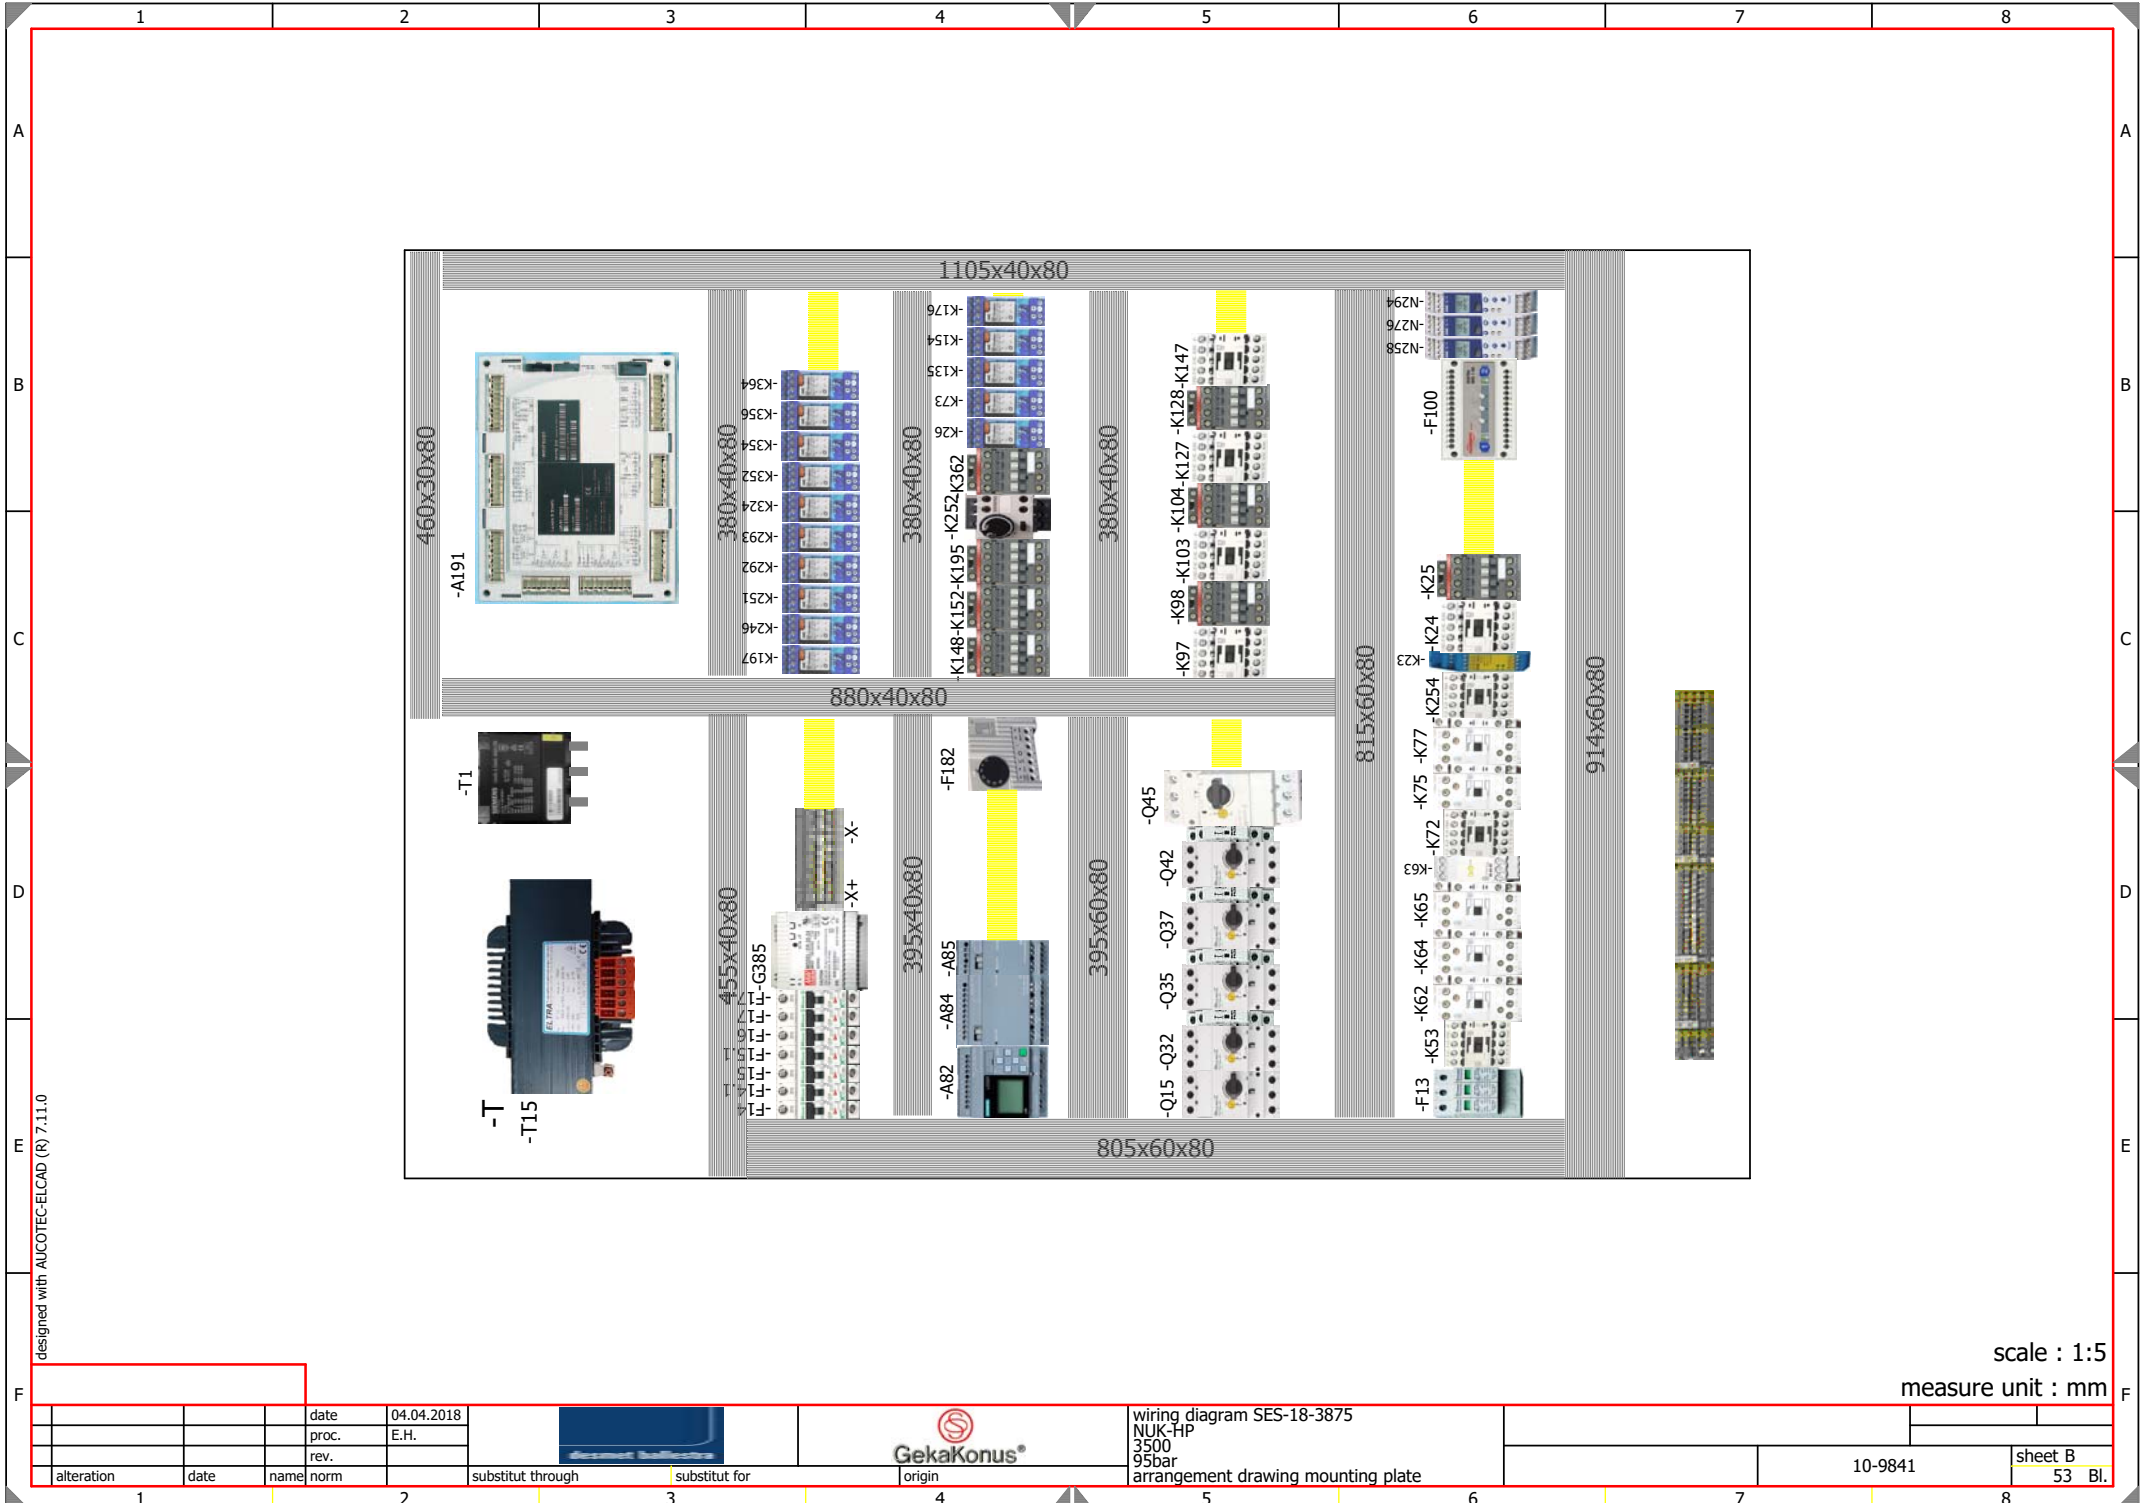


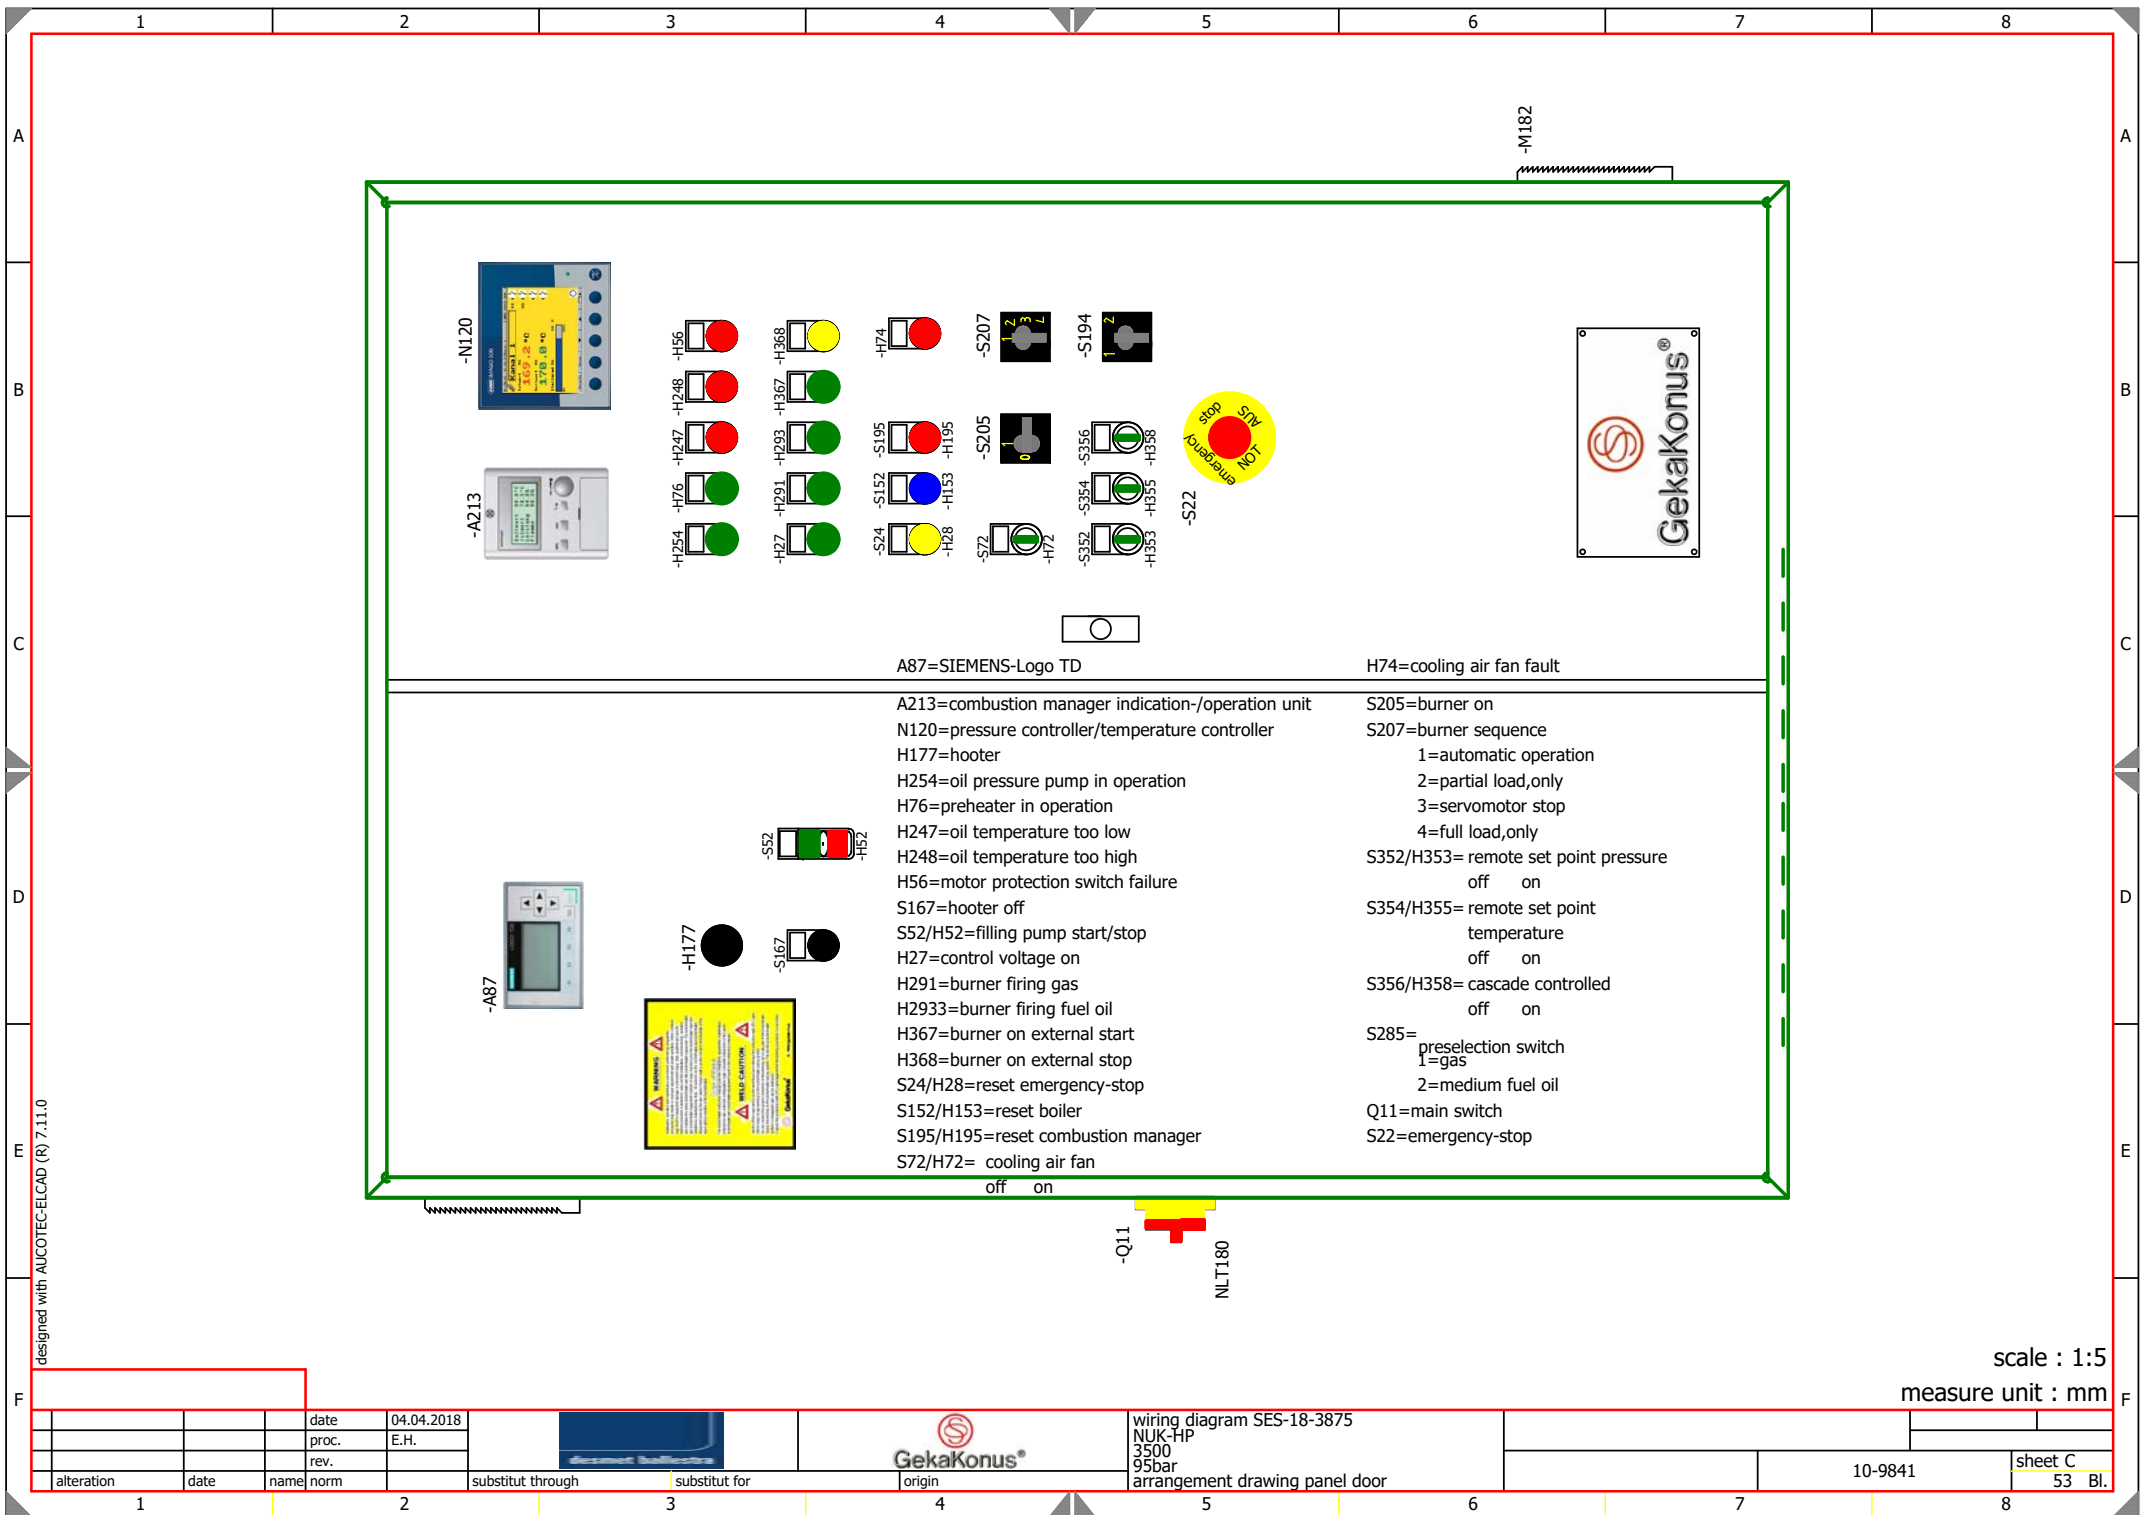

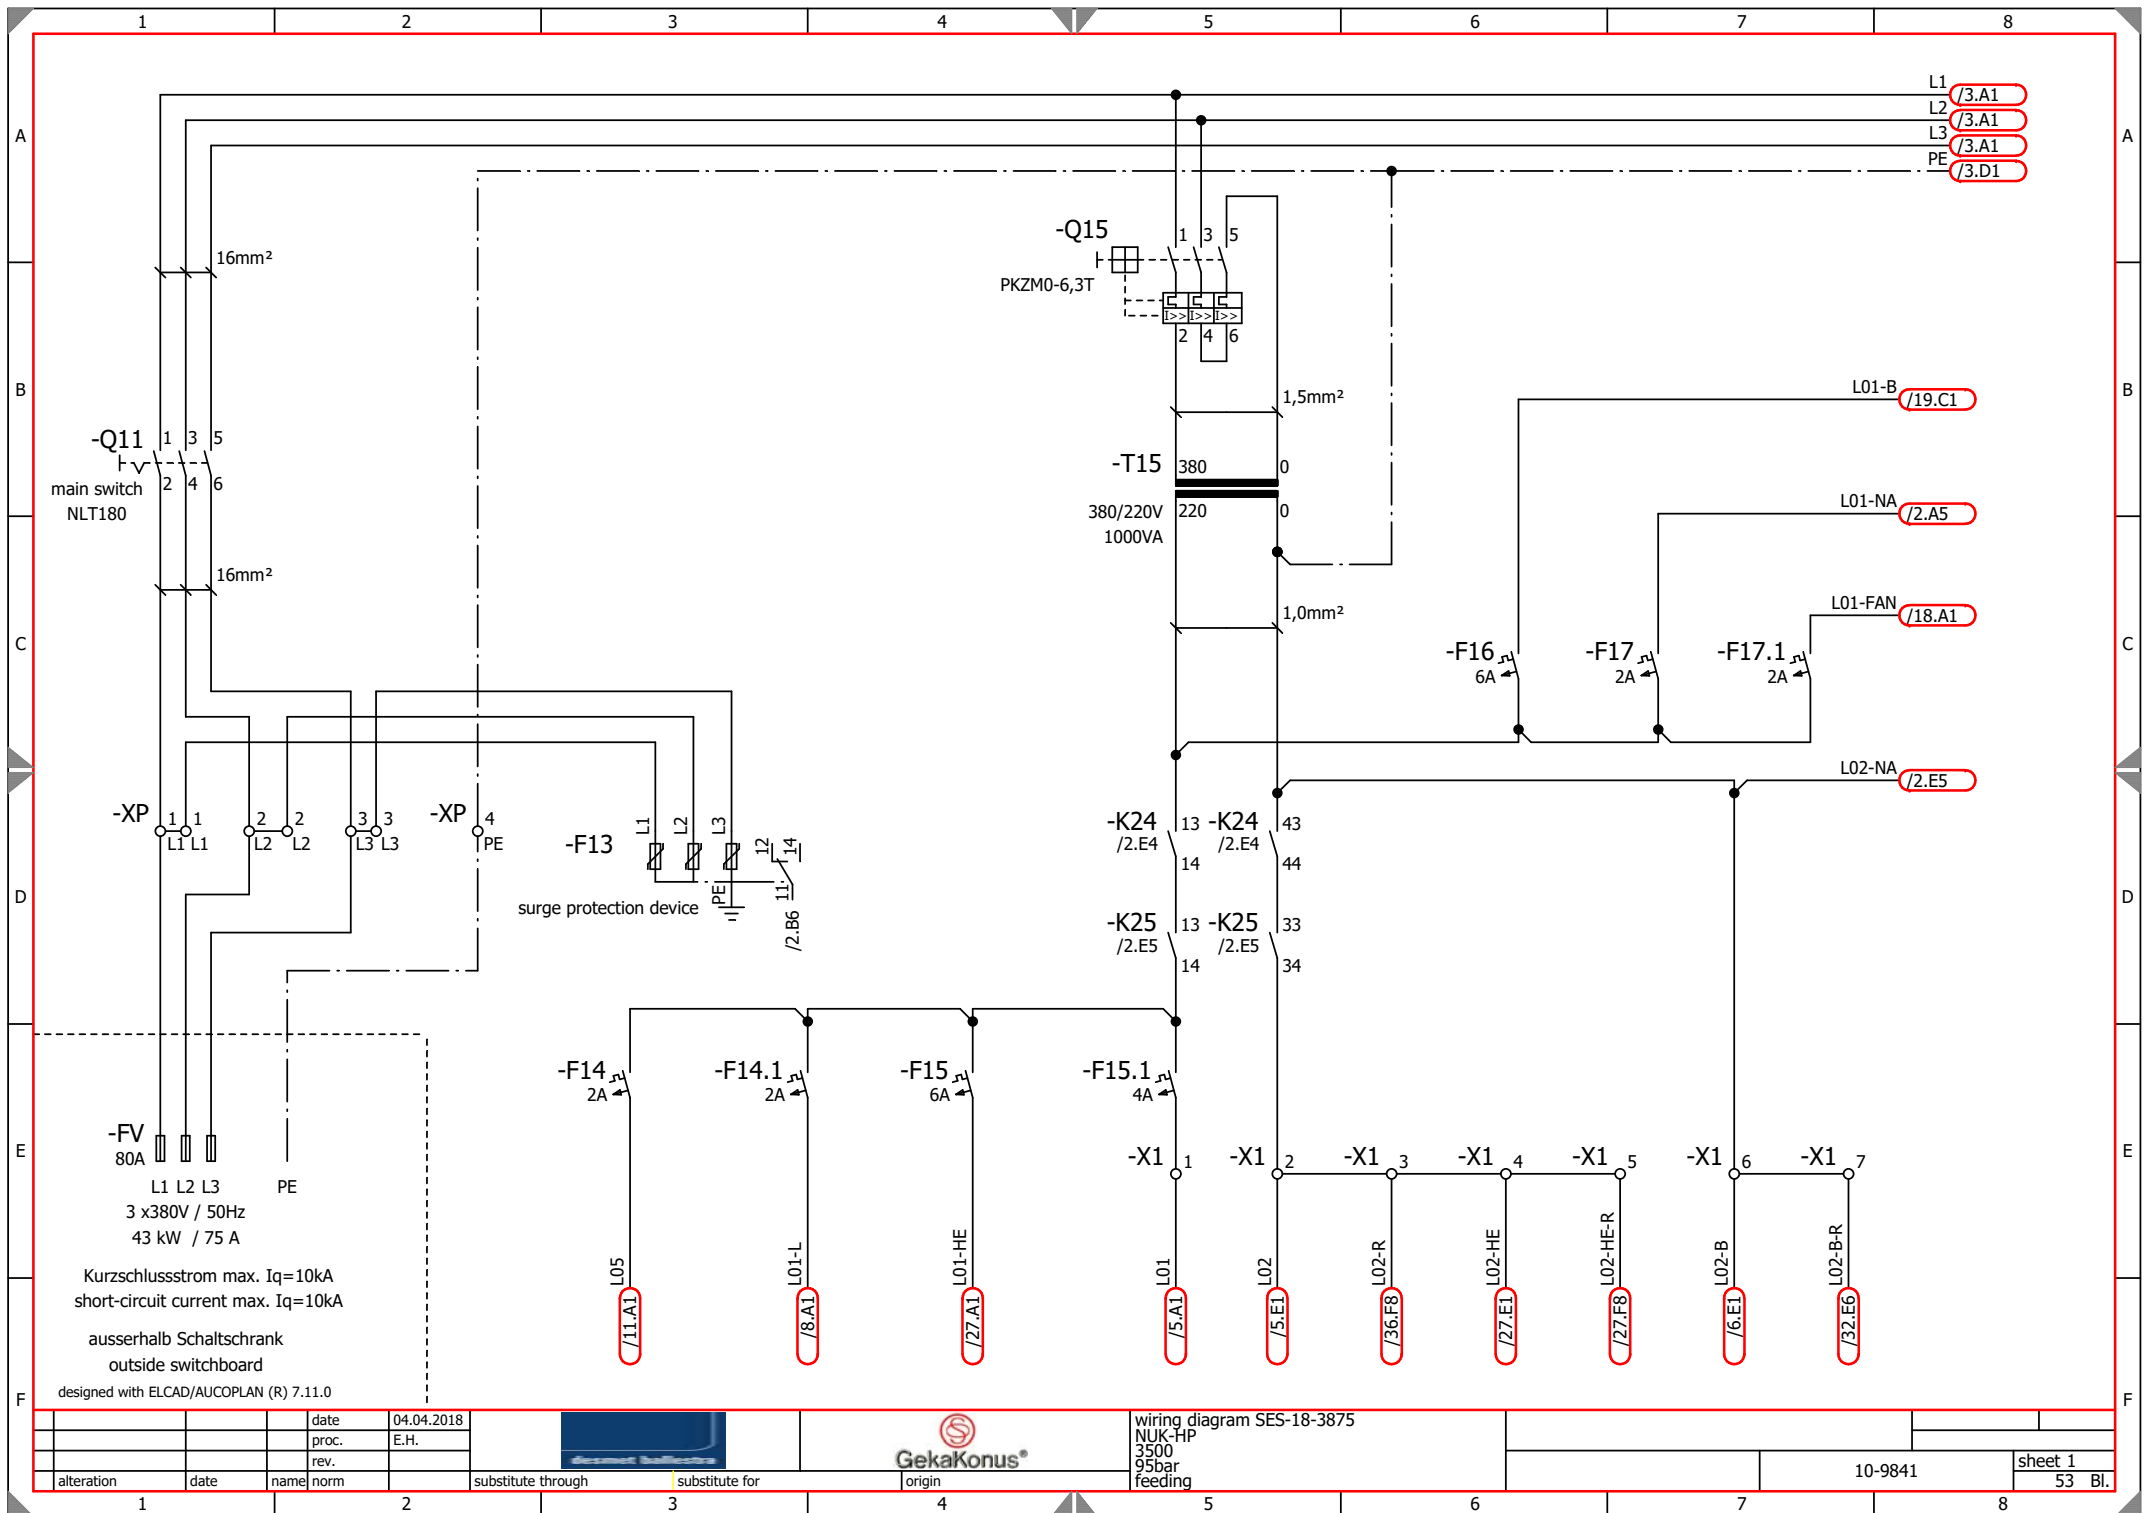

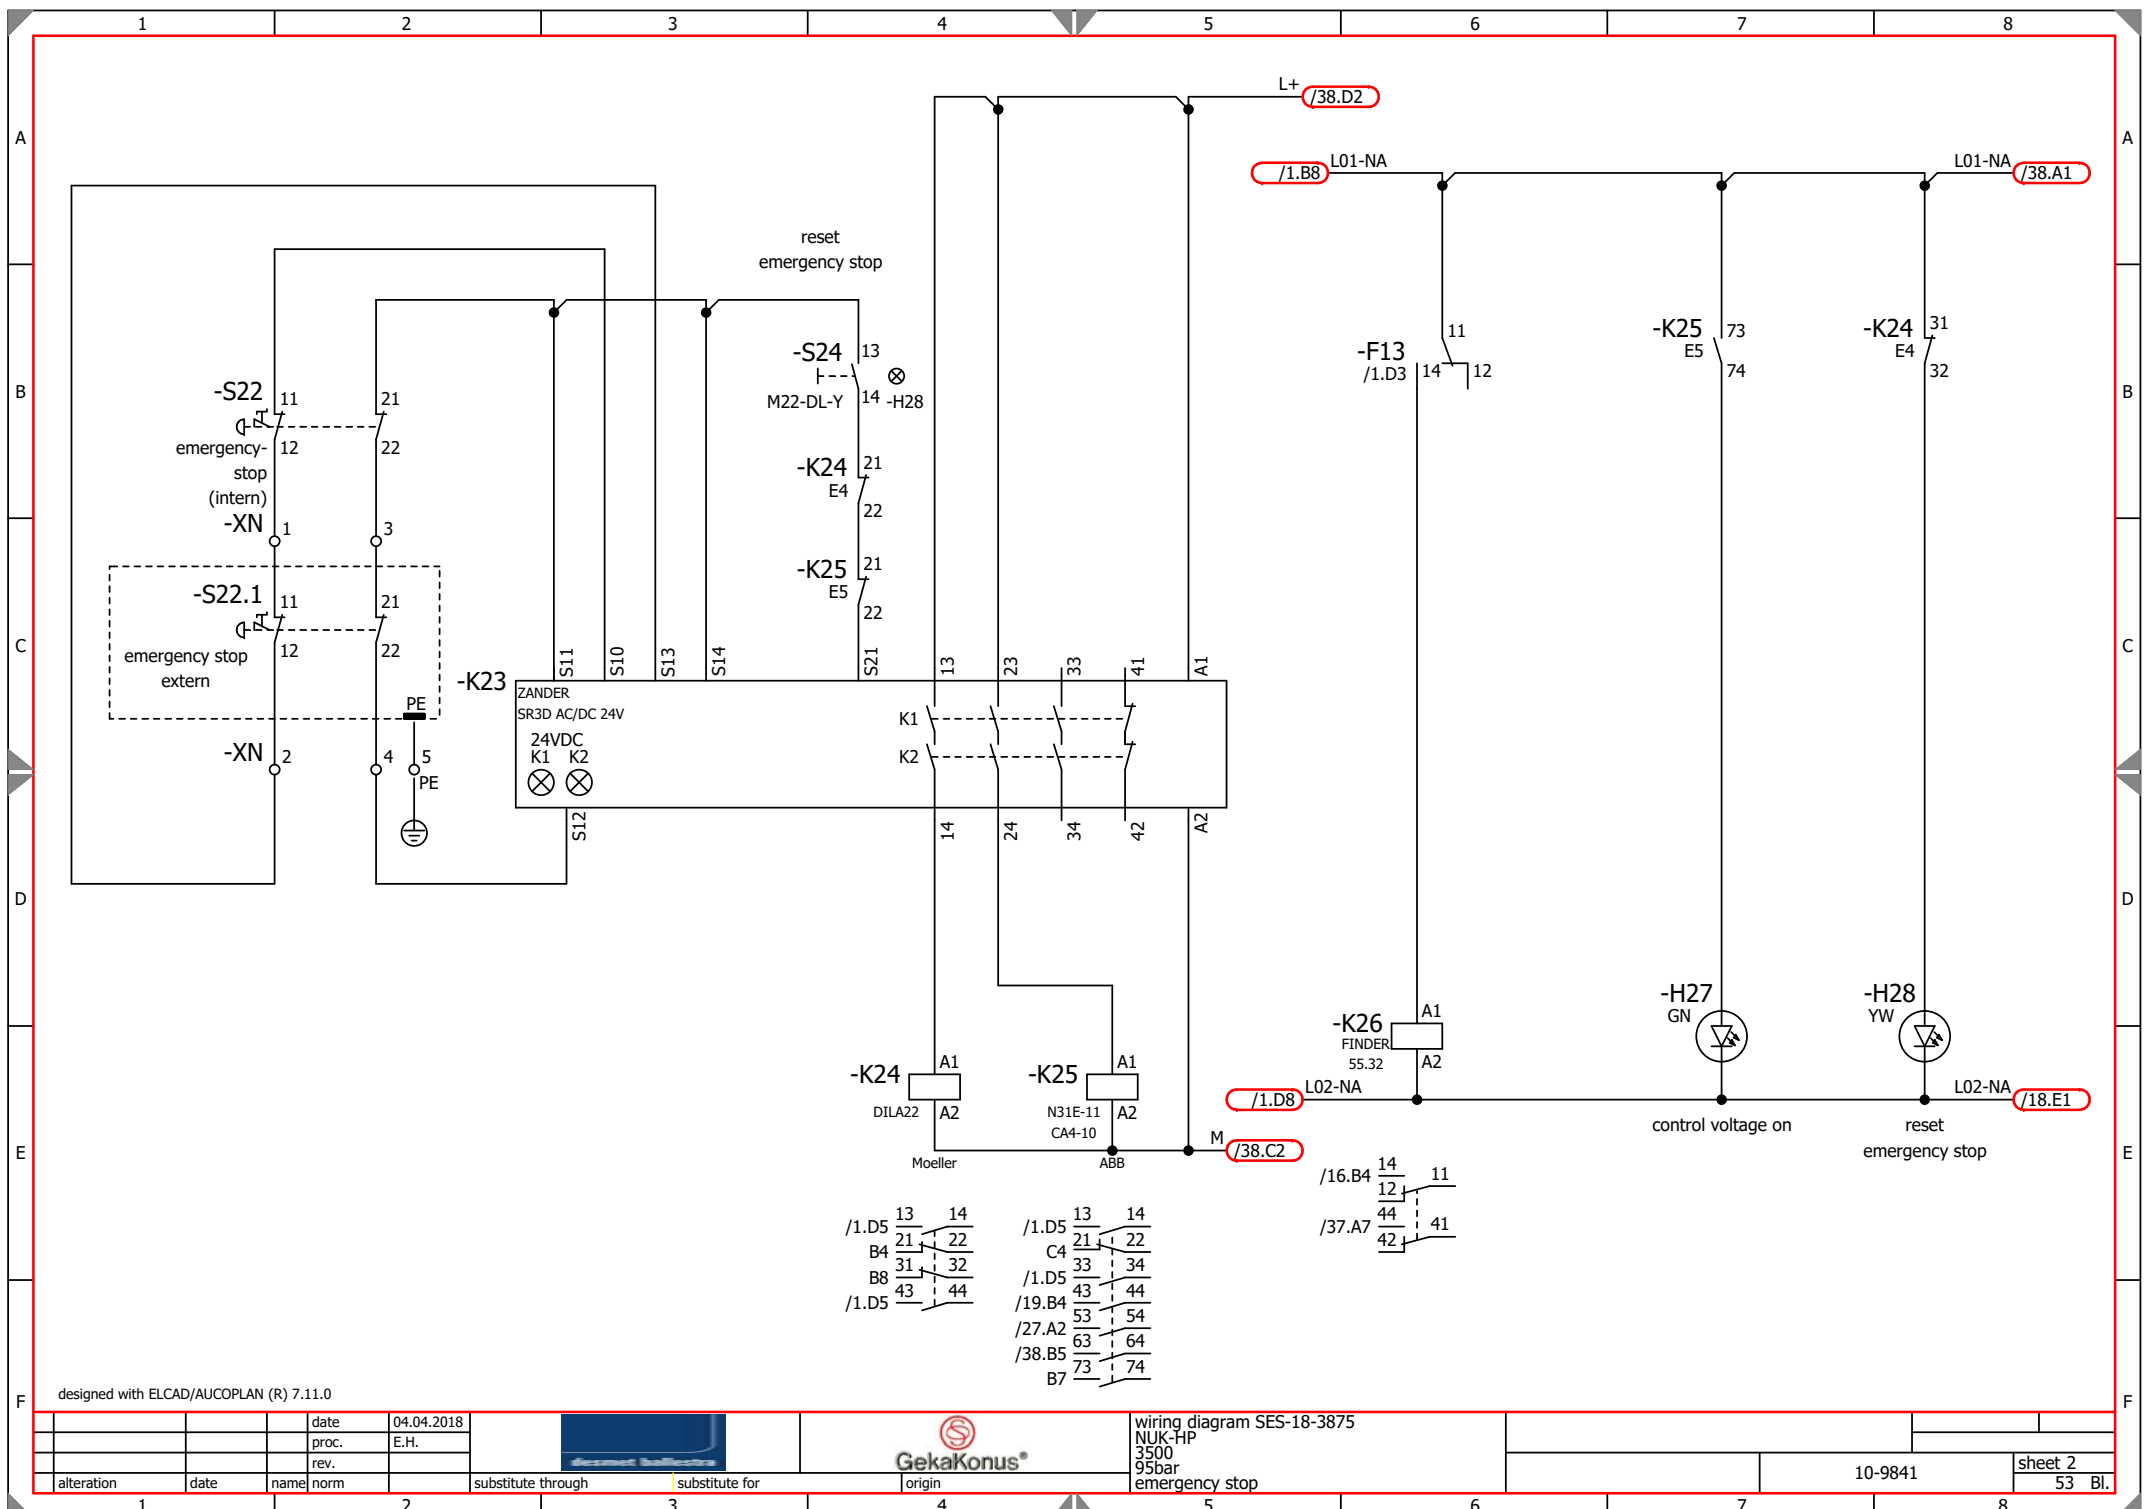

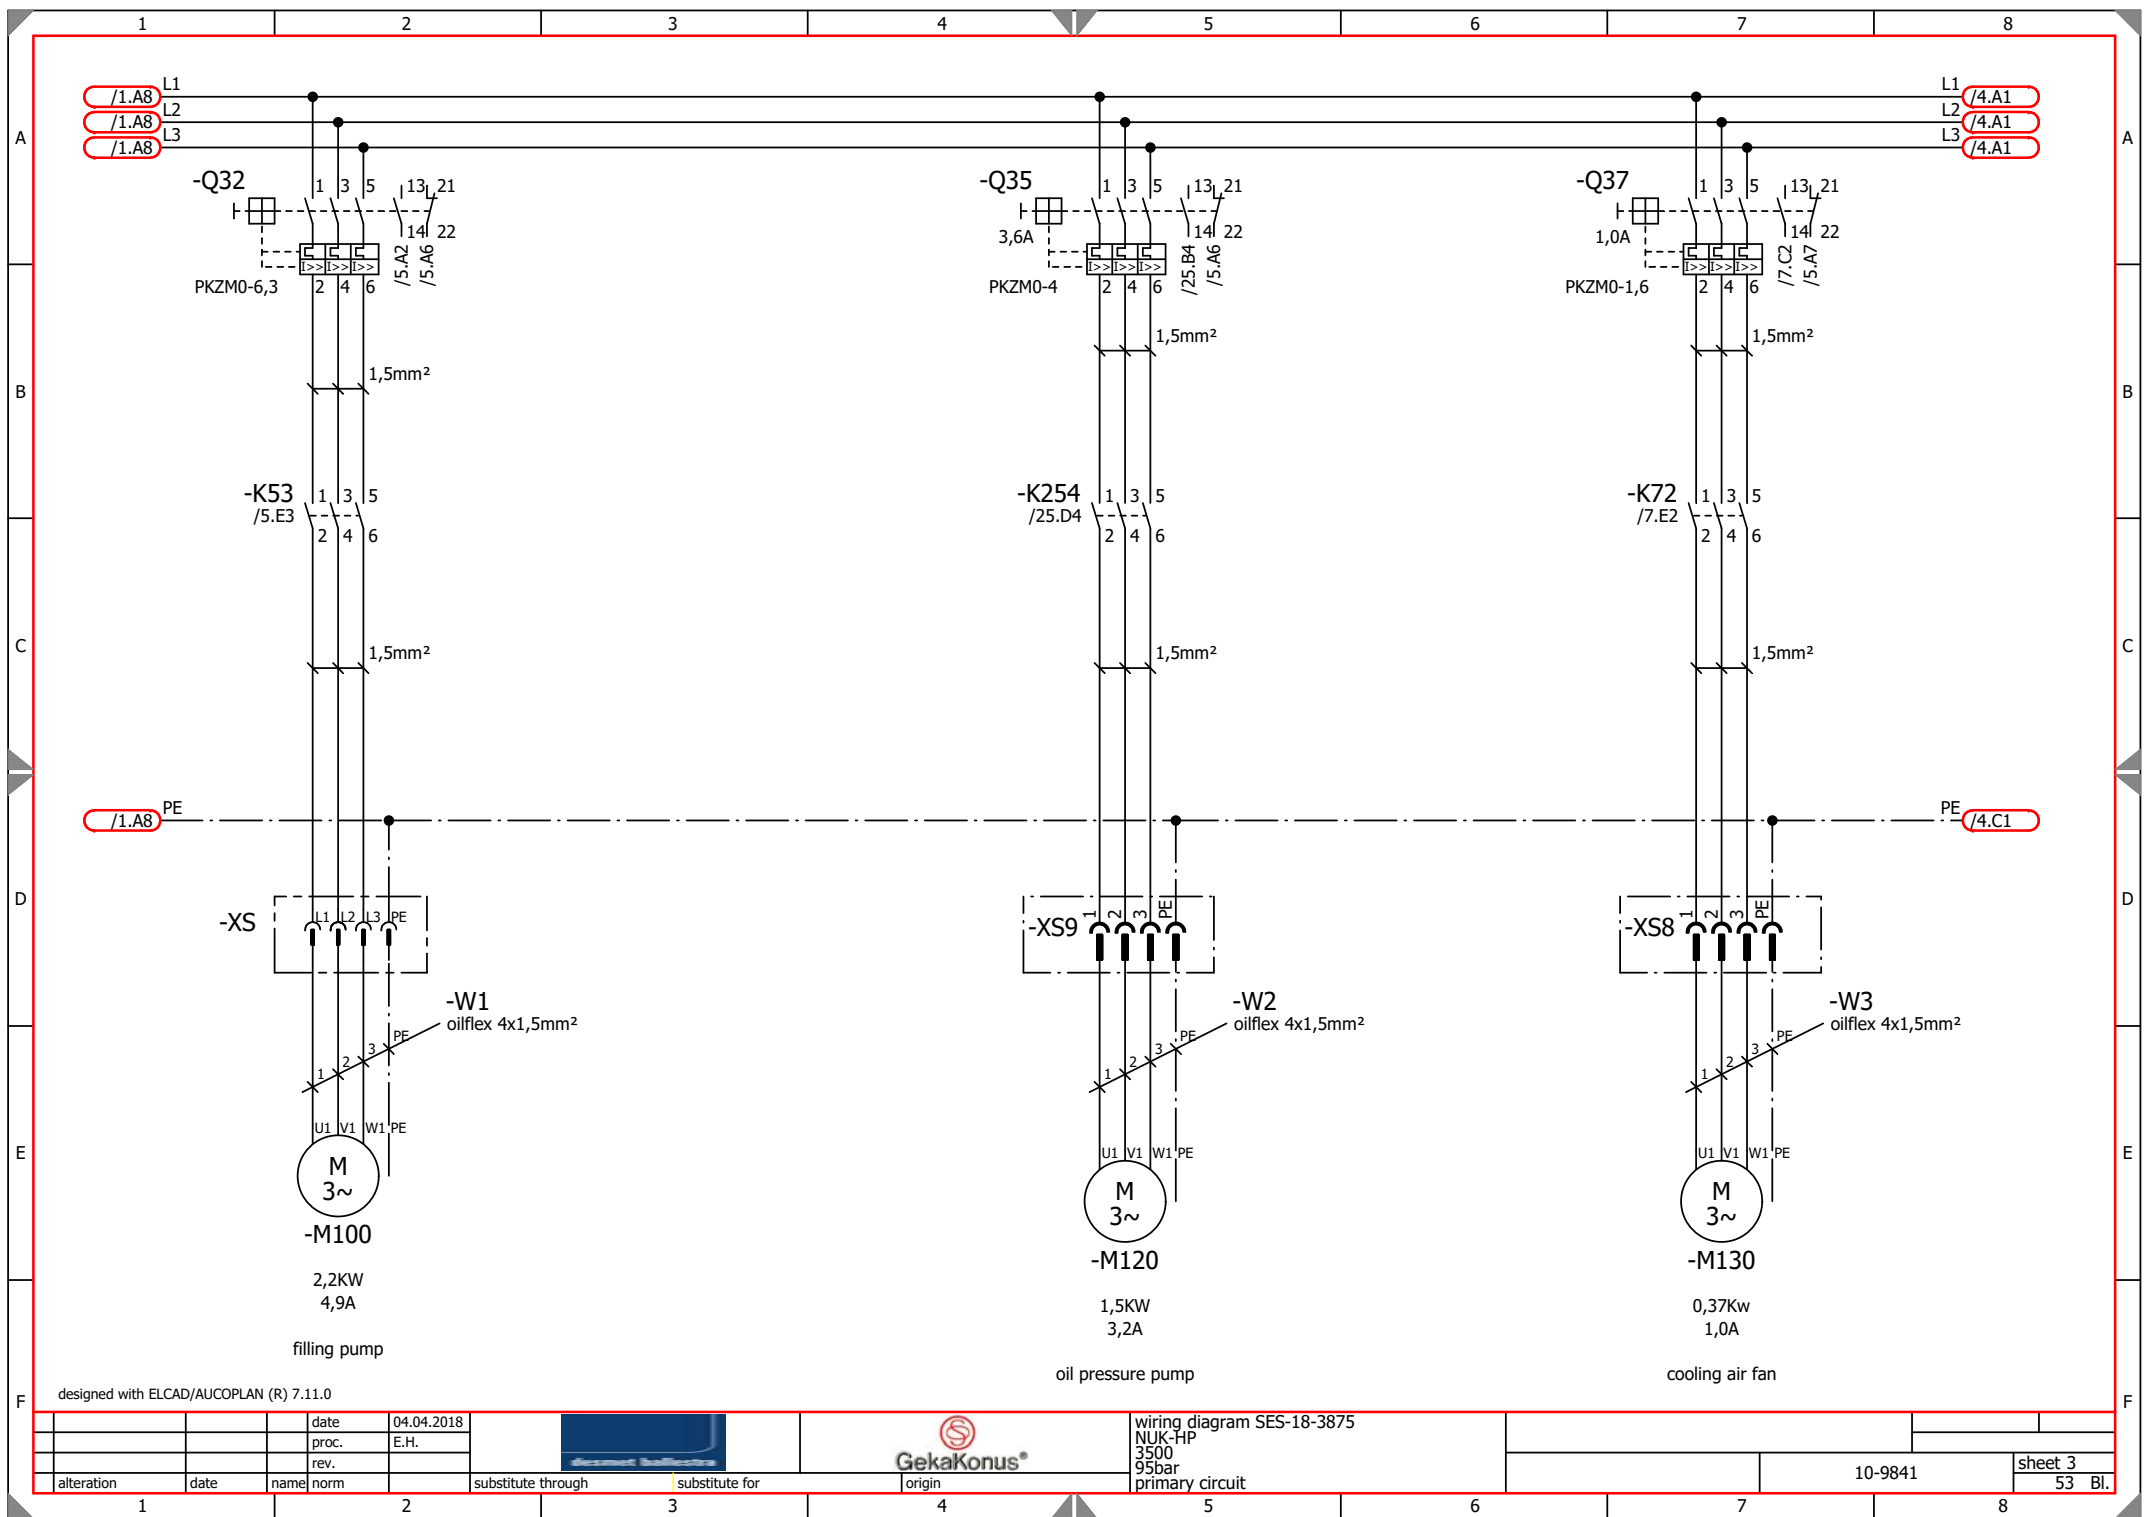

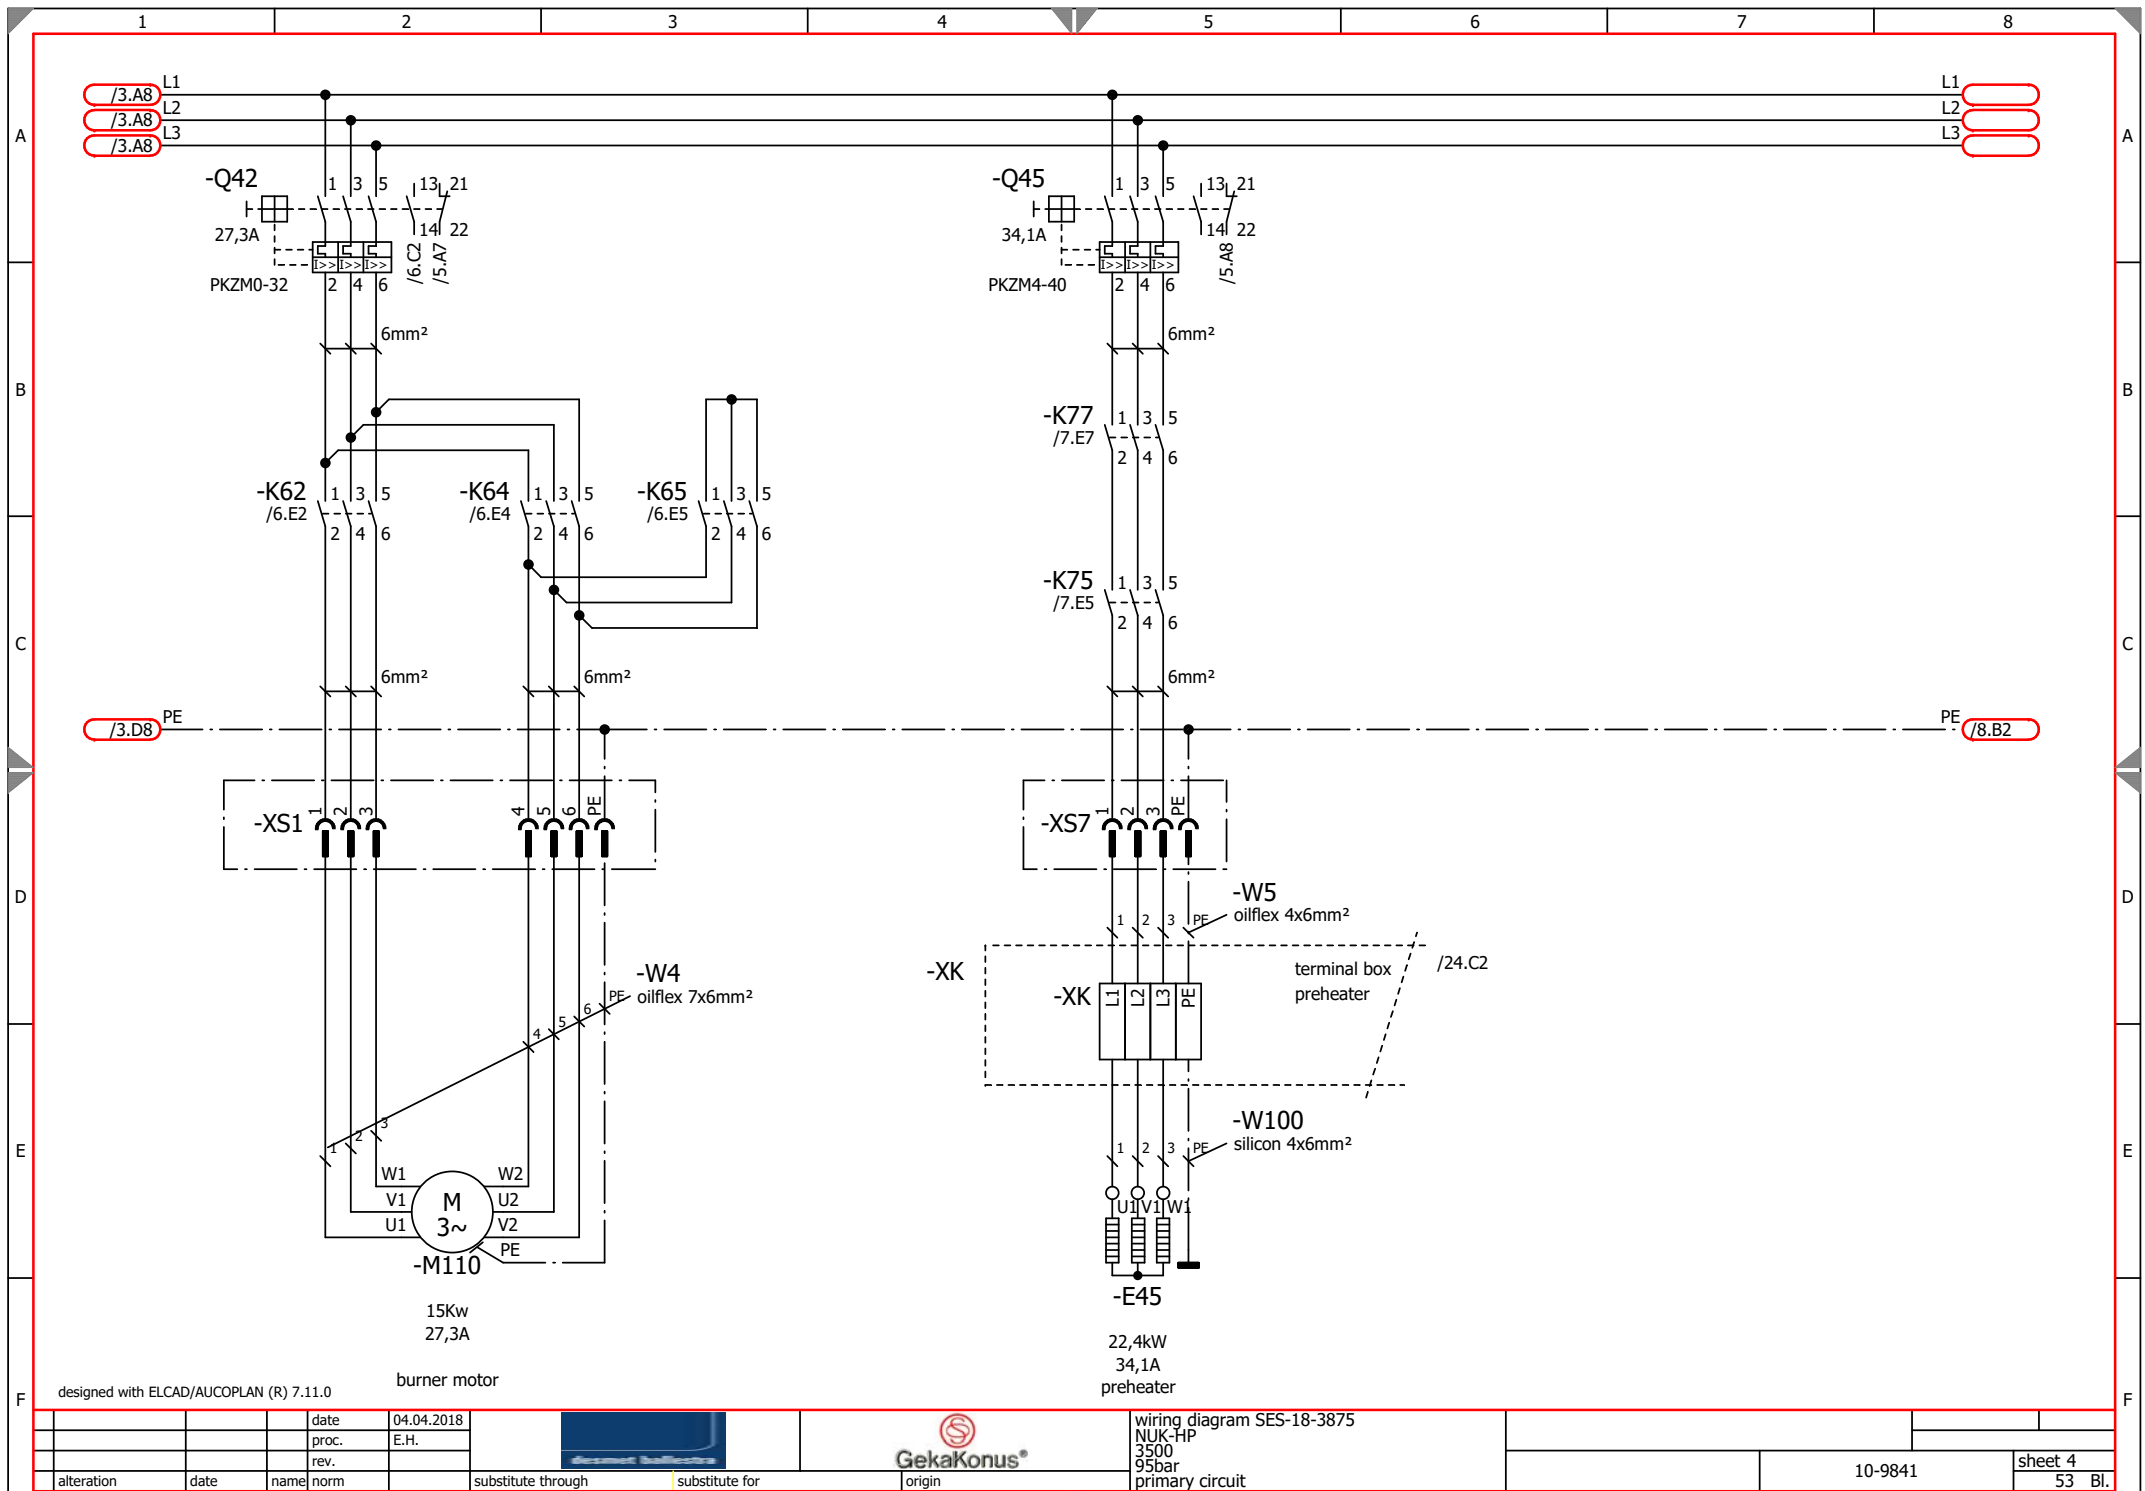

			date	04.04.2018
			proc.	E.H.
			rev.	
alteration	date	name	norm	substitute through


			substitute for	
--	--	--	----------------	--

GekaKonus®

wiring diagram SES-18-3875
NUK-HP
3500
95bar
primary circuit

10-9841

sheet 4
53 Bl.

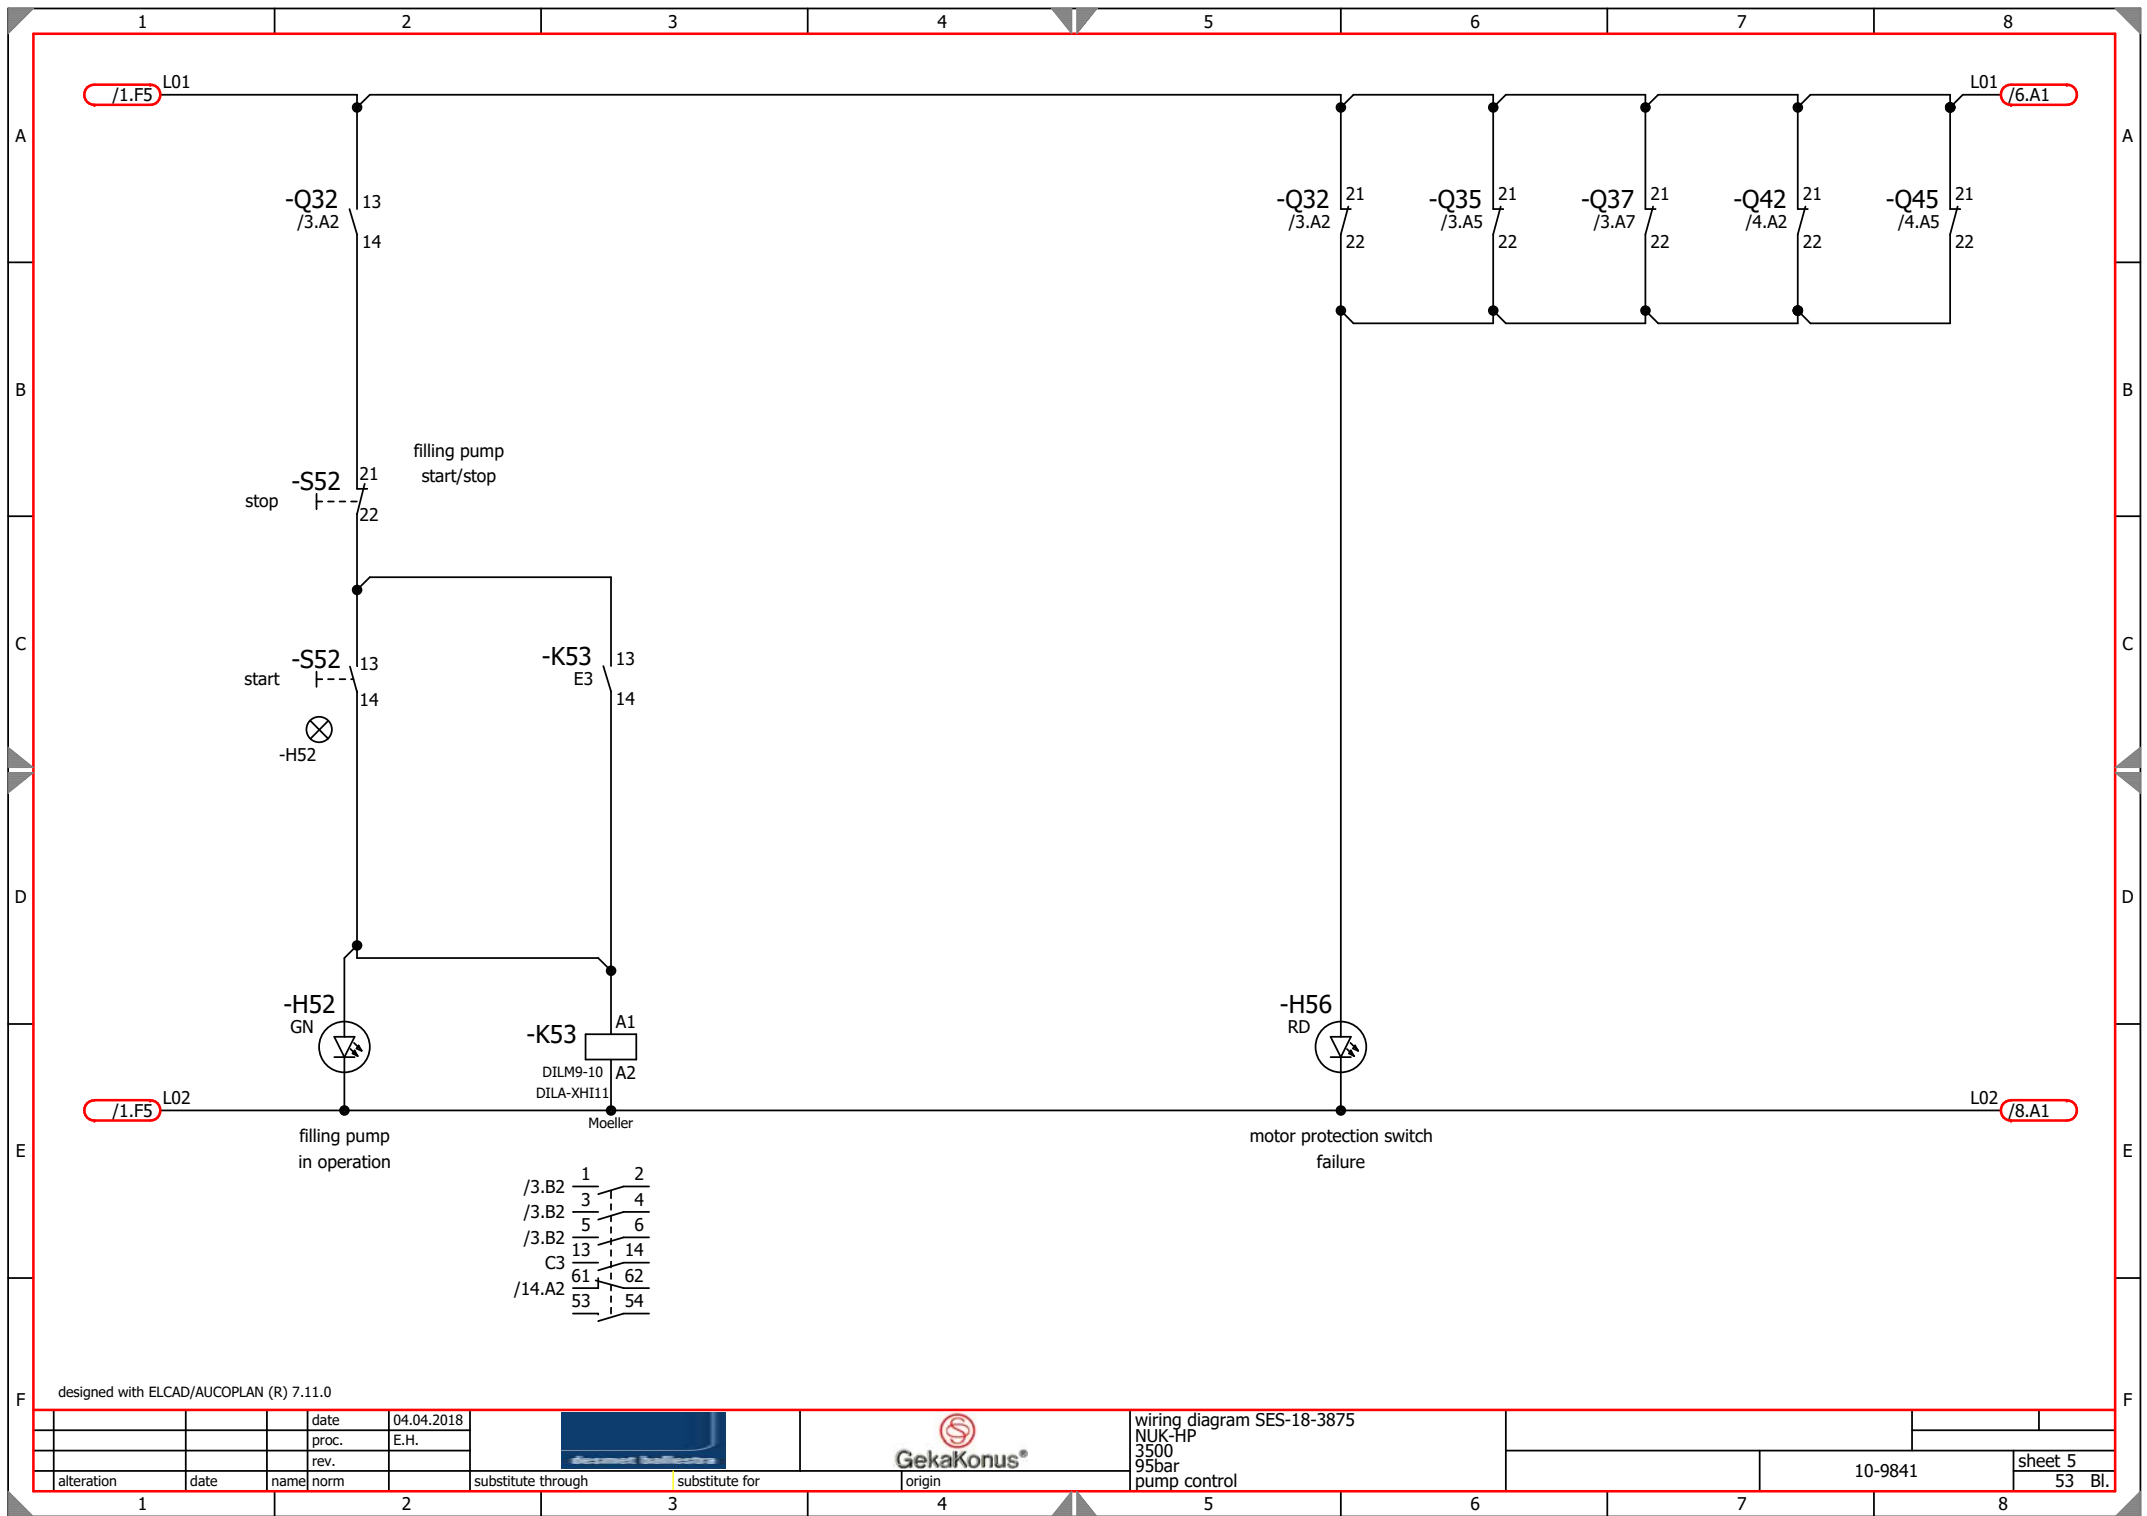

			date	04.04.2018
			proc.	E.H.
			rev.	
alteration	date	name	norm	substitute through


			substitute for
--	--	--	----------------



wiring diagram SES-18-3875
NUK-HP
3500
95bar
pump control

10-9841

sheet 5
53 Bl.

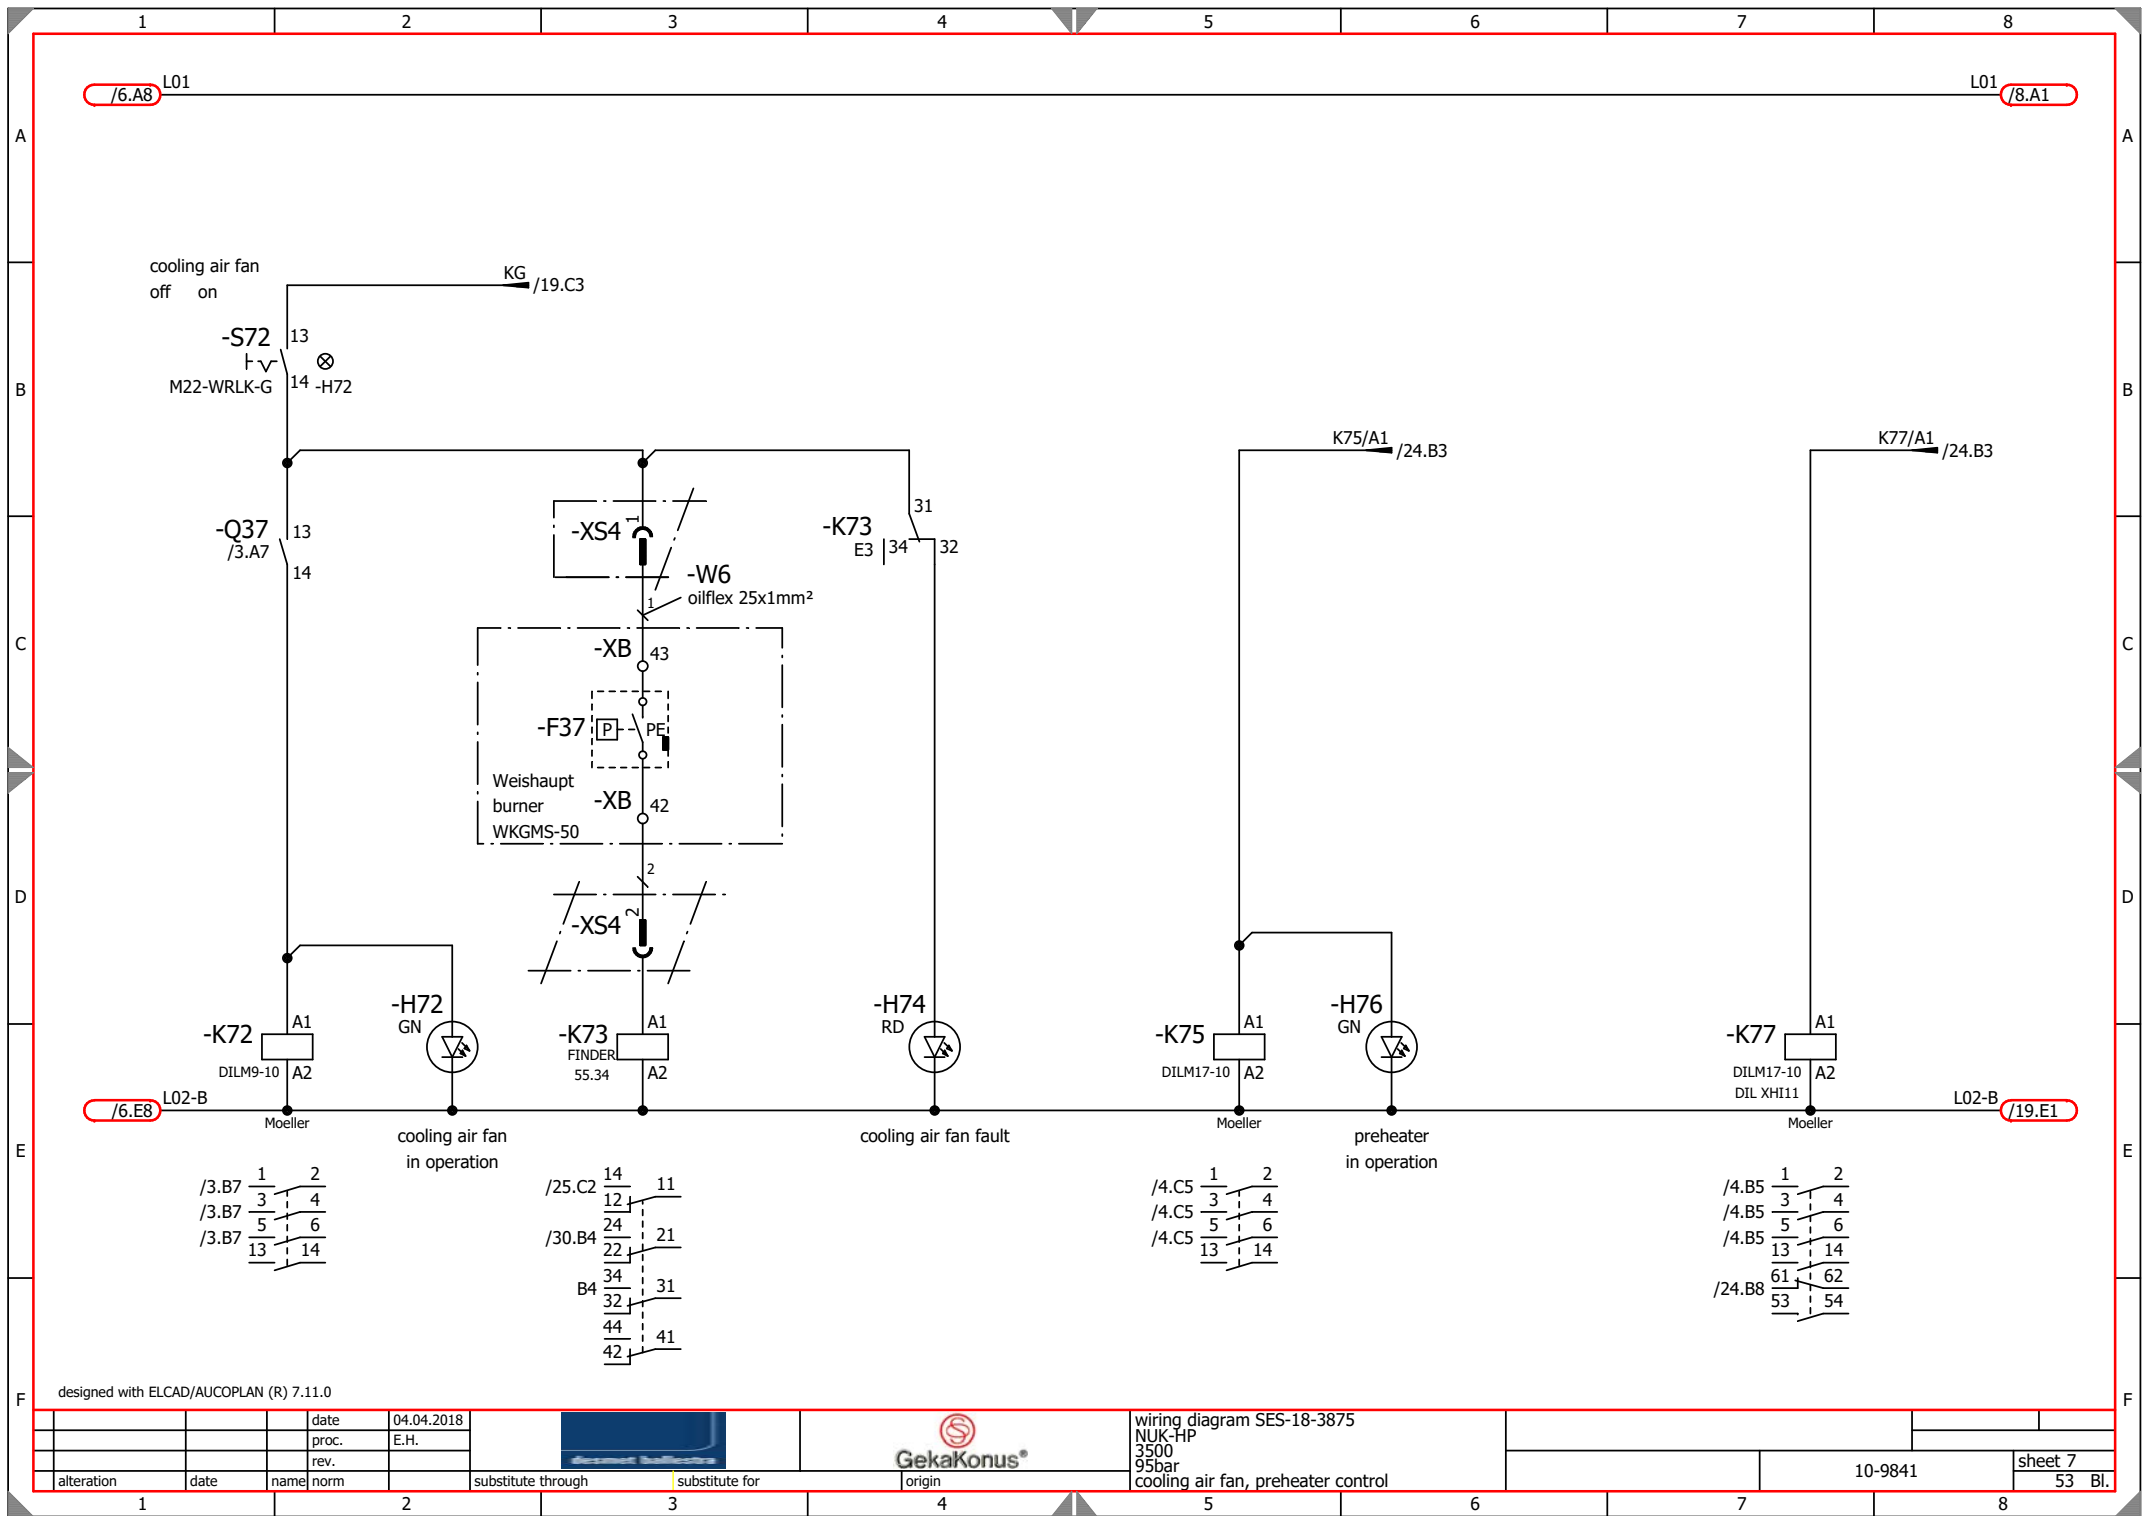

			date	04.04.2018
			proc.	E.H.
			rev.	
alteration	date	name	norm	substitute through


			substitute for	
--	--	--	----------------	--





wiring diagram SES-18-3875
NUK-HP
3500
95bar
cooling air fan, preheater control

10-9841

sheet 7
53 Bl.

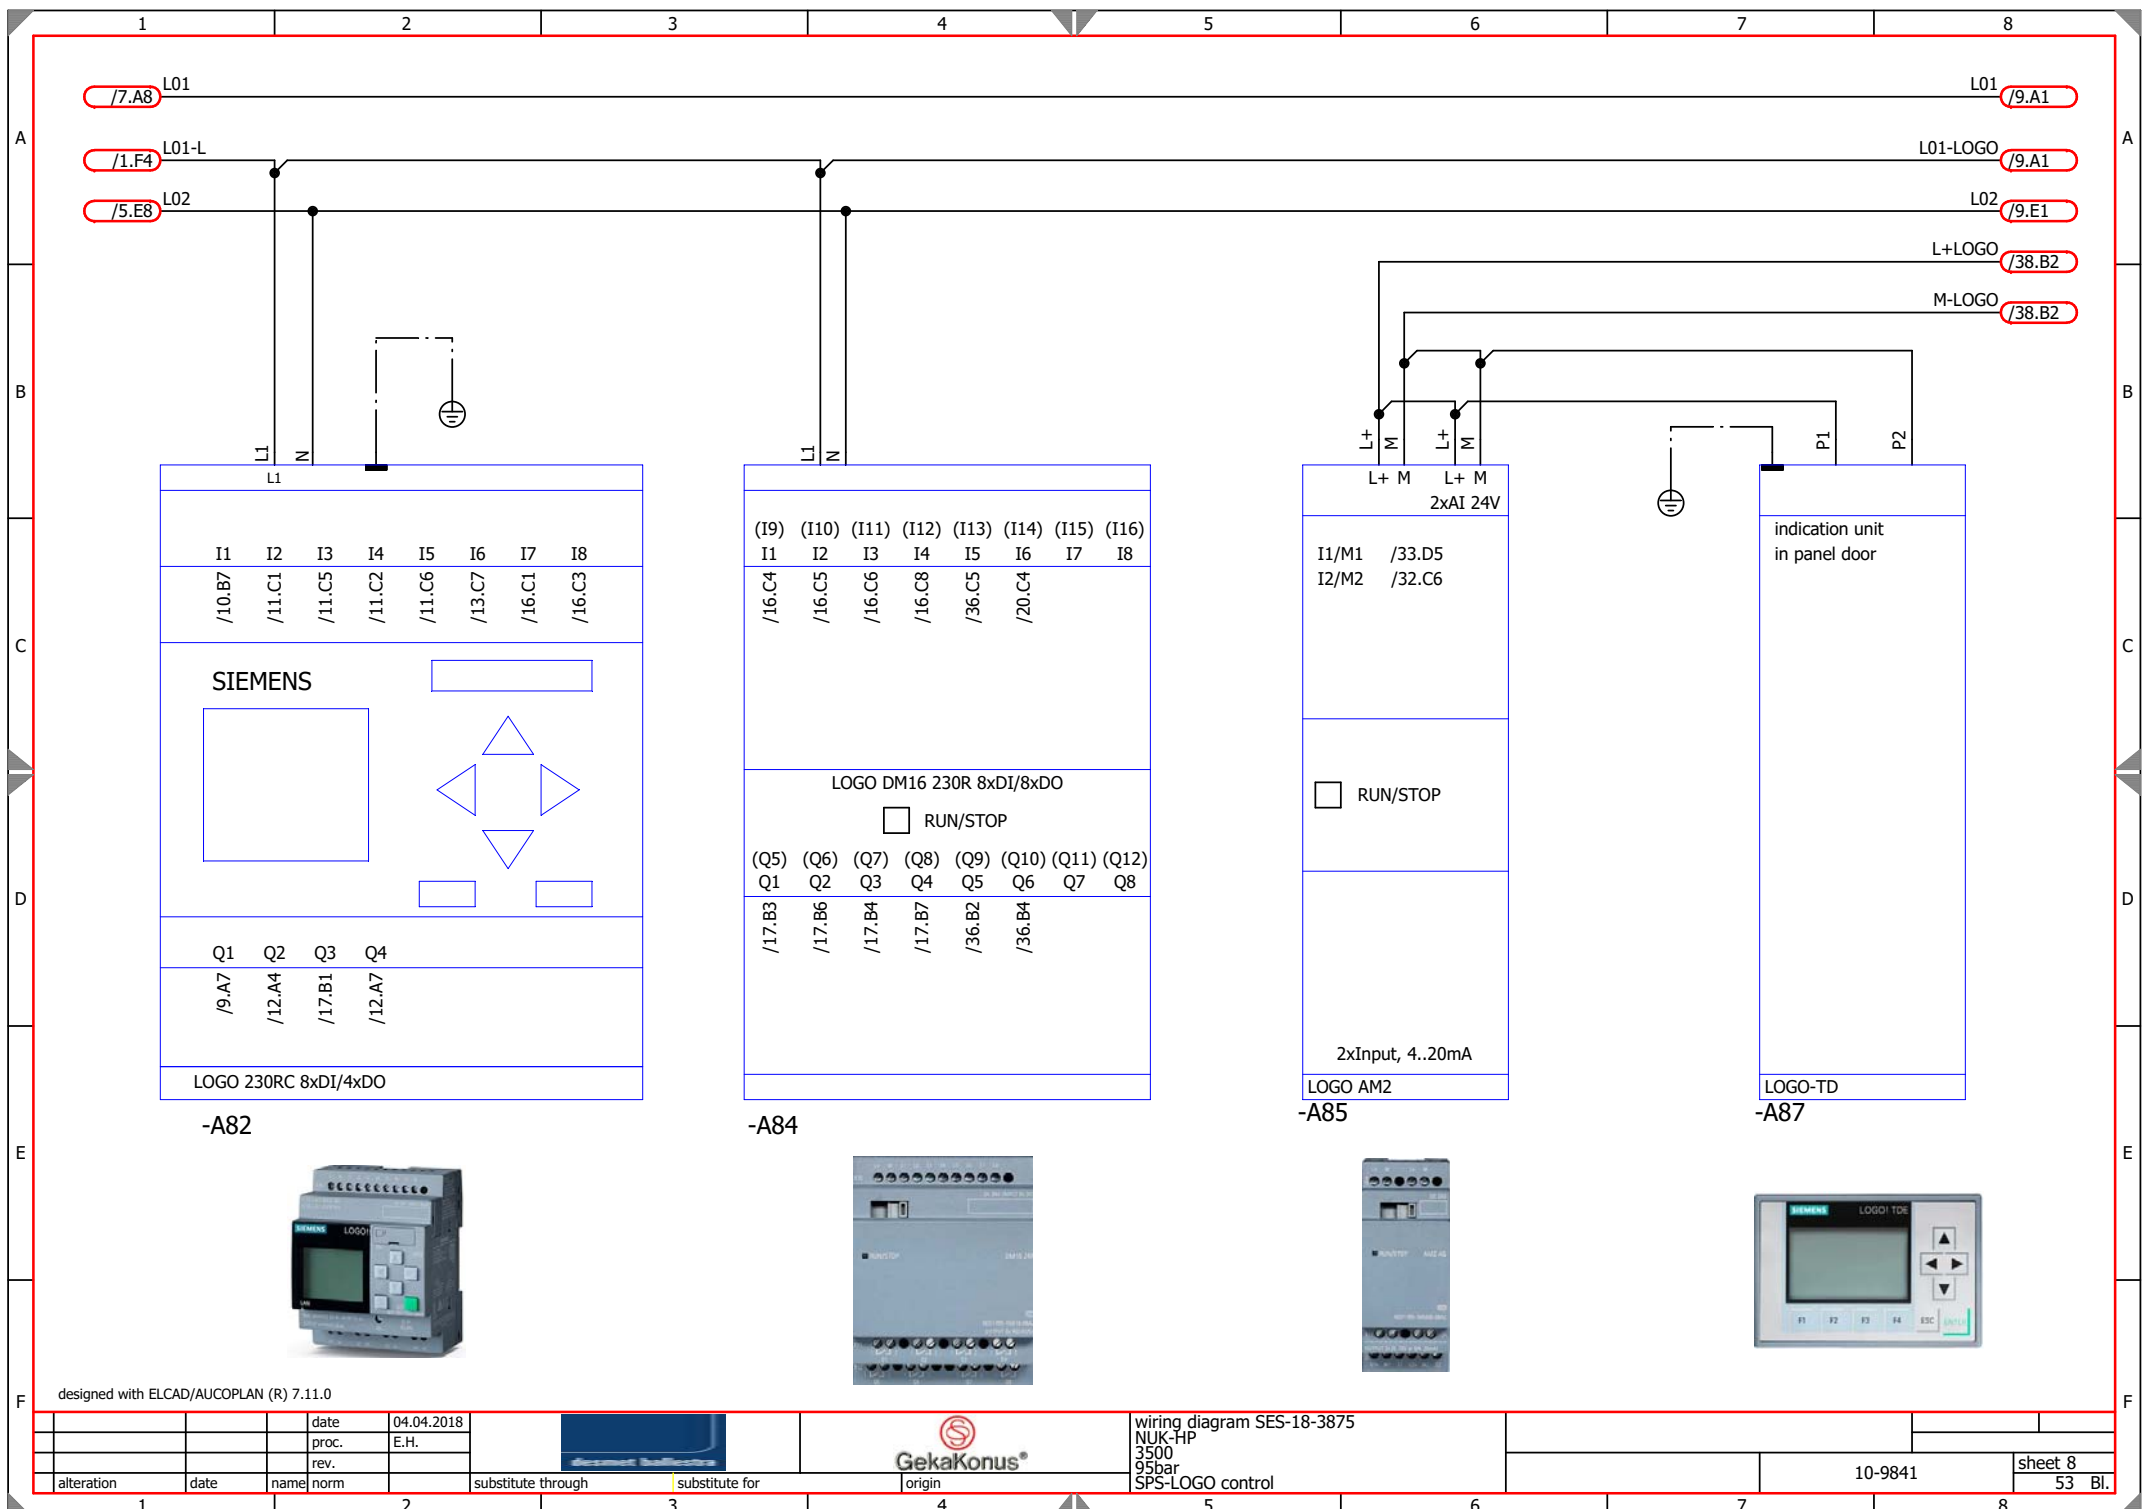

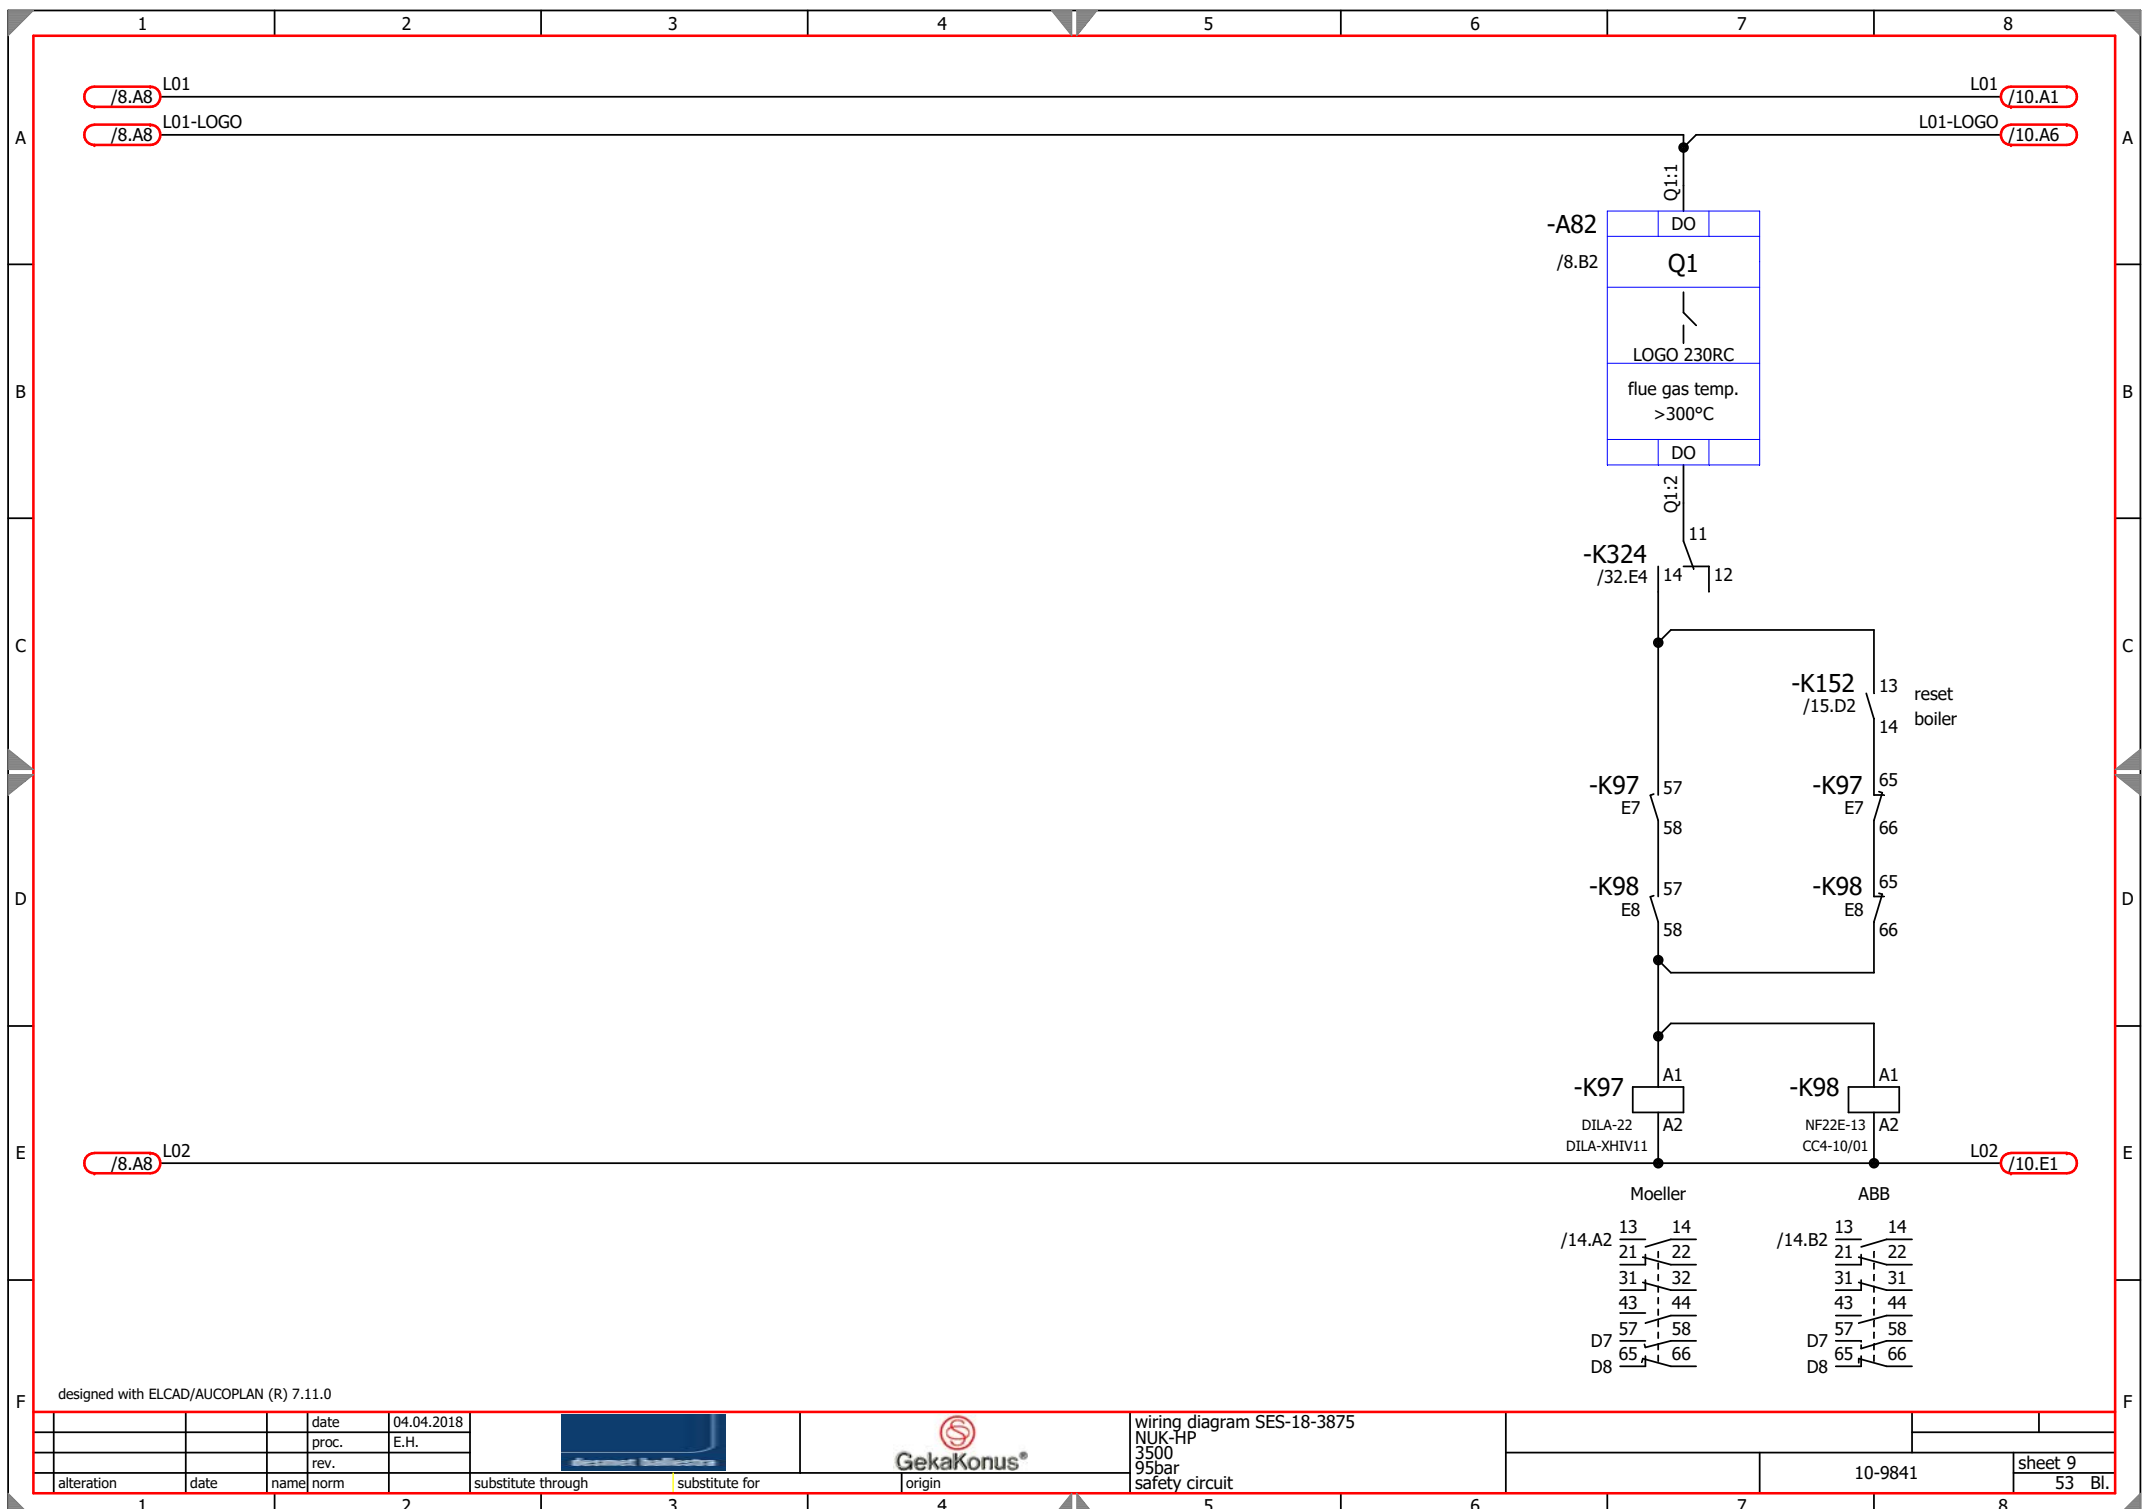

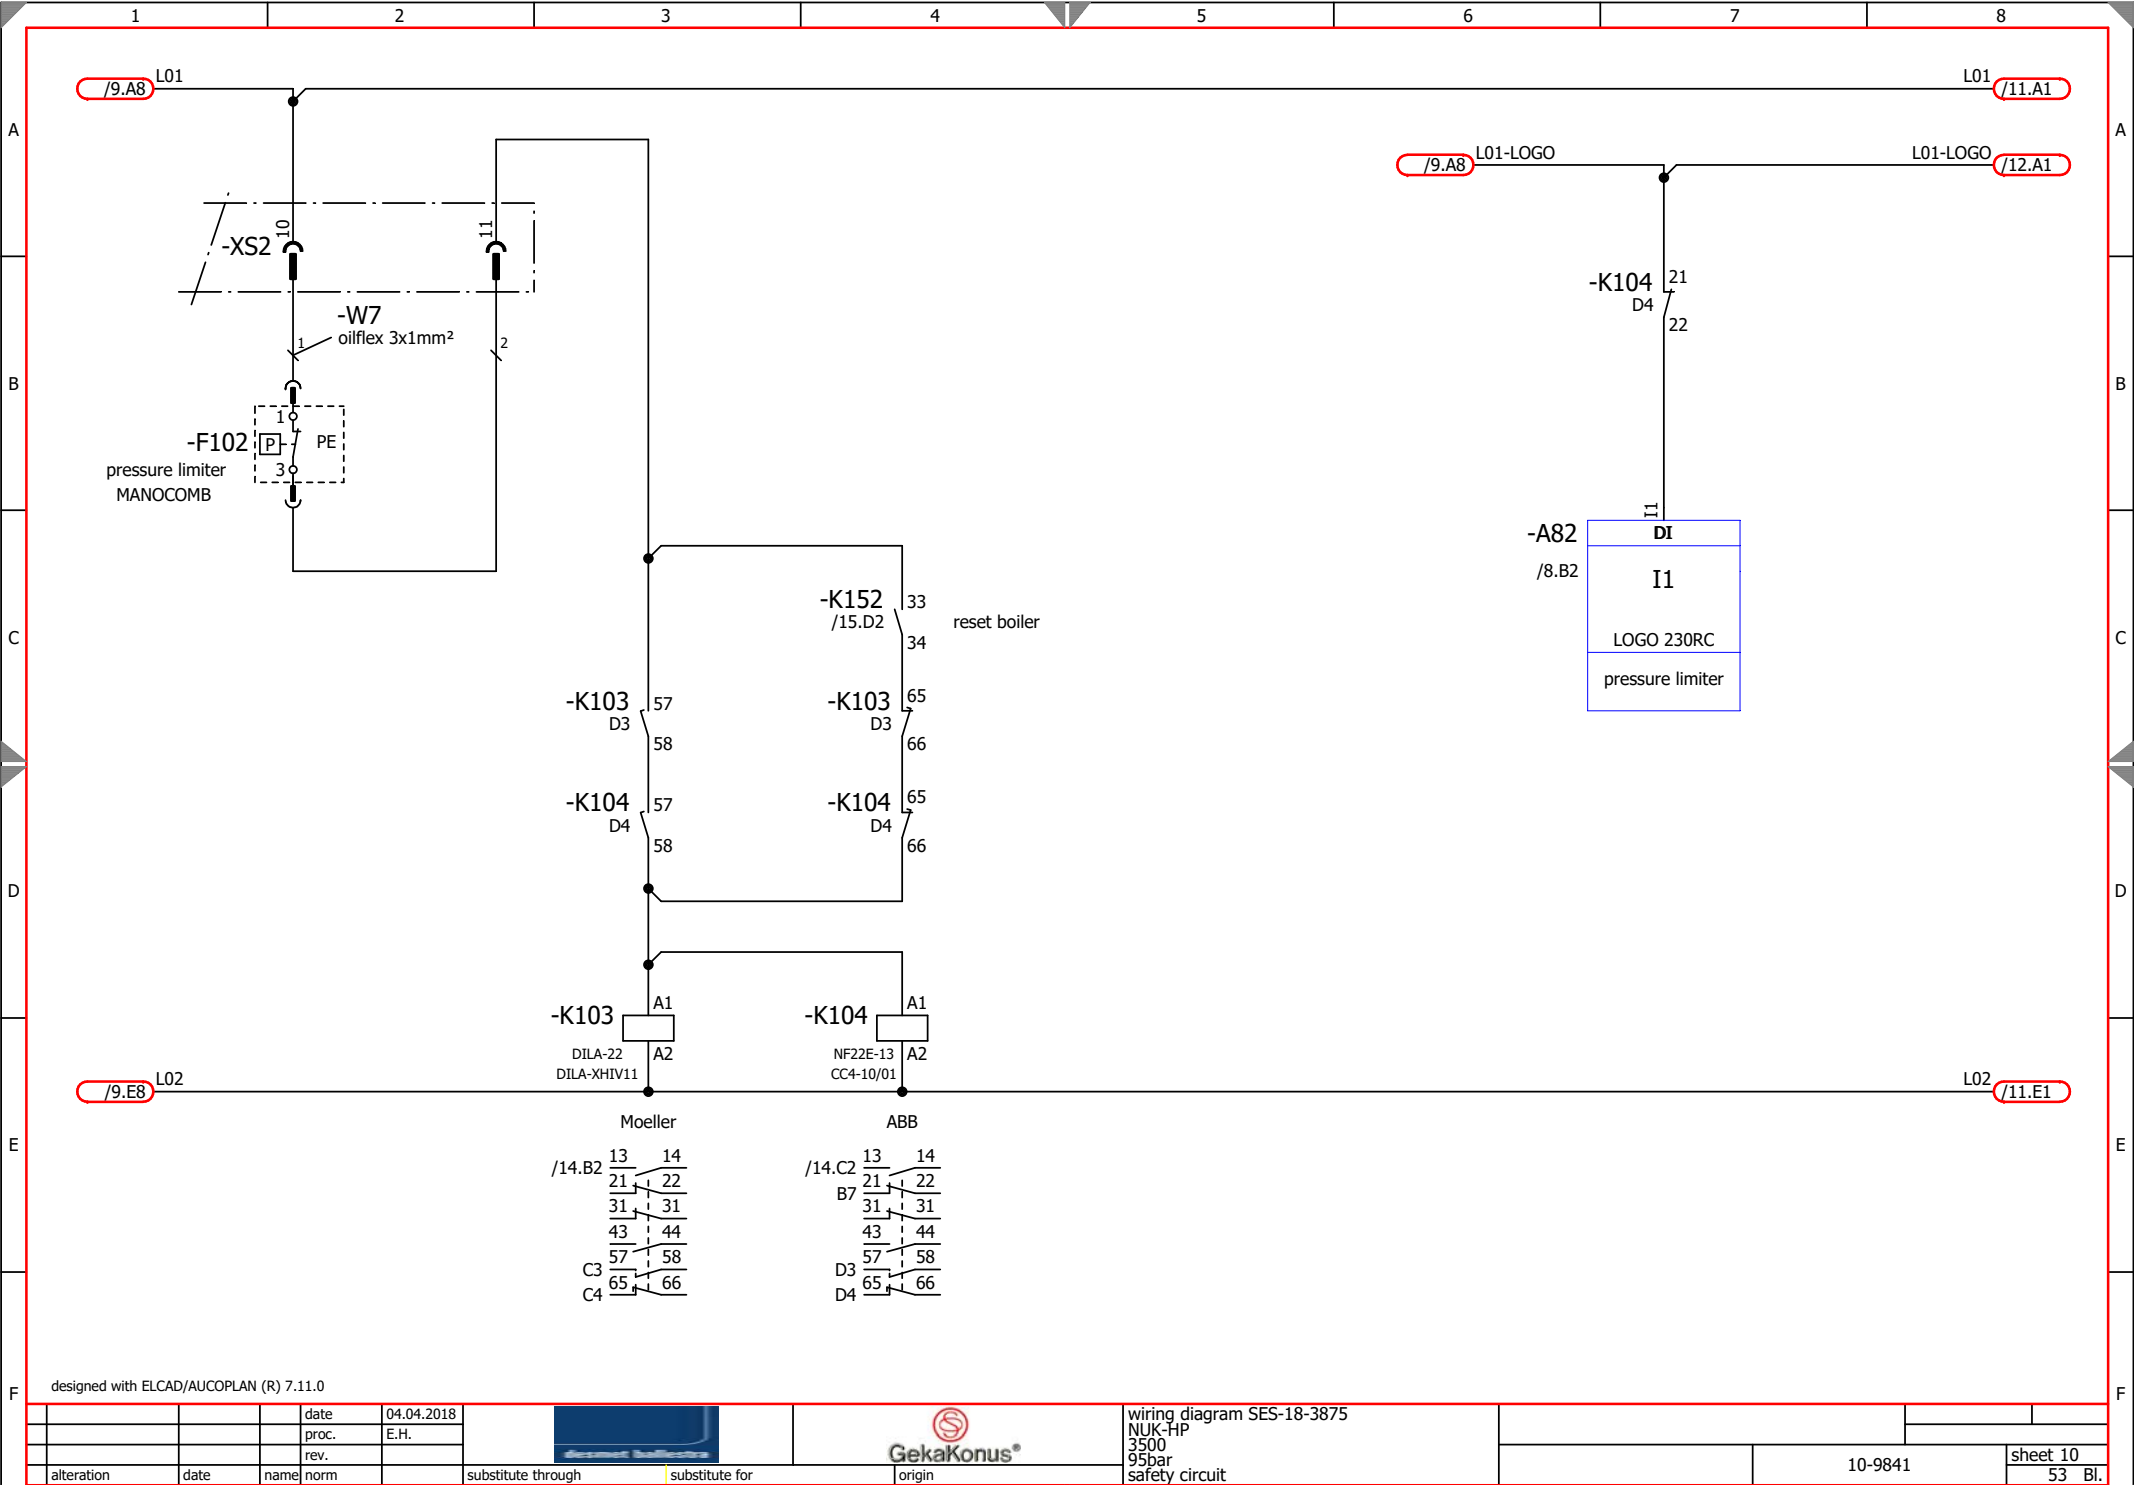


designed with ELCAD/AUCOPLAN (R) 7.11.0




wiring diagram SES-18-3875
NUK-HP
3500
95bar
safety circuit

10-9841

sheet 10
53 Bl.

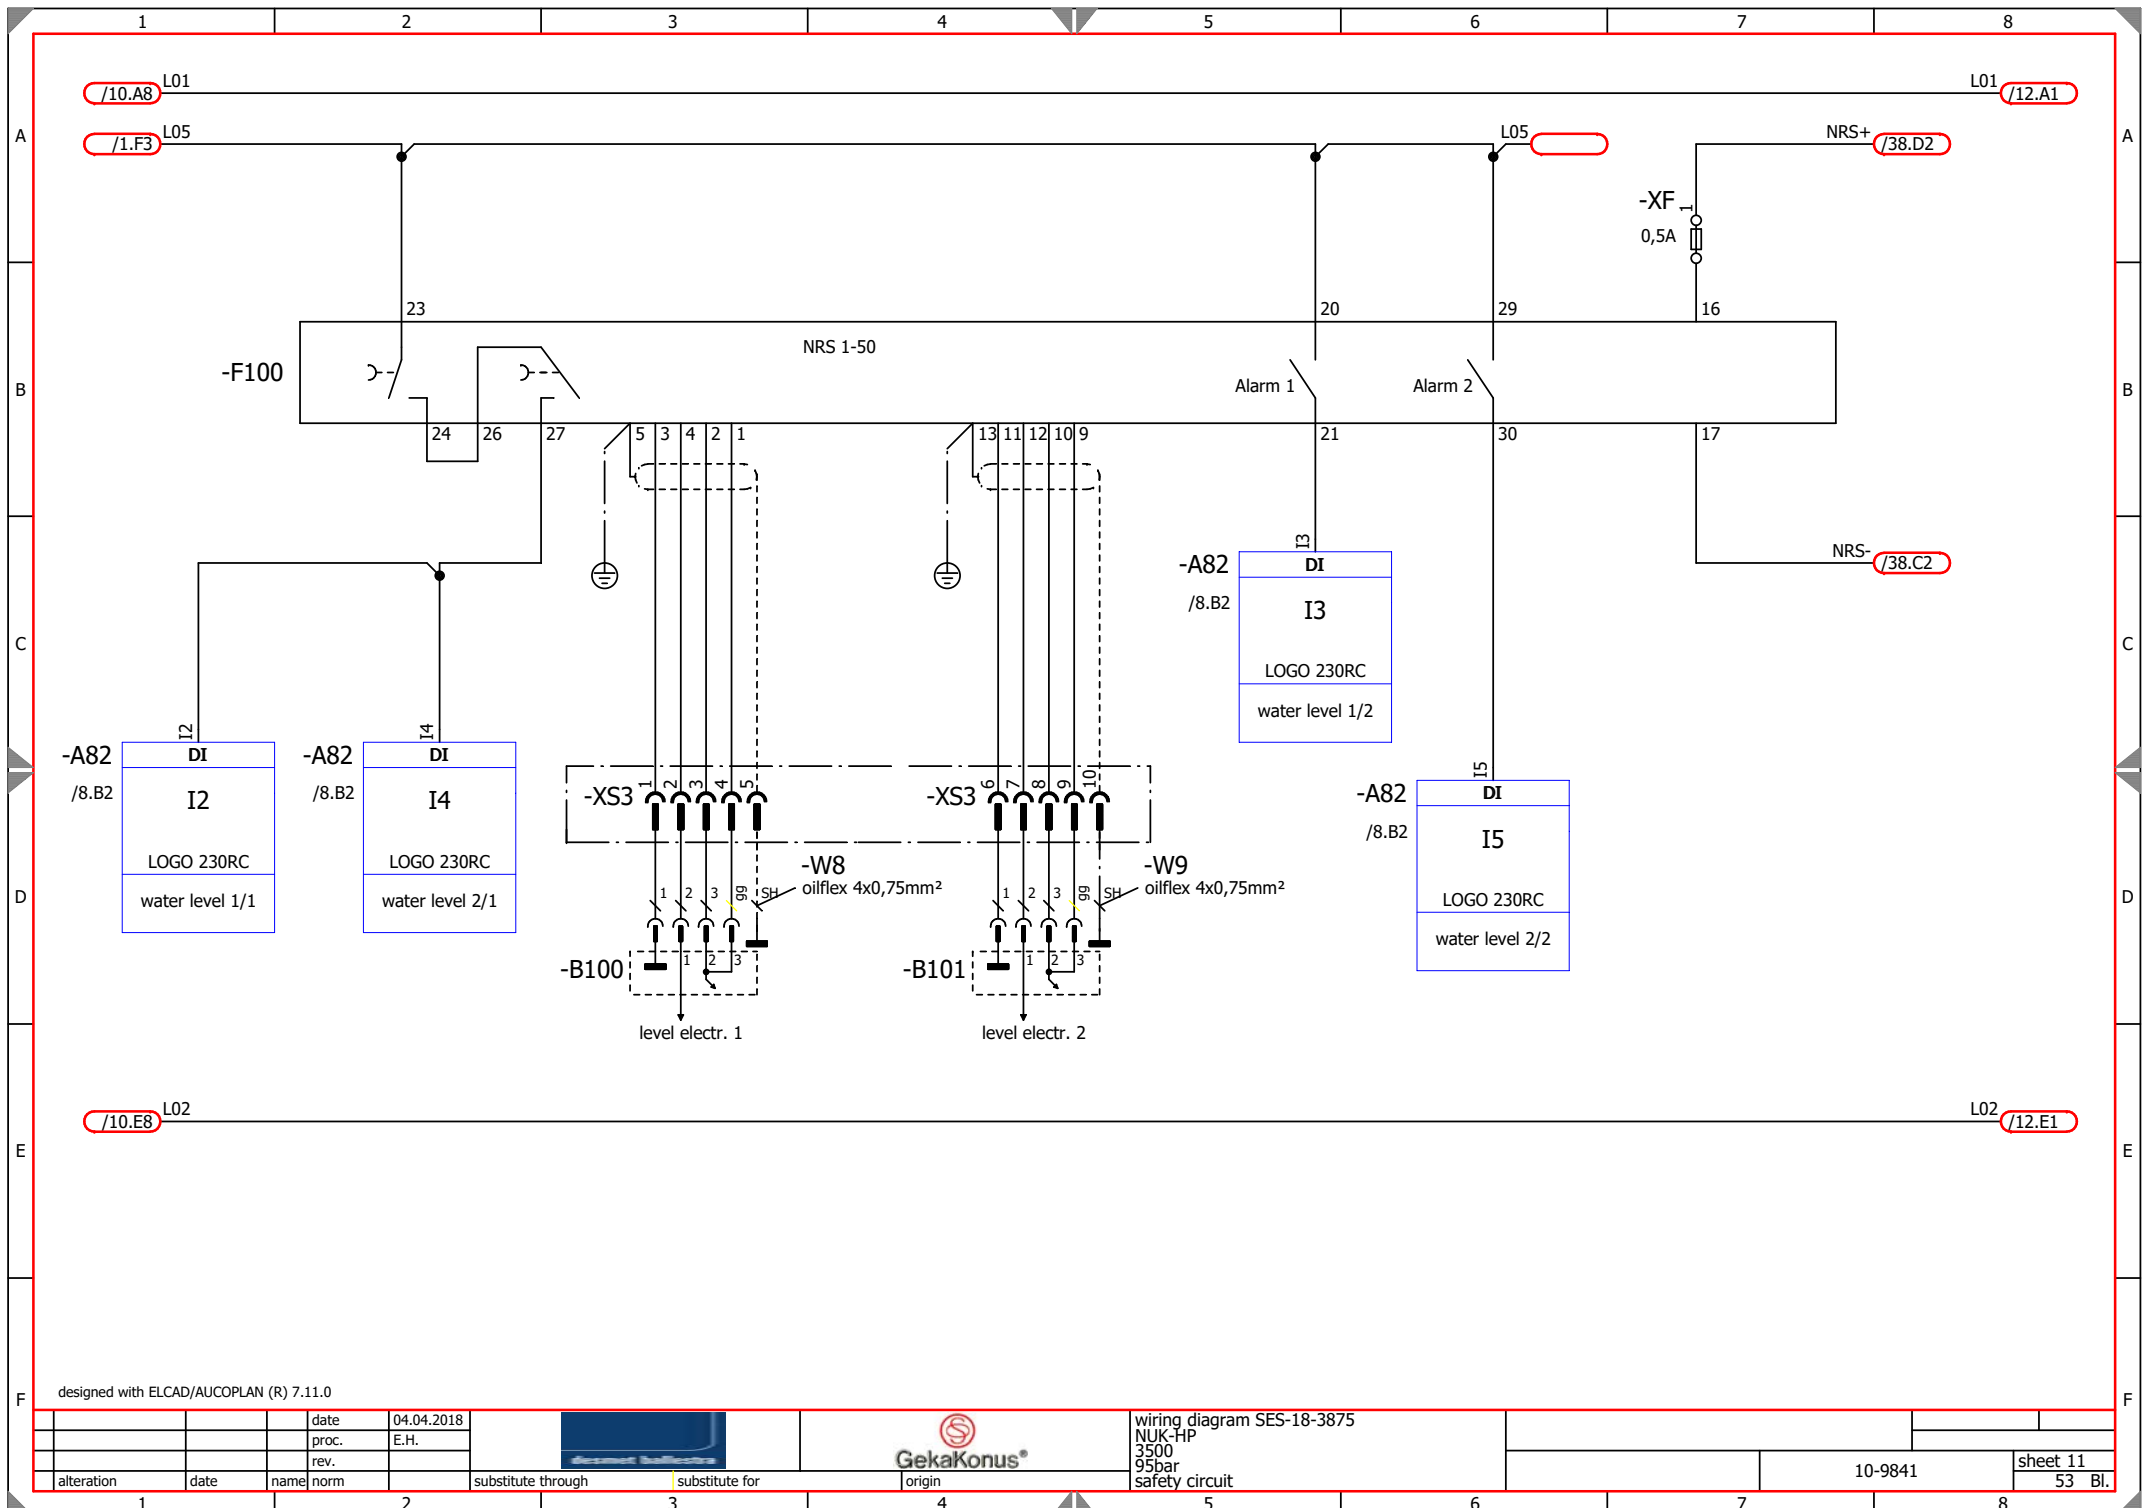

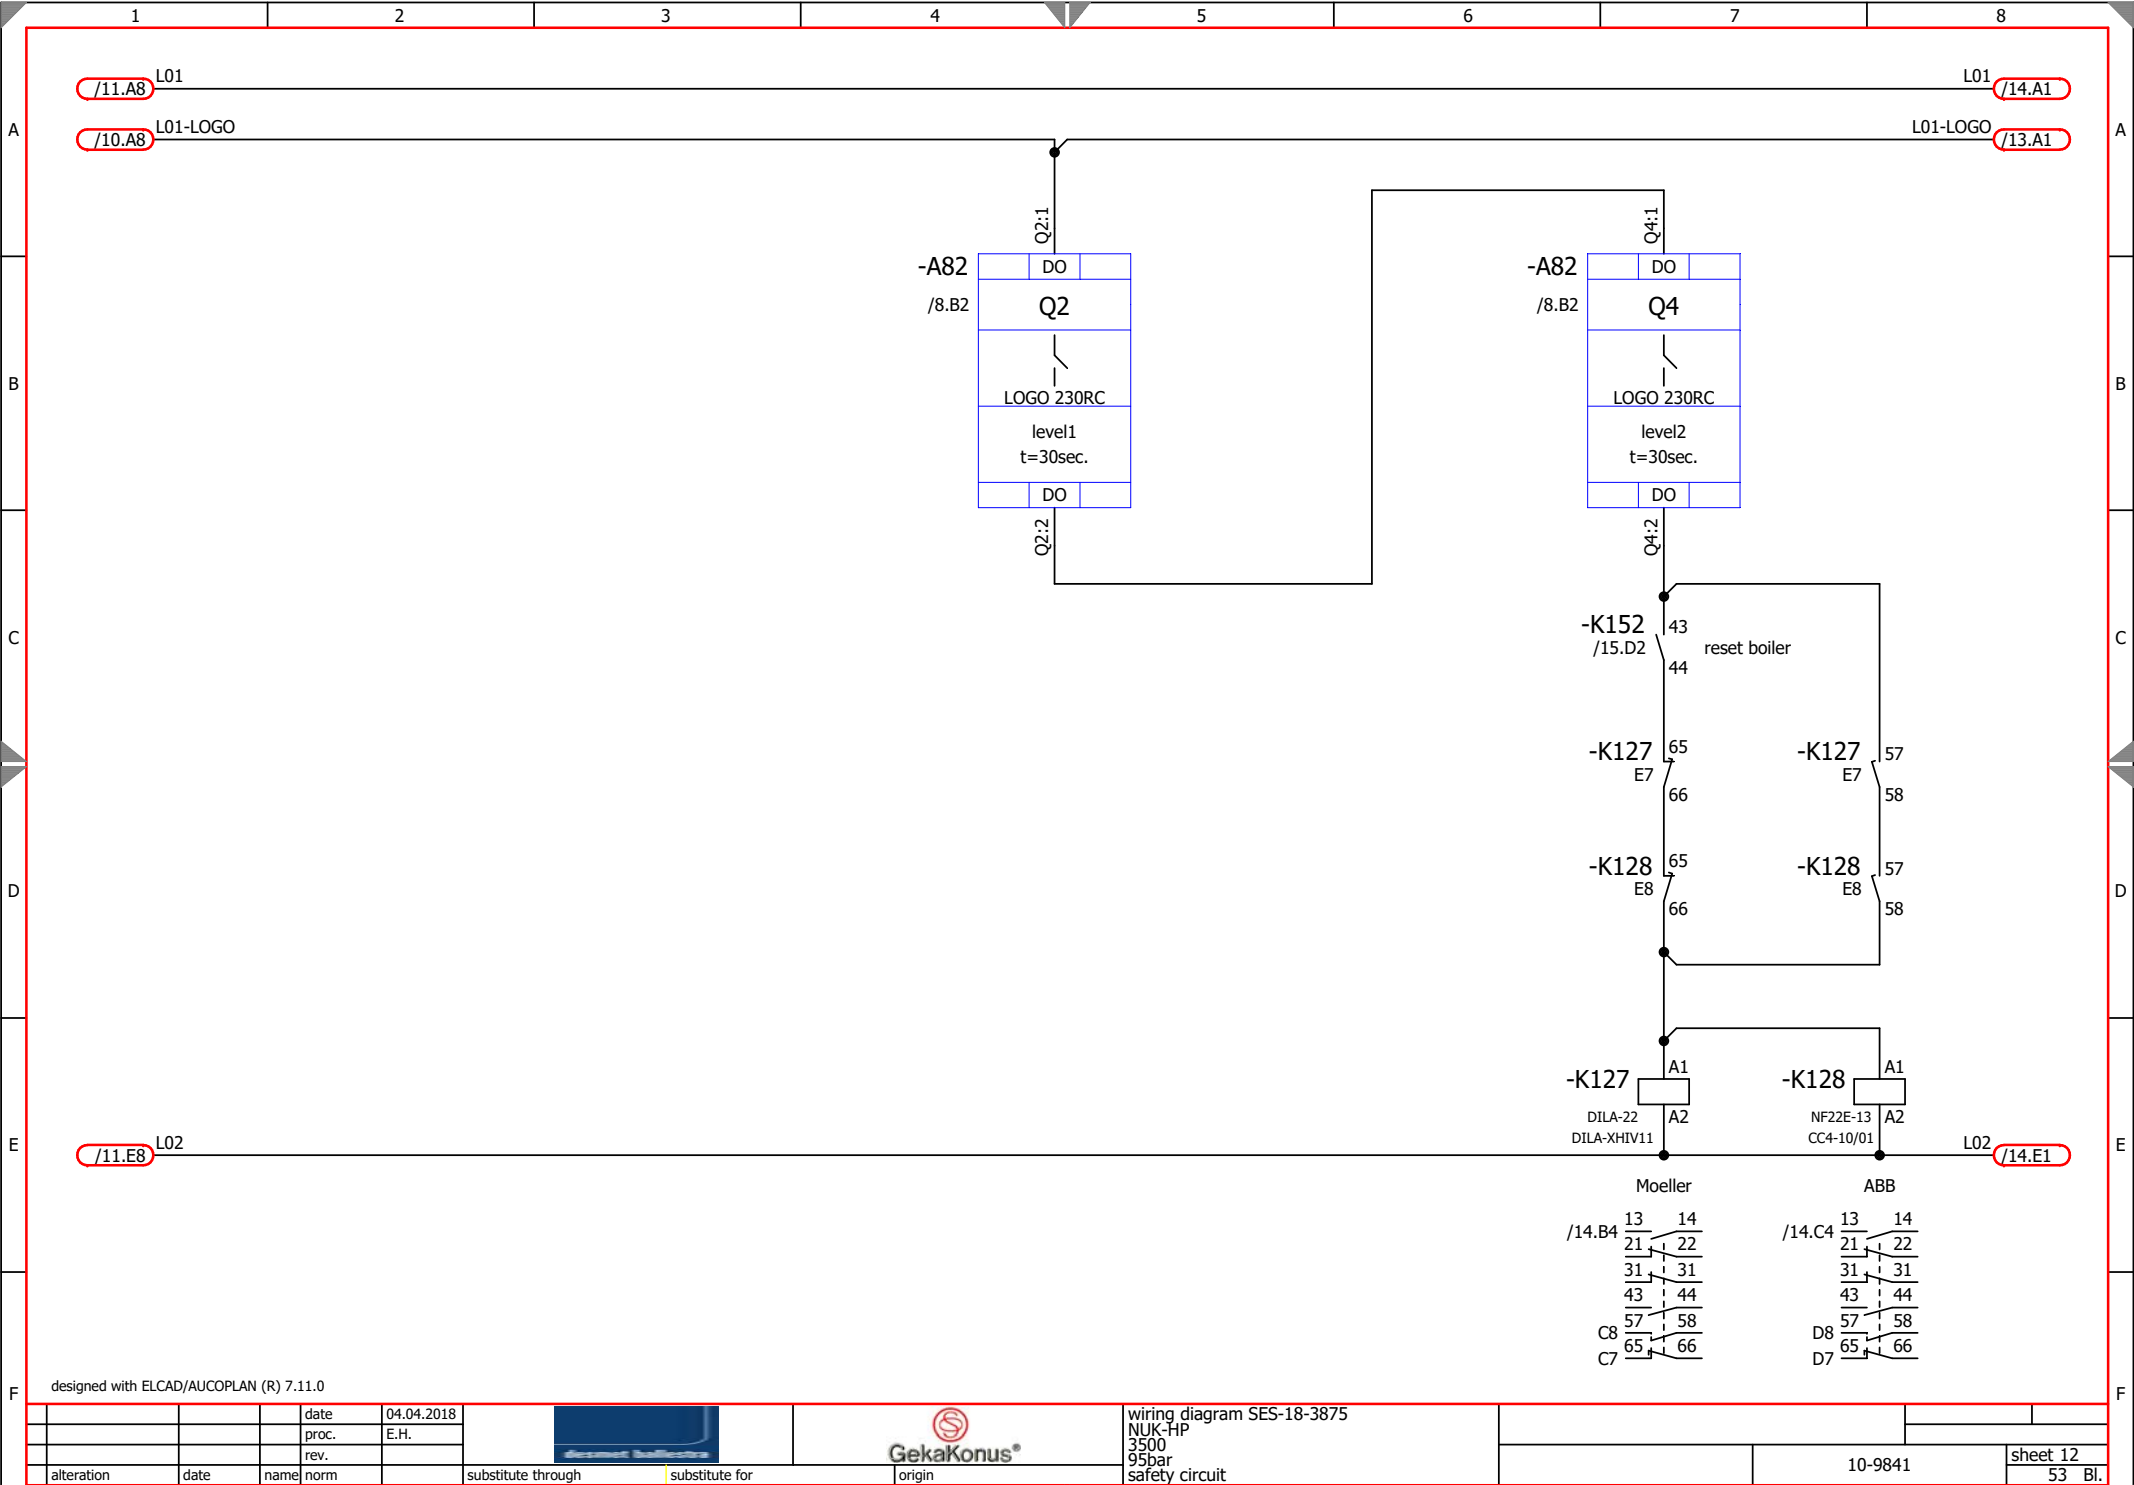


		date	04.04.2018
		proc.	E.H.
		rev.	
alteration	date	name	norm


substitute through	substitute for	origin
--------------------	----------------	--------



wiring diagram SES-18-3875
NUK-HP
3500
95bar
safety circuit

10-9841	sheet 12
	53 Bl.

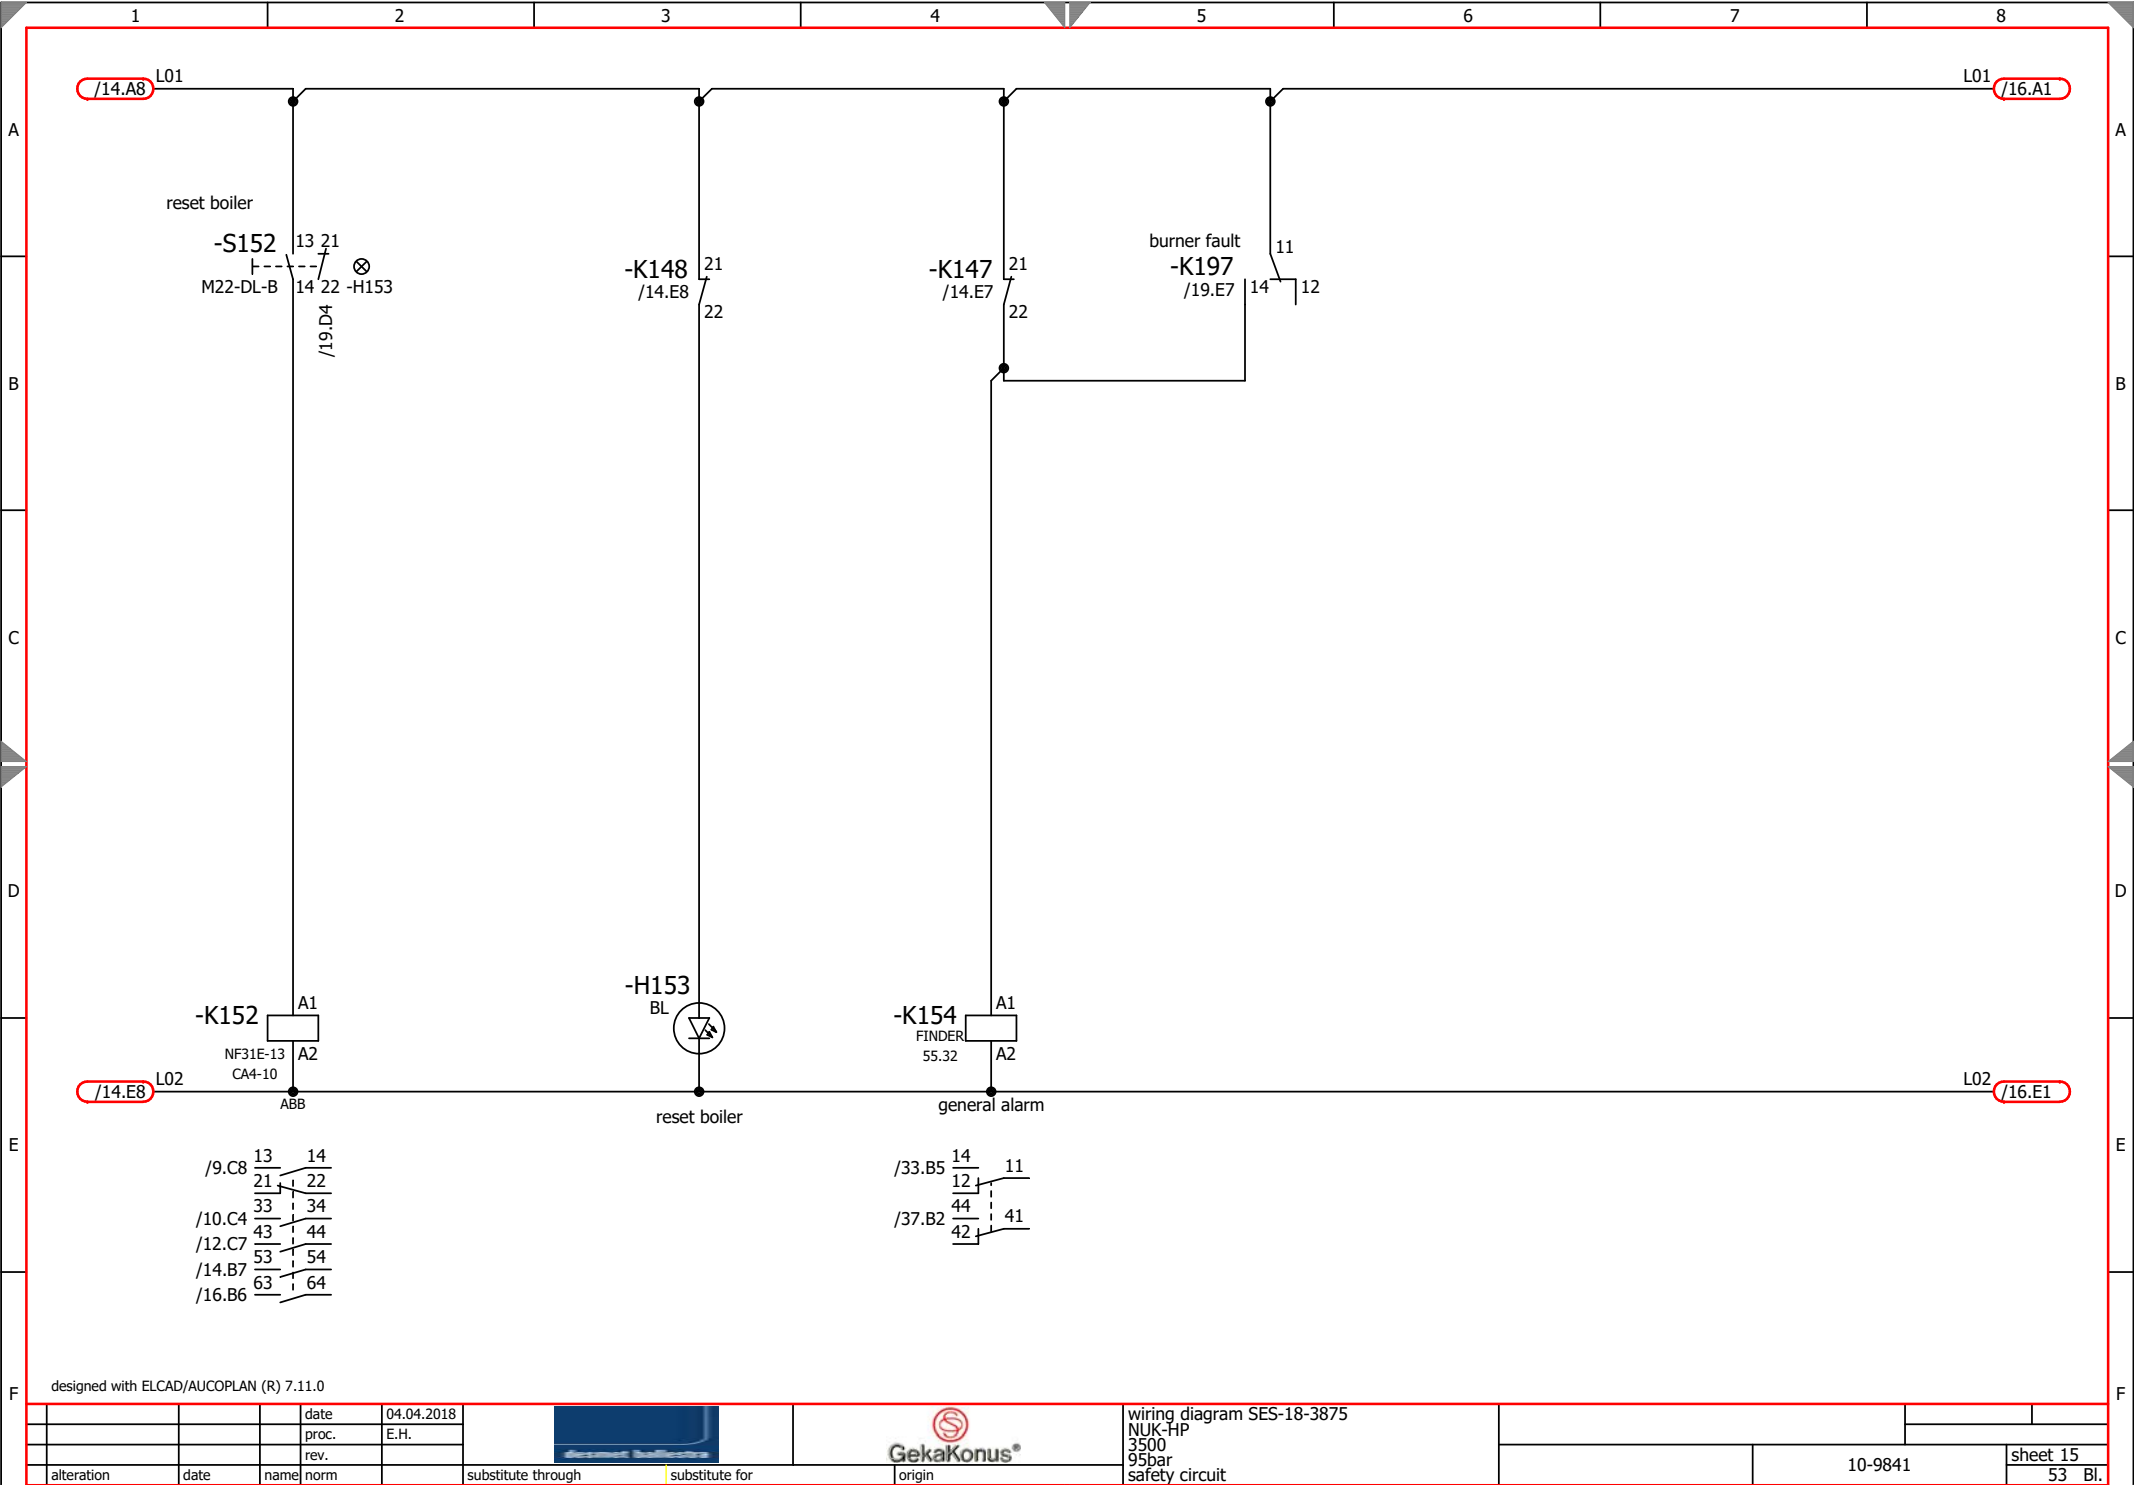

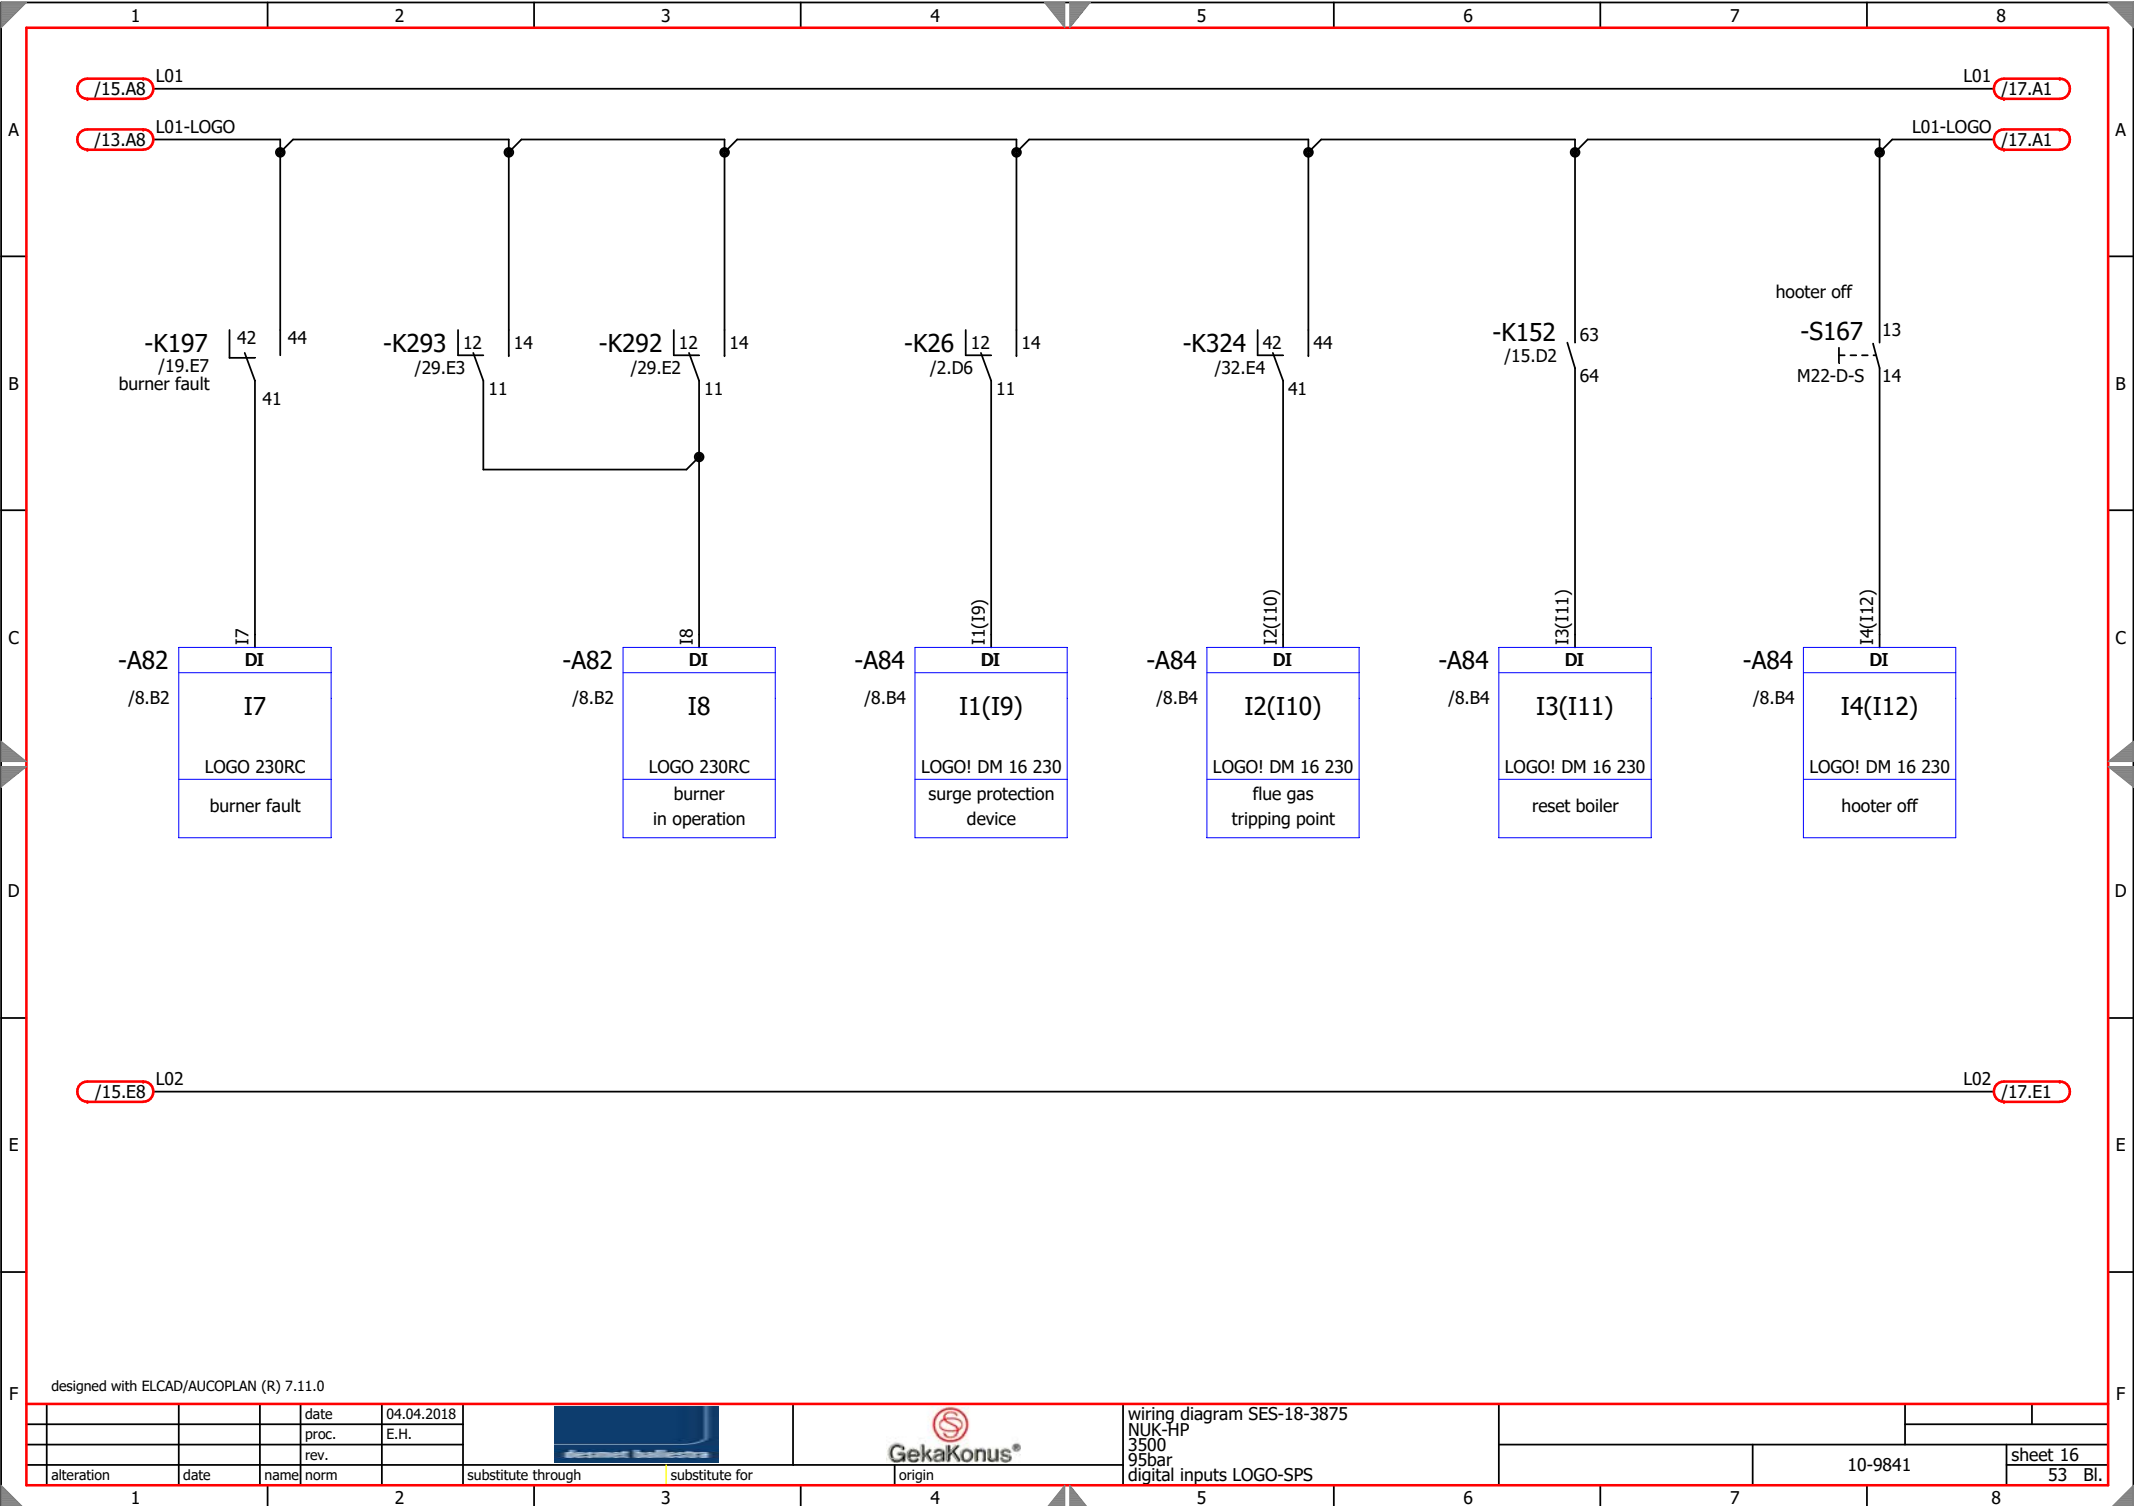


designed with ELCAD/AUCOPLAN (R) 7.11.0





wiring diagram SES-18-3875
NUK-HP
3500
95bar
digital inputs LOGO-SPS

10-9841

sheet 16
53 Bl.

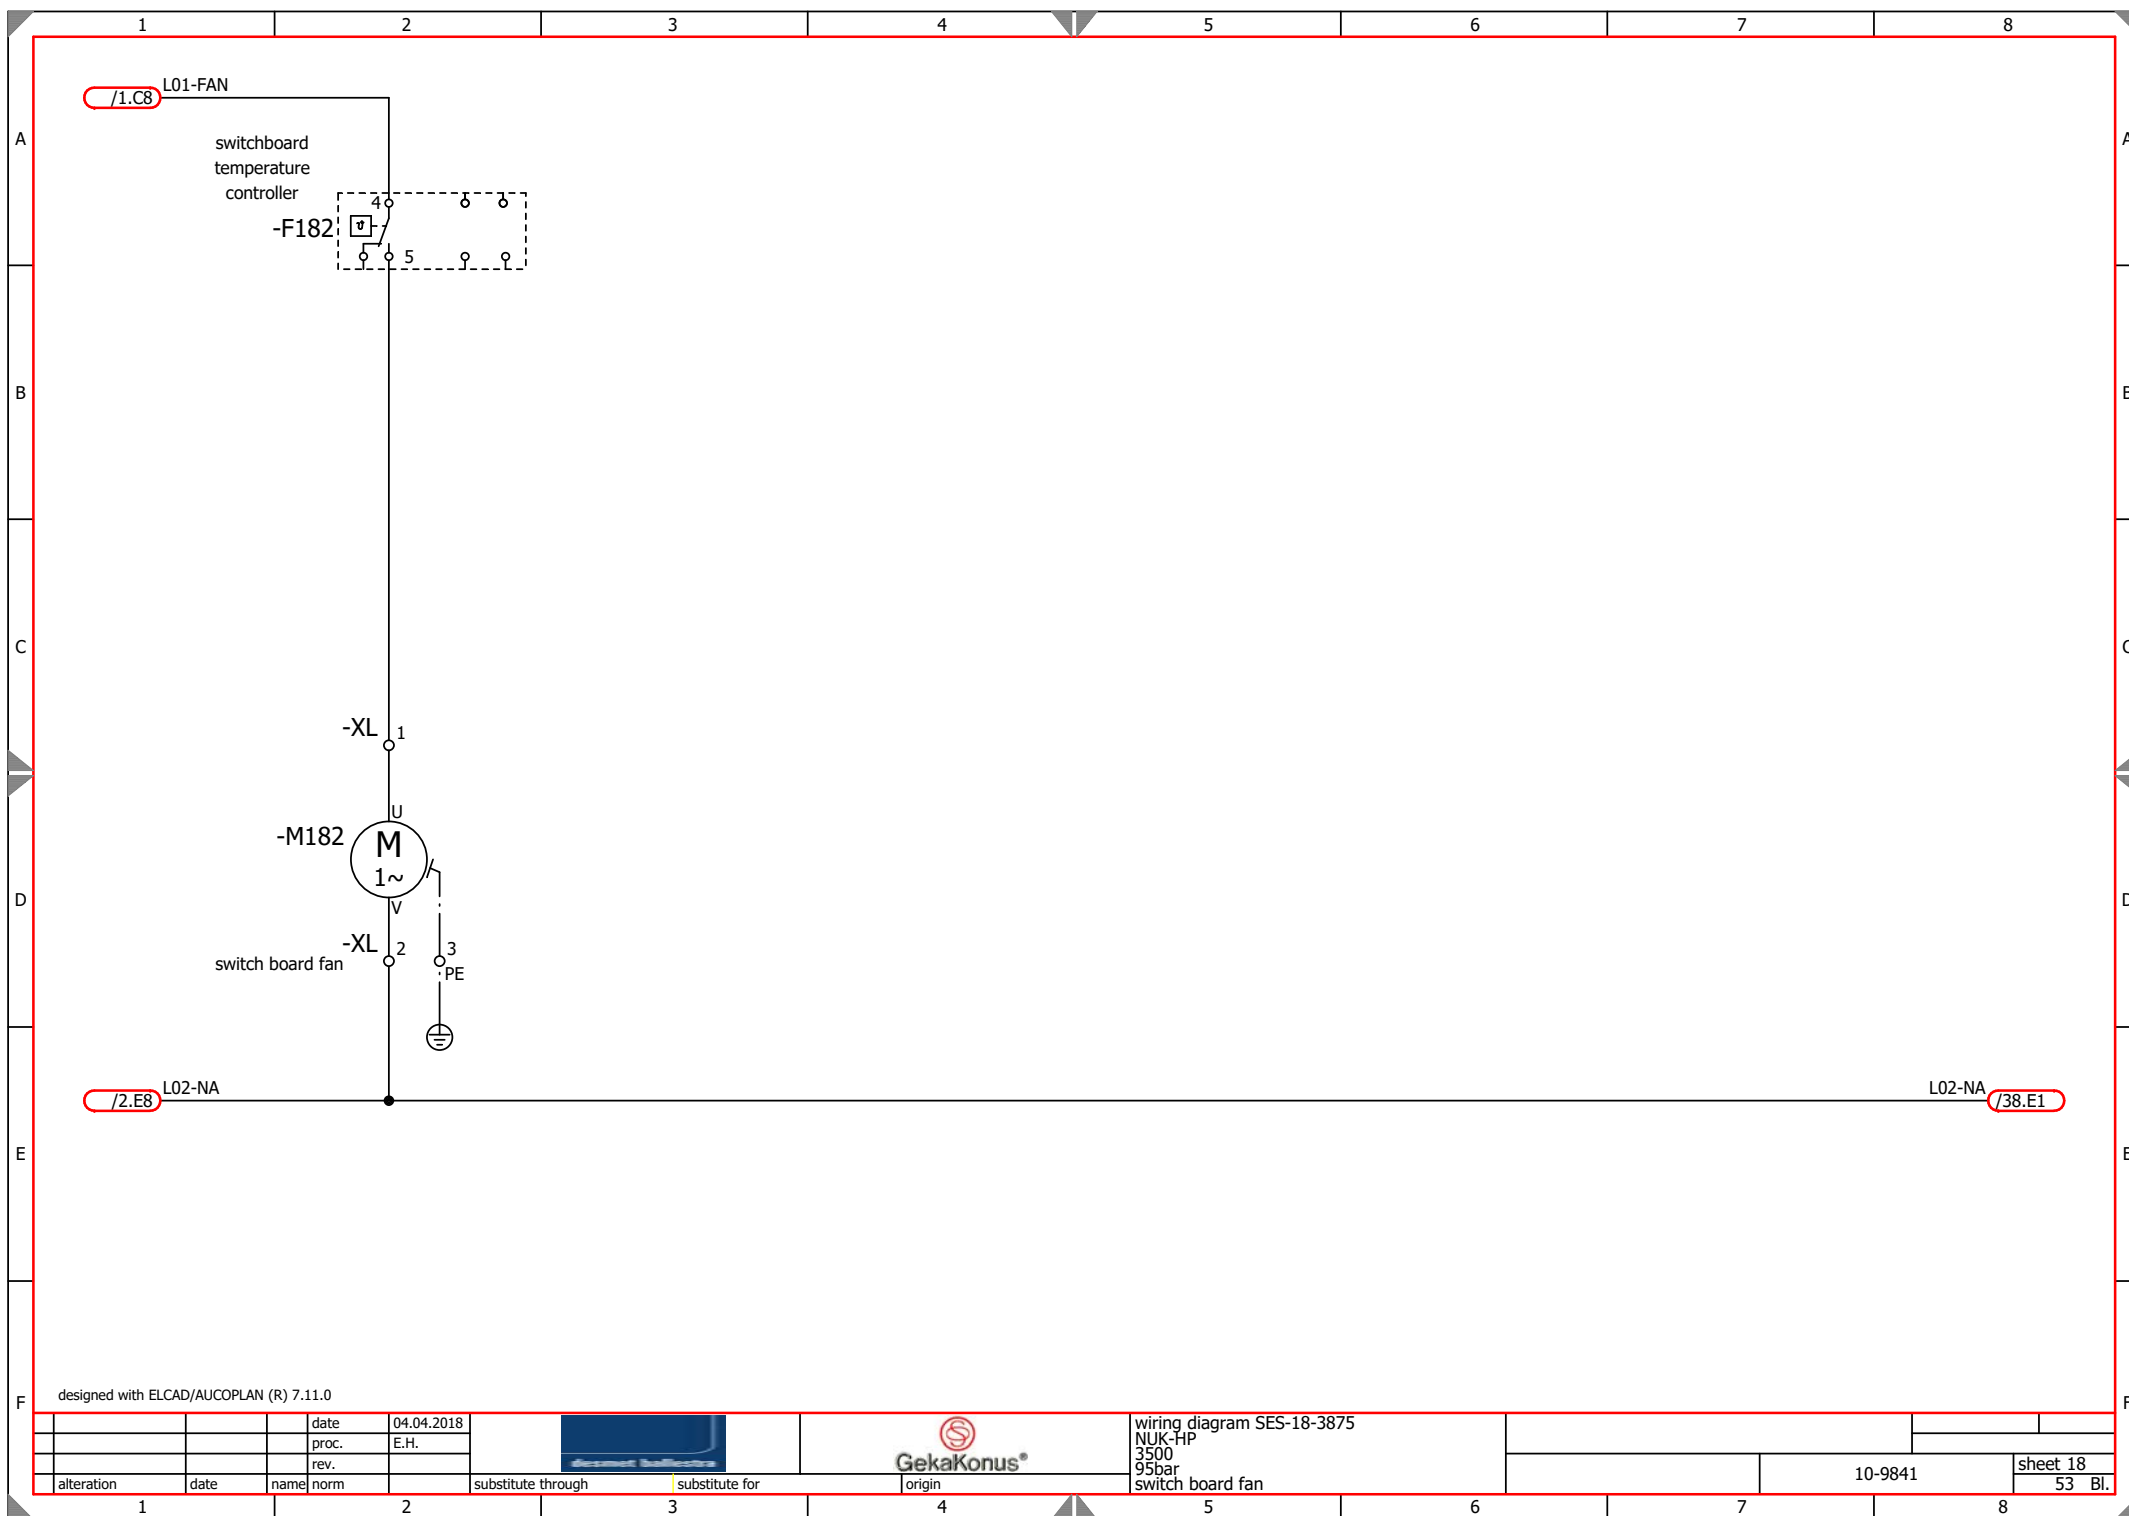

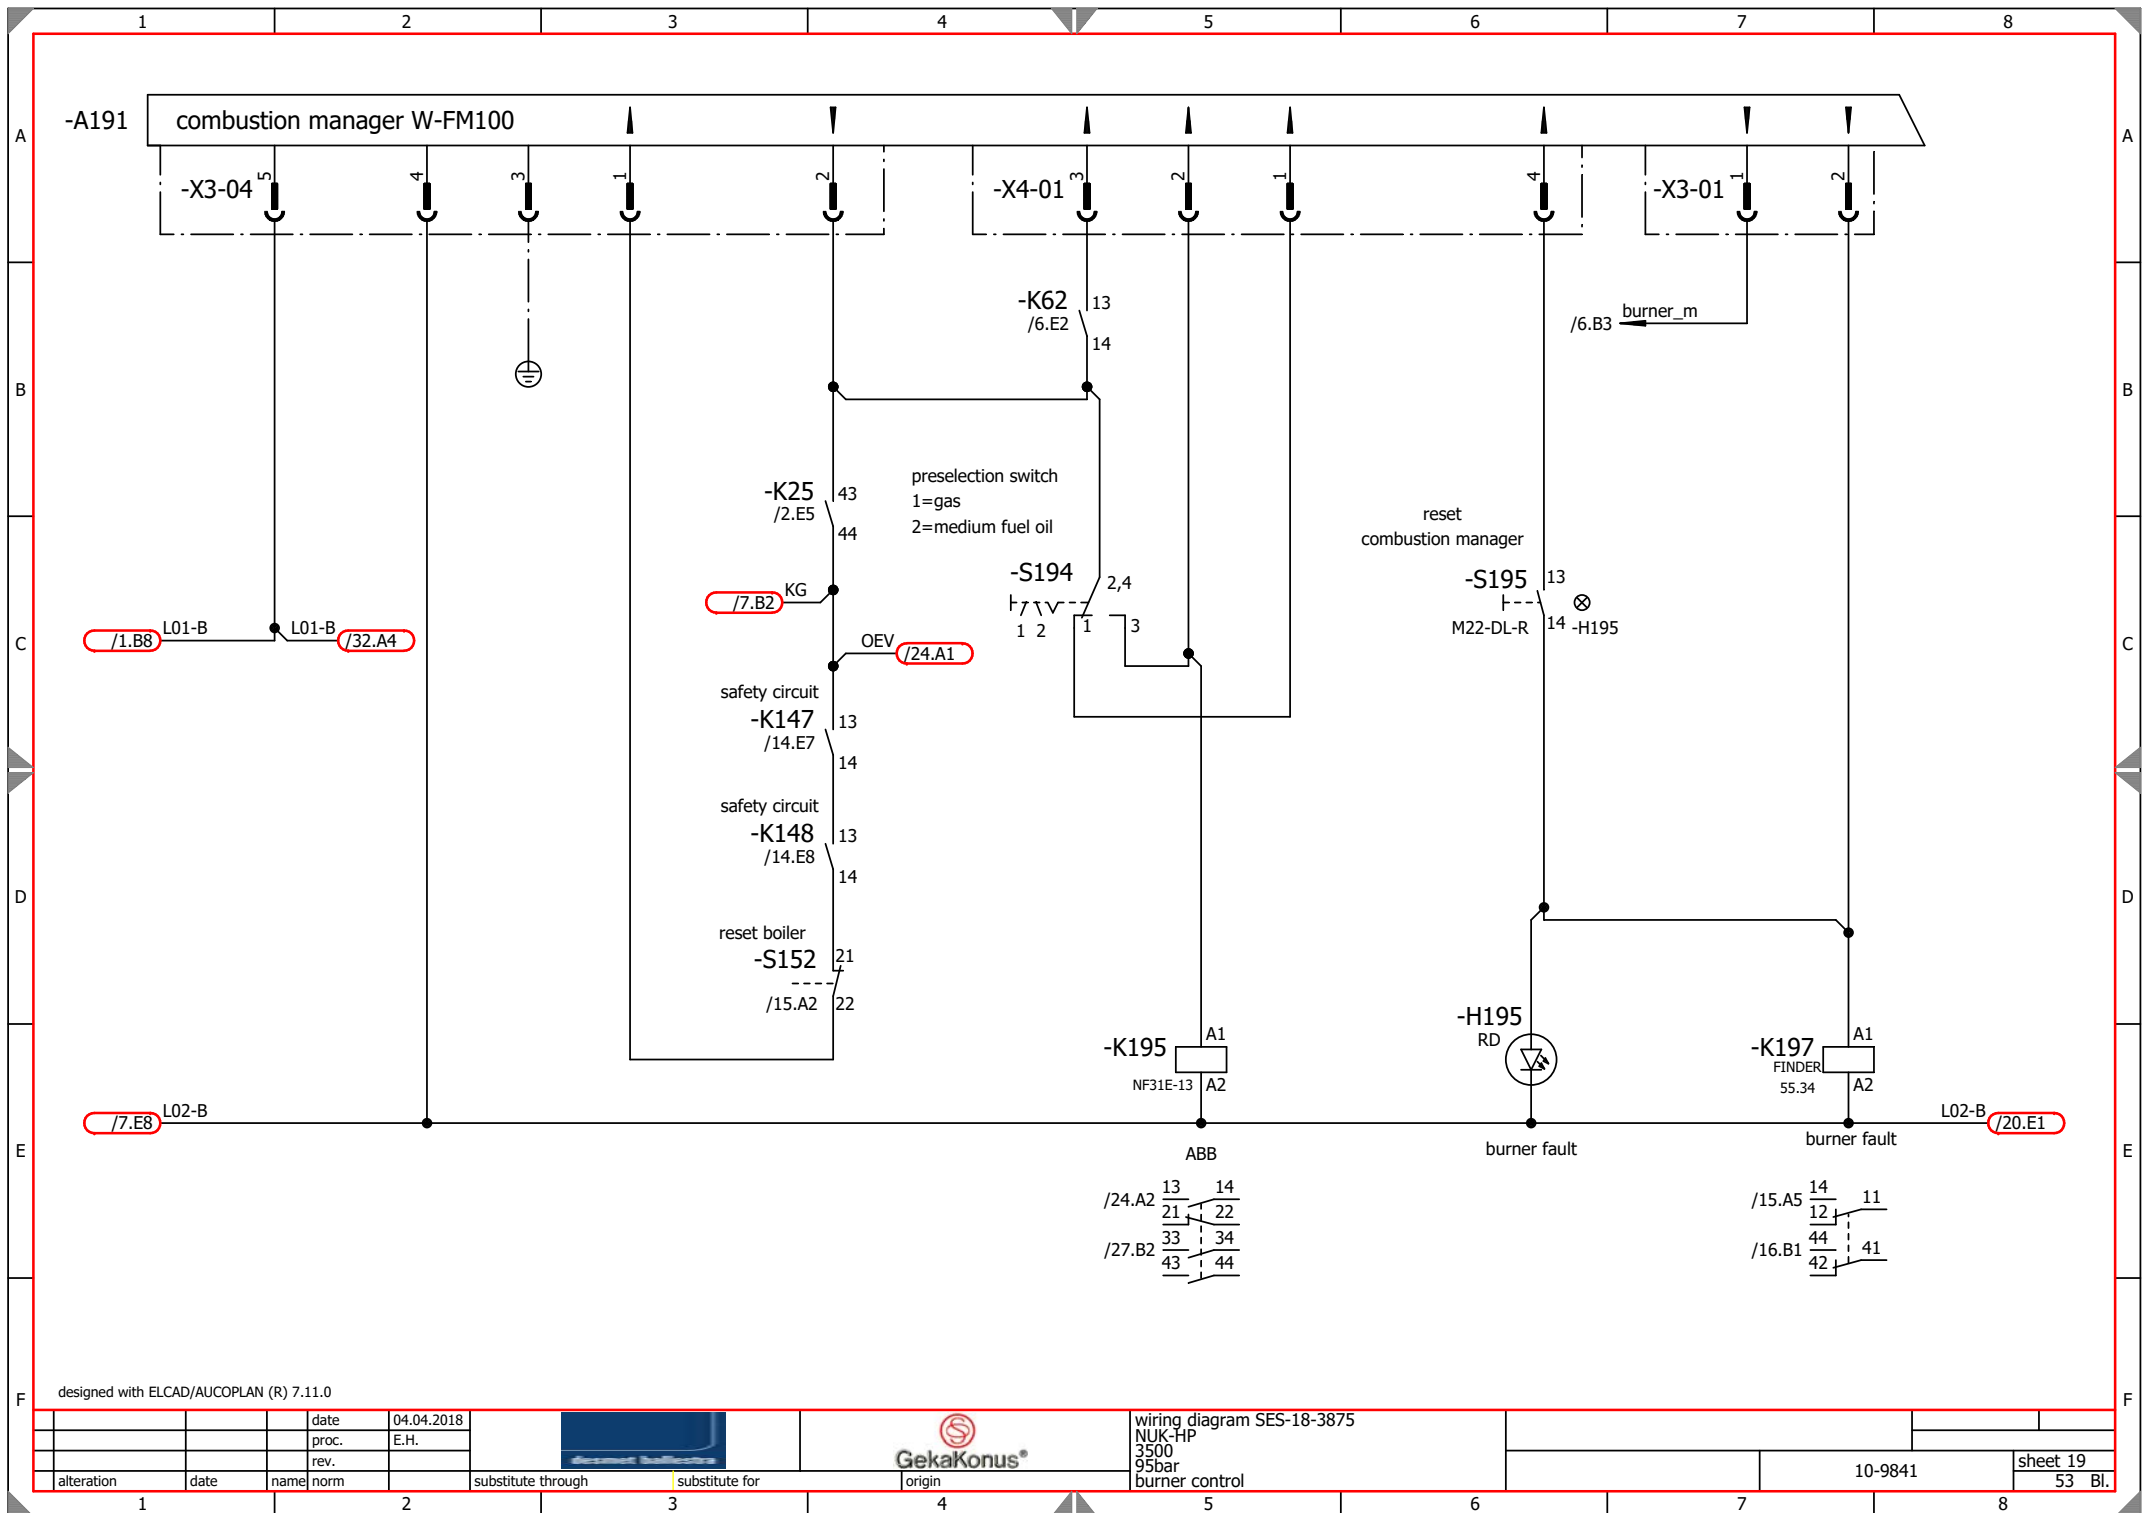

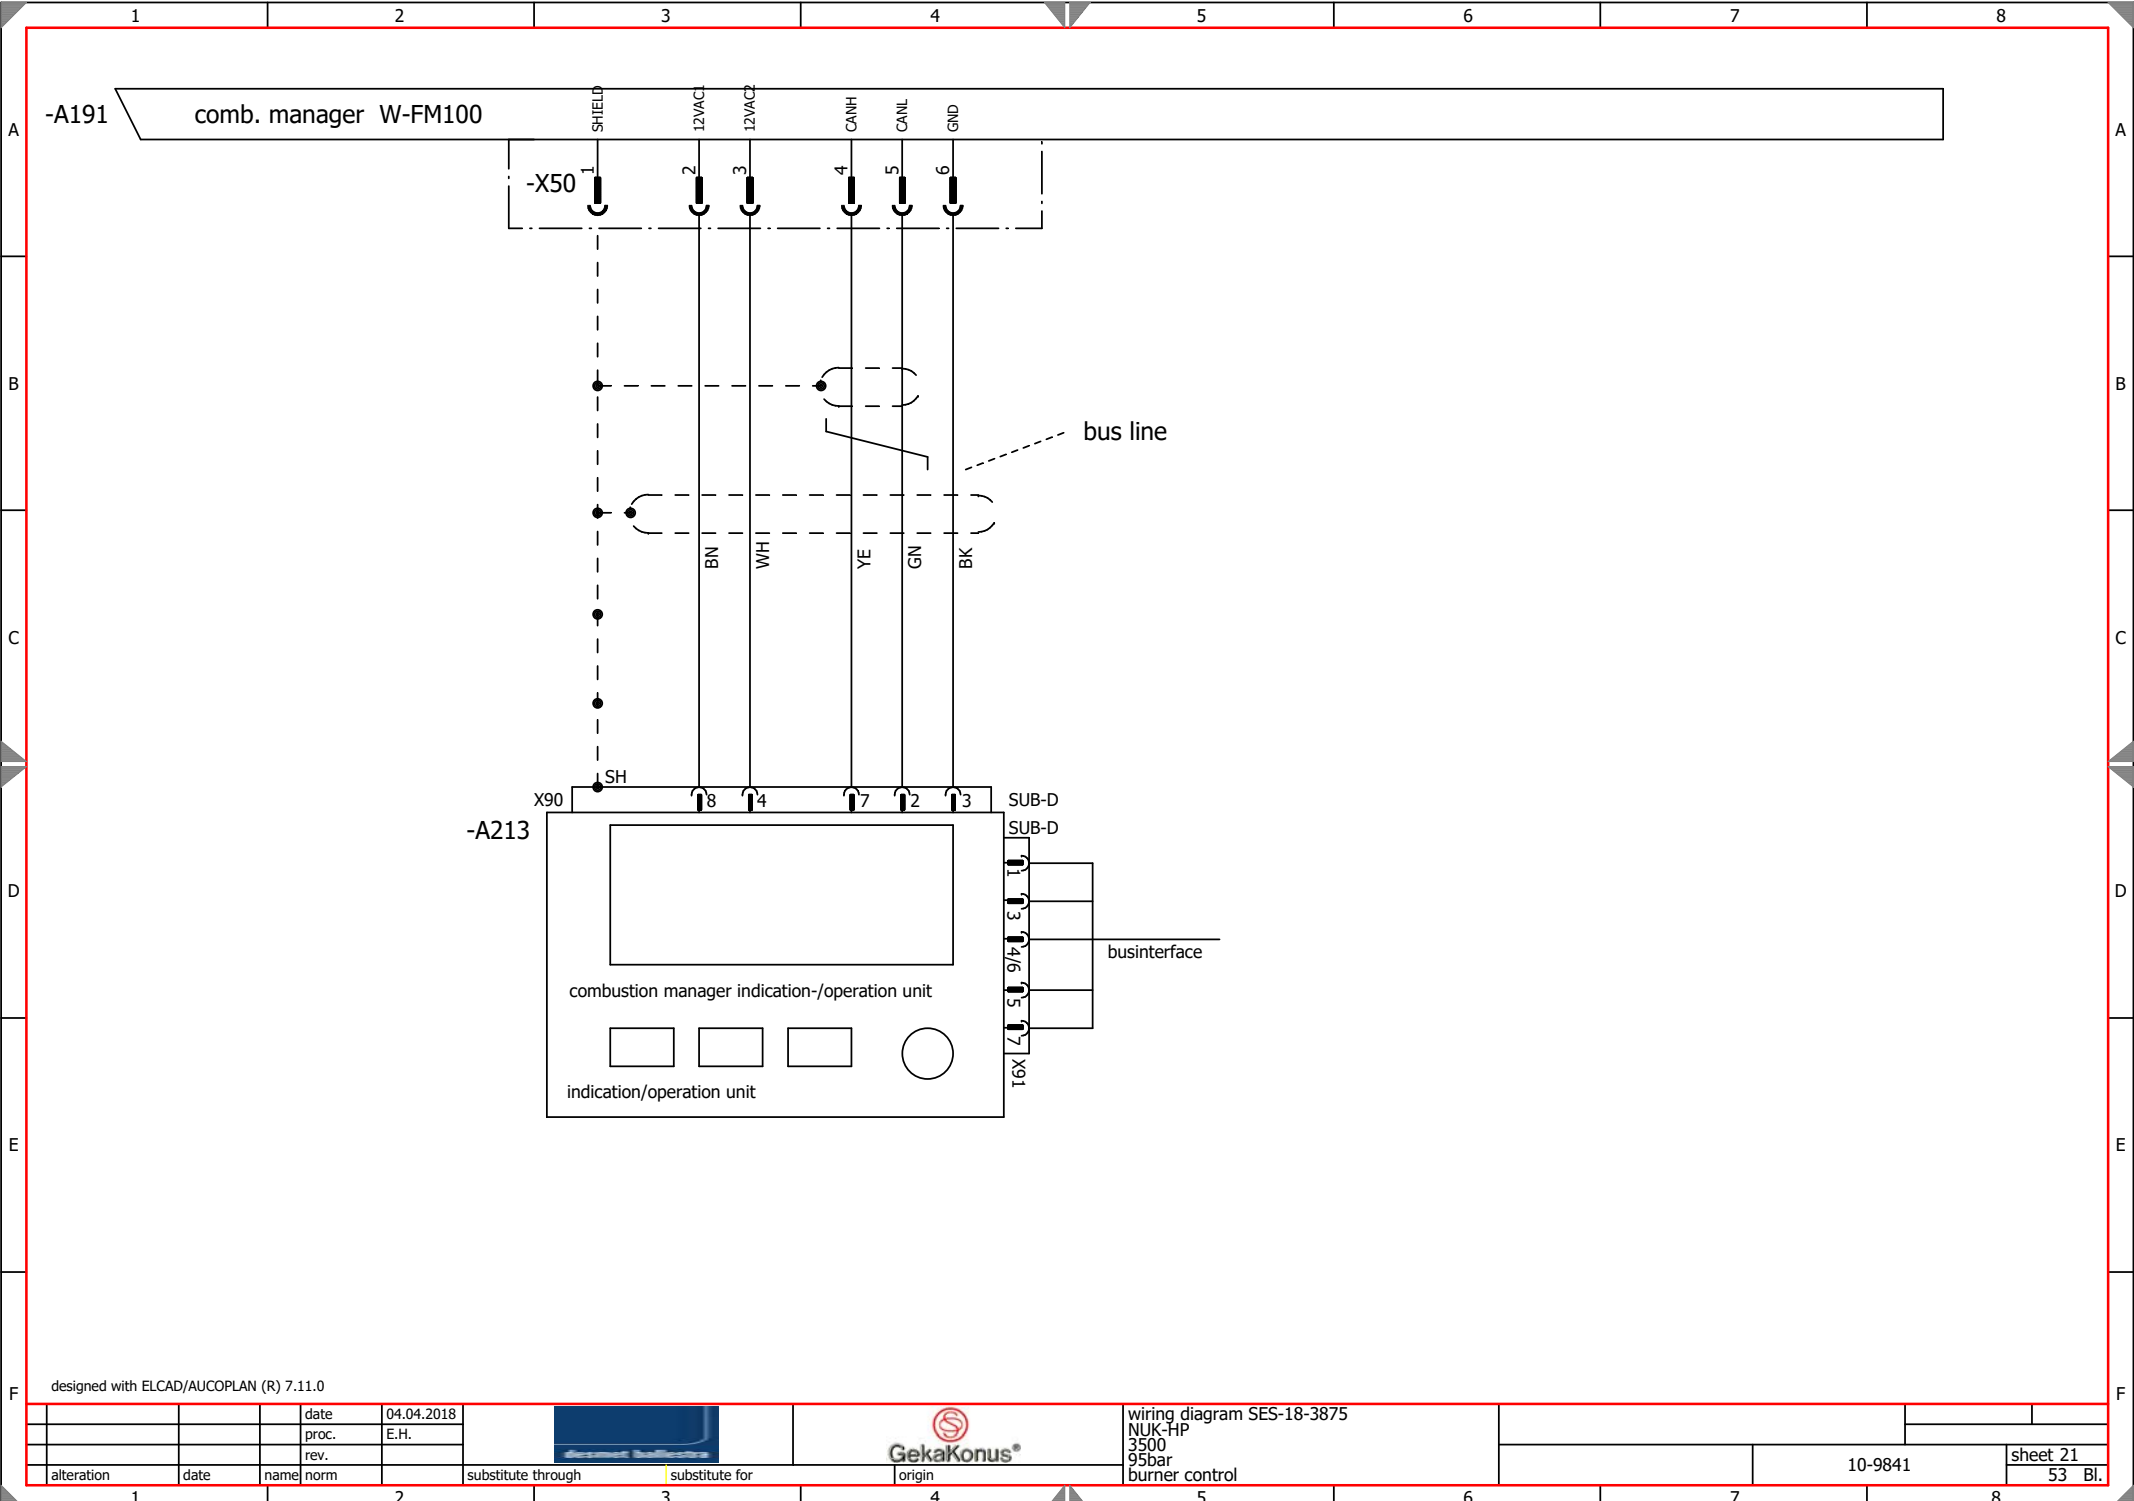

designed with ELCAD/AUCOPLAN (R) 7.11.0

			date	04.04.2018
			proc.	E.H.
			rev.	
alteration	date	name	norm	


substitute through	substitute for
--------------------	----------------


origin


wiring diagram SES-18-3875
NUK-HP
3500
95bar
burner control

10-9841

sheet 21
53 Bl.

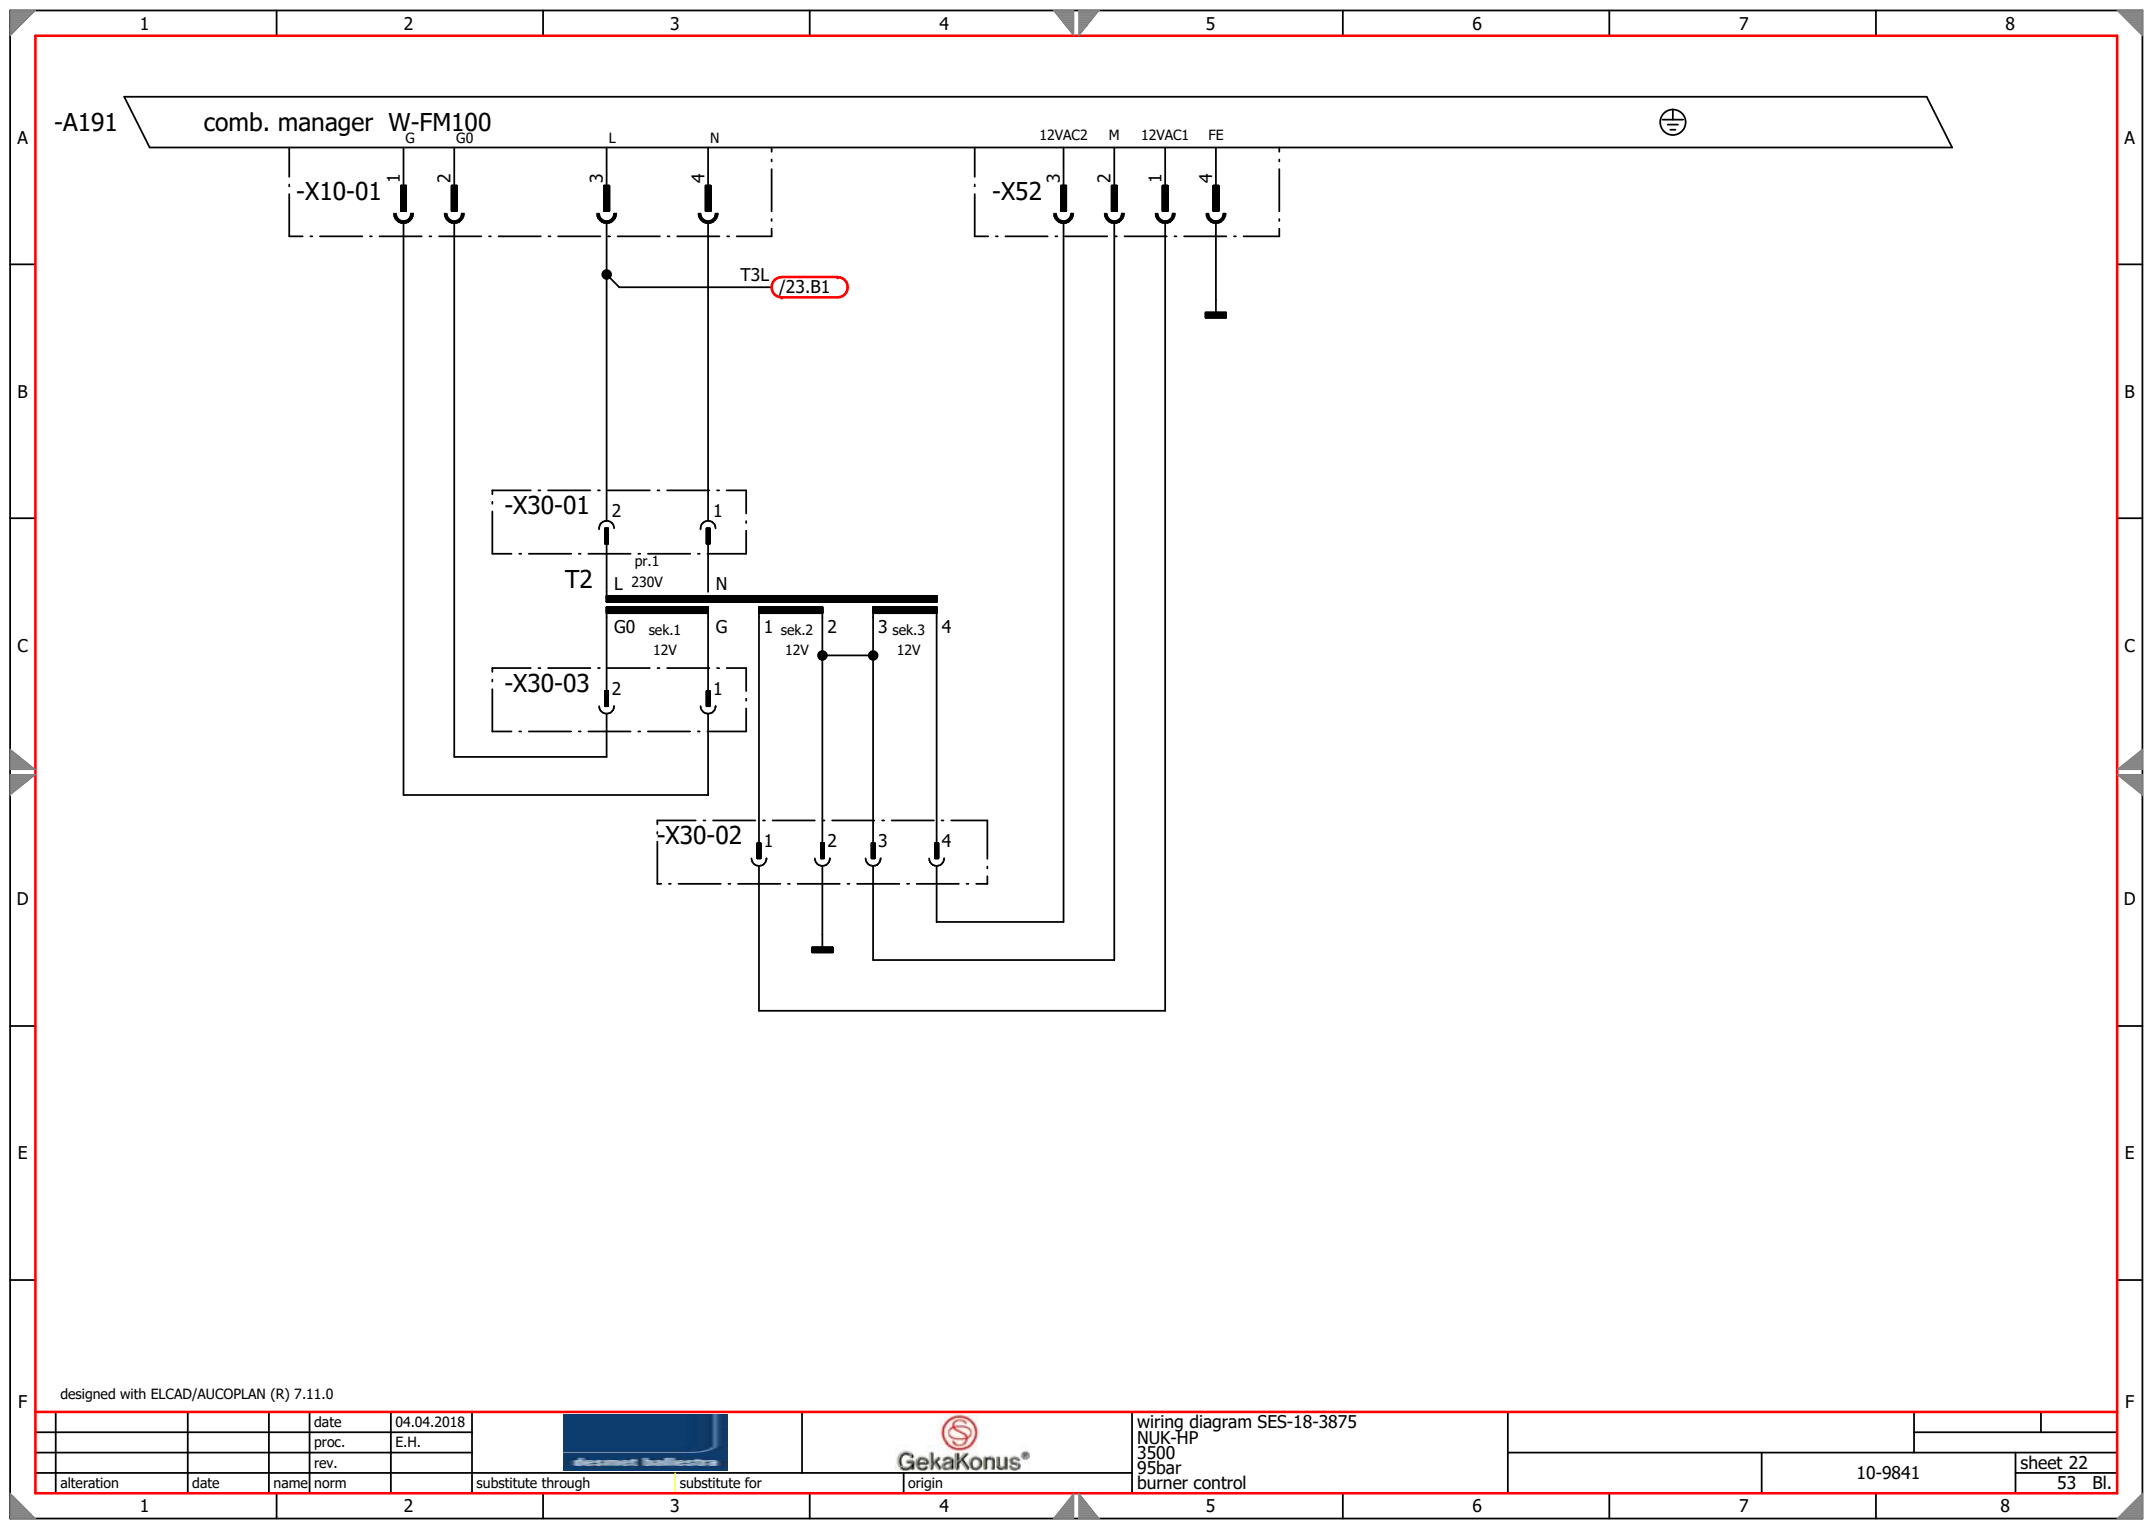


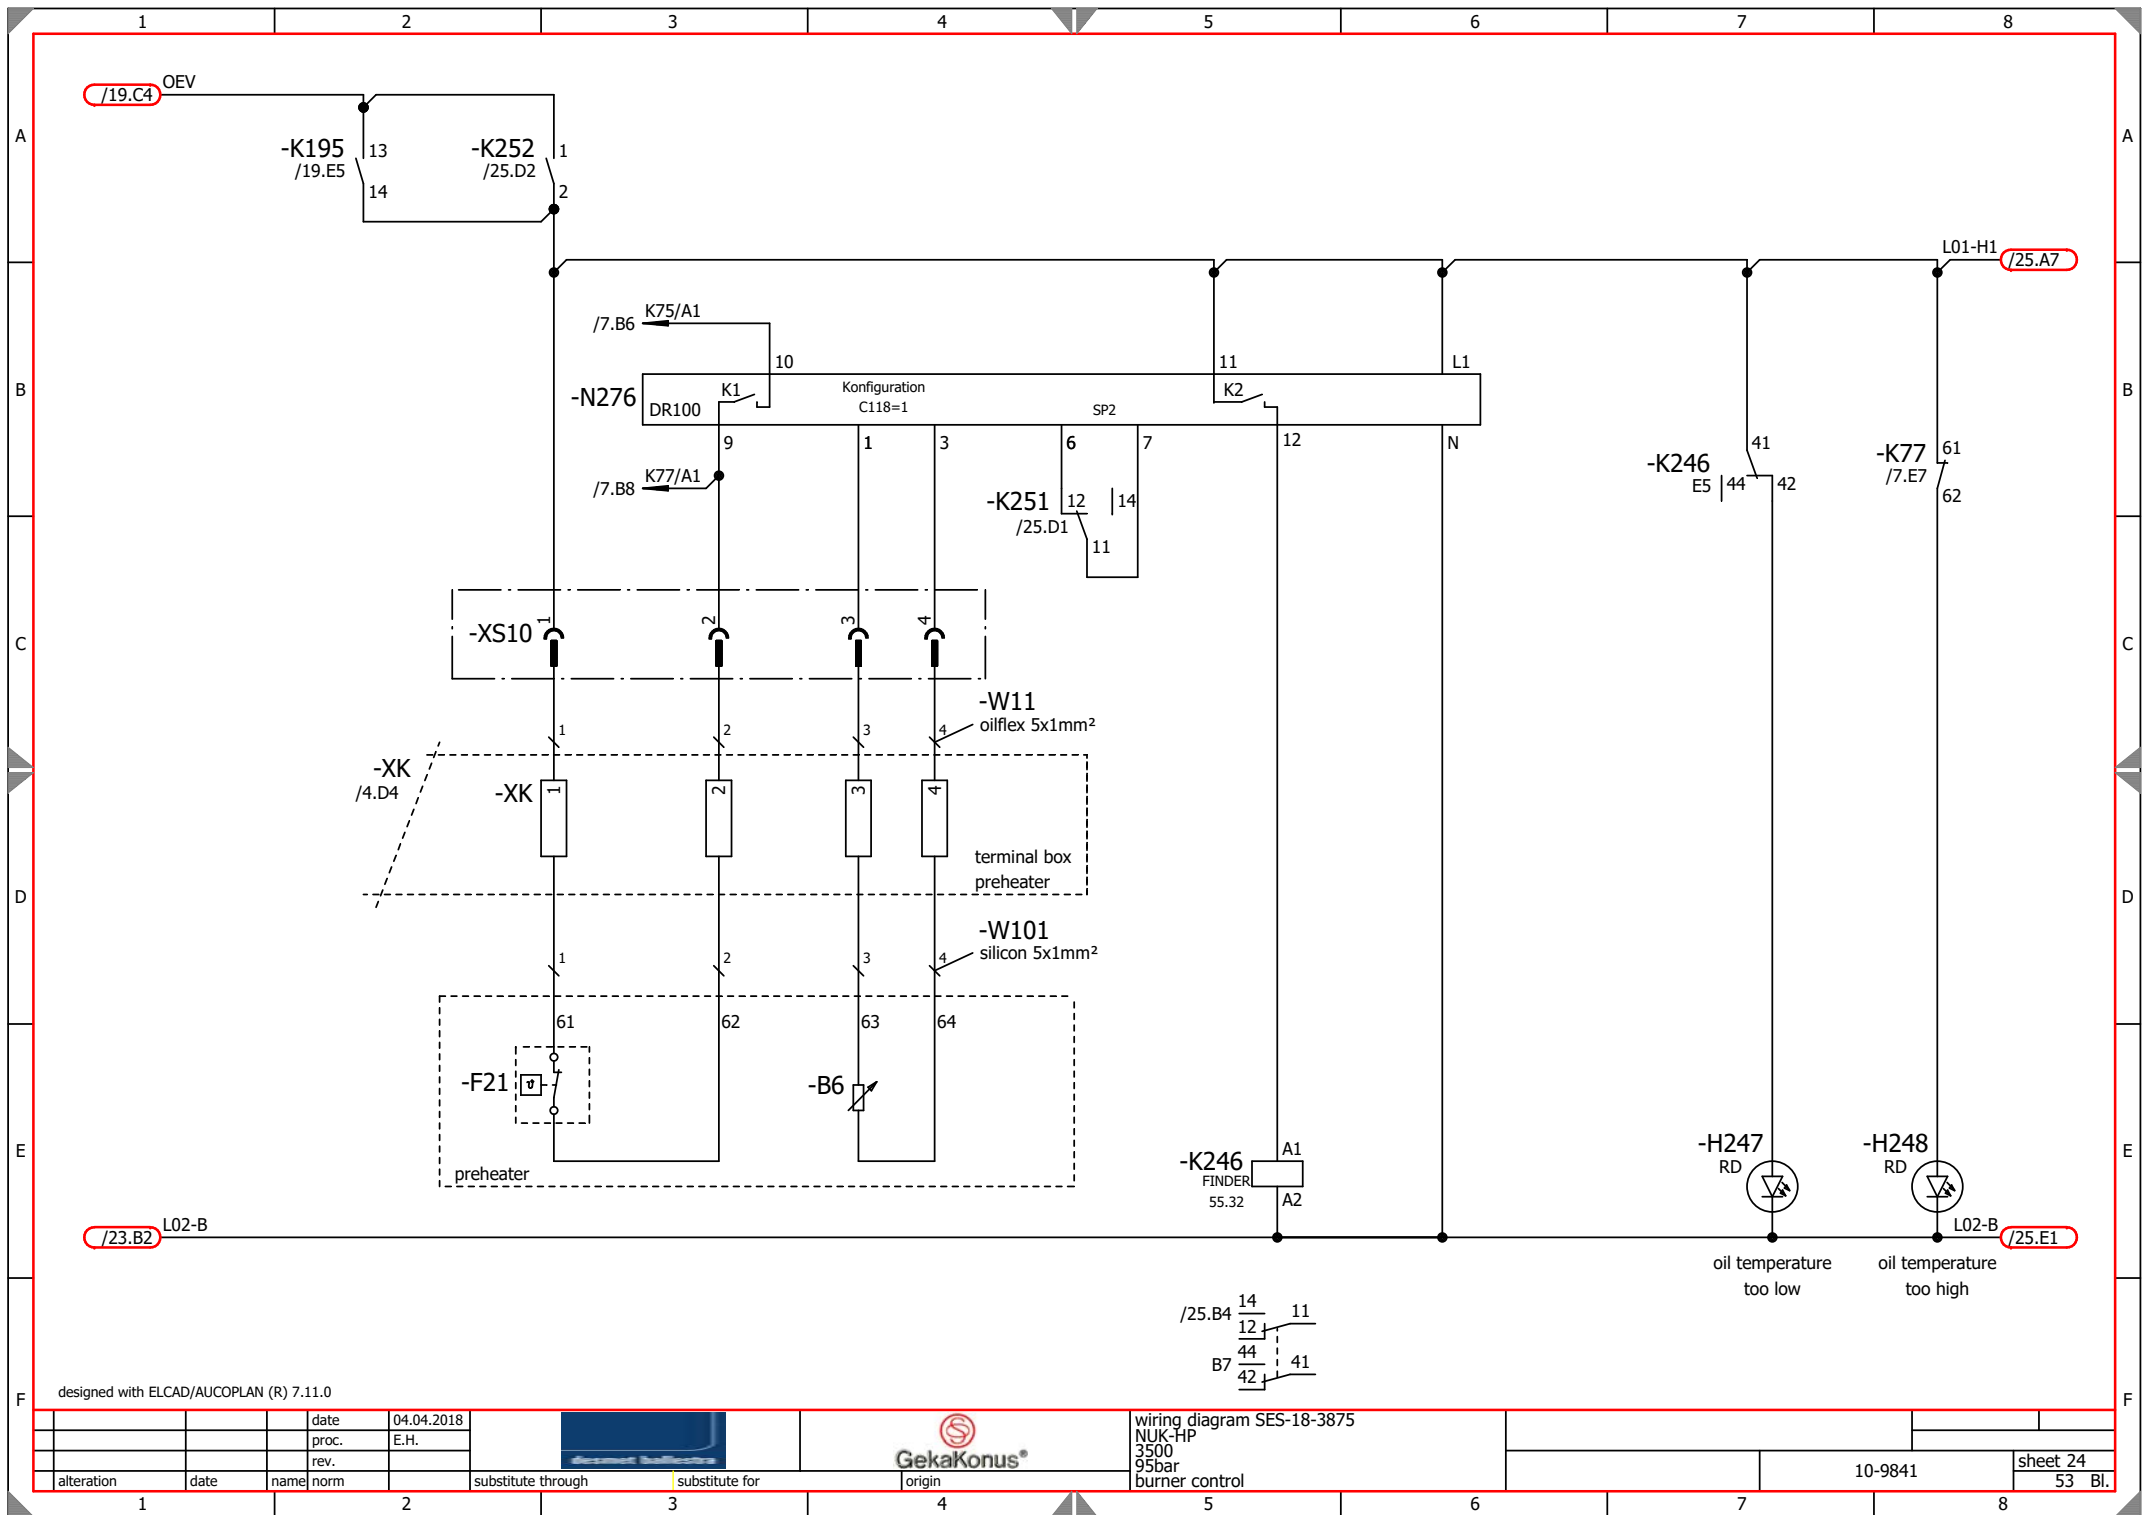

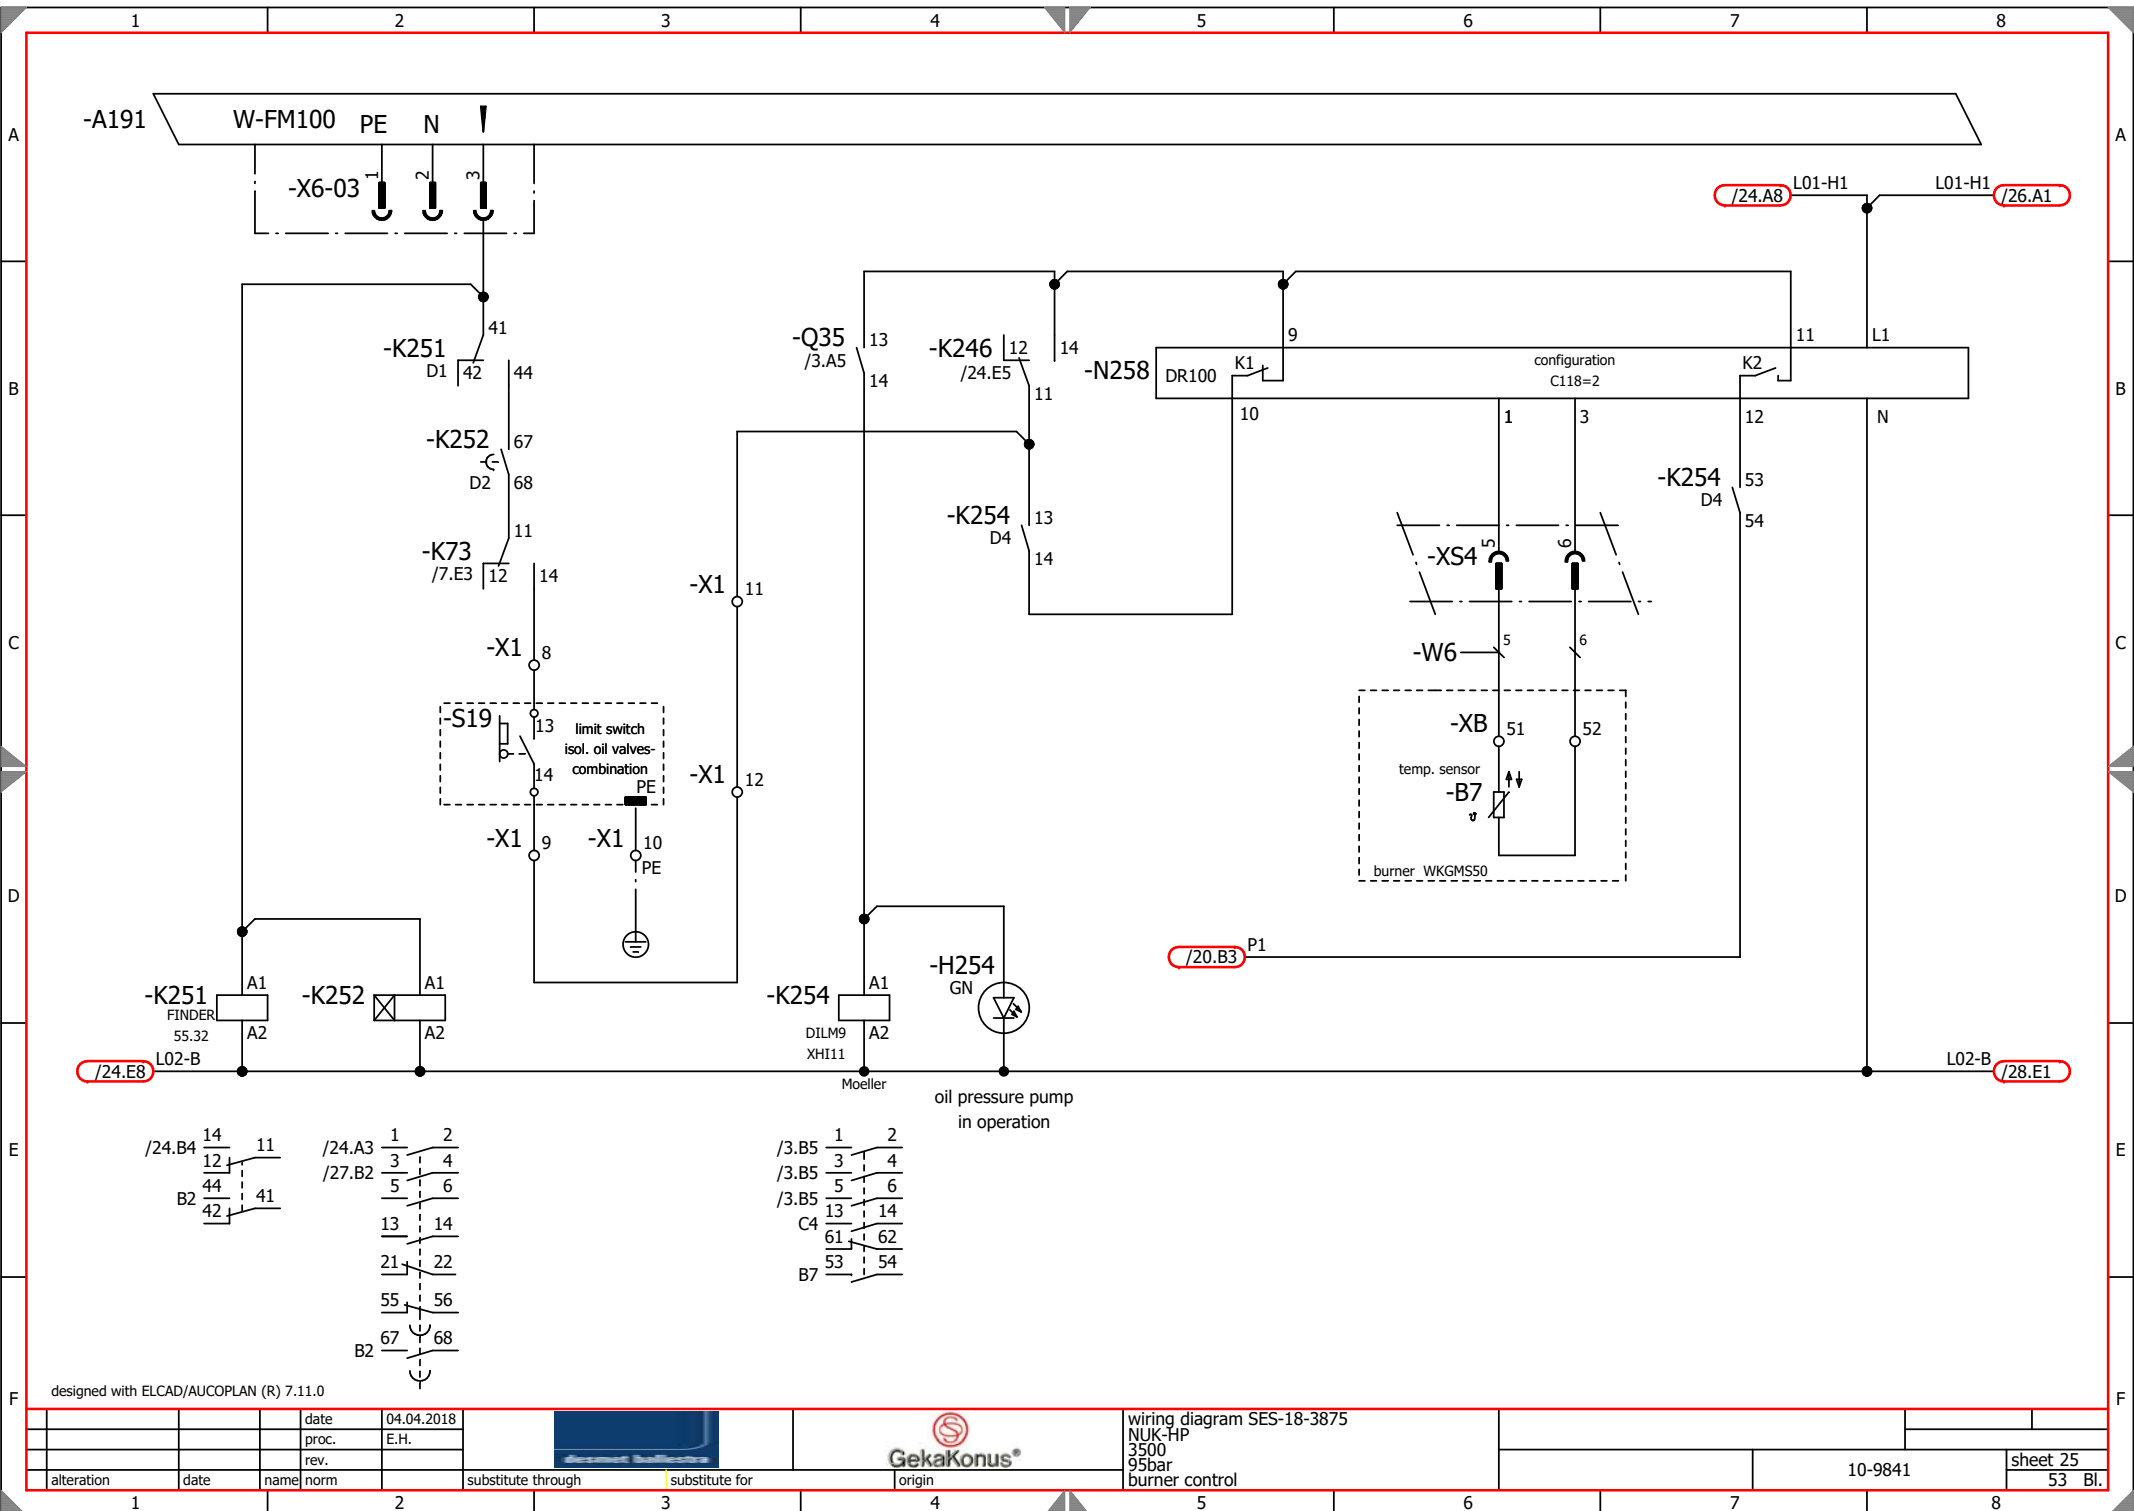

designed with ELCAD/AUCOPLAN (R) 7.11.0

alteration		date	name	norm	substitute through	substitute for	origin	wiring diagram SES-18-3875 NUK-HP 3500 95bar burner control		10-9841		sheet 25
												53 Bl.

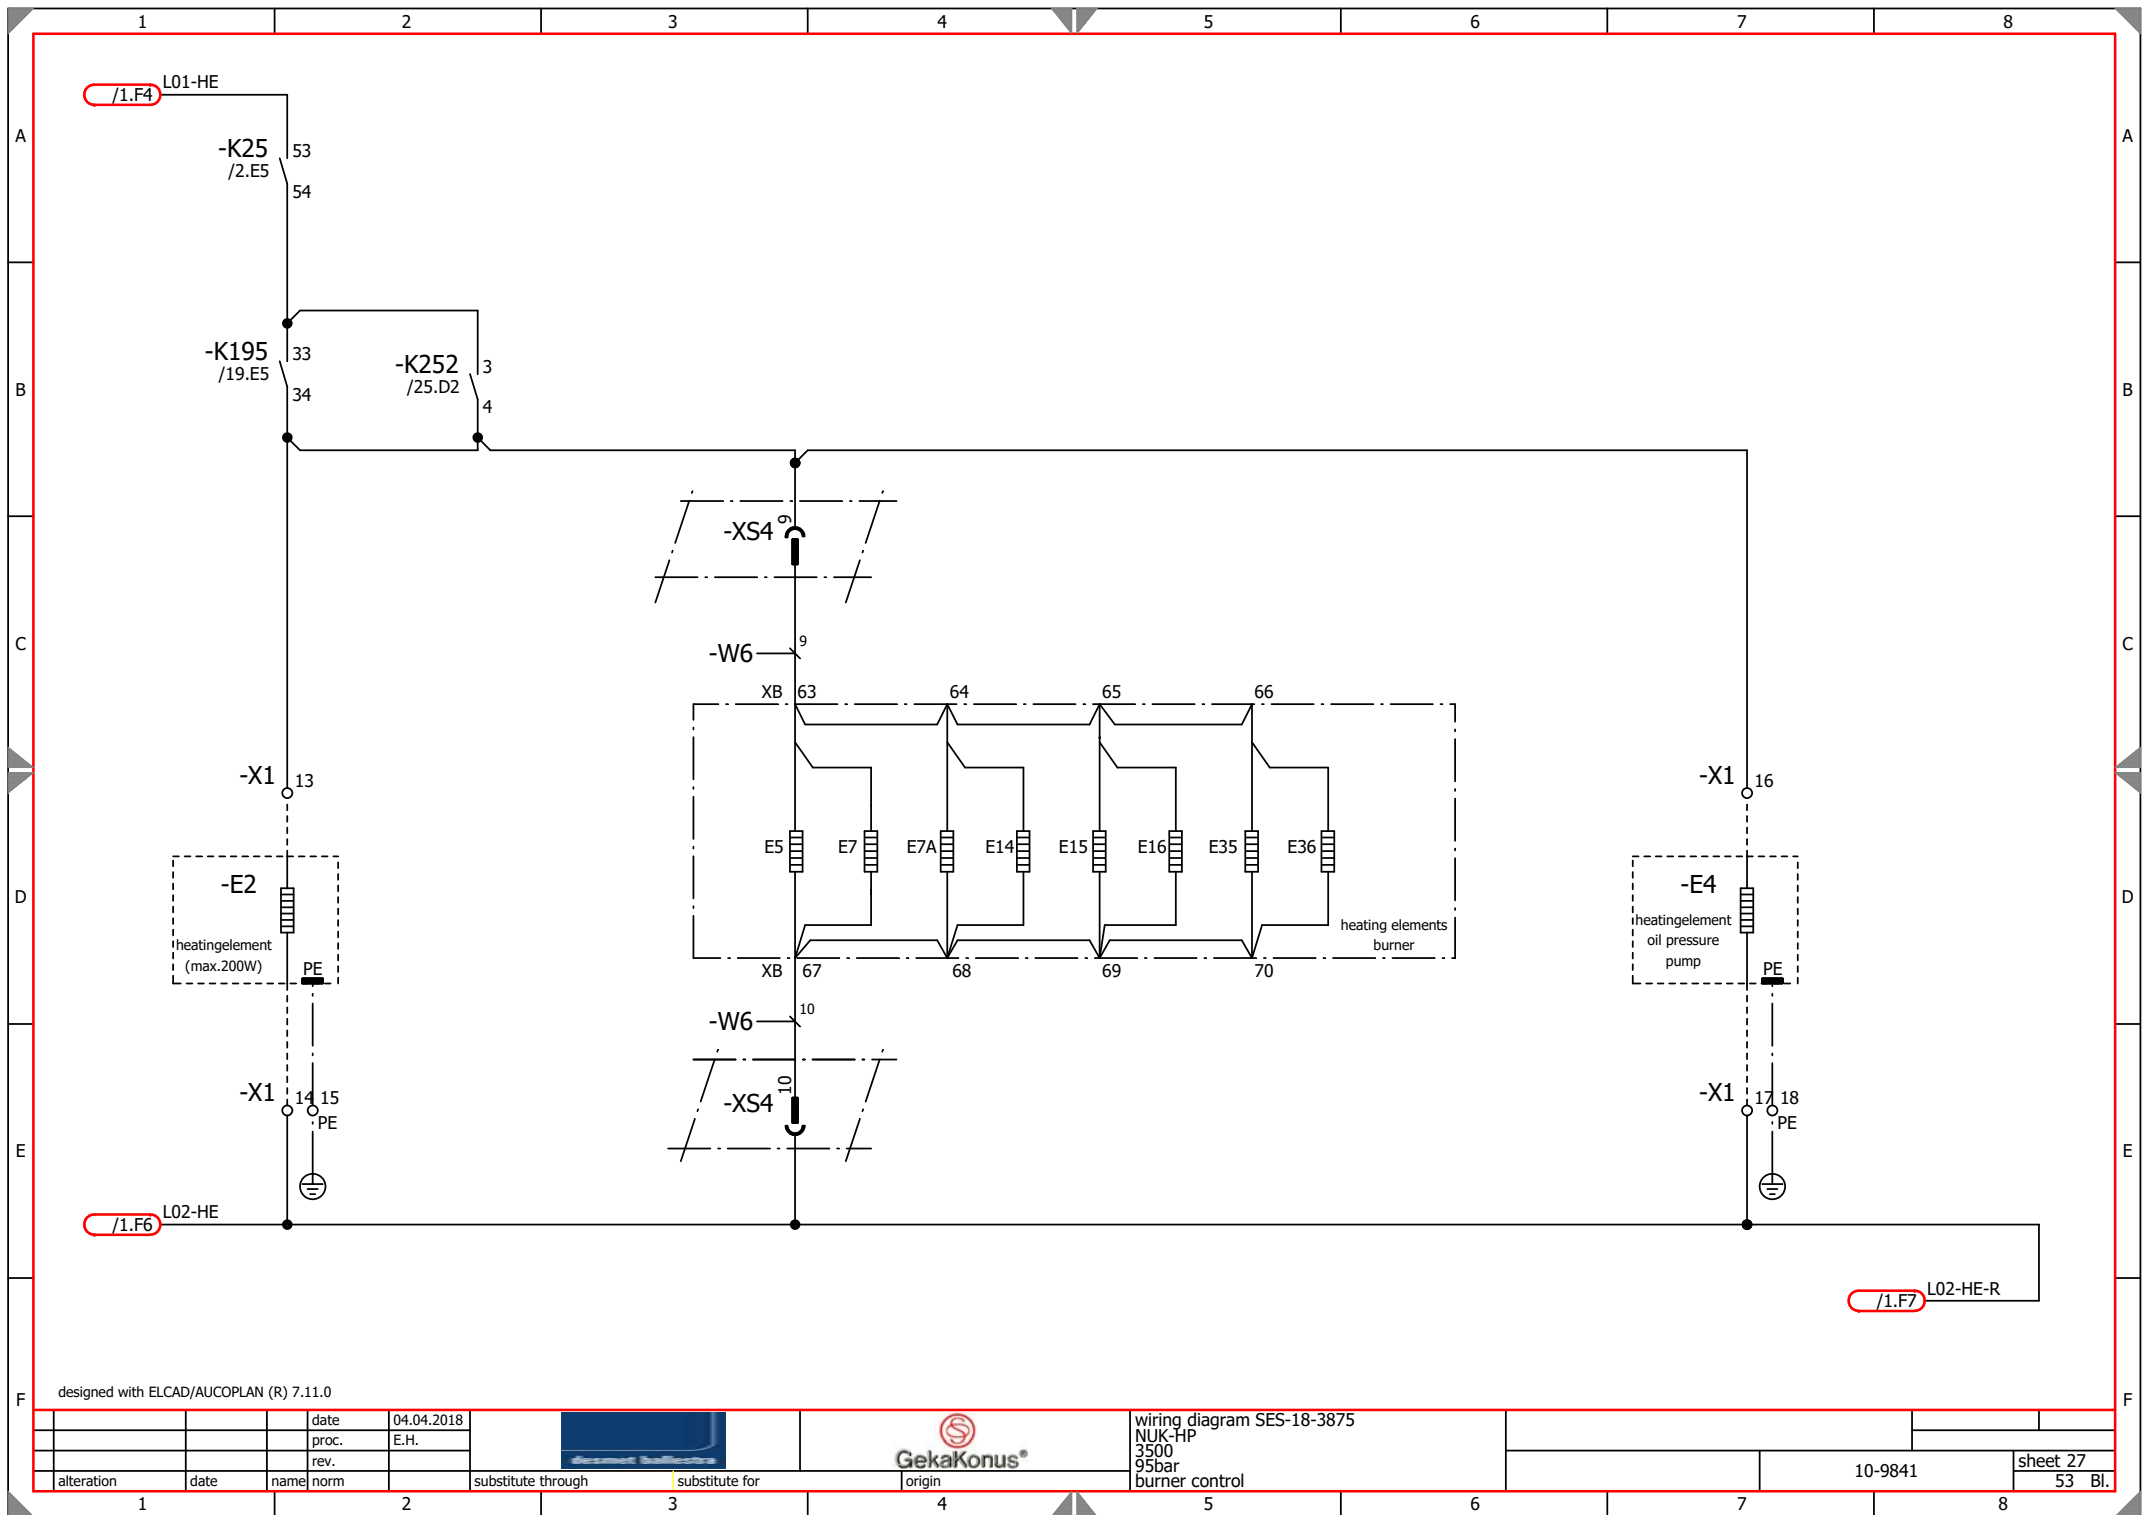

designed with ELCAD/AUCOPLAN (R) 7.11.0

			date	04.04.2018
			proc.	E.H.
			rev.	
alteration	date	name	norm	substitute through


			substitute for
--	--	--	----------------


GekaKonus®

wiring diagram SES-18-3875
NUK-HP
3500
95bar
burner control

10-9841

sheet 27
53 Bl.

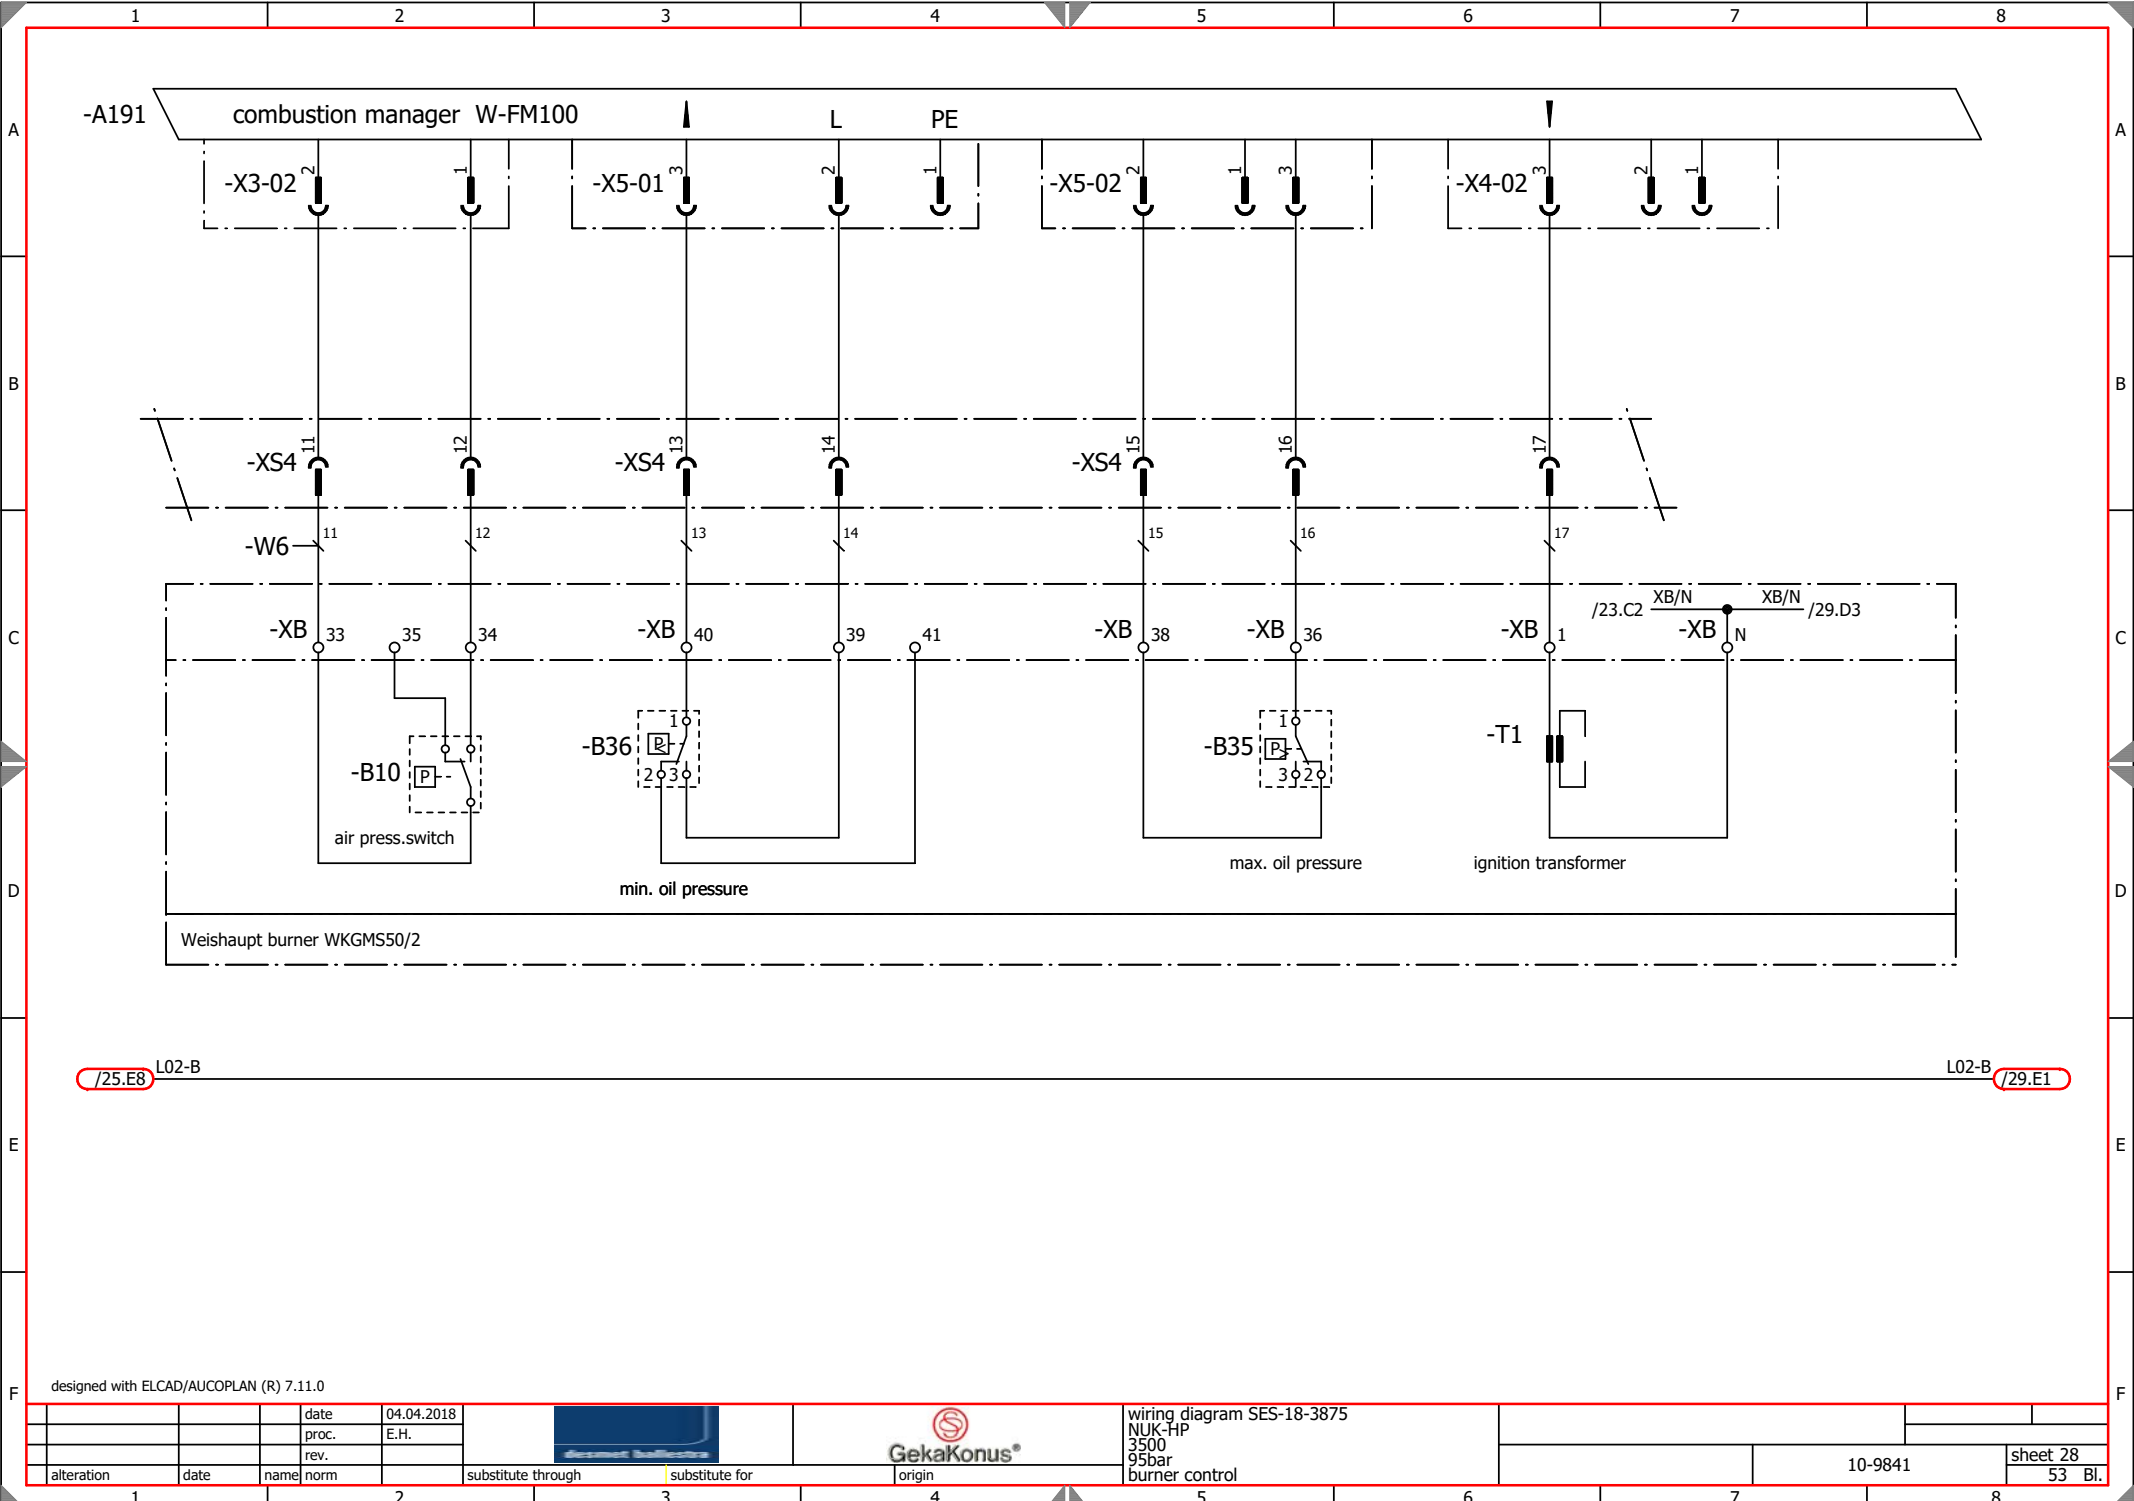

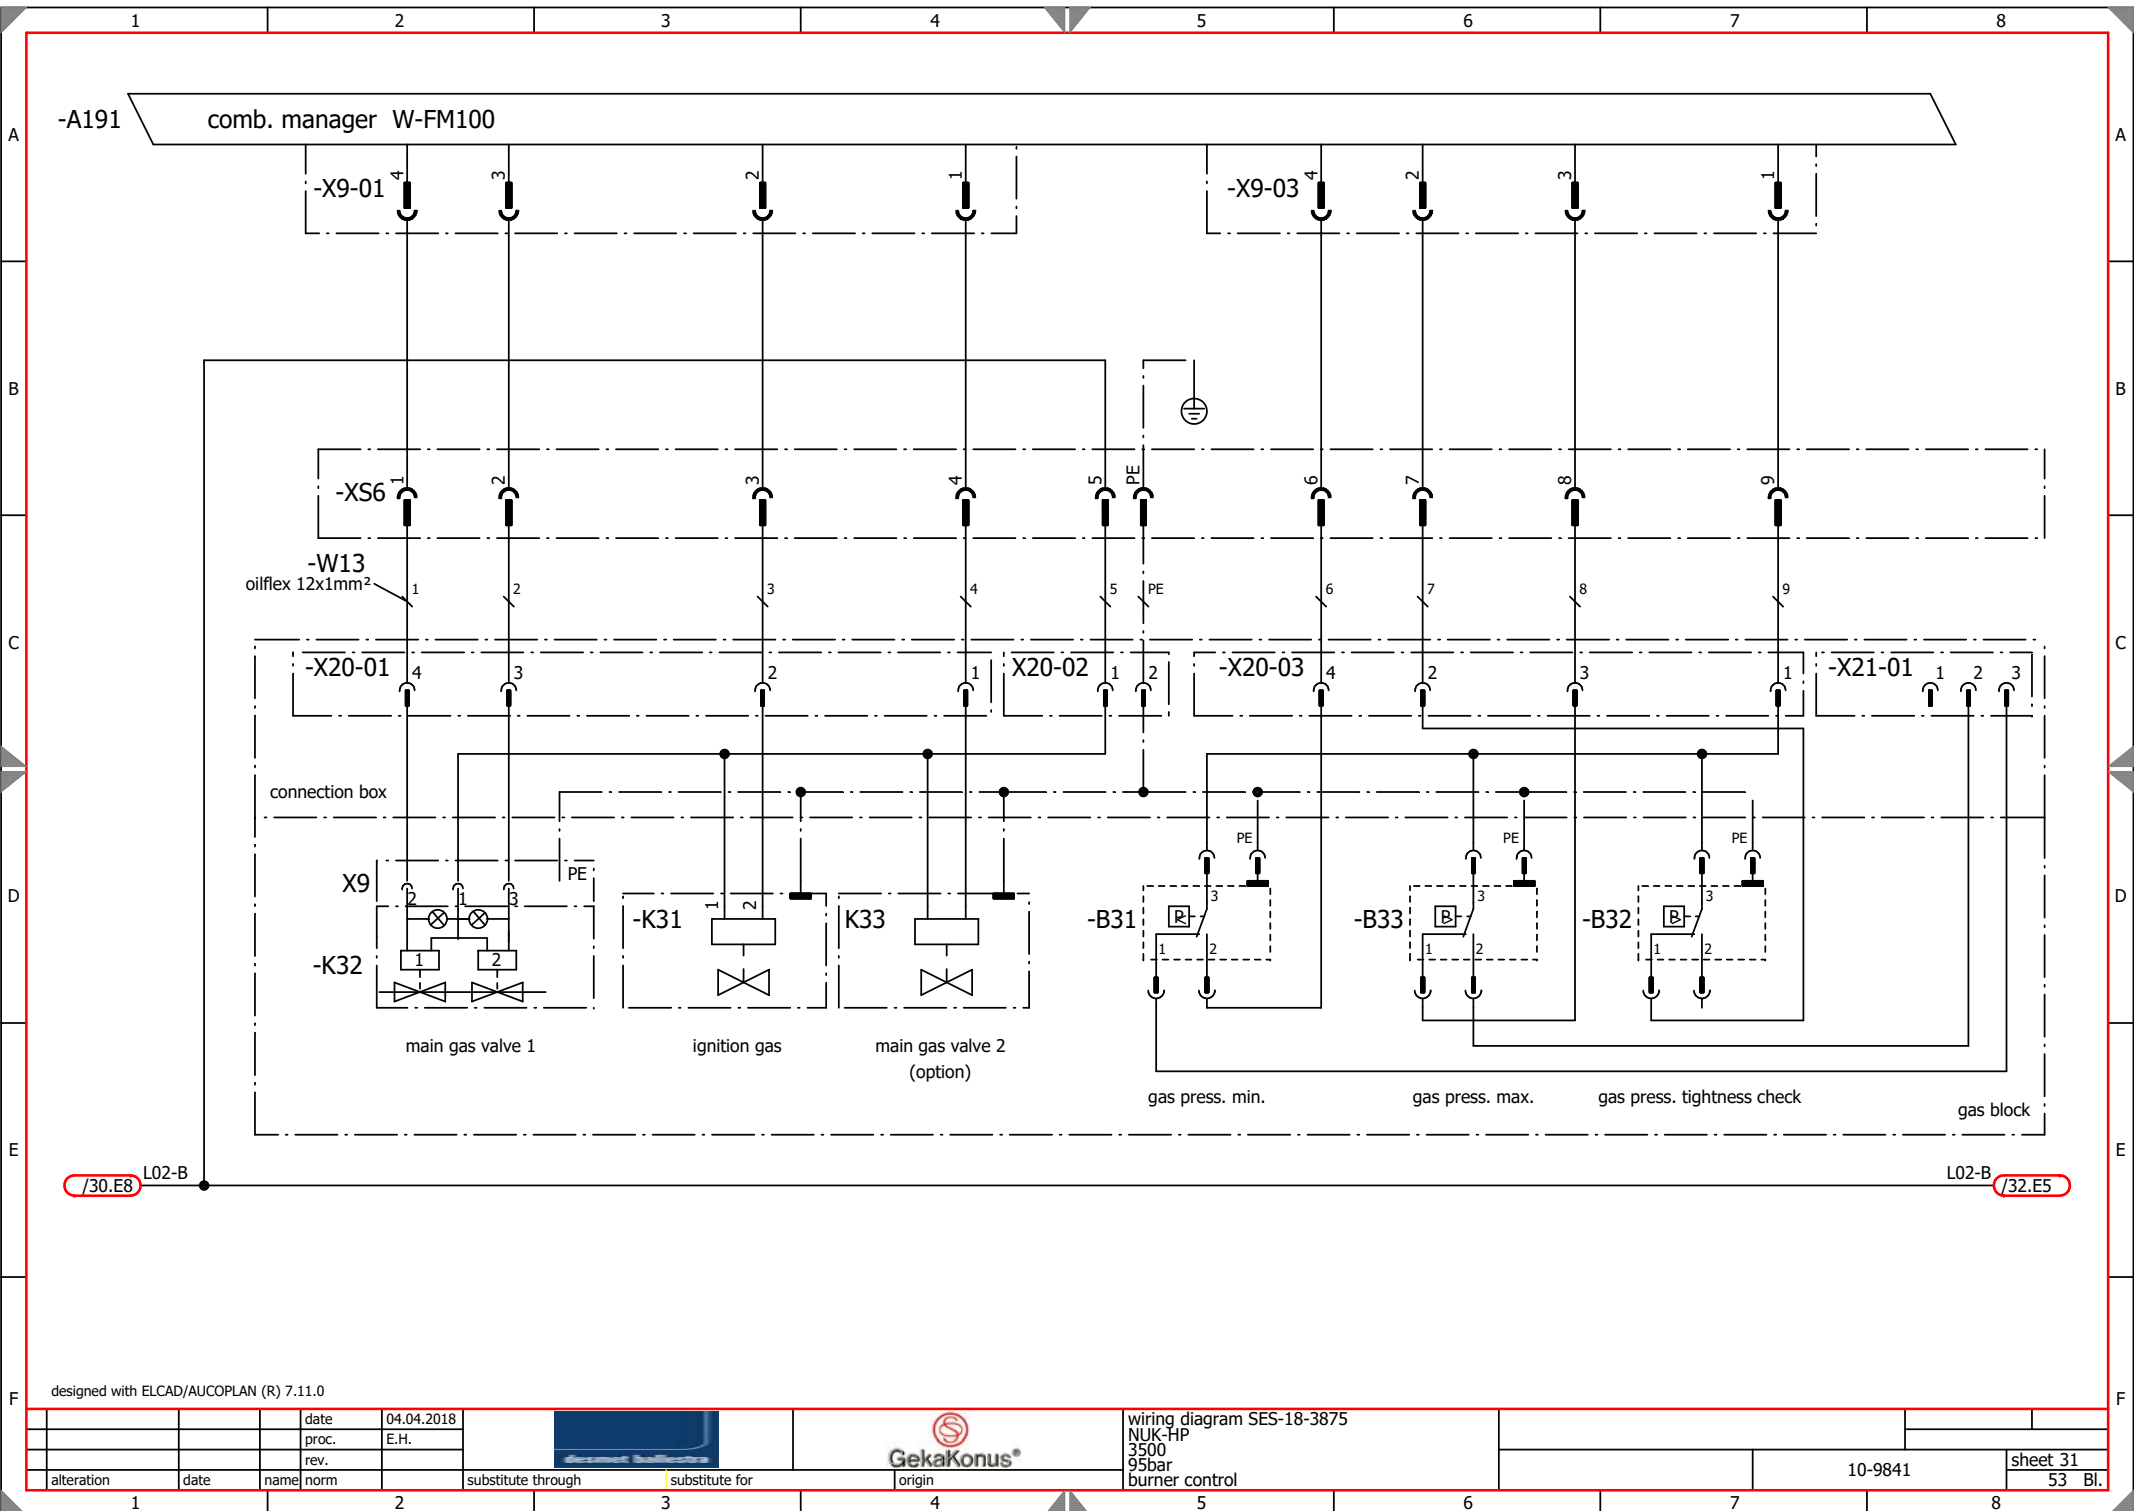

/30.E8 L02-B

L02-B /32.E5

designed with ELCAD/AUCOPLAN (R) 7.11.0

			date	04.04.2018
			proc.	E.H.
			rev.	
alteration	date	name	norm	substitute through


substitute for





wiring diagram SES-18-3875
NUK-HP
3500
95bar
burner control

10-9841

sheet 31
53 Bl.

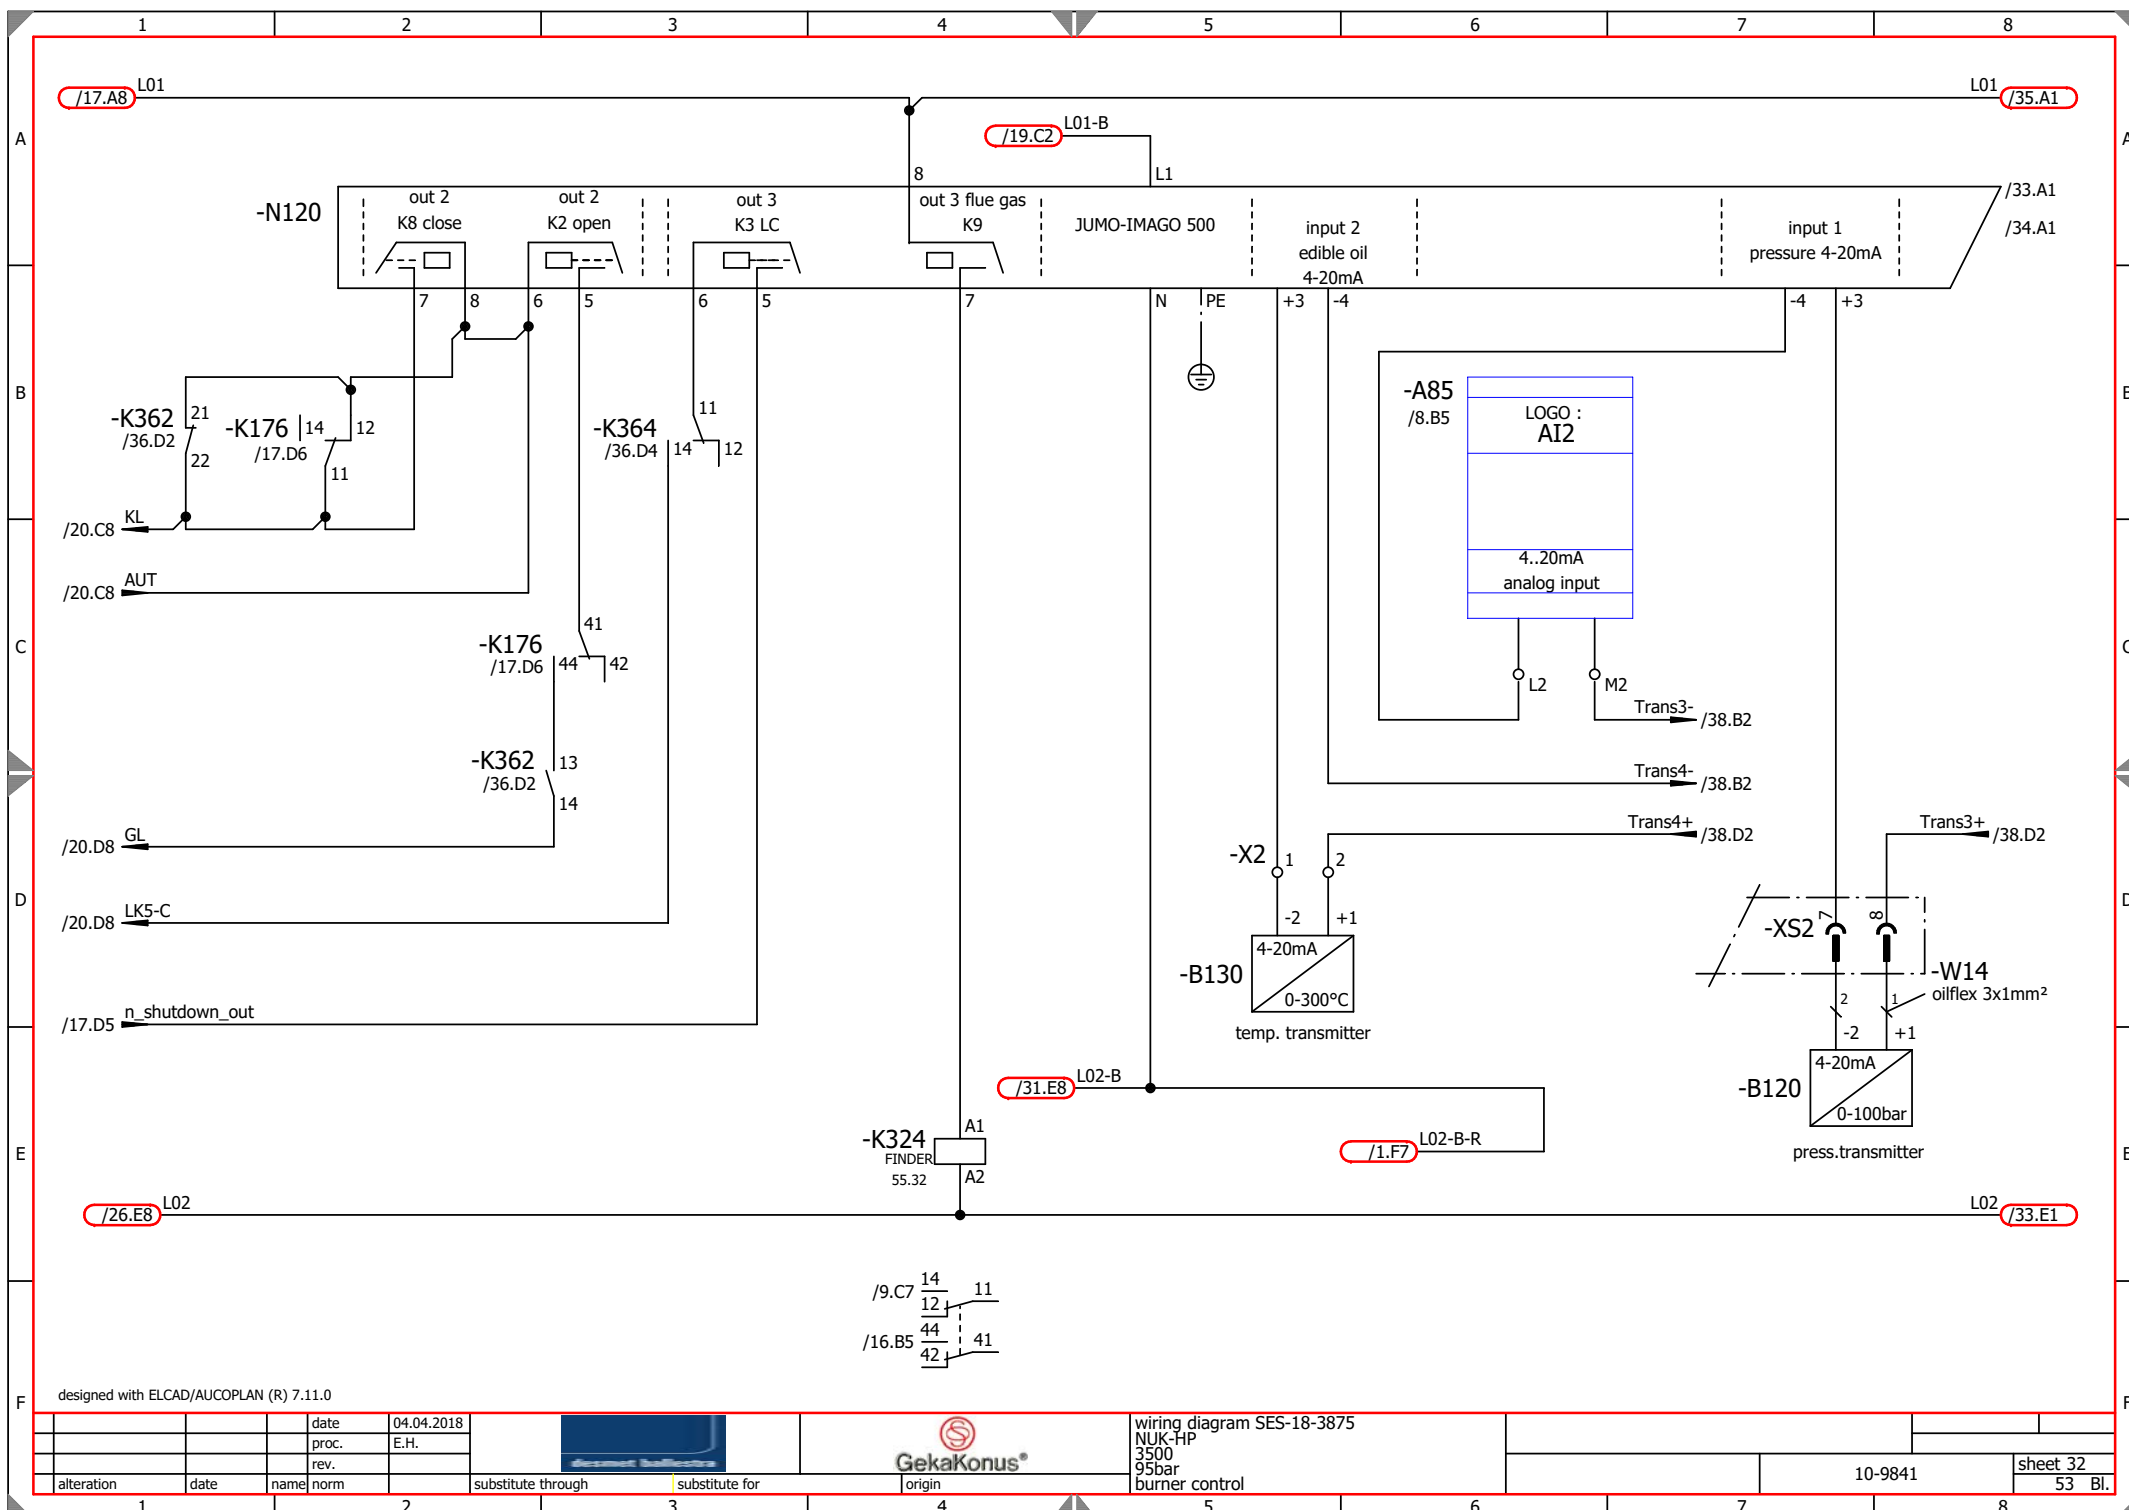

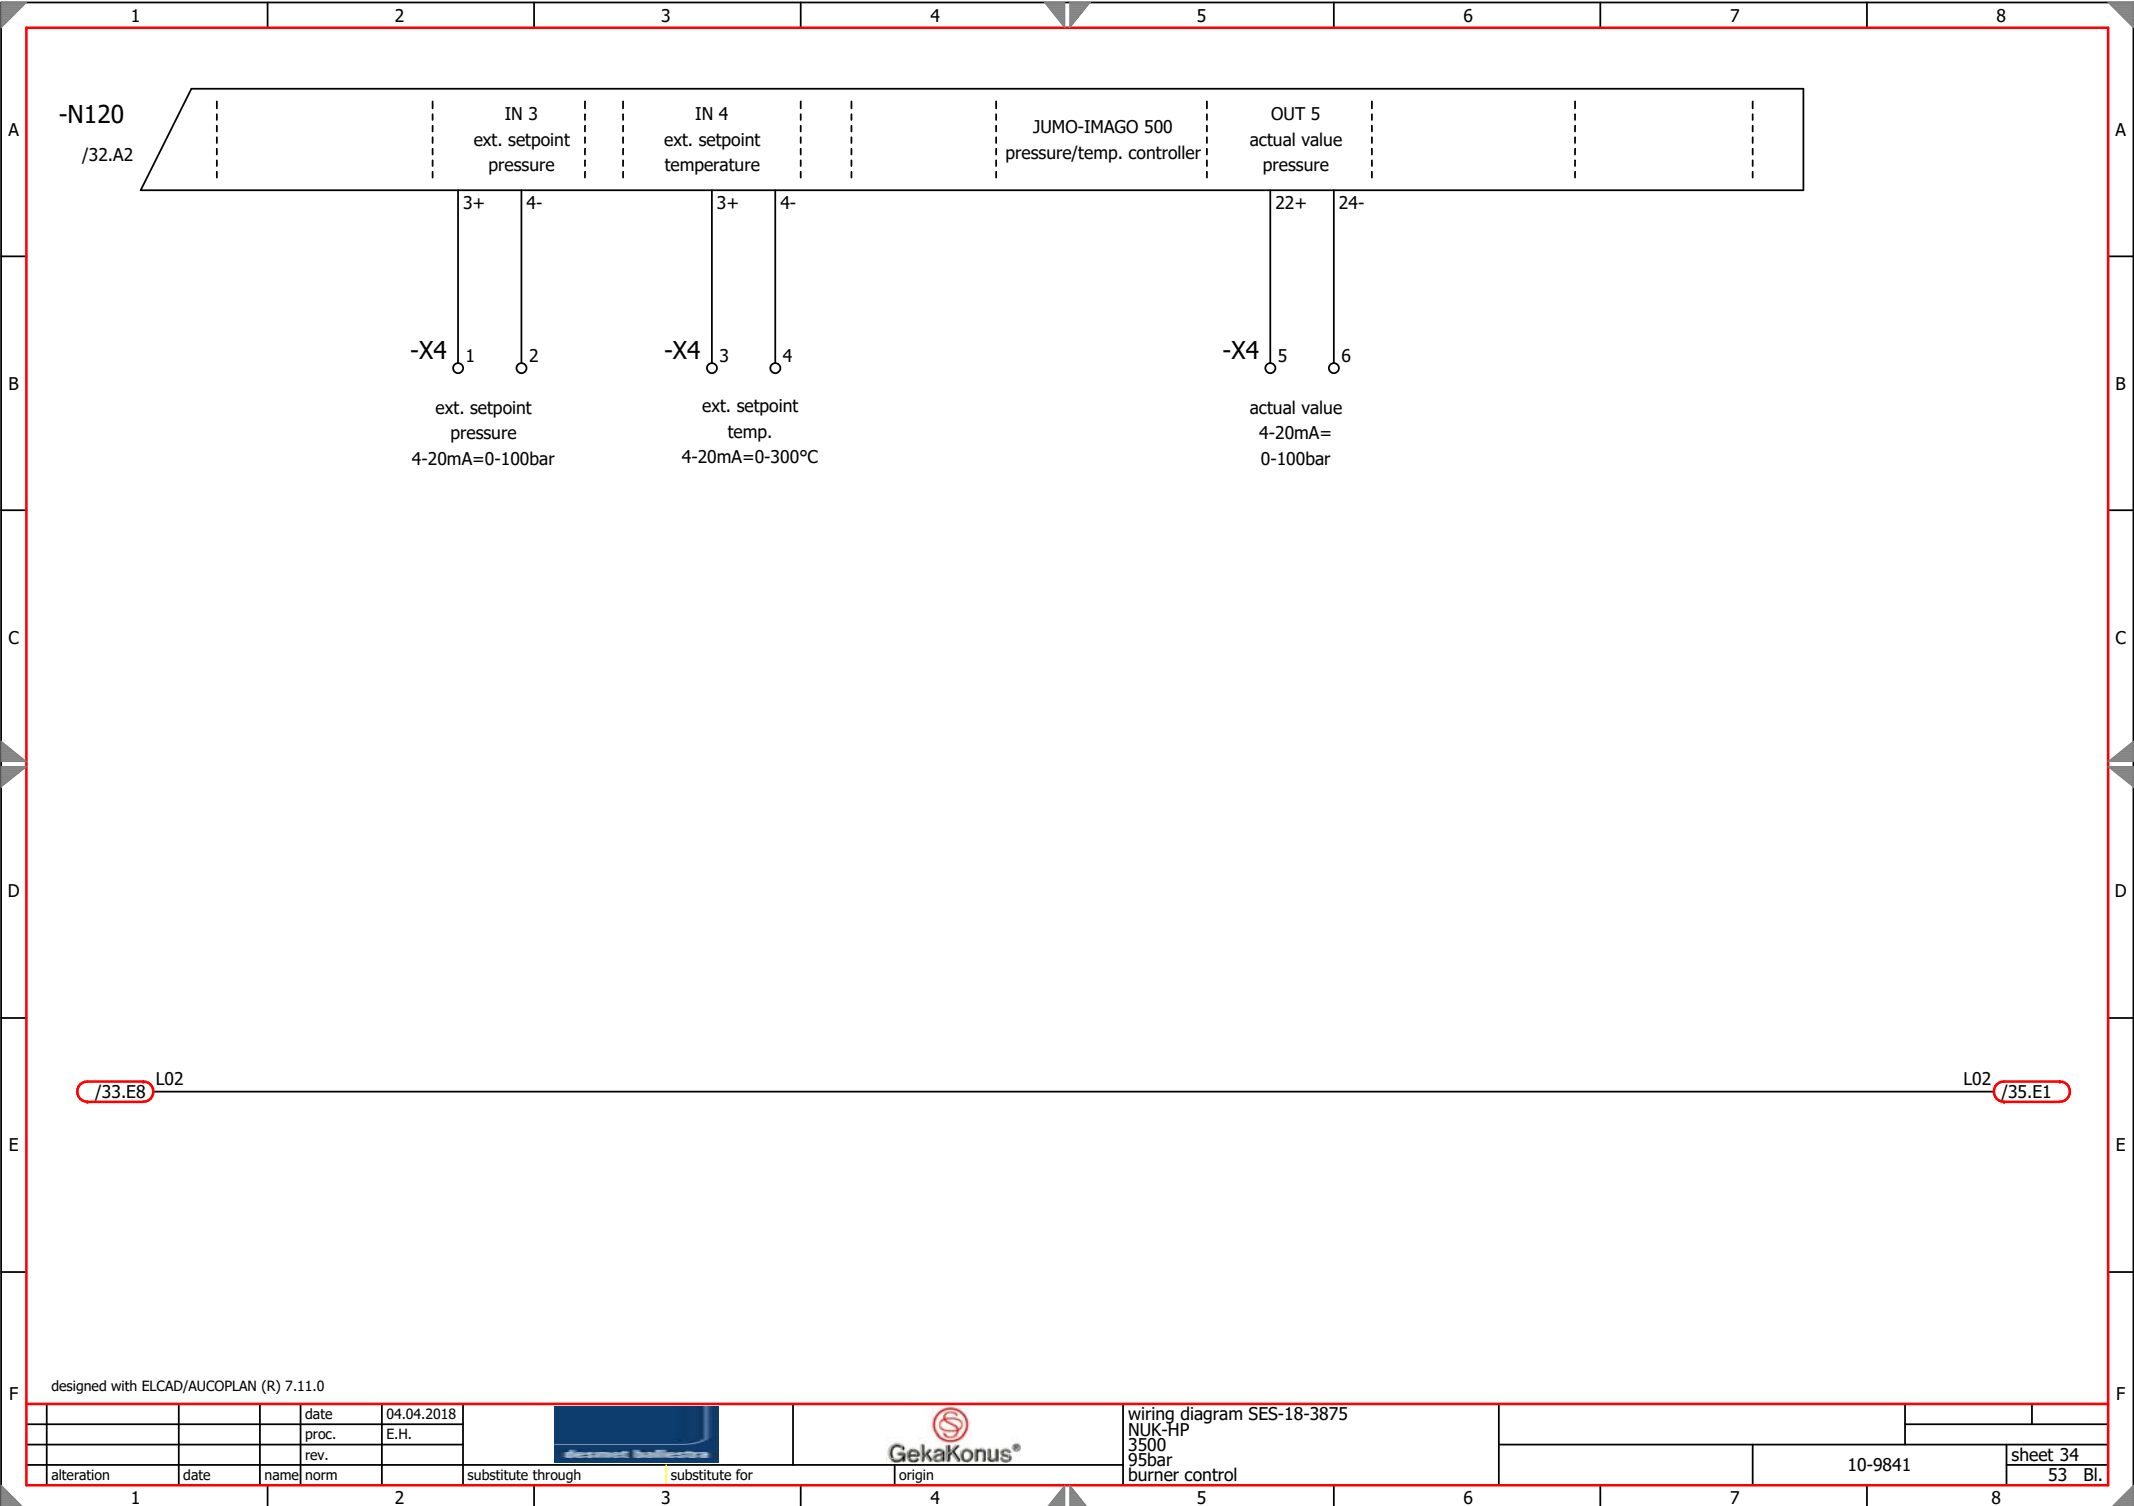

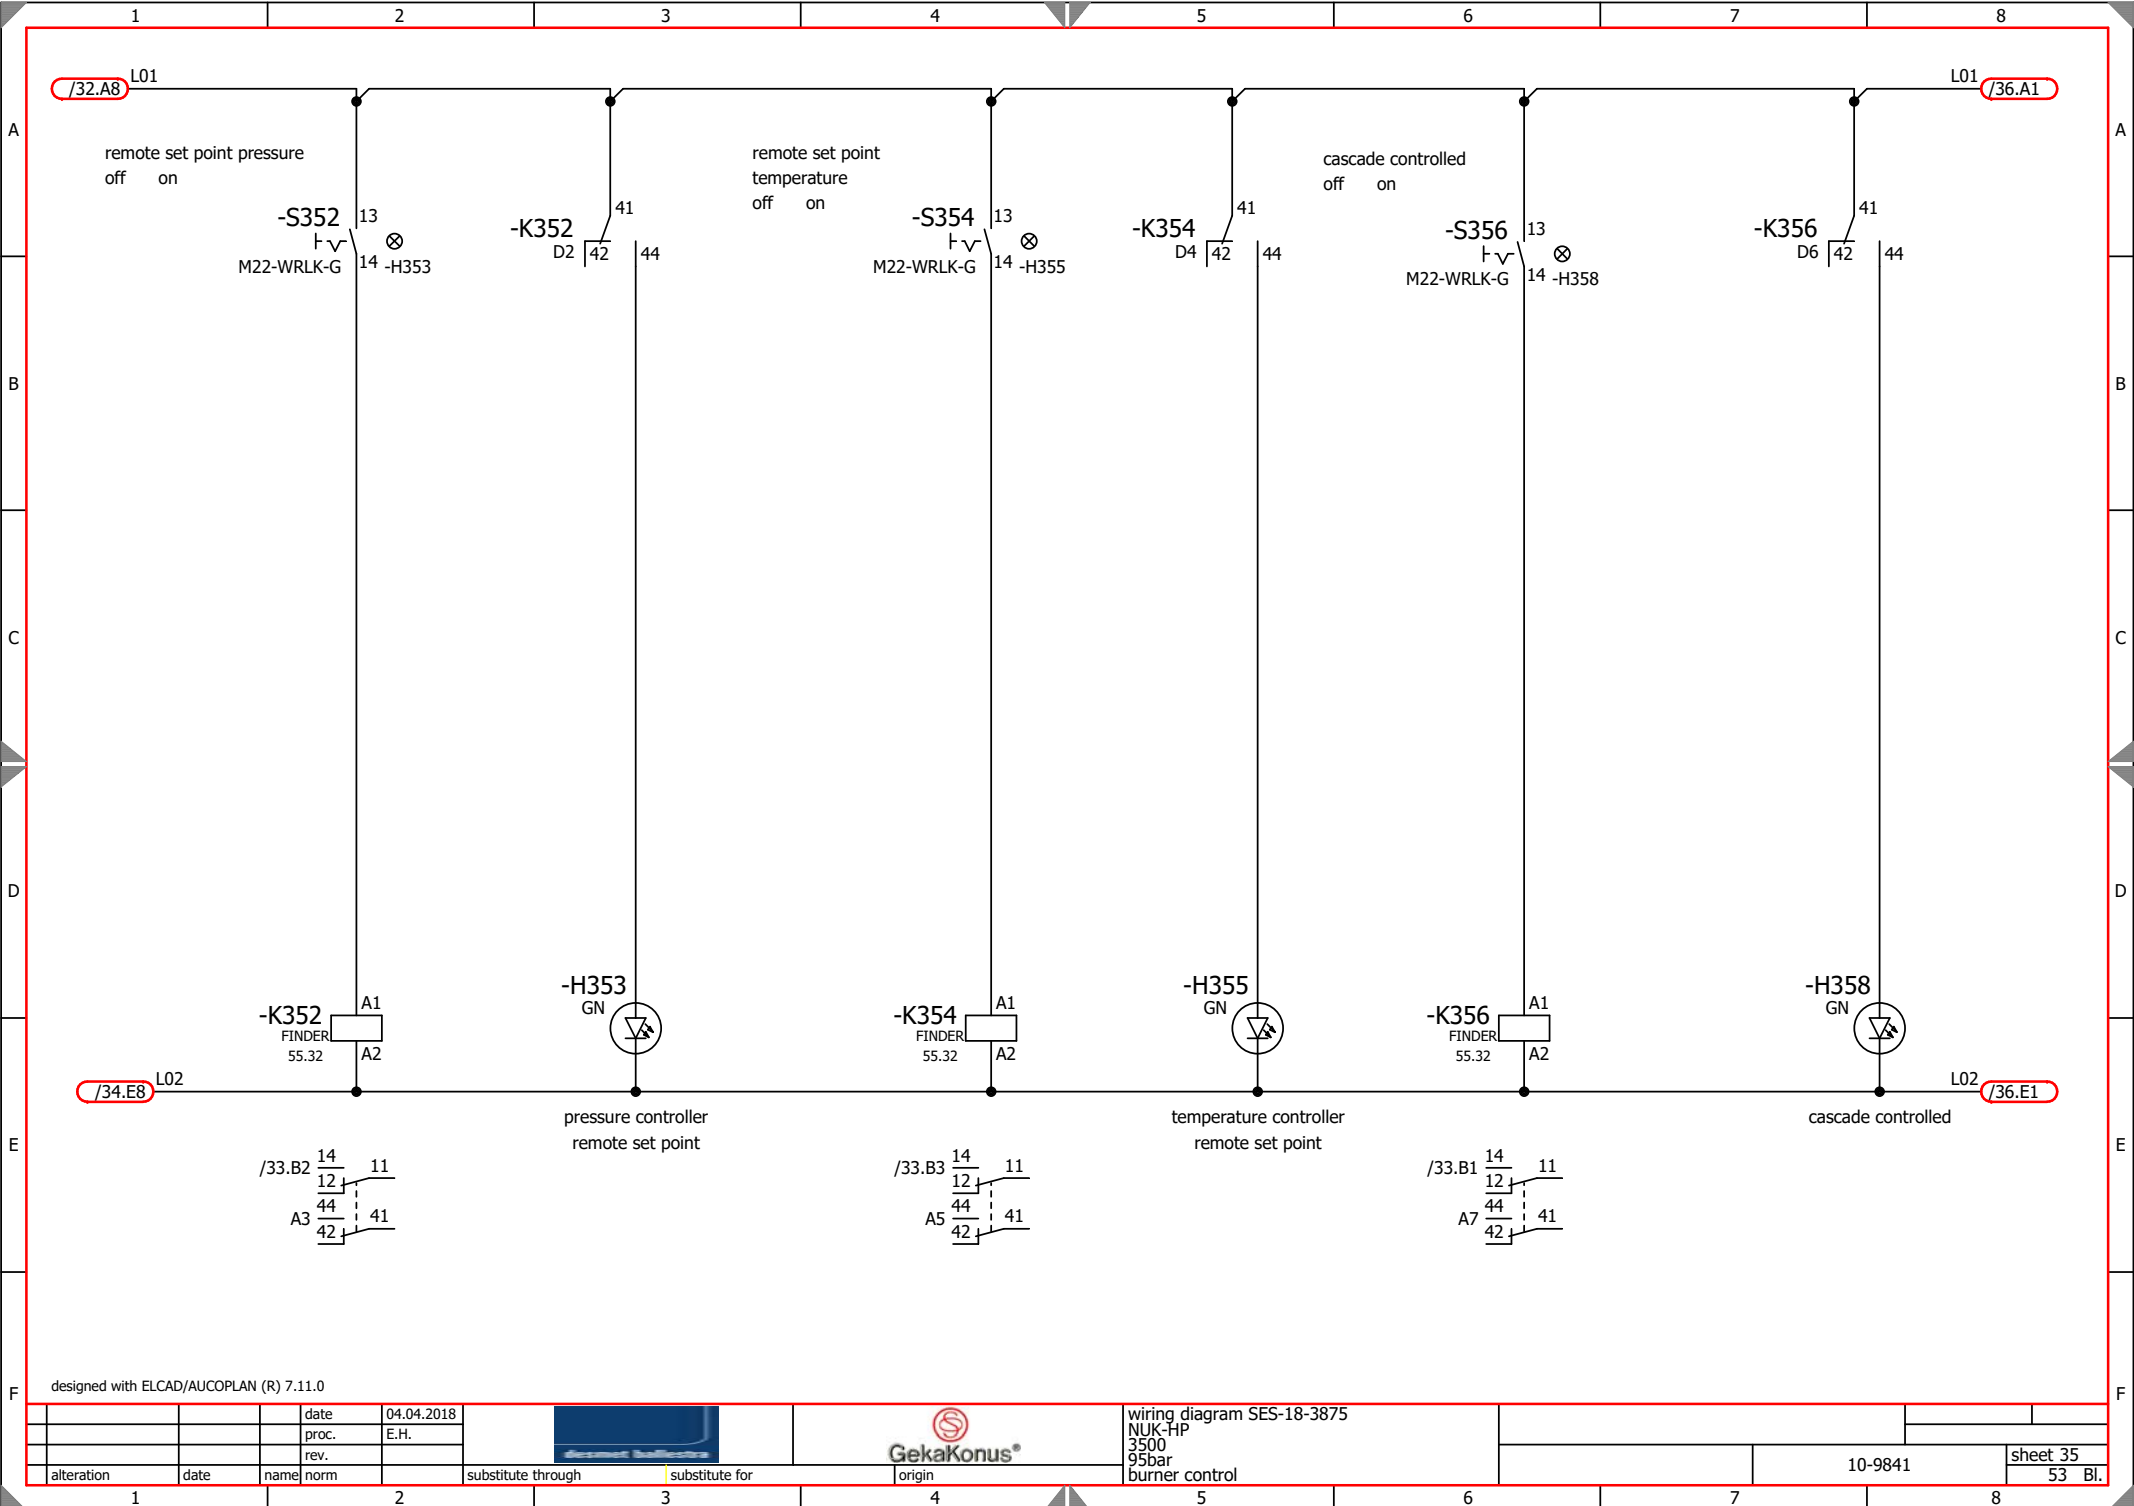


designed with ELCAD/AUCOPLAN (R) 7.11.0



wiring diagram SES-18-3875
NUK-HP
3500
95bar
burner control

10-9841

sheet 35
53 Bl.

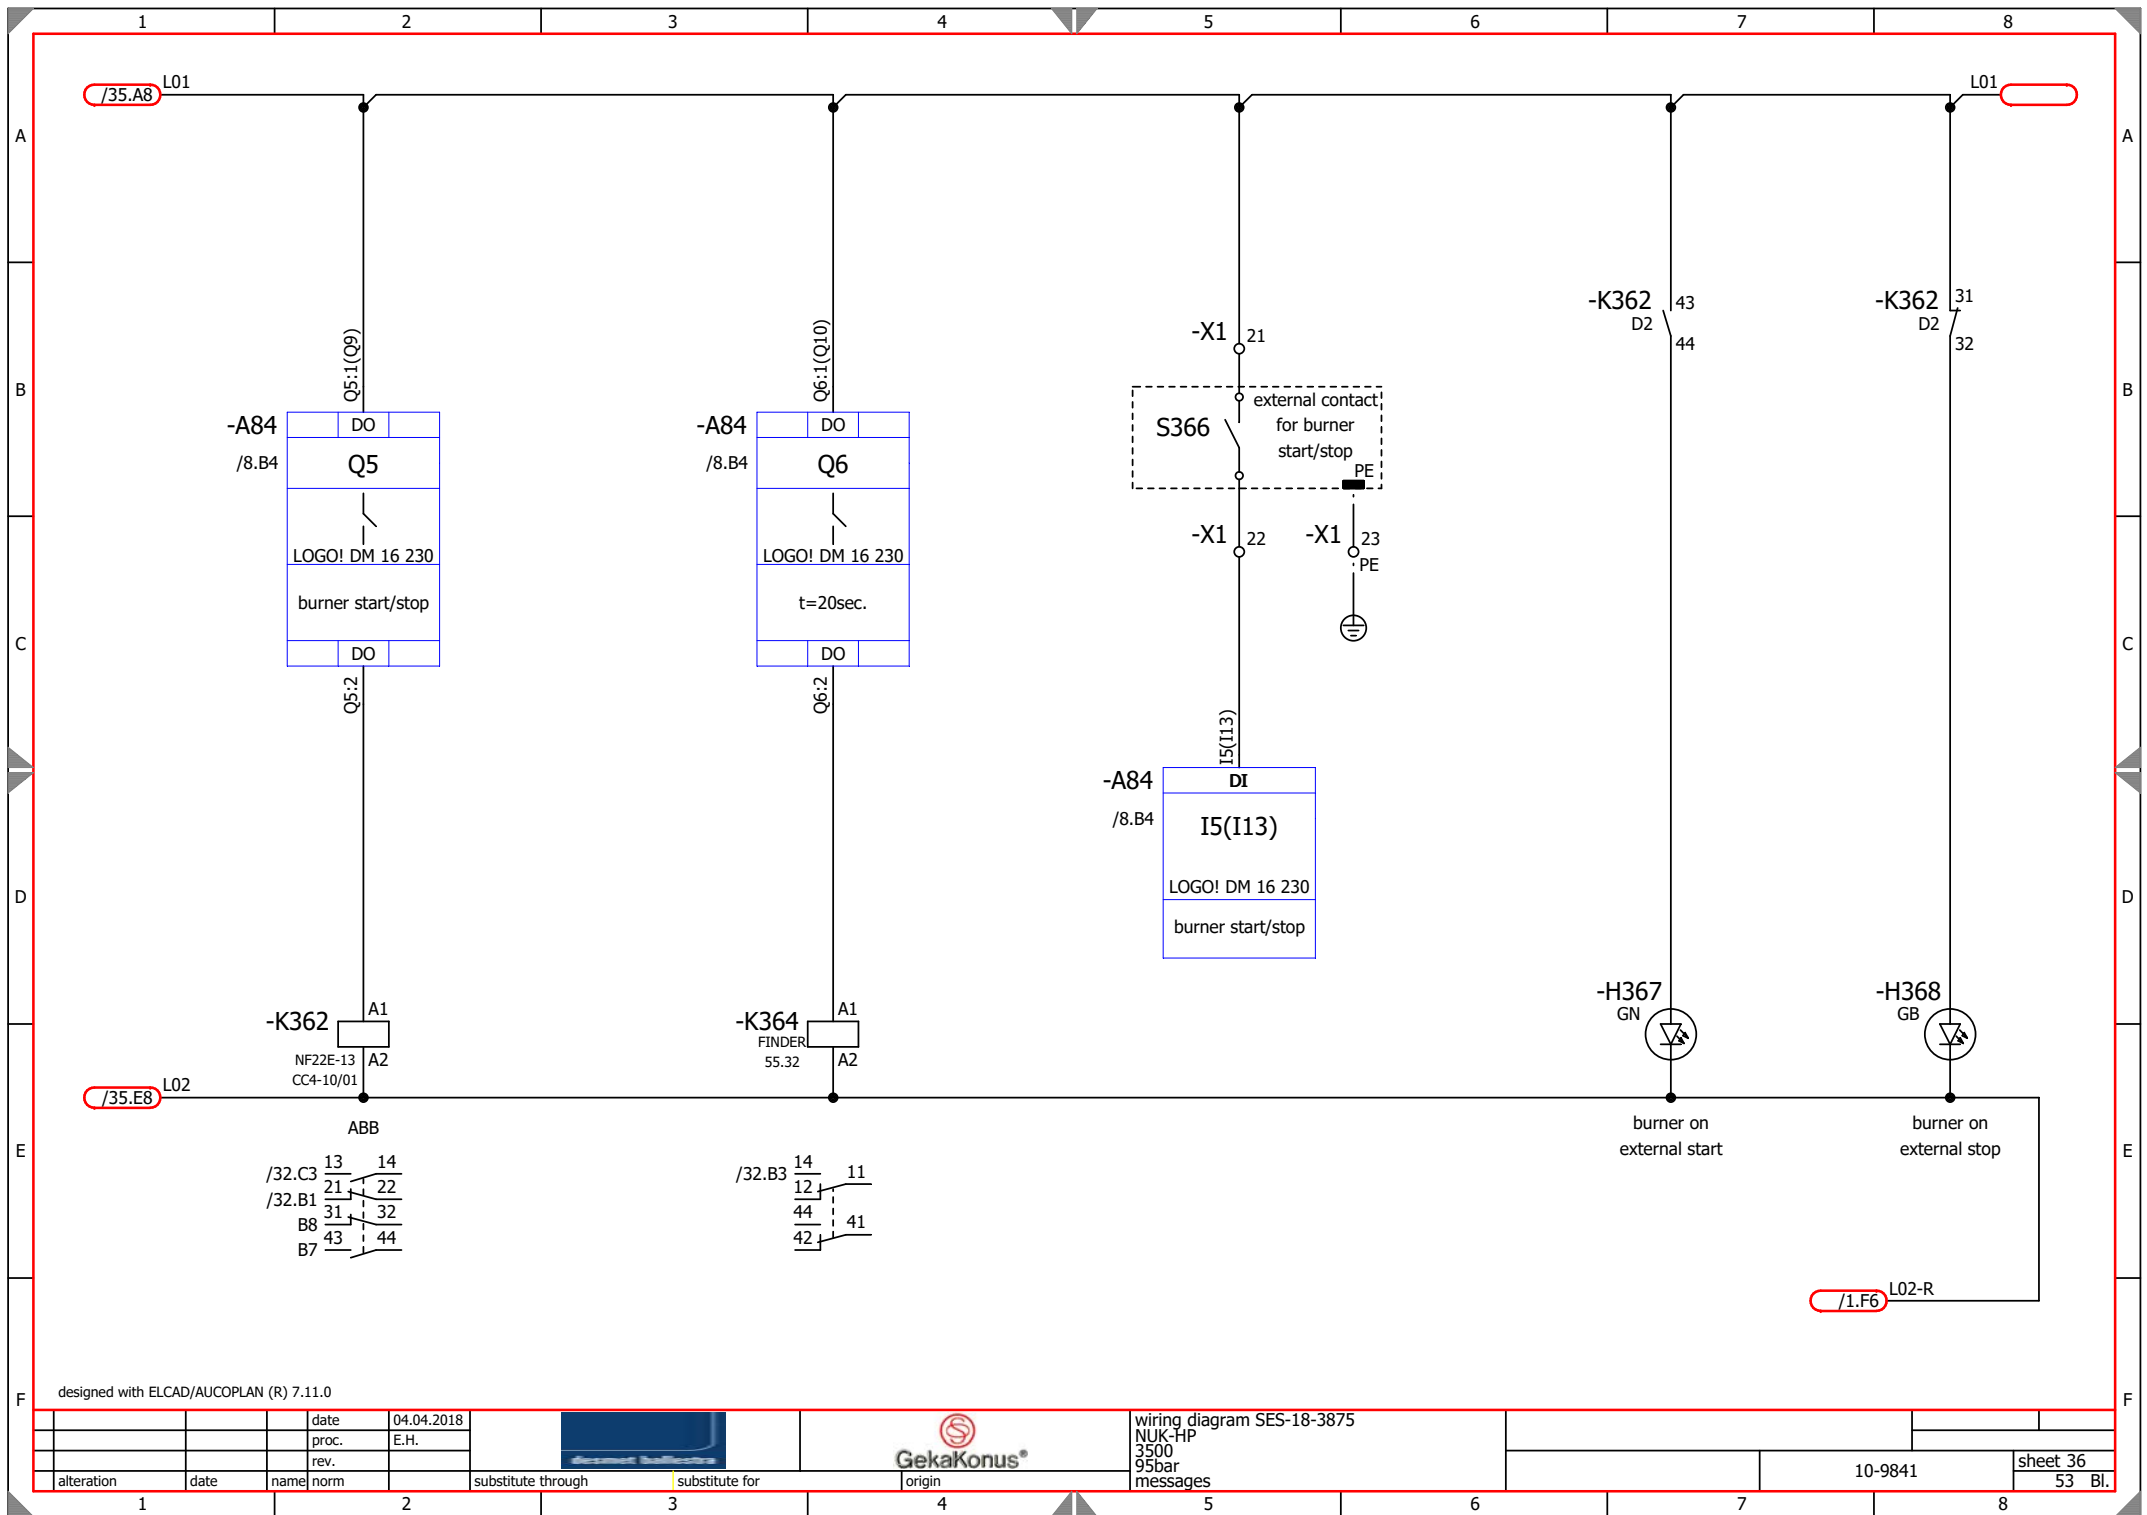

[illegible]

 **GekaKonus®**
oriqin

designed with AUCOTEC-ELCAD (R) 7.11.0

appliance comment	cable mark extern		target mark extern		connection strip					target mark intern		cable mark intern		appliance comment	
					terminal number	type	fish joint	wire connection	terminal comment	representation placet					
					</										

designed with AUCOTEC-ELCAD (R) 7.11.0

appliance comment	cable mark extern		target mark extern		connection strip					target mark intern		cable mark intern					appliance comment	
					terminal number	type	fish joint	wire connection	terminal comment	representation placet								
	-W4	oilflex 7x6 mm²																
	-W7	oilflex 3x1 mm²																
	-W8	oilflex 4x0,75 mm²																
	-W9	oilflex 4x0,75 mm²																
	-W10	oilflex 3x1 mm²																
	-W14	oilflex 3x1 mm²																
	-W15	oilflex 2x1 mm²																

				date	04.04.2018
				proc.	E.H.
				rev..	
alteration	date	name	norm		

substitute through	substitute for
--------------------	----------------



origin

wiring diagram SES-18-3875
NUK-HP
3500
95bar
-XS4,-XS5,-XS6

10-9841

appliance comment	cable mark extern			target mark extern		connection strip					target mark intern		cable mark intern					appliance comment		
						terminal number	type	fish joint	wire connection	terminal comment	representation placet	appliance mark	connection mark							
burner											strip terminal : -XS4 totality : 22									
	flame sensor											strip terminal : -XS5 totality : 4								
gas terminal box											strip terminal : -XS6 totality : 10									

 **GekaKonus®**
origin