


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz Lamp Flux:2076.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 76.89 lm/W			
MODEL		I _{max} (cd)	9176	S/MH(C0/180)	0.45
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.34
RATED VOLTAGE(V)		TOTAL FLUX(lm)	2076.0	η UP,DN(C0-180)	0.1,56.7
NOMINAL FLUX(lm)	2076.04	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,43.1
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.00
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.30

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

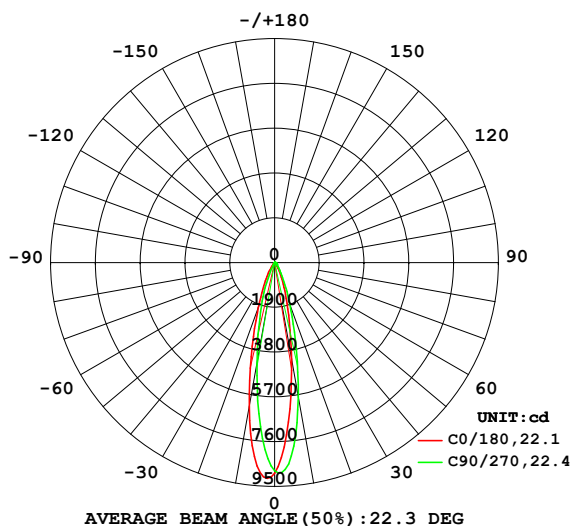

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

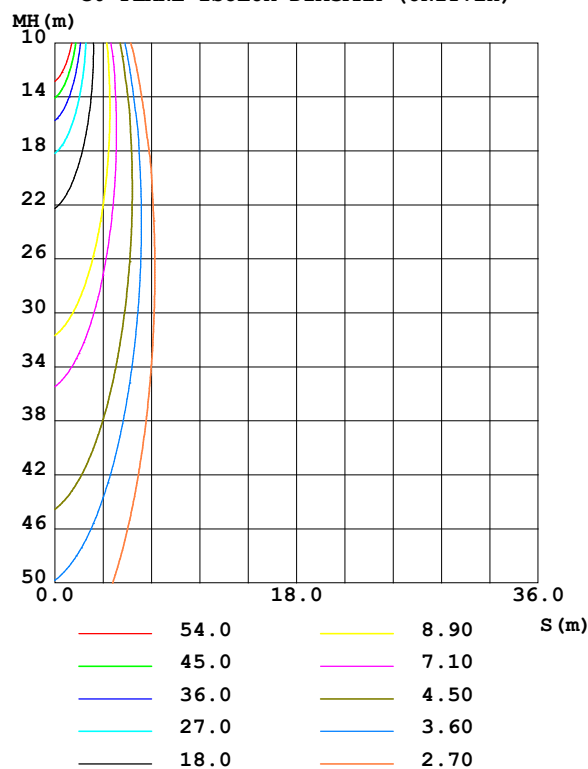

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3 °C
Operators: Allen
Test Date: 2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	4156	4444	5788	6539	6228	5667	4356	3767	0- 10	645.3	645.3	31.1,31.1
20	1278	1305	1916	2067	2029	1736	1342	1062	10- 20	821.2	1466	70.6,70.6
30	381.1	374.9	594.6	575.8	618.2	235.8	119.1	124.0	20- 30	377.8	1844	88.8,88.8
40	89.14	157.4	226.1	202.7	128.5	40.74	16.13	26.72	30- 40	129.8	1974	95.1,95.1
50	27.90	81.27	107.8	99.47	39.75	2.027	0	0.4881	40- 50	55.17	2029	97.7,97.7
60	3.262	34.28	58.49	46.95	6.970	0.2000	0	0.1183	50- 60	27.06	2056	99,99
70	0.9115	7.737	27.31	13.95	1.132	0	0	0	60- 70	11.91	2068	99.6,99.6
80	0.3065	1.422	4.093	2.070	0.5674	0	0	0	70- 80	3.257	2071	99.8,99.8
90	0	0.8405	1.491	1.139	0	0	0	0	80- 90	0.6961	2072	99.8,99.8
100	0	0.2650	0.8458	0.4840	0	0	0	0	90-100	0.3445	2073	99.8,99.8
110	0	0	0.2543	0	0	0	0	0	100-110	0.1118	2073	99.8,99.8
120	0	0	0	0	0	0	0	0	110-120	0.0088	2073	99.8,99.8
130	0.0195	0.0001	0	0	0.0002	0.0283	0.1270	0.1492	120-130	0.0053	2073	99.8,99.8
140	0.6684	0.6120	0.3871	0.3293	0.7138	0.8493	1.162	1.337	130-140	0.2374	2073	99.8,99.8
150	1.308	1.371	1.224	1.140	2.383	2.635	3.082	3.281	140-150	0.8827	2074	99.9,99.9
160	1.561	1.654	1.682	1.641	4.134	4.277	4.436	4.427	150-160	1.202	2075	99.9,99.9
170	1.565	1.624	1.642	1.575	4.060	4.077	3.917	3.711	160-170	0.8306	2076	100,100
180	2.486	2.475	2.193	2.019	2.484	2.498	2.250	2.103	170-180	0.2435	2076	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 2006.8 lm

%lum = 96.7%

%lamp = 96.7%

Conical surface Flux(120deg): 2056.3 lm

%lum = 99.0%


%lamp = 99.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz Lamp Flux:2076.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

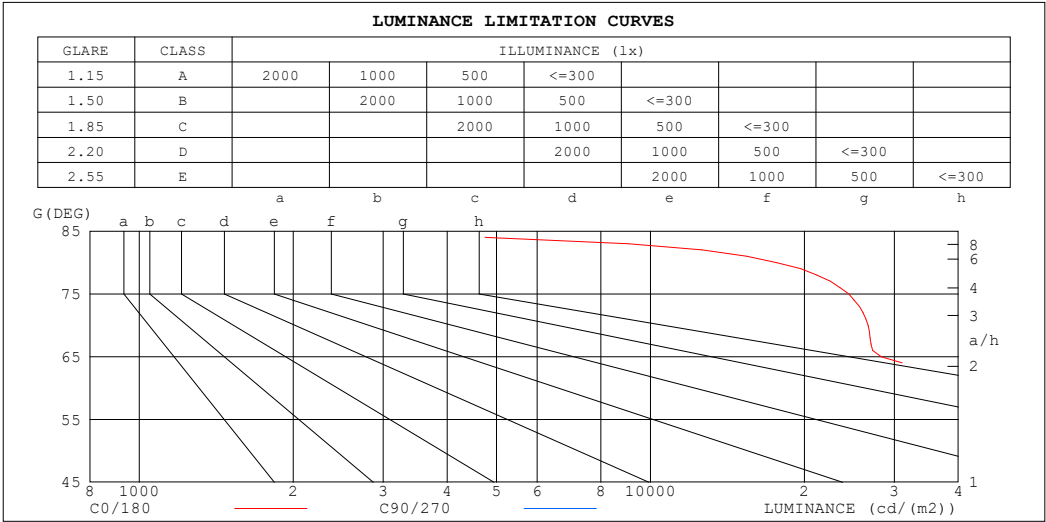

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	158	198796
80	17654	235702
75	24433	491448
70	26651	798404
65	28262	990062
60	65241	1169884
55	201822	1380941
50	434090	1676638
45	706840	2157657


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz		
Lamp Flux:2076.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.10	1.08	1.10	1.08	1.07	1.06	1.05	1.03	1.02	1.01	1.00	.99	.98	.97	.96
2.0	1.06	1.03	1.00	1.05	1.02	.99	1.01	.99	.97	.99	.97	.95	.96	.94	.93	.91
3.0	1.01	.97	.94	.90	.96	.93	.97	.94	.92	.95	.92	.90	.93	.91	.89	.88
4.0	.97	.92	.89	.95	.91	.88	.93	.90	.87	.92	.89	.86	.90	.87	.85	.84
5.0	.92	.88	.85	.92	.87	.84	.90	.86	.83	.88	.85	.83	.87	.84	.82	.81
6.0	.89	.84	.81	.88	.84	.81	.87	.83	.80	.85	.82	.80	.84	.81	.79	.78
7.0	.85	.81	.78	.85	.81	.77	.84	.80	.77	.83	.79	.77	.82	.79	.76	.75
8.0	.82	.78	.75	.82	.78	.75	.81	.77	.74	.80	.77	.74	.79	.76	.74	.73
9.0	.80	.75	.72	.79	.75	.72	.78	.75	.72	.78	.74	.72	.77	.74	.71	.70
10.0	.77	.73	.70	.77	.73	.70	.76	.72	.70	.75	.72	.69	.75	.72	.69	.68

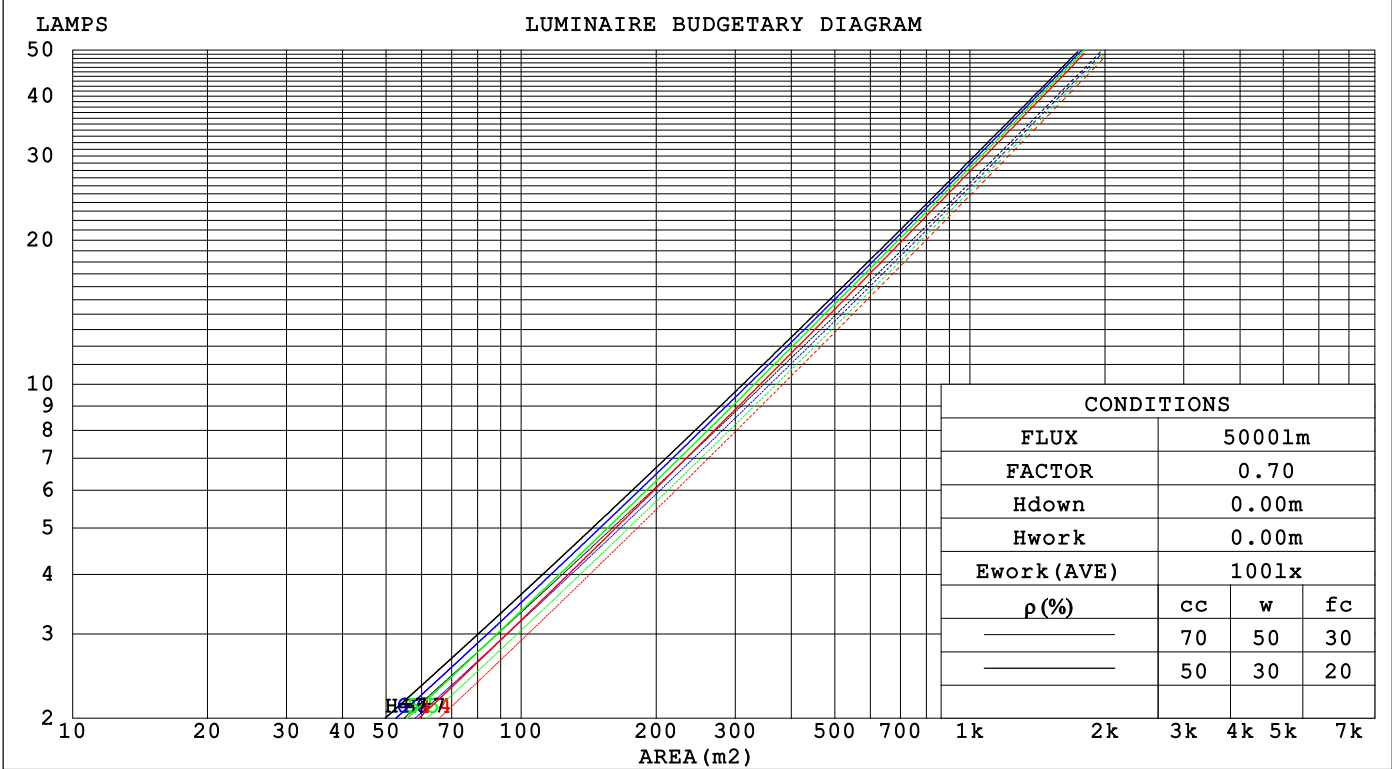

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-19

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz Lamp Flux:2076.04x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.148	.084	.027	.142	.081	.026	.129	.074	.024	.118	.068	.022	.107	.062	.020															
2.0	.139	.076	.023	.133	.073	.023	.123	.068	.021	.113	.064	.020	.104	.059	.019															
3.0	.130	.069	.021	.126	.067	.020	.117	.063	.019	.109	.060	.018	.101	.056	.017															
4.0	.122	.064	.019	.118	.062	.018	.111	.059	.018	.104	.056	.017	.098	.053	.016															
5.0	.116	.059	.017	.112	.058	.017	.106	.055	.016	.100	.053	.016	.094	.050	.015															
6.0	.109	.055	.016	.106	.054	.015	.101	.052	.015	.096	.050	.015	.091	.048	.014															
7.0	.104	.051	.015	.101	.050	.014	.097	.049	.014	.092	.047	.014	.088	.046	.013															
8.0	.099	.048	.014	.097	.048	.013	.092	.046	.013	.088	.045	.013	.085	.043	.013															
9.0	.095	.046	.013	.093	.045	.013	.089	.044	.012	.085	.043	.012	.082	.042	.012															
10.0	.090	.043	.012	.089	.043	.012	.085	.042	.012	.082	.041	.012	.079	.040	.011															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.171	.159	.149	.146	.136	.128	.100	.094	.088	.057	.054	.051	.018	.017	.017	
2.0	.153	.134	.118	.131	.115	.102	.090	.080	.071	.052	.046	.042	.017	.015	.014	
3.0	.139	.115	.096	.119	.099	.083	.082	.069	.058	.047	.040	.034	.015	.013	.011	
4.0	.127	.100	.079	.109	.086	.068	.075	.060	.048	.043	.035	.028	.014	.011	.009	
5.0	.117	.087	.066	.100	.076	.057	.069	.053	.040	.040	.031	.024	.013	.010	.008	
6.0	.108	.078	.056	.093	.067	.048	.064	.047	.034	.037	.028	.020	.012	.009	.007	
7.0	.101	.070	.048	.087	.060	.042	.060	.042	.029	.035	.025	.018	.011	.008	.006	
8.0	.095	.063	.041	.081	.055	.036	.056	.038	.026	.033	.023	.015	.011	.007	.005	
9.0	.089	.057	.036	.077	.050	.031	.053	.035	.022	.031	.021	.013	.010	.007	.004	
10.0	.084	.053	.032	.073	.046	.028	.050	.032	.020	.029	.019	.012	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz Lamp Flux:2076.04x1 lm										
NAME:					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.:					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	26.6	27.3	26.8	27.5	27.7	30.8	31.6	31.1	31.7	31.9
3H	26.5	27.2	26.7	27.3	27.5	31.4	32.0	31.6	32.2	32.4
4H	26.4	27.0	26.7	27.3	27.5	31.4	32.1	31.7	32.3	32.5
6H	26.3	26.9	26.6	27.2	27.4	31.4	32.0	31.7	32.2	32.5
8H	26.3	26.9	26.6	27.1	27.4	31.4	31.9	31.7	32.2	32.5
12H	26.2	26.8	26.5	27.1	27.3	31.3	31.9	31.6	32.1	32.4
4H 2H	27.0	27.6	27.2	27.8	28.0	30.8	31.4	31.0	31.6	31.8
3H	26.8	27.4	27.1	27.7	27.9	31.3	31.9	31.6	32.2	32.4
4H	26.7	27.2	27.1	27.5	27.8	31.4	31.9	31.8	32.2	32.5
6H	26.6	27.1	27.0	27.4	27.8	31.4	31.9	31.8	32.2	32.5
8H	26.6	27.0	27.0	27.4	27.7	31.4	31.8	31.8	32.1	32.5
12H	26.5	26.9	26.9	27.3	27.7	31.3	31.7	31.7	32.1	32.5
8H 4H	26.7	27.1	27.1	27.5	27.8	31.3	31.7	31.7	32.1	32.4
6H	26.6	26.9	27.0	27.3	27.7	31.3	31.6	31.7	32.0	32.4
8H	26.5	26.8	27.0	27.3	27.7	31.2	31.5	31.7	31.9	32.4
12H	26.5	26.7	26.9	27.2	27.7	31.2	31.4	31.6	31.9	32.4
12H 4H	26.6	27.0	27.0	27.4	27.8	31.2	31.6	31.6	32.0	32.4
6H	26.5	26.8	27.0	27.3	27.7	31.2	31.5	31.6	31.9	32.4
8H	26.5	26.7	27.0	27.2	27.7	31.2	31.4	31.6	31.9	32.3
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.1 / - 4.6					+ 1.3 / - 1.4				
1.5H	+ 2.1 / - 3.9					+ 2.2 / - 1.2				
2.0H	+ 2.8 / - 7.0					+ 2.3 / - 2.0				

CIE Pub.117, 2076 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 2.5$)
Area: 0.0001 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz Lamp Flux:2076.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	88	82	79	88	82	79	87	82	78	75
0.80	96	90	87	95	90	86	94	89	86	82
1.00	100	95	91	99	94	91	98	94	90	86
1.25	104	99	95	103	98	95	101	97	94	90
1.50	106	102	99	105	101	98	103	100	97	93
2.00	109	105	102	107	104	101	105	102	99	94
2.50	111	107	104	109	106	103	106	103	101	95
3.00	112	109	106	110	107	105	107	105	103	96
4.00	114	111	109	112	110	108	108	107	105	98
5.00	115	113	111	113	111	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz Lamp Flux:2076.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

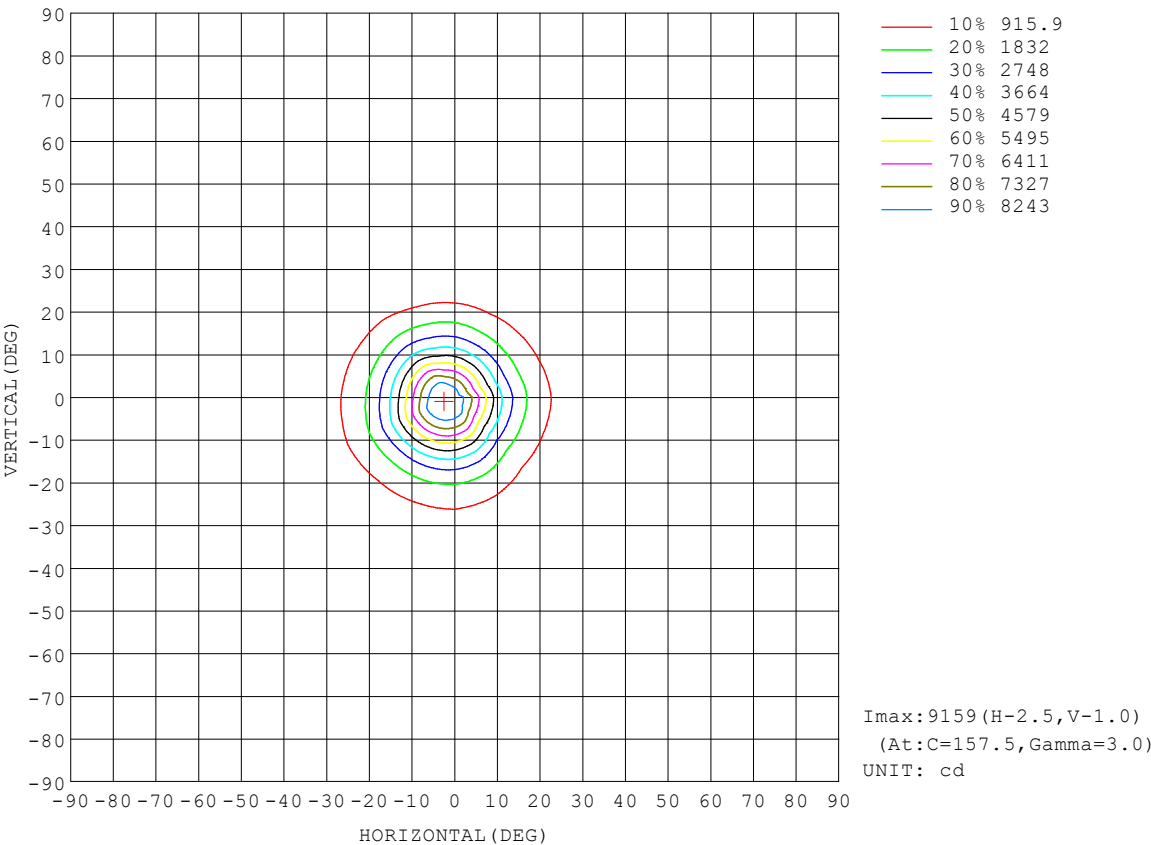

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

AAI Figure

Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz Lamp Flux:2076.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

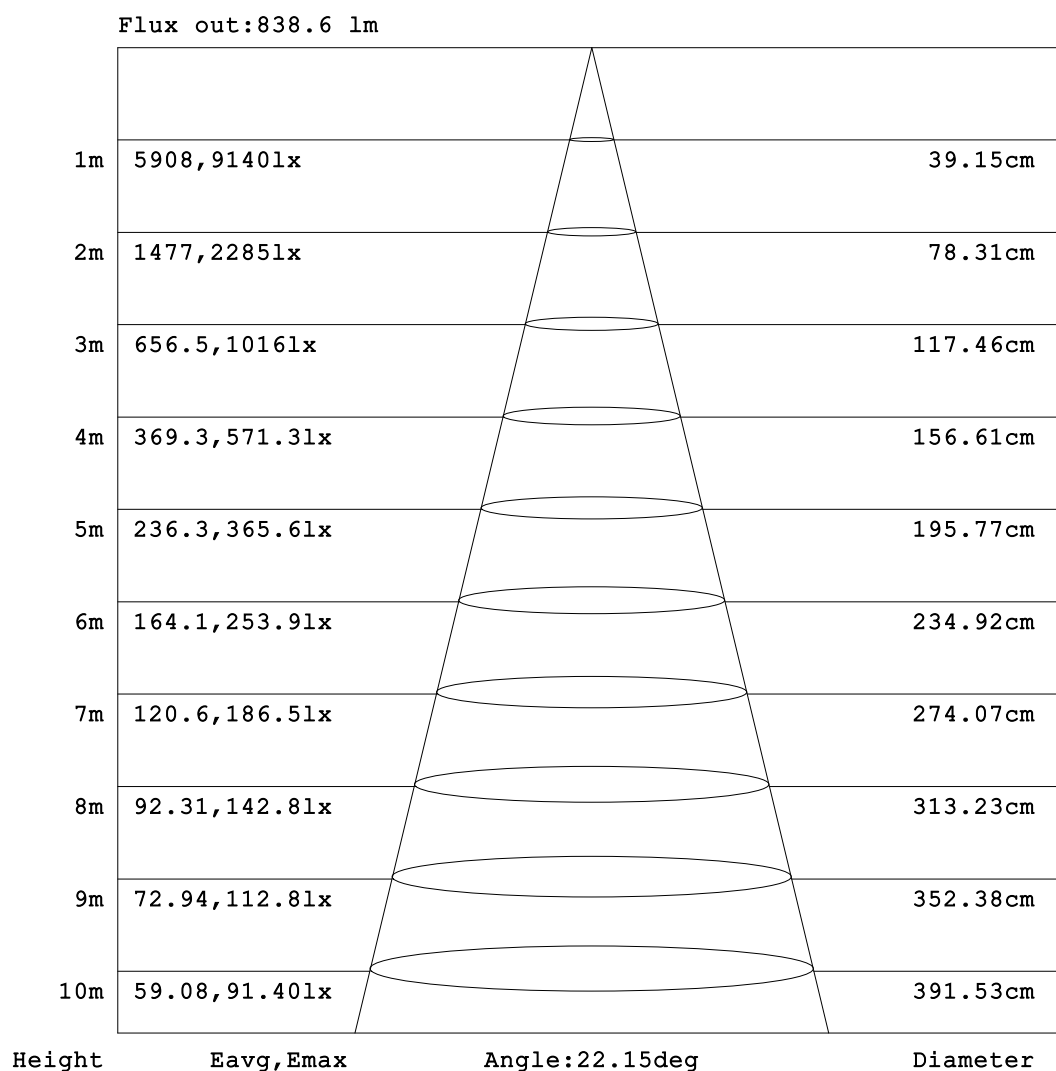


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:


ISOLUX DIAGRAM

Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz Lamp Flux:2076.04x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

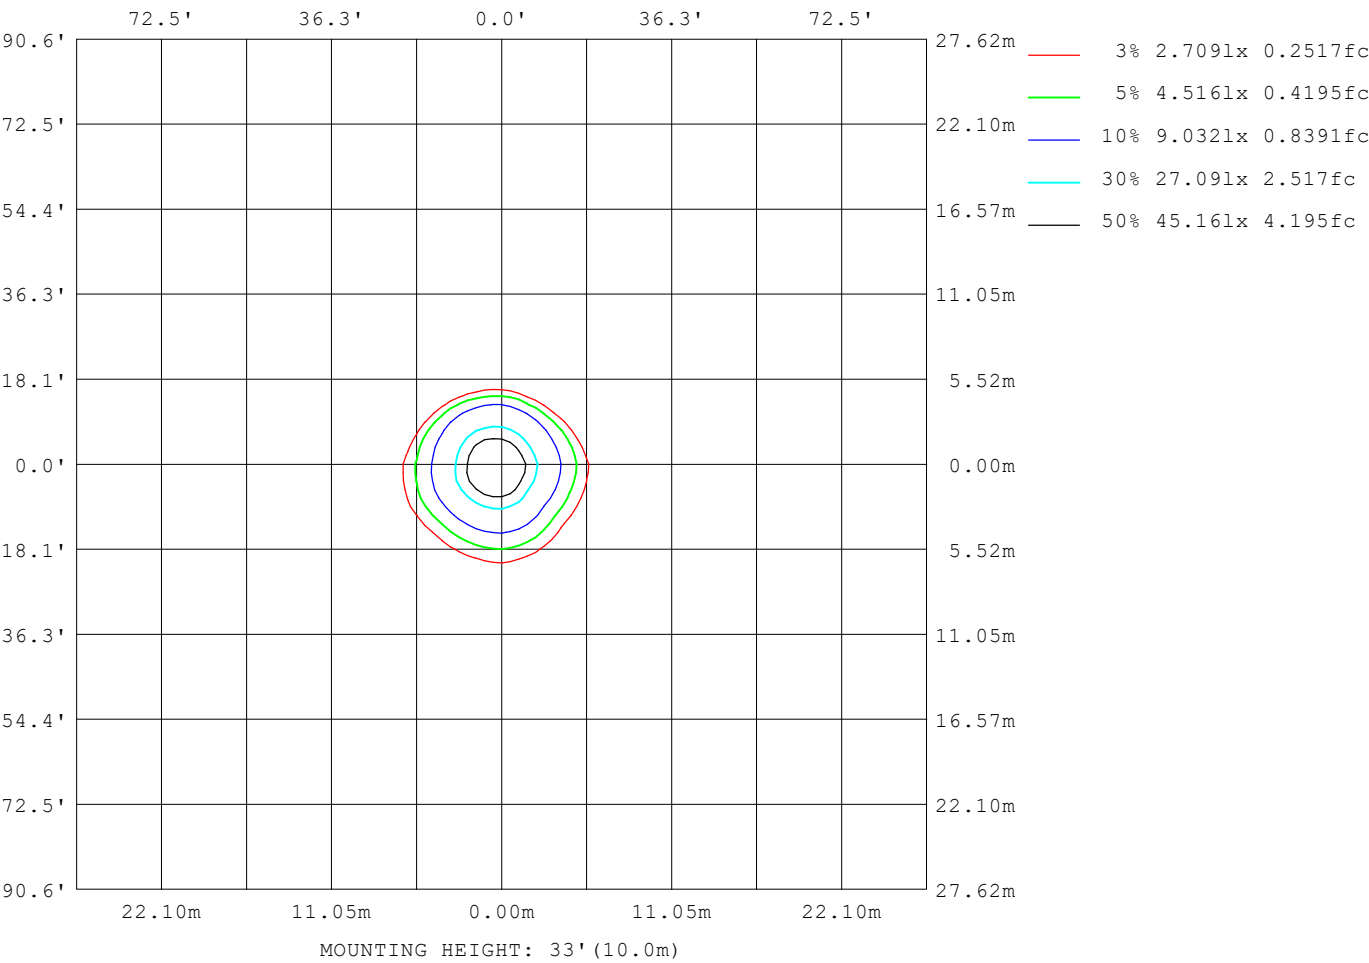

C Range: 0 - 360DEG C Interval: 22.5DEG Test Speed: HIGH Temperature:25.3℃ Operators:Allen Test Date:2026-01-19	γ Range: 0 - 180DEG γ Interval: 1.0DEG Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459 Humidity:45% Test Distance:2.900m [K=0.8783] Remarks:
--	---

Planar Illuminance Curve

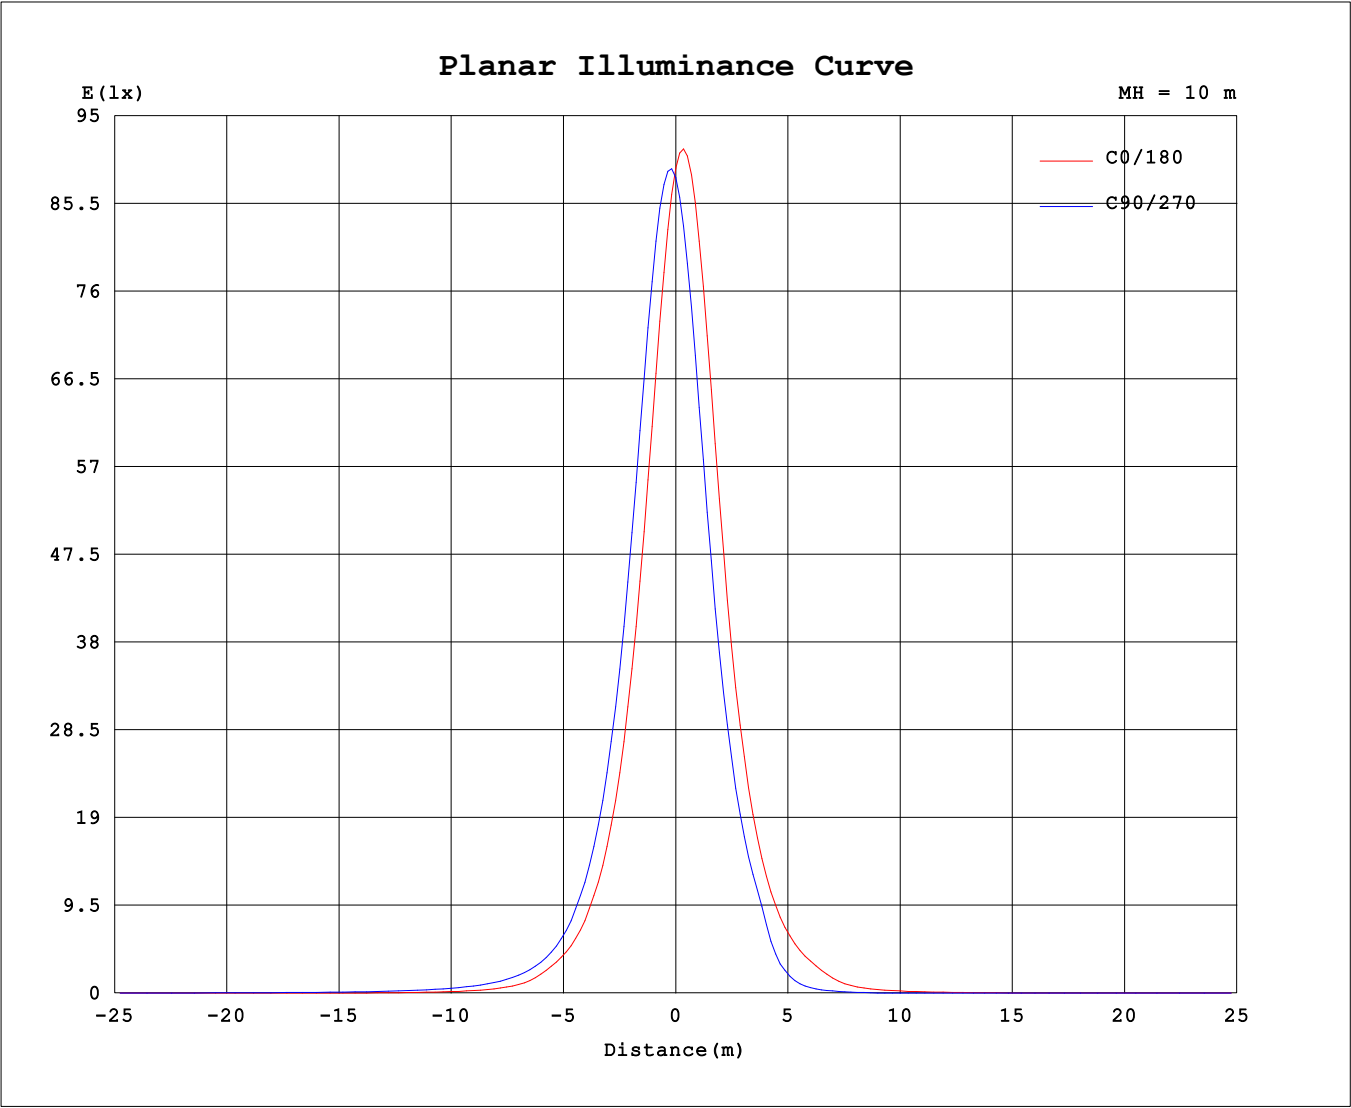

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:2.6584A P:27.000W PF:0.8732 Freq:60.01Hz Lamp Flux:2076.04x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	8932	8920	8921	8923	8830	8752	8696	8675	8932	8920	8921	8923	8830	8752	8696	8675			
5	6788	6898	7120	7894	8236	8538	8782	8938	8655	8502	8217	7394	6984	6631	6383	6257			
10	4156	4230	4444	5330	5788	6190	6539	6761	6228	5998	5667	4768	4356	3987	3767	3707			
15	2317	2328	2440	3075	3441	3665	3863	4081	3672	3451	3275	2753	2464	2173	2036	2047			
20	1278	1254	1305	1681	1916	1991	2067	2235	2029	1852	1736	1490	1342	1138	1062	1097			
25	693	659	674	905	1052	1056	1100	1211	1105	986	834	519	427	365	402	557			
30	381	372	375	504	595	575	576	660	618	425	236	143	119	101	124	204			
35	172	228	232	302	355	333	327	379	301	143	82.3	53.0	45.3	44.2	54.3	86.5			
40	89.1	137	157	196	226	208	203	229	129	66.4	40.7	21.5	16.1	15.8	26.7	45.8			
45	50.0	84.5	114	137	153	142	139	130	68.8	36.6	15.1	2.39	1.52	1.71	5.50	22.7			
50	27.9	52.9	81.3	100	108	103	99.5	78.1	39.8	15.4	2.03	0.01	0.00	0.01	0.49	5.90			
55	11.6	31.8	55.0	75.4	79.2	77.3	70.5	48.4	20.5	3.11	0.26	0.00	0.00	0.00	0.24	1.40			
60	3.26	15.7	34.3	54.7	58.5	57.6	46.9	28.2	6.97	0.77	0.20	0.00	0.00	0.00	0.12	0.64			
65	1.19	5.68	18.6	35.8	41.8	39.2	28.1	13.7	2.27	0.61	0.00	0.00	0.00	0.00	0.00	0.46			
70	0.91	2.25	7.74	20.0	27.3	22.8	13.9	4.71	1.13	0.38	0.00	0.00	0.00	0.00	0.00	0.17			
75	0.63	1.21	2.81	8.79	12.7	10.7	5.35	1.82	0.89	0.02	0.00	0.00	0.00	0.00	0.00	0.00			
80	0.31	0.93	1.42	2.85	4.09	3.52	2.07	1.28	0.57	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
85	0.00	0.62	1.15	1.59	1.73	1.66	1.43	0.99	0.19	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.00	0.32	0.84	1.33	1.49	1.41	1.14	0.65	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.07	0.53	1.00	1.18	1.09	0.81	0.31	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.26	0.68	0.85	0.76	0.48	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.04	0.38	0.52	0.45	0.21	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.14	0.25	0.19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.03	0.10	0.13	0.14	0.15	0.15			
135	0.23	0.22	0.18	0.09	0.06	0.04	0.03	0.04	0.23	0.26	0.31	0.45	0.49	0.54	0.57	0.57			
140	0.67	0.66	0.61	0.44	0.39	0.36	0.33	0.31	0.71	0.77	0.85	1.08	1.16	1.25	1.34	1.34			
145	1.09	1.12	1.10	0.95	0.87	0.83	0.79	0.74	1.47	1.55	1.67	1.97	2.09	2.21	2.31	2.32			
150	1.31	1.36	1.37	1.28	1.22	1.18	1.14	1.08	2.38	2.47	2.64	2.97	3.08	3.19	3.28	3.28			
155	1.51	1.56	1.61	1.57	1.54	1.52	1.49	1.43	3.41	3.45	3.63	3.91	3.99	4.05	4.09	4.07			
160	1.56	1.61	1.65	1.68	1.68	1.67	1.64	1.60	4.13	4.14	4.28	4.41	4.44	4.44	4.43	4.36			
165	1.54	1.59	1.63	1.65	1.65	1.63	1.59	1.54	4.29	4.29	4.35	4.36	4.34	4.30	4.23	4.11			
170	1.57	1.60	1.62	1.64	1.64	1.62	1.57	1.54	4.06	4.06	4.08	3.97	3.92	3.82	3.71	3.56			
175	1.77	1.80	1.80	1.71	1.67	1.66	1.63	1.59	3.46	3.47	3.46	3.21	3.12	3.02	2.90	2.75			
180	2.49	2.49	2.48	2.25	2.19	2.10	2.02	1.94	2.48	2.50	2.50	2.31	2.25	2.21	2.10	2.03			

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: