


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz Lamp Flux:1854.28x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 68.68 lm/W			
MODEL		I _{max} (cd)	3045	S/MH(C0/180)	0.77
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.64
RATED VOLTAGE(V)		TOTAL FLUX(lm)	1854.3	η UP,DN(C0-180)	0.1,56.7
NOMINAL FLUX(lm)	1854.28	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,43.2
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.50
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.70

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

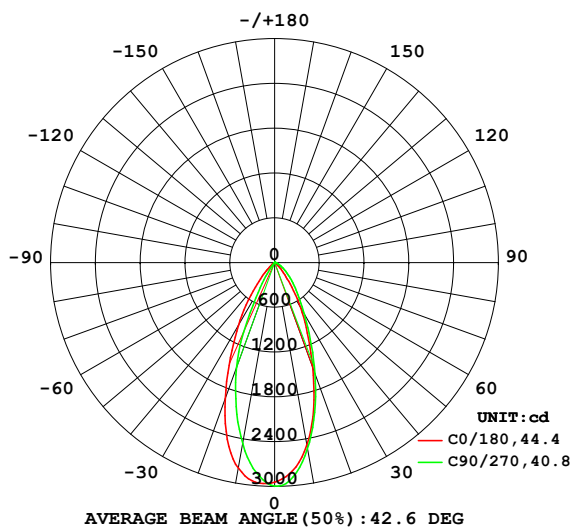

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

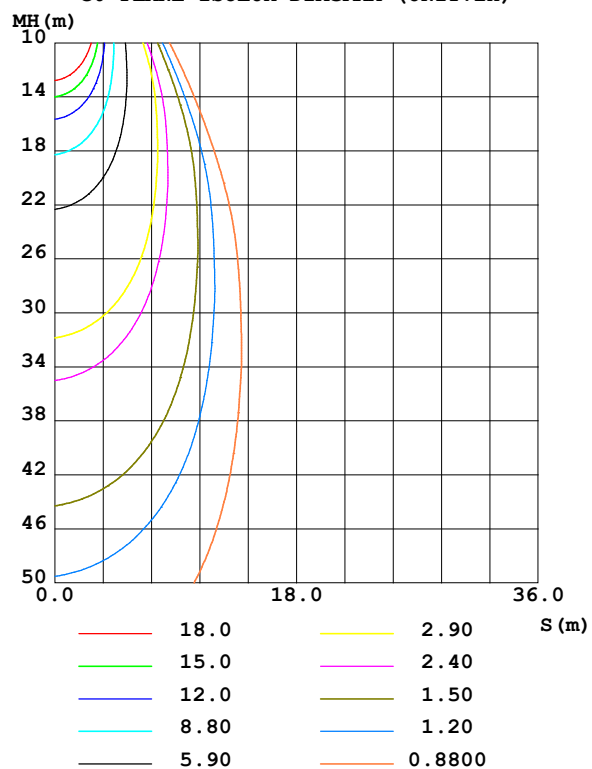

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	2489	2500	2535	2750	2796	2646	2467	2501	0- 10	265.8	265.8	14.3,14.3
20	1495	1569	1583	1877	1938	1798	1496	1561	10- 20	594.7	860.5	46.4,46.4
30	703.8	770.6	798.6	974.7	976.0	635.9	388.3	470.2	20- 30	527.0	1388	74.8,74.8
40	214.7	360.1	415.5	434.0	331.5	102.0	46.91	63.71	30- 40	272.6	1660	89.5,89.5
50	47.29	162.7	213.9	189.5	80.78	3.162	0.0376	1.983	40- 50	118.0	1778	95.9,95.9
60	5.407	55.71	101.3	67.71	11.56	0.5406	0	0.4469	50- 60	49.40	1827	98.6,98.6
70	1.825	11.82	37.33	17.01	2.255	0	0	0	60- 70	18.01	1845	99.5,99.5
80	0.6917	2.656	5.285	3.133	1.206	0	0	0	70- 80	4.364	1850	99.8,99.8
90	0	1.588	2.619	2.023	0	0	0	0	80- 90	1.207	1851	99.8,99.8
100	0	0.5436	1.414	0.8462	0	0	0	0	90-100	0.6129	1852	99.9,99.9
110	0	0	0.4210	0.0203	0	0	0	0	100-110	0.1942	1852	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0.0175	1852	99.9,99.9
130	0.1075	0.0320	0	0.0000	0.1057	0.1742	0.2093	0.2373	120-130	0.0227	1852	99.9,99.9
140	0.5239	0.4332	0.3548	0.3403	0.7497	0.8271	0.9155	0.9878	130-140	0.2596	1852	99.9,99.9
150	0.8950	0.8508	0.7854	0.7356	1.650	1.747	1.898	1.979	140-150	0.6133	1853	99.9,99.9
160	1.315	1.300	1.258	1.211	2.451	2.517	2.655	2.715	150-160	0.7561	1854	100,100
170	1.526	1.505	1.473	1.442	2.583	2.600	2.650	2.650	160-170	0.5695	1854	100,100
180	2.219	2.182	2.162	2.072	2.197	2.188	2.139	2.080	170-180	0.1988	1854	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1731.6 lm

%lum = 93.4%

%lamp = 93.4%

Conical surface Flux(120deg): 1827.5 lm

%lum = 98.6%


%lamp = 98.6%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz Lamp Flux:1854.28x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

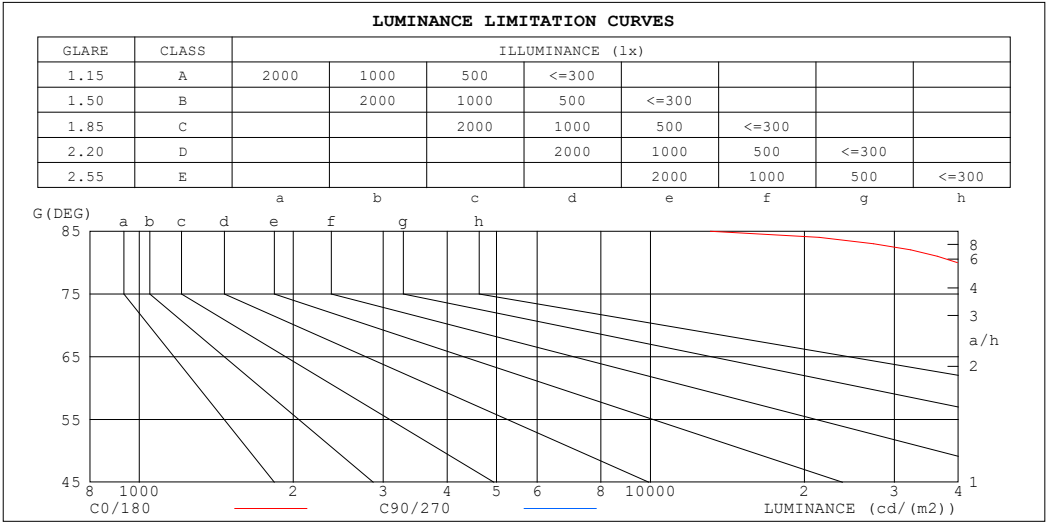


LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	13099	347358
80	39834	304329
75	50078	566451
70	53352	1091524
65	55585	1562315
60	108136	2025315
55	310569	2603243
50	735722	3326971
45	1525813	4249708

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz		
Lamp Flux:1854.28x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.11	1.08	1.06	1.09	1.06	1.04	1.05	1.03	1.01	1.01	.99	.98	.97	.96	.95	.94
2.0	1.03	.99	.96	1.02	.98	.95	.98	.95	.93	.95	.93	.91	.93	.91	.89	.87
3.0	.97	.92	.88	.95	.91	.87	.93	.89	.86	.90	.87	.84	.88	.85	.83	.81
4.0	.91	.85	.81	.89	.84	.81	.87	.83	.80	.85	.82	.79	.83	.80	.78	.76
5.0	.85	.79	.75	.84	.79	.75	.82	.78	.74	.81	.77	.74	.79	.76	.73	.71
6.0	.80	.74	.70	.79	.74	.70	.78	.73	.70	.77	.72	.69	.75	.72	.69	.67
7.0	.76	.70	.66	.75	.70	.66	.74	.69	.65	.73	.68	.65	.72	.68	.65	.63
8.0	.72	.66	.62	.71	.66	.62	.70	.65	.62	.69	.65	.61	.68	.64	.61	.60
9.0	.68	.63	.59	.68	.62	.59	.67	.62	.58	.66	.61	.58	.65	.61	.58	.57
10.0	.65	.59	.56	.65	.59	.56	.64	.59	.55	.63	.58	.55	.62	.58	.55	.54

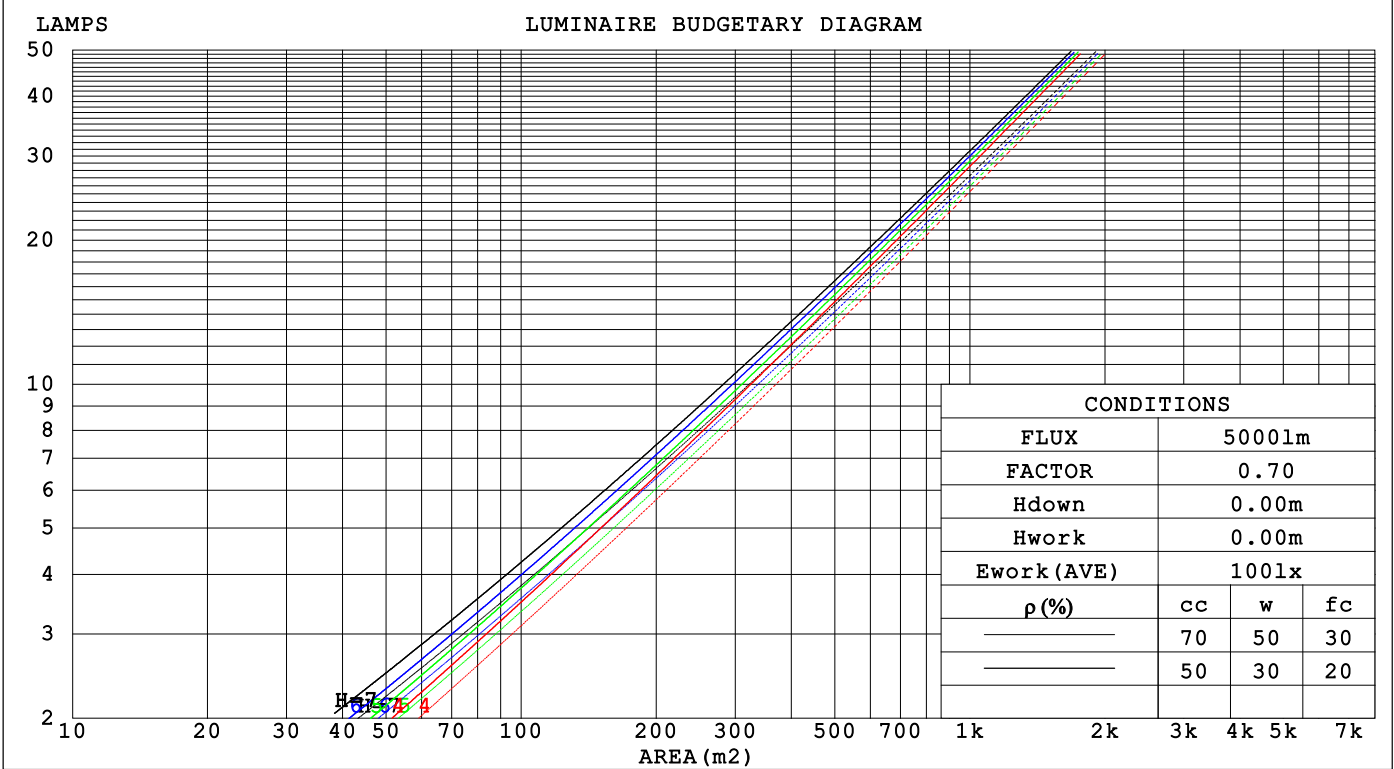

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-19

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz Lamp Flux:1854.28x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.176	.100	.032	.169	.096	.031	.156	.090	.029	.145	.084	.027	.134	.078	.025															
2.0	.168	.092	.028	.162	.089	.028	.152	.084	.026	.142	.080	.025	.133	.075	.024															
3.0	.160	.085	.025	.155	.083	.025	.146	.079	.024	.137	.075	.023	.129	.072	.022															
4.0	.152	.079	.023	.147	.077	.023	.140	.074	.022	.132	.071	.021	.125	.068	.021															
5.0	.144	.073	.021	.140	.072	.021	.134	.070	.020	.127	.067	.020	.121	.065	.019															
6.0	.137	.069	.020	.134	.068	.019	.128	.066	.019	.122	.064	.019	.117	.062	.018															
7.0	.131	.065	.018	.128	.064	.018	.122	.062	.018	.117	.060	.018	.113	.059	.017															
8.0	.125	.061	.017	.122	.060	.017	.117	.059	.017	.113	.057	.017	.109	.056	.016															
9.0	.119	.058	.016	.117	.057	.016	.113	.056	.016	.109	.055	.016	.105	.053	.015															
10.0	.114	.055	.015	.112	.054	.015	.108	.053	.015	.105	.052	.015	.101	.051	.015															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.172	.159	.146	.148	.136	.126	.101	.094	.087	.058	.054	.051	.019	.017	.016	
2.0	.157	.134	.114	.135	.115	.099	.092	.080	.069	.053	.046	.040	.017	.015	.013	
3.0	.145	.115	.091	.124	.099	.079	.085	.069	.056	.049	.040	.033	.016	.013	.011	
4.0	.134	.100	.074	.115	.087	.064	.079	.060	.045	.046	.035	.027	.015	.012	.009	
5.0	.125	.089	.061	.108	.077	.053	.074	.054	.038	.043	.031	.022	.014	.010	.007	
6.0	.118	.079	.052	.101	.069	.045	.070	.048	.032	.040	.028	.019	.013	.009	.006	
7.0	.111	.072	.044	.096	.062	.038	.066	.043	.027	.038	.026	.016	.012	.008	.005	
8.0	.105	.065	.038	.091	.057	.033	.063	.040	.023	.036	.023	.014	.012	.008	.005	
9.0	.100	.060	.033	.086	.052	.029	.060	.037	.020	.035	.022	.012	.011	.007	.004	
10.0	.095	.056	.029	.082	.048	.025	.057	.034	.018	.033	.020	.011	.011	.007	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz Lamp Flux:1854.28x1 lm										
NAME:					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.:					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	32.4	33.3	32.6	33.5	33.6	36.2	37.1	36.4	37.3	37.4
3H	32.2	33.1	32.5	33.3	33.5	36.4	37.2	36.7	37.4	37.7
4H	32.1	32.9	32.4	33.2	33.4	36.4	37.2	36.7	37.4	37.6
6H	32.1	32.8	32.3	33.0	33.3	36.3	37.1	36.6	37.3	37.6
8H	32.0	32.7	32.3	33.0	33.3	36.3	37.0	36.6	37.3	37.5
12H	32.0	32.7	32.3	32.9	33.2	36.2	36.9	36.6	37.2	37.5
4H 2H	32.5	33.4	32.8	33.6	33.8	36.0	36.8	36.3	37.1	37.3
3H	32.4	33.1	32.7	33.4	33.6	36.3	37.0	36.6	37.3	37.5
4H	32.3	32.9	32.6	33.2	33.5	36.3	36.9	36.6	37.2	37.5
6H	32.2	32.8	32.6	33.1	33.4	36.2	36.8	36.6	37.1	37.5
8H	32.2	32.7	32.6	33.0	33.4	36.2	36.7	36.6	37.0	37.4
12H	32.1	32.6	32.5	33.0	33.3	36.1	36.6	36.5	37.0	37.4
8H 4H	32.2	32.7	32.6	33.1	33.4	36.1	36.7	36.5	37.0	37.4
6H	32.1	32.5	32.5	32.9	33.3	36.1	36.5	36.5	36.9	37.3
8H	32.1	32.4	32.5	32.9	33.3	36.0	36.4	36.5	36.8	37.3
12H	32.0	32.3	32.5	32.8	33.2	36.0	36.3	36.5	36.8	37.2
12H 4H	32.2	32.6	32.6	33.0	33.4	36.1	36.6	36.5	36.9	37.3
6H	32.1	32.4	32.5	32.9	33.3	36.0	36.4	36.5	36.8	37.3
8H	32.0	32.3	32.5	32.8	33.3	36.0	36.3	36.5	36.7	37.2
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.4 / - 6.7					+ 1.2 / - 1.9				
1.5H	+ 2.8 / - 5.5					+ 1.4 / - 1.4				
2.0H	+ 3.4 / - 7.9					+ 2.6 / - 3.2				

CIE Pub.117, 1854 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 2.1$)
Area: 0.0001 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz Lamp Flux:1854.28x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	85	78	74	84	78	74	84	78	74	70
0.80	93	86	82	92	86	82	91	85	82	78
1.00	98	92	88	97	91	88	95	91	87	83
1.25	102	96	93	101	96	92	99	95	92	87
1.50	105	100	96	104	99	96	101	97	95	90
2.00	108	103	100	106	102	99	104	100	98	92
2.50	110	106	102	108	104	102	105	102	100	94
3.00	111	108	105	109	106	104	106	104	101	95
4.00	113	110	108	111	109	107	108	106	104	97
5.00	115	112	110	112	110	109	108	107	106	98
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz Lamp Flux:1854.28x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

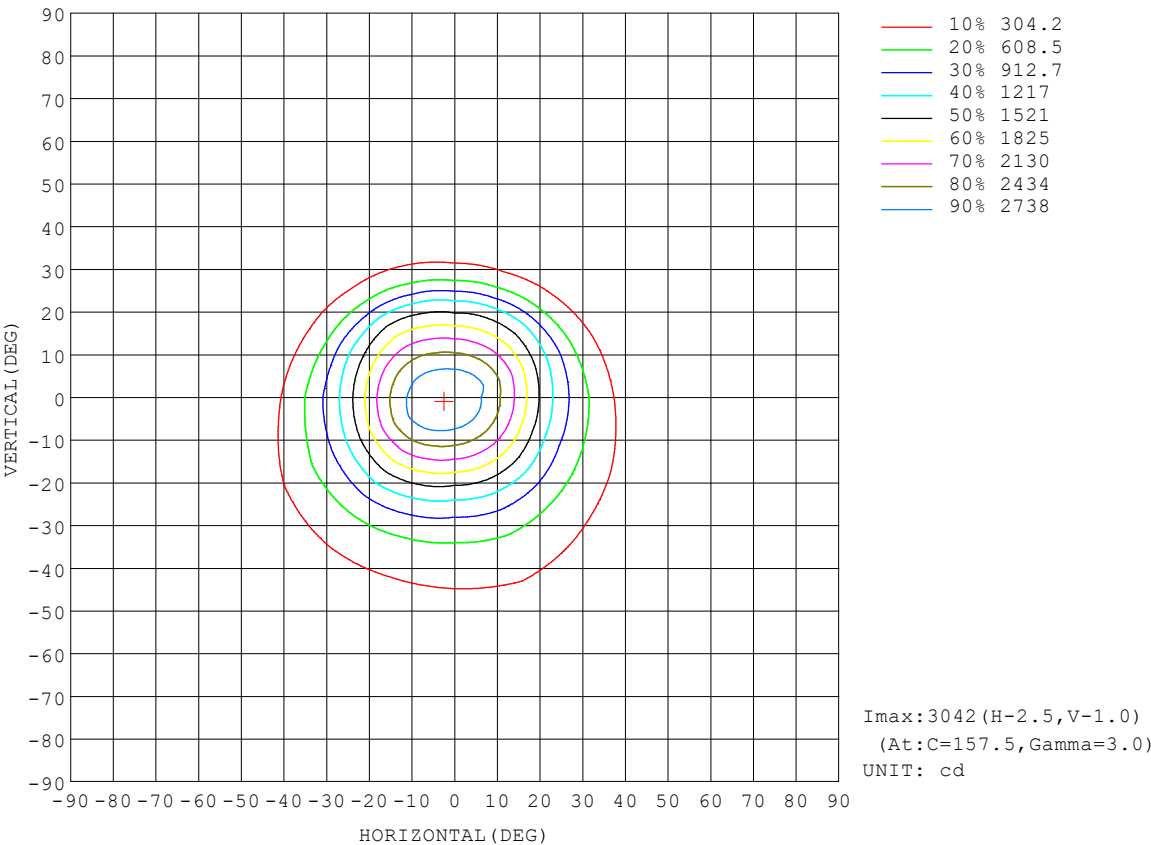

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

AAI Figure

Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz Lamp Flux:1854.28x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

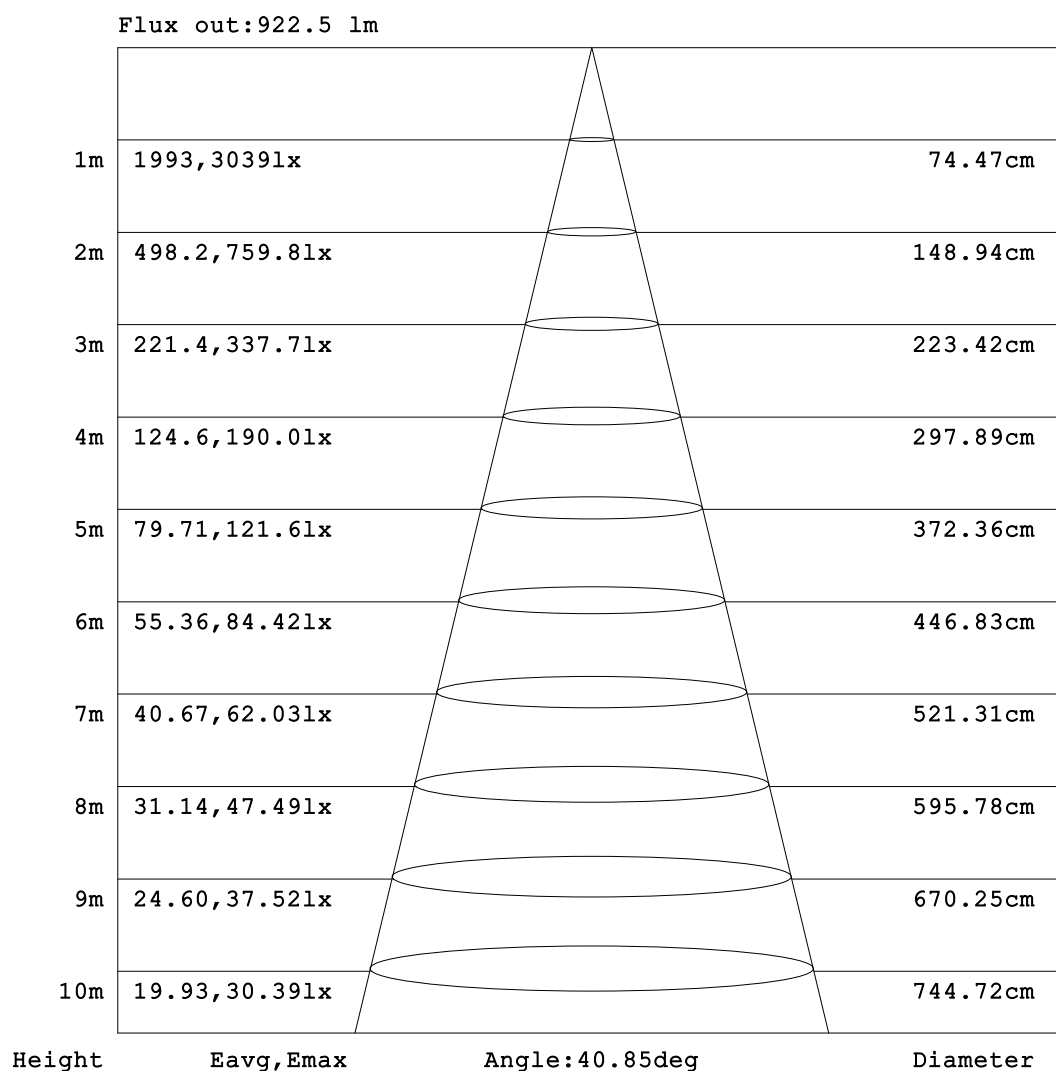


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3℃
Operators: Allen
Test Date: 2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:


ISOLUX DIAGRAM

Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz Lamp Flux:1854.28x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

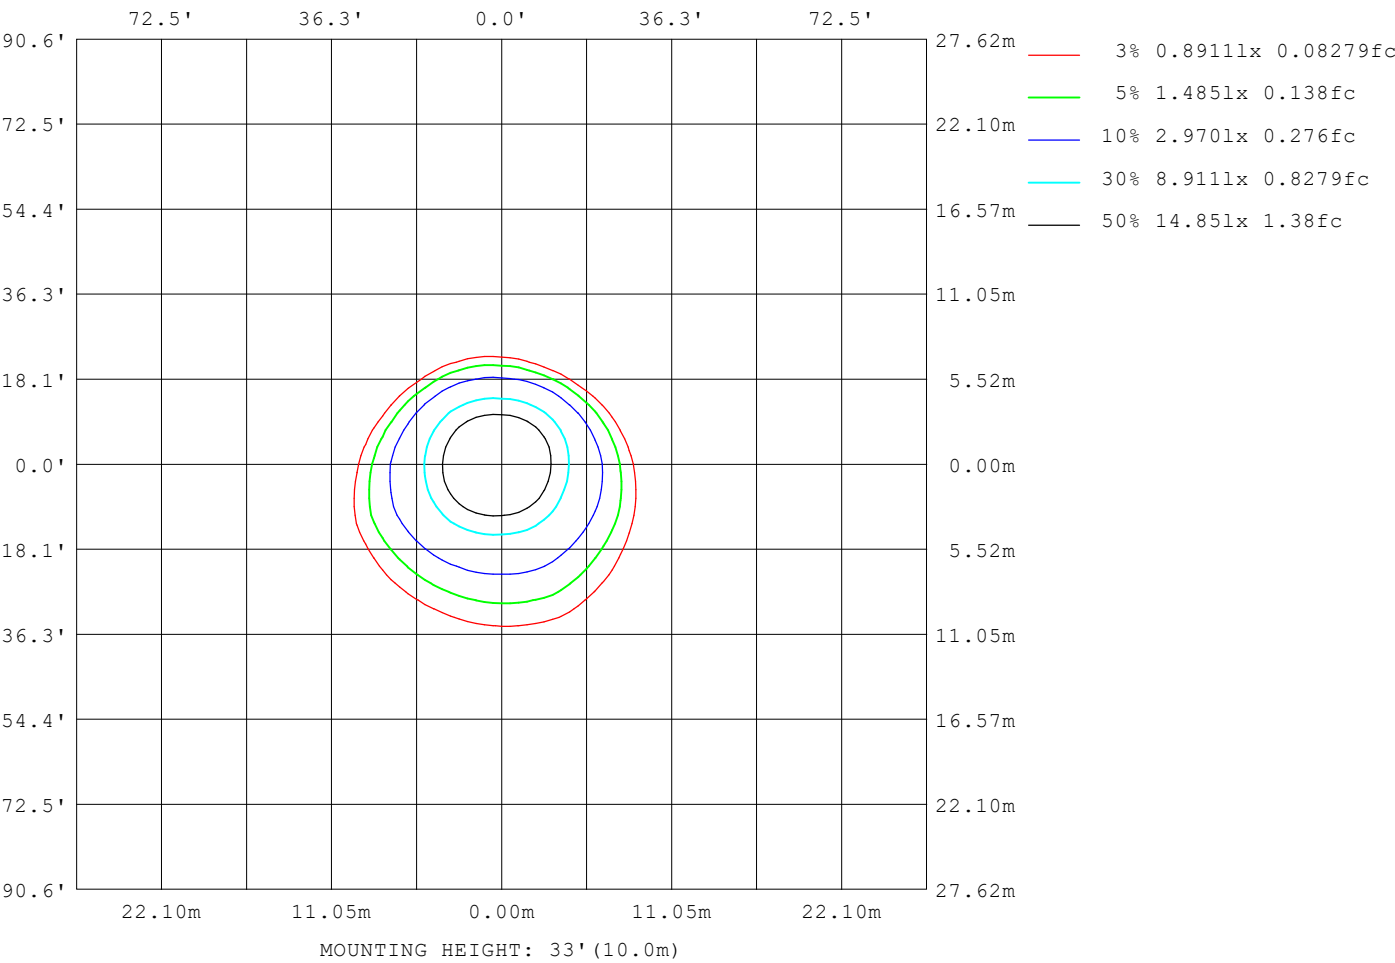

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

Planar Illuminance Curve

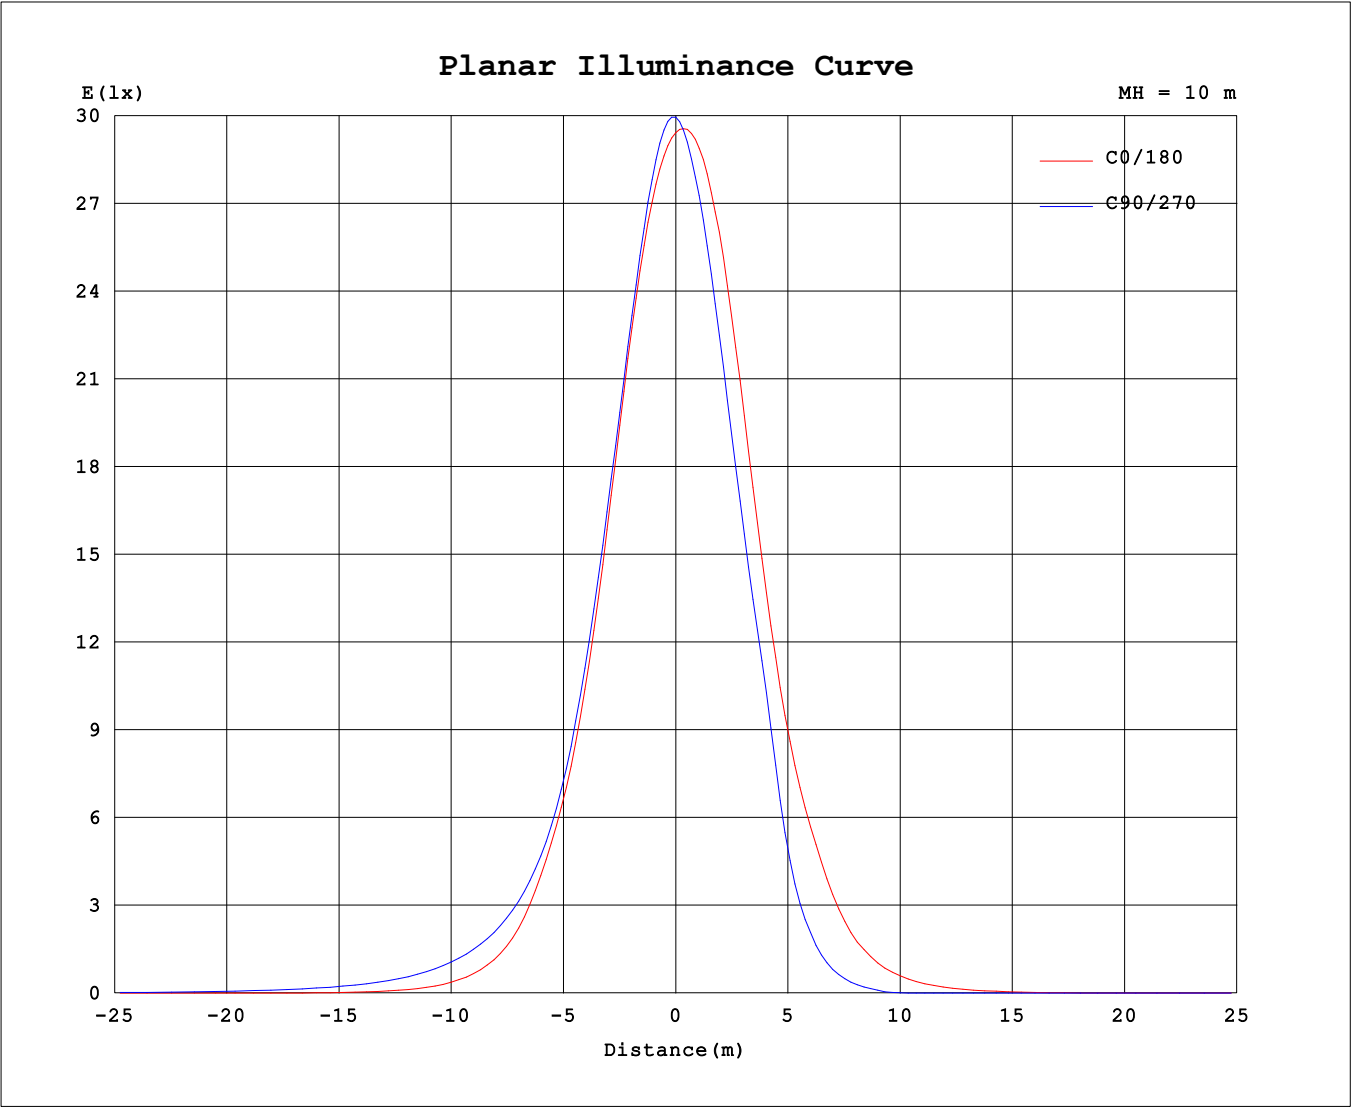

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:2.6638A P:27.000W PF:0.8732 Freq:60.00Hz Lamp Flux:1854.28x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	
0	2942	2956	2970	2983	2995	3005	3015	3026	2942	2956	2970	2983	2995	3005	3015	3026	
5	2798	2816	2831	2850	2882	2931	2986	3027	2953	2932	2893	2846	2823	2823	2847	2861	
10	2489	2496	2500	2504	2535	2623	2750	2848	2796	2750	2646	2533	2467	2467	2501	2538	
15	2023	2026	2050	2058	2077	2189	2354	2469	2451	2383	2262	2099	1997	2002	2047	2067	
20	1495	1503	1569	1583	1583	1709	1877	1956	1938	1883	1798	1621	1496	1519	1561	1539	
25	1043	1047	1125	1147	1134	1248	1395	1426	1404	1364	1284	1042	886	903	1010	1067	
30	704	714	771	813	799	866	975	991	976	847	636	479	388	392	470	595	
35	405	488	523	584	572	596	654	684	613	412	272	197	149	139	184	297	
40	215	305	360	426	416	413	434	463	332	186	102	68.8	46.9	43.7	63.7	128	
45	108	174	250	310	300	288	290	277	168	76.5	33.3	6.92	3.59	3.59	14.2	50.9	
50	47.3	95.9	163	223	214	199	189	157	80.8	28.0	3.16	0.19	0.04	0.18	1.98	14.0	
55	17.8	48.7	98.5	155	149	138	116	85.8	35.6	5.14	0.66	0.12	0.00	0.11	0.63	3.26	
60	5.41	22.7	55.7	100.0	101	91.9	67.7	42.2	11.6	1.61	0.54	0.00	0.00	0.00	0.45	1.39	
65	2.35	8.93	27.5	56.9	66.0	55.4	36.7	17.9	3.99	1.31	0.16	0.00	0.00	0.00	0.00	1.08	
70	1.82	3.90	11.8	27.4	37.3	29.4	17.0	6.12	2.26	0.89	0.00	0.00	0.00	0.00	0.00	0.59	
75	1.30	2.33	4.69	10.9	14.7	12.8	6.81	2.87	1.81	0.21	0.00	0.00	0.00	0.00	0.00	0.00	
80	0.69	1.80	2.66	4.05	5.28	4.77	3.13	2.32	1.21	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
85	0.11	1.22	2.16	2.81	3.03	2.94	2.56	1.78	0.51	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
90	0.00	0.69	1.59	2.33	2.62	2.50	2.02	1.15	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
95	0.00	0.24	1.02	1.72	2.04	1.90	1.42	0.57	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
100	0.00	0.00	0.54	1.13	1.41	1.29	0.85	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
105	0.00	0.00	0.18	0.63	0.86	0.77	0.38	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
110	0.00	0.00	0.00	0.25	0.42	0.35	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
115	0.00	0.00	0.00	0.00	0.09	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.03	0.04	0.04	0.04	0.02	
130	0.11	0.07	0.03	0.00	0.00	0.00	0.00	0.00	0.11	0.14	0.17	0.19	0.21	0.23	0.24	0.22	
135	0.28	0.25	0.20	0.15	0.12	0.11	0.12	0.15	0.37	0.41	0.44	0.47	0.50	0.53	0.55	0.54	
140	0.52	0.49	0.43	0.39	0.35	0.34	0.34	0.36	0.75	0.79	0.83	0.86	0.92	0.96	0.99	0.98	
145	0.73	0.71	0.67	0.63	0.59	0.57	0.56	0.57	1.20	1.23	1.29	1.34	1.41	1.46	1.49	1.48	
150	0.89	0.88	0.85	0.82	0.79	0.76	0.74	0.73	1.65	1.68	1.75	1.82	1.90	1.95	1.98	1.95	
155	1.13	1.11	1.09	1.07	1.04	1.02	0.99	0.99	2.10	2.12	2.19	2.27	2.34	2.40	2.42	2.39	
160	1.31	1.31	1.30	1.28	1.26	1.24	1.21	1.21	2.45	2.46	2.52	2.58	2.65	2.70	2.71	2.68	
165	1.42	1.42	1.41	1.40	1.38	1.36	1.34	1.33	2.58	2.59	2.62	2.67	2.71	2.74	2.75	2.70	
170	1.53	1.52	1.50	1.49	1.47	1.46	1.44	1.45	2.58	2.59	2.60	2.63	2.65	2.66	2.65	2.60	
175	1.81	1.81	1.78	1.75	1.72	1.71	1.70	1.69	2.47	2.48	2.48	2.48	2.48	2.46	2.44	2.39	
180	2.22	2.21	2.18	2.16	2.16	2.10	2.07	2.03	2.20	2.21	2.19	2.17	2.14	2.12	2.08	2.05	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: