


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz Lamp Flux:2288.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 84.14 lm/W			
MODEL		Imax (cd)	13656	S/MH(C0/180)	0.32
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.50
RATED VOLTAGE(V)		TOTAL FLUX(lm)	2288.6	η UP,DN(C0-180)	0.1,34.7
NOMINAL FLUX(lm)	2288.61	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,65.1
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.00
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.30

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

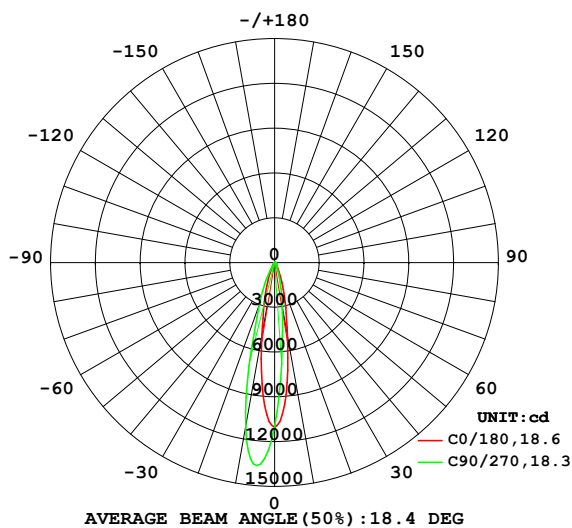

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

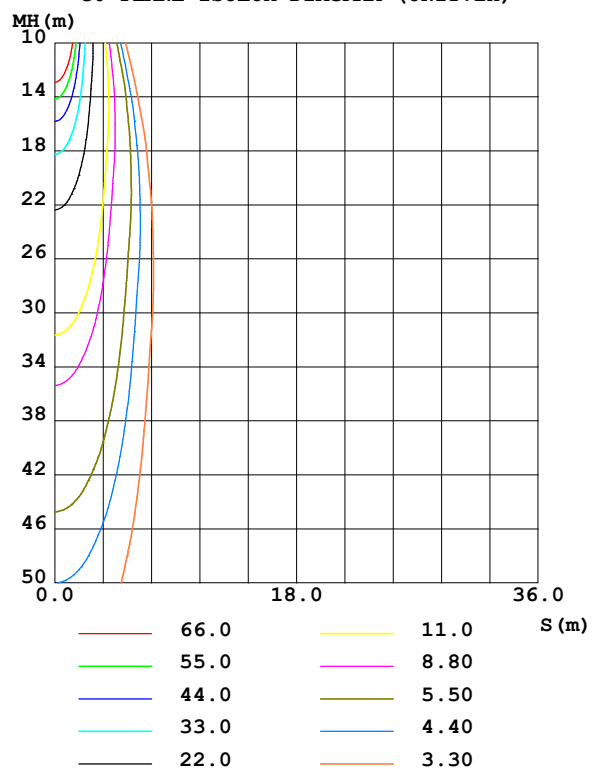

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	500.5	342.2	300.8	335.9	499.9	876.1	1120	863.4	0- 10	781.0	781.0	34.1,34.1
20	144.3	90.66	75.50	89.36	143.2	233.4	303.6	239.6	10- 20	907.2	1688	73.8,73.8
30	36.47	25.91	23.39	25.76	37.48	41.55	49.35	48.47	20- 30	397.1	2085	91.1,91.1
40	11.84	13.67	12.57	12.92	10.72	6.302	5.505	6.585	30- 40	109.7	2195	95.9,95.9
50	4.707	8.148	8.091	7.653	4.338	1.013	0.3119	1.081	40- 50	52.97	2248	98.2,98.2
60	0.6685	3.866	4.815	3.470	0.6298	0.0326	0	0.0238	50- 60	25.63	2274	99.3,99.3
70	0.1073	0.5558	1.267	0.4777	0.1068	0	0	0	60- 70	9.095	2283	99.7,99.7
80	0.0446	0.1715	0.1893	0.1336	0.0467	0	0	0	70- 80	1.461	2284	99.8,99.8
90	0	0.1013	0.1310	0.0734	0	0	0	0	80- 90	0.6017	2285	99.8,99.8
100	0	0.0279	0.0619	0.0206	0	0	0	0	90-100	0.2735	2285	99.8,99.8
110	0	0	0.0037	0	0	0	0	0	100-110	0.0586	2285	99.8,99.8
120	0	0	0	0	0	0	0	0	110-120	0.0001	2285	99.8,99.8
130	0	0.0015	0.0058	0.0033	0.0007	0	0	0	120-130	0.0008	2285	99.8,99.8
140	0.0519	0.0865	0.1086	0.0956	0.0910	0.0586	0.0486	0.0588	130-140	0.2112	2285	99.9,99.9
150	0.1219	0.1416	0.1640	0.1890	0.2996	0.2461	0.2184	0.2487	140-150	0.8745	2286	99.9,99.9
160	0.1463	0.1475	0.1629	0.1885	0.4670	0.4763	0.4794	0.4986	150-160	1.245	2287	99.9,99.9
170	0.1394	0.1393	0.1585	0.1907	0.3917	0.4416	0.5108	0.5381	160-170	0.9350	2288	100,100
180	0.1929	0.2539	0.3170	0.3284	0.1944	0.2226	0.2896	0.3278	170-180	0.2889	2289	100,100
DEG	LUMINOUS INTENSITY:X10cd									UNIT:lm		

Conical surface Flux(90deg): 2225.6 lm

%lum = 97.2%

%lamp = 97.2%

Conical surface Flux(120deg): 2273.6 lm

%lum = 99.3%


%lamp = 99.3%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz Lamp Flux:2288.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

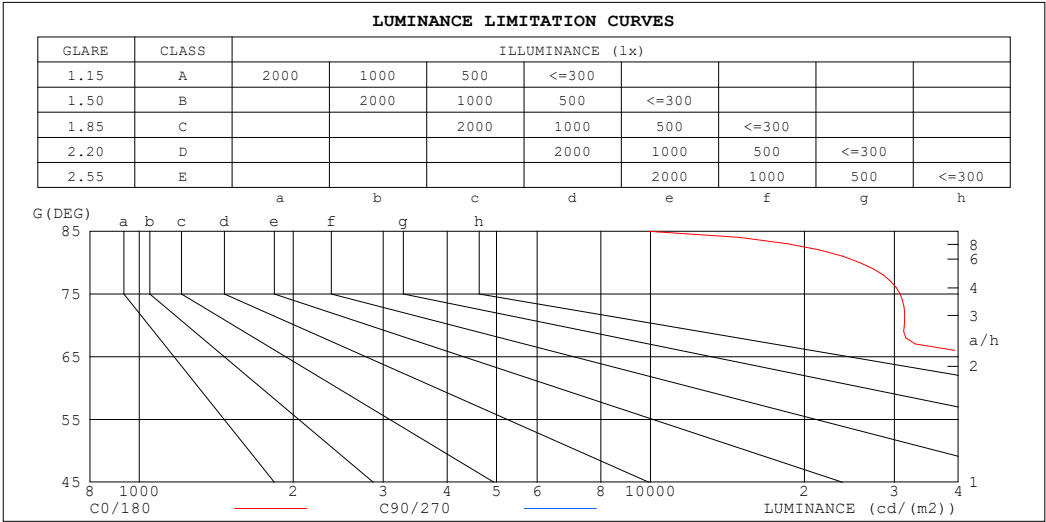

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	9898	189198
80	25690	109014
75	30786	132226
70	31368	370405
65	50857	748838
60	133706	962929
55	442317	1091952
50	732227	1258714
45	989563	1425634


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz		
Lamp Flux:2288.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Coefficients of Utilization(CU)														
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00														
1.0	1.13	1.11	1.09	1.10	1.09	1.07	1.06	1.05	1.04	1.03	1.02	1.01	.99	.98	.98	.96														
2.0	1.07	1.04	1.01	1.05	1.02	.00	1.02	.00	.98	.99	.97	.96	.96	.95	.94	.92														
3.0	1.02	.98	.95	1.01	.97	.94	.98	.95	.93	.96	.93	.91	.94	.92	.90	.89														
4.0	.98	.93	.90	.96	.93	.90	.94	.91	.89	.93	.90	.88	.91	.89	.87	.85														
5.0	.94	.89	.86	.93	.89	.86	.91	.88	.85	.90	.87	.84	.88	.86	.84	.82														
6.0	.90	.86	.83	.89	.85	.82	.88	.84	.82	.87	.84	.81	.86	.83	.81	.80														
7.0	.87	.83	.80	.86	.82	.79	.85	.82	.79	.84	.81	.79	.83	.80	.78	.77														
8.0	.84	.80	.77	.84	.79	.77	.83	.79	.76	.82	.78	.76	.81	.78	.76	.75														
9.0	.81	.77	.74	.81	.77	.74	.80	.77	.74	.79	.76	.74	.79	.76	.73	.73														
10.0	.79	.75	.72	.79	.75	.72	.78	.74	.72	.77	.74	.72	.77	.74	.71	.70														

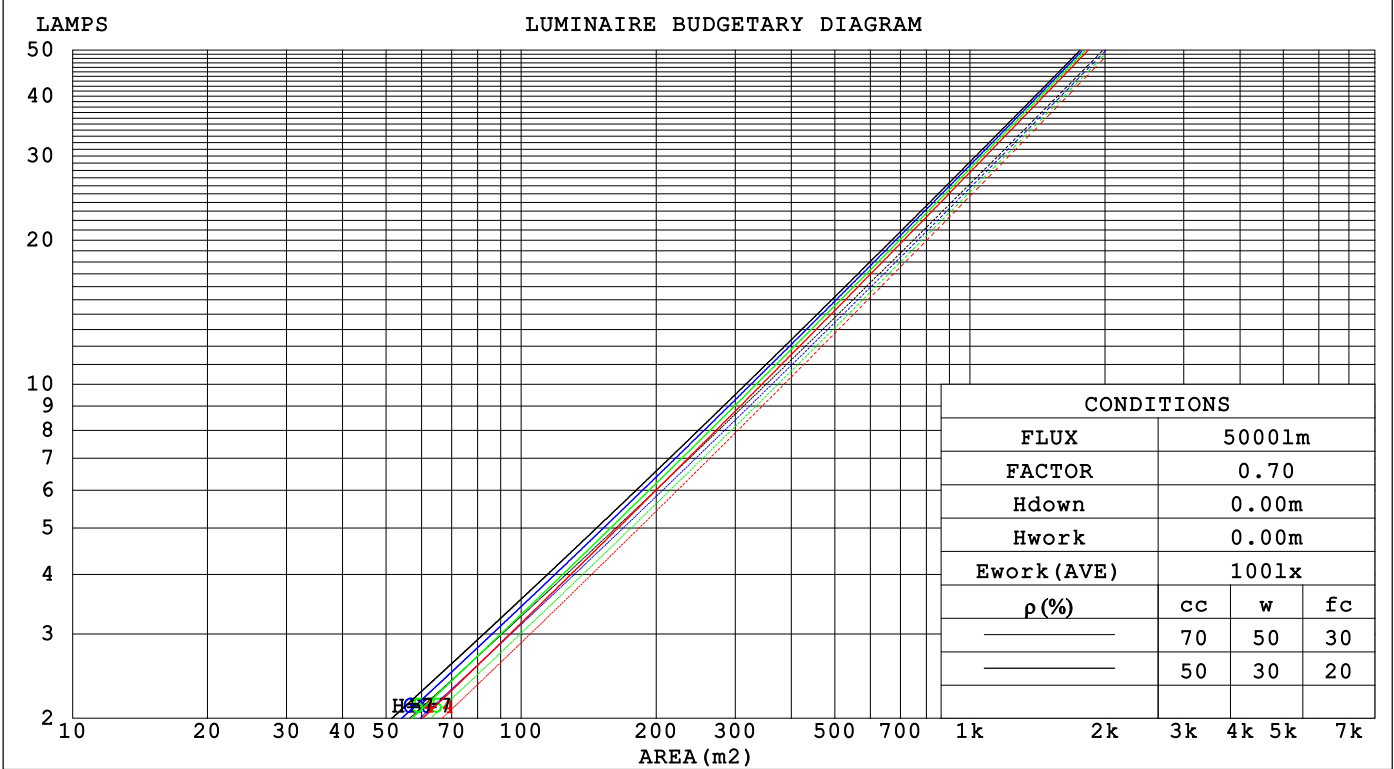

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-19

γ Range: 0 - 180DEG

γ Inteval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz Lamp Flux:2288.61x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.143	.082	.026	.137	.078	.025	.124	.071	.023	.113	.065	.021	.102	.059	.019	
2.0	.134	.073	.023	.128	.071	.022	.118	.066	.020	.108	.061	.019	.100	.056	.018	
3.0	.125	.067	.020	.121	.065	.019	.112	.061	.018	.104	.057	.017	.096	.053	.017	
4.0	.118	.061	.018	.114	.060	.018	.106	.056	.017	.100	.053	.016	.093	.051	.015	
5.0	.111	.057	.016	.108	.055	.016	.101	.053	.016	.095	.050	.015	.090	.048	.014	
6.0	.105	.053	.015	.102	.052	.015	.097	.050	.014	.092	.048	.014	.087	.046	.014	
7.0	.100	.049	.014	.097	.048	.014	.092	.047	.013	.088	.045	.013	.084	.044	.013	
8.0	.095	.046	.013	.093	.046	.013	.089	.044	.013	.085	.043	.012	.081	.042	.012	
9.0	.091	.044	.012	.089	.043	.012	.085	.042	.012	.081	.041	.012	.078	.040	.011	
10.0	.087	.042	.012	.085	.041	.011	.082	.040	.011	.079	.039	.011	.076	.038	.011	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.170	.159	.149	.146	.136	.128	.100	.094	.089	.057	.054	.052	.018	.017	.017	
2.0	.152	.134	.118	.131	.115	.102	.090	.080	.071	.052	.046	.042	.017	.015	.014	
3.0	.138	.115	.096	.118	.099	.083	.081	.069	.058	.047	.040	.034	.015	.013	.011	
4.0	.126	.099	.079	.108	.086	.069	.074	.060	.048	.043	.035	.029	.014	.011	.009	
5.0	.115	.087	.066	.099	.075	.058	.068	.053	.041	.040	.031	.024	.013	.010	.008	
6.0	.107	.077	.056	.092	.067	.049	.063	.047	.035	.037	.028	.021	.012	.009	.007	
7.0	.099	.069	.048	.085	.060	.042	.059	.042	.030	.034	.025	.018	.011	.008	.006	
8.0	.093	.062	.042	.080	.054	.036	.055	.038	.026	.032	.022	.015	.010	.007	.005	
9.0	.087	.057	.036	.075	.049	.032	.052	.035	.023	.030	.020	.013	.010	.007	.004	
10.0	.082	.052	.032	.071	.045	.028	.049	.032	.020	.029	.019	.012	.009	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz Lamp Flux:2288.61x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	26.4	27.1	26.7	27.3	27.4	28.2	28.9	28.4	29.1	29.2
3H	26.3	27.0	26.6	27.1	27.3	28.5	29.2	28.8	29.4	29.6
4H	26.2	26.8	26.5	27.1	27.3	28.5	29.1	28.8	29.3	29.5
6H	26.2	26.7	26.4	27.0	27.2	28.4	29.0	28.7	29.2	29.5
8H	26.1	26.7	26.4	26.9	27.2	28.4	28.9	28.7	29.2	29.4
12H	26.1	26.6	26.4	26.9	27.1	28.4	28.9	28.7	29.2	29.4
4H 2H	26.7	27.3	27.0	27.5	27.7	28.3	28.9	28.5	29.1	29.3
3H	26.6	27.1	26.9	27.4	27.6	28.6	29.1	28.9	29.4	29.7
4H	26.5	27.0	26.8	27.3	27.6	28.5	29.0	28.9	29.3	29.6
6H	26.4	26.8	26.8	27.1	27.5	28.5	28.9	28.8	29.2	29.6
8H	26.3	26.7	26.7	27.1	27.5	28.4	28.8	28.8	29.2	29.6
12H	26.3	26.7	26.7	27.0	27.4	28.4	28.8	28.8	29.1	29.5
8H 4H	26.4	26.8	26.7	27.1	27.5	28.4	28.8	28.8	29.2	29.5
6H	26.3	26.6	26.7	27.0	27.4	28.3	28.7	28.8	29.1	29.5
8H	26.2	26.5	26.7	26.9	27.4	28.3	28.6	28.7	29.0	29.5
12H	26.2	26.4	26.6	26.9	27.3	28.3	28.5	28.7	29.0	29.4
12H 4H	26.3	26.7	26.7	27.0	27.4	28.3	28.7	28.8	29.1	29.5
6H	26.2	26.5	26.7	26.9	27.4	28.3	28.6	28.7	29.0	29.4
8H	26.2	26.4	26.6	26.9	27.3	28.2	28.5	28.7	28.9	29.4
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.7 / - 3.6					+ 0.8 / - 1.1				
1.5H	+ 1.4 / - 2.5					+ 0.4 / - 0.5				
2.0H	+ 2.5 / - 9.0					+ 1.1 / - 1.7				

CIE Pub.117, 2289 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 2.9$)
Area: 0.0001 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz Lamp Flux:2288.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	89	83	79	88	83	79	88	82	79	76
0.80	96	91	87	96	90	87	94	90	87	83
1.00	100	95	92	99	95	91	98	94	91	87
1.25	104	99	96	103	99	96	101	97	95	91
1.50	107	102	99	105	101	99	103	100	97	93
2.00	109	105	102	108	104	101	105	102	100	95
2.50	111	107	104	109	106	103	106	103	101	96
3.00	112	109	106	110	107	105	107	105	103	97
4.00	114	111	109	112	110	108	108	107	105	98
5.00	115	113	111	113	111	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz Lamp Flux:2288.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

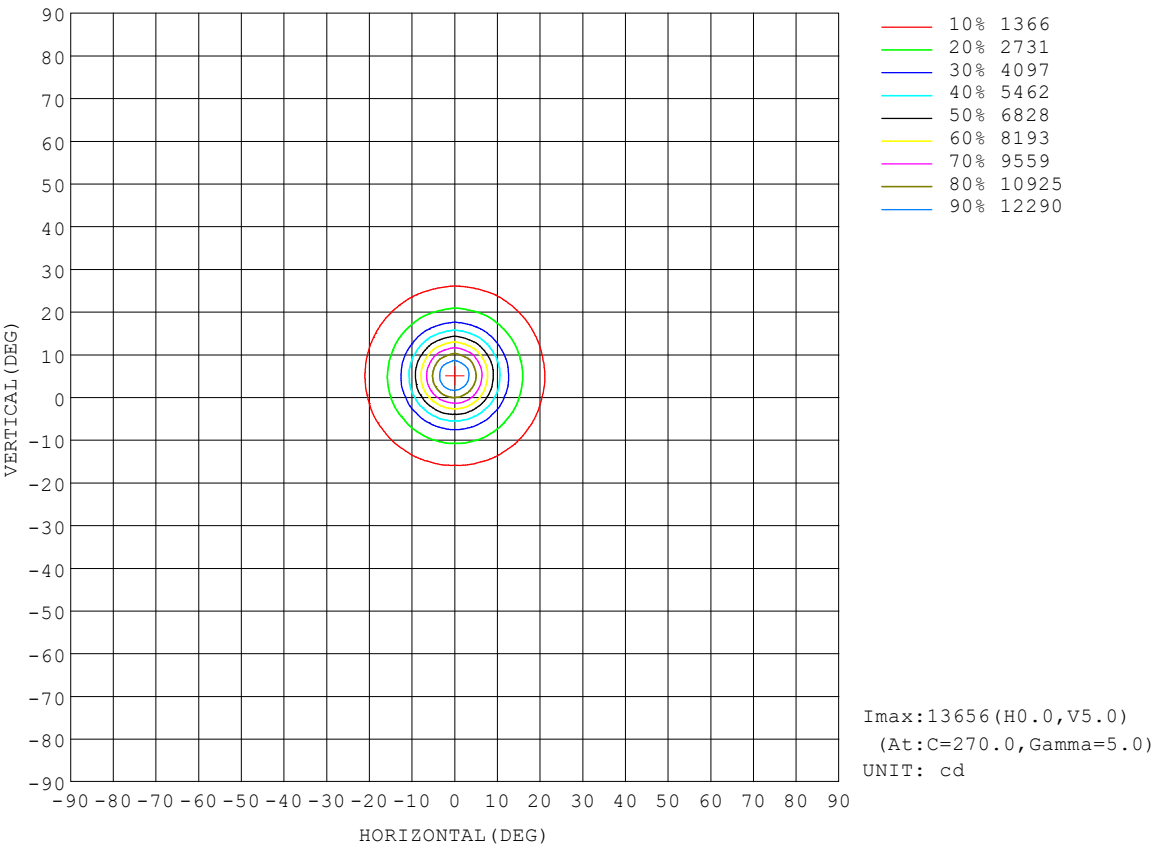

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

AAI Figure

Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz Lamp Flux:2288.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

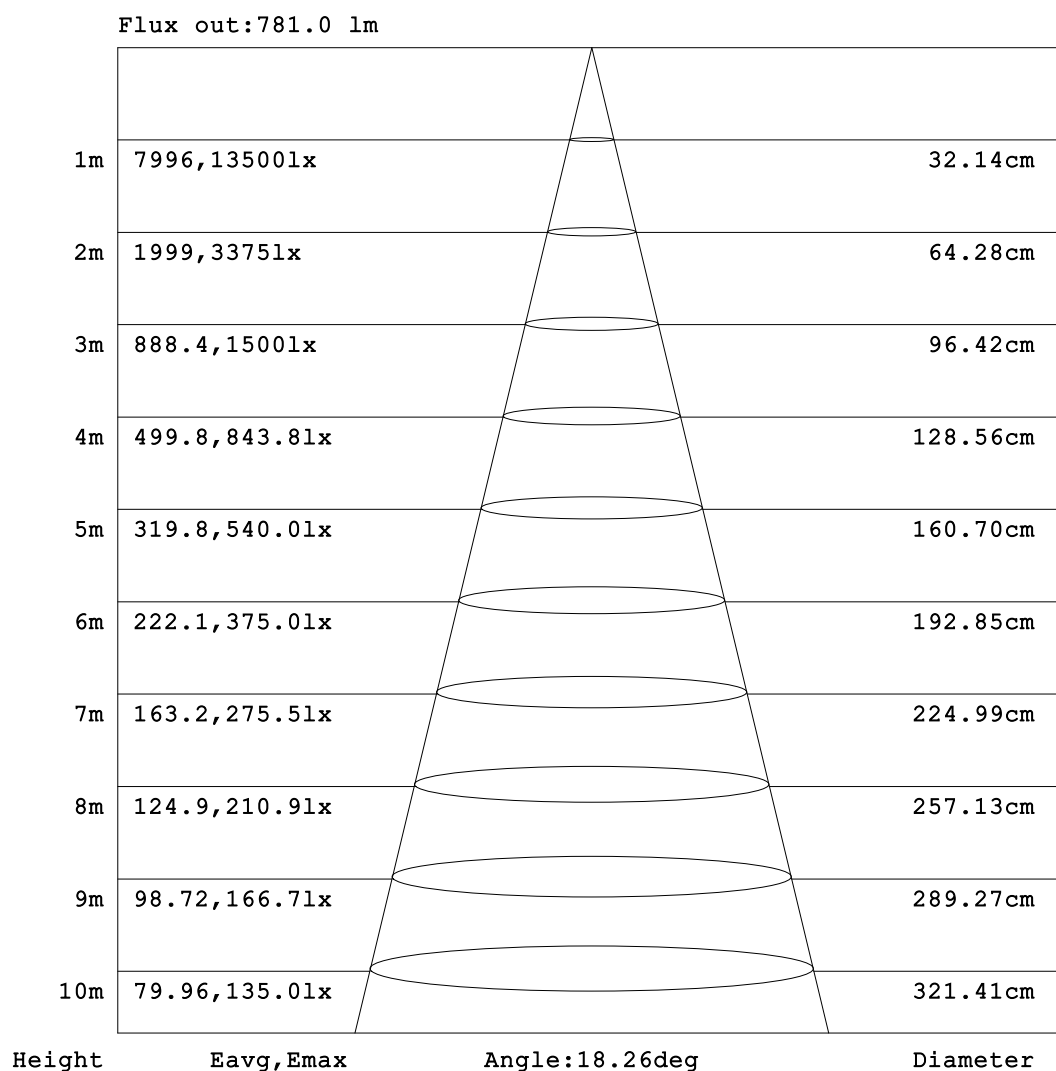


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:


ISOLUX DIAGRAM

Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz Lamp Flux:2288.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

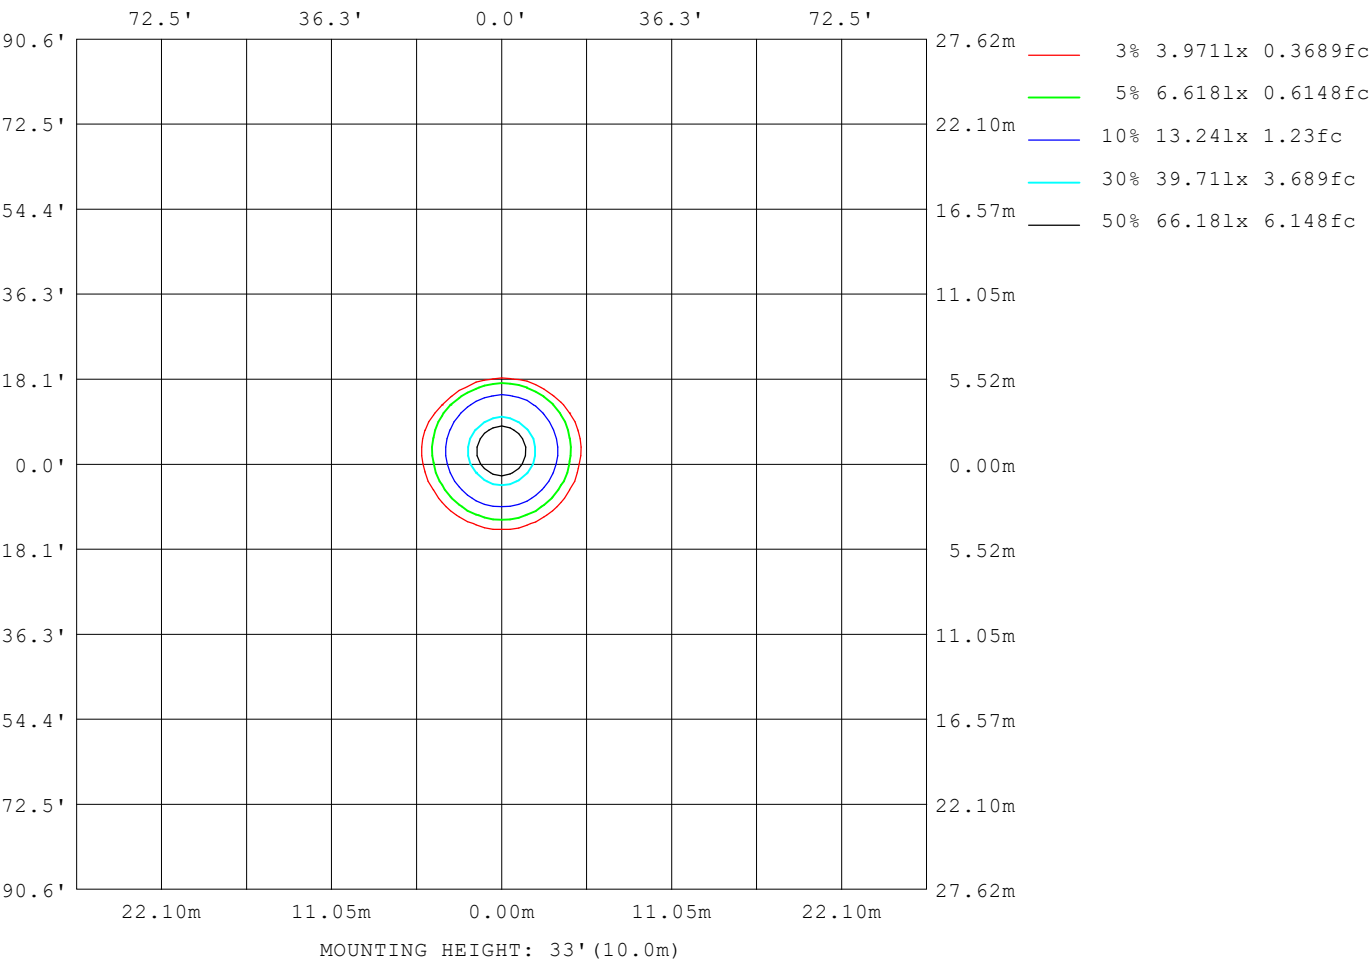

C Range: 0 - 360DEG C Interval: 22.5DEG Test Speed: HIGH Temperature:25.3℃ Operators:Allen Test Date:2026-01-19	γ Range: 0 - 180DEG γ Interval: 1.0DEG Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459 Humidity:45% Test Distance:2.900m [K=0.8783] Remarks:
--	---

Planar Illuminance Curve

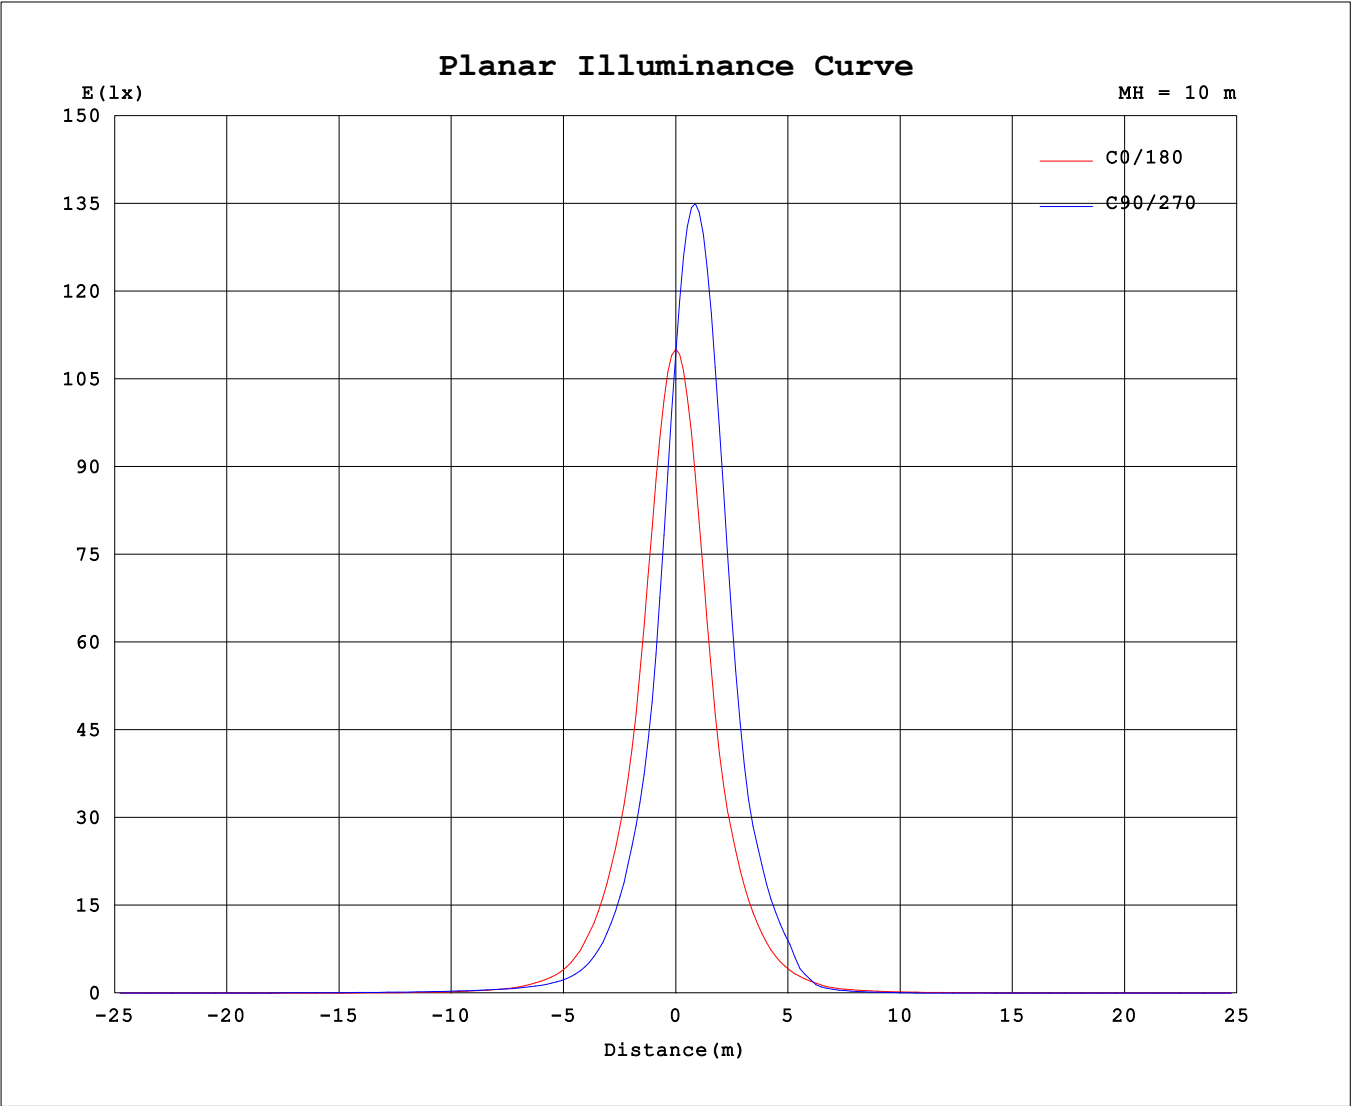

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:2.6964A P:27.200W PF:0.8735 Freq:60.01Hz Lamp Flux:2288.61x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: X10cd

C (DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	1102	1100	1099	1097	1094	1093	1091	1088	1102	1100	1099	1097	1094	1093	1091	1088			
5	888	752	659	607	586	606	665	756	894	1054	1213	1326	1366	1320	1199	1035			
10	500	398	342	311	301	307	336	392	500	670	876	1052	1120	1043	863	654			
15	276	221	184	164	156	162	180	214	271	340	444	560	611	555	444	348			
20	144	113	90.7	79.3	75.5	78.2	89.4	111	143	186	233	282	304	289	240	189			
25	71.1	54.6	44.9	40.0	38.5	39.7	45.0	54.5	72.6	96.3	122	146	159	151	124	95.7			
30	36.5	29.4	25.9	24.0	23.4	23.8	25.8	29.6	37.5	43.8	41.5	42.4	49.4	48.2	48.5	46.0			
35	19.1	19.4	18.0	16.8	16.3	16.3	16.9	18.0	17.1	14.1	12.2	11.6	12.0	12.2	13.6	16.0			
40	11.8	13.8	13.7	12.9	12.6	12.5	12.9	12.8	10.7	8.22	6.30	5.62	5.51	5.63	6.58	9.01			
45	7.00	9.70	10.8	10.3	10.1	10.1	10.2	9.08	6.51	4.85	3.49	2.68	2.59	2.72	3.62	5.11			
50	4.71	6.38	8.15	8.30	8.09	7.96	7.65	6.00	4.34	2.55	1.01	0.30	0.31	0.34	1.08	2.79			
55	2.54	4.43	5.75	6.39	6.26	6.11	5.32	4.05	2.31	0.60	0.13	0.00	0.00	0.00	0.12	0.65			
60	0.67	2.40	3.87	4.68	4.81	4.44	3.47	2.08	0.63	0.14	0.03	0.00	0.00	0.00	0.02	0.14			
65	0.21	0.69	1.93	2.84	3.16	2.59	1.65	0.62	0.21	0.07	0.02	0.00	0.00	0.00	0.01	0.06			
70	0.11	0.26	0.56	1.10	1.27	0.97	0.48	0.23	0.11	0.05	0.00	0.00	0.00	0.00	0.00	0.04			
75	0.08	0.14	0.24	0.33	0.34	0.28	0.18	0.12	0.08	0.02	0.00	0.00	0.00	0.00	0.00	0.01			
80	0.04	0.11	0.17	0.20	0.19	0.16	0.13	0.10	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
85	0.01	0.08	0.14	0.17	0.16	0.14	0.11	0.06	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.00	0.04	0.10	0.13	0.13	0.10	0.07	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.01	0.06	0.10	0.10	0.07	0.05	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.03	0.06	0.06	0.04	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.03	0.03	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.01	0.02	0.03	0.04	0.04	0.04	0.03	0.02	0.03	0.02	0.02	0.01	0.01	0.01	0.02	0.02			
140	0.05	0.07	0.09	0.10	0.11	0.11	0.10	0.08	0.09	0.07	0.06	0.05	0.05	0.05	0.06	0.07			
145	0.10	0.12	0.14	0.15	0.16	0.17	0.17	0.15	0.19	0.16	0.14	0.12	0.12	0.12	0.14	0.16			
150	0.12	0.13	0.14	0.15	0.16	0.18	0.19	0.19	0.30	0.28	0.25	0.23	0.22	0.23	0.25	0.28			
155	0.15	0.15	0.15	0.15	0.16	0.18	0.19	0.20	0.40	0.40	0.38	0.37	0.36	0.37	0.39	0.42			
160	0.15	0.14	0.15	0.15	0.16	0.18	0.19	0.20	0.47	0.47	0.48	0.48	0.48	0.49	0.50	0.51			
165	0.14	0.14	0.14	0.15	0.16	0.17	0.19	0.20	0.45	0.46	0.49	0.51	0.52	0.53	0.54	0.55			
170	0.14	0.14	0.14	0.15	0.16	0.17	0.19	0.20	0.39	0.40	0.44	0.48	0.51	0.53	0.54	0.54			
175	0.15	0.16	0.16	0.18	0.19	0.20	0.22	0.23	0.30	0.30	0.35	0.40	0.44	0.46	0.47	0.47			
180	0.19	0.22	0.25	0.29	0.32	0.33	0.33	0.31	0.19	0.20	0.22	0.26	0.29	0.32	0.33	0.33			

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: