


## LUMINAIRE PHOTOMETRIC TEST REPORT


|                                                                                    |       |                  |
|------------------------------------------------------------------------------------|-------|------------------|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz<br>Lamp Flux:2174.8x1 lm |       |                  |
| NAME:                                                                              | TYPE: | WEIGHT:          |
| SPEC.:                                                                             | DIM.: | SERIAL No.:      |
| MFR.:                                                                              | SUR.: | Shielding Angle: |

| DATA OF LAMP     |        | PHOTOMETRIC DATA Eff: 80.25 lm/W |        |                   |          |
|------------------|--------|----------------------------------|--------|-------------------|----------|
| MODEL            |        | I <sub>max</sub> (cd)            | 9536   | S/MH(C0/180)      | 0.39     |
| NOMINAL POWER(W) |        | LOR(%)                           | 100.0  | S/MH(C90/270)     | 0.57     |
| RATED VOLTAGE(V) |        | TOTAL FLUX(lm)                   | 2174.8 | η UP,DN(C0-180)   | 0.1,37.4 |
| NOMINAL FLUX(lm) | 2174.8 | CIE CLASS                        | DIRECT | η UP,DN(C180-360) | 0.1,62.4 |
| LAMPS INSIDE     | 1      | η up (%)                         | 0.2    | CIBSE SHR NOM     | 0.00     |
| TEST VOLTAGE(V)  |        | η down (%)                       | 99.8   | CIBSE SHR MAX     | 0.30     |

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

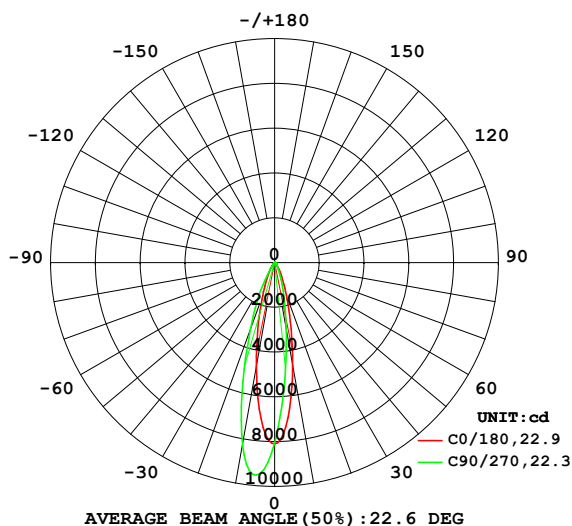

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

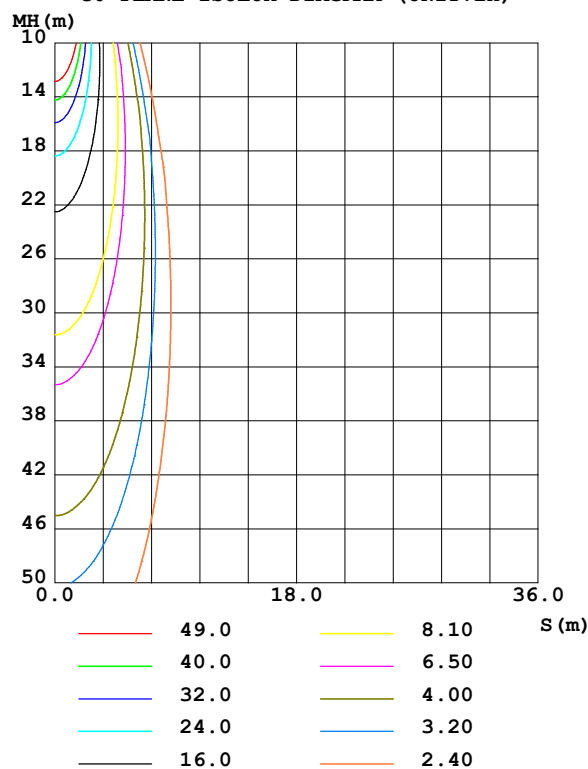

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: HIGH  
Temperature: 25.3 °C  
Operators: Allen  
Test Date: 2026-01-19

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System: EVERFINE GO-R5000\_V2 SYSTEM V2.00.459  
Humidity: 45%  
Test Distance: 2.900m [K=0.8783]  
Remarks:

## ZONAL FLUX DIAGRAM

## ZONAL FLUX DIAGRAM:

| $\gamma$ | C0                    | C45    | C90    | C135   | C180   | C225   | C270   | C315   | $\gamma$ | $\Phi$ zone | $\Phi$ total | %lum, lamp |
|----------|-----------------------|--------|--------|--------|--------|--------|--------|--------|----------|-------------|--------------|------------|
| 10       | 4665                  | 3328   | 3018   | 3319   | 4713   | 6928   | 8270   | 6906   | 0- 10    | 618.7       | 618.7        | 28.4,28.4  |
| 20       | 1553                  | 961.7  | 923.2  | 957.8  | 1573   | 2415   | 3209   | 2430   | 10- 20   | 865.2       | 1484         | 68.2,68.2  |
| 30       | 507.5                 | 313.5  | 325.6  | 310.1  | 519.8  | 513.2  | 706.2  | 561.6  | 20- 30   | 449.7       | 1934         | 88.9,88.9  |
| 40       | 143.7                 | 149.8  | 151.2  | 142.0  | 131.0  | 70.08  | 65.72  | 73.78  | 30- 40   | 145.4       | 2079         | 95.6,95.6  |
| 50       | 45.32                 | 81.31  | 82.99  | 75.62  | 42.23  | 10.16  | 3.509  | 10.57  | 40- 50   | 57.20       | 2136         | 98.2,98.2  |
| 60       | 7.032                 | 32.94  | 43.62  | 29.82  | 6.690  | 0.3327 | 0      | 0.2473 | 50- 60   | 24.58       | 2161         | 99.4,99.4  |
| 70       | 1.173                 | 6.091  | 11.65  | 5.022  | 1.138  | 0      | 0      | 0      | 60- 70   | 8.146       | 2169         | 99.7,99.7  |
| 80       | 0.5046                | 1.886  | 2.091  | 1.446  | 0.5186 | 0      | 0      | 0      | 70- 80   | 1.560       | 2170         | 99.8,99.8  |
| 90       | 0                     | 1.135  | 1.488  | 0.8228 | 0      | 0      | 0      | 0      | 80- 90   | 0.6724      | 2171         | 99.8,99.8  |
| 100      | 0                     | 0.3209 | 0.7108 | 0.2460 | 0      | 0      | 0      | 0      | 90-100   | 0.3153      | 2171         | 99.8,99.8  |
| 110      | 0                     | 0      | 0.0571 | 0      | 0      | 0      | 0      | 0      | 100-110  | 0.0692      | 2172         | 99.9,99.9  |
| 120      | 0                     | 0      | 0      | 0      | 0      | 0      | 0      | 0      | 110-120  | 0.0002      | 2172         | 99.9,99.9  |
| 130      | 0                     | 0.0405 | 0.0815 | 0.0537 | 0.0377 | 0.0002 | 0      | 0.0000 | 120-130  | 0.0018      | 2172         | 99.9,99.9  |
| 140      | 0.5121                | 0.7827 | 0.9332 | 0.8726 | 0.9026 | 0.6280 | 0.5317 | 0.6369 | 130-140  | 0.2251      | 2172         | 99.9,99.9  |
| 150      | 1.079                 | 1.260  | 1.459  | 1.618  | 2.624  | 2.255  | 2.016  | 2.276  | 140-150  | 0.8011      | 2173         | 99.9,99.9  |
| 160      | 1.417                 | 1.442  | 1.600  | 1.834  | 4.064  | 4.123  | 4.124  | 4.315  | 150-160  | 1.112       | 2174         | 99.9,99.9  |
| 170      | 1.389                 | 1.406  | 1.595  | 1.906  | 3.569  | 3.927  | 4.445  | 4.691  | 160-170  | 0.8406      | 2175         | 100,100    |
| 180      | 2.037                 | 2.566  | 3.080  | 3.186  | 2.035  | 2.286  | 2.835  | 3.151  | 170-180  | 0.2695      | 2175         | 100,100    |
| DEG      | LUMINOUS INTENSITY:cd |        |        |        |        |        |        |        |          | UNIT:lm     |              |            |

Conical surface Flux(90deg): 2113.1 lm

%lum = 97.2%

%lamp = 97.2%

Conical surface Flux(120deg): 2160.8 lm

%lum = 99.4%


%lamp = 99.4%

C Range: 0 - 360DEG  
 C Interval: 22.5DEG  
 Test Speed: HIGH  
 Temperature:25.3℃  
 Operators:Allen  
 Test Date:2026-01-19

$\gamma$  Range: 0 - 180DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.459  
 Humidity:45%  
 Test Distance:2.900m [K=0.8783]  
 Remarks:

## LUMINANCE LIMITATION CURVES

|                                                                                    |       |                  |
|------------------------------------------------------------------------------------|-------|------------------|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz<br>Lamp Flux:2174.8x1 lm |       |                  |
| NAME:                                                                              | TYPE: | WEIGHT:          |
| SPEC.:                                                                             | DIM.: | SERIAL No.:      |
| MFR.:                                                                              | SUR.: | Shielding Angle: |

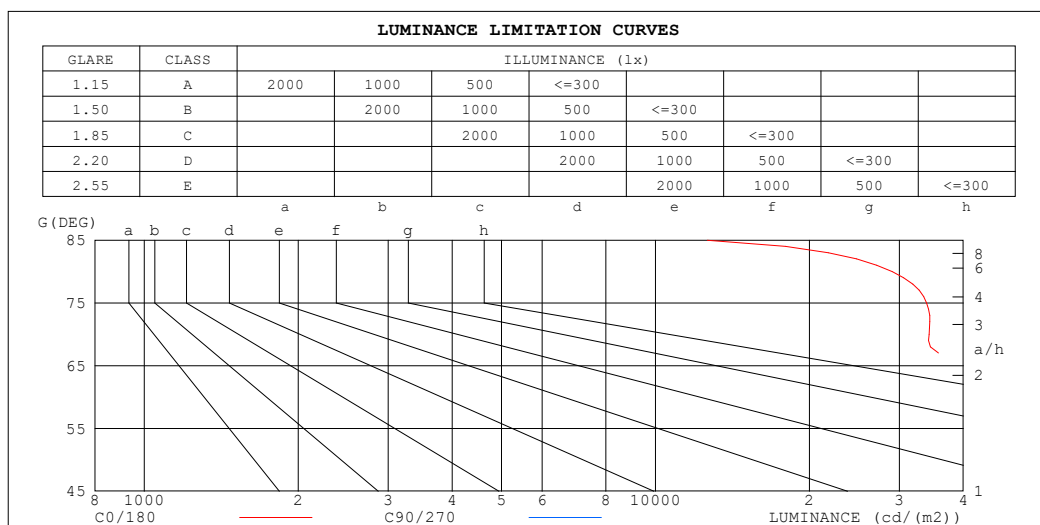

| LUMINANCE cd/(m2) |         |         |
|-------------------|---------|---------|
| G( DEG)           | C0/180  | C90/270 |
| 85                | 12625   | 210333  |
| 80                | 29060   | 120425  |
| 75                | 33925   | 140645  |
| 70                | 34289   | 340687  |
| 65                | 53497   | 638025  |
| 60                | 140644  | 872340  |
| 55                | 393823  | 1073822 |
| 50                | 704986  | 1291092 |
| 45                | 1129582 | 1565328 |

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: HIGH  
Temperature: 25.3℃  
Operators: Allen  
Test Date: 2026-01-19

```


γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

```

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

|                                                           |       |                  |
|-----------------------------------------------------------|-------|------------------|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz |       |                  |
| Lamp Flux:2174.8x1 lm                                     |       |                  |
| NAME:                                                     | TYPE: | WEIGHT:          |
| SPEC.:                                                    | DIM.: | SERIAL No.:      |
| MFR.:                                                     | SUR.: | Shielding Angle: |

| pcc  | 80%                   |      |      | 70%                             |      |      | 50%  |      |      | 30%  |      |      | 10%  |      |      | 0   |
|------|-----------------------|------|------|---------------------------------|------|------|------|------|------|------|------|------|------|------|------|-----|
| pw   | 50%                   | 30%  | 10%  | 50%                             | 30%  | 10%  | 50%  | 30%  | 10%  | 50%  | 30%  | 10%  | 50%  | 30%  | 10%  | 0   |
| pfc  | 20%                   |      |      | 20%                             |      |      | 20%  |      |      | 20%  |      |      | 20%  |      |      | 0   |
| RCR  | RCR:Room Cavity Ratio |      |      | Coefficients of Utilization(CU) |      |      |      |      |      |      |      |      |      |      |      |     |
| 0.0  | 1.19                  | 1.19 | 1.19 | 1.16                            | 1.16 | 1.16 | 1.11 | 1.11 | 1.11 | 1.06 | 1.06 | 1.06 | 1.02 | 1.02 | 1.02 | .00 |
| 1.0  | 1.12                  | 1.10 | 1.08 | 1.10                            | 1.08 | 1.07 | 1.06 | 1.05 | 1.03 | 1.02 | 1.01 | 1.00 | .99  | .98  | .97  | .96 |
| 2.0  | 1.06                  | 1.03 | 1.00 | 1.04                            | 1.02 | .99  | 1.01 | .99  | .97  | .98  | .96  | .95  | .96  | .94  | .93  | .91 |
| 3.0  | 1.01                  | .97  | .94  | .00                             | .96  | .93  | .97  | .94  | .91  | .95  | .92  | .90  | .93  | .90  | .89  | .87 |
| 4.0  | .96                   | .92  | .88  | .95                             | .91  | .88  | .93  | .90  | .87  | .91  | .88  | .86  | .89  | .87  | .85  | .84 |
| 5.0  | .92                   | .87  | .84  | .91                             | .87  | .84  | .89  | .86  | .83  | .88  | .85  | .82  | .86  | .84  | .81  | .80 |
| 6.0  | .88                   | .84  | .80  | .87                             | .83  | .80  | .86  | .82  | .79  | .85  | .81  | .79  | .84  | .81  | .78  | .77 |
| 7.0  | .85                   | .80  | .77  | .84                             | .80  | .77  | .83  | .79  | .76  | .82  | .78  | .76  | .81  | .78  | .75  | .74 |
| 8.0  | .82                   | .77  | .74  | .81                             | .77  | .74  | .80  | .76  | .73  | .79  | .76  | .73  | .78  | .75  | .73  | .72 |
| 9.0  | .79                   | .74  | .71  | .78                             | .74  | .71  | .77  | .73  | .71  | .77  | .73  | .70  | .76  | .73  | .70  | .69 |
| 10.0 | .76                   | .72  | .69  | .76                             | .71  | .68  | .75  | .71  | .68  | .74  | .71  | .68  | .74  | .70  | .68  | .67 |

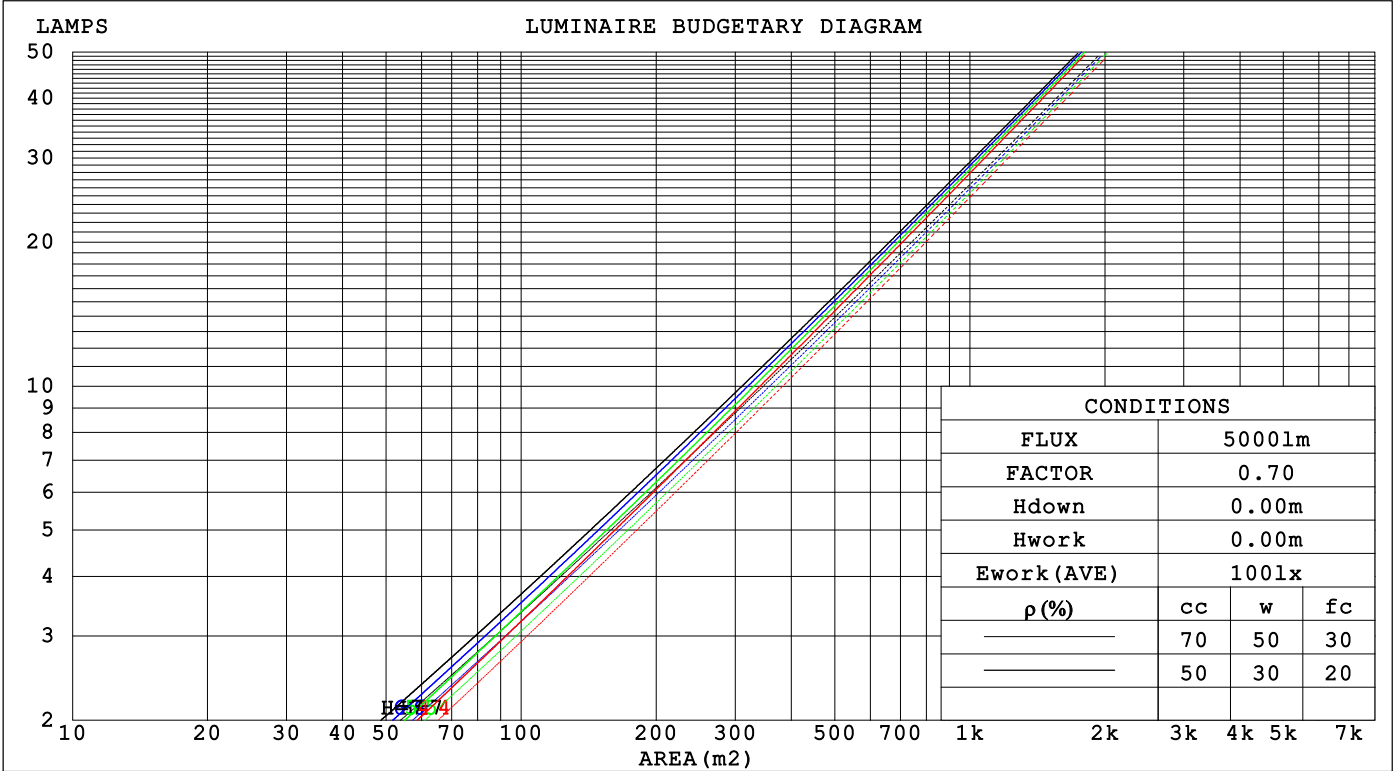

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-19

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

## WEC AND CCEC

|                                                                                    |  |       |  |                  |  |
|------------------------------------------------------------------------------------|--|-------|--|------------------|--|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz<br>Lamp Flux:2174.8x1 lm |  |       |  |                  |  |
| NAME:                                                                              |  | TYPE: |  | WEIGHT:          |  |
| SPEC.:                                                                             |  | DIM.: |  | SERIAL No.:      |  |
| MFR.:                                                                              |  | SUR.: |  | Shielding Angle: |  |

| pcc  | 80%                   |      |      | 70%  |      |      | 50%                             |      |      | 30%  |      |      | 10%  |      |      | 0 |
|------|-----------------------|------|------|------|------|------|---------------------------------|------|------|------|------|------|------|------|------|---|
| pw   | 50%                   | 30%  | 10%  | 50%  | 30%  | 10%  | 50%                             | 30%  | 10%  | 50%  | 30%  | 10%  | 50%  | 30%  | 10%  | 0 |
| pfc  | 20%                   |      |      | 20%  |      |      | 20%                             |      |      | 20%  |      |      | 20%  |      |      | 0 |
| RCR  | RCR:Room Cavity Ratio |      |      |      |      |      | Wall Exitance Coefficients(WEC) |      |      |      |      |      |      |      |      |   |
| 0.0  |                       |      |      |      |      |      |                                 |      |      |      |      |      |      |      |      |   |
| 1.0  | .150                  | .085 | .027 | .143 | .081 | .026 | .130                            | .075 | .024 | .119 | .068 | .022 | .108 | .063 | .020 |   |
| 2.0  | .140                  | .077 | .024 | .135 | .074 | .023 | .124                            | .069 | .021 | .115 | .064 | .020 | .106 | .060 | .019 |   |
| 3.0  | .132                  | .070 | .021 | .127 | .068 | .020 | .118                            | .064 | .019 | .110 | .060 | .019 | .103 | .057 | .018 |   |
| 4.0  | .124                  | .064 | .019 | .120 | .063 | .019 | .113                            | .060 | .018 | .106 | .057 | .017 | .099 | .054 | .016 |   |
| 5.0  | .117                  | .060 | .017 | .114 | .058 | .017 | .108                            | .056 | .016 | .102 | .054 | .016 | .096 | .051 | .015 |   |
| 6.0  | .111                  | .056 | .016 | .108 | .055 | .016 | .103                            | .053 | .015 | .098 | .051 | .015 | .093 | .049 | .015 |   |
| 7.0  | .106                  | .052 | .015 | .103 | .051 | .015 | .098                            | .050 | .014 | .094 | .048 | .014 | .090 | .047 | .014 |   |
| 8.0  | .101                  | .049 | .014 | .099 | .049 | .014 | .094                            | .047 | .013 | .090 | .046 | .013 | .087 | .044 | .013 |   |
| 9.0  | .097                  | .047 | .013 | .095 | .046 | .013 | .091                            | .045 | .013 | .087 | .044 | .013 | .084 | .043 | .012 |   |
| 10.0 | .093                  | .044 | .012 | .091 | .044 | .012 | .087                            | .043 | .012 | .084 | .042 | .012 | .081 | .041 | .012 |   |

| pcc  | 80%                   |      |      | 70%  |      |      | 50%                                        |      |      | 30%  |      |      | 10%  |      |      | 0 |
|------|-----------------------|------|------|------|------|------|--------------------------------------------|------|------|------|------|------|------|------|------|---|
| pw   | 50%                   | 30%  | 10%  | 50%  | 30%  | 10%  | 50%                                        | 30%  | 10%  | 50%  | 30%  | 10%  | 50%  | 30%  | 10%  | 0 |
| pfc  | 20%                   |      |      | 20%  |      |      | 20%                                        |      |      | 20%  |      |      | 20%  |      |      | 0 |
| RCR  | RCR:Room Cavity Ratio |      |      |      |      |      | Ceiling Cavity Exitance Coefficients(CCEC) |      |      |      |      |      |      |      |      |   |
| 0.0  | .192                  | .192 | .192 | .164 | .164 | .164 | .112                                       | .112 | .112 | .064 | .064 | .064 | .021 | .021 | .021 |   |
| 1.0  | .171                  | .159 | .148 | .146 | .136 | .128 | .100                                       | .094 | .088 | .057 | .054 | .051 | .018 | .017 | .017 |   |
| 2.0  | .153                  | .134 | .118 | .131 | .115 | .102 | .090                                       | .080 | .071 | .052 | .046 | .042 | .017 | .015 | .014 |   |
| 3.0  | .139                  | .115 | .095 | .119 | .099 | .082 | .082                                       | .069 | .058 | .047 | .040 | .034 | .015 | .013 | .011 |   |
| 4.0  | .127                  | .100 | .078 | .109 | .086 | .068 | .075                                       | .060 | .048 | .043 | .035 | .028 | .014 | .011 | .009 |   |
| 5.0  | .117                  | .087 | .065 | .101 | .076 | .057 | .069                                       | .053 | .040 | .040 | .031 | .024 | .013 | .010 | .008 |   |
| 6.0  | .109                  | .078 | .055 | .094 | .067 | .048 | .065                                       | .047 | .034 | .037 | .028 | .020 | .012 | .009 | .007 |   |
| 7.0  | .102                  | .070 | .047 | .087 | .060 | .041 | .060                                       | .042 | .029 | .035 | .025 | .017 | .011 | .008 | .006 |   |
| 8.0  | .095                  | .063 | .041 | .082 | .055 | .036 | .057                                       | .038 | .025 | .033 | .023 | .015 | .011 | .007 | .005 |   |
| 9.0  | .090                  | .058 | .036 | .077 | .050 | .031 | .054                                       | .035 | .022 | .031 | .021 | .013 | .010 | .007 | .004 |   |
| 10.0 | .085                  | .053 | .031 | .073 | .046 | .027 | .051                                       | .032 | .019 | .030 | .019 | .012 | .010 | .006 | .004 |   |

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: HIGH  
Temperature:25.3℃  
Operators:Allen  
Test Date:2026-01-19

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.459  
Humidity:45%  
Test Distance:2.900m [K=0.8783]  
Remarks:

UGR(Unified Glare Rating) Table

|                                                                                    |                  |      |       |      |      |                  |      |      |      |      |
|------------------------------------------------------------------------------------|------------------|------|-------|------|------|------------------|------|------|------|------|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz<br>Lamp Flux:2174.8x1 lm |                  |      |       |      |      |                  |      |      |      |      |
| NAME:                                                                              |                  |      | TYPE: |      |      | WEIGHT:          |      |      |      |      |
| SPEC.:                                                                             |                  |      | DIM.: |      |      | SERIAL No.:      |      |      |      |      |
| MFR.:                                                                              |                  |      | SUR.: |      |      | Shielding Angle: |      |      |      |      |
| ceiling/cavity                                                                     | 0.7              | 0.7  | 0.5   | 0.5  | 0.3  | 0.7              | 0.7  | 0.5  | 0.5  | 0.3  |
| walls                                                                              | 0.5              | 0.3  | 0.5   | 0.3  | 0.3  | 0.5              | 0.3  | 0.5  | 0.3  | 0.3  |
| working plane                                                                      | 0.2              | 0.2  | 0.2   | 0.2  | 0.2  | 0.2              | 0.2  | 0.2  | 0.2  | 0.2  |
| Room dimensions                                                                    | Viewed crosswise |      |       |      |      | Viewed endwise   |      |      |      |      |
| x = 2H y = 2H                                                                      | 27.5             | 28.2 | 27.7  | 28.4 | 28.5 | 28.7             | 29.4 | 28.9 | 29.6 | 29.7 |
| 3H                                                                                 | 27.3             | 28.0 | 27.6  | 28.2 | 28.4 | 28.9             | 29.6 | 29.1 | 29.8 | 30.0 |
| 4H                                                                                 | 27.3             | 27.9 | 27.5  | 28.1 | 28.3 | 28.8             | 29.5 | 29.1 | 29.7 | 29.9 |
| 6H                                                                                 | 27.2             | 27.8 | 27.5  | 28.0 | 28.3 | 28.8             | 29.4 | 29.1 | 29.6 | 29.9 |
| 8H                                                                                 | 27.1             | 27.7 | 27.4  | 28.0 | 28.2 | 28.7             | 29.3 | 29.0 | 29.6 | 29.8 |
| 12H                                                                                | 27.1             | 27.7 | 27.4  | 27.9 | 28.2 | 28.7             | 29.3 | 29.0 | 29.5 | 29.8 |
| 4H 2H                                                                              | 27.6             | 28.2 | 27.8  | 28.4 | 28.7 | 28.7             | 29.3 | 28.9 | 29.5 | 29.7 |
| 3H                                                                                 | 27.4             | 28.0 | 27.7  | 28.3 | 28.5 | 28.9             | 29.5 | 29.2 | 29.7 | 30.0 |
| 4H                                                                                 | 27.3             | 27.9 | 27.7  | 28.2 | 28.5 | 28.8             | 29.4 | 29.2 | 29.6 | 30.0 |
| 6H                                                                                 | 27.2             | 27.7 | 27.6  | 28.0 | 28.4 | 28.8             | 29.2 | 29.1 | 29.6 | 29.9 |
| 8H                                                                                 | 27.2             | 27.6 | 27.6  | 28.0 | 28.3 | 28.7             | 29.2 | 29.1 | 29.5 | 29.9 |
| 12H                                                                                | 27.1             | 27.5 | 27.6  | 27.9 | 28.3 | 28.7             | 29.1 | 29.1 | 29.5 | 29.9 |
| 8H 4H                                                                              | 27.2             | 27.6 | 27.6  | 28.0 | 28.4 | 28.7             | 29.1 | 29.1 | 29.5 | 29.8 |
| 6H                                                                                 | 27.1             | 27.5 | 27.6  | 27.9 | 28.3 | 28.6             | 29.0 | 29.1 | 29.4 | 29.8 |
| 8H                                                                                 | 27.1             | 27.4 | 27.5  | 27.8 | 28.2 | 28.6             | 28.9 | 29.0 | 29.3 | 29.8 |
| 12H                                                                                | 27.0             | 27.3 | 27.5  | 27.7 | 28.2 | 28.6             | 28.9 | 29.1 | 29.3 | 29.8 |
| 12H 4H                                                                             | 27.2             | 27.6 | 27.6  | 27.9 | 28.3 | 28.6             | 29.0 | 29.0 | 29.4 | 29.8 |
| 6H                                                                                 | 27.1             | 27.4 | 27.5  | 27.8 | 28.2 | 28.6             | 28.9 | 29.0 | 29.3 | 29.7 |
| 8H                                                                                 | 27.0             | 27.3 | 27.5  | 27.7 | 28.2 | 28.6             | 28.8 | 29.0 | 29.3 | 29.7 |
| Variations with the observer position at spacings(CIE Pub.117):                    |                  |      |       |      |      |                  |      |      |      |      |
| S = 1.0H                                                                           | + 2.2 / - 5.1    |      |       |      |      | + 1.0 / - 1.6    |      |      |      |      |
| 1.5H                                                                               | + 2.8 / - 3.6    |      |       |      |      | + 1.1 / - 0.7    |      |      |      |      |
| 2.0H                                                                               | + 3.2 / - 8.3    |      |       |      |      | + 1.8 / - 2.6    |      |      |      |      |

CIE Pub.117, 2175 lm Total Lamp Luminous Flux Correct ( $8\log(F/F_0) = 2.7$ )  
Area: 0.0001 m<sup>2</sup>

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: HIGH  
Temperature:25.3℃  
Operators:Allen  
Test Date:2026-01-19

$\gamma$  Range: 0 - 180DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.459  
Humidity:45%  
Test Distance:2.900m [K=0.8783]  
Remarks:

## UTILIZATION FACTORS TABLE

|                                                                                    |       |                  |
|------------------------------------------------------------------------------------|-------|------------------|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz<br>Lamp Flux:2174.8x1 lm |       |                  |
| NAME:                                                                              | TYPE: | WEIGHT:          |
| SPEC.:                                                                             | DIM.: | SERIAL No.:      |
| MFR.:                                                                              | SUR.: | Shielding Angle: |


| REFLECTANCE                      |                                                      |     |           |     |     |     |     |               |     |        |
|----------------------------------|------------------------------------------------------|-----|-----------|-----|-----|-----|-----|---------------|-----|--------|
| Ceiling                          | 0.8                                                  | 0.8 | 0.8       | 0.7 | 0.7 | 0.7 | 0.5 | 0.5           | 0.5 | 0      |
| Walls                            | 0.7                                                  | 0.5 | 0.3       | 0.7 | 0.5 | 0.3 | 0.7 | 0.5           | 0.3 | 0      |
| Working plane                    | 0.2                                                  | 0.2 | 0.2       | 0.2 | 0.2 | 0.2 | 0.2 | 0.2           | 0.2 | 0      |
| ROOM INDEX                       | UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$ |     |           |     |     |     |     |               |     |        |
| $k = 0.60$                       | 89                                                   | 83  | 79        | 88  | 83  | 79  | 87  | 82            | 79  | 75     |
| 0.80                             | 96                                                   | 90  | 87        | 95  | 90  | 87  | 94  | 90            | 86  | 83     |
| 1.00                             | 100                                                  | 95  | 91        | 99  | 94  | 91  | 98  | 94            | 91  | 87     |
| 1.25                             | 104                                                  | 99  | 96        | 103 | 99  | 95  | 101 | 97            | 95  | 91     |
| 1.50                             | 107                                                  | 102 | 99        | 105 | 101 | 98  | 103 | 100           | 97  | 93     |
| 2.00                             | 109                                                  | 105 | 102       | 108 | 104 | 101 | 105 | 102           | 100 | 95     |
| 2.50                             | 111                                                  | 107 | 104       | 109 | 106 | 103 | 106 | 103           | 101 | 95     |
| 3.00                             | 112                                                  | 109 | 106       | 110 | 107 | 105 | 107 | 105           | 103 | 97     |
| 4.00                             | 114                                                  | 111 | 109       | 112 | 110 | 108 | 108 | 107           | 105 | 98     |
| 5.00                             | 115                                                  | 113 | 111       | 113 | 111 | 110 | 109 | 108           | 107 | 99     |
| ROOM INDEX                       | UF (total)                                           |     |           |     |     |     |     |               |     | Direct |
| According to DIN EN 13032-2 2004 |                                                      |     | Suspended |     |     |     |     | SHRNOM = 1.25 |     |        |

C Range: 0 - 360DEG  
 C Interval: 22.5DEG  
 Test Speed: HIGH  
 Temperature: 25.3℃  
 Operators: Allen  
 Test Date: 2026-01-19

γ Range: 0 - 180DEG  
 γ Interval: 1.0DEG  
 Test System: EVERFINE GO-R5000\_V2 SYSTEM V2.00.459  
 Humidity: 45%  
 Test Distance: 2.900m [K=0.8783]  
 Remarks:

ISOCANDELA DIAGRAM

|                                                                                    |       |                  |
|------------------------------------------------------------------------------------|-------|------------------|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz<br>Lamp Flux:2174.8x1 lm |       |                  |
| NAME:                                                                              | TYPE: | WEIGHT:          |
| SPEC.:                                                                             | DIM.: | SERIAL No.:      |
| MFR.:                                                                              | SUR.: | Shielding Angle: |

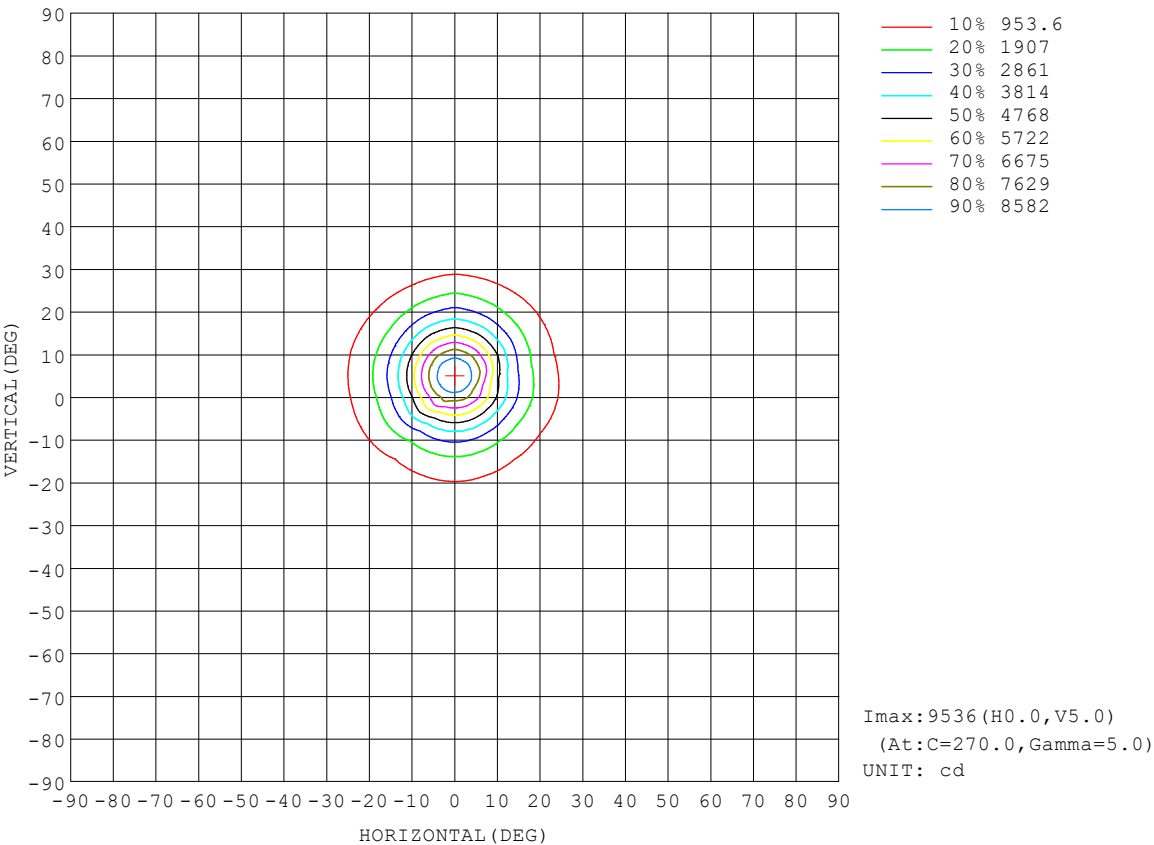


|                      |                                                   |
|----------------------|---------------------------------------------------|
| C Range: 0 - 360DEG  | γ Range: 0 - 180DEG                               |
| C Interval: 22.5DEG  | γ Interval: 1.0DEG                                |
| Test Speed: HIGH     | Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459 |
| Temperature:25.3℃    | Humidity:45%                                      |
| Operators:Allen      | Test Distance:2.900m [K=0.8783]                   |
| Test Date:2026-01-19 | Remarks:                                          |



## AAI Figure

|                                                                                    |       |                  |
|------------------------------------------------------------------------------------|-------|------------------|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz<br>Lamp Flux:2174.8x1 lm |       |                  |
| NAME:                                                                              | TYPE: | WEIGHT:          |
| SPEC.:                                                                             | DIM.: | SERIAL No.:      |
| MFR.:                                                                              | SUR.: | Shielding Angle: |

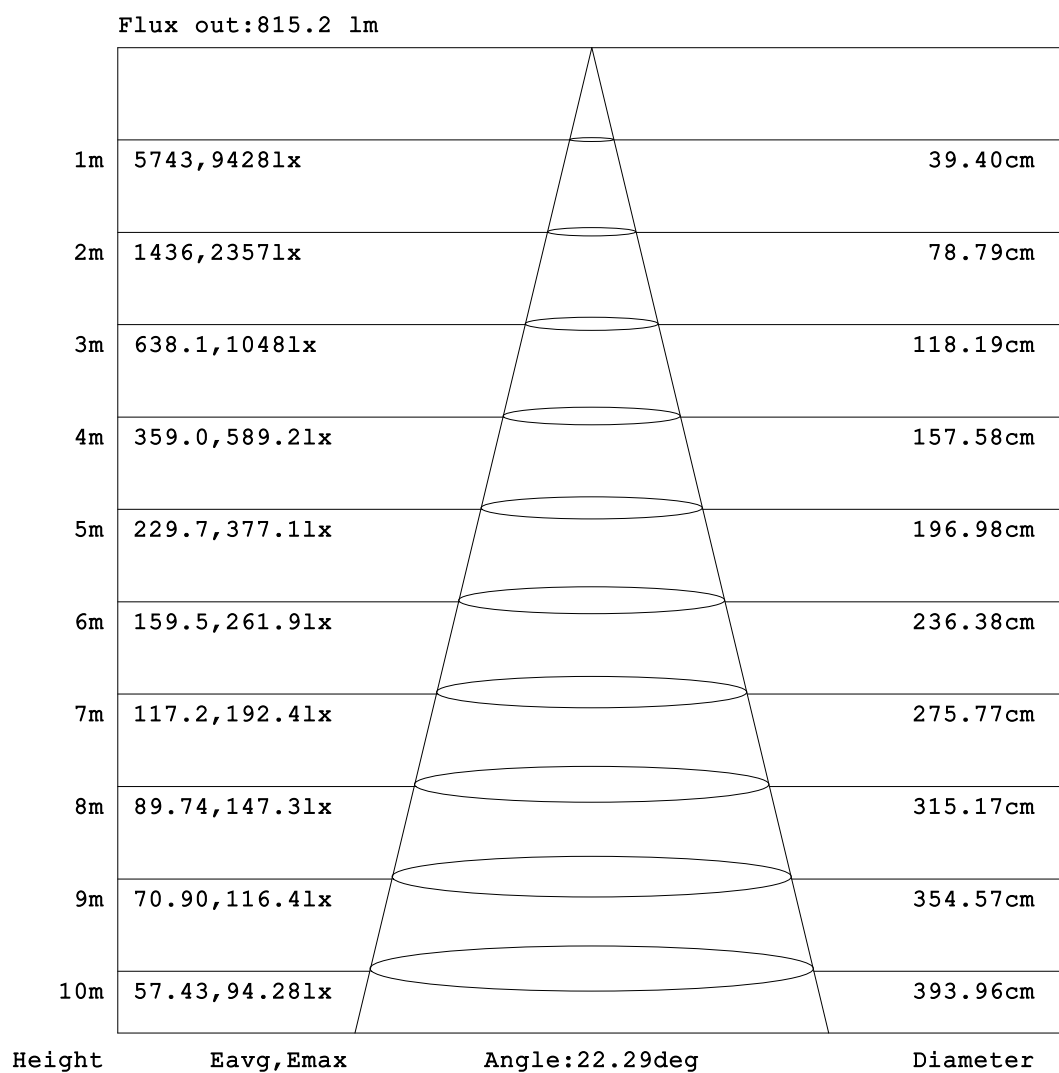


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: HIGH  
Temperature:25.3℃  
Operators:Allen  
Test Date:2026-01-19

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.459  
Humidity:45%  
Test Distance:2.900m [K=0.8783]  
Remarks:

ISOLUX DIAGRAM


|                                                                                    |       |                  |
|------------------------------------------------------------------------------------|-------|------------------|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz<br>Lamp Flux:2174.8x1 lm |       |                  |
| NAME:                                                                              | TYPE: | WEIGHT:          |
| SPEC.:                                                                             | DIM.: | SERIAL No.:      |
| MFR.:                                                                              | SUR.: | Shielding Angle: |

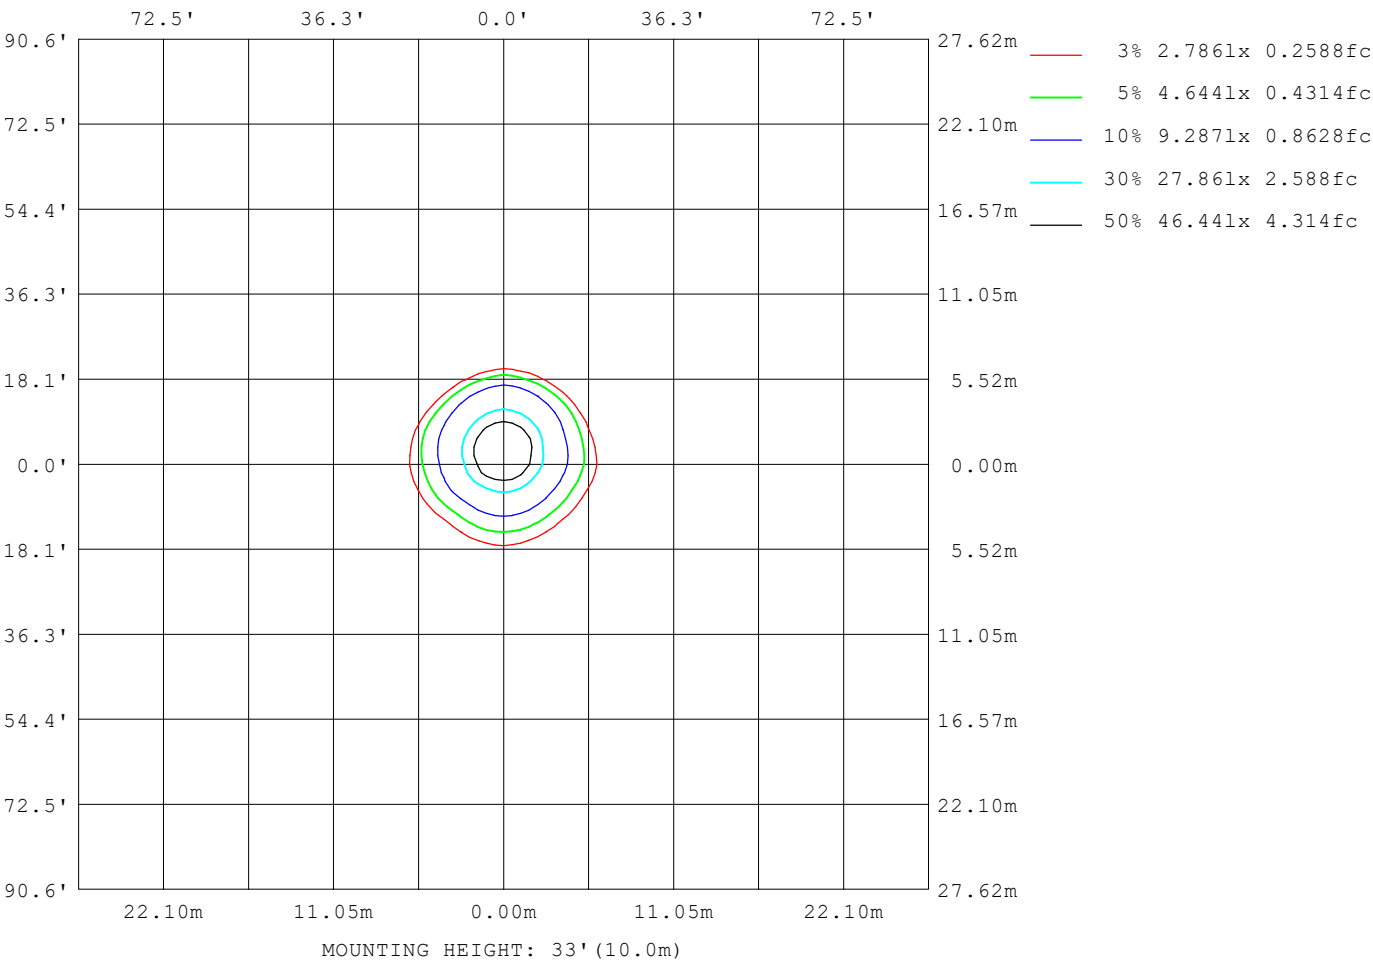

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: HIGH  
Temperature:25.3℃  
Operators:Allen  
Test Date:2026-01-19

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.459  
Humidity:45%  
Test Distance:2.900m [K=0.8783]  
Remarks:

Planar Illuminance Curve

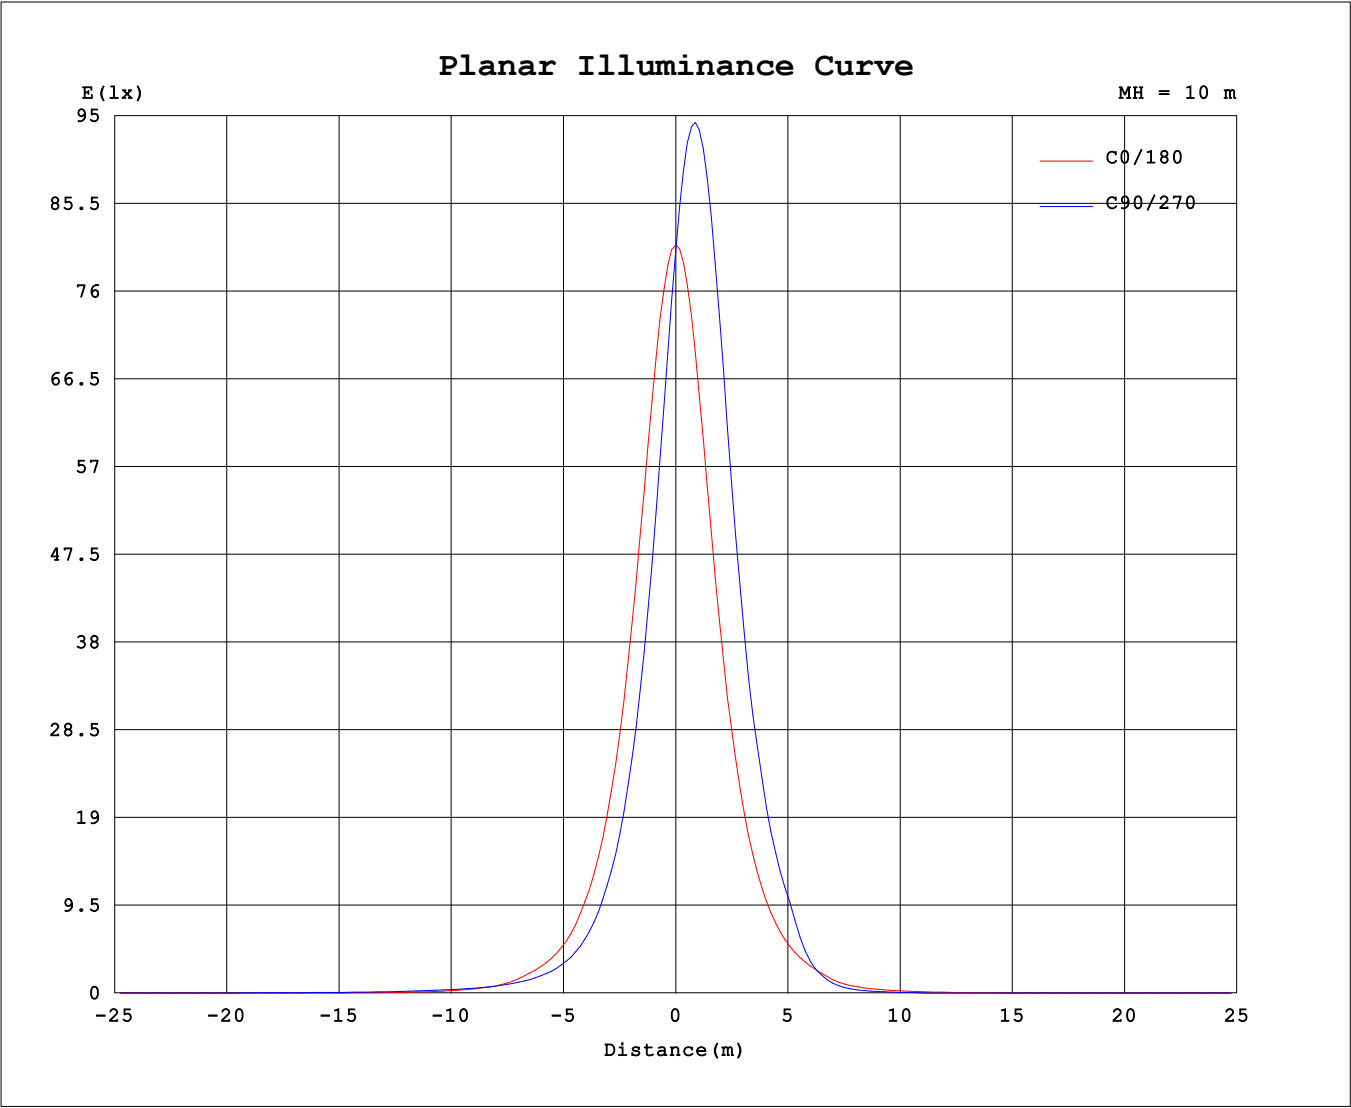

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: HIGH  
Temperature:25.3℃  
Operators:Allen  
Test Date:2026-01-19

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.459  
Humidity:45%  
Test Distance:2.900m [K=0.8783]  
Remarks:

## LUMINOUS DISTRIBUTION INTENSITY DATA

|                                                                                    |  |  |  |  |  |  |  |  |       |  |  |  |  |  |                  |  |  |
|------------------------------------------------------------------------------------|--|--|--|--|--|--|--|--|-------|--|--|--|--|--|------------------|--|--|
| Test:U:12.000V I:2.6709A P:27.100W PF:0.8727 Freq:60.00Hz<br>Lamp Flux:2174.8x1 lm |  |  |  |  |  |  |  |  |       |  |  |  |  |  |                  |  |  |
| NAME:                                                                              |  |  |  |  |  |  |  |  | TYPE: |  |  |  |  |  | WEIGHT:          |  |  |
| SPEC.:                                                                             |  |  |  |  |  |  |  |  | DIM.: |  |  |  |  |  | SERIAL No.:      |  |  |
| MFR.:                                                                              |  |  |  |  |  |  |  |  | SUR.: |  |  |  |  |  | Shielding Angle: |  |  |

Table--1

UNIT: cd

| C (DEG)<br>γ (DEG) | 0    | 22.5 | 45   | 67.5 | 90   | 112.5 | 135  | 157.5 | 180  | 202.5 | 225  | 247.5 | 270  | 292.5 | 315  | 337.5 |  |  |  |
|--------------------|------|------|------|------|------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|--|--|--|
| 0                  | 8100 | 8087 | 8089 | 8057 | 8048 | 8058  | 8059 | 8208  | 8100 | 8087  | 8089 | 8057  | 8048 | 8058  | 8059 | 8208  |  |  |  |
| 5                  | 6951 | 6196 | 5676 | 5357 | 5256 | 5363  | 5667 | 6671  | 7010 | 7876  | 8703 | 9324  | 9536 | 9294  | 8666 | 7506  |  |  |  |
| 10                 | 4665 | 3822 | 3328 | 3079 | 3018 | 3090  | 3319 | 4255  | 4713 | 5809  | 6928 | 7888  | 8270 | 7866  | 6906 | 5283  |  |  |  |
| 15                 | 2750 | 2138 | 1808 | 1686 | 1671 | 1691  | 1795 | 2400  | 2815 | 3563  | 4337 | 5113  | 5491 | 5112  | 4347 | 3215  |  |  |  |
| 20                 | 1553 | 1179 | 962  | 915  | 923  | 920   | 958  | 1318  | 1573 | 2031  | 2415 | 2914  | 3209 | 2936  | 2430 | 1794  |  |  |  |
| 25                 | 872  | 639  | 527  | 513  | 531  | 520   | 526  | 712   | 892  | 1130  | 1294 | 1555  | 1770 | 1576  | 1298 | 989   |  |  |  |
| 30                 | 508  | 375  | 313  | 310  | 326  | 314   | 310  | 407   | 520  | 591   | 513  | 559   | 706  | 609   | 562  | 518   |  |  |  |
| 35                 | 287  | 241  | 208  | 205  | 215  | 206   | 201  | 251   | 268  | 210   | 166  | 162   | 200  | 178   | 181  | 196   |  |  |  |
| 40                 | 144  | 161  | 150  | 147  | 151  | 145   | 142  | 161   | 131  | 94.7  | 70.1 | 62.9  | 65.7 | 64.1  | 73.8 | 90.1  |  |  |  |
| 45                 | 79.9 | 103  | 113  | 110  | 111  | 107   | 106  | 102   | 73.4 | 50.4  | 35.7 | 27.6  | 27.4 | 28.2  | 37.1 | 48.5  |  |  |  |
| 50                 | 45.3 | 66.0 | 81.3 | 83.9 | 83.0 | 81.0  | 75.6 | 66.8  | 42.2 | 25.1  | 10.2 | 3.32  | 3.51 | 3.72  | 10.6 | 22.6  |  |  |  |
| 55                 | 22.6 | 39.5 | 54.9 | 62.4 | 61.6 | 59.7  | 50.3 | 40.7  | 21.1 | 6.50  | 1.38 | 0.04  | 0.00 | 0.01  | 1.32 | 4.80  |  |  |  |
| 60                 | 7.03 | 20.1 | 32.9 | 41.7 | 43.6 | 39.5  | 29.8 | 21.4  | 6.69 | 1.55  | 0.33 | 0.00  | 0.00 | 0.00  | 0.25 | 0.96  |  |  |  |
| 65                 | 2.26 | 7.35 | 16.4 | 23.6 | 27.0 | 21.7  | 14.3 | 8.16  | 2.20 | 0.77  | 0.21 | 0.00  | 0.00 | 0.00  | 0.13 | 0.64  |  |  |  |
| 70                 | 1.17 | 2.74 | 6.09 | 10.6 | 11.7 | 9.21  | 5.02 | 2.78  | 1.14 | 0.54  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.40  |  |  |  |
| 75                 | 0.88 | 1.56 | 2.57 | 3.53 | 3.64 | 2.93  | 1.92 | 1.39  | 0.86 | 0.20  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.05  |  |  |  |
| 80                 | 0.50 | 1.23 | 1.89 | 2.20 | 2.09 | 1.78  | 1.45 | 1.09  | 0.52 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 85                 | 0.11 | 0.86 | 1.54 | 1.91 | 1.83 | 1.52  | 1.15 | 0.78  | 0.16 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 90                 | 0.00 | 0.46 | 1.14 | 1.52 | 1.49 | 1.19  | 0.82 | 0.46  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 95                 | 0.00 | 0.11 | 0.71 | 1.10 | 1.10 | 0.83  | 0.52 | 0.17  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 100                | 0.00 | 0.00 | 0.32 | 0.68 | 0.71 | 0.51  | 0.25 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 105                | 0.00 | 0.00 | 0.00 | 0.29 | 0.35 | 0.23  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 110                | 0.00 | 0.00 | 0.00 | 0.00 | 0.06 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 115                | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 120                | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 125                | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.00  |  |  |  |
| 130                | 0.00 | 0.01 | 0.04 | 0.07 | 0.08 | 0.08  | 0.05 | 0.00  | 0.04 | 0.01  | 0.00 | 0.00  | 0.00 | 0.00  | 0.00 | 0.05  |  |  |  |
| 135                | 0.15 | 0.22 | 0.30 | 0.36 | 0.39 | 0.39  | 0.34 | 0.20  | 0.33 | 0.25  | 0.20 | 0.17  | 0.16 | 0.17  | 0.20 | 0.34  |  |  |  |
| 140                | 0.51 | 0.64 | 0.78 | 0.88 | 0.93 | 0.94  | 0.87 | 0.61  | 0.90 | 0.74  | 0.63 | 0.56  | 0.53 | 0.56  | 0.64 | 0.90  |  |  |  |
| 145                | 0.87 | 1.02 | 1.17 | 1.28 | 1.36 | 1.40  | 1.39 | 1.16  | 1.74 | 1.54  | 1.35 | 1.21  | 1.16 | 1.21  | 1.34 | 1.74  |  |  |  |
| 150                | 1.08 | 1.17 | 1.26 | 1.36 | 1.46 | 1.56  | 1.62 | 1.52  | 2.62 | 2.46  | 2.25 | 2.08  | 2.02 | 2.09  | 2.28 | 2.76  |  |  |  |
| 155                | 1.35 | 1.37 | 1.41 | 1.48 | 1.57 | 1.68  | 1.78 | 1.78  | 3.50 | 3.44  | 3.32 | 3.20  | 3.15 | 3.23  | 3.41 | 3.83  |  |  |  |
| 160                | 1.42 | 1.40 | 1.44 | 1.50 | 1.60 | 1.72  | 1.83 | 1.91  | 4.06 | 4.08  | 4.12 | 4.12  | 4.12 | 4.18  | 4.31 | 4.54  |  |  |  |
| 165                | 1.36 | 1.36 | 1.41 | 1.48 | 1.59 | 1.72  | 1.84 | 1.93  | 3.99 | 4.03  | 4.24 | 4.39  | 4.50 | 4.60  | 4.70 | 4.77  |  |  |  |
| 170                | 1.39 | 1.38 | 1.41 | 1.48 | 1.59 | 1.75  | 1.91 | 2.01  | 3.57 | 3.60  | 3.93 | 4.22  | 4.45 | 4.61  | 4.69 | 4.63  |  |  |  |
| 175                | 1.57 | 1.64 | 1.73 | 1.86 | 1.98 | 2.11  | 2.23 | 2.20  | 2.91 | 2.93  | 3.29 | 3.65  | 3.94 | 4.13  | 4.23 | 3.99  |  |  |  |
| 180                | 2.04 | 2.28 | 2.57 | 2.84 | 3.08 | 3.17  | 3.19 | 2.90  | 2.04 | 2.05  | 2.29 | 2.57  | 2.83 | 3.05  | 3.15 | 2.97  |  |  |  |

C Range: 0 - 360DEG  
C Interval: 22.5DEG  
Test Speed: HIGH  
Temperature:25.3℃  
Operators:Allen  
Test Date:2026-01-19

γ Range: 0 - 180DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-R5000\_V2 SYSTEM V2.00.459  
Humidity:45%  
Test Distance:2.900m [K=0.8783]  
Remarks: