


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz Lamp Flux:2077.07x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 76.93 lm/W			
MODEL		Imax (cd)	5301	S/MH(C0/180)	0.55
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.70
RATED VOLTAGE(V)		TOTAL FLUX(lm)	2077.1	η UP,DN(C0-180)	0.1,41.2
NOMINAL FLUX(lm)	2077.07	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,58.6
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.50
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.55

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

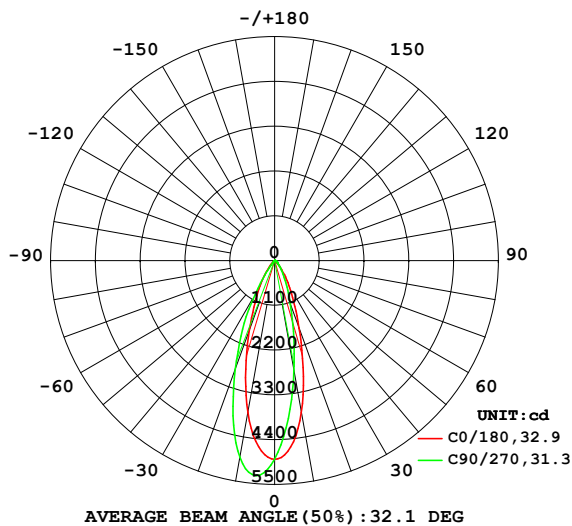

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

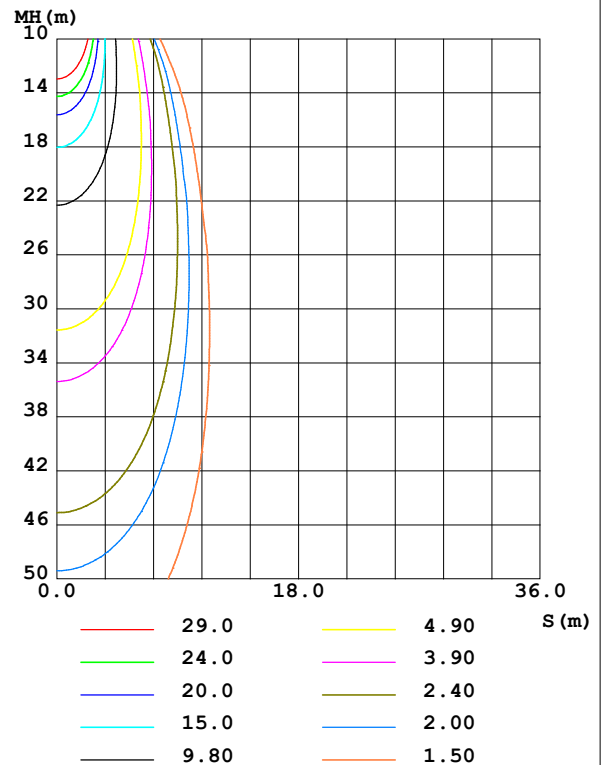

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	3794	3051	2755	3025	3798	4619	4913	4652	0- 10	413.9	413.9	19.9,19.9
20	1768	1264	1142	1245	1815	2490	2836	2552	10- 20	772.8	1187	57.1,57.1
30	702.1	460.3	470.1	451.7	726.8	793.9	973.3	849.8	20- 30	550.1	1737	83.6,83.6
40	213.7	201.1	211.5	189.7	201.2	105.9	113.8	106.2	30- 40	223.2	1960	94.4,94.4
50	51.53	93.96	102.3	85.55	48.77	11.13	3.899	11.37	40- 50	74.56	2035	98,98
60	8.096	35.19	48.89	31.57	7.634	0.4468	0	0.3483	50- 60	27.46	2062	99.3,99.3
70	1.525	7.182	13.10	5.880	1.468	0	0	0	60- 70	8.888	2071	99.7,99.7
80	0.6842	2.411	2.665	1.844	0.7015	0	0	0	70- 80	1.899	2073	99.8,99.8
90	0	1.471	1.928	1.074	0	0	0	0	80- 90	0.8649	2074	99.8,99.8
100	0	0.4389	0.9318	0.3511	0	0	0	0	90-100	0.4114	2074	99.9,99.9
110	0	0	0.1112	0	0	0	0	0	100-110	0.0966	2074	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0.0008	2074	99.9,99.9
130	0.0268	0.0818	0.1057	0.0965	0.1049	0.0491	0.0371	0.0500	120-130	0.0066	2074	99.9,99.9
140	0.5009	0.6577	0.7348	0.7175	0.9269	0.7248	0.6404	0.7368	130-140	0.2552	2074	99.9,99.9
150	0.9321	1.087	1.227	1.281	2.200	1.991	1.860	2.036	140-150	0.7128	2075	99.9,99.9
160	1.375	1.448	1.584	1.731	3.261	3.278	3.300	3.450	150-160	0.9395	2076	100,100
170	1.479	1.521	1.686	1.902	3.086	3.266	3.582	3.774	160-170	0.7208	2077	100,100
180	2.196	2.539	2.883	2.969	2.181	2.348	2.696	2.921	170-180	0.2476	2077	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 2006.5 lm

%lum = 96.6%

%lamp = 96.6%

Conical surface Flux(120deg): 2062 lm

%lum = 99.3%


%lamp = 99.3%

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz Lamp Flux:2077.07x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

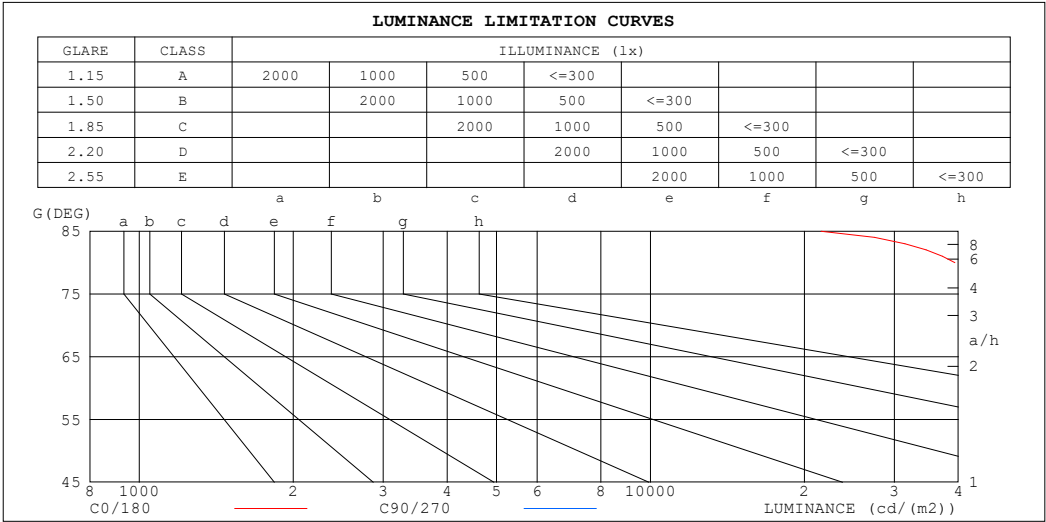

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	21572	269831
80	39399	153473
75	44477	172542
70	44590	382912
65	66212	703762
60	161913	977874
55	419297	1247560
50	801695	1591571
45	1544500	2072917


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz		
Lamp Flux:2077.07x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.09	1.07	1.09	1.07	1.06	1.05	1.04	1.02	1.02	1.00	.99	.98	.97	.96	.95
2.0	1.05	1.01	.98	1.03	.00	.97	1.00	.97	.95	.97	.95	.93	.94	.93	.91	.90
3.0	.99	.95	.91	.98	.94	.90	.95	.92	.89	.93	.90	.88	.90	.88	.86	.85
4.0	.94	.89	.85	.93	.88	.85	.90	.87	.84	.88	.85	.83	.87	.84	.82	.80
5.0	.89	.84	.80	.88	.83	.80	.86	.82	.79	.85	.81	.78	.83	.80	.78	.76
6.0	.85	.79	.76	.84	.79	.75	.82	.78	.75	.81	.77	.74	.80	.76	.74	.73
7.0	.81	.75	.72	.80	.75	.72	.79	.74	.71	.78	.74	.71	.77	.73	.70	.69
8.0	.77	.72	.68	.76	.72	.68	.75	.71	.68	.74	.70	.68	.74	.70	.67	.66
9.0	.74	.69	.65	.73	.68	.65	.72	.68	.65	.71	.67	.65	.71	.67	.64	.63
10.0	.71	.66	.62	.70	.65	.62	.69	.65	.62	.69	.65	.62	.68	.64	.62	.61

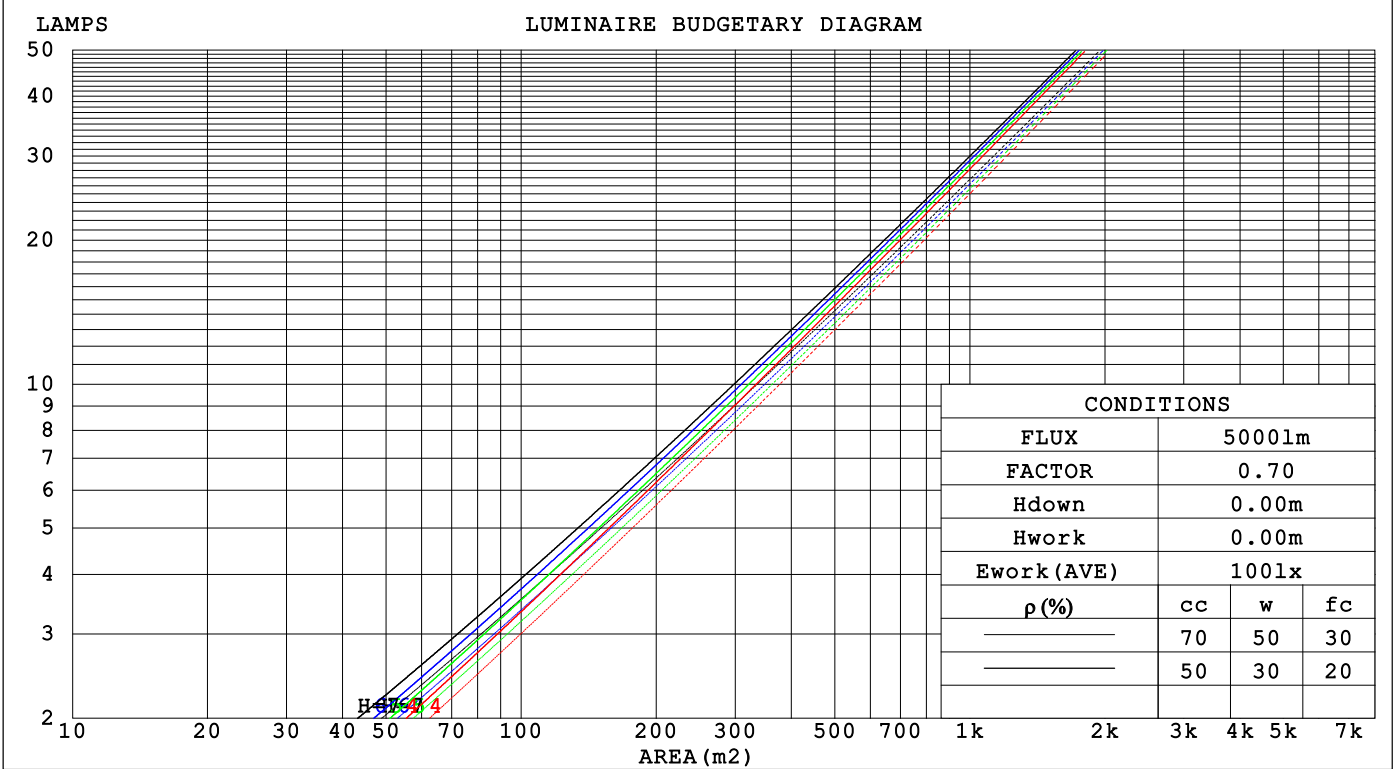

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-19

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz Lamp Flux:2077.07x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.161	.092	.029	.154	.088	.028	.142	.081	.026	.130	.075	.024	.119	.069	.022															
2.0	.152	.083	.026	.147	.081	.025	.136	.076	.024	.127	.071	.022	.118	.066	.021															
3.0	.144	.077	.023	.139	.075	.022	.130	.071	.021	.122	.067	.021	.114	.063	.020															
4.0	.136	.071	.021	.132	.069	.020	.125	.066	.020	.118	.063	.019	.111	.060	.018															
5.0	.129	.066	.019	.126	.065	.019	.119	.062	.018	.113	.060	.018	.107	.057	.017															
6.0	.123	.062	.018	.120	.061	.017	.114	.059	.017	.109	.057	.017	.104	.055	.016															
7.0	.117	.058	.016	.115	.057	.016	.110	.055	.016	.105	.054	.016	.101	.052	.015															
8.0	.112	.055	.015	.110	.054	.015	.105	.053	.015	.101	.051	.015	.097	.050	.015															
9.0	.108	.052	.015	.105	.051	.014	.101	.050	.014	.098	.049	.014	.094	.048	.014															
10.0	.103	.049	.014	.101	.049	.014	.098	.048	.013	.094	.047	.013	.091	.046	.013															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.171	.159	.147	.147	.136	.127	.100	.094	.088	.058	.054	.051	.018	.017	.016	
2.0	.155	.134	.116	.133	.115	.100	.091	.080	.070	.052	.046	.041	.017	.015	.013	
3.0	.141	.115	.093	.121	.099	.081	.083	.069	.057	.048	.040	.033	.015	.013	.011	
4.0	.130	.100	.076	.112	.086	.066	.077	.060	.047	.044	.035	.028	.014	.011	.009	
5.0	.121	.088	.063	.104	.076	.055	.072	.053	.039	.041	.031	.023	.013	.010	.008	
6.0	.113	.078	.053	.097	.068	.047	.067	.047	.033	.039	.028	.020	.013	.009	.006	
7.0	.106	.070	.046	.091	.061	.040	.063	.043	.028	.037	.025	.017	.012	.008	.006	
8.0	.100	.064	.039	.086	.056	.034	.060	.039	.024	.035	.023	.015	.011	.008	.005	
9.0	.095	.059	.034	.082	.051	.030	.057	.036	.021	.033	.021	.013	.011	.007	.004	
10.0	.090	.054	.030	.078	.047	.026	.054	.033	.019	.031	.020	.011	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz Lamp Flux:2077.07x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	29.7	30.5	29.9	30.6	30.8	30.5	31.3	30.7	31.5	31.7
3H	29.5	30.3	29.8	30.5	30.7	30.6	31.4	30.9	31.6	31.8
4H	29.4	30.1	29.7	30.4	30.6	30.6	31.3	30.9	31.5	31.8
6H	29.3	30.0	29.6	30.3	30.5	30.5	31.2	30.8	31.4	31.7
8H	29.3	30.0	29.6	30.2	30.5	30.5	31.1	30.8	31.4	31.7
12H	29.3	29.9	29.6	30.1	30.4	30.5	31.1	30.8	31.4	31.6
4H 2H	29.7	30.4	29.9	30.6	30.8	30.5	31.2	30.7	31.4	31.6
3H	29.5	30.1	29.8	30.4	30.7	30.6	31.2	30.9	31.5	31.8
4H	29.4	30.0	29.8	30.3	30.6	30.5	31.1	30.9	31.4	31.7
6H	29.3	29.8	29.7	30.2	30.5	30.5	31.0	30.8	31.3	31.7
8H	29.3	29.7	29.7	30.1	30.5	30.4	30.9	30.8	31.3	31.6
12H	29.2	29.6	29.6	30.0	30.4	30.4	30.9	30.8	31.2	31.6
8H 4H	29.3	29.7	29.7	30.1	30.5	30.4	30.9	30.8	31.2	31.6
6H	29.2	29.6	29.6	30.0	30.4	30.3	30.7	30.8	31.1	31.5
8H	29.1	29.5	29.6	29.9	30.3	30.3	30.7	30.8	31.1	31.5
12H	29.1	29.4	29.6	29.8	30.3	30.3	30.6	30.8	31.1	31.5
12H 4H	29.2	29.7	29.6	30.0	30.4	30.3	30.8	30.8	31.1	31.5
6H	29.1	29.5	29.6	29.9	30.3	30.3	30.6	30.7	31.0	31.5
8H	29.1	29.4	29.6	29.8	30.3	30.3	30.6	30.7	31.0	31.5
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.8 / - 6.4					+ 1.3 / - 2.1				
1.5H	+ 3.9 / - 4.7					+ 1.8 / - 1.3				
2.0H	+ 3.9 / - 8.0					+ 2.5 / - 3.0				

CIE Pub.117, 2077 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 2.5$)
Area: 0.0001 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz Lamp Flux:2077.07x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	88	82	78	87	82	78	87	81	78	74
0.80	95	90	86	95	89	86	94	89	85	82
1.00	100	94	91	99	94	90	97	94	90	86
1.25	104	99	95	103	98	95	101	97	94	90
1.50	106	102	98	105	101	98	103	99	97	92
2.00	109	105	102	107	104	101	105	102	99	94
2.50	110	107	104	109	105	103	106	103	101	95
3.00	112	109	106	110	107	105	107	105	103	96
4.00	114	111	109	112	110	108	108	106	105	98
5.00	115	113	111	113	111	110	109	108	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz Lamp Flux:2077.07x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

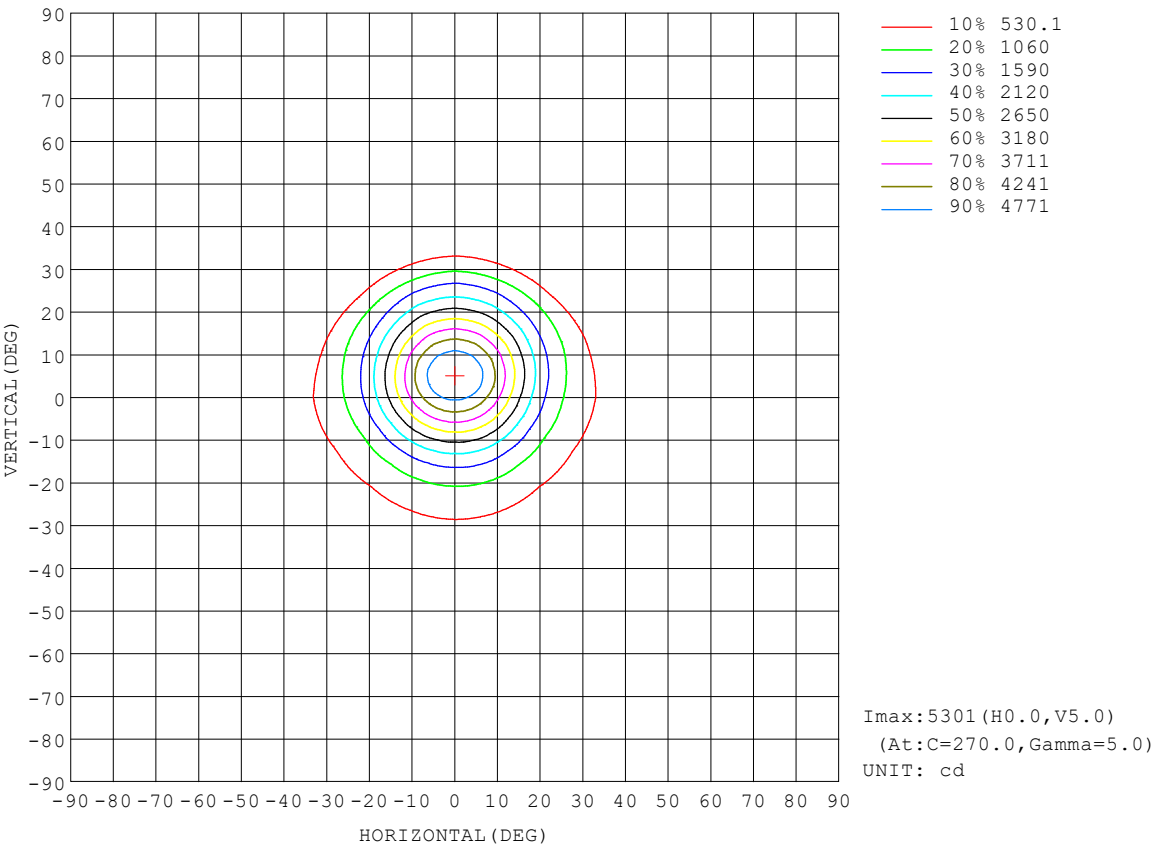

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

AAI Figure

Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz Lamp Flux:2077.07x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

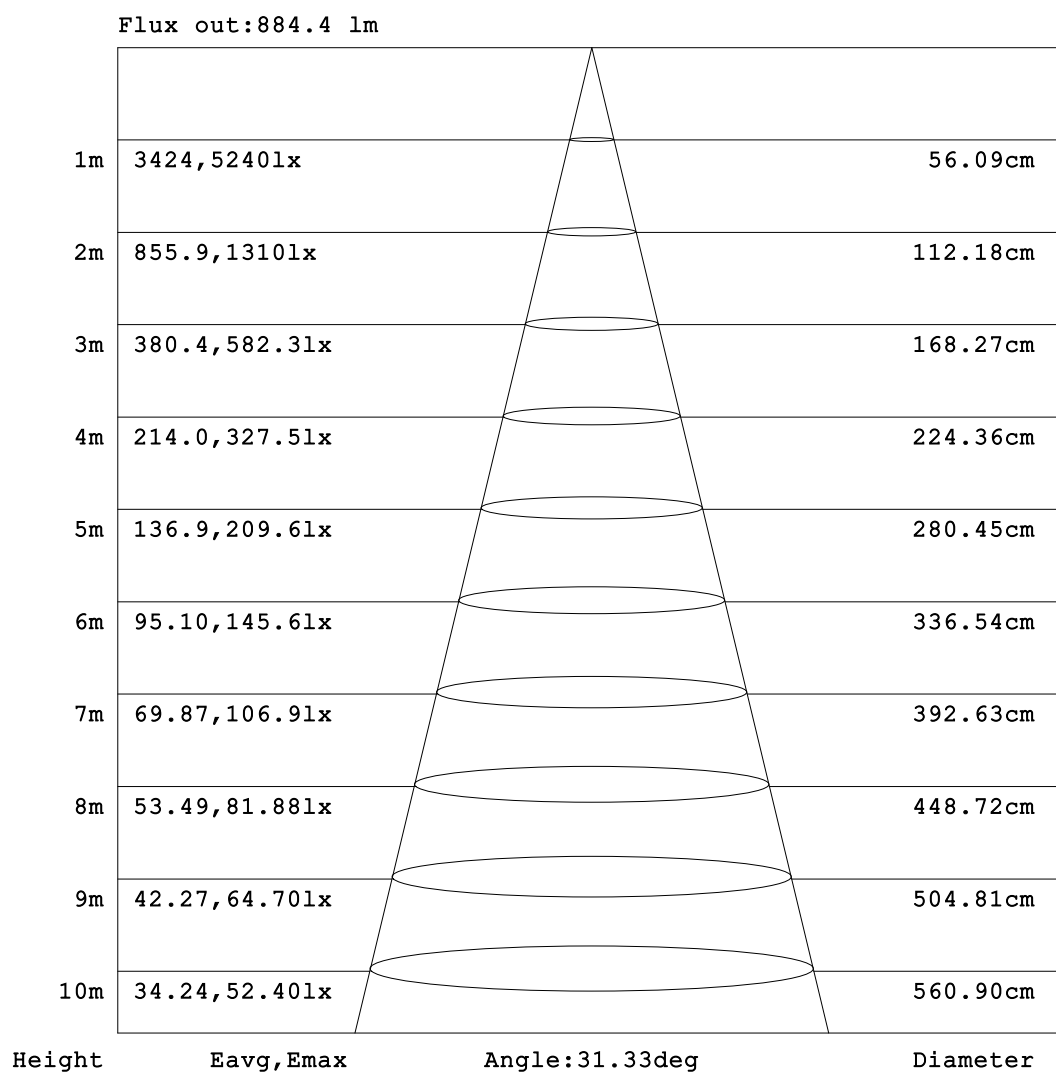


C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:


ISOLUX DIAGRAM

Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz Lamp Flux:2077.07x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

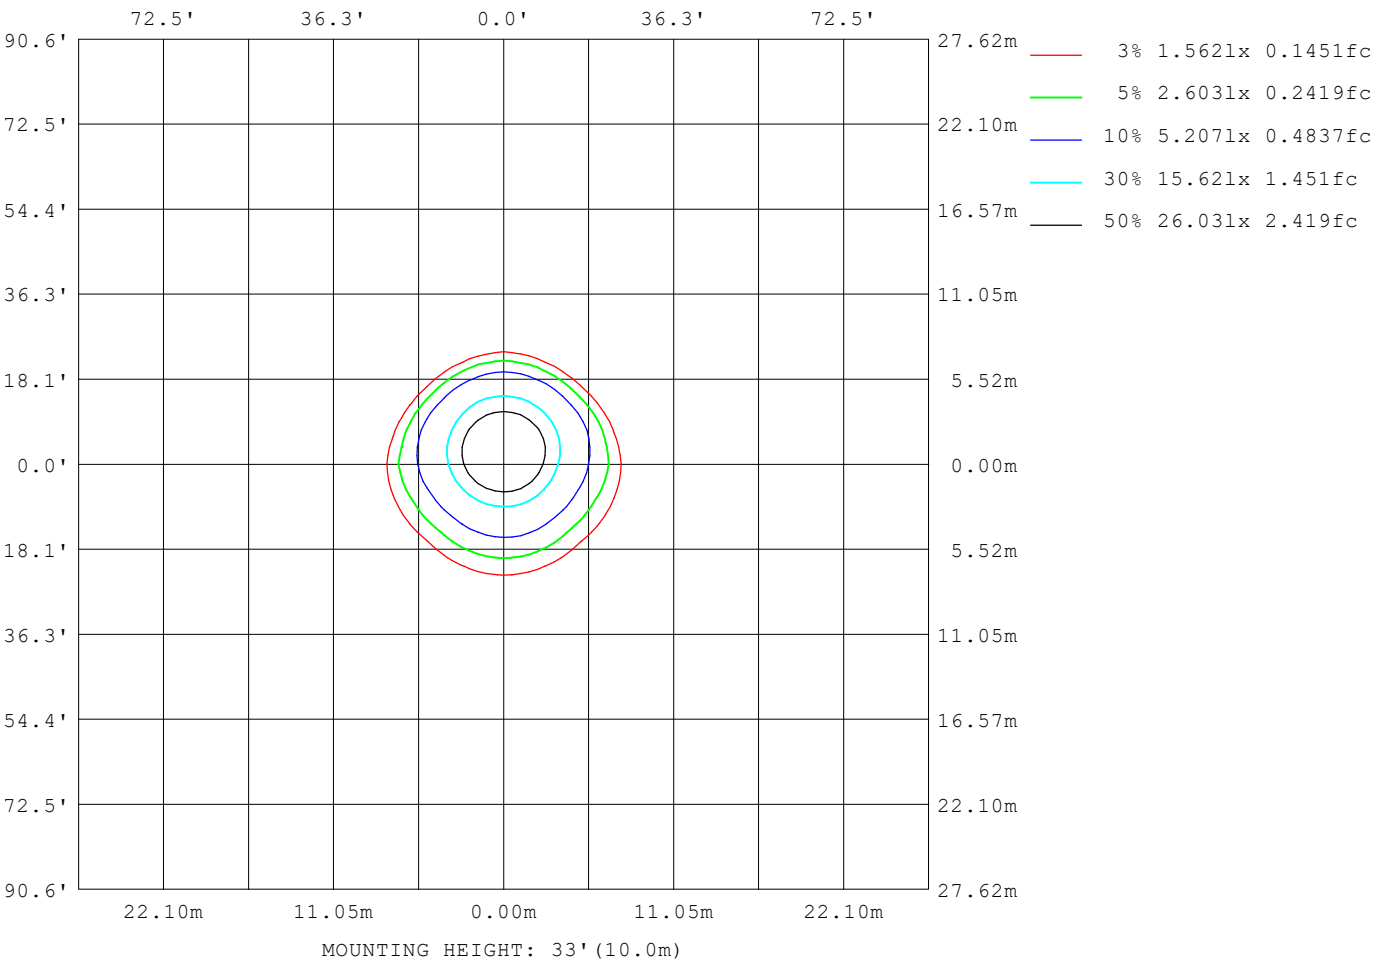

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

Planar Illuminance Curve

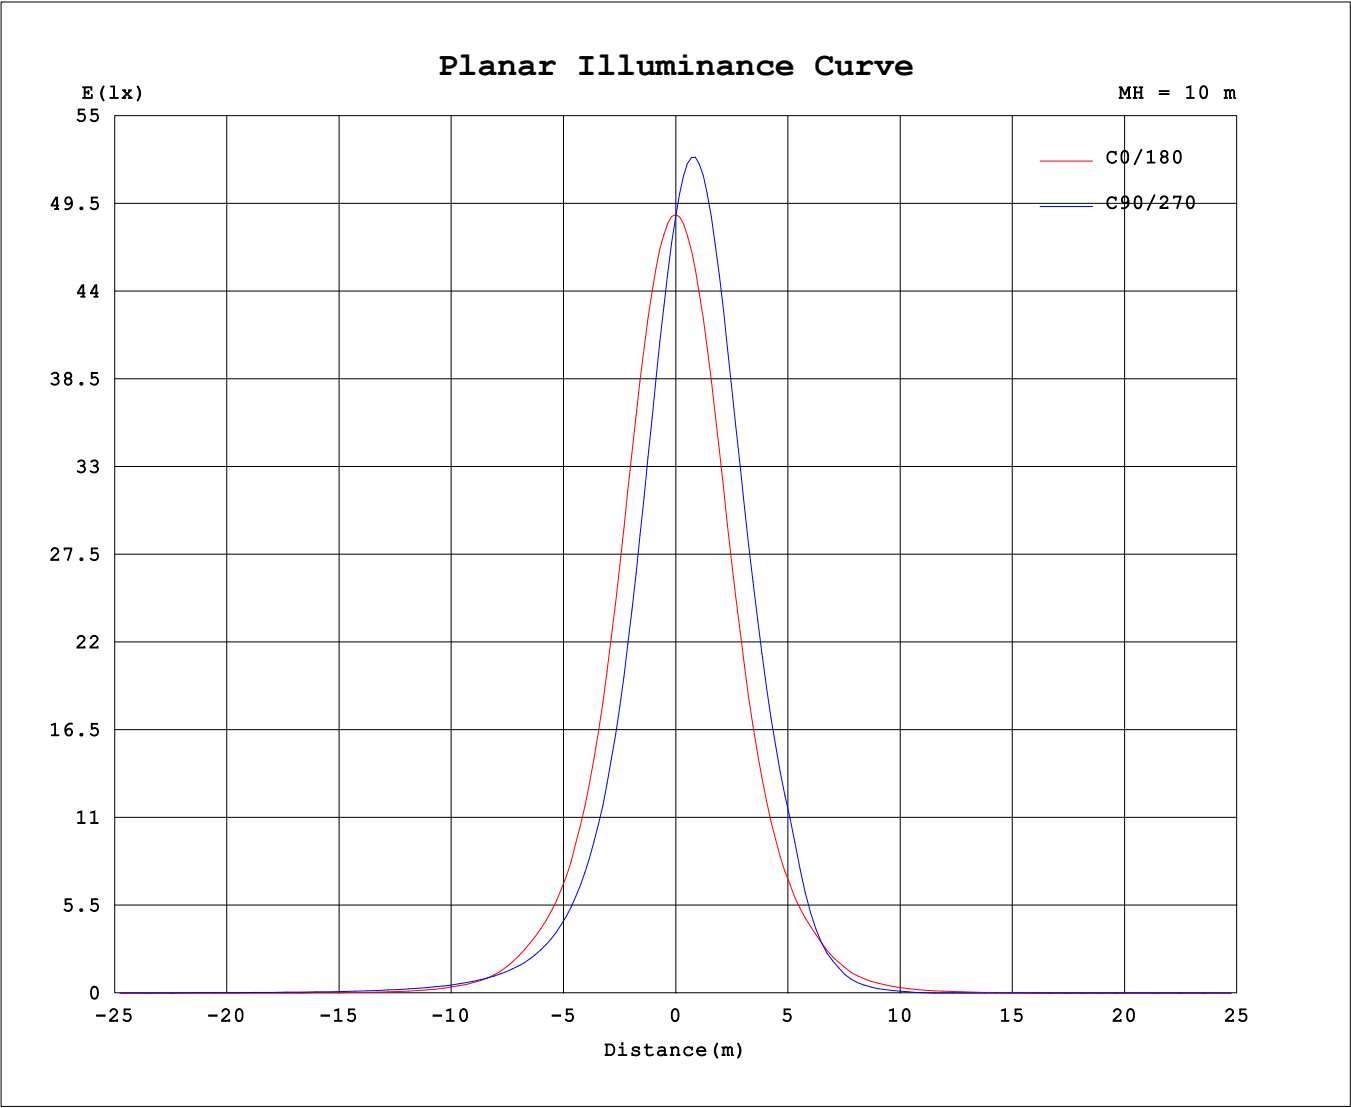

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:2.6665A P:27.000W PF:0.8729 Freq:60.02Hz Lamp Flux:2077.07x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	
0	4880	4876	4874	4871	4874	4873	4879	4888	4880	4876	4874	4871	4874	4873	4879	4888	
5	4595	4319	4096	3951	3893	3937	4084	4314	4587	4869	5098	5248	5301	5254	5114	4892	
10	3794	3368	3051	2842	2755	2811	3025	3358	3798	4246	4619	4843	4913	4856	4652	4282	
15	2717	2299	2030	1872	1800	1837	2012	2310	2760	3200	3611	3880	3949	3894	3662	3240	
20	1768	1439	1264	1191	1142	1161	1245	1454	1815	2160	2490	2768	2836	2775	2552	2192	
25	1110	871	751	738	726	718	742	881	1150	1368	1565	1792	1863	1792	1608	1385	
30	702	538	460	467	470	456	452	538	727	810	794	876	973	908	850	846	
35	425	347	296	304	312	298	286	338	414	361	305	330	372	332	321	385	
40	214	223	201	205	212	201	190	206	201	149	106	103	114	103	106	162	
45	109	132	141	142	147	138	131	120	100	62.9	42.0	35.2	36.9	35.2	41.8	67.0	
50	51.5	76.6	94.0	101	102	97.6	85.6	69.6	48.8	27.8	11.1	3.68	3.90	4.24	11.4	29.8	
55	24.0	42.5	60.1	70.8	71.6	68.1	54.4	38.8	22.8	7.31	1.66	0.08	0.00	0.04	1.60	7.96	
60	8.10	21.4	35.2	45.9	48.9	43.5	31.6	19.2	7.63	1.90	0.45	0.03	0.00	0.00	0.35	1.91	
65	2.80	8.52	17.7	25.8	29.7	23.7	15.4	7.29	2.68	1.00	0.29	0.00	0.00	0.00	0.20	0.91	
70	1.53	3.40	7.18	11.8	13.1	10.3	5.88	2.85	1.47	0.72	0.00	0.00	0.00	0.00	0.00	0.63	
75	1.15	2.00	3.22	4.37	4.47	3.57	2.40	1.68	1.13	0.28	0.00	0.00	0.00	0.00	0.00	0.21	
80	0.68	1.60	2.41	2.81	2.67	2.27	1.84	1.33	0.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
85	0.19	1.13	1.98	2.45	2.35	1.94	1.48	0.93	0.26	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
90	0.00	0.63	1.47	1.97	1.93	1.53	1.07	0.54	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
95	0.00	0.18	0.93	1.43	1.43	1.08	0.69	0.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
100	0.00	0.00	0.44	0.89	0.93	0.68	0.35	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
105	0.00	0.00	0.03	0.39	0.47	0.32	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
110	0.00	0.00	0.00	0.02	0.11	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
130	0.03	0.06	0.08	0.10	0.11	0.11	0.10	0.07	0.10	0.07	0.05	0.04	0.04	0.04	0.05	0.08	
135	0.20	0.26	0.31	0.34	0.35	0.36	0.34	0.29	0.42	0.35	0.30	0.27	0.26	0.27	0.31	0.37	
140	0.50	0.58	0.66	0.71	0.73	0.75	0.72	0.64	0.93	0.82	0.72	0.66	0.64	0.66	0.74	0.84	
145	0.76	0.85	0.94	1.01	1.05	1.08	1.05	0.98	1.57	1.45	1.32	1.23	1.19	1.23	1.34	1.48	
150	0.93	1.00	1.09	1.17	1.23	1.28	1.28	1.23	2.20	2.10	1.99	1.90	1.86	1.90	2.04	2.19	
155	1.21	1.25	1.31	1.38	1.45	1.52	1.54	1.53	2.82	2.77	2.71	2.66	2.64	2.68	2.81	2.95	
160	1.38	1.40	1.45	1.51	1.58	1.67	1.73	1.76	3.26	3.26	3.28	3.28	3.30	3.35	3.45	3.54	
165	1.41	1.43	1.47	1.53	1.62	1.72	1.80	1.87	3.28	3.29	3.39	3.49	3.58	3.65	3.74	3.78	
170	1.48	1.49	1.52	1.59	1.69	1.80	1.90	1.99	3.09	3.10	3.27	3.44	3.58	3.70	3.77	3.80	
175	1.73	1.82	1.91	2.02	2.12	2.20	2.27	2.29	2.73	2.74	2.94	3.14	3.33	3.46	3.54	3.52	
180	2.20	2.36	2.54	2.71	2.88	2.94	2.97	2.90	2.18	2.19	2.35	2.53	2.70	2.86	2.92	2.94	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: