
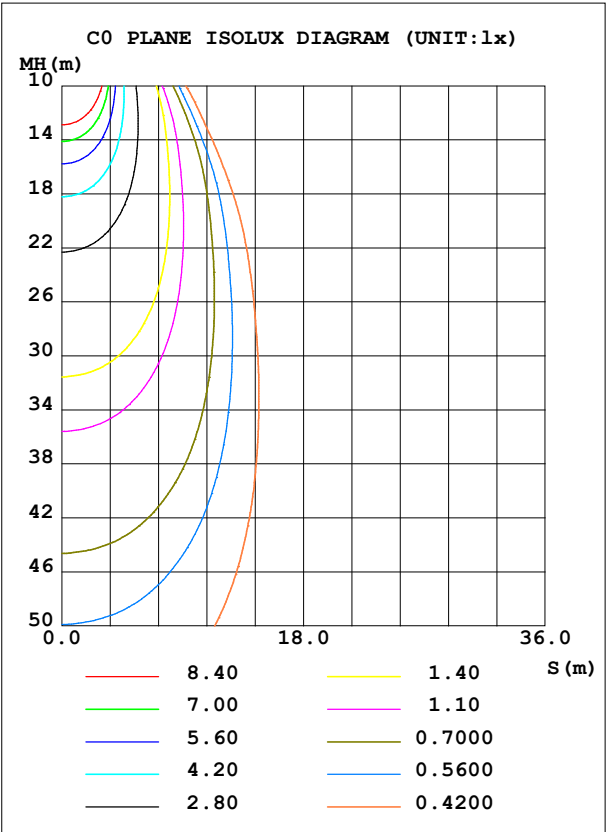


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz Lamp Flux:911.51x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 68.53 lm/W
MODEL		Imax (cd)	1422	S/MH(C0/180)		0.75
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)		0.73
RATED VOLTAGE(V)		TOTAL FLUX(lm)	911.51	η UP,DN(C0-180)		0.1,52.6
NOMINAL FLUX(lm)	911.51	CIE CLASS	DIRECT	η UP,DN(C180-360)		0.1,47.2
LAMPS INSIDE	1	η up (%)	0.1	CIBSE SHR NOM		0.75
TEST VOLTAGE(V)		η down (%)	99.9	CIBSE SHR MAX		0.75

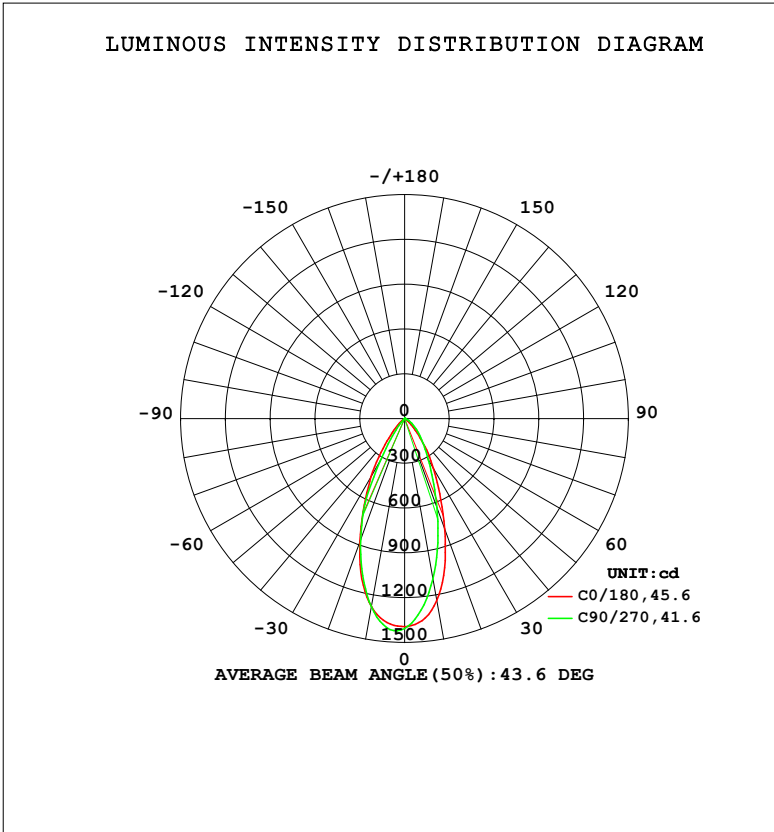

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1238	1156	1093	1197	1280	1314	1283	1257	0- 10	125.4	125.4	13.8,13.8
20	786.7	729.5	635.5	798.1	877.3	917.4	864.1	840.8	10- 20	284.5	409.9	45,45
30	387.1	358.0	320.1	422.4	450.3	379.0	328.3	338.4	20- 30	265.2	675.1	74.1,74.1
40	147.5	170.4	171.2	195.3	149.7	65.33	53.68	53.78	30- 40	141.8	816.9	89.6,89.6
50	38.96	84.28	88.69	84.78	36.24	2.351	0.6580	2.294	40- 50	59.68	876.5	96.2,96.2
60	5.980	31.24	41.35	29.46	3.867	0.1306	0	0.2010	50- 60	23.49	900.0	98.7,98.7
70	1.019	7.179	12.57	6.474	0.8499	0	0	0	60- 70	7.935	908.0	99.6,99.6
80	0.4756	1.655	1.808	1.254	0.3061	0	0	0	70- 80	1.678	909.7	99.8,99.8
90	0	1.064	1.277	0.7418	0	0	0	0	80- 90	0.5785	910.2	99.9,99.9
100	0	0.3670	0.6137	0.2293	0	0	0	0	90-100	0.2848	910.5	99.9,99.9
110	0	0	0.0667	0	0	0	0	0	100-110	0.0669	910.6	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0.0005	910.6	99.9,99.9
130	0	0	0	0	0	0	0	0.0122	120-130	0.0001	910.6	99.9,99.9
140	0.1182	0.0987	0.1005	0.0701	0.2882	0.2912	0.2798	0.3650	130-140	0.0563	910.6	99.9,99.9
150	0.2831	0.2885	0.3117	0.2823	0.7164	0.7262	0.7367	0.8331	140-150	0.2279	910.9	99.9,99.9
160	0.4888	0.5005	0.5318	0.5183	1.064	1.086	1.128	1.189	150-160	0.3121	911.2	100,100
170	0.5843	0.5901	0.6300	0.6462	1.081	1.100	1.175	1.215	160-170	0.2431	911.4	100,100
180	0.9116	0.9307	0.9853	0.9543	0.8887	0.8924	0.9482	0.9477	170-180	0.0856	911.5	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 853.53 lm

%lum = 93.6%

%lamp = 93.6%

Conical surface Flux(120deg): 900.04 lm

%lum = 98.7%


%lamp = 98.7%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz Lamp Flux:911.51x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

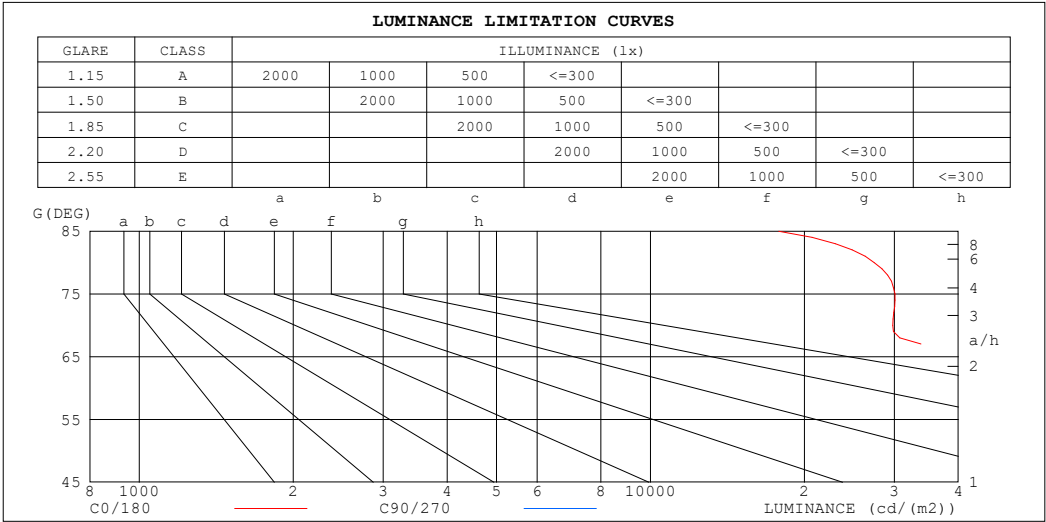

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	17839	174769
80	27391	104118
75	30073	177095
70	29784	367621
65	47298	614657
60	119609	826933
55	297908	1074350
50	606080	1379801
45	1125594	1767341


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz		
Lamp Flux:911.51x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.11	1.08	1.06	1.09	1.06	1.04	1.05	1.03	1.01	1.01	.99	.98	.97	.96	.95	.94
2.0	1.03	.99	.96	1.01	.98	.95	.98	.95	.93	.95	.93	.91	.92	.91	.89	.87
3.0	.96	.92	.88	.95	.91	.87	.92	.89	.86	.90	.87	.84	.88	.85	.83	.81
4.0	.90	.85	.81	.89	.84	.80	.87	.83	.79	.85	.81	.78	.83	.80	.77	.76
5.0	.85	.79	.75	.84	.79	.75	.82	.77	.74	.80	.76	.73	.79	.75	.73	.71
6.0	.80	.74	.70	.79	.74	.70	.78	.73	.69	.76	.72	.69	.75	.71	.68	.67
7.0	.75	.70	.66	.75	.69	.65	.74	.69	.65	.72	.68	.65	.71	.67	.64	.63
8.0	.71	.66	.62	.71	.65	.62	.70	.65	.61	.69	.64	.61	.68	.64	.61	.59
9.0	.68	.62	.58	.67	.62	.58	.66	.61	.58	.65	.61	.58	.65	.60	.57	.56
10.0	.64	.59	.55	.64	.59	.55	.63	.58	.55	.62	.58	.55	.62	.58	.55	.53

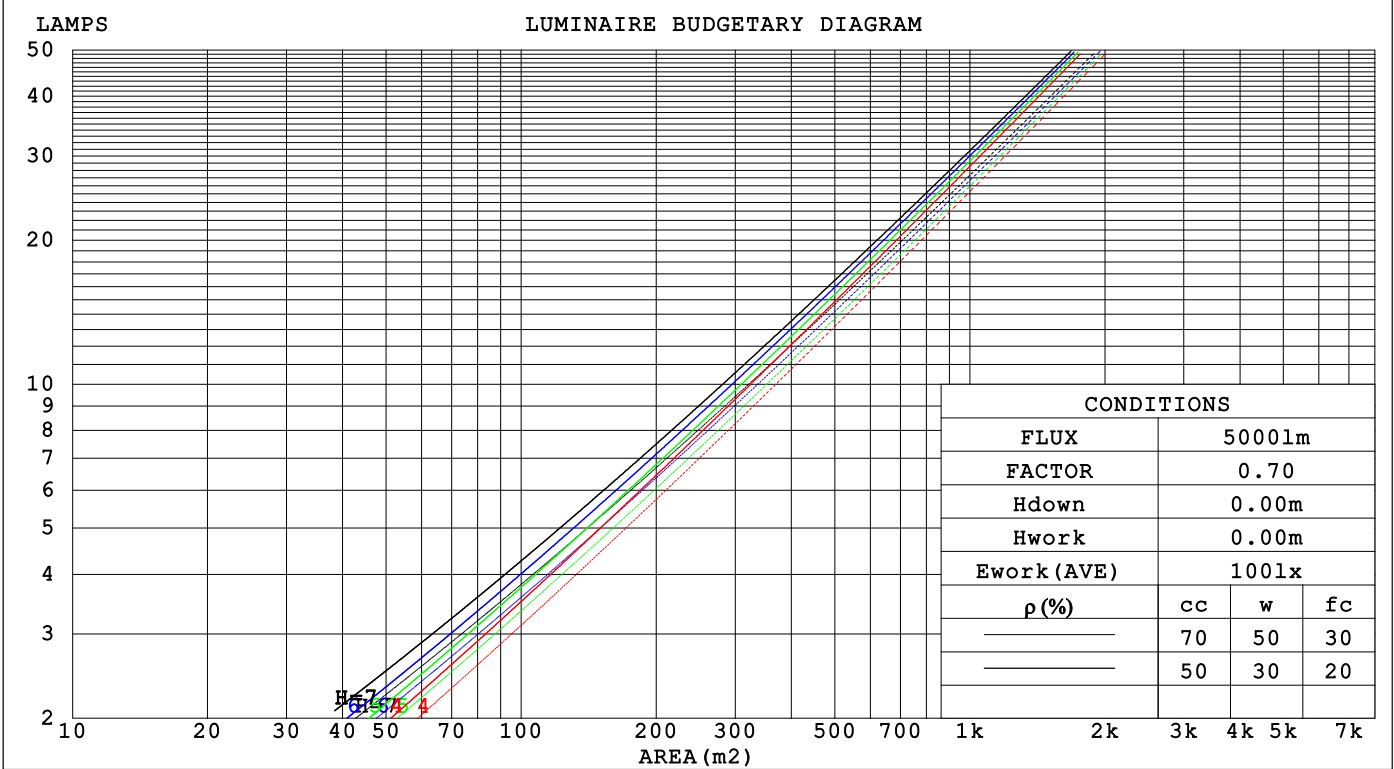

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-19

γ Range: 0 - 180DEG

γ Intmval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz Lamp Flux:911.51x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.177	.100	.032	.170	.097	.031	.157	.090	.029	.145	.084	.027	.135	.078	.025	
2.0	.169	.093	.028	.163	.090	.028	.152	.085	.026	.143	.080	.025	.134	.076	.024	
3.0	.160	.085	.026	.156	.083	.025	.147	.079	.024	.138	.076	.023	.130	.072	.022	
4.0	.152	.079	.023	.148	.078	.023	.140	.074	.022	.133	.072	.022	.126	.069	.021	
5.0	.145	.074	.021	.141	.073	.021	.135	.070	.021	.128	.068	.020	.122	.065	.020	
6.0	.138	.069	.020	.135	.068	.020	.129	.066	.019	.123	.064	.019	.118	.062	.018	
7.0	.132	.065	.018	.129	.064	.018	.124	.062	.018	.119	.061	.018	.114	.059	.017	
8.0	.126	.061	.017	.123	.061	.017	.118	.059	.017	.114	.058	.017	.110	.056	.016	
9.0	.120	.058	.016	.118	.058	.016	.114	.056	.016	.110	.055	.016	.106	.054	.016	
10.0	.115	.055	.015	.113	.055	.015	.109	.054	.015	.106	.053	.015	.102	.051	.015	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.172	.158	.146	.147	.136	.126	.101	.094	.087	.058	.054	.051	.019	.017	.016	
2.0	.157	.134	.114	.134	.115	.099	.092	.080	.069	.053	.046	.040	.017	.015	.013	
3.0	.144	.115	.091	.124	.099	.079	.085	.069	.055	.049	.040	.033	.016	.013	.011	
4.0	.134	.100	.074	.115	.086	.064	.079	.060	.045	.046	.035	.027	.015	.011	.009	
5.0	.125	.088	.061	.108	.076	.053	.074	.053	.037	.043	.031	.022	.014	.010	.007	
6.0	.118	.079	.051	.101	.068	.045	.070	.048	.031	.041	.028	.019	.013	.009	.006	
7.0	.111	.071	.043	.096	.062	.038	.066	.043	.027	.038	.026	.016	.012	.008	.005	
8.0	.105	.065	.037	.091	.056	.033	.063	.040	.023	.036	.023	.014	.012	.008	.005	
9.0	.100	.060	.033	.086	.052	.028	.060	.037	.020	.035	.022	.012	.011	.007	.004	
10.0	.095	.055	.029	.082	.048	.025	.057	.034	.018	.033	.020	.011	.011	.007	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz Lamp Flux:911.51x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	33.5	34.4	33.7	34.6	34.8	35.3	36.2	35.5	36.4	36.5
3H	33.3	34.2	33.6	34.4	34.6	35.4	36.3	35.7	36.5	36.7
4H	33.3	34.1	33.5	34.3	34.5	35.4	36.2	35.7	36.4	36.6
6H	33.2	33.9	33.5	34.2	34.4	35.3	36.1	35.6	36.3	36.6
8H	33.1	33.8	33.4	34.1	34.4	35.3	36.0	35.6	36.3	36.5
12H	33.1	33.8	33.4	34.0	34.3	35.2	35.9	35.6	36.2	36.5
4H 2H	33.6	34.4	33.8	34.6	34.8	35.2	36.0	35.5	36.2	36.4
3H	33.4	34.1	33.7	34.4	34.7	35.4	36.1	35.7	36.4	36.6
4H	33.3	34.0	33.7	34.3	34.6	35.3	36.0	35.7	36.3	36.6
6H	33.2	33.8	33.6	34.1	34.5	35.3	35.8	35.7	36.2	36.5
8H	33.2	33.7	33.6	34.1	34.4	35.2	35.8	35.6	36.1	36.5
12H	33.1	33.6	33.6	34.0	34.4	35.2	35.7	35.6	36.1	36.4
8H 4H	33.2	33.7	33.6	34.1	34.5	35.2	35.7	35.6	36.1	36.5
6H	33.1	33.6	33.6	33.9	34.4	35.1	35.6	35.6	36.0	36.4
8H	33.1	33.5	33.5	33.9	34.3	35.1	35.5	35.6	35.9	36.3
12H	33.0	33.4	33.5	33.8	34.3	35.1	35.4	35.6	35.9	36.3
12H 4H	33.2	33.6	33.6	34.0	34.4	35.2	35.6	35.6	36.0	36.4
6H	33.1	33.5	33.5	33.9	34.3	35.1	35.5	35.5	35.9	36.3
8H	33.0	33.4	33.5	33.8	34.3	35.1	35.4	35.5	35.8	36.3
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.2 / - 5.9					+ 1.3 / - 2.0				
1.5H	+ 2.6 / - 4.7					+ 1.3 / - 1.1				
2.0H	+ 3.7 / - 8.0					+ 2.5 / - 2.9				

CIE Pub.117, 911.5 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.3)
Area: 0.0001 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz Lamp Flux:911.51x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	85	78	74	84	78	74	84	78	74	70
0.80	93	86	82	92	86	82	91	86	82	78
1.00	98	92	88	97	91	88	95	91	87	83
1.25	102	96	93	101	96	92	99	95	92	87
1.50	105	100	96	104	99	96	101	98	95	90
2.00	108	103	100	106	102	99	104	100	98	92
2.50	110	106	103	108	104	102	105	102	100	94
3.00	111	108	105	109	106	104	106	104	102	95
4.00	113	110	108	111	109	107	108	106	104	97
5.00	115	112	110	112	110	109	108	107	106	98
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-19

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz Lamp Flux:911.51x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

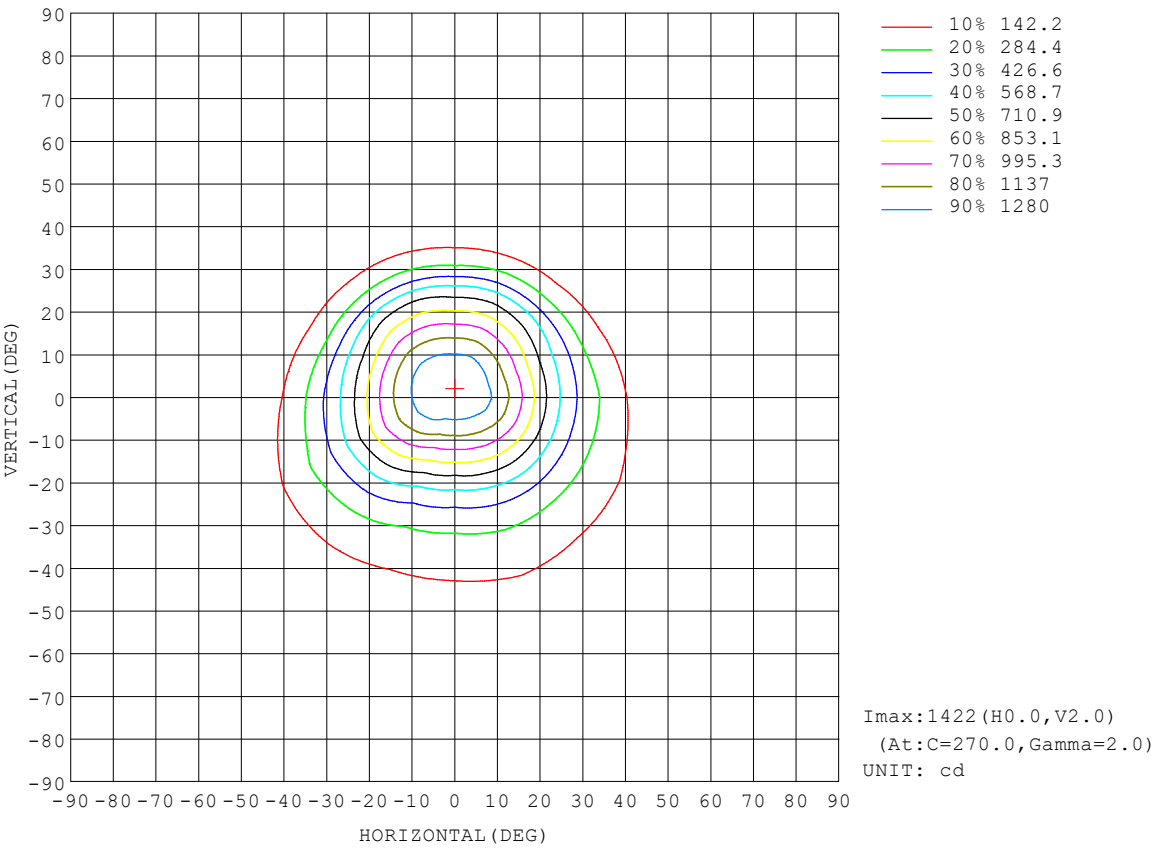

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

AAI Figure

Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz Lamp Flux:911.51x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

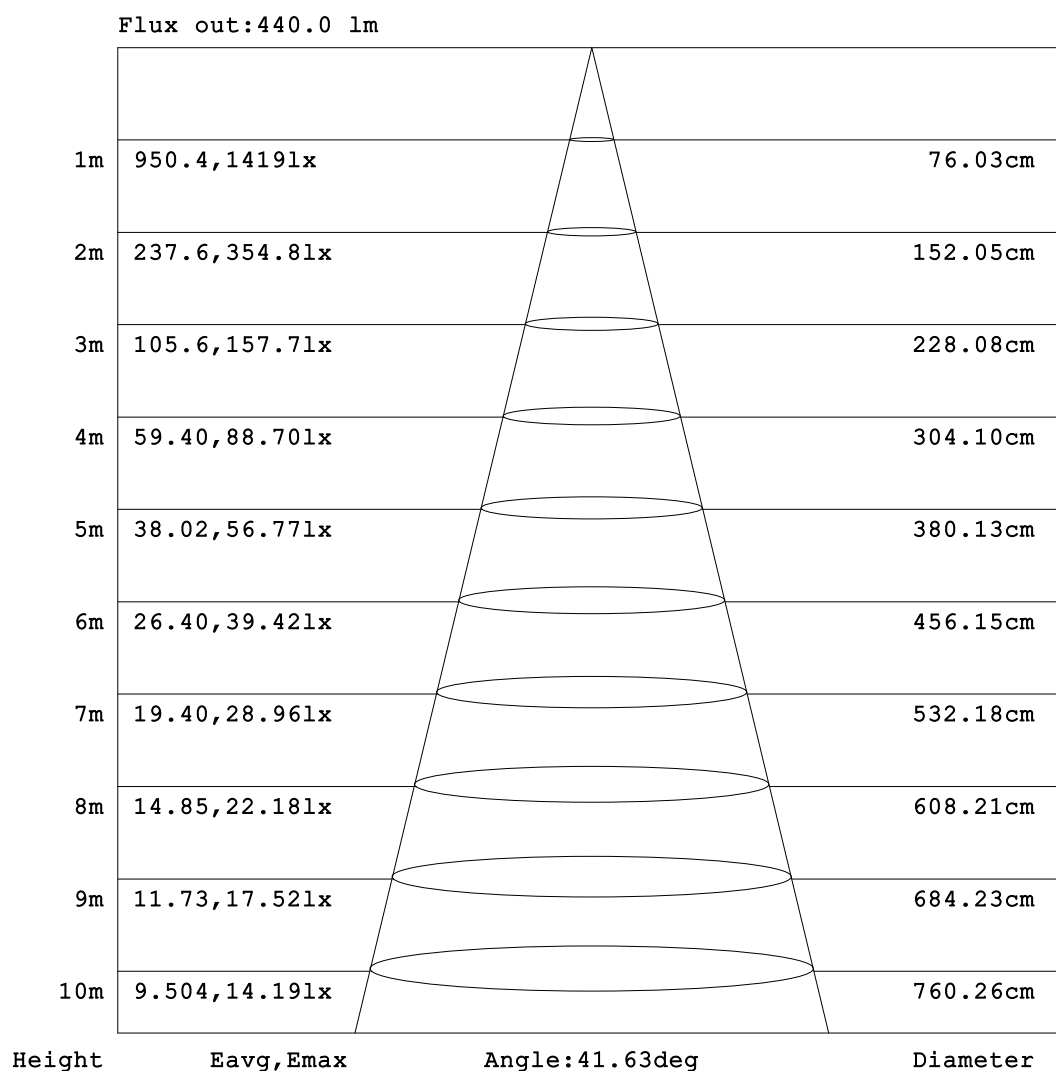


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3℃
Operators: Allen
Test Date: 2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:


ISOLUX DIAGRAM

Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz Lamp Flux:911.51x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

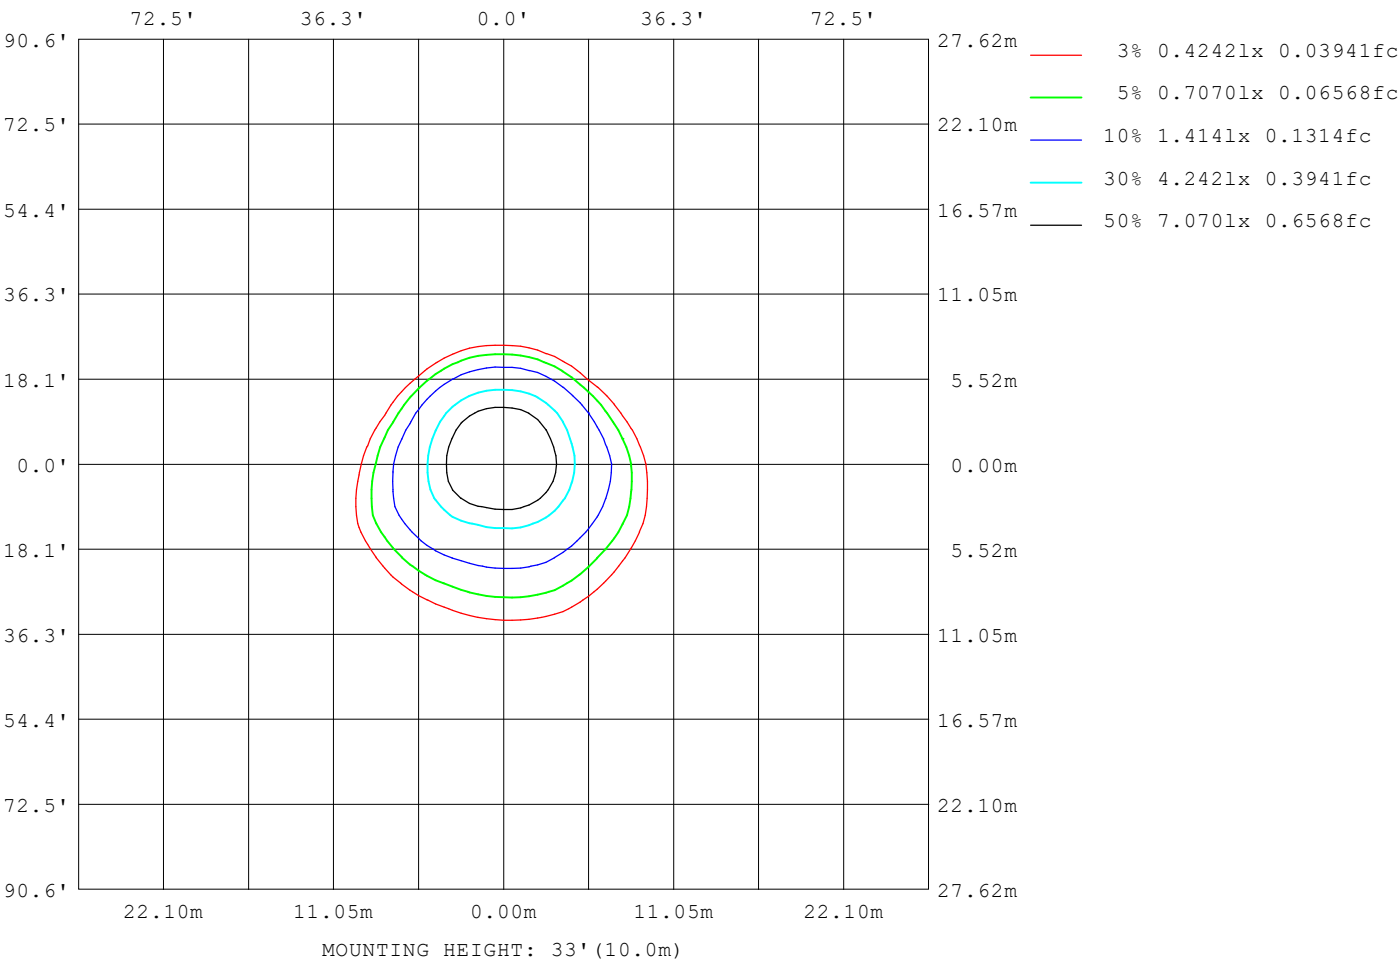

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

Planar Illuminance Curve

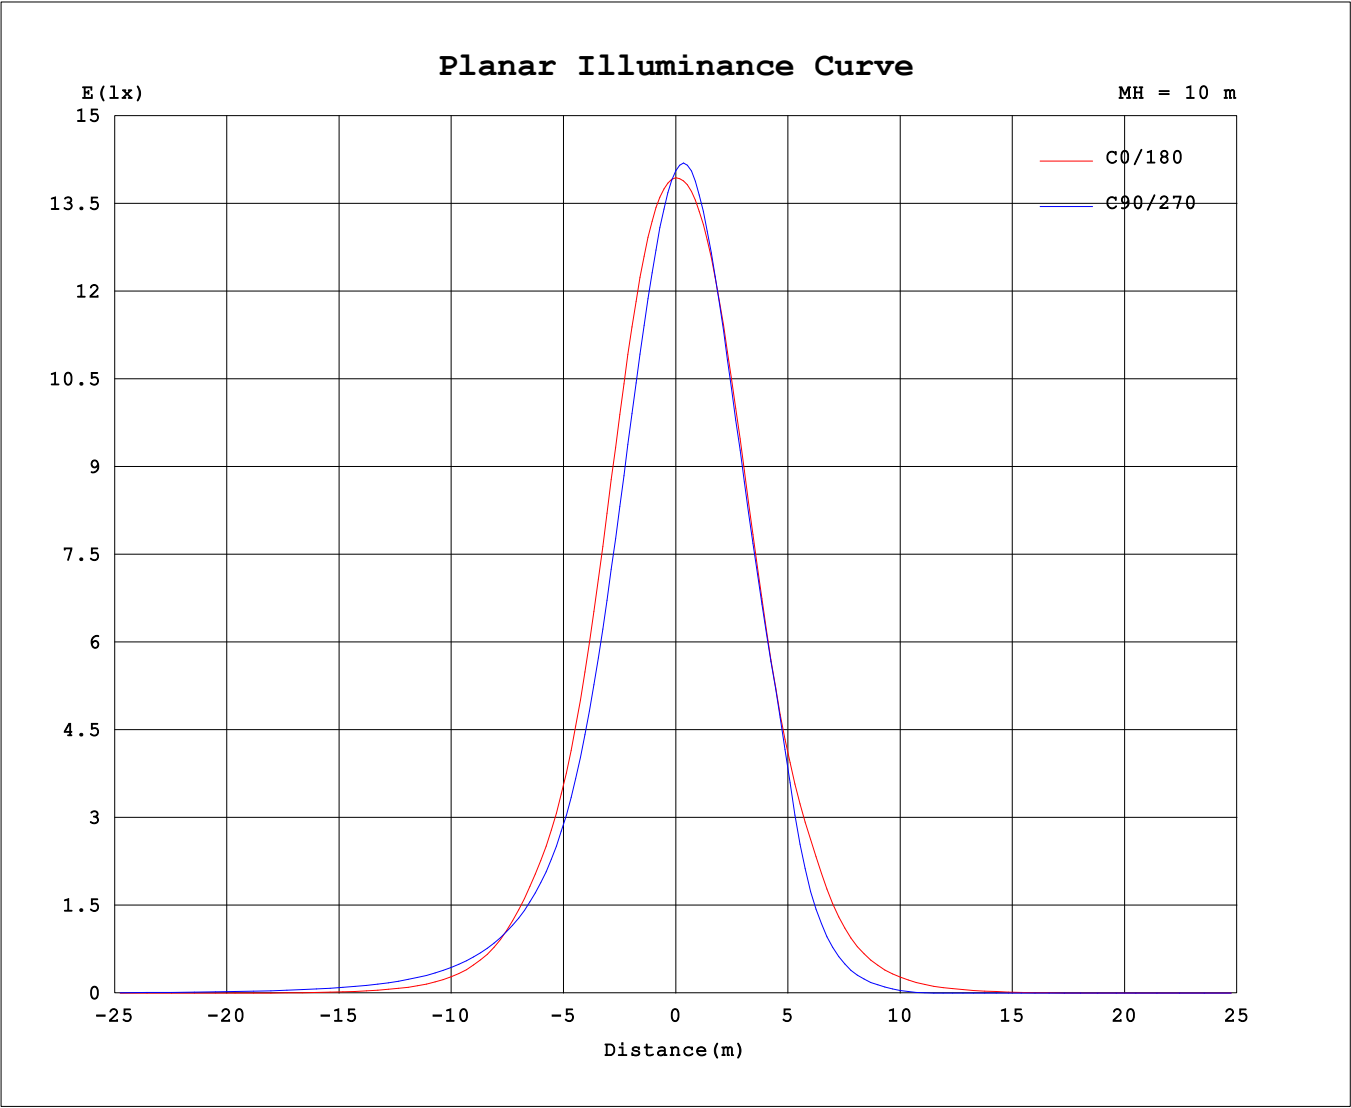

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-19	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:1.3300A P:13.300W PF:0.8132 Freq:60.00Hz Lamp Flux:911.51x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																			
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5				
0	1394	1400	1404	1406	1406	1404	1408	1398	1394	1400	1404	1406	1406	1404	1408	1398				
5	1358	1341	1313	1294	1285	1294	1338	1363	1371	1392	1405	1408	1404	1401	1381	1358				
10	1238	1213	1156	1113	1093	1110	1197	1260	1280	1300	1314	1300	1283	1286	1257	1230				
15	1036	1012	952	896	863	891	1009	1098	1110	1121	1140	1117	1087	1097	1064	1025				
20	787	772	729	674	636	667	798	891	877	879	917	904	864	876	841	782				
25	558	546	522	484	449	475	597	670	640	636	685	676	633	648	616	560				
30	387	375	358	345	320	333	422	476	450	396	379	362	328	346	338	360				
35	259	257	245	250	233	236	289	331	278	197	171	158	142	144	147	187				
40	147	177	170	183	171	170	195	224	150	91.1	65.3	60.4	53.7	51.3	53.8	90.0				
45	79.6	111	121	134	125	122	133	135	77.4	37.3	21.6	14.7	13.3	12.9	17.6	38.0				
50	39.0	64.3	84.3	95.1	88.7	86.1	84.8	76.1	36.2	12.5	2.35	0.71	0.66	0.95	2.29	13.9				
55	17.1	35.5	53.4	65.9	61.6	59.5	51.0	41.0	15.0	2.08	0.21	0.00	0.00	0.00	0.30	2.56				
60	5.98	17.6	31.2	43.0	41.3	37.2	29.5	19.4	3.87	0.62	0.13	0.00	0.00	0.00	0.20	0.76				
65	2.00	7.96	16.0	24.4	26.0	20.7	14.9	7.76	1.33	0.46	0.00	0.00	0.00	0.00	0.03	0.56				
70	1.02	2.91	7.18	11.7	12.6	9.64	6.47	2.43	0.85	0.23	0.00	0.00	0.00	0.00	0.00	0.32				
75	0.78	1.42	2.83	4.35	4.58	3.43	2.33	1.15	0.61	0.00	0.00	0.00	0.00	0.00	0.00	0.02				
80	0.48	1.14	1.66	1.90	1.81	1.51	1.25	0.90	0.31	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
85	0.16	0.84	1.39	1.63	1.52	1.25	1.00	0.63	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
90	0.00	0.51	1.06	1.35	1.28	1.00	0.74	0.36	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
95	0.00	0.20	0.71	0.99	0.94	0.70	0.47	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
100	0.00	0.00	0.37	0.63	0.61	0.42	0.23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
105	0.00	0.00	0.08	0.30	0.31	0.18	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
110	0.00	0.00	0.00	0.04	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.02			
135	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.10	0.12	0.11	0.10	0.10	0.11	0.16	0.18				
140	0.12	0.10	0.10	0.10	0.10	0.10	0.07	0.07	0.29	0.31	0.29	0.28	0.28	0.30	0.37	0.39				
145	0.21	0.21	0.21	0.22	0.22	0.22	0.19	0.19	0.51	0.53	0.51	0.49	0.50	0.52	0.60	0.62				
150	0.28	0.28	0.29	0.30	0.31	0.31	0.28	0.27	0.72	0.74	0.73	0.72	0.74	0.76	0.83	0.85				
155	0.40	0.38	0.40	0.41	0.42	0.43	0.39	0.39	0.91	0.94	0.94	0.94	0.96	0.99	1.05	1.06				
160	0.49	0.49	0.50	0.52	0.53	0.54	0.52	0.52	1.06	1.08	1.09	1.10	1.13	1.15	1.19	1.19				
165	0.53	0.53	0.54	0.56	0.58	0.59	0.59	0.59	1.10	1.10	1.12	1.15	1.18	1.21	1.23	1.23				
170	0.58	0.58	0.59	0.61	0.63	0.65	0.65	0.67	1.08	1.07	1.10	1.14	1.17	1.20	1.21	1.21				
175	0.72	0.70	0.72	0.73	0.76	0.78	0.75	0.75	1.02	1.00	1.03	1.06	1.10	1.13	1.11	1.10				
180	0.91	0.89	0.93	0.95	0.99	0.99	0.95	0.94	0.89	0.87	0.89	0.92	0.95	0.99	0.95	0.95				

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-19

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: