


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz Lamp Flux:1960.58x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 75.72 lm/W
MODEL	SMART FIXTURE 2700K	Imax (cd)	11775	S/MH(C0/180)	0.30	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.42	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	1960.6	η UP,DN(C0-180)	0.1,42.9	
NOMINAL FLUX(lm)	1960.58	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,56.9	
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.30	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

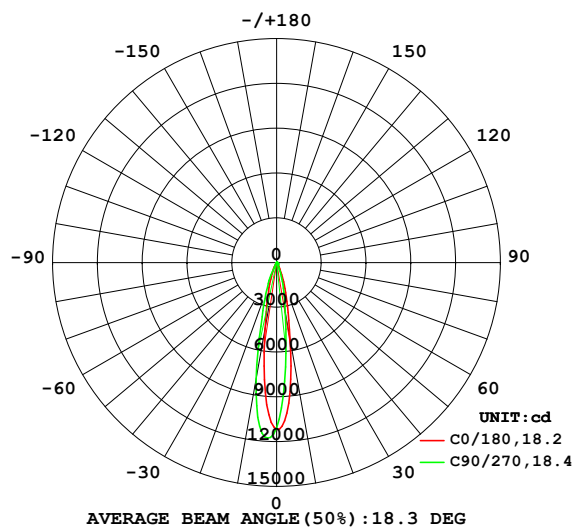

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

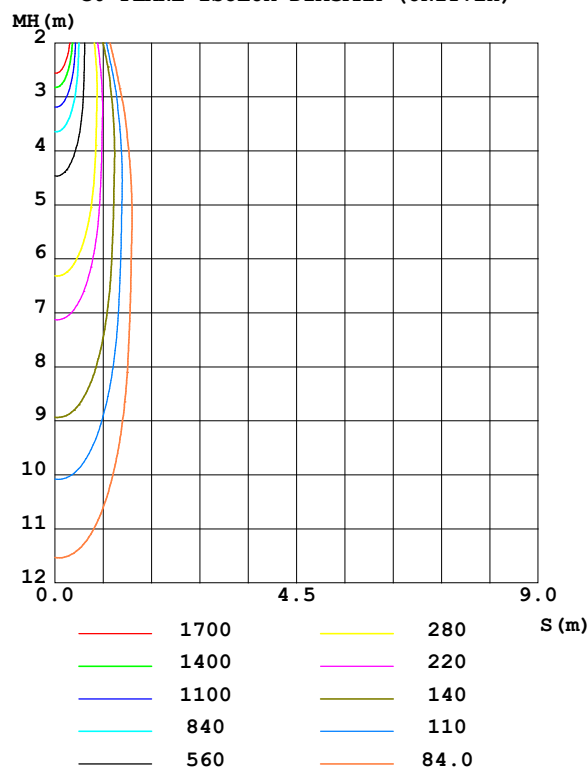

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	529.9	392.6	340.6	349.8	451.8	641.6	794.0	729.7	0- 10	744.2	744.2	38,38
20	138.7	104.7	85.45	89.20	117.5	161.1	196.8	184.4	10- 20	753.8	1498	76.4,76.4
30	33.08	25.66	22.93	23.68	27.88	16.36	18.31	29.65	20- 30	301.4	1799	91.8,91.8
40	10.26	12.21	11.23	11.00	7.415	3.632	3.276	4.807	30- 40	82.85	1882	96,96
50	4.141	7.452	6.929	6.162	2.705	0.1734	0.0647	0.7187	40- 50	42.20	1924	98.2,98.2
60	1.002	3.805	4.262	2.770	0.2687	0.0111	0	0.0231	50- 60	21.47	1946	99.3,99.3
70	0.0994	0.9462	1.621	0.4180	0.0742	0	0	0	60- 70	8.960	1955	99.7,99.7
80	0.0477	0.1281	0.1640	0.1138	0.0174	0	0	0	70- 80	1.736	1957	99.8,99.8
90	0	0.0749	0.1035	0.0605	0	0	0	0	80- 90	0.4759	1957	99.8,99.8
100	0	0.0232	0.0478	0.0101	0	0	0	0	90-100	0.2111	1957	99.8,99.8
110	0	0	0.0049	0	0	0	0	0	100-110	0.0460	1957	99.8,99.8
120	0	0	0	0	0	0	0	0	110-120	0.0003	1957	99.8,99.8
130	0	0	0.0000	0.0000	0.0000	0	0	0	120-130	0.0000	1957	99.8,99.8
140	0.0421	0.0595	0.0740	0.0740	0.0882	0.0669	0.0556	0.0576	130-140	0.1630	1958	99.8,99.8
150	0.1106	0.1246	0.1380	0.1528	0.2843	0.2595	0.2354	0.2417	140-150	0.8078	1958	99.9,99.9
160	0.1324	0.1317	0.1382	0.1513	0.4309	0.4425	0.4452	0.4522	150-160	1.160	1960	99.9,99.9
170	0.1251	0.1227	0.1313	0.1476	0.3555	0.3835	0.4288	0.4516	160-170	0.8218	1960	100,100
180	0.1732	0.1987	0.2353	0.2458	0.1739	0.1859	0.2191	0.2457	170-180	0.2380	1961	100,100
DEG	LUMINOUS INTENSITY:X10cd									UNIT:lm		

Conical surface Flux(90deg): 1906.8 lm

%lum = 97.3%

%lamp = 97.3%

Conical surface Flux(120deg): 1946 lm

%lum = 99.3%


%lamp = 99.3%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz Lamp Flux:1960.58x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

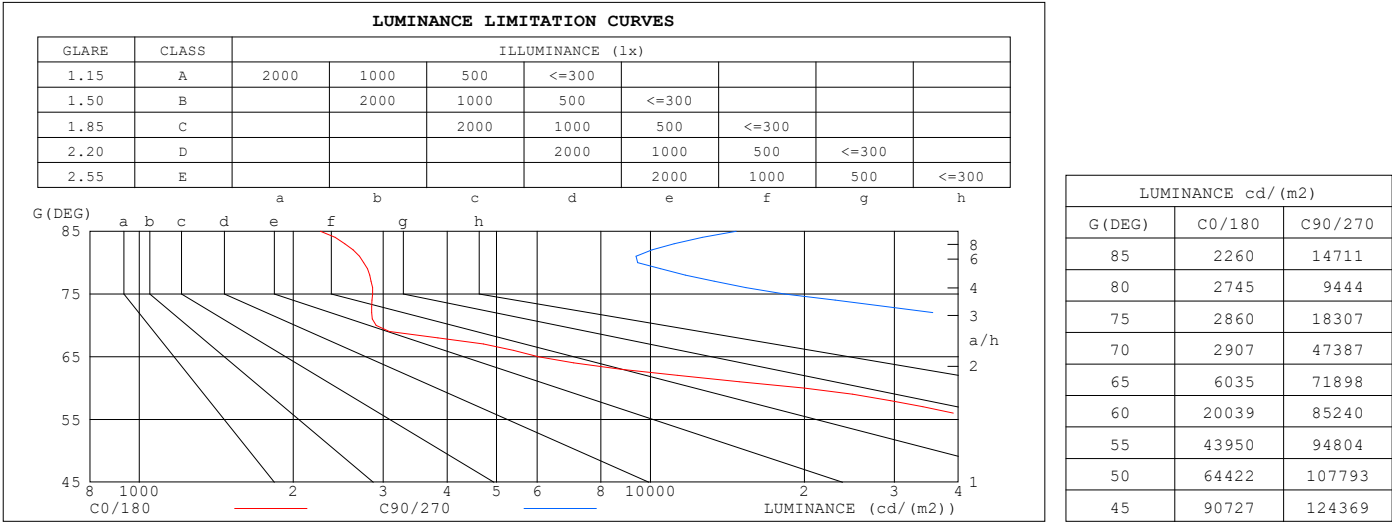


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz		
Lamp Flux:1960.58x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.13	1.11	1.09	1.11	1.09	1.07	1.07	1.05	1.04	1.03	1.02	1.01	.99	.99	.98	.96
2.0	1.07	1.04	1.02	1.06	1.03	1.00	1.02	1.00	.98	.99	.98	.96	.97	.95	.94	.93
3.0	1.02	.99	.96	1.01	.98	.95	.99	.96	.93	.96	.94	.92	.94	.92	.91	.89
4.0	.98	.94	.91	.97	.93	.91	.95	.92	.90	.93	.91	.89	.92	.89	.88	.86
5.0	.95	.90	.87	.94	.90	.87	.92	.89	.86	.91	.88	.85	.89	.87	.85	.84
6.0	.91	.87	.84	.91	.87	.84	.89	.86	.83	.88	.85	.83	.87	.84	.82	.81
7.0	.88	.84	.81	.88	.84	.81	.87	.83	.80	.85	.82	.80	.84	.82	.80	.79
8.0	.86	.81	.78	.85	.81	.78	.84	.80	.78	.83	.80	.78	.82	.79	.77	.76
9.0	.83	.79	.76	.83	.79	.76	.82	.78	.76	.81	.78	.76	.80	.77	.75	.74
10.0	.81	.77	.74	.80	.76	.74	.80	.76	.74	.79	.76	.74	.78	.75	.73	.72

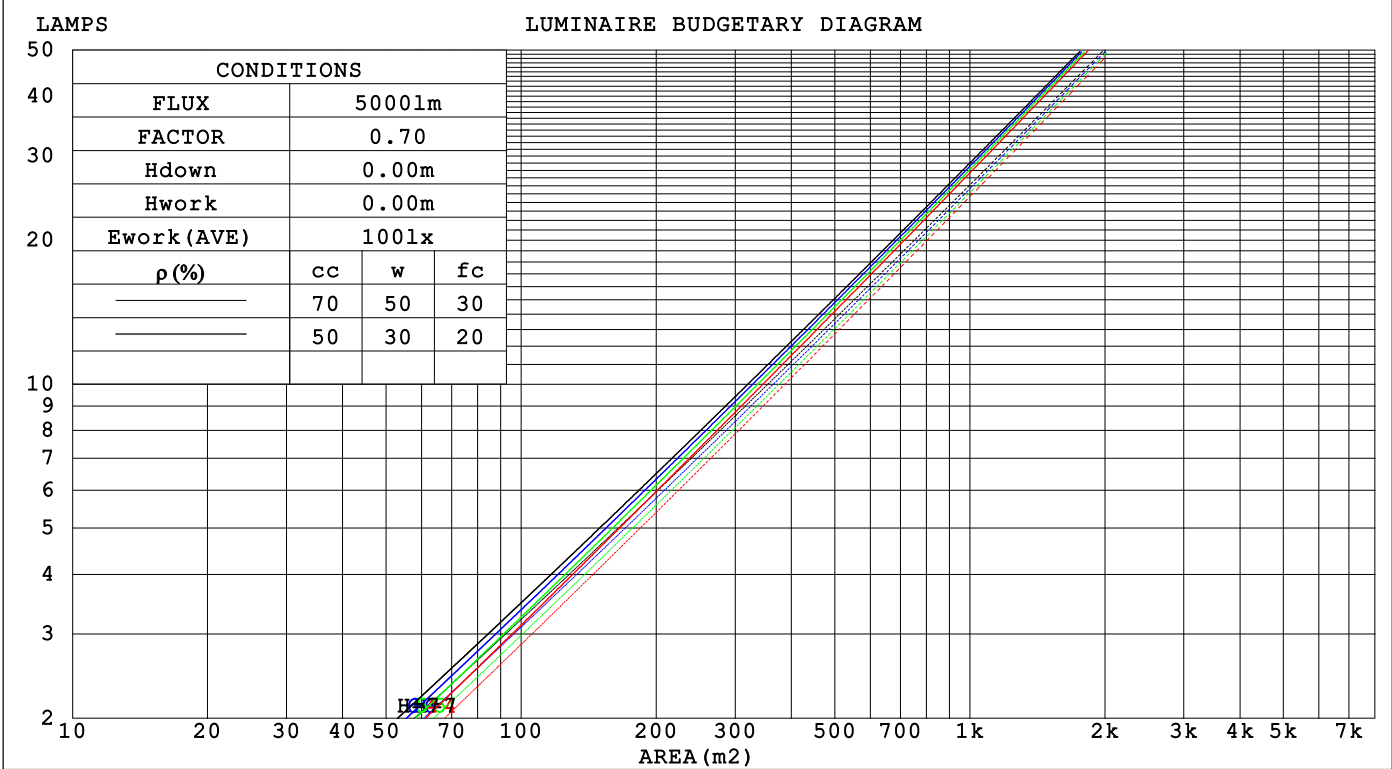

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

WEC AND CCEC

Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz Lamp Flux:1960.58x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.140	.080	.025	.134	.076	.024	.121	.070	.022	.110	.063	.020	.099	.057	.019	
2.0	.131	.072	.022	.125	.069	.021	.115	.064	.020	.105	.059	.018	.096	.055	.017	
3.0	.122	.065	.019	.117	.063	.019	.109	.059	.018	.101	.055	.017	.093	.052	.016	
4.0	.114	.059	.017	.110	.058	.017	.103	.055	.016	.096	.052	.016	.090	.049	.015	
5.0	.107	.055	.016	.104	.053	.016	.098	.051	.015	.092	.049	.014	.087	.046	.014	
6.0	.102	.051	.015	.099	.050	.014	.093	.048	.014	.088	.046	.013	.084	.044	.013	
7.0	.096	.048	.013	.094	.047	.013	.089	.045	.013	.085	.043	.013	.081	.042	.012	
8.0	.092	.045	.013	.089	.044	.012	.085	.043	.012	.081	.041	.012	.078	.040	.012	
9.0	.087	.042	.012	.085	.042	.012	.082	.040	.011	.078	.039	.011	.075	.038	.011	
10.0	.083	.040	.011	.082	.040	.011	.079	.038	.011	.076	.037	.011	.073	.037	.010	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.170	.159	.149	.145	.136	.128	.099	.094	.089	.057	.054	.052	.018	.017	.017	
2.0	.152	.134	.119	.130	.115	.103	.089	.080	.072	.051	.046	.042	.017	.015	.014	
3.0	.137	.115	.097	.118	.099	.084	.081	.069	.059	.047	.040	.035	.015	.013	.011	
4.0	.125	.099	.080	.107	.086	.069	.074	.060	.049	.043	.035	.029	.014	.011	.009	
5.0	.115	.087	.067	.098	.075	.058	.068	.053	.041	.039	.031	.024	.013	.010	.008	
6.0	.106	.077	.057	.091	.067	.049	.063	.047	.035	.036	.028	.021	.012	.009	.007	
7.0	.098	.069	.049	.084	.060	.042	.058	.042	.030	.034	.025	.018	.011	.008	.006	
8.0	.092	.062	.042	.079	.054	.037	.055	.038	.026	.032	.022	.016	.010	.007	.005	
9.0	.086	.057	.037	.074	.049	.032	.051	.035	.023	.030	.020	.014	.010	.007	.005	
10.0	.081	.052	.032	.070	.045	.028	.048	.032	.020	.028	.019	.012	.009	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz Lamp Flux:1960.58x1 lm											
NAME:			TYPE:			WEIGHT:					
SPEC.:			DIM.:			SERIAL No.:					
MFR.:			SUR.:			Shielding Angle:					
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions	Viewed crosswise					Viewed endwise					
x = 2H y = 2H	3H	18.9	19.5	19.2	19.7	19.9	21.2	21.8	21.4	22.0	22.2
	4H	18.8	19.4	19.1	19.7	19.9	21.2	21.8	21.4	22.0	22.2
	6H	18.8	19.3	19.1	19.6	19.8	21.1	21.7	21.4	21.9	22.2
	8H	18.7	19.3	19.0	19.5	19.8	21.1	21.6	21.4	21.9	22.1
	12H	18.7	19.2	19.0	19.5	19.7	21.0	21.6	21.4	21.8	22.1
	4H	19.4	20.0	19.7	20.2	20.4	20.8	21.4	21.0	21.6	21.8
4H	3H	19.3	19.8	19.6	20.1	20.4	21.4	21.9	21.7	22.2	22.4
	4H	19.2	19.7	19.6	20.0	20.3	21.4	21.9	21.7	22.2	22.5
	6H	19.1	19.5	19.5	19.9	20.2	21.3	21.7	21.7	22.1	22.4
	8H	19.1	19.5	19.5	19.8	20.2	21.3	21.7	21.7	22.0	22.4
	12H	19.0	19.4	19.4	19.7	20.1	21.2	21.6	21.6	22.0	22.4
	8H	19.1	19.5	19.5	19.9	20.2	21.2	21.6	21.6	22.0	22.4
8H	6H	19.0	19.4	19.4	19.7	20.2	21.2	21.5	21.6	21.9	22.3
	8H	19.0	19.3	19.4	19.7	20.1	21.1	21.4	21.6	21.8	22.3
	12H	18.9	19.2	19.4	19.6	20.1	21.1	21.3	21.6	21.8	22.3
	12H	19.1	19.4	19.5	19.8	20.2	21.2	21.6	21.6	21.9	22.3
12H	6H	19.0	19.3	19.4	19.7	20.1	21.1	21.4	21.6	21.8	22.3
	8H	18.9	19.2	19.4	19.6	20.1	21.1	21.3	21.5	21.8	22.2
	Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.5 / - 2.8					+ 0.7 / - 1.0					
1.5H	+ 1.3 / - 2.2					+ 0.4 / - 0.7					
2.0H	+ 2.1 / - 6.3					+ 1.0 / - 1.0					

CIE Pub.117, 1961 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 2.3$)
Area: 0.001 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz Lamp Flux:1960.58x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	89	83	79	89	83	79	88	82	79	76
0.80	96	91	87	96	90	87	94	90	87	83
1.00	100	95	92	100	95	91	98	94	91	87
1.25	104	99	96	103	99	96	101	97	95	91
1.50	107	102	99	105	101	99	103	100	97	93
2.00	109	105	102	108	104	101	105	102	100	95
2.50	111	107	104	109	106	103	106	103	101	96
3.00	112	109	106	110	107	105	107	105	103	97
4.00	114	111	109	112	110	108	108	107	105	98
5.00	115	113	111	113	111	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz Lamp Flux:1960.58x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

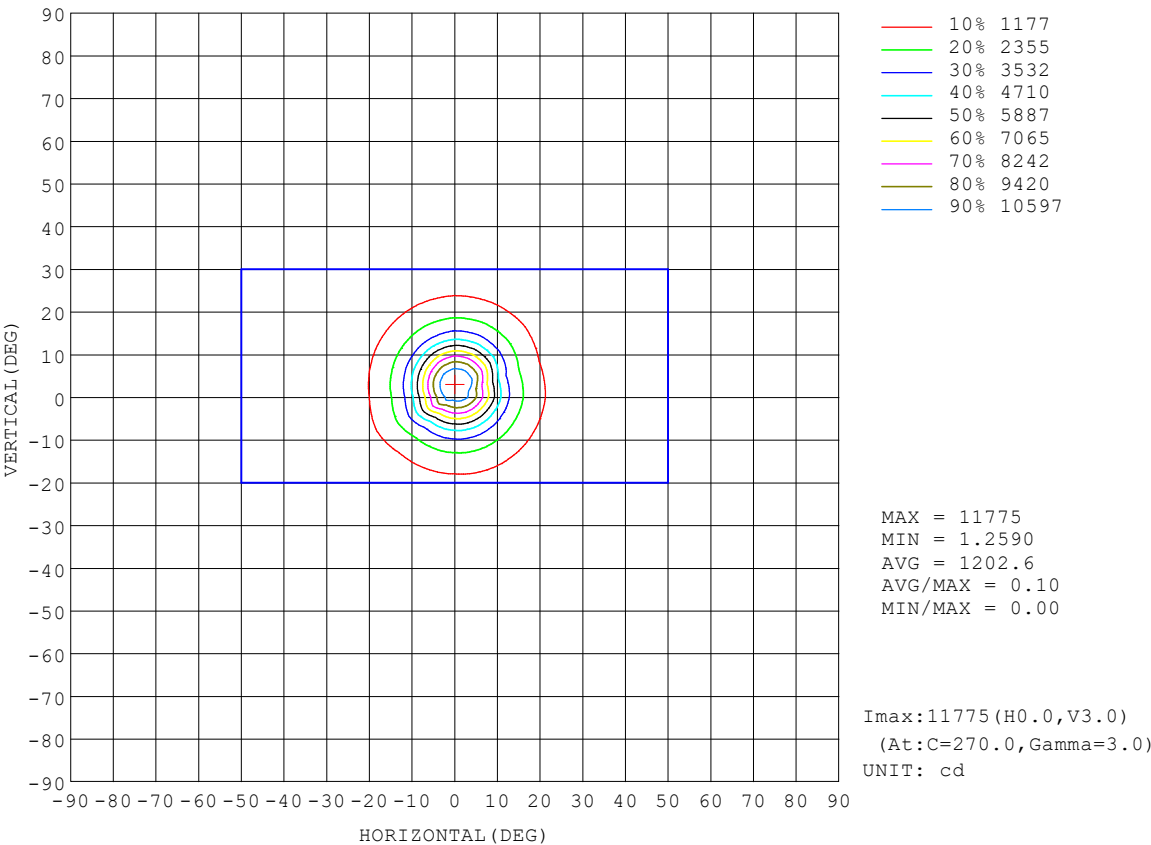

C Range: 0 - 360DEG C Interval: 22.5DEG Test Speed: HIGH Temperature:25.3℃ Operators:Allen Test Date:2026-01-29	γ Range: 0 - 180DEG γ Interval: 1.0DEG Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459 Humidity:45% Test Distance:2.900m [K=0.8783] Remarks:
--	---

AAI Figure

Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz Lamp Flux:1960.58x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

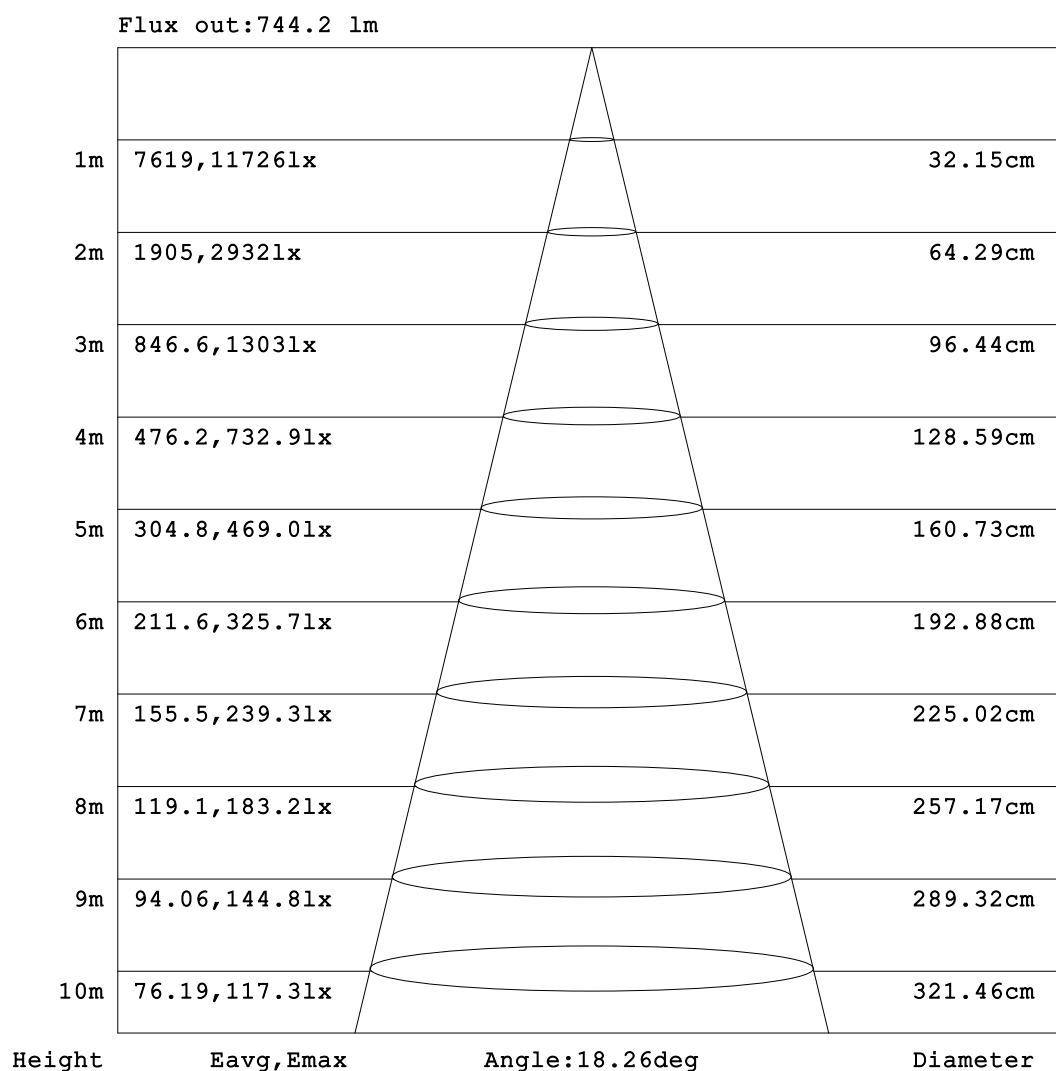


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ISOLUX DIAGRAM


Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz Lamp Flux:1960.58x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

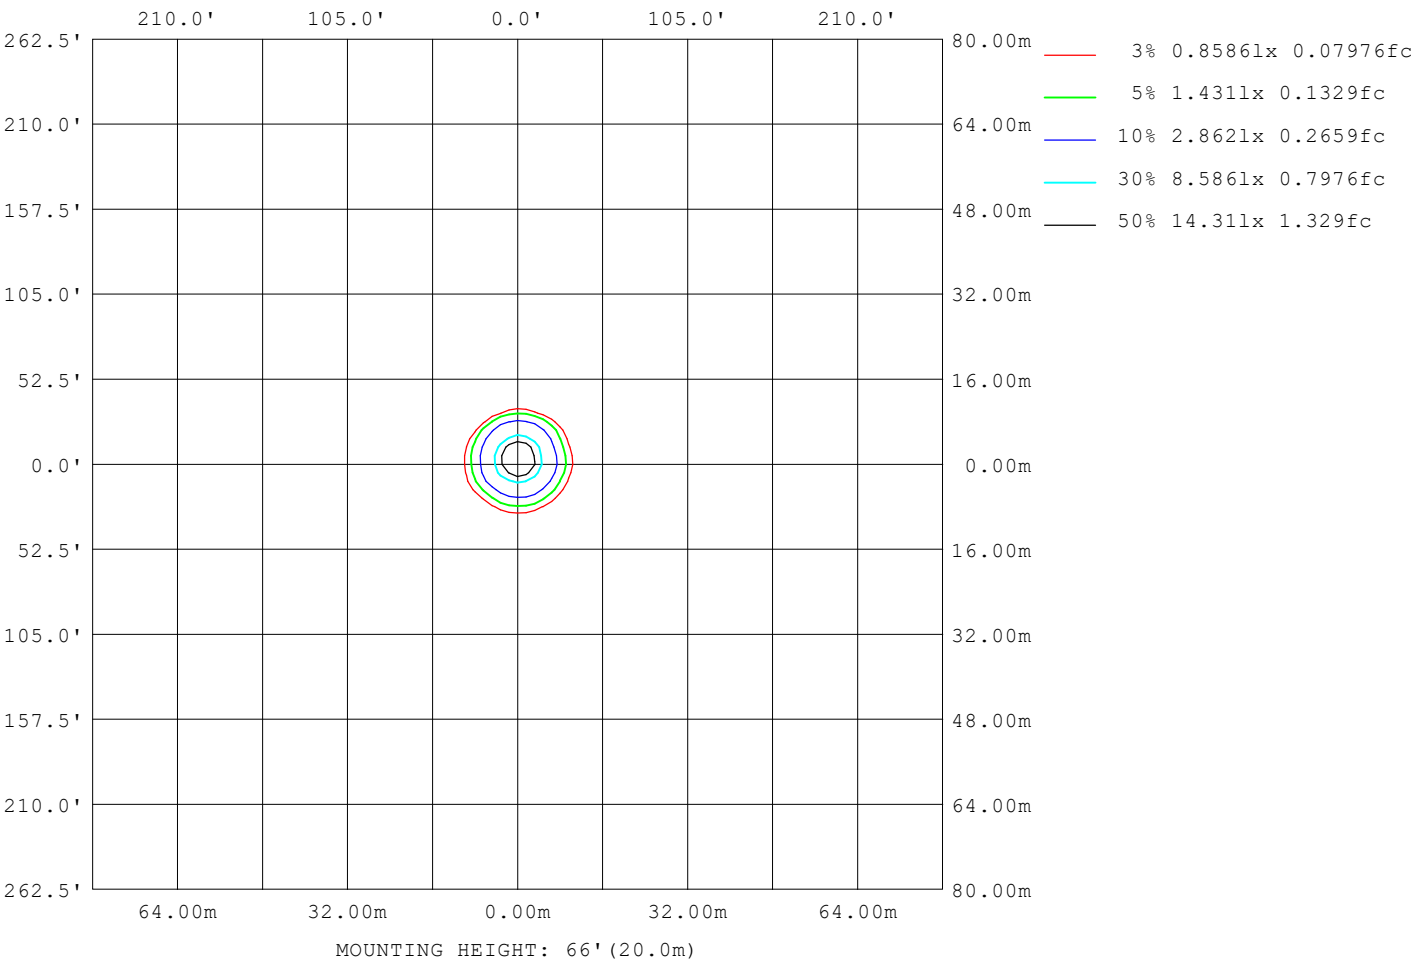

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

Planar Illuminance Curve

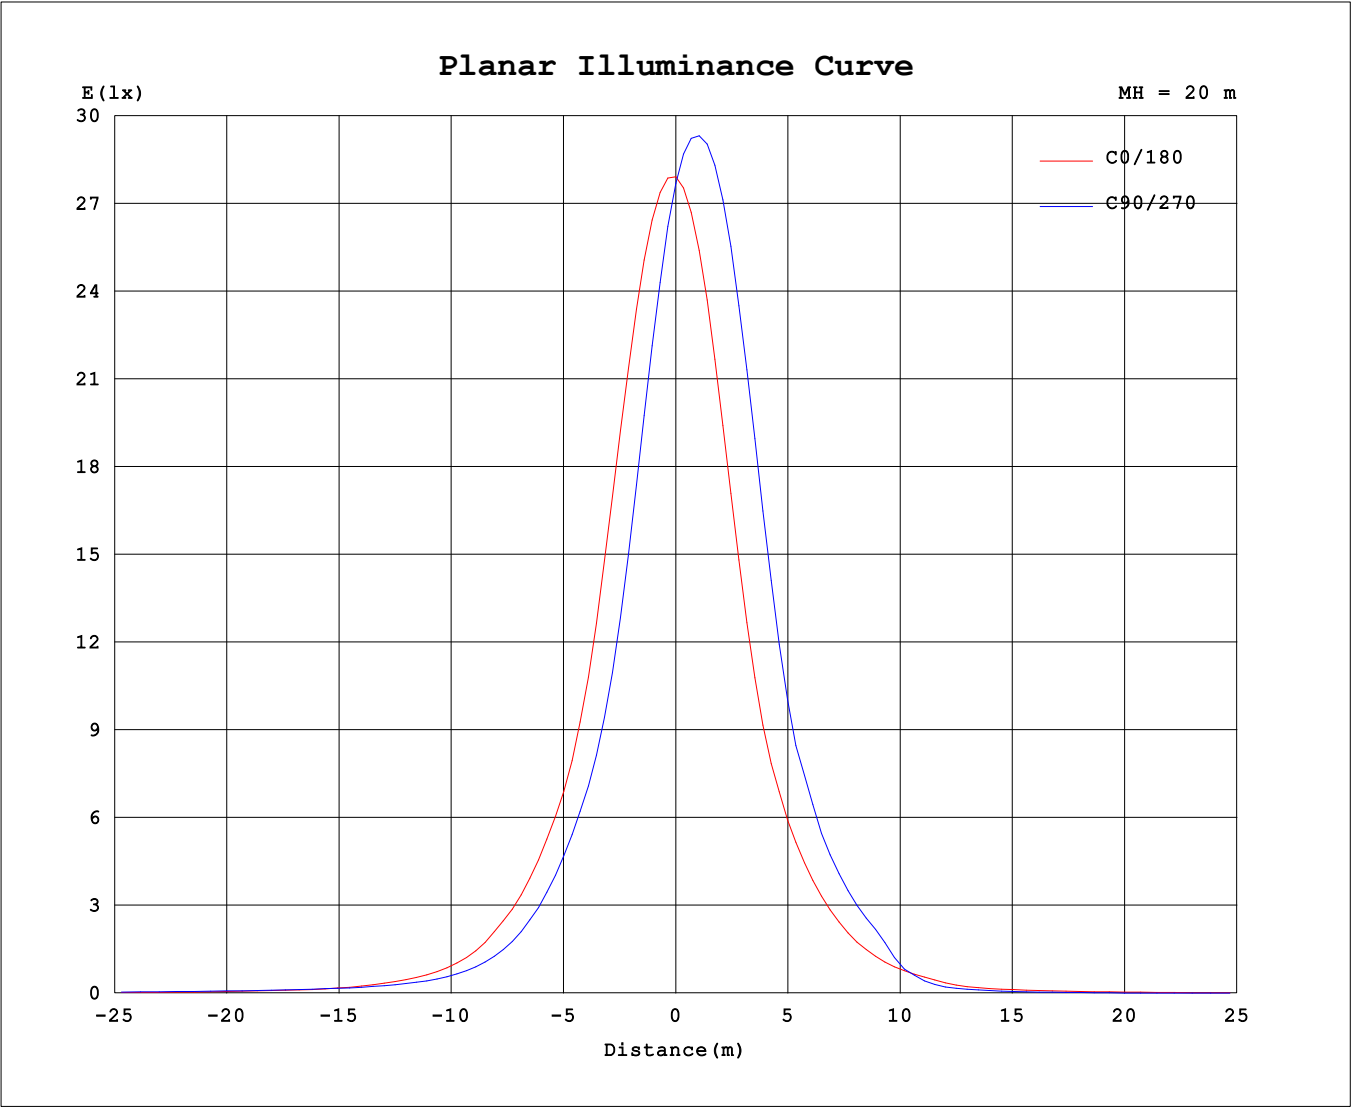

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:2.6680A P:25.893W PF:0.8323 Freq:60.02Hz Lamp Flux:1960.58x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: X10cd

C (DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	1117	1115	1112	1110	1107	1108	1105	1125	1117	1115	1112	1110	1107	1108	1105	1125			
5	946	856	783	733	703	702	729	868	877	969	1053	1116	1145	1141	1103	971			
10	530	449	393	359	341	339	350	444	452	538	642	737	794	787	730	553			
15	268	235	210	189	179	178	182	225	229	269	310	345	376	377	350	281			
20	139	121	105	91.0	85.5	85.4	89.2	115	118	137	161	183	197	197	184	144			
25	65.8	55.5	48.1	43.2	41.2	41.4	43.4	54.9	57.2	68.2	75.3	80.2	93.0	95.5	91.1	69.1			
30	33.1	28.7	25.7	23.7	22.9	22.9	23.7	28.7	27.9	19.8	16.4	15.8	18.3	20.3	29.7	29.7			
35	17.6	17.7	16.5	15.6	14.9	14.6	14.7	16.8	11.8	8.89	6.88	6.31	6.64	7.30	9.45	11.5			
40	10.3	12.4	12.2	11.7	11.2	11.1	11.0	10.7	7.42	4.88	3.63	3.29	3.28	3.68	4.81	6.62			
45	6.42	8.87	9.57	9.30	8.79	8.67	8.52	7.38	4.46	2.80	1.53	1.01	1.09	1.44	2.65	3.92			
50	4.14	5.96	7.45	7.29	6.93	6.81	6.16	4.65	2.71	1.00	0.17	0.04	0.06	0.14	0.72	2.15			
55	2.52	4.15	5.44	5.63	5.44	5.18	4.22	3.11	1.12	0.18	0.02	0.00	0.00	0.00	0.09	0.54			
60	1.00	2.60	3.81	4.34	4.26	3.83	2.77	1.56	0.27	0.05	0.01	0.00	0.00	0.00	0.02	0.13			
65	0.26	1.12	2.31	2.97	3.04	2.38	1.36	0.48	0.10	0.04	0.00	0.00	0.00	0.00	0.01	0.06			
70	0.10	0.32	0.95	1.53	1.62	1.07	0.42	0.19	0.07	0.01	0.00	0.00	0.00	0.00	0.00	0.04			
75	0.07	0.13	0.29	0.46	0.47	0.32	0.17	0.10	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.01			
80	0.05	0.09	0.13	0.17	0.16	0.14	0.11	0.08	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
85	0.02	0.07	0.10	0.12	0.13	0.12	0.09	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.00	0.04	0.07	0.10	0.10	0.09	0.06	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.01	0.05	0.07	0.07	0.06	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.00	0.02	0.04	0.05	0.04	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.00	0.02	0.02	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0.01	0.03	0.02	0.02	0.02	0.01	0.01	0.01	0.02			
140	0.04	0.05	0.06	0.07	0.07	0.08	0.07	0.05	0.09	0.08	0.07	0.06	0.06	0.06	0.06	0.08			
145	0.09	0.10	0.11	0.12	0.13	0.13	0.13	0.12	0.18	0.17	0.15	0.14	0.13	0.13	0.14	0.17			
150	0.11	0.12	0.12	0.13	0.14	0.15	0.15	0.15	0.28	0.28	0.26	0.24	0.24	0.24	0.24	0.28			
155	0.14	0.14	0.14	0.14	0.14	0.15	0.16	0.16	0.38	0.38	0.37	0.37	0.36	0.36	0.37	0.40			
160	0.13	0.13	0.13	0.13	0.14	0.14	0.15	0.16	0.43	0.43	0.44	0.44	0.45	0.45	0.45	0.46			
165	0.13	0.12	0.13	0.13	0.13	0.14	0.15	0.15	0.41	0.42	0.44	0.45	0.46	0.47	0.47	0.47			
170	0.13	0.12	0.12	0.13	0.13	0.14	0.15	0.16	0.36	0.36	0.38	0.41	0.43	0.44	0.45	0.44			
175	0.13	0.14	0.14	0.14	0.15	0.16	0.17	0.17	0.27	0.27	0.30	0.32	0.35	0.37	0.38	0.35			
180	0.17	0.18	0.20	0.22	0.24	0.24	0.25	0.23	0.17	0.18	0.19	0.20	0.22	0.24	0.25	0.23			

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: