


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz Lamp Flux:931.651x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 64.25 lm/W
MODEL	SMART FIXTURE 2700K	Imax (cd)	2268	S/MH(C0/180)	0.54	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.65	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	931.65	η UP,DN(C0-180)	0.1,47.2	
NOMINAL FLUX(lm)	931.651	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,52.7	
LAMPS INSIDE	1	η up (%)	0.1	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)		η down (%)	99.9	CIBSE SHR MAX	0.55	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

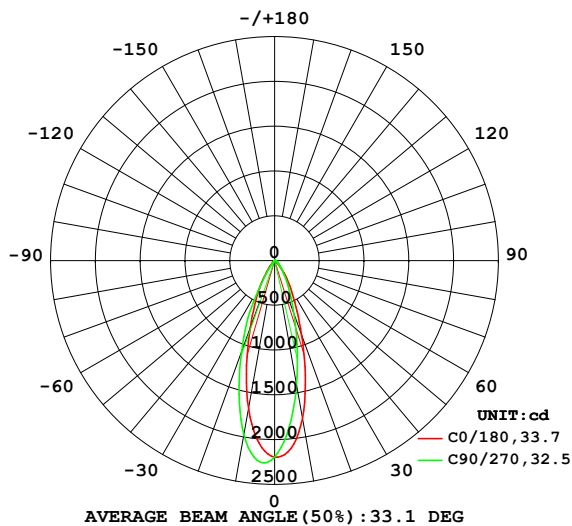

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

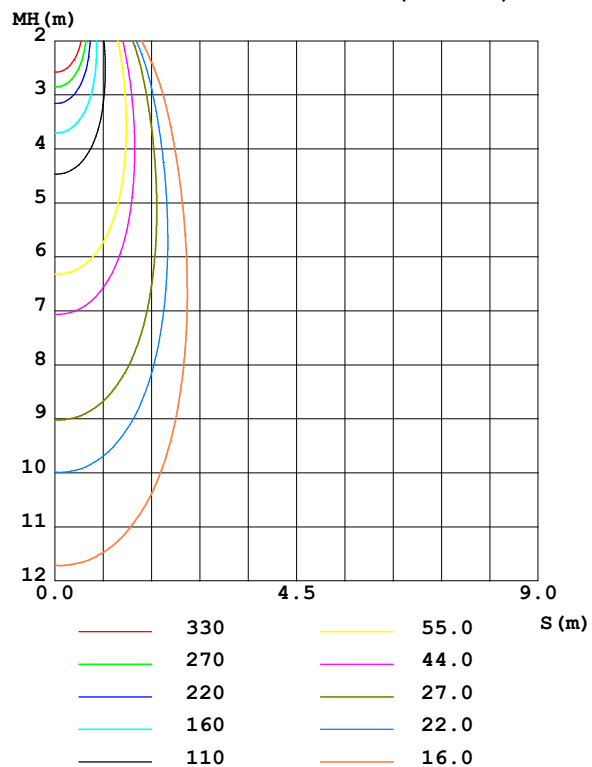

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1792	1551	1414	1468	1681	1887	1977	1974	0- 10	185.9	185.9	20,20
20	886.5	699.7	636.7	642.6	801.1	964.8	1083	1078	10- 20	347.5	533.5	57.3,57.3
30	358.7	259.8	272.4	235.9	316.9	238.0	314.2	354.7	20- 30	244.9	778.3	83.5,83.5
40	119.4	107.4	121.8	94.69	73.73	31.36	34.17	44.71	30- 40	98.46	876.8	94.1,94.1
50	28.35	49.88	55.53	36.92	15.34	1.099	0.4913	4.760	40- 50	34.56	911.3	97.8,97.8
60	5.763	19.67	25.23	12.86	1.658	0.0124	0	0.1203	50- 60	13.10	924.4	99.2,99.2
70	0.7254	5.087	8.125	2.483	0.4836	0	0	0	60- 70	4.619	929.1	99.7,99.7
80	0.3325	0.8975	1.074	0.7628	0.0621	0	0	0	70- 80	1.023	930.1	99.8,99.8
90	0	0.5153	0.7195	0.3775	0	0	0	0	80- 90	0.3190	930.4	99.9,99.9
100	0	0.1185	0.2904	0.0089	0	0	0	0	90-100	0.1332	930.5	99.9,99.9
110	0	0	0	0	0	0	0	0	100-110	0.0199	930.5	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0	930.5	99.9,99.9
130	0	0	0	0	0	0	0	0	120-130	0	930.5	99.9,99.9
140	0.1111	0.1508	0.1766	0.1967	0.3574	0.2974	0.2524	0.2642	130-140	0.0490	930.6	99.9,99.9
150	0.3126	0.3566	0.4021	0.4346	0.9529	0.9012	0.8434	0.8671	140-150	0.2676	930.9	99.9,99.9
160	0.5329	0.5490	0.5891	0.6431	1.430	1.440	1.448	1.477	150-160	0.3869	931.3	100,100
170	0.6038	0.5963	0.6436	0.7181	1.342	1.393	1.494	1.561	160-170	0.2983	931.5	100,100
180	0.9483	1.031	1.144	1.178	0.9370	0.9798	1.073	1.154	170-180	0.1011	931.7	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 898.32 lm

%lum = 96.4%

%lamp = 96.4%

Conical surface Flux(120deg): 924.43 lm

%lum = 99.2%


%lamp = 99.2%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz Lamp Flux:931.651x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

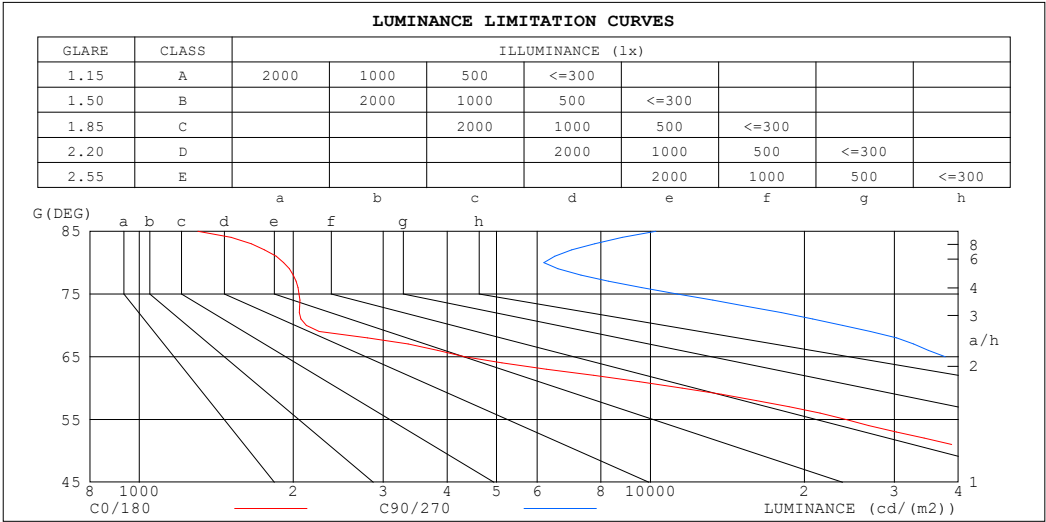

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	1302	10254
80	1915	6182
75	2054	11287
70	2121	23755
65	4330	37741
60	11525	50456
55	24147	65714
50	44099	86396
45	83655	115841


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz		
Lamp Flux:931.651x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.09	1.07	1.09	1.07	1.06	1.05	1.04	1.02	1.02	1.00	.99	.98	.97	.96	.95
2.0	1.05	1.01	.98	1.03	.00	.97	.00	.97	.95	.97	.95	.93	.94	.93	.91	.89
3.0	.99	.95	.91	.98	.94	.90	.95	.92	.89	.93	.90	.87	.90	.88	.86	.85
4.0	.94	.89	.85	.93	.88	.85	.90	.87	.84	.88	.85	.83	.87	.84	.82	.80
5.0	.89	.84	.80	.88	.83	.80	.86	.82	.79	.85	.81	.78	.83	.80	.78	.76
6.0	.84	.79	.76	.84	.79	.75	.82	.78	.75	.81	.77	.74	.80	.76	.74	.73
7.0	.81	.75	.72	.80	.75	.71	.79	.74	.71	.78	.74	.71	.76	.73	.70	.69
8.0	.77	.72	.68	.76	.71	.68	.75	.71	.68	.74	.70	.67	.73	.70	.67	.66
9.0	.74	.69	.65	.73	.68	.65	.72	.68	.65	.71	.67	.65	.71	.67	.64	.63
10.0	.71	.66	.62	.70	.65	.62	.69	.65	.62	.69	.65	.62	.68	.64	.62	.61

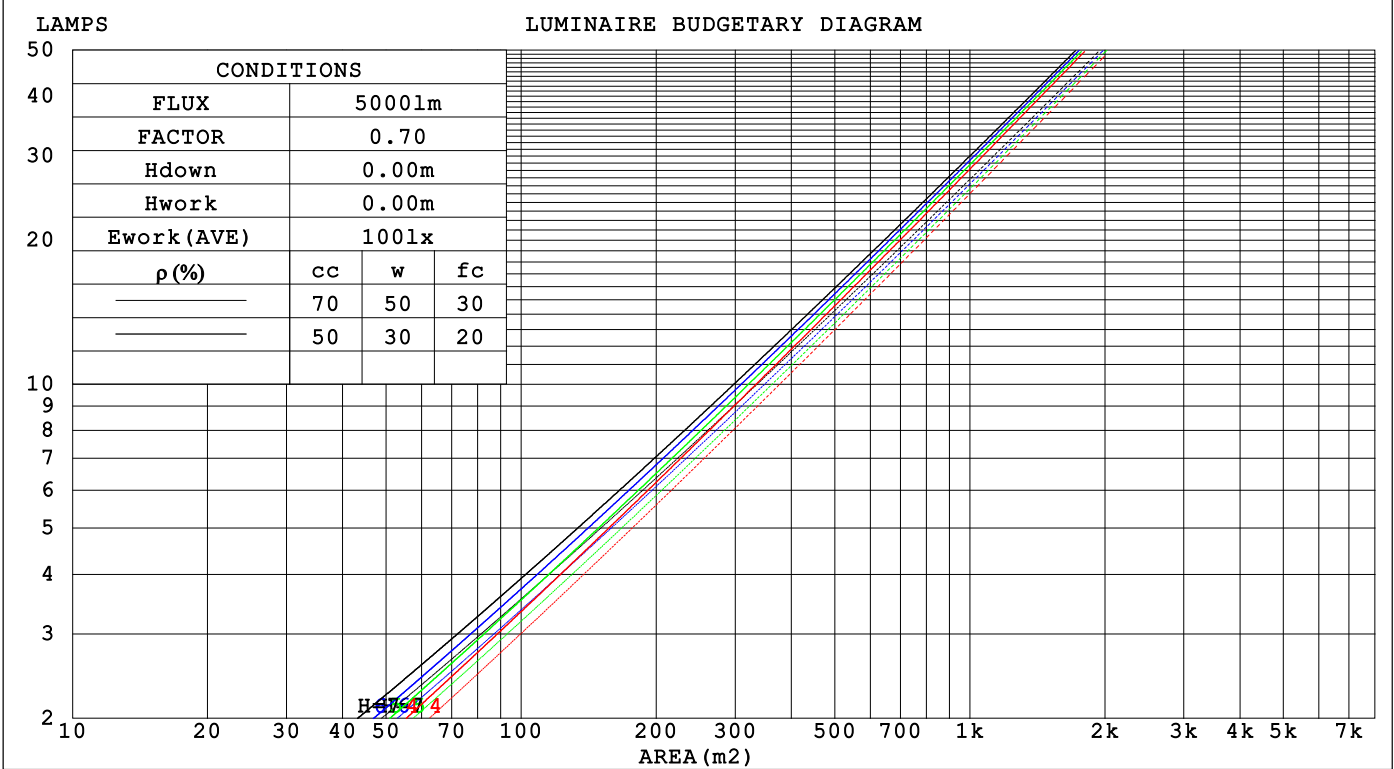

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

WEC AND CCEC

Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz Lamp Flux:931.651x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.161	.092	.029	.155	.088	.028	.142	.081	.026	.130	.075	.024	.120	.069	.022															
2.0	.153	.084	.026	.147	.081	.025	.137	.076	.024	.127	.071	.022	.118	.067	.021															
3.0	.144	.077	.023	.140	.075	.022	.131	.071	.022	.122	.067	.021	.115	.064	.020															
4.0	.137	.071	.021	.133	.069	.021	.125	.066	.020	.118	.063	.019	.111	.060	.018															
5.0	.130	.066	.019	.126	.065	.019	.120	.062	.018	.113	.060	.018	.108	.058	.017															
6.0	.123	.062	.018	.120	.061	.017	.115	.059	.017	.109	.057	.017	.104	.055	.016															
7.0	.118	.058	.016	.115	.057	.016	.110	.056	.016	.105	.054	.016	.101	.052	.015															
8.0	.112	.055	.015	.110	.054	.015	.106	.053	.015	.101	.051	.015	.097	.050	.015															
9.0	.108	.052	.015	.105	.051	.014	.101	.050	.014	.098	.049	.014	.094	.048	.014															
10.0	.103	.049	.014	.101	.049	.014	.098	.048	.013	.094	.047	.013	.091	.046	.013															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.171	.158	.147	.146	.136	.127	.100	.094	.088	.058	.054	.051	.018	.017	.016	
2.0	.155	.134	.116	.133	.115	.100	.091	.080	.070	.052	.046	.041	.017	.015	.013	
3.0	.141	.114	.093	.121	.099	.081	.083	.069	.057	.048	.040	.033	.015	.013	.011	
4.0	.130	.100	.076	.112	.086	.066	.077	.060	.047	.044	.035	.028	.014	.011	.009	
5.0	.121	.088	.063	.104	.076	.055	.071	.053	.039	.041	.031	.023	.013	.010	.008	
6.0	.113	.078	.053	.097	.068	.046	.067	.047	.033	.039	.028	.019	.013	.009	.006	
7.0	.106	.070	.045	.091	.061	.040	.063	.043	.028	.037	.025	.017	.012	.008	.006	
8.0	.100	.064	.039	.086	.055	.034	.059	.039	.024	.035	.023	.014	.011	.008	.005	
9.0	.094	.058	.034	.081	.051	.030	.056	.036	.021	.033	.021	.013	.011	.007	.004	
10.0	.090	.054	.030	.077	.047	.026	.054	.033	.019	.031	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz Lamp Flux:931.651x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	23.1	23.9	23.3	24.0	24.2	23.8	24.6	24.0	24.8	25.0
3H	22.9	23.7	23.2	23.9	24.1	24.0	24.8	24.2	25.0	25.1
4H	22.8	23.6	23.1	23.8	24.0	24.0	24.7	24.2	24.9	25.1
6H	22.7	23.4	23.0	23.7	23.9	23.9	24.6	24.2	24.8	25.0
8H	22.7	23.4	23.0	23.6	23.9	23.8	24.5	24.2	24.8	25.0
12H	22.7	23.3	23.0	23.5	23.8	23.8	24.4	24.1	24.7	25.0
4H 2H	23.1	23.8	23.3	24.0	24.2	23.8	24.5	24.0	24.7	24.9
3H	22.9	23.5	23.2	23.8	24.1	24.0	24.6	24.3	24.9	25.1
4H	22.8	23.4	23.2	23.7	24.0	24.0	24.5	24.3	24.8	25.1
6H	22.7	23.2	23.1	23.6	23.9	23.9	24.4	24.3	24.7	25.1
8H	22.7	23.2	23.1	23.5	23.9	23.8	24.3	24.2	24.7	25.0
12H	22.6	23.1	23.0	23.4	23.8	23.8	24.2	24.2	24.6	25.0
8H 4H	22.7	23.2	23.1	23.5	23.9	23.8	24.3	24.2	24.6	25.0
6H	22.6	23.0	23.0	23.4	23.8	23.7	24.1	24.2	24.5	24.9
8H	22.6	22.9	23.0	23.3	23.8	23.7	24.0	24.1	24.5	24.9
12H	22.5	22.8	23.0	23.2	23.7	23.7	24.0	24.1	24.4	24.9
12H 4H	22.7	23.1	23.1	23.5	23.8	23.8	24.2	24.2	24.6	25.0
6H	22.6	22.9	23.0	23.3	23.8	23.7	24.0	24.1	24.4	24.9
8H	22.5	22.8	23.0	23.2	23.7	23.6	23.9	24.1	24.4	24.9
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.7 / - 6.1					+ 1.5 / - 2.1				
1.5H	+ 3.8 / - 4.6					+ 2.2 / - 1.6				
2.0H	+ 3.9 / - 7.1					+ 2.8 / - 2.6				

CIE Pub.117, 931.7 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.2)
Area: 0.001 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz Lamp Flux:931.651x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	88	82	78	87	81	78	87	81	78	74
0.80	95	89	86	95	89	86	93	89	85	82
1.00	100	94	91	99	94	90	97	93	90	86
1.25	104	98	95	102	98	95	101	97	94	90
1.50	106	102	98	105	101	98	103	99	97	92
2.00	109	105	102	107	104	101	105	102	99	94
2.50	110	107	104	109	105	103	106	103	101	95
3.00	112	109	106	110	107	105	107	104	103	96
4.00	114	111	109	112	110	108	108	106	105	98
5.00	115	113	111	113	111	110	109	108	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz Lamp Flux:931.651x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

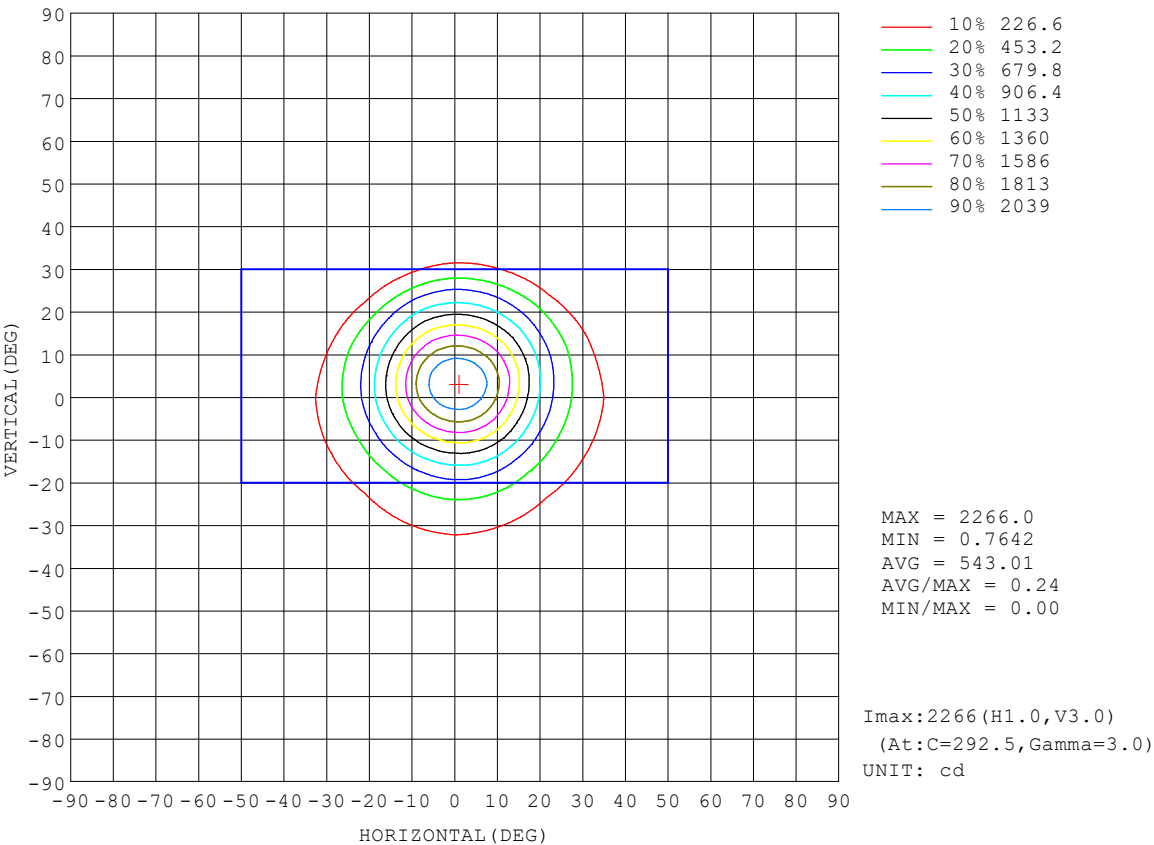

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-29	Remarks:

AAI Figure

Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz Lamp Flux:931.651x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

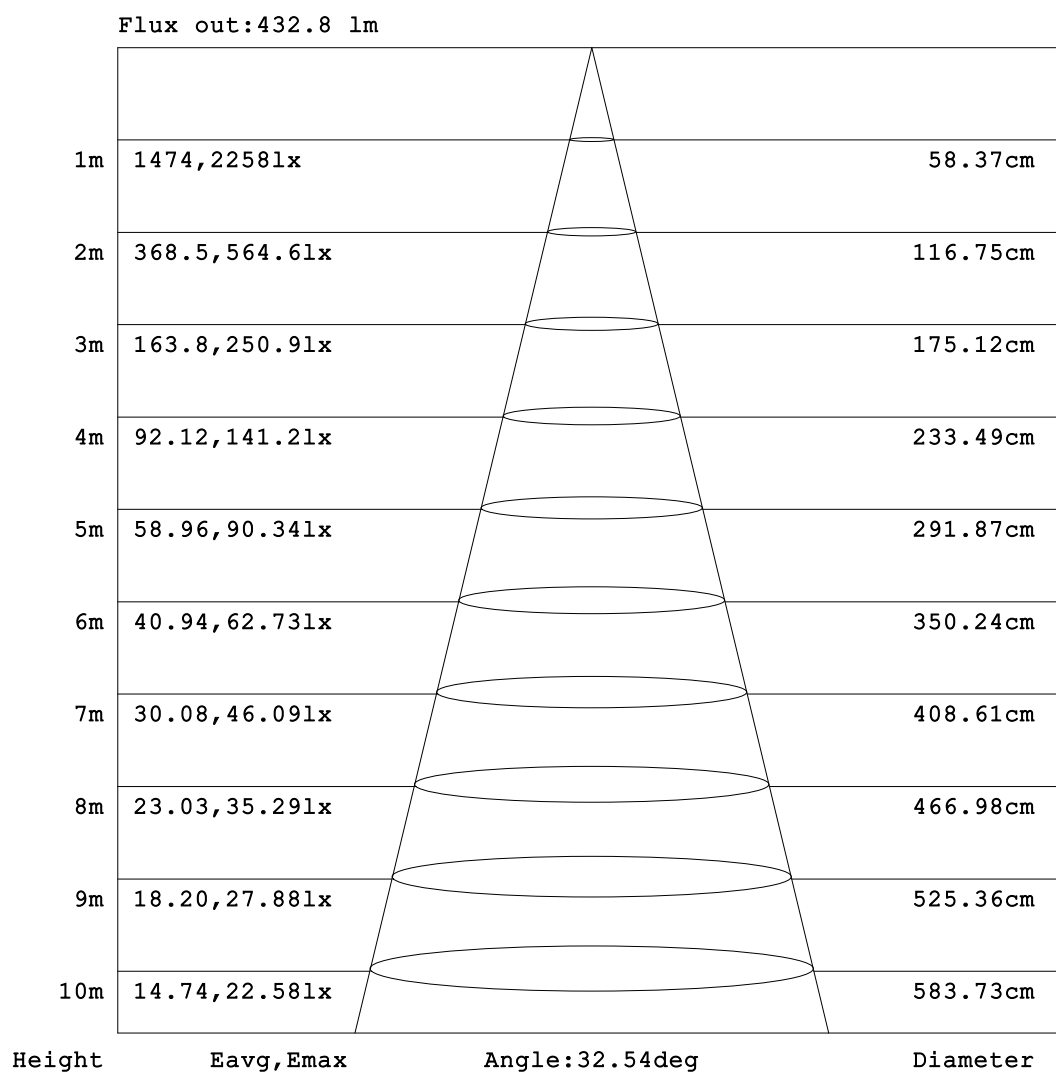


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3℃
Operators: Allen
Test Date: 2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:

ISOLUX DIAGRAM


Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz Lamp Flux:931.651x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

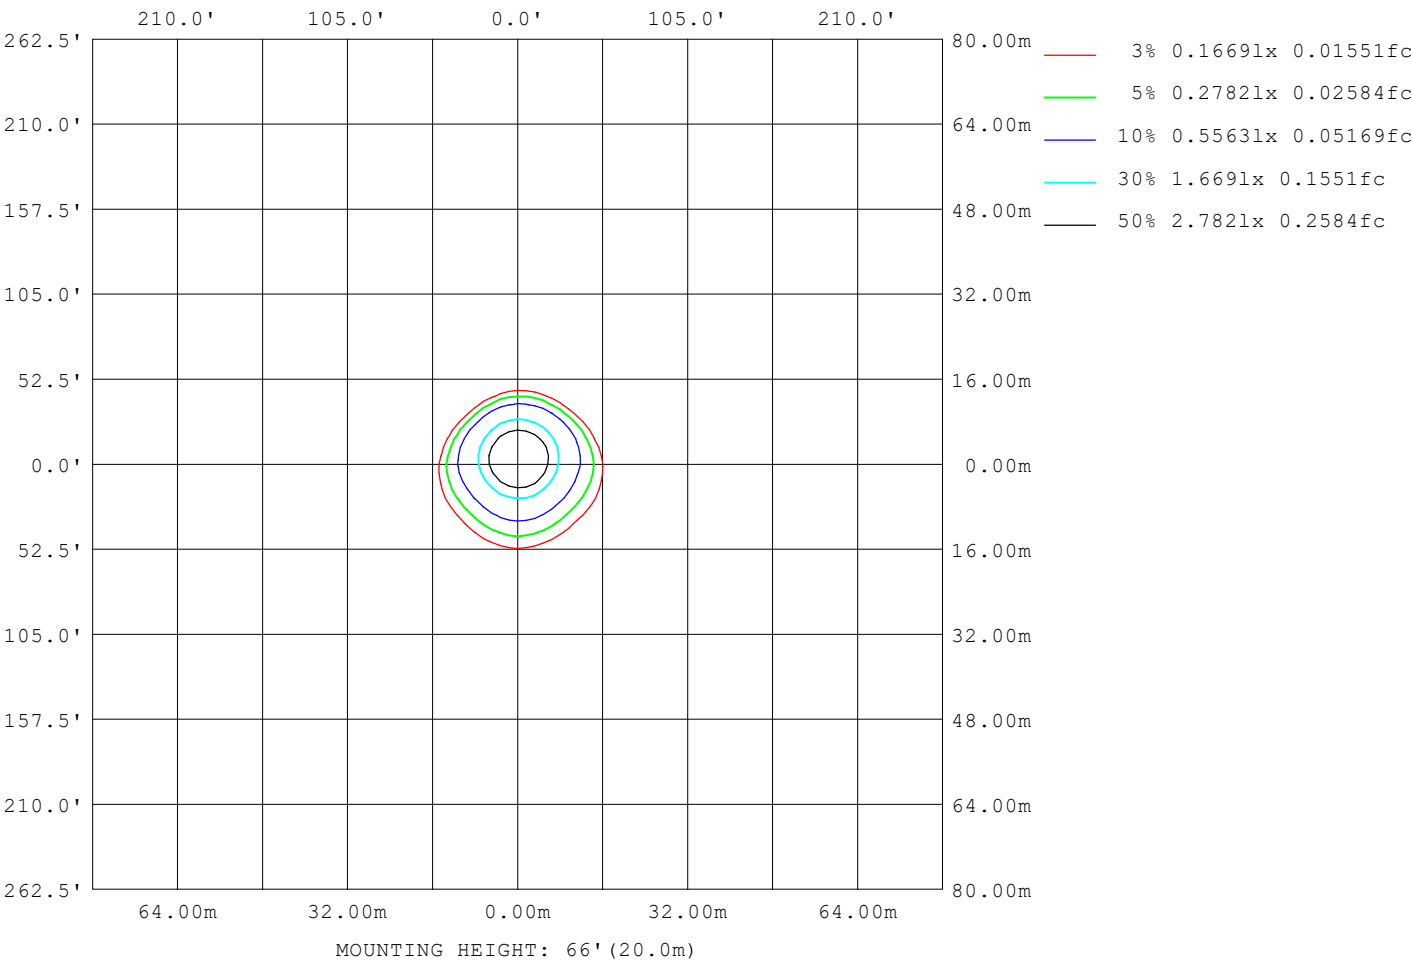

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

Planar Illuminance Curve

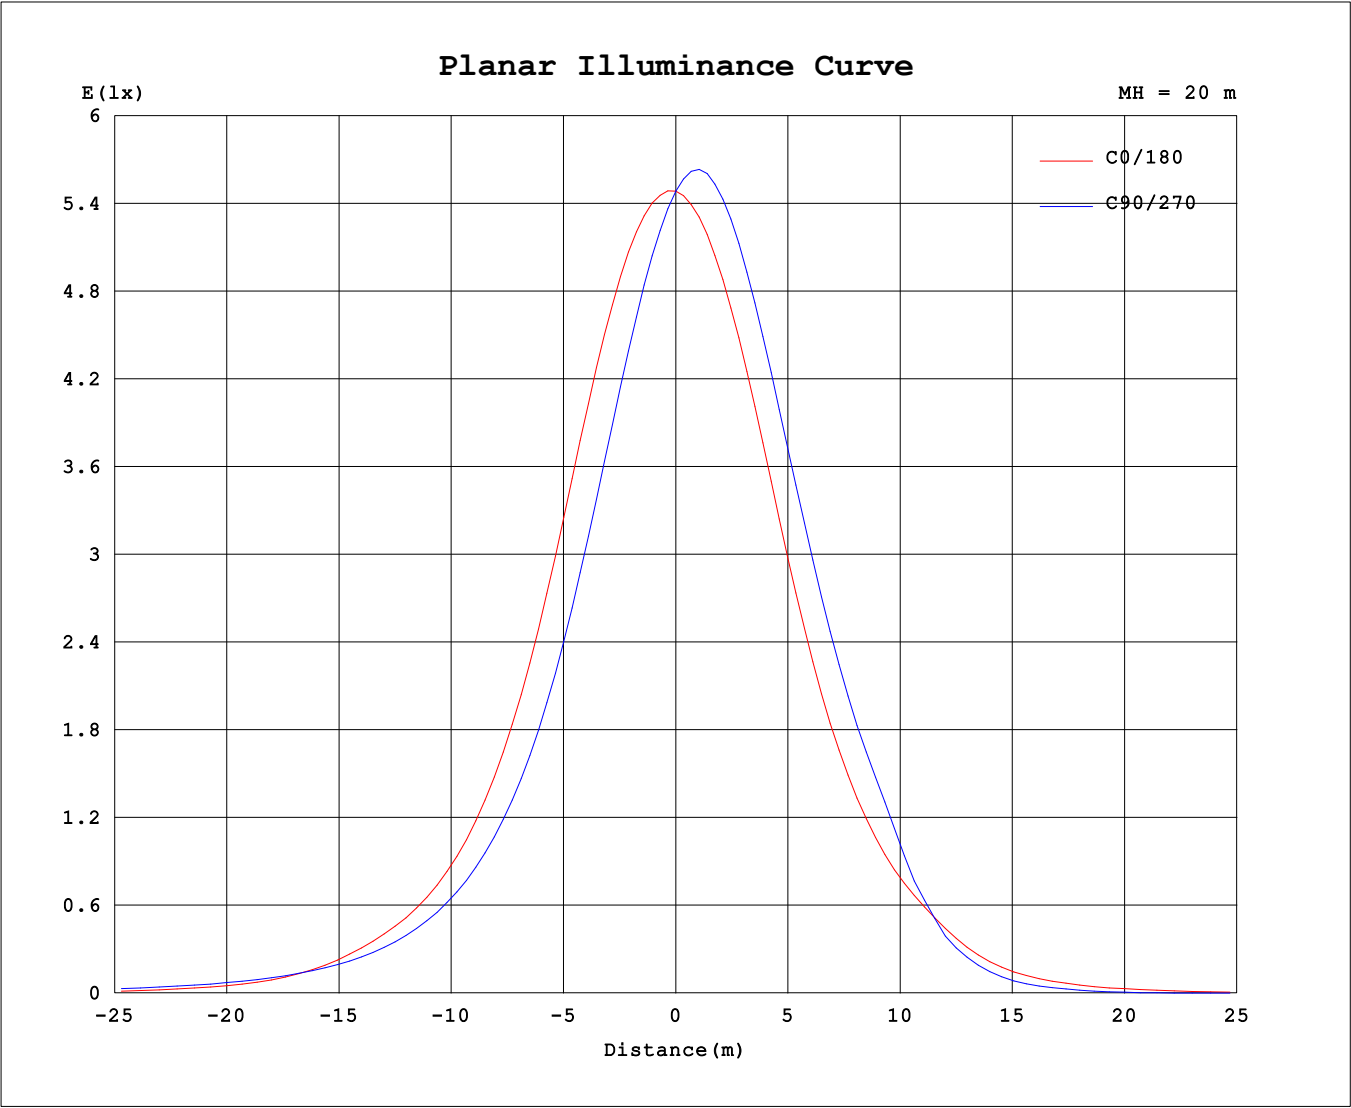

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:1.4740A P:14.500W PF:0.7914 Freq:60.00Hz Lamp Flux:931.651x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	
0	2194	2196	2196	2196	2194	2198	2203	2206	2194	2196	2196	2196	2194	2198	2203	2206	
5	2106	2029	1958	1901	1871	1870	1906	1967	2041	2113	2172	2215	2238	2245	2229	2190	
10	1792	1666	1551	1464	1414	1416	1468	1560	1681	1791	1887	1948	1977	1986	1974	1919	
15	1327	1194	1095	1017	971	967	1015	1095	1215	1324	1432	1512	1542	1556	1547	1473	
20	886	773	700	664	637	625	643	701	801	881	965	1055	1083	1091	1078	1004	
25	564	481	427	422	415	397	389	429	510	558	592	658	703	705	683	638	
30	359	299	260	267	272	255	236	262	317	287	238	259	314	328	355	390	
35	226	191	164	171	181	166	147	160	157	115	83.3	87.1	107	113	128	182	
40	119	126	107	112	122	110	94.7	86.7	73.7	44.6	31.4	29.4	34.2	37.6	44.7	77.4	
45	59.2	75.3	73.1	75.3	81.9	73.7	60.2	46.8	34.7	18.1	9.10	6.22	7.84	10.2	17.5	33.2	
50	28.3	43.1	49.9	51.5	55.5	50.2	36.9	25.5	15.3	5.58	1.10	0.28	0.49	1.01	4.76	14.6	
55	13.8	24.1	32.3	35.7	37.7	33.4	22.4	13.7	5.89	1.12	0.06	0.00	0.00	0.00	0.75	4.95	
60	5.76	12.9	19.7	24.3	25.2	20.7	12.9	6.41	1.66	0.31	0.01	0.00	0.00	0.00	0.12	1.29	
65	1.83	6.08	11.0	14.8	15.9	11.7	6.41	2.28	0.63	0.21	0.00	0.00	0.00	0.00	0.05	0.43	
70	0.73	2.22	5.09	7.71	8.12	5.37	2.48	0.90	0.48	0.04	0.00	0.00	0.00	0.00	0.00	0.31	
75	0.53	0.89	1.90	2.93	2.92	1.94	1.04	0.66	0.30	0.00	0.00	0.00	0.00	0.00	0.00	0.13	
80	0.33	0.65	0.90	1.09	1.07	0.95	0.76	0.48	0.06	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
85	0.11	0.45	0.71	0.87	0.89	0.79	0.58	0.27	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
90	0.00	0.25	0.52	0.69	0.72	0.60	0.38	0.06	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
95	0.00	0.06	0.31	0.48	0.50	0.39	0.18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
100	0.00	0.00	0.12	0.27	0.29	0.19	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
105	0.00	0.00	0.00	0.09	0.11	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
135	0.00	0.00	0.00	0.01	0.01	0.02	0.03	0.03	0.11	0.09	0.07	0.06	0.05	0.04	0.05	0.06	
140	0.11	0.13	0.15	0.16	0.18	0.19	0.20	0.18	0.36	0.33	0.30	0.27	0.25	0.25	0.26	0.28	
145	0.23	0.25	0.28	0.30	0.31	0.34	0.34	0.33	0.66	0.63	0.59	0.56	0.53	0.53	0.55	0.58	
150	0.31	0.33	0.36	0.38	0.40	0.42	0.43	0.43	0.95	0.93	0.90	0.87	0.84	0.85	0.87	0.89	
155	0.45	0.45	0.48	0.49	0.52	0.54	0.56	0.56	1.23	1.23	1.22	1.20	1.18	1.19	1.21	1.23	
160	0.53	0.54	0.55	0.57	0.59	0.62	0.64	0.66	1.43	1.43	1.44	1.45	1.45	1.46	1.48	1.49	
165	0.56	0.56	0.57	0.59	0.61	0.64	0.67	0.70	1.43	1.43	1.47	1.50	1.53	1.55	1.58	1.58	
170	0.60	0.60	0.60	0.61	0.64	0.68	0.72	0.76	1.34	1.35	1.39	1.45	1.49	1.53	1.56	1.56	
175	0.72	0.74	0.76	0.79	0.82	0.86	0.89	0.91	1.18	1.18	1.24	1.30	1.35	1.40	1.43	1.43	
180	0.95	0.98	1.03	1.08	1.14	1.16	1.18	1.18	0.94	0.94	0.98	1.02	1.07	1.13	1.15	1.17	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: