


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz Lamp Flux:953.174x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 69.07 lm/W
MODEL	SMART FIXTURE 3000K	Imax (cd)	3139	S/MH(C0/180)	0.46	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.44	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	953.17	η UP,DN(C0-180)	0.1,54.6	
NOMINAL FLUX(lm)	953.174	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,45.3	
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.50	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

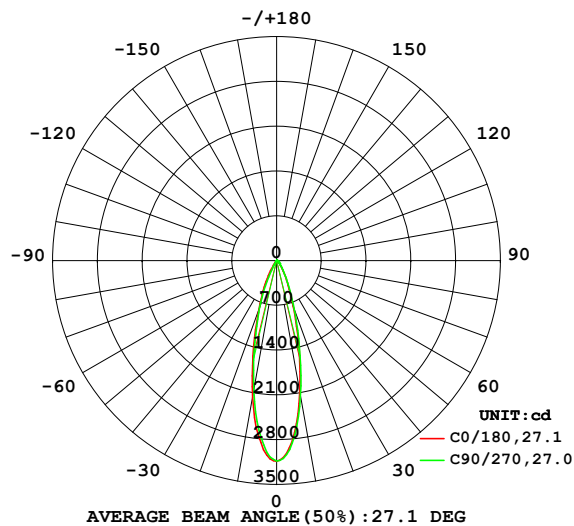

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

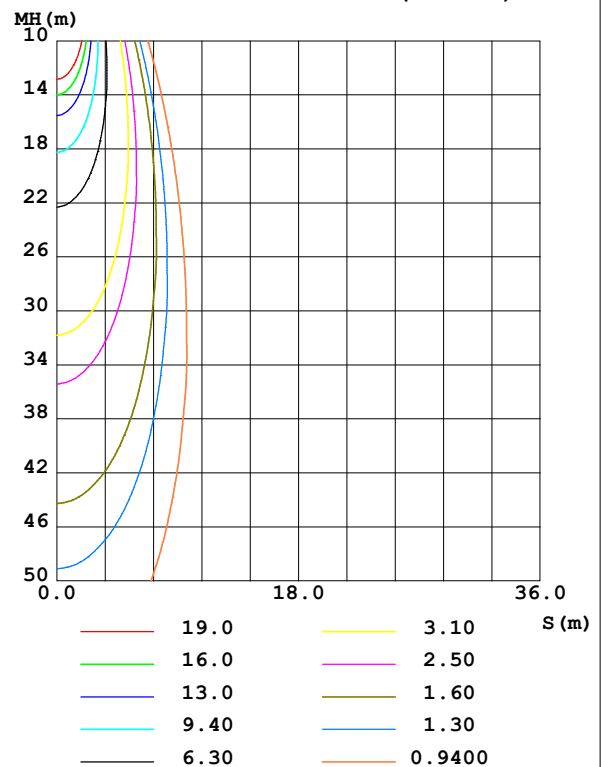

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	2099	2115	2153	2197	2169	2103	2072	2094	0- 10	247.4	247.4	26,26
20	769.7	802.5	816.3	840.4	814.5	806.0	774.8	786.0	10- 20	376.3	623.7	65.4,65.4
30	251.2	268.1	269.0	280.1	224.9	129.1	111.9	185.7	20- 30	205.5	829.2	87,87
40	86.30	104.3	104.7	105.7	37.67	14.61	12.36	29.42	30- 40	73.71	902.9	94.7,94.7
50	27.77	49.66	49.91	36.57	8.229	0	0	3.874	40- 50	28.99	931.9	97.8,97.8
60	7.891	24.81	25.91	12.19	0.4022	0	0	0.1467	50- 60	12.93	944.8	99.1,99.1
70	1.048	8.347	9.588	1.830	0.1327	0	0	0	60- 70	5.273	950.1	99.7,99.7
80	0.4264	1.266	1.262	0.5103	0	0	0	0	70- 80	1.299	951.4	99.8,99.8
90	0.0744	0.7689	0.6655	0.2018	0	0	0	0	80- 90	0.3208	951.7	99.8,99.8
100	0	0.3523	0.3073	0	0	0	0	0	90-100	0.1586	951.9	99.9,99.9
110	0	0	0	0	0	0	0	0	100-110	0.0369	951.9	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0.0001	951.9	99.9,99.9
130	0	0	0	0	0	0	0	0	120-130	0	951.9	99.9,99.9
140	0.1531	0.1387	0.1344	0.1405	0.3388	0.3599	0.3651	0.3672	130-140	0.0529	952.0	99.9,99.9
150	0.4226	0.4338	0.4274	0.4241	1.068	1.106	1.113	1.117	140-150	0.3155	952.3	99.9,99.9
160	0.6201	0.6337	0.6365	0.6277	1.694	1.708	1.715	1.717	150-160	0.4571	952.7	100,100
170	0.6555	0.6477	0.6458	0.6482	1.587	1.577	1.570	1.565	160-170	0.3292	953.1	100,100
180	1.038	0.9977	0.9952	0.9815	1.034	1.018	0.9845	0.9840	170-180	0.1017	953.2	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 920.46 lm

%lum = 96.6%

%lamp = 96.6%

Conical surface Flux(120deg): 944.83 lm

%lum = 99.1%


%lamp = 99.1%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz Lamp Flux:953.174x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

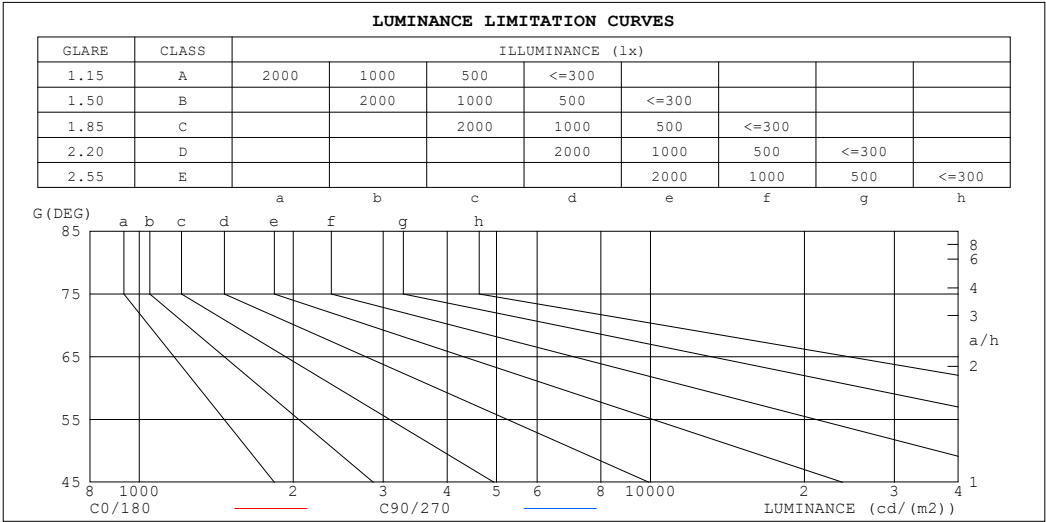

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	293461	924219
80	245567	726844
75	219774	1515705
70	306335	2803209
65	652961	4020907
60	1578200	5181348
55	2702746	6282559
50	4319918	7765355
45	6874292	10013718


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz		
Lamp Flux:953.174x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	Coefficients of Utilization(CU)															
	RCR:Room Cavity Ratio															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.10	1.08	1.10	1.08	1.06	1.06	1.04	1.03	1.02	1.01	.00	.99	.98	.97	.95
2.0	1.06	1.02	.99	1.04	1.01	.98	1.01	.98	.96	.98	.96	.94	.95	.94	.92	.91
3.0	1.00	.96	.93	.99	.95	.92	.96	.93	.91	.94	.91	.89	.92	.90	.88	.86
4.0	.95	.91	.87	.94	.90	.87	.92	.89	.86	.90	.87	.85	.88	.86	.84	.83
5.0	.91	.86	.83	.90	.86	.82	.88	.85	.82	.87	.83	.81	.85	.82	.80	.79
6.0	.87	.82	.79	.86	.82	.78	.85	.81	.78	.84	.80	.77	.82	.79	.77	.76
7.0	.83	.79	.75	.83	.78	.75	.82	.78	.75	.81	.77	.74	.79	.76	.74	.73
8.0	.80	.75	.72	.80	.75	.72	.79	.75	.72	.78	.74	.71	.77	.73	.71	.70
9.0	.77	.72	.69	.77	.72	.69	.76	.72	.69	.75	.71	.69	.74	.71	.68	.67
10.0	.74	.70	.67	.74	.70	.67	.73	.69	.66	.73	.69	.66	.72	.69	.66	.65

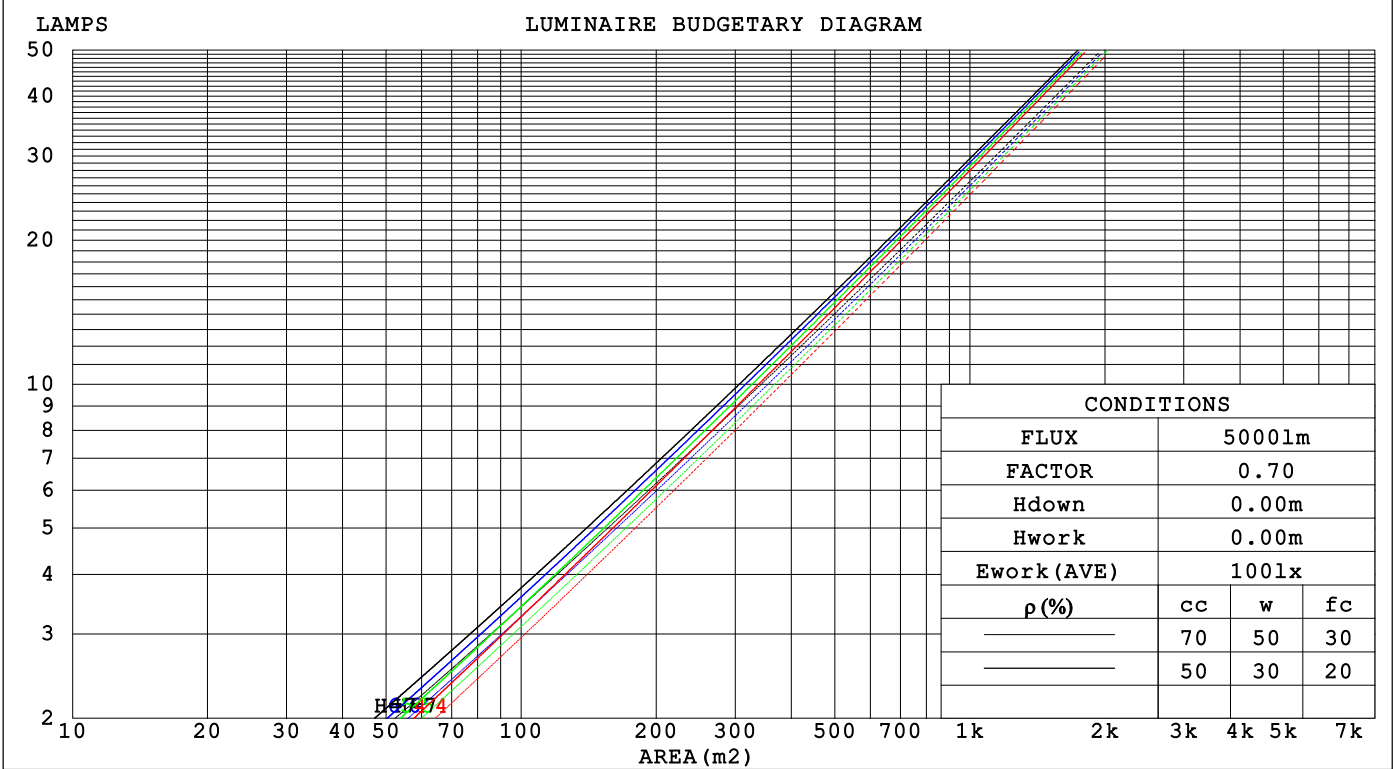

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-27

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz Lamp Flux:953.174x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.154	.087	.028	.147	.084	.027	.134	.077	.025	.123	.071	.023	.112	.065	.021	
2.0	.145	.079	.024	.139	.077	.024	.129	.072	.022	.119	.067	.021	.110	.062	.020	
3.0	.136	.072	.022	.131	.070	.021	.123	.066	.020	.114	.063	.019	.107	.059	.018	
4.0	.128	.067	.020	.124	.065	.019	.117	.062	.019	.110	.059	.018	.103	.056	.017	
5.0	.121	.062	.018	.118	.061	.018	.111	.058	.017	.105	.056	.017	.100	.053	.016	
6.0	.115	.058	.017	.112	.057	.016	.107	.055	.016	.101	.053	.015	.096	.051	.015	
7.0	.110	.054	.015	.107	.053	.015	.102	.052	.015	.097	.050	.015	.093	.048	.014	
8.0	.105	.051	.014	.102	.050	.014	.098	.049	.014	.094	.048	.014	.090	.046	.013	
9.0	.100	.048	.014	.098	.048	.013	.094	.047	.013	.090	.045	.013	.087	.044	.013	
10.0	.096	.046	.013	.094	.045	.013	.091	.044	.012	.087	.043	.012	.084	.042	.012	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.171	.159	.148	.146	.136	.127	.100	.094	.088	.057	.054	.051	.018	.017	.017	
2.0	.154	.134	.117	.132	.115	.101	.090	.080	.071	.052	.046	.041	.017	.015	.013	
3.0	.140	.115	.094	.120	.099	.082	.082	.069	.057	.048	.040	.034	.015	.013	.011	
4.0	.128	.099	.078	.110	.086	.067	.076	.060	.047	.044	.035	.028	.014	.011	.009	
5.0	.118	.087	.065	.102	.076	.056	.070	.053	.040	.041	.031	.024	.013	.010	.008	
6.0	.110	.078	.055	.095	.067	.047	.065	.047	.034	.038	.028	.020	.012	.009	.007	
7.0	.103	.070	.047	.089	.060	.041	.061	.042	.029	.036	.025	.017	.011	.008	.006	
8.0	.097	.063	.040	.083	.055	.035	.058	.039	.025	.034	.023	.015	.011	.007	.005	
9.0	.091	.058	.035	.079	.050	.031	.054	.035	.022	.032	.021	.013	.010	.007	.004	
10.0	.086	.053	.031	.075	.046	.027	.052	.032	.019	.030	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz Lamp Flux:953.174x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	38.0	38.7	38.2	38.9	39.0	39.8	40.5	40.0	40.7	40.9
3H	37.9	38.6	38.1	38.8	39.0	40.1	40.8	40.4	41.0	41.2
4H	37.8	38.5	38.1	38.7	38.9	40.1	40.8	40.4	41.0	41.2
6H	37.7	38.3	38.0	38.6	38.8	40.1	40.7	40.3	40.9	41.2
8H	37.7	38.3	38.0	38.5	38.8	40.0	40.6	40.3	40.9	41.1
12H	37.6	38.2	37.9	38.5	38.7	40.0	40.6	40.3	40.8	41.1
4H 2H	38.2	38.9	38.5	39.1	39.3	39.8	40.5	40.1	40.7	40.9
3H	38.2	38.7	38.5	39.0	39.3	40.3	40.8	40.6	41.1	41.4
4H	38.1	38.6	38.4	38.9	39.2	40.3	40.8	40.6	41.1	41.4
6H	38.0	38.5	38.4	38.8	39.1	40.2	40.7	40.6	41.0	41.4
8H	37.9	38.4	38.3	38.7	39.1	40.2	40.6	40.6	41.0	41.3
12H	37.9	38.3	38.3	38.7	39.1	40.1	40.5	40.6	40.9	41.3
8H 4H	38.0	38.5	38.4	38.8	39.2	40.2	40.6	40.6	41.0	41.3
6H	37.9	38.3	38.4	38.7	39.1	40.1	40.5	40.5	40.9	41.3
8H	37.9	38.2	38.3	38.6	39.1	40.1	40.4	40.5	40.8	41.3
12H	37.8	38.1	38.3	38.6	39.0	40.0	40.3	40.5	40.8	41.2
12H 4H	38.0	38.4	38.4	38.8	39.1	40.1	40.5	40.5	40.9	41.3
6H	37.9	38.2	38.3	38.6	39.1	40.1	40.4	40.5	40.8	41.2
8H	37.8	38.1	38.3	38.6	39.0	40.0	40.3	40.5	40.7	41.2
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.7 / - 3.3					+ 1.2 / - 1.7				
1.5H	+ 2.2 / - 3.0					+ 1.7 / - 1.3				
2.0H	+ 2.5 / - 4.9					+ 2.0 / - 1.5				

CIE Pub.117, 953.2 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.2)
Area: 1e-005 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz Lamp Flux:953.174x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	88	82	78	88	82	78	87	81	78	75
0.80	96	90	86	95	90	86	94	89	86	82
1.00	100	94	91	99	94	91	97	94	90	86
1.25	104	99	95	103	98	95	101	97	94	90
1.50	106	102	99	105	101	98	103	99	97	93
2.00	109	105	102	107	104	101	105	102	99	94
2.50	110	107	104	109	106	103	106	103	101	95
3.00	112	109	106	110	107	105	107	105	103	96
4.00	114	111	109	112	110	108	108	106	105	98
5.00	115	113	111	113	111	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz Lamp Flux:953.174x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

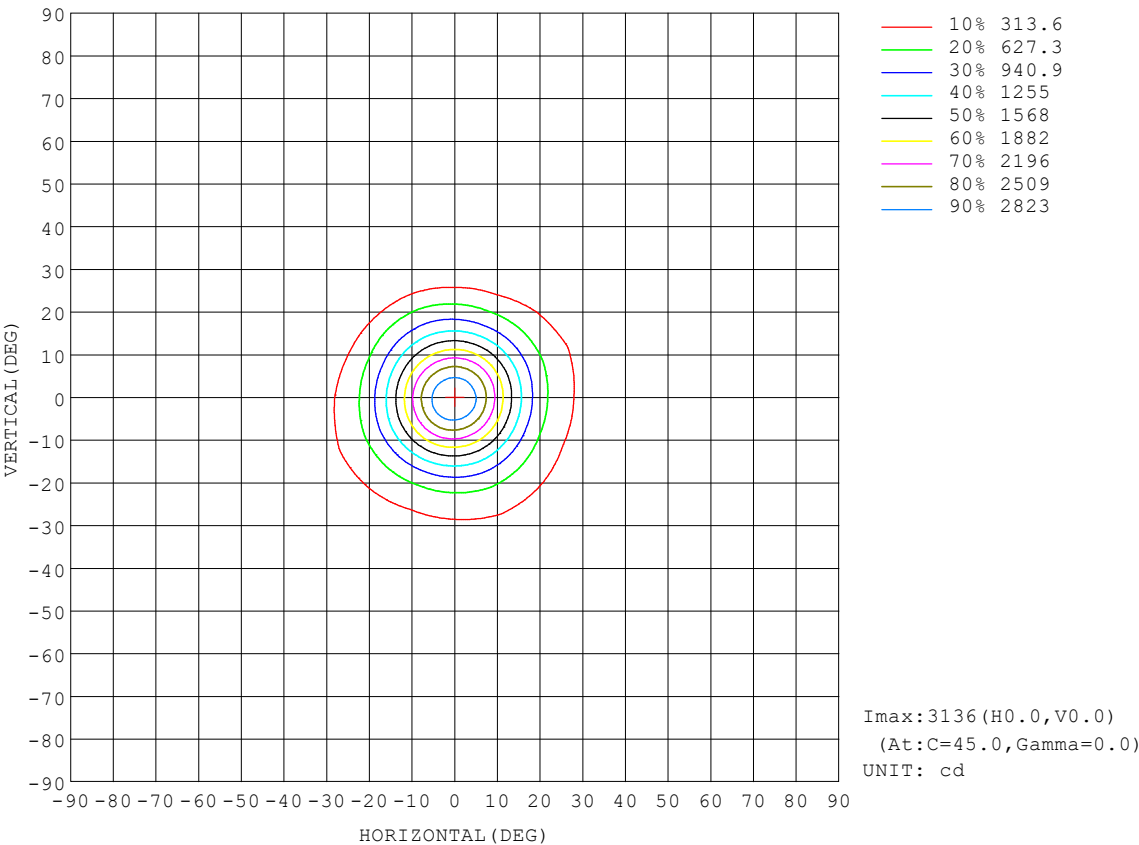

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-27	Remarks:

AAI Figure

Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz Lamp Flux:953.174x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

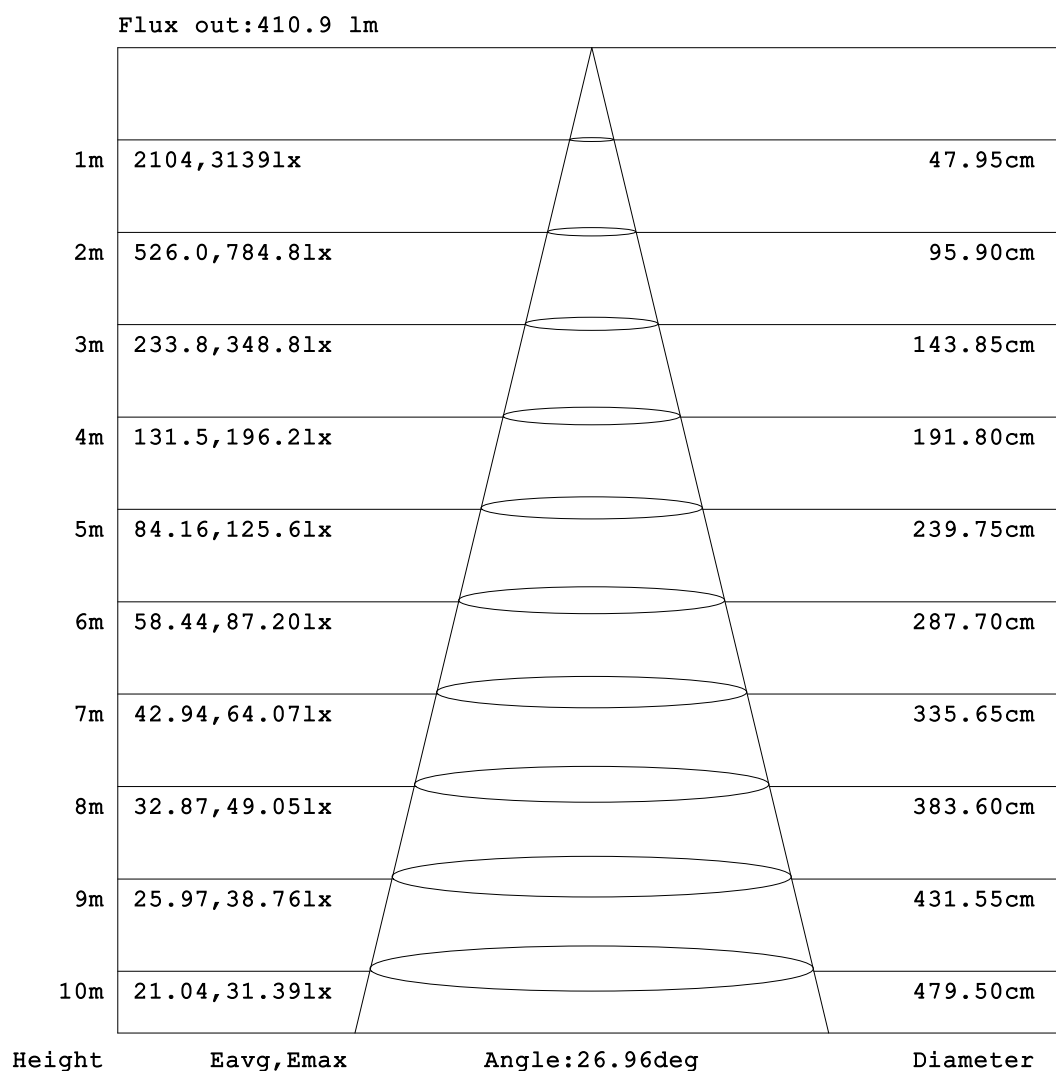


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3℃
Operators: Allen
Test Date: 2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:


ISOLUX DIAGRAM

Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz Lamp Flux:953.174x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

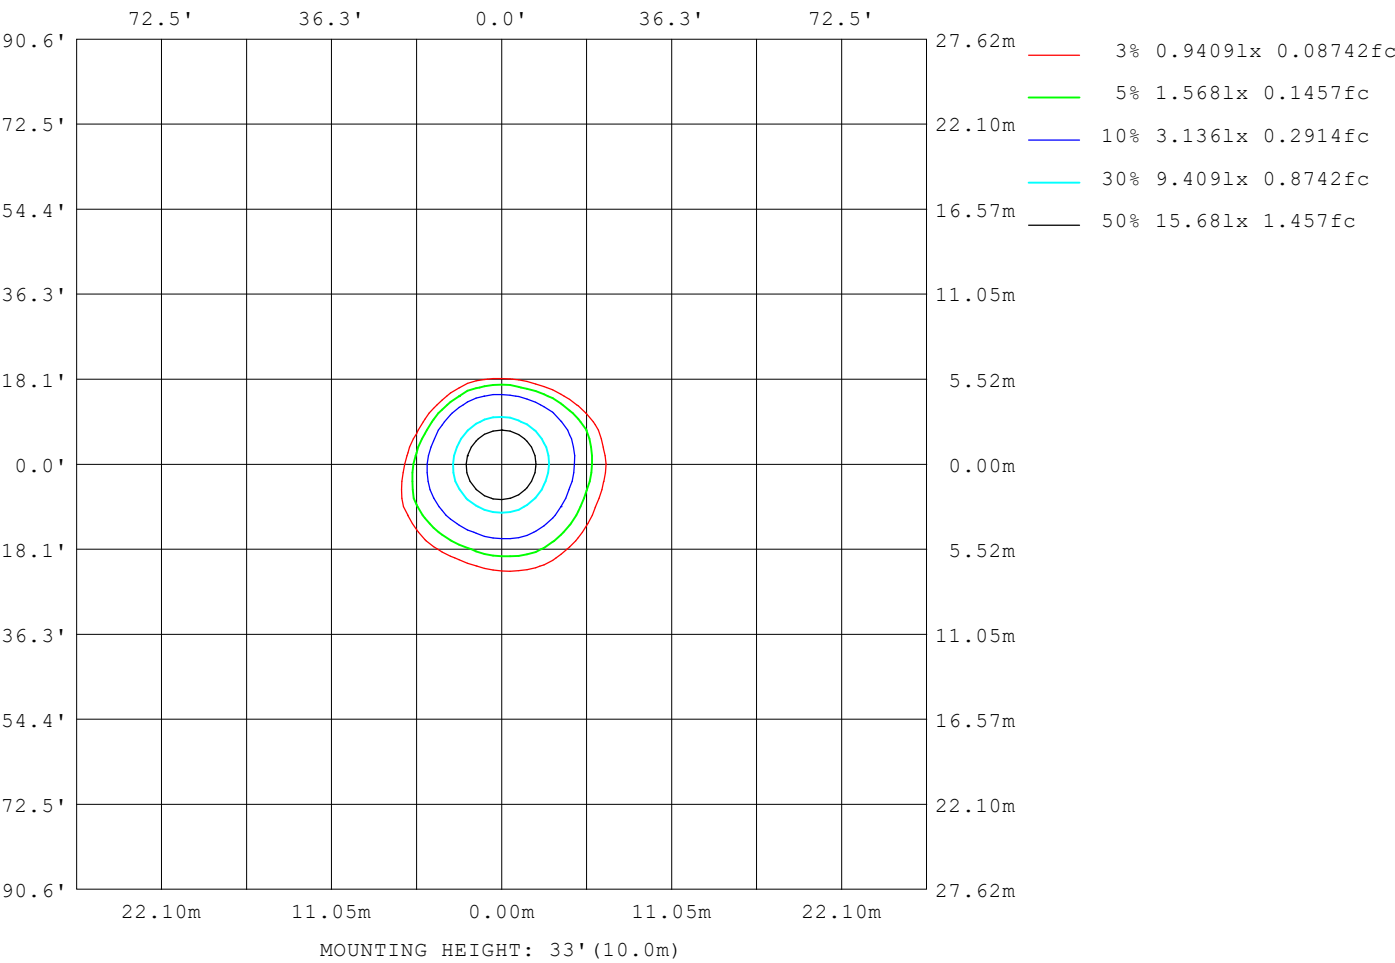

C Range: 0 - 360DEG C Interval: 22.5DEG Test Speed: HIGH Temperature:25.3℃ Operators:Allen Test Date:2026-01-27	γ Range: 0 - 180DEG γ Interval: 1.0DEG Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459 Humidity:45% Test Distance:2.900m [K=0.8783] Remarks:
--	---

Planar Illuminance Curve

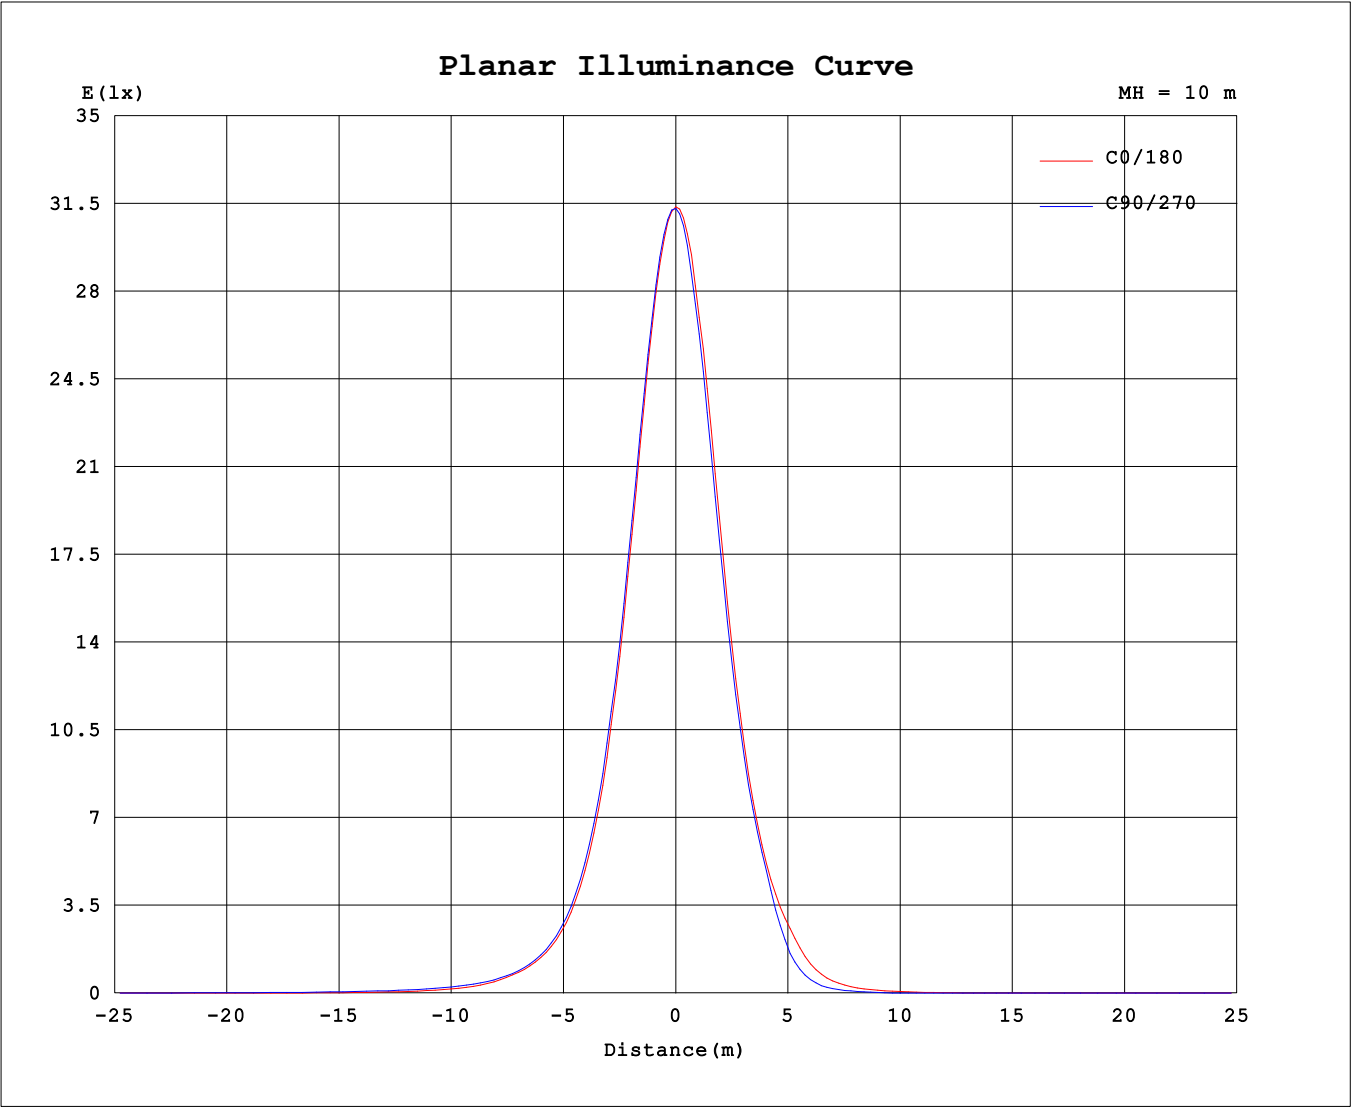

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-27	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:1.4105A P:13.800W PF:0.7502 Freq:60.01Hz Lamp Flux:953.174x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	
0	3136	3137	3139	3135	3130	3131	3127	3126	3136	3137	3139	3135	3130	3131	3127	3126	
5	2828	2833	2839	2846	2858	2878	2882	2879	2854	2829	2803	2787	2781	2784	2794	2799	
10	2099	2101	2115	2132	2153	2185	2197	2186	2169	2137	2103	2077	2072	2076	2094	2101	
15	1338	1340	1353	1384	1390	1408	1424	1421	1393	1363	1357	1339	1321	1316	1339	1346	
20	770	762	802	827	816	813	840	850	815	788	806	807	775	754	786	800	
25	435	423	461	488	466	451	482	499	463	419	400	395	364	370	444	467	
30	251	240	268	291	269	253	280	297	225	149	129	127	112	121	186	271	
35	152	144	163	180	163	151	169	161	89.8	51.3	38.2	38.1	34.6	38.3	70.8	128	
40	86.3	93.1	104	116	105	96.3	106	75.9	37.7	21.5	14.6	12.5	12.4	16.5	29.4	59.3	
45	48.6	63.4	70.5	77.8	70.8	65.6	61.4	38.1	18.8	8.43	2.41	1.64	1.68	4.44	13.5	28.7	
50	27.8	42.1	49.7	53.8	49.9	46.4	36.6	19.9	8.23	1.26	0.00	0.00	0.00	0.46	3.87	14.3	
55	15.5	27.5	35.9	38.1	36.0	31.7	21.5	10.4	1.91	0.07	0.00	0.00	0.00	0.00	0.74	5.80	
60	7.89	16.6	24.8	27.1	25.9	20.4	12.2	3.85	0.40	0.02	0.00	0.00	0.00	0.00	0.15	1.46	
65	2.76	9.16	15.4	18.7	17.0	12.0	5.56	1.19	0.25	0.00	0.00	0.00	0.00	0.00	0.07	0.46	
70	1.05	3.78	8.35	11.5	9.59	5.69	1.83	0.49	0.13	0.00	0.00	0.00	0.00	0.00	0.00	0.33	
75	0.57	1.43	3.33	4.74	3.92	1.95	0.69	0.36	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.19	
80	0.43	0.81	1.27	1.50	1.26	0.78	0.51	0.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	
85	0.26	0.65	0.93	0.95	0.81	0.61	0.36	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
90	0.07	0.47	0.77	0.81	0.67	0.46	0.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
95	0.00	0.27	0.57	0.63	0.49	0.29	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
100	0.00	0.08	0.35	0.42	0.31	0.14	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
105	0.00	0.00	0.14	0.21	0.14	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
110	0.00	0.00	0.00	0.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.08	0.08	0.09	0.09	0.09	0.10	0.09	0.08	
140	0.15	0.15	0.14	0.13	0.13	0.14	0.14	0.14	0.34	0.35	0.36	0.36	0.37	0.37	0.37	0.35	
145	0.31	0.32	0.32	0.31	0.31	0.32	0.31	0.30	0.69	0.71	0.72	0.72	0.73	0.74	0.73	0.71	
150	0.42	0.43	0.43	0.43	0.43	0.43	0.42	0.41	1.07	1.08	1.11	1.11	1.11	1.13	1.12	1.09	
155	0.55	0.57	0.57	0.57	0.57	0.57	0.56	0.55	1.45	1.45	1.48	1.48	1.49	1.50	1.49	1.47	
160	0.62	0.63	0.63	0.64	0.64	0.63	0.63	0.62	1.69	1.69	1.71	1.71	1.71	1.72	1.72	1.69	
165	0.63	0.64	0.64	0.64	0.64	0.63	0.62	0.63	1.71	1.70	1.70	1.70	1.70	1.70	1.70	1.68	
170	0.66	0.65	0.65	0.65	0.65	0.65	0.65	0.66	1.59	1.59	1.58	1.57	1.57	1.57	1.57	1.55	
175	0.77	0.76	0.75	0.75	0.74	0.74	0.75	0.75	1.36	1.36	1.35	1.33	1.32	1.31	1.31	1.30	
180	1.04	1.02	1.00	0.98	1.00	0.98	0.98	0.98	1.03	1.03	1.02	1.00	0.98	0.99	0.98	0.98	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: