


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz Lamp Flux:1754.85x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 64.99 lm/W
MODEL	SMART FIXTURE 3000K	I _{max} (cd)	3511	S/MH(C0/180)	0.67	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.38	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	1754.8	η UP,DN(C0-180)	0.1,57.5	
NOMINAL FLUX(lm)	1754.85	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,42.4	
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.60	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

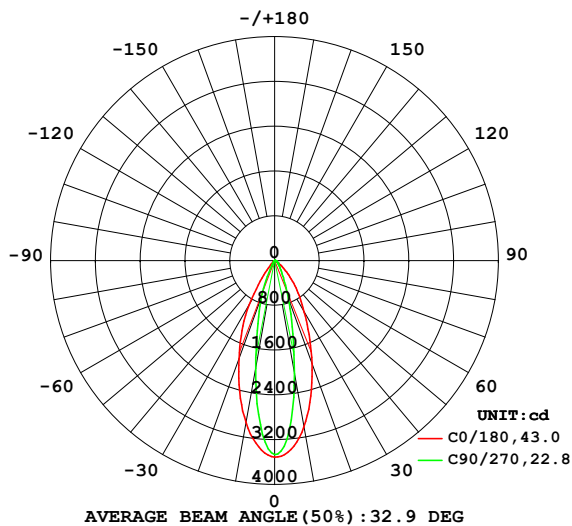

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

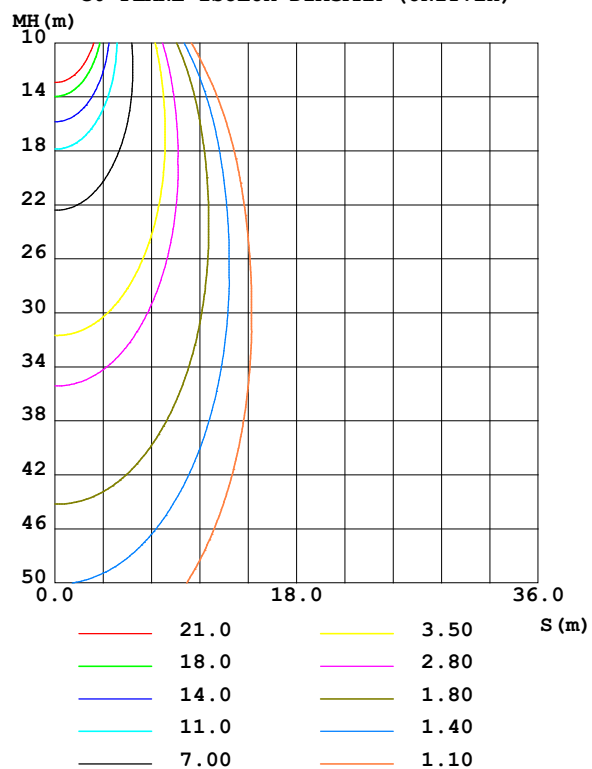

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3 °C
Operators: Allen
Test Date: 2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	3021	2022	2051	3117	2940	1937	1959	2860	0- 10	279.7	279.7	15.9,15.9
20	1958	707.3	732.2	2190	1870	669.7	689.7	1885	10- 20	511.9	791.6	45.1,45.1
30	1063	256.5	267.0	1290	906.9	111.1	109.9	817.8	20- 30	448.6	1240	70.7,70.7
40	534.4	136.1	140.9	695.3	179.9	27.53	24.13	125.0	30- 40	290.4	1531	87.2,87.2
50	192.6	88.15	89.26	307.2	23.62	0.4697	0.2442	9.312	40- 50	147.3	1678	95.6,95.6
60	37.56	51.75	54.48	81.85	3.215	0.0601	0	1.854	50- 60	53.76	1732	98.7,98.7
70	4.996	18.87	22.04	10.69	1.774	0	0	0.4996	60- 70	14.91	1747	99.5,99.5
80	2.749	3.356	3.573	3.431	0	0	0	0	70- 80	3.874	1751	99.8,99.8
90	1.146	1.980	1.918	2.007	0	0	0	0	80- 90	1.267	1752	99.8,99.8
100	0	1.042	1.003	0.5089	0	0	0	0	90-100	0.6249	1752	99.9,99.9
110	0	0.1846	0.2522	0	0	0	0	0	100-110	0.1803	1753	99.9,99.9
120	0	0	0	0	0	0	0	0.0226	110-120	0.0092	1753	99.9,99.9
130	0.2408	0	0	0.0862	0.2531	0	0.0000	0.4263	120-130	0.0358	1753	99.9,99.9
140	0.6504	0.2905	0.2315	0.3942	0.8778	0.5109	0.5598	1.170	130-140	0.2361	1753	99.9,99.9
150	0.9422	0.9073	0.7277	0.6528	1.574	1.606	1.681	1.962	140-150	0.5743	1753	99.9,99.9
160	1.229	1.301	1.193	0.9440	2.065	2.358	2.682	2.566	150-160	0.7112	1754	100,100
170	1.325	1.430	1.358	1.193	2.036	2.149	2.586	2.463	160-170	0.5132	1755	100,100
180	1.815	1.801	1.897	1.793	1.804	1.786	1.757	1.826	170-180	0.1733	1755	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1619.4 lm

%lum = 92.3%

%lamp = 92.3%

Conical surface Flux(120deg): 1731.7 lm

%lum = 98.7%


%lamp = 98.7%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz Lamp Flux:1754.85x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

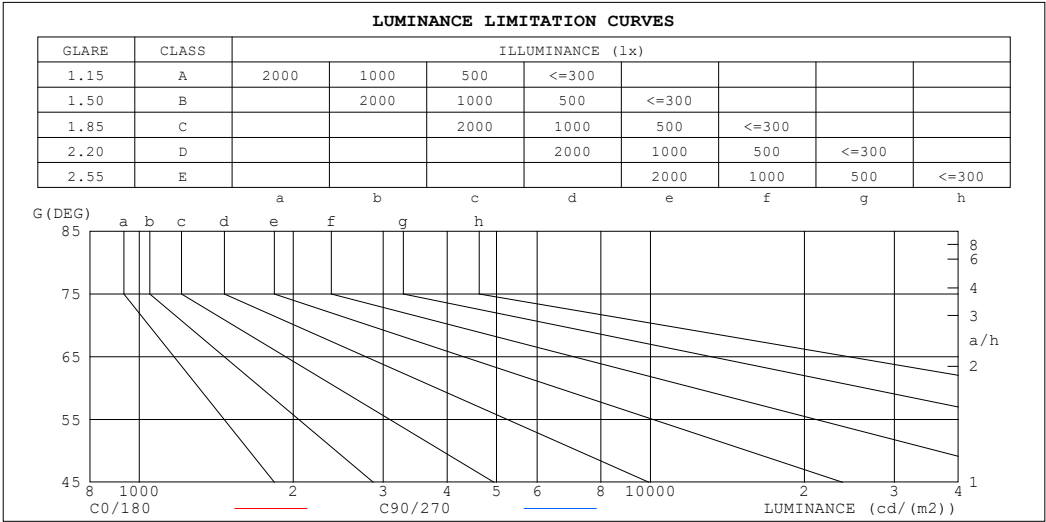

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	2317066	2608064
80	1583144	2057349
75	1268361	3752011
70	1460752	6443803
65	2959606	8938087
60	7511064	10896536
55	16523938	12401283
50	29969951	13887019
45	47595586	15611930


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz		
Lamp Flux:1754.85x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.11	1.08	1.06	1.09	1.06	1.04	1.04	1.03	1.01	1.01	.99	.98	.97	.96	.95	.93
2.0	1.03	.99	.96	1.01	.98	.95	.98	.95	.92	.95	.93	.90	.92	.90	.89	.87
3.0	.96	.91	.87	.95	.90	.87	.92	.88	.85	.90	.86	.84	.87	.85	.82	.81
4.0	.90	.85	.80	.89	.84	.80	.87	.82	.79	.85	.81	.78	.83	.80	.77	.76
5.0	.84	.79	.74	.84	.78	.74	.82	.77	.73	.80	.76	.73	.78	.75	.72	.71
6.0	.80	.74	.69	.79	.73	.69	.77	.72	.69	.76	.72	.68	.74	.71	.68	.66
7.0	.75	.69	.65	.74	.69	.65	.73	.68	.65	.72	.68	.64	.71	.67	.64	.62
8.0	.71	.65	.61	.71	.65	.61	.69	.64	.61	.68	.64	.61	.67	.63	.60	.59
9.0	.67	.62	.58	.67	.62	.58	.66	.61	.58	.65	.61	.57	.64	.60	.57	.56
10.0	.64	.59	.55	.64	.58	.55	.63	.58	.55	.62	.58	.54	.61	.57	.54	.53

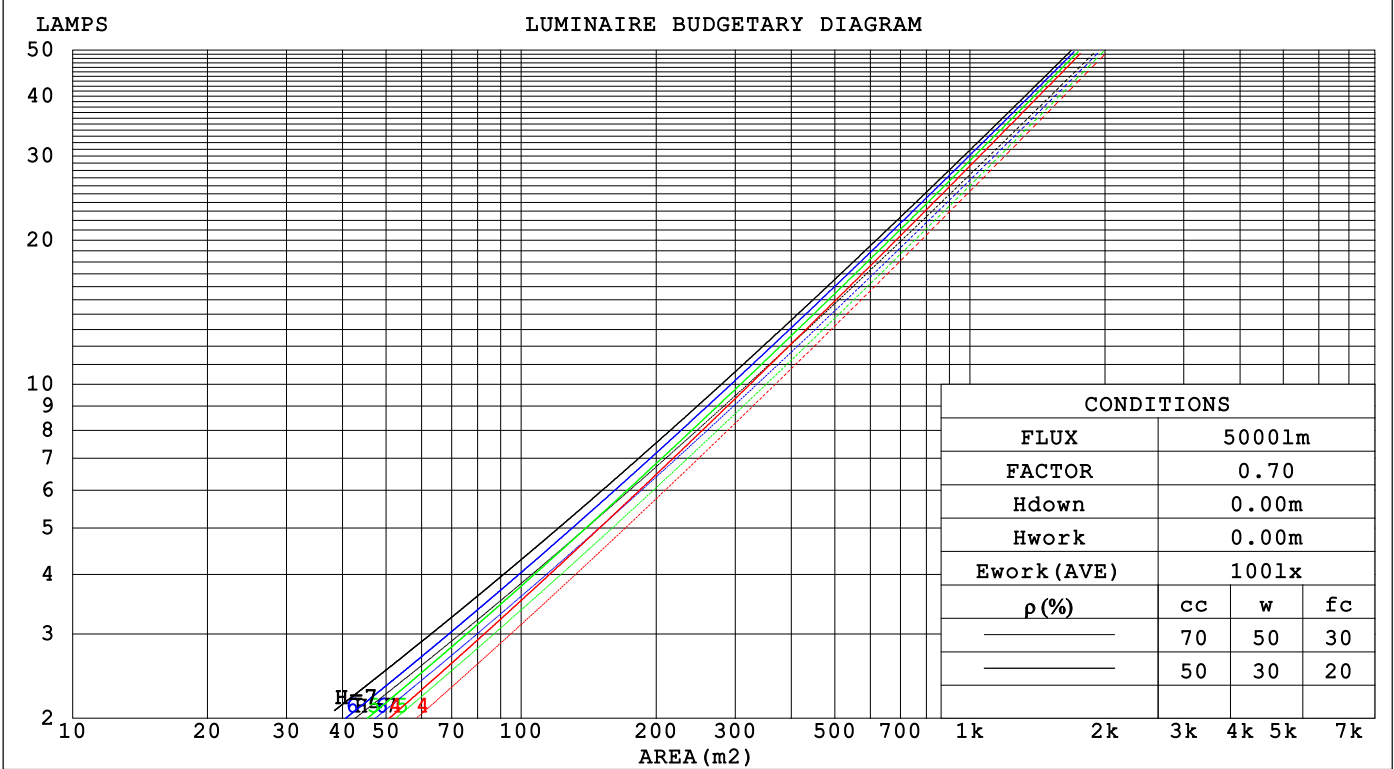

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-27

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz Lamp Flux:1754.85x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.178	.101	.032	.171	.098	.031	.159	.091	.029	.147	.085	.027	.136	.079	.025															
2.0	.171	.093	.029	.165	.091	.028	.154	.086	.027	.144	.081	.025	.135	.076	.024															
3.0	.162	.086	.026	.157	.084	.025	.148	.080	.024	.140	.077	.023	.132	.073	.023															
4.0	.154	.080	.024	.150	.078	.023	.142	.075	.022	.135	.072	.022	.128	.069	.021															
5.0	.146	.075	.022	.143	.073	.021	.136	.071	.021	.129	.068	.020	.123	.066	.020															
6.0	.139	.070	.020	.136	.069	.020	.130	.067	.019	.124	.065	.019	.119	.063	.019															
7.0	.133	.066	.019	.130	.065	.018	.124	.063	.018	.119	.061	.018	.115	.060	.018															
8.0	.126	.062	.017	.124	.061	.017	.119	.060	.017	.115	.058	.017	.111	.057	.017															
9.0	.121	.058	.016	.119	.058	.016	.114	.057	.016	.110	.055	.016	.107	.054	.016															
10.0	.116	.055	.015	.114	.055	.015	.110	.054	.015	.106	.053	.015	.103	.052	.015															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.173	.159	.146	.148	.136	.126	.101	.094	.087	.058	.054	.051	.019	.017	.016	
2.0	.157	.134	.114	.135	.115	.099	.092	.080	.069	.053	.046	.040	.017	.015	.013	
3.0	.145	.115	.091	.124	.099	.079	.085	.069	.055	.049	.040	.033	.016	.013	.011	
4.0	.135	.100	.074	.116	.087	.064	.080	.060	.045	.046	.035	.027	.015	.012	.009	
5.0	.126	.089	.061	.108	.077	.053	.075	.054	.037	.043	.031	.022	.014	.010	.007	
6.0	.118	.079	.051	.102	.069	.045	.070	.048	.032	.041	.028	.019	.013	.009	.006	
7.0	.112	.072	.044	.096	.062	.038	.066	.044	.027	.039	.026	.016	.012	.008	.005	
8.0	.106	.065	.038	.091	.057	.033	.063	.040	.023	.037	.024	.014	.012	.008	.005	
9.0	.101	.060	.033	.087	.052	.029	.060	.037	.020	.035	.022	.012	.011	.007	.004	
10.0	.096	.056	.029	.083	.048	.025	.057	.034	.018	.033	.020	.011	.011	.007	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz Lamp Flux:1754.85x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	41.4	42.3	41.6	42.5	42.7	38.6	39.5	38.8	39.7	39.9
3H	41.3	42.1	41.5	42.3	42.6	39.3	40.1	39.5	40.3	40.6
4H	41.2	42.0	41.5	42.2	42.5	39.4	40.2	39.6	40.4	40.6
6H	41.1	41.9	41.4	42.1	42.4	39.3	40.1	39.6	40.3	40.6
8H	41.1	41.8	41.4	42.1	42.4	39.3	40.0	39.6	40.3	40.6
12H	41.1	41.8	41.4	42.0	42.3	39.3	40.0	39.6	40.2	40.5
4H 2H	41.4	42.2	41.6	42.4	42.6	38.9	39.7	39.2	39.9	40.2
3H	41.3	42.0	41.6	42.3	42.6	39.7	40.4	40.0	40.6	40.9
4H	41.2	41.9	41.6	42.2	42.5	39.8	40.4	40.1	40.7	41.0
6H	41.2	41.7	41.5	42.1	42.4	39.7	40.3	40.1	40.6	41.0
8H	41.1	41.7	41.5	42.0	42.4	39.7	40.2	40.1	40.6	41.0
12H	41.1	41.6	41.5	42.0	42.3	39.7	40.2	40.1	40.5	40.9
8H 4H	41.2	41.7	41.5	42.0	42.4	39.7	40.2	40.1	40.6	40.9
6H	41.1	41.5	41.5	41.9	42.3	39.7	40.1	40.1	40.5	40.9
8H	41.1	41.4	41.5	41.9	42.3	39.7	40.0	40.1	40.5	40.9
12H	41.0	41.4	41.5	41.8	42.3	39.7	40.0	40.1	40.4	40.9
12H 4H	41.1	41.6	41.5	42.0	42.4	39.6	40.1	40.1	40.5	40.9
6H	41.0	41.4	41.5	41.8	42.3	39.6	40.0	40.1	40.4	40.9
8H	41.0	41.3	41.5	41.8	42.3	39.6	39.9	40.1	40.4	40.9
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 4.5 / - 3.4					+ 0.4 / - 0.6				
1.5H	+ 5.5 / - 4.2					+ 0.2 / - 0.3				
2.0H	+ 6.4 / - 4.2					+ 0.8 / - 0.8				

CIE Pub.117, 1755 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 2.0$)
Area: 1e-005 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz Lamp Flux:1754.85x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	83	76	72	83	76	72	82	76	72	68
0.80	91	85	81	91	85	81	89	84	80	76
1.00	97	91	87	96	90	86	94	90	86	81
1.25	101	96	92	100	95	91	98	94	91	86
1.50	104	99	95	103	98	95	101	97	94	89
2.00	107	103	99	106	102	99	103	100	97	92
2.50	109	105	102	108	104	101	104	101	99	93
3.00	111	107	104	109	106	103	106	103	101	94
4.00	113	110	108	111	108	106	107	105	104	96
5.00	114	112	110	112	110	108	108	107	105	97
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz Lamp Flux:1754.85x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

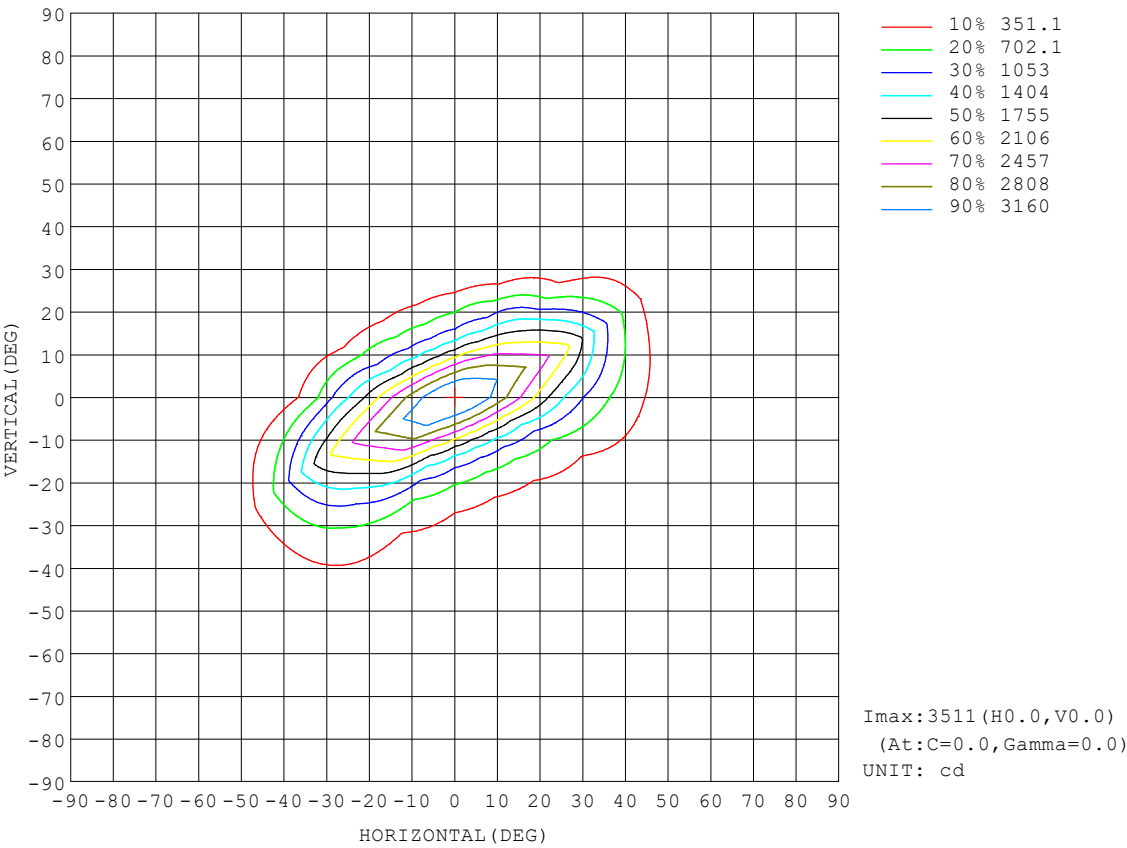


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

AAI Figure

Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz Lamp Flux:1754.85x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

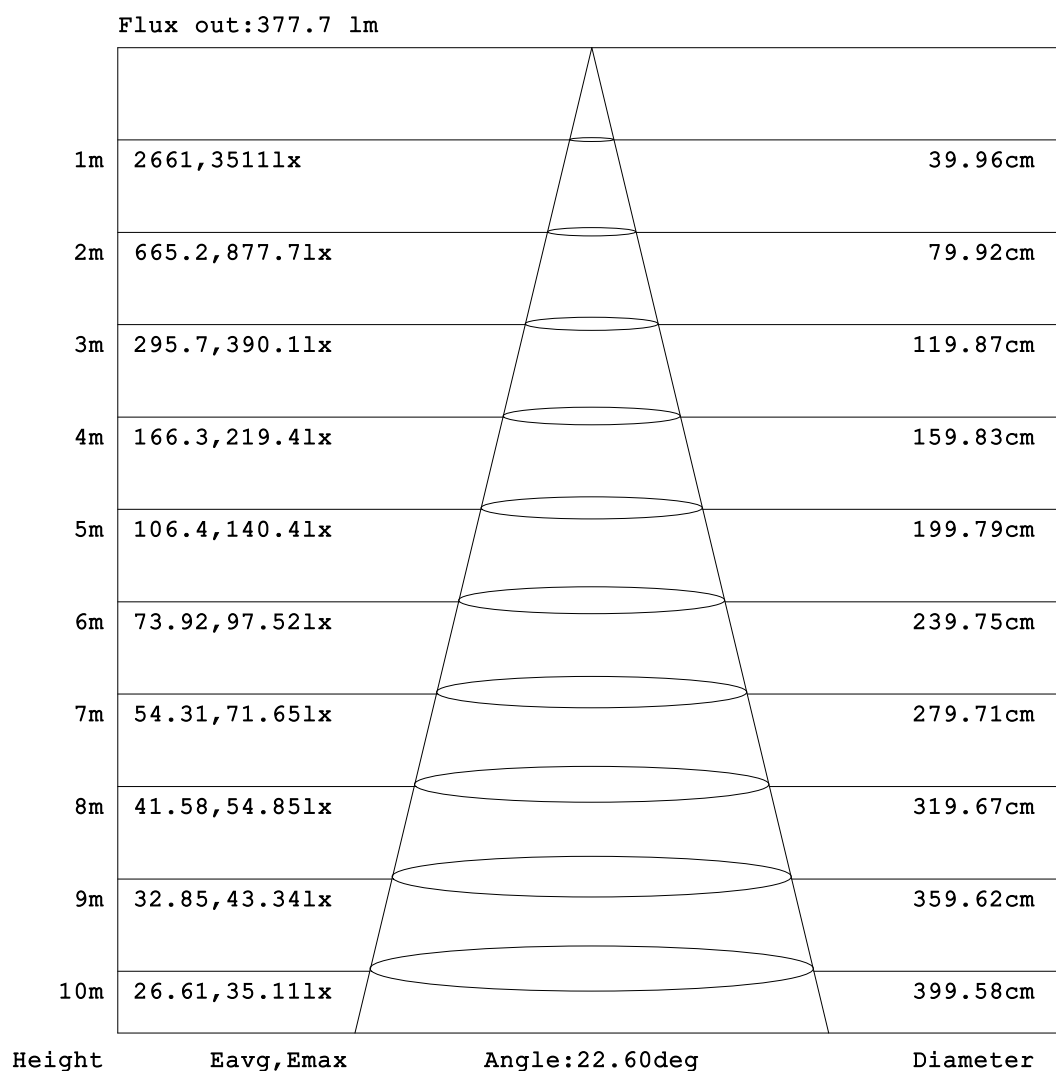


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:


ISOLUX DIAGRAM

Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz Lamp Flux:1754.85x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

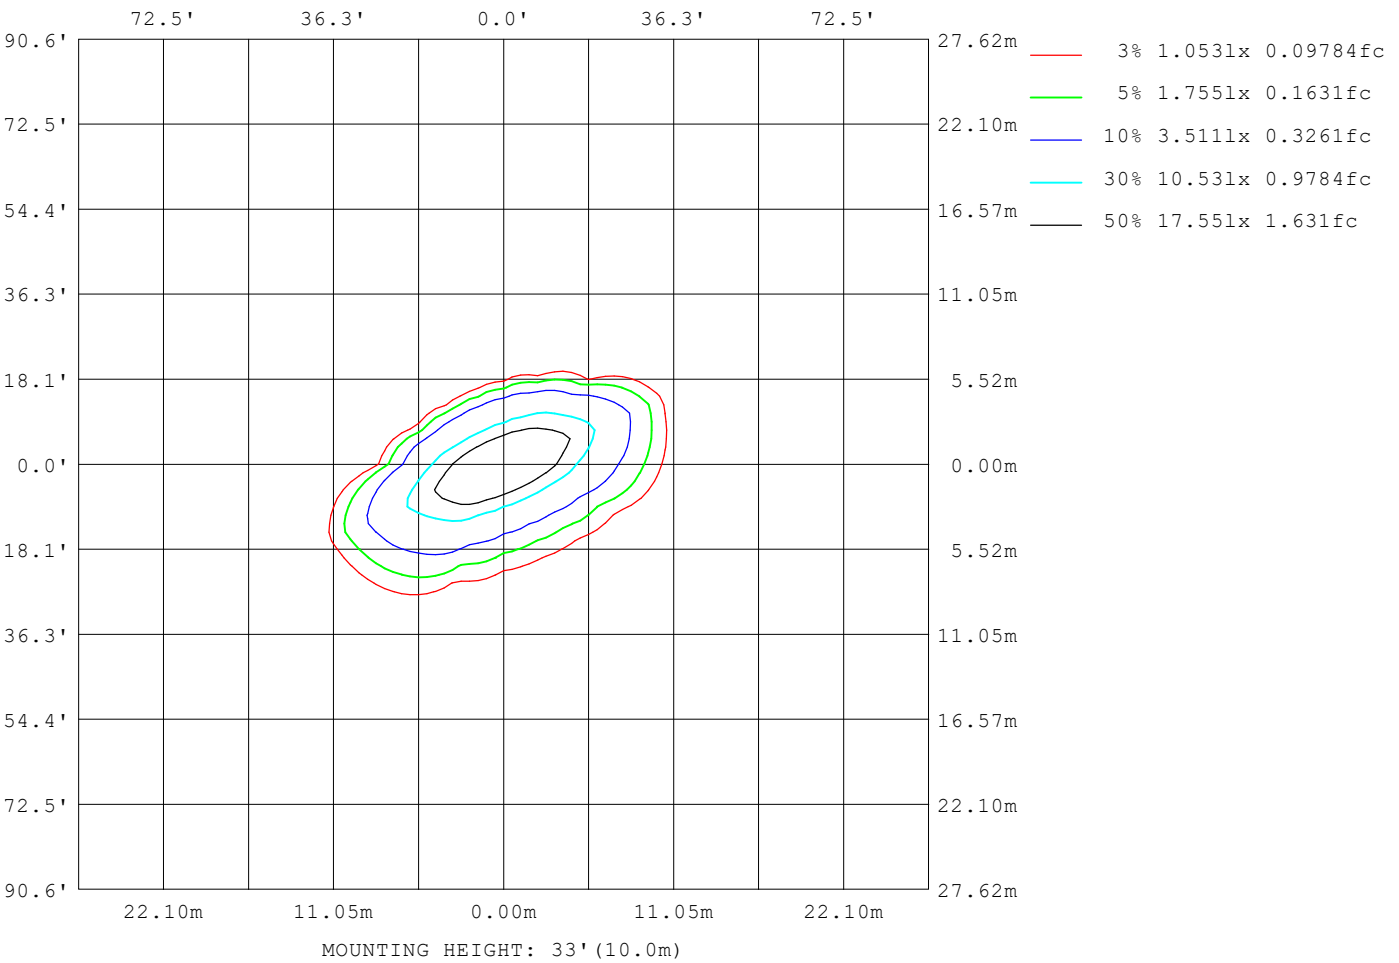

C Range: 0 - 360DEG C Interval: 22.5DEG Test Speed: HIGH Temperature:25.3℃ Operators:Allen Test Date:2026-01-27	γ Range: 0 - 180DEG γ Interval: 1.0DEG Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459 Humidity:45% Test Distance:2.900m [K=0.8783] Remarks:
--	---

Planar Illuminance Curve

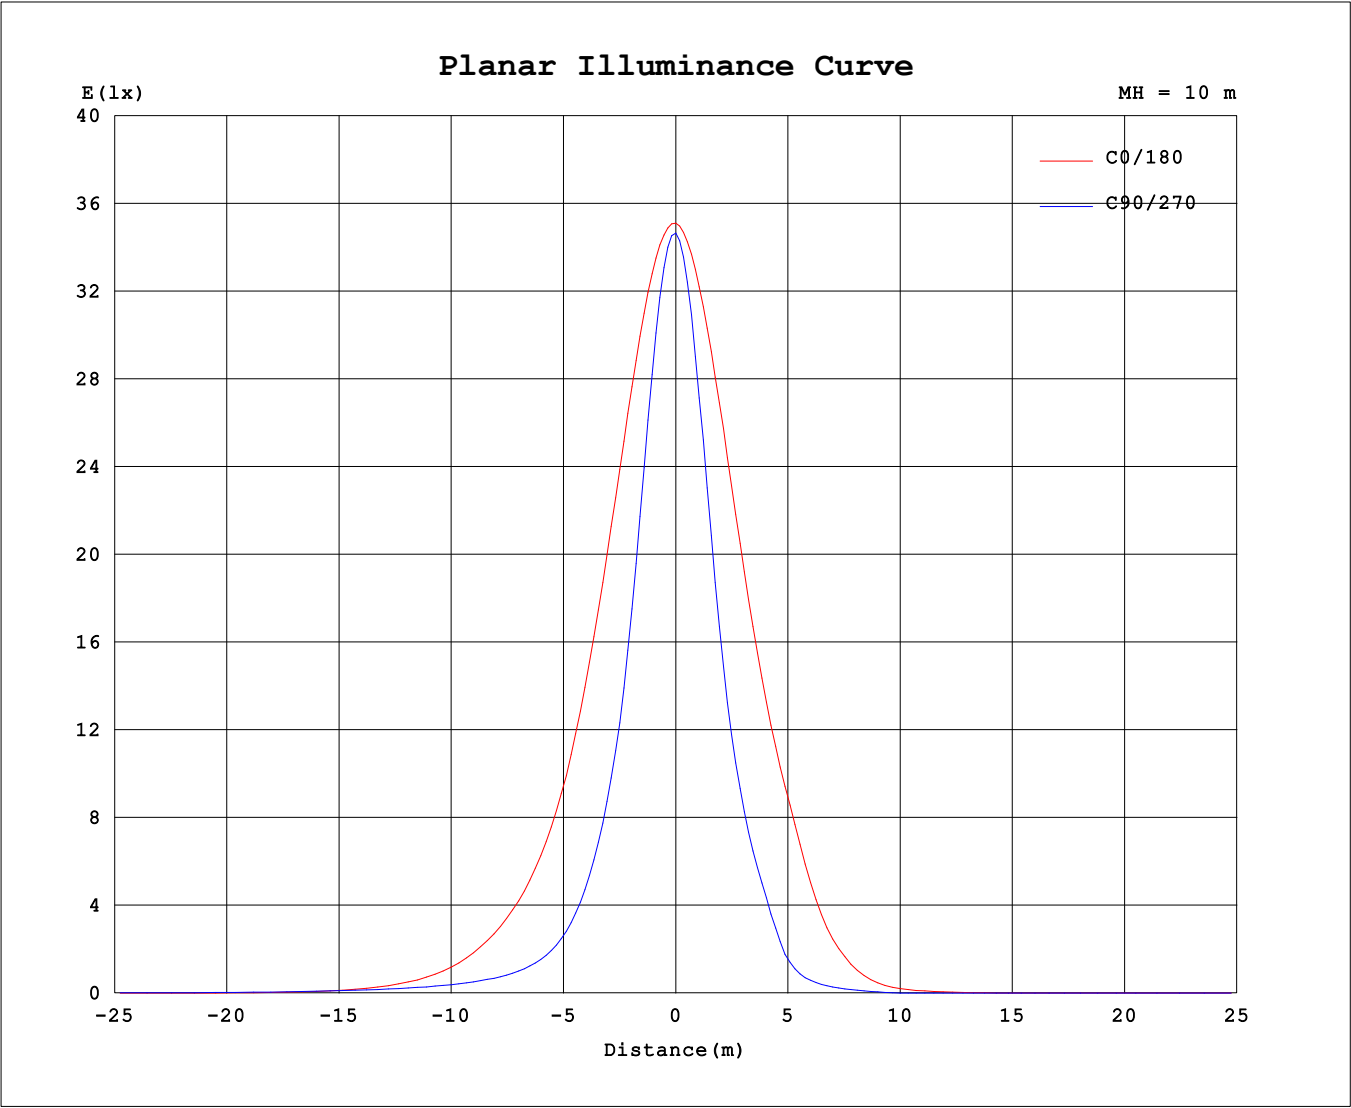

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-27	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:2.6836A P:27.000W PF:0.8048 Freq:59.99Hz Lamp Flux:1754.85x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	
0	3511	3494	3480	3472	3465	3457	3439	3443	3511	3494	3480	3472	3465	3457	3439	3443	
5	3390	3209	3045	2978	3045	3203	3393	3410	3338	3129	2946	2877	2937	3119	3242	3362	
10	3021	2445	2022	1890	2051	2495	3117	3280	2940	2358	1937	1808	1959	2391	2860	3195	
15	2507	1630	1209	1086	1227	1705	2684	3079	2422	1562	1144	1034	1166	1617	2383	2965	
20	1958	1056	707	620	732	1122	2190	2820	1870	1013	670	582	690	1059	1885	2699	
25	1461	685	413	354	432	742	1707	2532	1384	619	308	230	317	617	1412	2405	
30	1063	438	256	223	267	485	1290	2228	907	240	111	96.1	110	244	818	2060	
35	767	286	178	162	184	318	951	1870	450	90.3	55.6	49.8	51.9	80.3	386	1492	
40	534	195	136	127	141	215	695	1343	180	43.1	27.5	22.8	24.1	34.7	125	973	
45	337	139	109	104	110	152	488	858	60.0	19.0	5.27	3.36	4.08	11.1	38.0	553	
50	193	99.1	88.1	85.0	89.3	110	307	472	23.6	4.26	0.47	0.08	0.24	2.04	9.31	249	
55	94.8	68.1	70.2	67.8	71.1	78.5	172	201	7.41	1.49	0.29	0.00	0.11	0.84	2.85	70.7	
60	37.6	43.7	51.8	52.0	54.5	53.2	81.9	57.0	3.21	1.16	0.06	0.00	0.00	0.59	1.85	5.64	
65	12.5	24.5	34.1	37.3	37.8	32.4	31.0	6.74	2.57	0.49	0.00	0.00	0.00	0.00	1.37	3.02	
70	5.00	11.9	18.9	22.4	22.0	16.4	10.7	3.83	1.77	0.00	0.00	0.00	0.00	0.00	0.50	2.52	
75	3.28	5.24	8.12	9.15	9.71	7.24	4.57	3.15	0.66	0.00	0.00	0.00	0.00	0.00	0.00	1.78	
80	2.75	3.04	3.36	3.34	3.57	3.41	3.43	2.28	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.83	
85	2.02	2.59	2.35	2.09	2.27	2.80	2.80	1.28	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
90	1.15	2.07	1.98	1.78	1.92	2.30	2.01	0.37	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
95	0.37	1.43	1.52	1.36	1.47	1.68	1.21	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
100	0.00	0.78	1.04	0.94	1.00	1.08	0.51	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
105	0.00	0.24	0.57	0.56	0.60	0.55	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
110	0.00	0.00	0.18	0.23	0.25	0.09	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.03	
125	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.07	0.00	0.00	0.00	0.00	0.00	0.18	0.17	
130	0.24	0.04	0.00	0.00	0.00	0.00	0.09	0.14	0.25	0.09	0.00	0.00	0.00	0.18	0.43	0.39	
135	0.43	0.25	0.03	0.00	0.00	0.16	0.22	0.26	0.53	0.35	0.16	0.11	0.20	0.49	0.76	0.69	
140	0.65	0.56	0.29	0.17	0.23	0.39	0.39	0.43	0.88	0.76	0.51	0.42	0.56	0.92	1.17	1.04	
145	0.83	0.86	0.63	0.47	0.51	0.59	0.56	0.58	1.25	1.23	1.04	0.93	1.08	1.41	1.58	1.40	
150	0.94	1.03	0.91	0.76	0.73	0.72	0.65	0.66	1.57	1.64	1.61	1.55	1.68	1.90	1.96	1.71	
155	1.11	1.22	1.17	1.07	0.99	0.92	0.81	0.81	1.87	1.95	2.11	2.16	2.27	2.36	2.33	2.01	
160	1.23	1.32	1.30	1.28	1.19	1.07	0.94	0.93	2.07	2.10	2.36	2.54	2.68	2.70	2.57	2.19	
165	1.26	1.35	1.35	1.37	1.30	1.13	1.01	1.01	2.06	2.07	2.27	2.57	2.76	2.77	2.58	2.22	
170	1.33	1.40	1.43	1.45	1.36	1.27	1.19	1.17	2.04	2.03	2.15	2.40	2.59	2.63	2.46	2.18	
175	1.52	1.52	1.54	1.56	1.55	1.57	1.50	1.45	1.98	1.98	2.02	2.13	2.23	2.28	2.18	2.03	
180	1.82	1.80	1.80	1.75	1.90	1.88	1.79	1.73	1.80	1.81	1.79	1.79	1.76	1.88	1.83	1.79	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: