


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz Lamp Flux:998.503x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 70.25 lm/W
MODEL	SMART FIXTURE 2700K	Imax (cd)	6022	S/MH(C0/180)	0.30	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.42	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	998.50	η UP,DN(C0-180)	0.0,41.6	
NOMINAL FLUX(lm)	998.503	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,58.3	
LAMPS INSIDE	1	η up (%)	0.1	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)		η down (%)	99.9	CIBSE SHR MAX	0.30	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

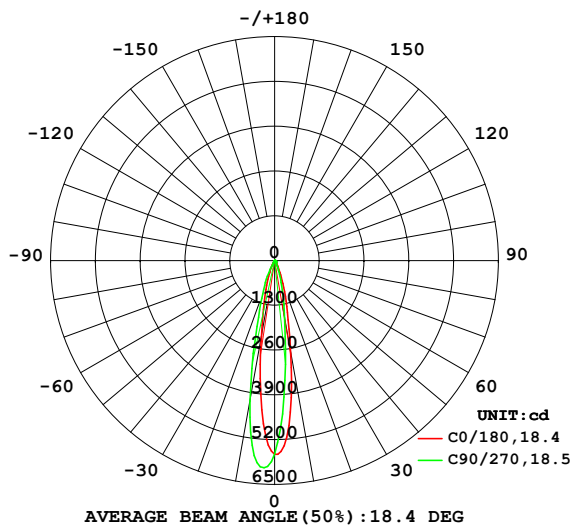

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

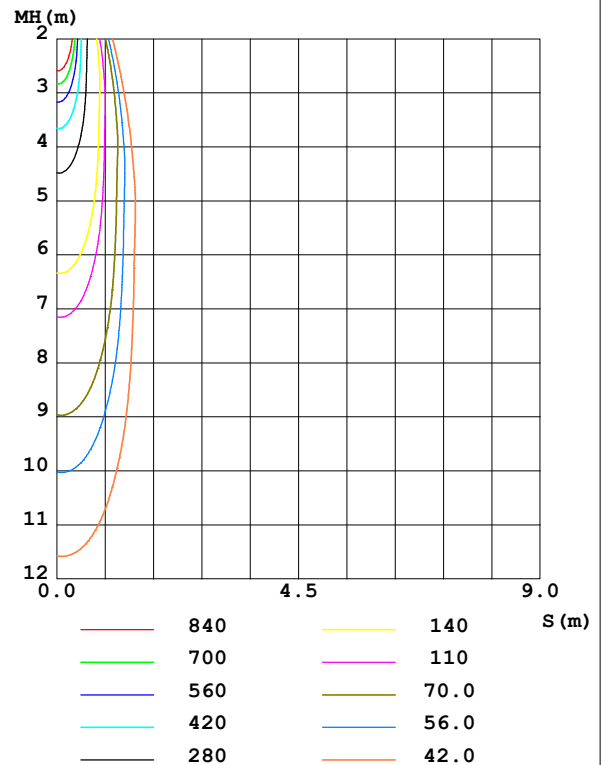

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3 °C
Operators: Allen
Test Date: 2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	2725	1966	1696	1741	2238	3317	4143	3802	0- 10	377.2	377.2	37.8,37.8
20	712.4	514.0	423.0	444.7	582.4	822.4	1028	964.3	10- 20	386.6	763.8	76.5,76.5
30	169.5	131.4	116.2	119.5	136.8	82.48	99.58	141.1	20- 30	154.8	918.5	92,92
40	52.17	60.85	55.33	54.16	35.36	18.16	16.81	24.87	30- 40	41.87	960.4	96.2,96.2
50	20.89	36.93	34.12	29.56	12.81	0.7775	0.3100	4.029	40- 50	20.92	981.3	98.3,98.3
60	5.127	18.74	20.90	13.17	1.119	0	0	0.0238	50- 60	10.49	991.8	99.3,99.3
70	0.4190	4.460	7.608	1.741	0.2591	0	0	0	60- 70	4.279	996.1	99.8,99.8
80	0.1497	0.5355	0.6602	0.4515	0	0	0	0	70- 80	0.7425	996.8	99.8,99.8
90	0	0.2707	0.3983	0.1802	0	0	0	0	80- 90	0.1771	997.0	99.9,99.9
100	0	0.0129	0.1230	0	0	0	0	0	90-100	0.0613	997.1	99.9,99.9
110	0	0	0	0	0	0	0	0	100-110	0.0044	997.1	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0	997.1	99.9,99.9
130	0	0	0	0	0	0	0	0	120-130	0	997.1	99.9,99.9
140	0.1018	0.1992	0.2818	0.2829	0.3498	0.2327	0.1725	0.1831	130-140	0.0340	997.1	99.9,99.9
150	0.4488	0.5222	0.5998	0.6841	1.354	1.205	1.074	1.112	140-150	0.3430	997.5	99.9,99.9
160	0.5675	0.5638	0.6007	0.6737	2.082	2.142	2.159	2.202	150-160	0.5380	998.0	99.9,99.9
170	0.5268	0.5169	0.5667	0.6570	1.683	1.838	2.089	2.222	160-170	0.3892	998.4	100,100
180	0.7604	0.9088	1.114	1.180	0.7672	0.8324	1.018	1.172	170-180	0.1123	998.5	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 972.62 lm

%lum = 97.4%

%lamp = 97.4%

Conical surface Flux(120deg): 991.82 lm

%lum = 99.3%


%lamp = 99.3%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz Lamp Flux:998.503x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

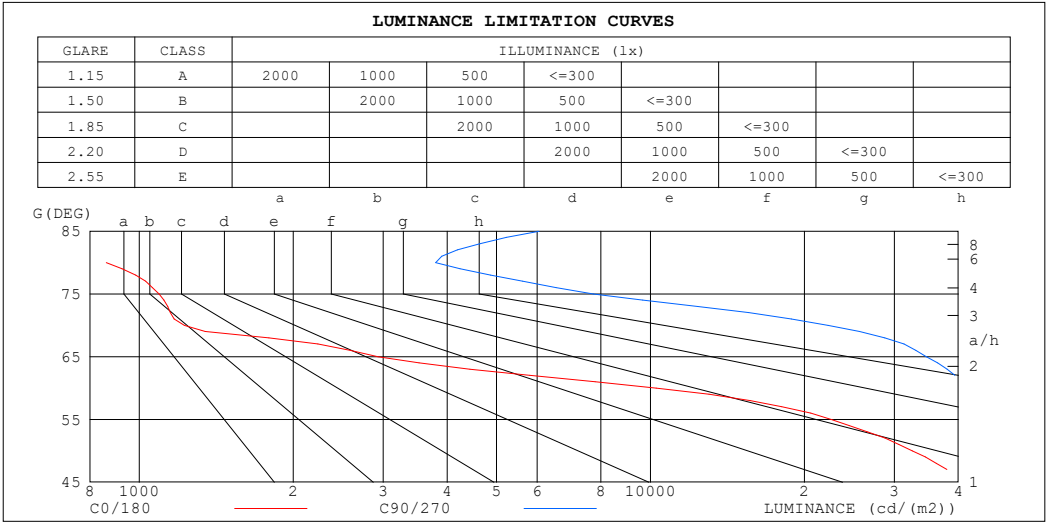

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	60	6052
80	862	3802
75	1093	7737
70	1225	22245
65	2933	34658
60	10254	41803
55	22572	46496
50	32501	53080
45	46341	61216


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz		
Lamp Flux:998.503x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.13	1.11	1.09	1.11	1.09	1.07	1.07	1.05	1.04	1.03	1.02	1.01	.99	.99	.98	.96
2.0	1.07	1.04	1.02	1.06	1.03	1.00	1.02	1.00	.98	.00	.98	.96	.97	.95	.94	.93
3.0	1.02	.99	.96	1.01	.98	.95	.99	.96	.94	.96	.94	.92	.94	.92	.91	.89
4.0	.98	.94	.91	.97	.94	.91	.95	.92	.90	.93	.91	.89	.92	.89	.88	.86
5.0	.95	.90	.87	.94	.90	.87	.92	.89	.86	.91	.88	.85	.89	.87	.85	.84
6.0	.91	.87	.84	.91	.87	.84	.89	.86	.83	.88	.85	.83	.87	.84	.82	.81
7.0	.88	.84	.81	.88	.84	.81	.87	.83	.80	.86	.82	.80	.85	.82	.80	.79
8.0	.86	.81	.78	.85	.81	.78	.84	.81	.78	.83	.80	.78	.82	.80	.77	.76
9.0	.83	.79	.76	.83	.79	.76	.82	.78	.76	.81	.78	.76	.80	.77	.75	.74
10.0	.81	.77	.74	.80	.77	.74	.80	.76	.74	.79	.76	.74	.78	.76	.73	.72

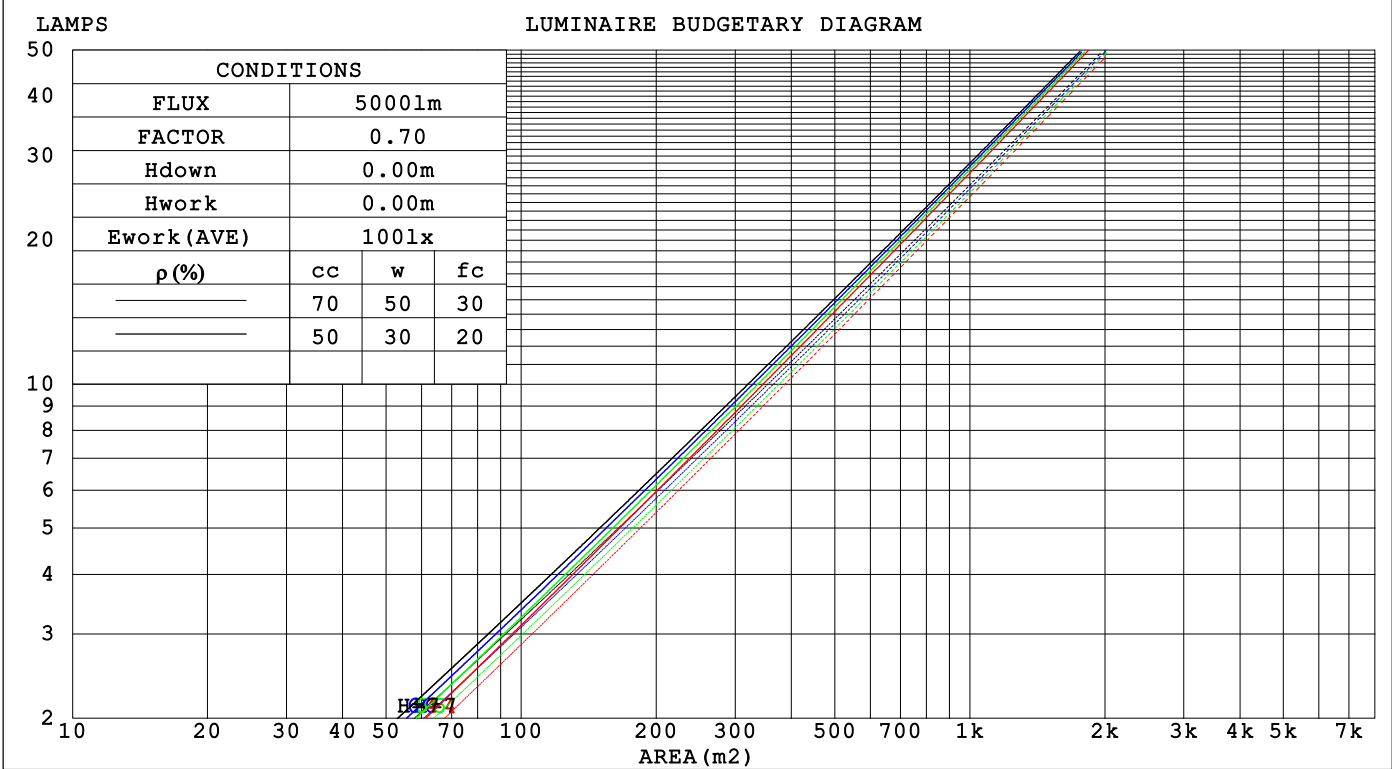

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-29

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz Lamp Flux:998.503x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.140	.080	.025	.133	.076	.024	.121	.069	.022	.109	.063	.020	.099	.057	.018															
2.0	.130	.071	.022	.125	.069	.021	.115	.064	.020	.105	.059	.018	.096	.054	.017															
3.0	.122	.065	.019	.117	.063	.019	.108	.059	.018	.100	.055	.017	.093	.052	.016															
4.0	.114	.059	.017	.110	.058	.017	.103	.055	.016	.096	.052	.016	.090	.049	.015															
5.0	.107	.055	.016	.104	.053	.016	.098	.051	.015	.092	.049	.014	.087	.046	.014															
6.0	.101	.051	.015	.099	.050	.014	.093	.048	.014	.088	.046	.013	.083	.044	.013															
7.0	.096	.048	.013	.094	.047	.013	.089	.045	.013	.085	.043	.013	.081	.042	.012															
8.0	.091	.045	.013	.089	.044	.012	.085	.043	.012	.081	.041	.012	.078	.040	.012															
9.0	.087	.042	.012	.085	.042	.012	.082	.040	.011	.078	.039	.011	.075	.038	.011															
10.0	.083	.040	.011	.082	.039	.011	.079	.038	.011	.075	.037	.011	.073	.037	.010															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.170	.159	.149	.145	.136	.128	.099	.094	.089	.057	.054	.052	.018	.017	.017	
2.0	.152	.134	.119	.130	.115	.103	.089	.080	.072	.051	.046	.042	.016	.015	.014	
3.0	.137	.114	.096	.118	.099	.084	.081	.069	.059	.047	.040	.035	.015	.013	.011	
4.0	.125	.099	.080	.107	.086	.069	.074	.060	.049	.043	.035	.029	.014	.011	.009	
5.0	.114	.087	.067	.098	.075	.058	.068	.053	.041	.039	.031	.024	.013	.010	.008	
6.0	.105	.077	.056	.091	.067	.049	.063	.047	.035	.036	.027	.021	.012	.009	.007	
7.0	.098	.069	.048	.084	.060	.042	.058	.042	.030	.034	.025	.018	.011	.008	.006	
8.0	.091	.062	.042	.079	.054	.037	.054	.038	.026	.032	.022	.015	.010	.007	.005	
9.0	.086	.056	.037	.074	.049	.032	.051	.034	.023	.030	.020	.014	.010	.007	.004	
10.0	.081	.052	.032	.069	.045	.028	.048	.032	.020	.028	.019	.012	.009	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz Lamp Flux:998.503x1 lm											
NAME:			TYPE:			WEIGHT:					
SPEC.:			DIM.:			SERIAL No.:					
MFR.:			SUR.:			Shielding Angle:					
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions	Viewed crosswise					Viewed endwise					
x = 2H y = 2H	3H	18.8	19.5	19.1	19.7	19.8	20.9	21.5	21.2	21.7	21.9
	4H	18.8	19.4	19.0	19.6	19.8	20.9	21.5	21.2	21.7	21.9
	6H	18.7	19.2	19.0	19.5	19.7	20.8	21.4	21.1	21.6	21.9
	8H	18.6	19.2	18.9	19.4	19.7	20.8	21.3	21.1	21.6	21.8
	12H	18.6	19.1	18.9	19.4	19.6	20.8	21.3	21.1	21.5	21.8
	4H	19.3	19.9	19.6	20.1	20.3	20.5	21.1	20.8	21.3	21.6
4H	3H	19.2	19.7	19.5	20.0	20.2	21.1	21.6	21.4	21.9	22.2
	4H	19.1	19.6	19.4	19.9	20.2	21.1	21.6	21.4	21.9	22.2
	6H	19.0	19.4	19.4	19.8	20.1	21.0	21.4	21.4	21.8	22.1
	8H	19.0	19.3	19.3	19.7	20.1	21.0	21.4	21.4	21.7	22.1
	12H	18.9	19.3	19.3	19.6	20.0	20.9	21.3	21.3	21.7	22.1
	8H	19.0	19.4	19.4	19.8	20.1	21.0	21.4	21.3	21.7	22.1
8H	6H	18.9	19.2	19.3	19.6	20.0	20.9	21.2	21.3	21.6	22.0
	8H	18.8	19.1	19.3	19.6	20.0	20.8	21.1	21.3	21.5	22.0
	12H	18.8	19.0	19.3	19.5	19.9	20.8	21.0	21.3	21.5	21.9
	12H	19.0	19.3	19.4	19.7	20.1	20.9	21.3	21.3	21.6	22.0
12H	6H	18.8	19.1	19.3	19.6	20.0	20.8	21.1	21.3	21.5	22.0
	8H	18.8	19.0	19.3	19.5	20.0	20.8	21.0	21.2	21.5	21.9
	Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.5 / - 2.8					+ 0.7 / - 1.0					
1.5H	+ 1.3 / - 2.2					+ 0.5 / - 0.8					
2.0H	+ 2.1 / - 6.4					+ 1.0 / - 1.0					

CIE Pub.117, 998.5 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.0)
Area: 0.001 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz Lamp Flux:998.503x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	89	83	80	89	83	79	88	83	79	76
0.80	96	91	87	96	90	87	95	90	87	83
1.00	100	95	92	100	95	91	98	94	91	87
1.25	104	99	96	103	99	96	101	98	95	91
1.50	107	102	99	106	102	99	103	100	98	93
2.00	109	105	102	108	104	101	105	102	100	95
2.50	111	107	104	109	106	103	106	104	101	96
3.00	112	109	106	110	108	105	107	105	103	97
4.00	114	112	109	112	110	108	109	107	105	98
5.00	115	113	112	113	111	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz Lamp Flux:998.503x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

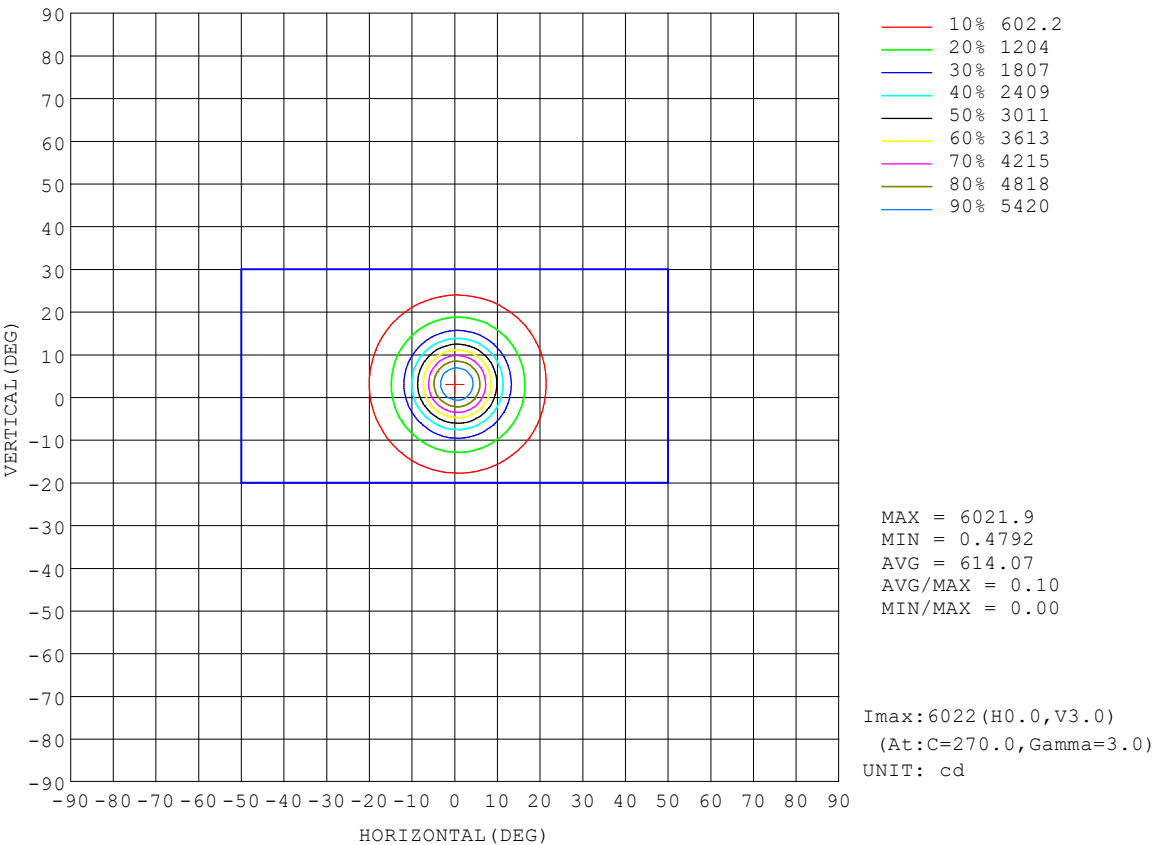


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3℃
Operators: Allen
Test Date: 2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:

AAI Figure

Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz Lamp Flux:998.503x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

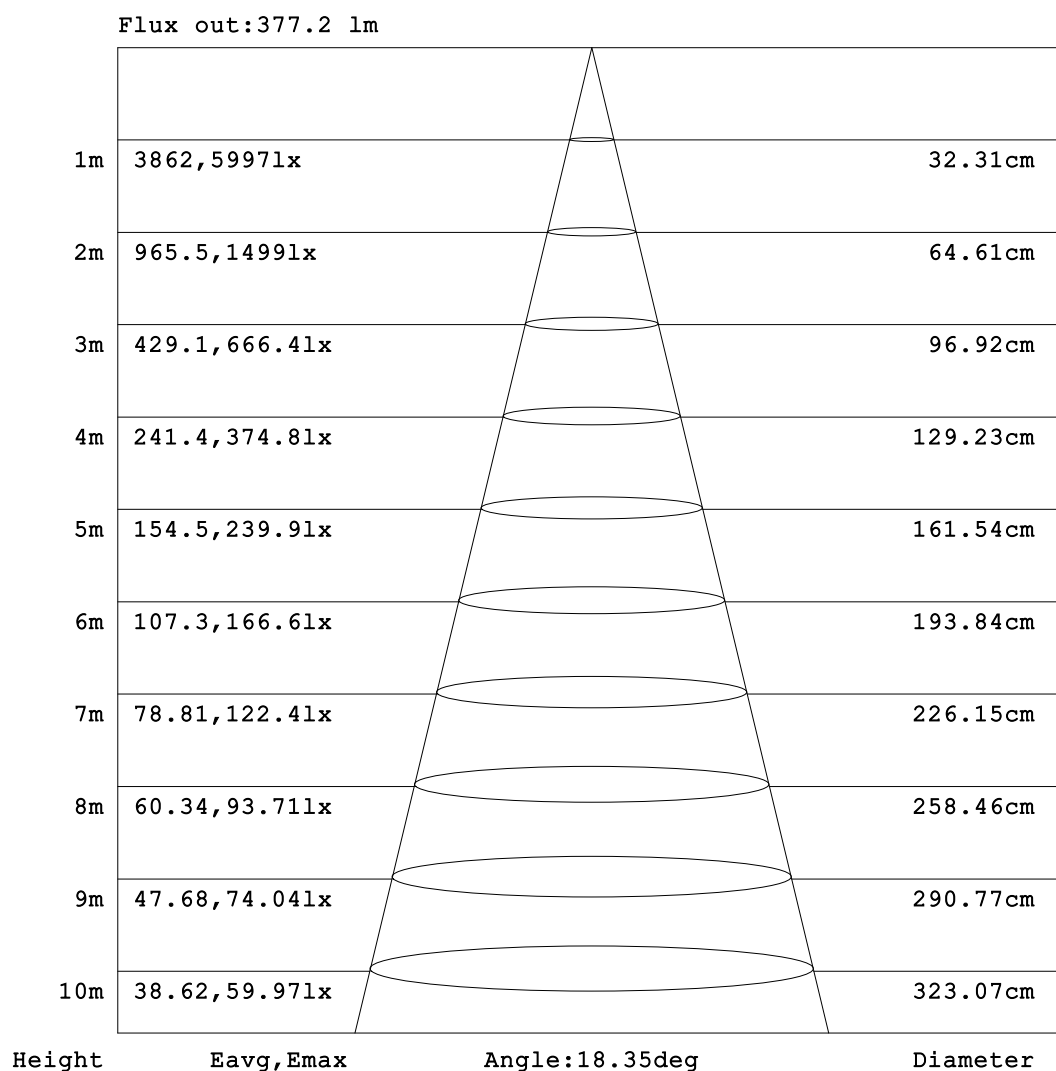


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ISOLUX DIAGRAM


Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz Lamp Flux:998.503x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

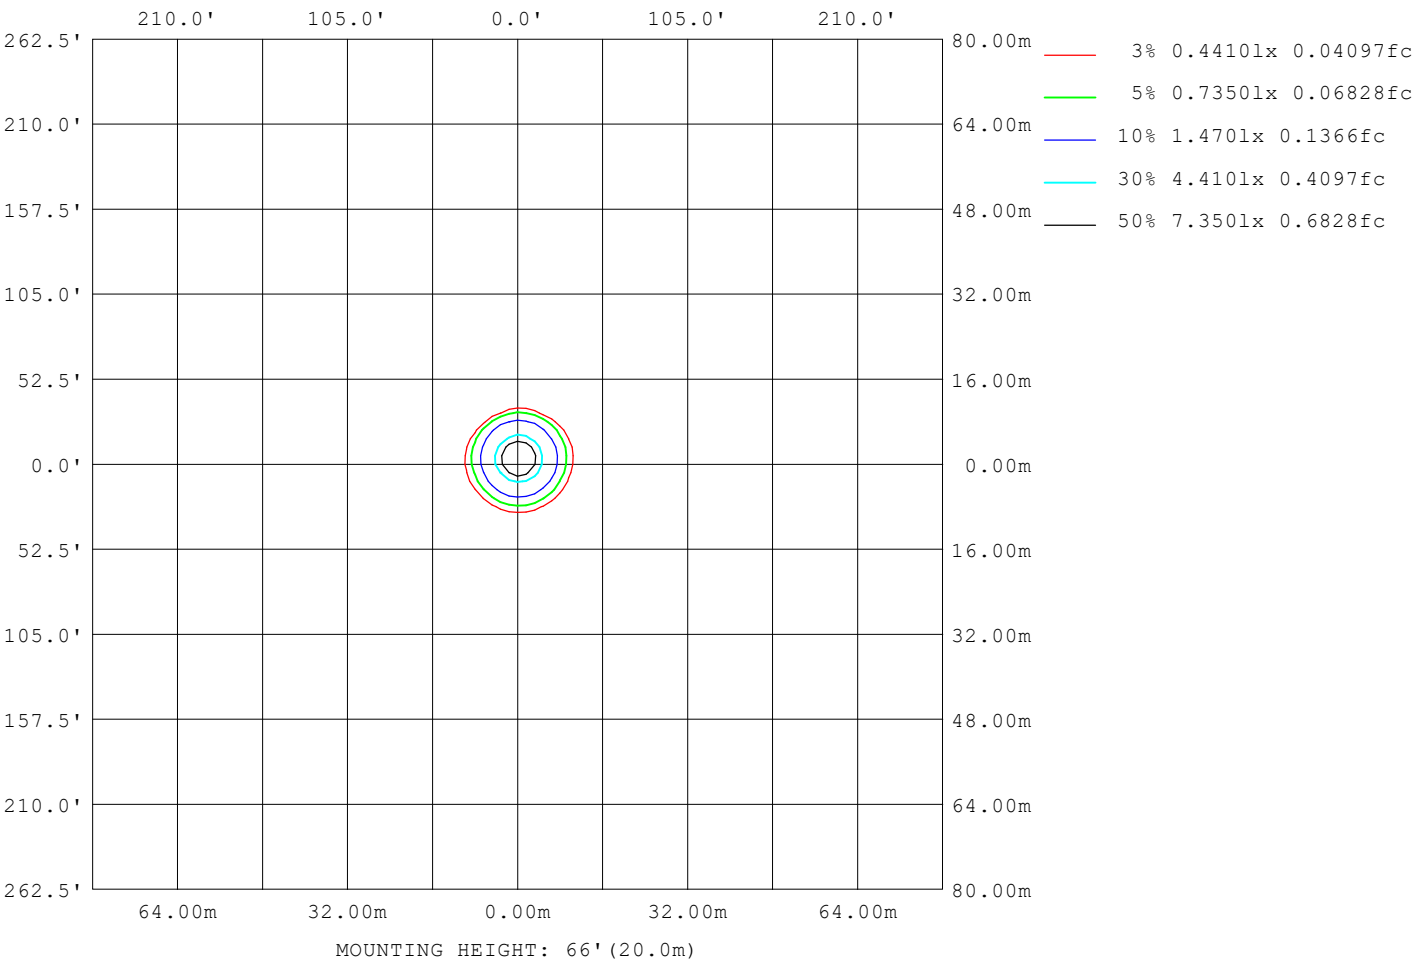

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

Planar Illuminance Curve

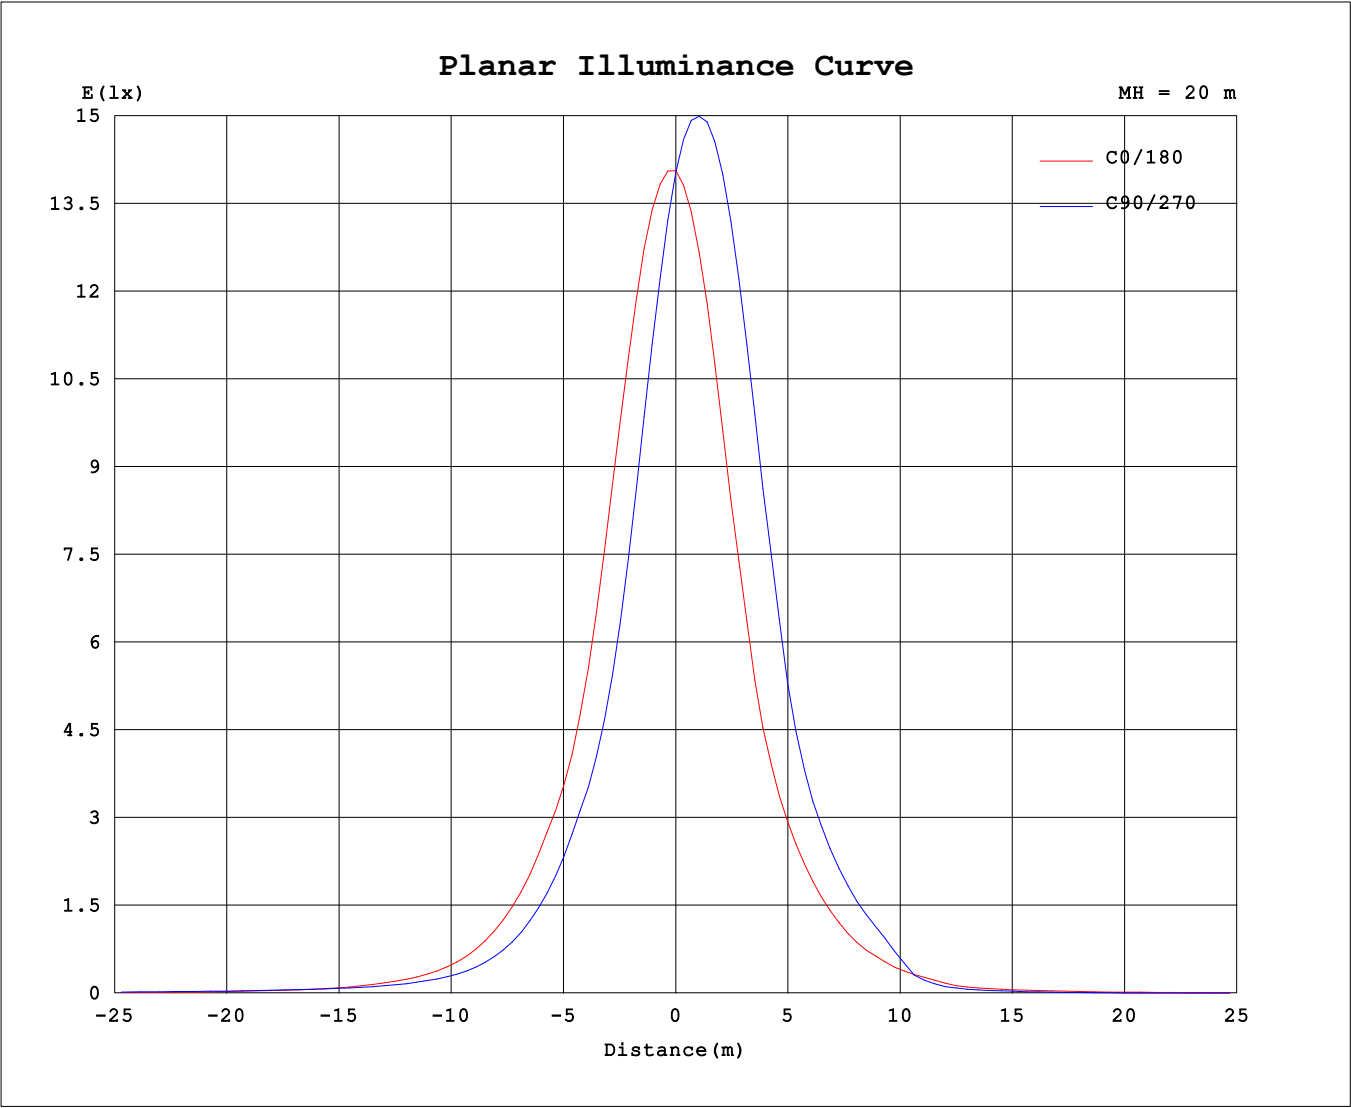

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:1.4330A P:14.214W PF:0.7916 Freq:60.01Hz Lamp Flux:998.503x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	
0	5624	5625	5620	5619	5614	5611	5607	5609	5624	5625	5620	5619	5614	5611	5607	5609	
5	4806	4338	3927	3649	3495	3488	3629	3930	4350	4854	5352	5721	5889	5866	5656	5265	
10	2725	2285	1966	1784	1696	1687	1741	1919	2238	2739	3317	3829	4143	4114	3802	3291	
15	1383	1204	1052	941	888	884	906	993	1133	1316	1552	1808	1989	1999	1838	1602	
20	712	609	514	452	423	422	445	491	582	687	822	950	1028	1033	964	853	
25	340	283	242	215	205	205	216	241	290	341	380	434	506	512	477	411	
30	170	146	131	121	116	116	119	130	137	95.0	82.5	82.2	99.6	112	141	196	
35	92.0	89.2	82.4	77.3	73.8	71.8	72.2	73.5	56.7	43.1	34.2	33.5	34.3	37.9	49.2	68.1	
40	52.2	61.8	60.9	57.9	55.3	54.3	54.2	49.0	35.4	23.8	18.2	16.7	16.8	19.1	24.9	38.4	
45	32.8	44.4	47.5	45.8	43.3	42.6	41.5	32.4	21.6	13.5	7.61	5.15	5.82	7.83	13.9	22.2	
50	20.9	29.9	36.9	35.9	34.1	33.4	29.6	20.8	12.8	4.59	0.78	0.14	0.31	0.71	4.03	12.9	
55	12.9	20.7	26.8	27.7	26.7	25.1	20.2	13.3	4.97	0.76	0.00	0.00	0.00	0.00	0.48	4.27	
60	5.13	13.2	18.7	21.3	20.9	18.4	13.2	6.00	1.12	0.15	0.00	0.00	0.00	0.00	0.02	0.86	
65	1.24	5.59	11.6	14.4	14.6	11.4	6.09	1.63	0.36	0.08	0.00	0.00	0.00	0.00	0.00	0.22	
70	0.42	1.52	4.46	7.41	7.61	4.68	1.74	0.57	0.26	0.00	0.00	0.00	0.00	0.00	0.00	0.13	
75	0.28	0.55	1.29	1.99	2.00	1.33	0.66	0.39	0.13	0.00	0.00	0.00	0.00	0.00	0.00	0.02	
80	0.15	0.37	0.54	0.68	0.66	0.57	0.45	0.26	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
85	0.01	0.23	0.41	0.51	0.53	0.46	0.32	0.11	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
90	0.00	0.09	0.27	0.39	0.40	0.32	0.18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
95	0.00	0.00	0.13	0.24	0.25	0.18	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
100	0.00	0.00	0.01	0.11	0.12	0.06	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
105	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
135	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.00	0.04	0.01	0.00	0.00	0.00	0.00	0.00	0.00	
140	0.10	0.14	0.20	0.25	0.28	0.29	0.28	0.24	0.35	0.29	0.23	0.19	0.17	0.17	0.18	0.21	
145	0.32	0.39	0.45	0.50	0.55	0.58	0.58	0.54	0.84	0.77	0.67	0.59	0.55	0.55	0.57	0.63	
150	0.45	0.49	0.52	0.56	0.60	0.65	0.68	0.69	1.35	1.30	1.21	1.12	1.07	1.08	1.11	1.19	
155	0.58	0.58	0.59	0.60	0.62	0.66	0.71	0.74	1.83	1.83	1.79	1.75	1.72	1.72	1.76	1.82	
160	0.57	0.55	0.56	0.58	0.60	0.64	0.67	0.71	2.08	2.10	2.14	2.15	2.16	2.18	2.20	2.22	
165	0.53	0.52	0.54	0.55	0.58	0.62	0.65	0.69	1.98	2.00	2.11	2.19	2.25	2.29	2.33	2.33	
170	0.53	0.51	0.52	0.54	0.57	0.61	0.66	0.70	1.68	1.69	1.84	1.98	2.09	2.17	2.22	2.22	
175	0.57	0.58	0.59	0.63	0.67	0.72	0.76	0.79	1.25	1.26	1.40	1.55	1.69	1.78	1.84	1.83	
180	0.76	0.82	0.91	1.00	1.11	1.16	1.18	1.15	0.77	0.77	0.83	0.92	1.02	1.12	1.17	1.19	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: