


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz Lamp Flux:1805.55x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 70.75 lm/W
MODEL	SMART FIXTURE 2700K	Imax (cd)	4824	S/MH(C0/180)	0.51	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.58	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	1805.5	η UP,DN(C0-180)	0.1,50.9	
NOMINAL FLUX(lm)	1805.55	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,48.9	
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.55	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

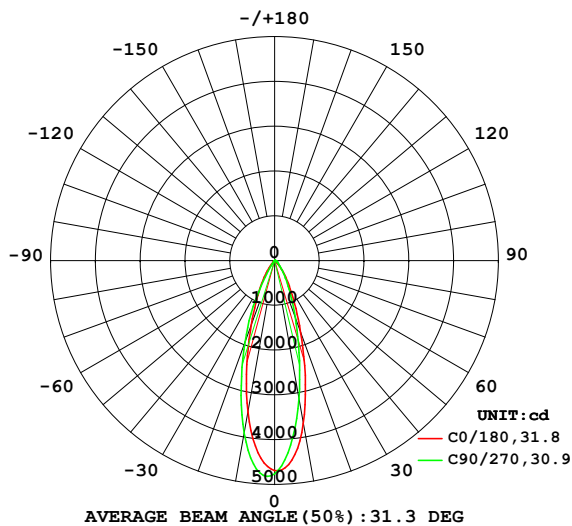

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

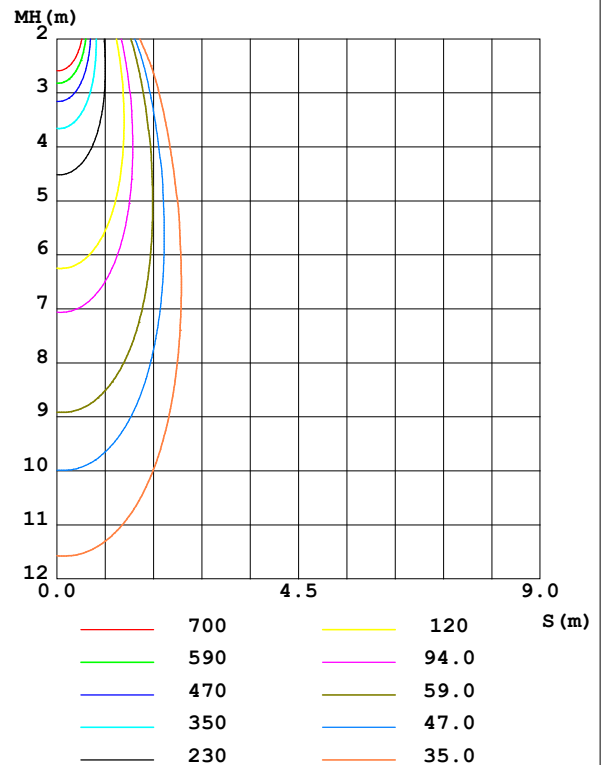

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	3700	3208	3131	3441	3445	3889	3922	3713	0- 10	392.8	392.8	21.8,21.8
20	1711	1369	1361	1508	1535	1845	1929	1707	10- 20	691.4	1084	60,60
30	657.4	473.8	545.5	527.4	578.6	408.5	423.4	402.7	20- 30	445.3	1530	84.7,84.7
40	203.1	193.1	233.3	202.8	130.7	49.87	42.21	51.35	30- 40	169.9	1699	94.1,94.1
50	50.58	91.55	107.4	85.66	29.62	2.176	0.1087	3.646	40- 50	63.59	1763	97.6,97.6
60	10.86	38.09	51.07	32.68	3.416	0.1878	0	0.3199	50- 60	26.23	1789	99.1,99.1
70	1.443	10.13	19.16	7.920	1.063	0	0	0	60- 70	10.05	1799	99.7,99.7
80	0.7453	1.812	2.685	1.739	0.3124	0	0	0	70- 80	2.447	1802	99.8,99.8
90	0.0016	1.122	1.597	1.066	0	0	0	0	80- 90	0.7268	1802	99.8,99.8
100	0	0.4076	0.8225	0.3397	0	0	0	0	90-100	0.3589	1803	99.8,99.8
110	0	0	0.1889	0	0	0	0	0	100-110	0.0997	1803	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0.0040	1803	99.9,99.9
130	0	0.0032	0	0	0.0932	0.0600	0.0813	0.1191	120-130	0.0047	1803	99.9,99.9
140	0.4171	0.4972	0.4741	0.4352	0.8961	0.7829	0.7970	0.9348	130-140	0.2256	1803	99.9,99.9
150	0.8358	0.9212	0.9724	0.9987	2.125	2.030	2.048	2.243	140-150	0.6814	1804	99.9,99.9
160	1.257	1.280	1.340	1.415	3.114	3.144	3.215	3.320	150-160	0.8906	1805	100,100
170	1.367	1.349	1.425	1.544	2.904	3.002	3.169	3.266	160-170	0.6541	1805	100,100
180	2.034	2.197	2.288	2.258	2.022	2.097	2.177	2.203	170-180	0.2117	1806	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1738.4 lm

%lum = 96.3%

%lamp = 96.3%

Conical surface Flux(120deg): 1789.2 lm

%lum = 99.1%


%lamp = 99.1%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz Lamp Flux:1805.55x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

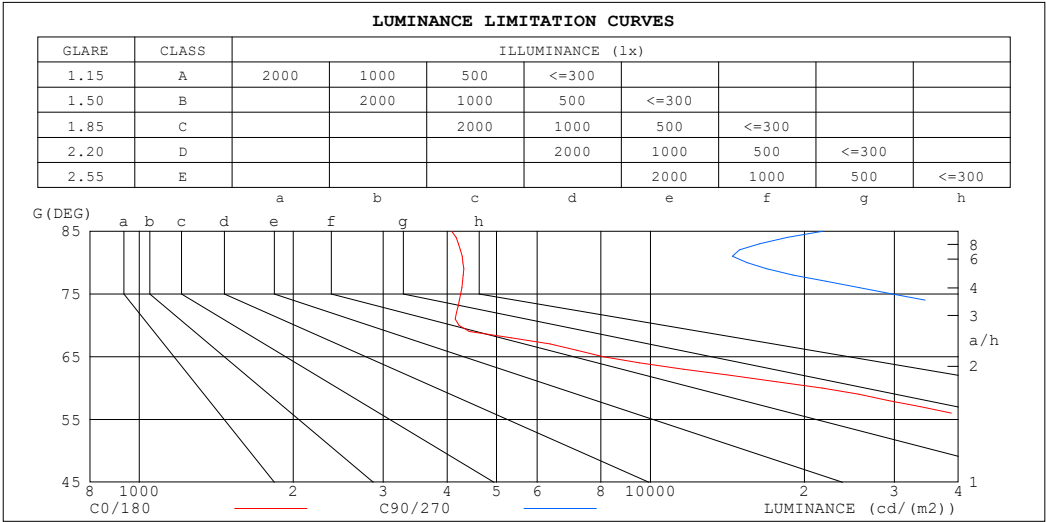

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	4083	21706
80	4292	15462
75	4252	29759
70	4220	56017
65	8085	80161
60	21719	102144
55	43928	129202
50	78684	167123
45	144838	222023


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz		
Lamp Flux:1805.55x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.09	1.07	1.10	1.08	1.06	1.05	1.04	1.02	1.02	1.01	.99	.98	.97	.97	.95
2.0	1.05	1.02	.99	1.03	1.00	.98	1.00	.98	.95	.97	.95	.93	.95	.93	.91	.90
3.0	.99	.95	.92	.98	.94	.91	.95	.92	.89	.93	.90	.88	.91	.89	.87	.85
4.0	.94	.89	.86	.93	.89	.85	.91	.87	.84	.89	.86	.83	.87	.85	.82	.81
5.0	.89	.84	.81	.89	.84	.80	.87	.83	.80	.85	.82	.79	.84	.81	.78	.77
6.0	.85	.80	.77	.84	.80	.76	.83	.79	.76	.82	.78	.75	.80	.77	.75	.73
7.0	.81	.76	.73	.81	.76	.73	.80	.75	.72	.78	.75	.72	.77	.74	.71	.70
8.0	.78	.73	.69	.77	.73	.69	.76	.72	.69	.75	.72	.69	.74	.71	.68	.67
9.0	.75	.70	.66	.74	.70	.66	.73	.69	.66	.73	.69	.66	.72	.68	.66	.64
10.0	.72	.67	.64	.71	.67	.64	.71	.66	.63	.70	.66	.63	.69	.66	.63	.62

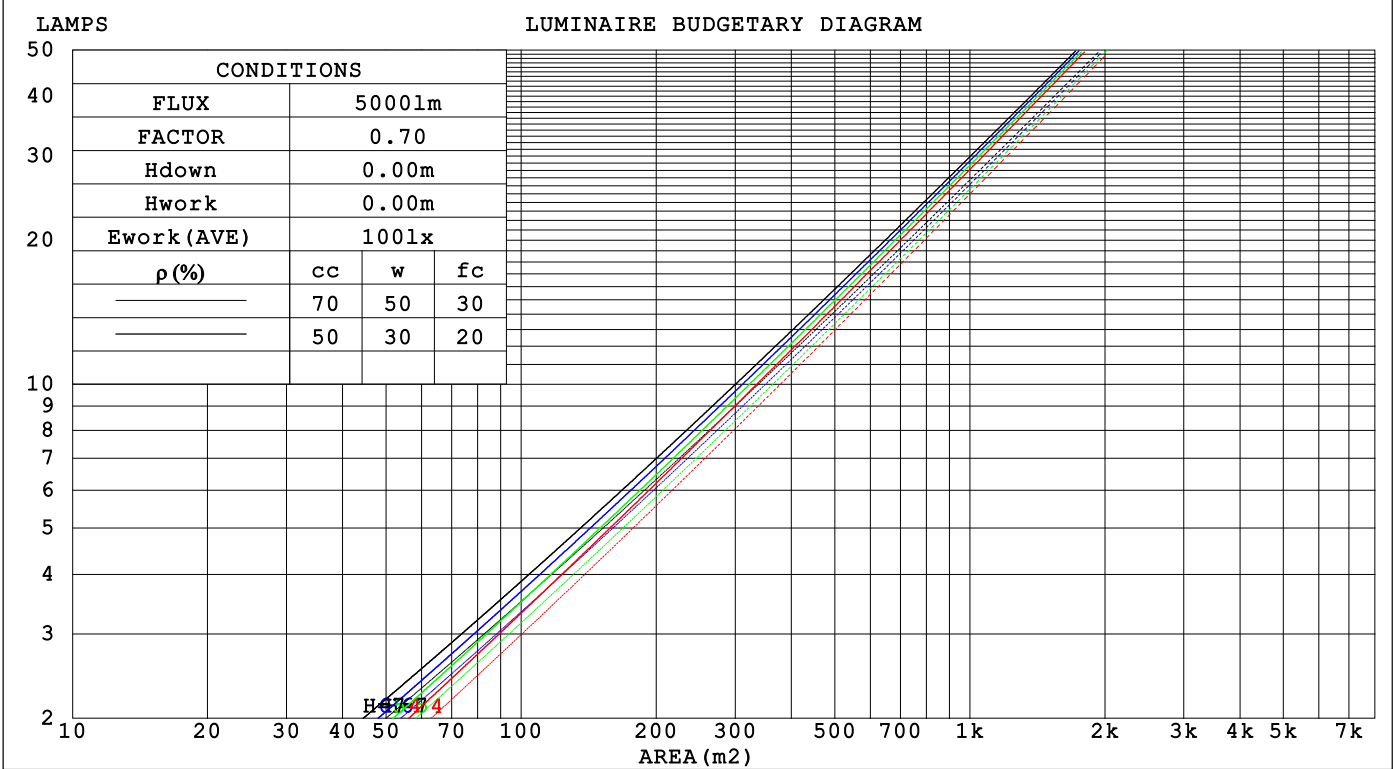

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

WEC AND CCEC

Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz Lamp Flux:1805.55x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.159	.091	.029	.152	.087	.028	.140	.080	.026	.128	.074	.024	.118	.068	.022	
2.0	.150	.082	.025	.145	.080	.025	.134	.075	.023	.125	.070	.022	.116	.065	.021	
3.0	.142	.075	.023	.137	.073	.022	.128	.070	.021	.120	.066	.020	.112	.062	.019	
4.0	.134	.070	.020	.130	.068	.020	.122	.065	.019	.115	.062	.019	.109	.059	.018	
5.0	.127	.065	.019	.124	.063	.018	.117	.061	.018	.111	.059	.017	.105	.056	.017	
6.0	.121	.061	.017	.118	.060	.017	.112	.057	.017	.107	.055	.016	.102	.054	.016	
7.0	.115	.057	.016	.112	.056	.016	.107	.054	.016	.103	.053	.015	.098	.051	.015	
8.0	.110	.054	.015	.108	.053	.015	.103	.052	.015	.099	.050	.014	.095	.049	.014	
9.0	.105	.051	.014	.103	.050	.014	.099	.049	.014	.095	.048	.014	.092	.047	.013	
10.0	.101	.048	.013	.099	.048	.013	.095	.047	.013	.092	.046	.013	.089	.045	.013	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.171	.159	.148	.147	.136	.127	.100	.094	.088	.058	.054	.051	.018	.017	.017	
2.0	.155	.134	.116	.133	.115	.101	.091	.080	.070	.052	.046	.041	.017	.015	.013	
3.0	.141	.115	.094	.121	.099	.081	.083	.069	.057	.048	.040	.034	.015	.013	.011	
4.0	.130	.100	.077	.111	.086	.067	.077	.060	.047	.044	.035	.028	.014	.011	.009	
5.0	.120	.088	.064	.103	.076	.056	.071	.053	.039	.041	.031	.023	.013	.010	.008	
6.0	.112	.078	.054	.096	.068	.047	.067	.047	.033	.039	.028	.020	.012	.009	.007	
7.0	.105	.070	.046	.090	.061	.040	.063	.043	.028	.036	.025	.017	.012	.008	.006	
8.0	.099	.064	.040	.085	.055	.035	.059	.039	.025	.034	.023	.015	.011	.008	.005	
9.0	.094	.058	.035	.081	.051	.030	.056	.036	.021	.033	.021	.013	.011	.007	.004	
10.0	.089	.054	.031	.077	.047	.027	.053	.033	.019	.031	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz Lamp Flux:1805.55x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	22.6	23.4	22.8	23.5	23.7	23.6	24.4	23.8	24.5	24.7
3H	22.4	23.2	22.7	23.4	23.6	23.8	24.6	24.1	24.8	25.0
4H	22.4	23.1	22.6	23.3	23.5	23.8	24.5	24.1	24.8	25.0
6H	22.3	22.9	22.6	23.2	23.4	23.8	24.4	24.1	24.7	24.9
8H	22.2	22.9	22.5	23.1	23.4	23.7	24.4	24.0	24.6	24.9
12H	22.2	22.8	22.5	23.1	23.3	23.7	24.3	24.0	24.6	24.9
4H 2H	22.6	23.3	22.9	23.5	23.7	23.5	24.2	23.8	24.5	24.7
3H	22.5	23.1	22.8	23.4	23.6	23.8	24.5	24.2	24.7	25.0
4H	22.4	22.9	22.7	23.2	23.5	23.8	24.4	24.2	24.7	25.0
6H	22.3	22.8	22.7	23.1	23.5	23.8	24.3	24.2	24.6	25.0
8H	22.2	22.7	22.6	23.1	23.4	23.7	24.2	24.1	24.6	24.9
12H	22.2	22.6	22.6	23.0	23.4	23.7	24.1	24.1	24.5	24.9
8H 4H	22.3	22.7	22.7	23.1	23.5	23.7	24.2	24.1	24.5	24.9
6H	22.2	22.6	22.6	22.9	23.4	23.6	24.0	24.1	24.4	24.8
8H	22.1	22.5	22.6	22.9	23.3	23.6	23.9	24.1	24.4	24.8
12H	22.1	22.4	22.5	22.8	23.3	23.6	23.9	24.1	24.3	24.8
12H 4H	22.2	22.6	22.6	23.0	23.4	23.7	24.1	24.1	24.5	24.8
6H	22.1	22.5	22.6	22.9	23.3	23.6	23.9	24.0	24.3	24.8
8H	22.1	22.4	22.5	22.8	23.3	23.6	23.8	24.0	24.3	24.8
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.6 / - 5.6					+ 1.6 / - 1.8				
1.5H	+ 3.6 / - 4.4					+ 2.5 / - 1.5				
2.0H	+ 3.7 / - 6.7					+ 2.9 / - 2.5				

CIE Pub.117, 1806 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 2.1$)
Area: 0.001 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz Lamp Flux:1805.55x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	88	82	78	87	81	78	87	81	78	74
0.80	95	89	86	95	89	86	93	89	85	82
1.00	100	94	91	99	94	90	97	93	90	86
1.25	103	98	95	102	98	95	100	97	94	90
1.50	106	102	98	105	101	98	103	99	97	92
2.00	109	105	102	107	104	101	105	102	99	94
2.50	110	107	104	109	105	103	106	103	101	95
3.00	112	109	106	110	107	105	107	104	103	96
4.00	114	111	109	112	110	108	108	106	105	98
5.00	115	113	111	113	111	110	109	108	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz Lamp Flux:1805.55x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

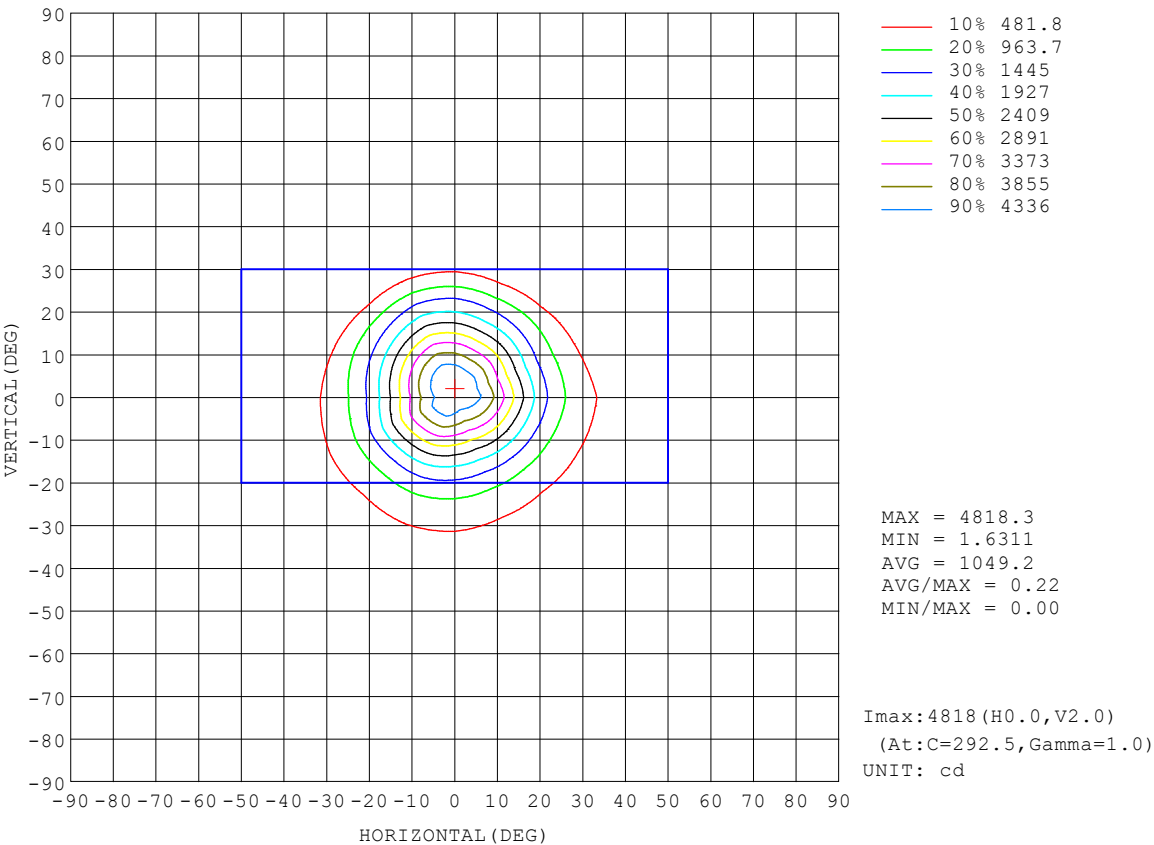

C Range: 0 - 360DEG C Interval: 22.5DEG Test Speed: HIGH Temperature:25.3℃ Operators:Allen Test Date:2026-01-29	γ Range: 0 - 180DEG γ Interval: 1.0DEG Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459 Humidity:45% Test Distance:2.900m [K=0.8783] Remarks:
--	---

AAI Figure

Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz Lamp Flux:1805.55x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

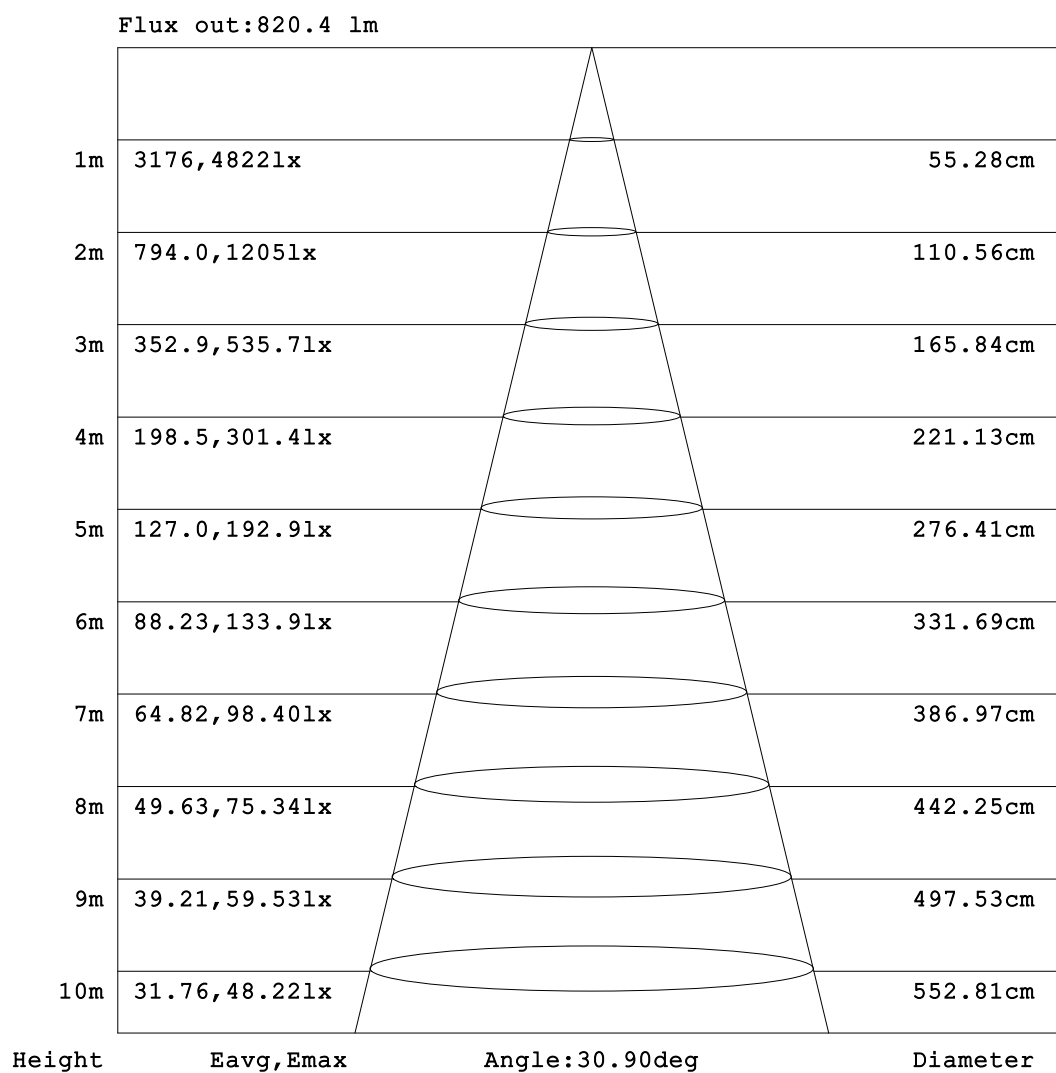


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3℃
Operators: Allen
Test Date: 2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:

ISOLUX DIAGRAM


Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz Lamp Flux:1805.55x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

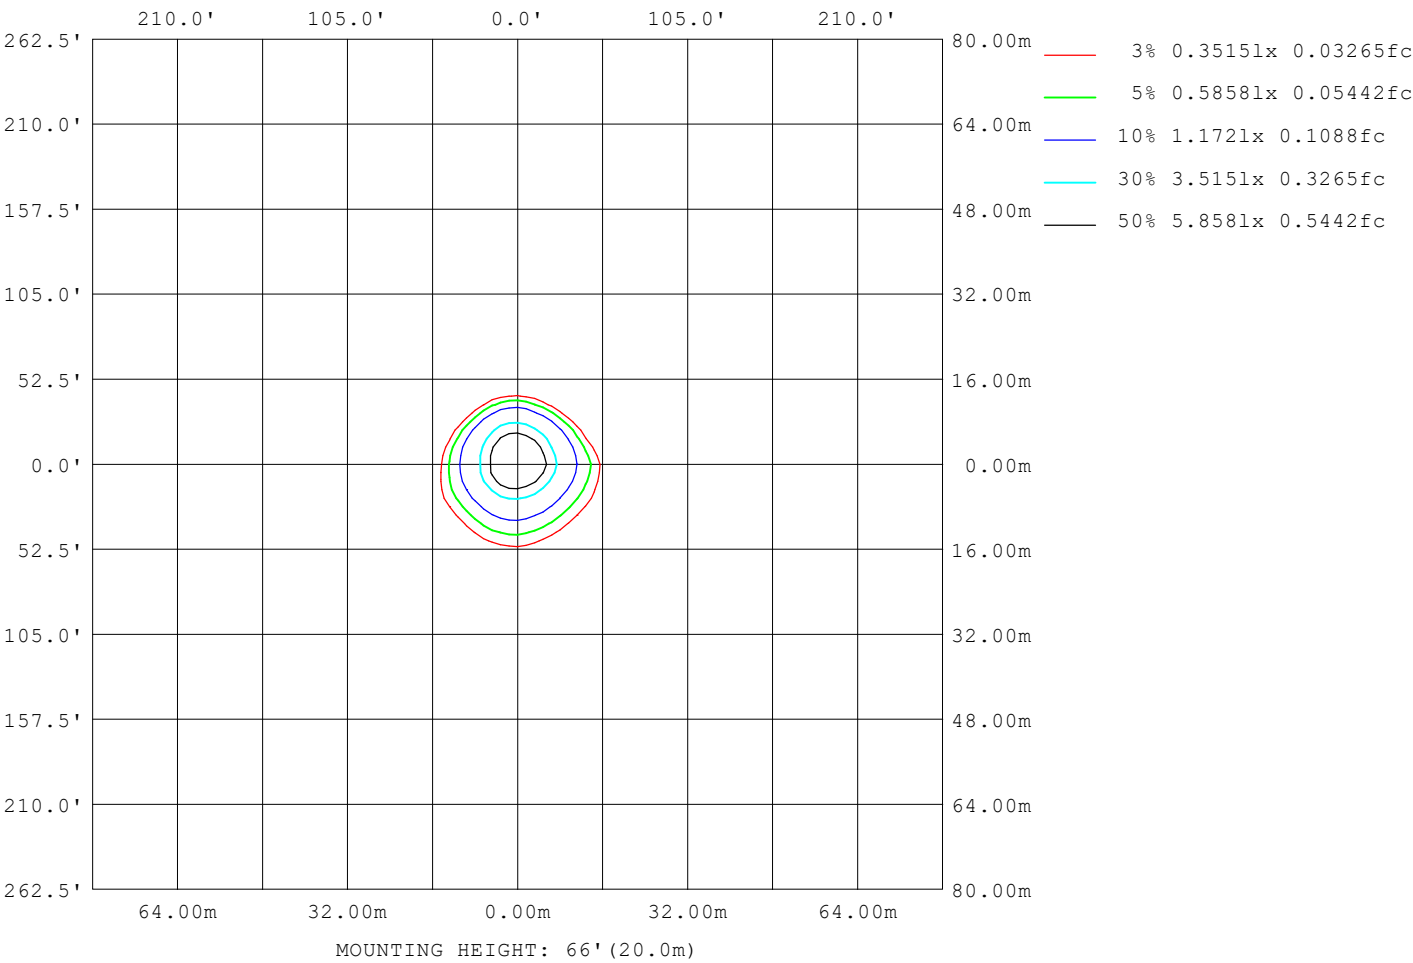

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

Planar Illuminance Curve

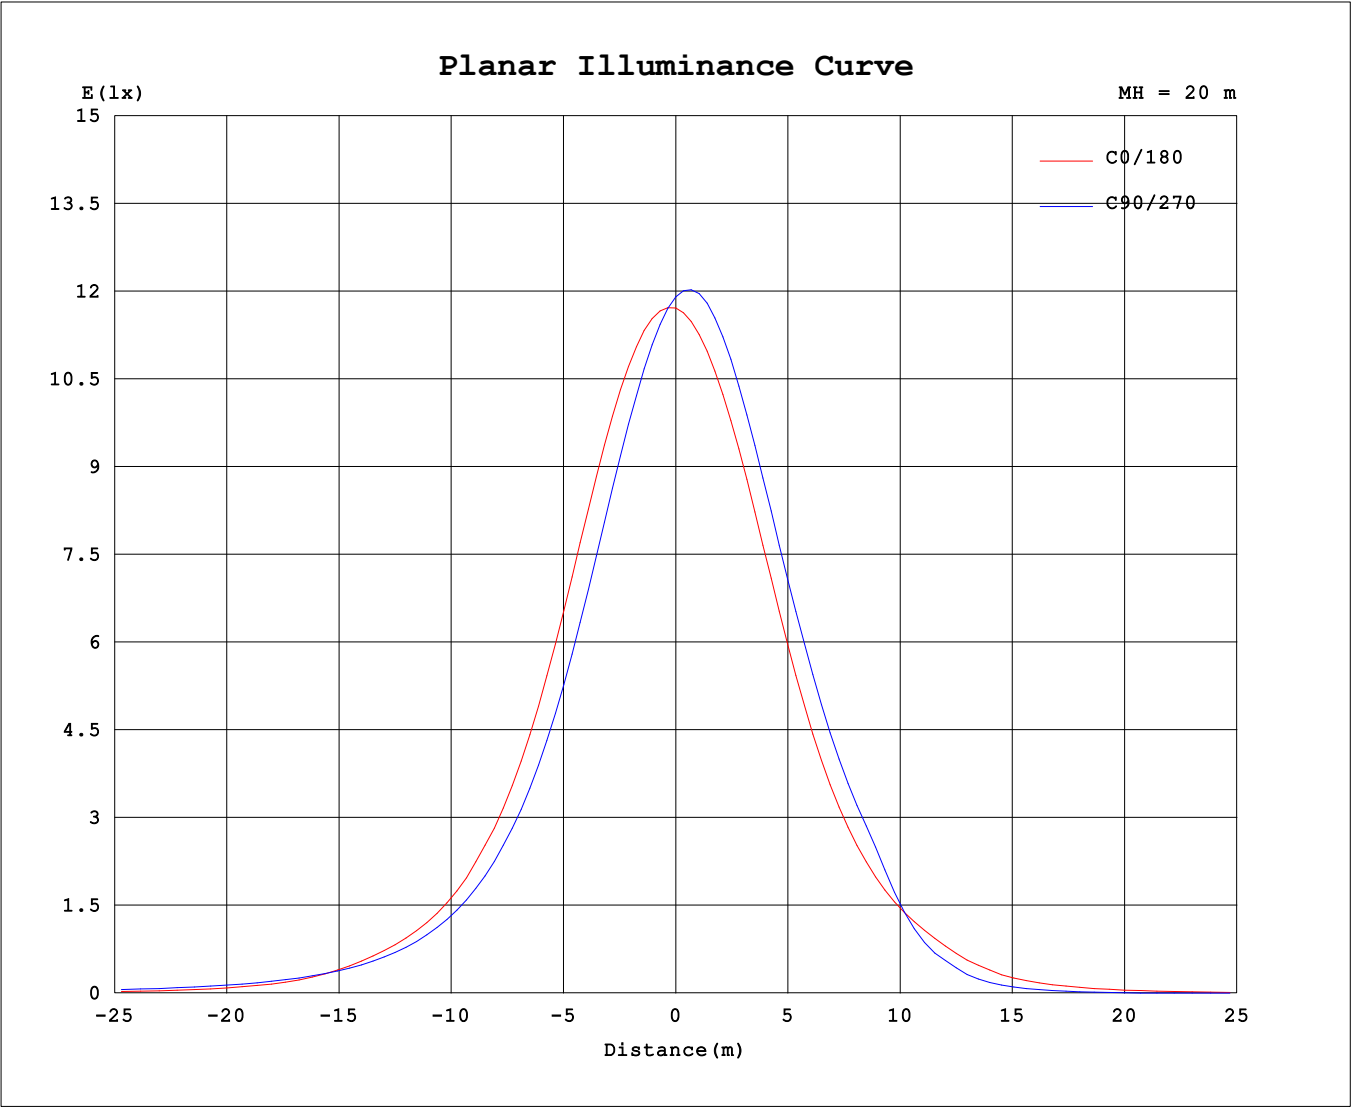

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:2.6634A P:25.521W PF:0.8320 Freq:60.01Hz Lamp Flux:1805.55x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	
0	4687	4682	4691	4687	4761	4812	4785	4754	4687	4682	4691	4687	4761	4812	4785	4754	
5	4471	4306	4145	4028	4132	4305	4352	4430	4303	4465	4598	4689	4671	4574	4541	4425	
10	3700	3440	3208	3025	3131	3336	3441	3607	3445	3684	3889	4033	3922	3756	3713	3565	
15	2651	2382	2179	2043	2124	2300	2400	2567	2410	2631	2849	3025	2896	2717	2672	2510	
20	1711	1497	1369	1298	1361	1462	1508	1632	1535	1689	1845	2025	1929	1766	1707	1595	
25	1060	901	794	788	857	904	895	977	948	1038	1084	1198	1133	975	994	963	
30	657	549	474	485	546	560	527	578	579	503	408	440	423	370	403	518	
35	402	346	295	306	353	355	320	351	287	198	138	139	135	114	136	215	
40	203	223	193	200	233	231	203	203	131	77.7	49.9	46.1	42.2	38.1	51.3	90.3	
45	102	136	133	136	157	155	135	111	61.0	33.5	16.4	10.5	8.06	7.19	20.1	41.1	
50	50.6	78.7	91.5	93.8	107	106	85.7	62.5	29.6	10.8	2.18	0.52	0.11	0.19	3.65	18.2	
55	25.2	45.2	60.9	66.5	74.1	73.6	54.2	34.8	11.8	2.28	0.26	0.00	0.00	0.02	0.44	4.74	
60	10.9	24.4	38.1	46.3	51.1	48.7	32.7	17.8	3.42	0.73	0.19	0.00	0.00	0.00	0.32	1.27	
65	3.42	11.8	21.2	29.1	33.9	29.4	17.6	7.39	1.35	0.55	0.00	0.00	0.00	0.00	0.13	0.82	
70	1.44	4.30	10.1	15.1	19.2	15.0	7.92	2.86	1.06	0.25	0.00	0.00	0.00	0.00	0.00	0.56	
75	1.10	1.81	3.82	6.11	7.70	6.30	3.10	1.54	0.74	0.00	0.00	0.00	0.00	0.00	0.00	0.20	
80	0.75	1.33	1.81	2.29	2.68	2.44	1.74	1.22	0.31	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
85	0.36	0.98	1.48	1.79	1.89	1.78	1.42	0.86	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
90	0.00	0.62	1.12	1.47	1.60	1.46	1.07	0.46	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
95	0.00	0.28	0.74	1.07	1.22	1.08	0.68	0.11	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
100	0.00	0.01	0.41	0.70	0.82	0.71	0.34	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
105	0.00	0.00	0.13	0.36	0.47	0.37	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
110	0.00	0.00	0.00	0.10	0.19	0.11	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
130	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.09	0.08	0.06	0.05	0.08	0.12	0.12	0.13	
135	0.14	0.17	0.19	0.20	0.18	0.15	0.16	0.15	0.40	0.36	0.33	0.31	0.35	0.41	0.43	0.45	
140	0.42	0.45	0.50	0.52	0.47	0.43	0.44	0.42	0.90	0.84	0.78	0.73	0.80	0.90	0.93	0.97	
145	0.66	0.71	0.76	0.80	0.79	0.78	0.79	0.75	1.51	1.46	1.39	1.32	1.38	1.51	1.55	1.59	
150	0.84	0.87	0.92	0.97	0.97	0.98	1.00	0.97	2.13	2.08	2.03	1.96	2.05	2.19	2.24	2.29	
155	1.09	1.11	1.15	1.19	1.18	1.18	1.21	1.21	2.72	2.70	2.68	2.65	2.74	2.87	2.92	2.95	
160	1.26	1.26	1.28	1.31	1.34	1.38	1.41	1.44	3.11	3.11	3.14	3.16	3.21	3.28	3.32	3.33	
165	1.30	1.30	1.31	1.34	1.38	1.43	1.48	1.53	3.11	3.11	3.18	3.25	3.30	3.35	3.40	3.41	
170	1.37	1.35	1.35	1.38	1.42	1.48	1.54	1.62	2.90	2.91	3.00	3.11	3.17	3.21	3.27	3.27	
175	1.58	1.61	1.65	1.70	1.66	1.65	1.71	1.77	2.54	2.55	2.65	2.77	2.78	2.75	2.81	2.82	
180	2.03	2.11	2.20	2.28	2.29	2.21	2.26	2.26	2.02	2.03	2.10	2.19	2.18	2.15	2.20	2.25	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: