
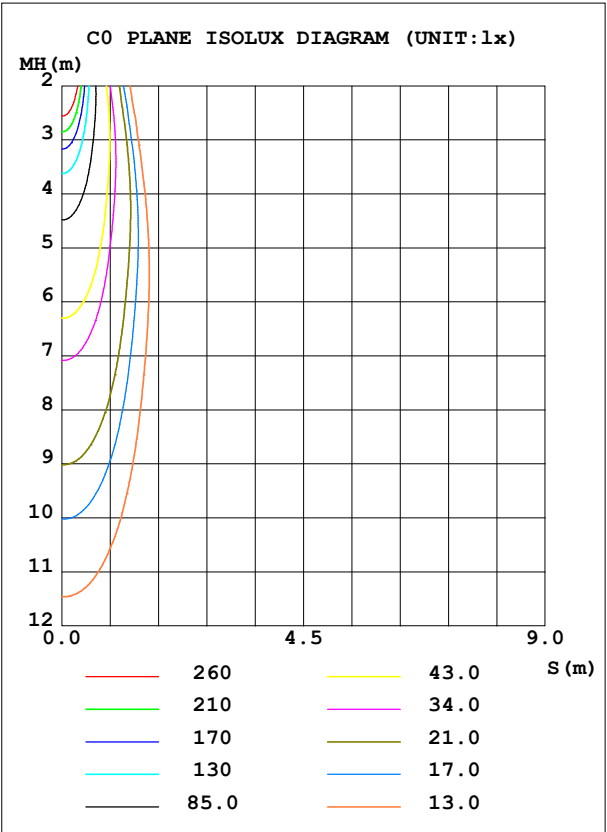


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz Lamp Flux:840.376x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 59.18 lm/W
MODEL	SMART FIXTURE 2700K	Imax (cd)	1707	S/MH(C0/180)	0.34	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.90	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	840.38	η UP,DN(C0-180)	0.1,55.6	
NOMINAL FLUX(lm)	840.376	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,44.3	
LAMPS INSIDE	1	η up (%)	0.1	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)		η down (%)	99.9	CIBSE SHR MAX	0.30	

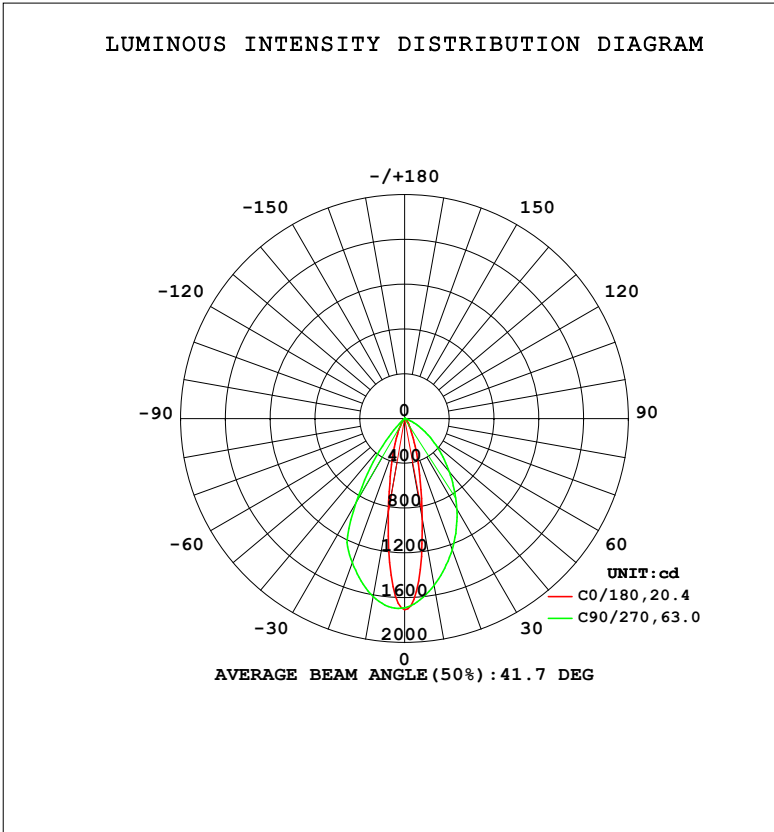

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	911.3	1089	1514	1143	841.3	1075	1616	1296	0- 10	134.9	134.9	16.1,16.1
20	296.5	442.1	1245	520.2	271.9	434.2	1370	622.8	10- 20	242.7	377.7	44.9,44.9
30	103.2	174.5	934.1	236.4	89.18	116.5	869.9	259.3	20- 30	216.2	593.9	70.7,70.7
40	49.08	80.15	623.2	108.4	35.38	21.49	264.5	50.92	30- 40	133.9	727.8	86.6,86.6
50	21.93	43.56	364.0	39.41	13.14	1.547	0.9494	5.843	40- 50	65.88	793.7	94.4,94.4
60	5.333	20.40	167.6	15.54	1.676	0	0	0.1313	50- 60	31.33	825.0	98.2,98.2
70	0.5702	6.548	40.38	3.955	0.3748	0	0	0	60- 70	11.49	836.5	99.5,99.5
80	0.2186	1.506	2.524	1.542	0.0028	0	0	0	70- 80	2.099	838.6	99.8,99.8
90	0	0.7412	1.760	0.6745	0	0	0	0	80- 90	0.6061	839.2	99.9,99.9
100	0	0.1578	0.7295	0.0724	0	0	0	0	90-100	0.2712	839.5	99.9,99.9
110	0	0	0.0846	0	0	0	0	0	100-110	0.0579	839.5	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0.0005	839.5	99.9,99.9
130	0	0	0	0	0	0	0.0901	0	120-130	0.0021	839.5	99.9,99.9
140	0	0.0316	0.0833	0.1764	0.0926	0.2669	0.3970	0.2818	130-140	0.0491	839.6	99.9,99.9
150	0.2741	0.1971	0.1847	0.3446	0.6445	0.7609	0.7345	0.6762	140-150	0.1990	839.8	99.9,99.9
160	0.5075	0.3867	0.3219	0.4848	1.157	1.195	1.017	0.9226	150-160	0.2872	840.1	100,100
170	0.6016	0.4750	0.4265	0.5402	1.141	1.184	1.026	0.9003	160-170	0.2186	840.3	100,100
180	0.7535	0.8205	0.8010	0.7923	0.7486	0.7784	0.8151	0.7779	170-180	0.0753	840.4	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 767.22 lm

%lum = 91.3%

%lamp = 91.3%

Conical surface Flux(120deg): 825.02 lm

%lum = 98.2%


%lamp = 98.2%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz Lamp Flux:840.376x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

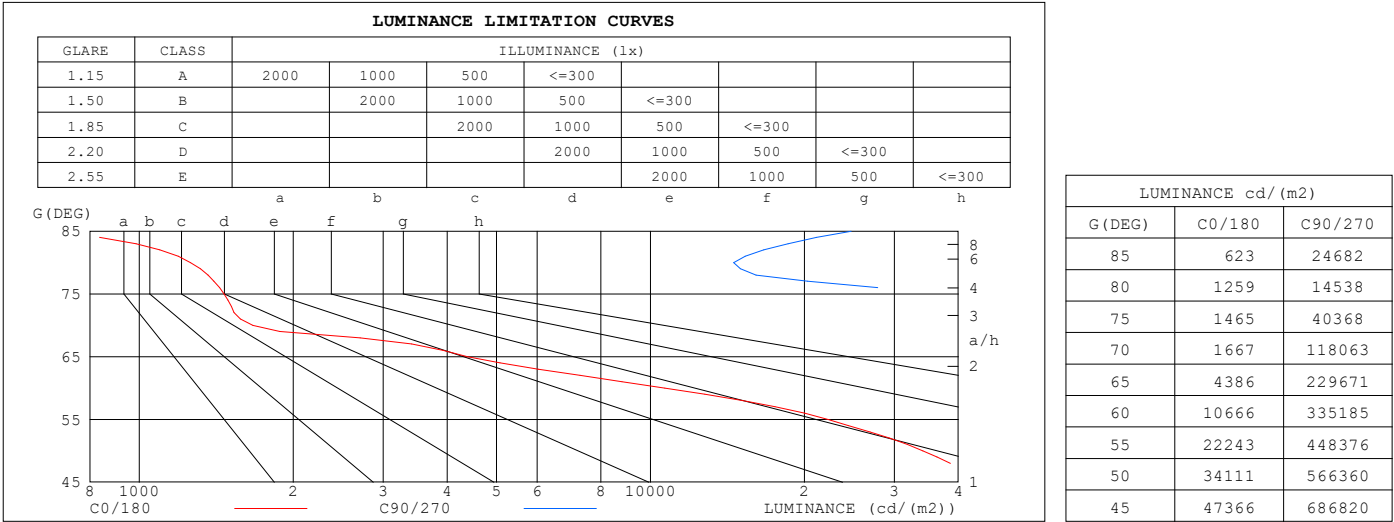


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz		
Lamp Flux:840.376x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

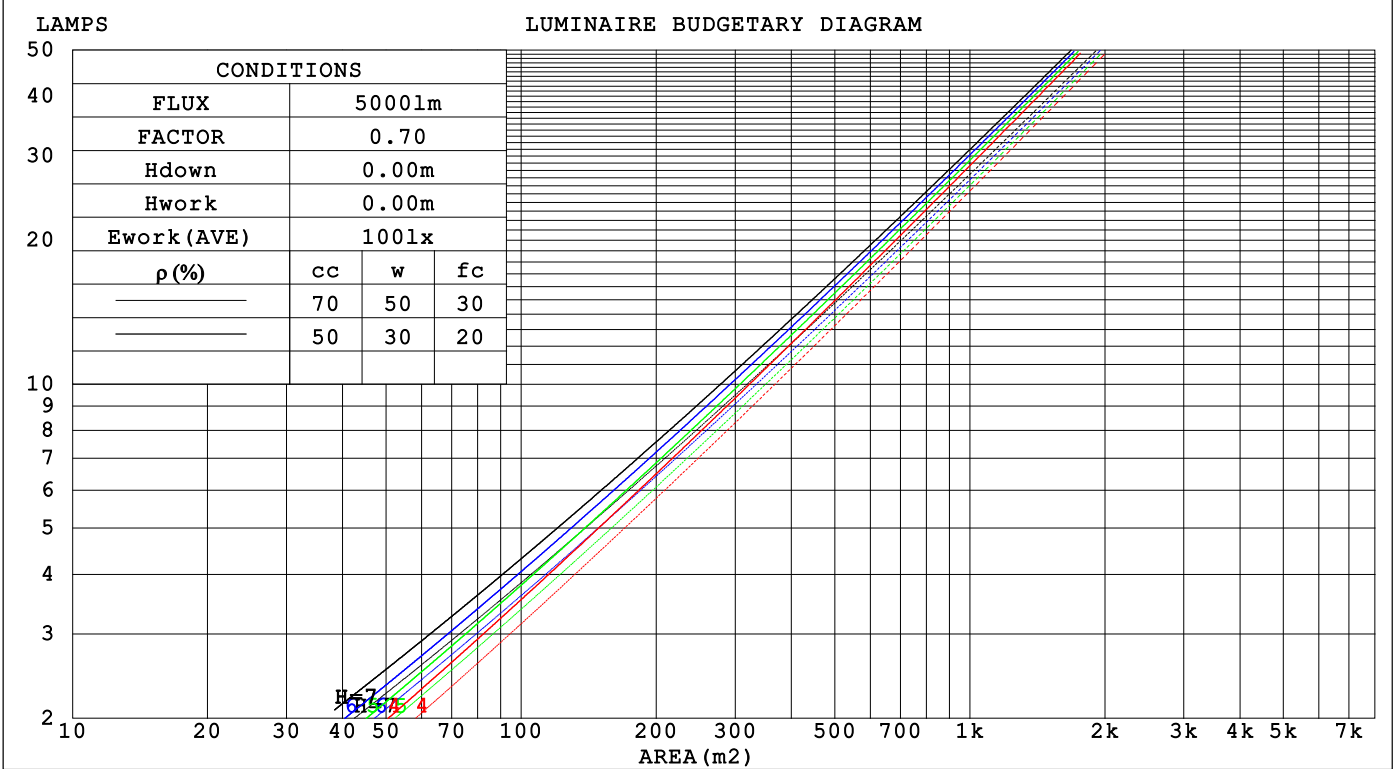

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-29

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz Lamp Flux:840.376x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.180	.102	.032	.173	.099	.031	.160	.092	.029	.149	.086	.028	.138	.080	.026															
2.0	.172	.094	.029	.167	.092	.028	.156	.087	.027	.146	.082	.026	.137	.078	.024															
3.0	.164	.087	.026	.159	.085	.026	.150	.081	.025	.141	.077	.024	.134	.074	.023															
4.0	.155	.081	.024	.151	.079	.023	.143	.076	.023	.136	.073	.022	.129	.070	.021															
5.0	.148	.075	.022	.144	.074	.022	.137	.071	.021	.131	.069	.021	.125	.067	.020															
6.0	.140	.070	.020	.137	.069	.020	.131	.067	.020	.125	.065	.019	.120	.063	.019															
7.0	.133	.066	.019	.131	.065	.019	.125	.063	.018	.120	.062	.018	.115	.060	.018															
8.0	.127	.062	.017	.125	.061	.017	.120	.060	.017	.115	.058	.017	.111	.057	.017															
9.0	.121	.059	.016	.119	.058	.016	.115	.057	.016	.111	.056	.016	.107	.054	.016															
10.0	.116	.056	.015	.114	.055	.015	.110	.054	.015	.107	.053	.015	.103	.052	.015															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.172	.158	.146	.147	.136	.125	.101	.093	.087	.058	.054	.050	.019	.017	.016	
2.0	.157	.134	.114	.135	.115	.098	.092	.080	.068	.053	.046	.040	.017	.015	.013	
3.0	.145	.115	.090	.124	.099	.078	.085	.069	.055	.049	.040	.032	.016	.013	.011	
4.0	.135	.100	.073	.116	.086	.064	.080	.060	.045	.046	.035	.027	.015	.011	.009	
5.0	.126	.088	.061	.108	.076	.053	.075	.053	.037	.043	.031	.022	.014	.010	.007	
6.0	.118	.079	.051	.102	.068	.044	.070	.048	.031	.041	.028	.019	.013	.009	.006	
7.0	.112	.071	.043	.096	.062	.038	.066	.043	.027	.039	.026	.016	.012	.008	.005	
8.0	.106	.065	.037	.091	.057	.032	.063	.040	.023	.037	.023	.014	.012	.008	.005	
9.0	.101	.060	.033	.087	.052	.028	.060	.037	.020	.035	.022	.012	.011	.007	.004	
10.0	.096	.056	.029	.083	.048	.025	.057	.034	.018	.033	.020	.011	.011	.007	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz Lamp Flux:840.376x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	20.3	21.3	20.6	21.4	21.6	32.7	33.7	32.9	33.8	34.0
3H	20.2	21.1	20.5	21.3	21.5	33.0	33.9	33.3	34.1	34.3
4H	20.1	21.0	20.4	21.2	21.4	33.0	33.8	33.2	34.0	34.2
6H	20.0	20.8	20.3	21.1	21.3	32.9	33.7	33.2	33.9	34.1
8H	20.0	20.7	20.3	21.0	21.3	32.8	33.6	33.1	33.8	34.1
12H	19.9	20.7	20.3	20.9	21.2	32.8	33.5	33.1	33.8	34.1
4H 2H	21.1	21.9	21.4	22.1	22.4	32.5	33.3	32.7	33.5	33.7
3H	21.0	21.7	21.3	22.0	22.3	32.8	33.5	33.1	33.8	34.0
4H	20.9	21.6	21.3	21.9	22.2	32.7	33.4	33.1	33.7	34.0
6H	20.8	21.4	21.2	21.7	22.1	32.6	33.2	33.0	33.5	33.9
8H	20.8	21.3	21.2	21.7	22.0	32.6	33.1	33.0	33.5	33.8
12H	20.7	21.2	21.2	21.6	22.0	32.6	33.0	33.0	33.4	33.8
8H 4H	20.9	21.5	21.3	21.8	22.2	32.6	33.1	33.0	33.5	33.8
6H	20.8	21.3	21.3	21.7	22.1	32.5	32.9	32.9	33.3	33.7
8H	20.8	21.2	21.3	21.6	22.0	32.4	32.8	32.9	33.2	33.7
12H	20.8	21.1	21.2	21.5	22.0	32.4	32.7	32.9	33.2	33.7
12H 4H	20.9	21.4	21.3	21.7	22.1	32.5	33.0	32.9	33.4	33.8
6H	20.8	21.2	21.3	21.6	22.1	32.4	32.8	32.9	33.2	33.7
8H	20.8	21.1	21.3	21.6	22.0	32.4	32.7	32.9	33.2	33.6
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.6 / - 2.9					+ 3.5 / - 3.2				
1.5H	+ 1.2 / - 2.2					+ 4.4 / - 7.3				
2.0H	+ 2.1 / - 5.1					+ 6.0 / - 9.5				

CIE Pub.117, 840.4 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.6)
Area: 0.001 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz Lamp Flux:840.376x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	83	76	72	82	76	72	82	75	71	67
0.80	91	84	80	90	84	80	89	83	80	76
1.00	96	90	86	95	90	86	94	90	85	81
1.25	101	95	91	100	95	91	98	93	90	85
1.50	104	99	95	103	98	94	100	96	93	89
2.00	107	103	99	106	102	98	103	100	97	91
2.50	109	105	102	107	104	101	104	101	99	93
3.00	111	107	104	109	106	103	106	103	101	94
4.00	113	110	108	111	108	106	107	105	103	96
5.00	114	112	110	112	110	108	108	106	105	97
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz Lamp Flux:840.376x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

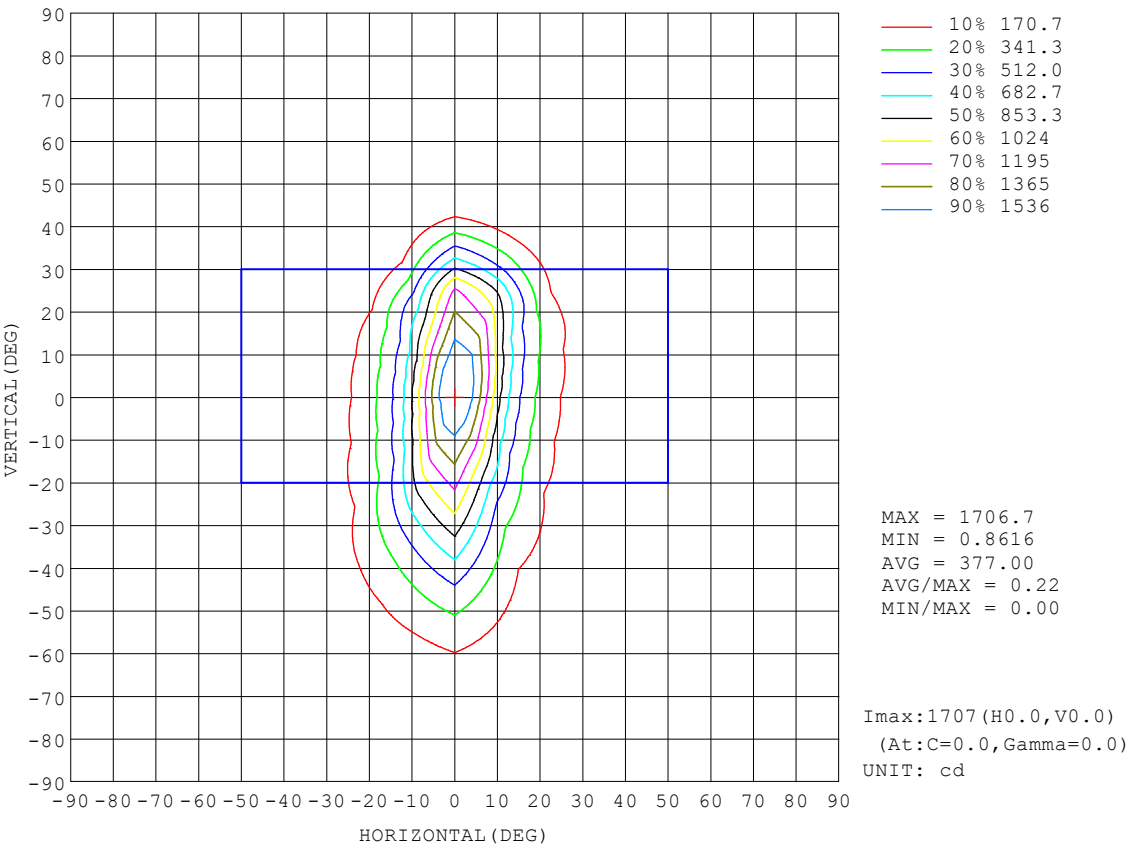

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-29	Remarks:

AAI Figure

Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz Lamp Flux:840.376x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

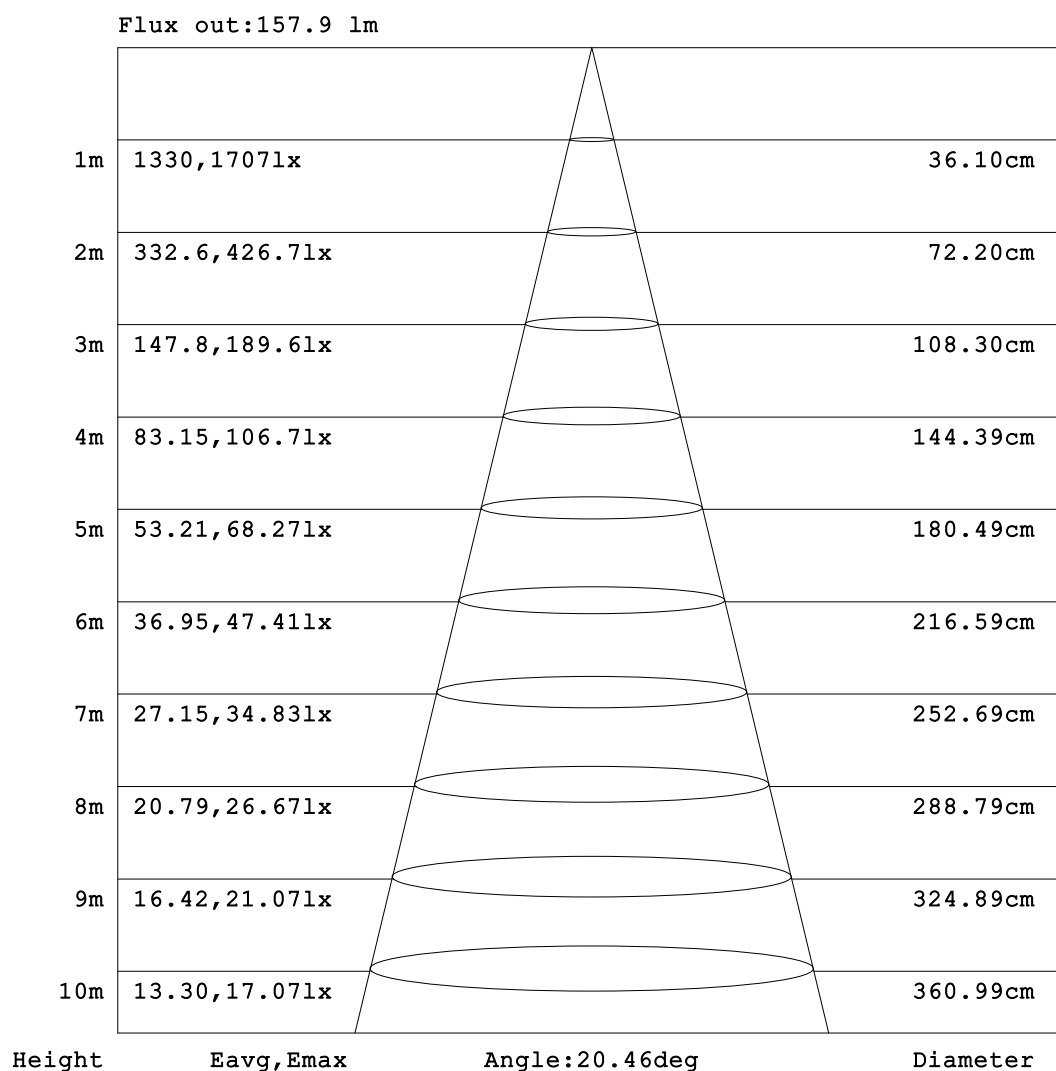


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Allen
Test Date: 2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:


ISOLUX DIAGRAM

Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz Lamp Flux:840.376x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

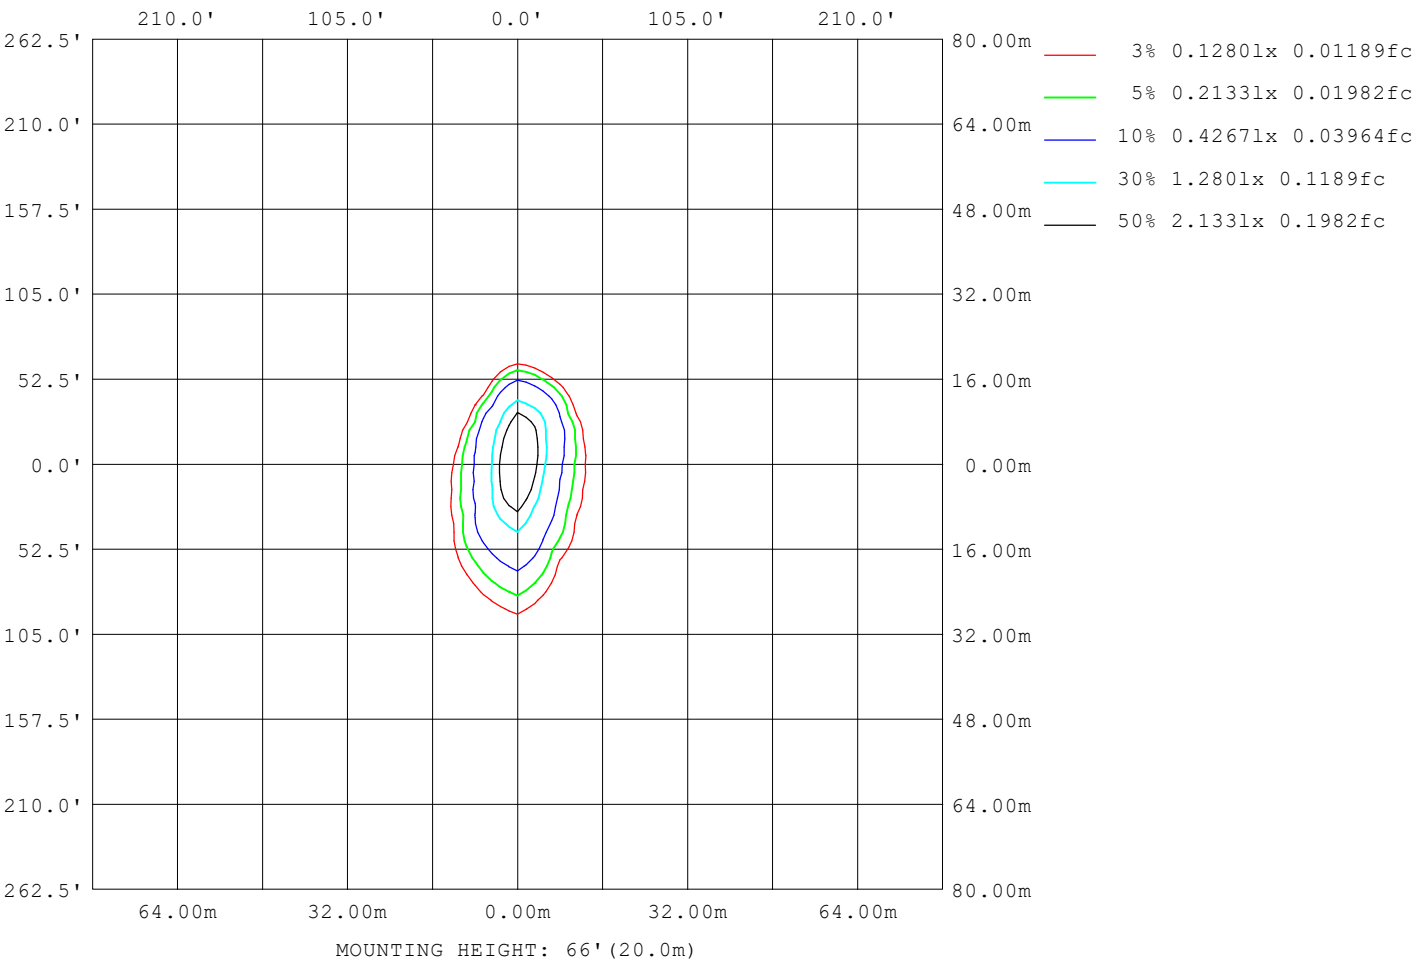

C Range: 0 - 360DEG C Interval: 22.5DEG Test Speed: HIGH Temperature:25.3℃ Operators:Allen Test Date:2026-01-29	γ Range: 0 - 180DEG γ Interval: 1.0DEG Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459 Humidity:45% Test Distance:2.900m [K=0.8783] Remarks:
--	---

Planar Illuminance Curve

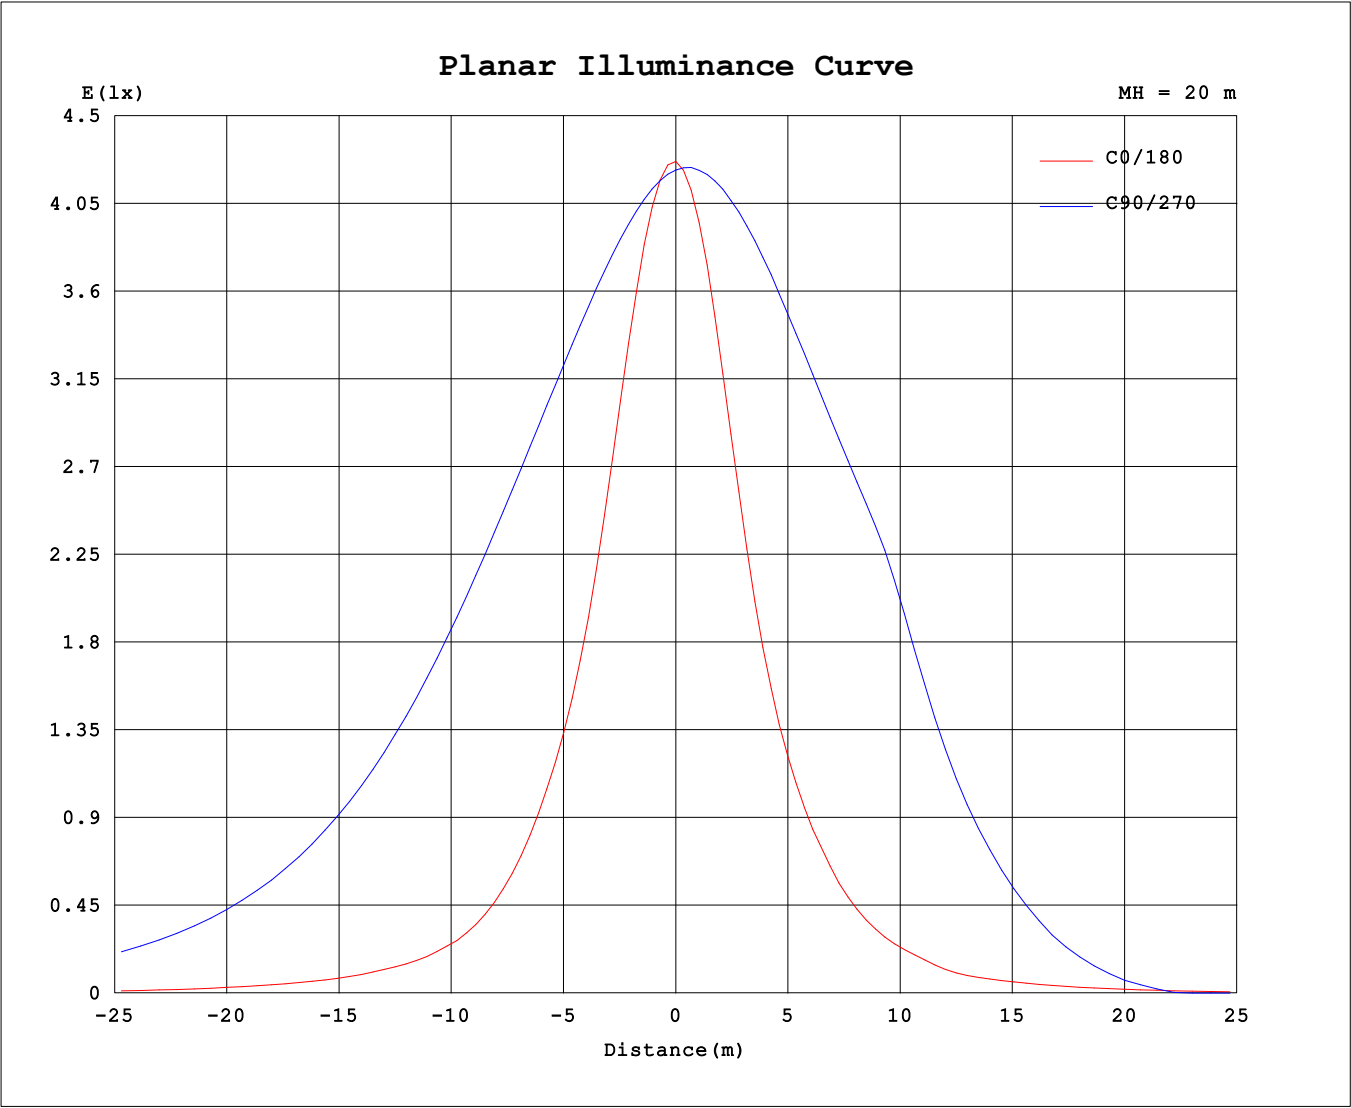

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-29	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:1.4308A P:14.200W PF:0.7910 Freq:60.01Hz Lamp Flux:840.376x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	
0	1707	1701	1696	1692	1689	1686	1684	1683	1707	1701	1696	1692	1689	1686	1684	1683	
5	1456	1451	1509	1585	1623	1592	1503	1410	1404	1432	1515	1619	1686	1676	1603	1512	
10	911	926	1089	1346	1514	1425	1143	908	841	885	1075	1388	1616	1563	1296	1040	
15	526	540	693	1056	1385	1220	780	540	480	512	678	1083	1502	1378	918	633	
20	296	312	442	782	1245	1006	520	325	272	302	434	801	1370	1161	623	386	
25	166	178	278	564	1094	801	351	195	155	172	268	570	1220	942	428	226	
30	103	111	174	404	934	618	236	123	89.2	79.8	116	313	870	621	259	133	
35	70.2	78.2	115	290	775	466	159	75.7	52.6	44.1	47.8	132	535	345	123	71.5	
40	49.1	58.7	80.1	204	623	344	108	49.2	35.4	26.4	21.5	40.5	264	146	50.9	42.3	
45	33.5	43.9	59.2	141	486	250	64.5	34.5	23.0	14.3	8.50	7.00	75.2	39.4	19.0	25.0	
50	21.9	30.8	43.6	96.7	364	176	39.4	22.8	13.1	5.34	1.55	0.50	0.95	1.68	5.84	13.6	
55	12.8	21.1	31.2	65.3	257	114	25.4	14.2	5.26	1.30	0.02	0.00	0.00	0.00	1.14	5.42	
60	5.33	12.9	20.4	41.2	168	58.6	15.5	7.11	1.68	0.22	0.00	0.00	0.00	0.00	0.13	1.58	
65	1.85	5.99	12.7	22.5	97.1	25.3	8.84	2.67	0.55	0.14	0.00	0.00	0.00	0.00	0.09	0.36	
70	0.57	2.26	6.55	11.1	40.4	9.51	3.96	1.22	0.37	0.01	0.00	0.00	0.00	0.00	0.00	0.27	
75	0.38	0.94	2.68	4.90	10.4	3.85	2.04	0.84	0.20	0.00	0.00	0.00	0.00	0.00	0.00	0.14	
80	0.22	0.62	1.51	2.33	2.52	2.29	1.54	0.55	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
85	0.05	0.38	1.12	1.91	2.15	1.92	1.09	0.27	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
90	0.00	0.17	0.74	1.48	1.76	1.42	0.67	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
95	0.00	0.01	0.41	0.99	1.22	0.92	0.32	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
100	0.00	0.00	0.16	0.56	0.73	0.49	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
105	0.00	0.00	0.00	0.24	0.35	0.19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
110	0.00	0.00	0.00	0.01	0.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.08	0.09	0.05	0.00	0.00	
135	0.00	0.00	0.00	0.00	0.00	0.04	0.04	0.00	0.00	0.00	0.07	0.23	0.23	0.18	0.10	0.00	
140	0.00	0.00	0.03	0.06	0.08	0.14	0.18	0.08	0.09	0.13	0.27	0.42	0.40	0.34	0.28	0.13	
145	0.14	0.11	0.13	0.13	0.14	0.21	0.29	0.24	0.34	0.38	0.51	0.62	0.57	0.52	0.49	0.38	
150	0.27	0.22	0.20	0.18	0.18	0.25	0.34	0.36	0.64	0.68	0.76	0.81	0.73	0.67	0.68	0.65	
155	0.42	0.36	0.30	0.27	0.27	0.33	0.43	0.47	0.94	0.97	1.00	1.00	0.89	0.81	0.84	0.90	
160	0.51	0.45	0.39	0.34	0.32	0.40	0.48	0.53	1.16	1.18	1.20	1.16	1.02	0.91	0.92	1.02	
165	0.55	0.51	0.43	0.37	0.34	0.42	0.51	0.55	1.20	1.22	1.24	1.19	1.04	0.92	0.91	0.99	
170	0.60	0.55	0.48	0.45	0.43	0.46	0.54	0.60	1.14	1.15	1.18	1.14	1.03	0.92	0.90	0.96	
175	0.65	0.63	0.63	0.64	0.62	0.61	0.63	0.66	0.98	0.98	1.01	1.02	0.96	0.89	0.88	0.91	
180	0.75	0.78	0.82	0.82	0.80	0.78	0.79	0.81	0.75	0.75	0.78	0.82	0.82	0.80	0.78	0.78	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: