


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz Lamp Flux:999.105x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 72.40 lm/W			
MODEL	SMART FIXTURE 3000K	Imax (cd)	5945	S/MH(C0/180)	0.33
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.32
RATED VOLTAGE(V)		TOTAL FLUX(lm)	999.11	η UP,DN(C0-180)	0.1,54.0
NOMINAL FLUX(lm)	999.105	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,45.9
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.00
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.30

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

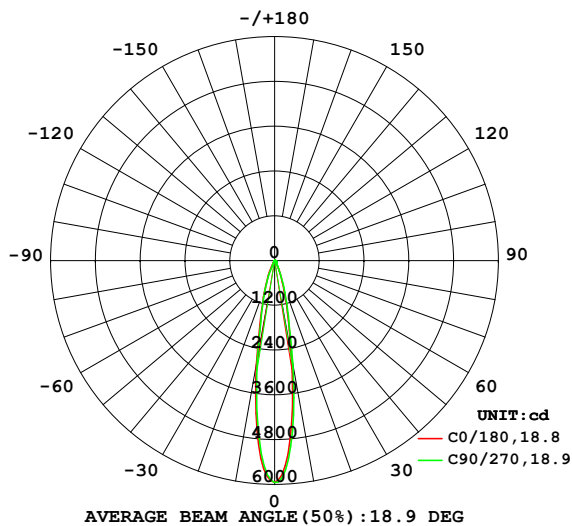

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

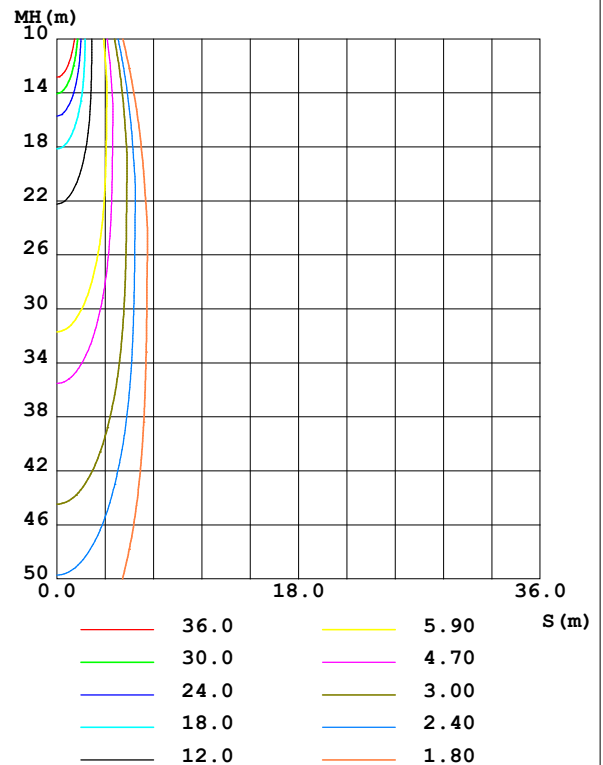

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	2593	2702	2814	2809	2834	2755	2670	2665	0- 10	393.8	393.8	39.4,39.4
20	624.3	652.4	677.1	674.1	684.7	665.5	651.3	644.8	10- 20	376.6	770.4	77.1,77.1
30	148.5	157.6	162.6	164.5	116.9	56.73	53.64	93.75	20- 30	143.2	913.6	91.4,91.4
40	56.49	66.18	67.10	63.74	29.50	13.06	11.41	23.18	30- 40	43.41	957.0	95.8,95.8
50	24.51	41.27	41.20	30.59	8.412	0	0	3.844	40- 50	21.85	978.9	98,98
60	8.638	23.68	24.63	12.71	0.2956	0	0	0.0852	50- 60	11.86	990.8	99.2,99.2
70	0.8077	8.915	10.26	1.458	0.0725	0	0	0	60- 70	5.356	996.1	99.7,99.7
80	0.2889	0.9493	0.9676	0.3601	0	0	0	0	70- 80	1.173	997.3	99.8,99.8
90	0.0094	0.5319	0.4591	0.1019	0	0	0	0	80- 90	0.2247	997.5	99.8,99.8
100	0	0.2071	0.1703	0	0	0	0	0	90-100	0.0983	997.6	99.9,99.9
110	0	0	0	0	0	0	0	0	100-110	0.0159	997.6	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0	997.6	99.9,99.9
130	0	0	0	0	0	0	0	0	120-130	0	997.6	99.9,99.9
140	0.1531	0.1516	0.1423	0.1434	0.3008	0.3202	0.3305	0.3288	130-140	0.0386	997.7	99.9,99.9
150	0.5494	0.5876	0.5856	0.5772	1.293	1.354	1.366	1.371	140-150	0.3736	998.0	99.9,99.9
160	0.6394	0.6740	0.6819	0.6682	2.118	2.167	2.171	2.171	150-160	0.5732	998.6	100,100
170	0.6007	0.6034	0.6058	0.6048	1.858	1.847	1.846	1.832	160-170	0.3835	999.0	100,100
180	0.9183	0.8860	0.8808	0.8548	0.9222	0.9115	0.8845	0.8780	170-180	0.1043	999.1	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 969.63 lm

%lum = 97.0%

%lamp = 97.0%

Conical surface Flux(120deg): 990.76 lm

%lum = 99.2%


%lamp = 99.2%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz Lamp Flux:999.105x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

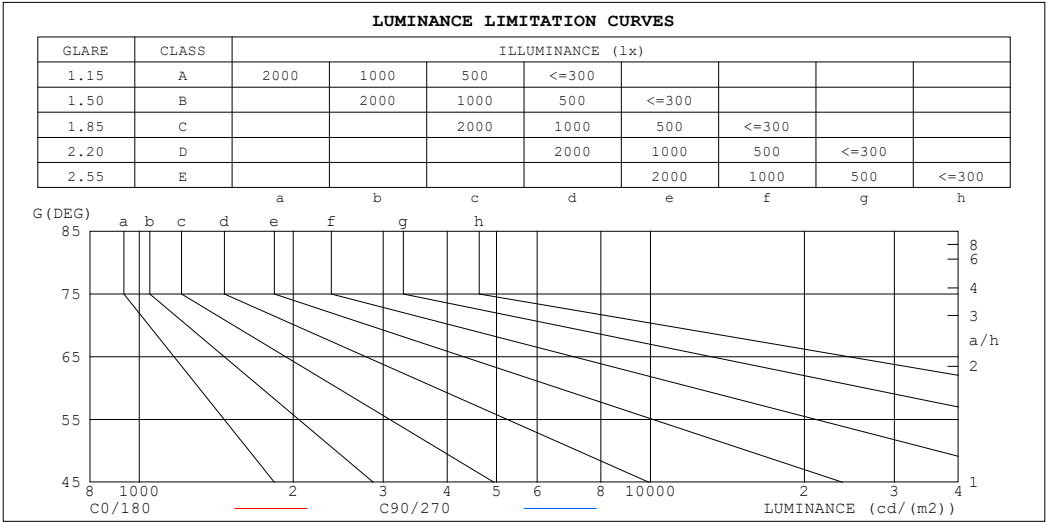

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	172215	661304
80	166351	557230
75	156593	1327364
70	236152	2999149
65	542071	4178498
60	1727657	4925688
55	2863086	5645801
50	3813494	6410320
45	5375286	7285739


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz		
Lamp Flux:999.105x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.13	1.11	1.09	1.11	1.09	1.07	1.07	1.05	1.04	1.03	1.02	1.01	.99	.99	.98	.96
2.0	1.07	1.04	1.02	1.06	1.03	1.00	1.02	1.00	.98	.00	.98	.96	.97	.95	.94	.93
3.0	1.03	.99	.96	1.01	.98	.95	.99	.96	.94	.96	.94	.92	.94	.92	.91	.89
4.0	.98	.94	.91	.97	.94	.91	.95	.92	.90	.93	.91	.89	.92	.90	.88	.86
5.0	.95	.91	.87	.94	.90	.87	.92	.89	.86	.91	.88	.86	.89	.87	.85	.84
6.0	.91	.87	.84	.91	.87	.84	.89	.86	.83	.88	.85	.83	.87	.84	.82	.81
7.0	.89	.84	.81	.88	.84	.81	.87	.83	.81	.86	.83	.80	.85	.82	.80	.79
8.0	.86	.82	.79	.85	.81	.79	.84	.81	.78	.84	.80	.78	.83	.80	.78	.77
9.0	.83	.79	.77	.83	.79	.76	.82	.79	.76	.81	.78	.76	.81	.78	.76	.75
10.0	.81	.77	.74	.81	.77	.74	.80	.77	.74	.79	.76	.74	.79	.76	.74	.73

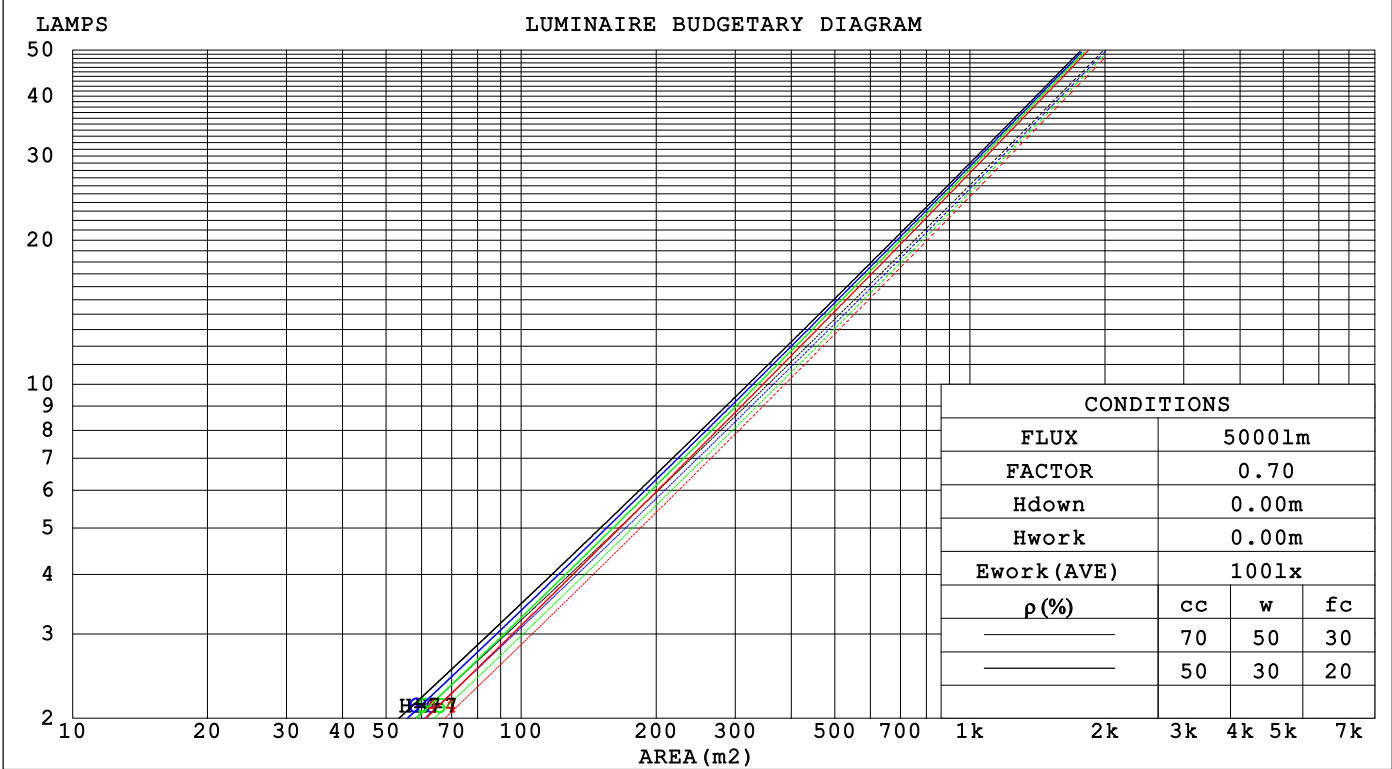

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-27

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz Lamp Flux:999.105x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.140	.080	.025	.133	.076	.024	.121	.069	.022	.109	.063	.020	.099	.057	.018	
2.0	.130	.071	.022	.125	.069	.021	.114	.064	.020	.105	.059	.018	.096	.054	.017	
3.0	.121	.065	.019	.117	.063	.019	.108	.059	.018	.100	.055	.017	.093	.051	.016	
4.0	.114	.059	.017	.110	.057	.017	.102	.054	.016	.096	.051	.015	.089	.049	.015	
5.0	.107	.054	.016	.103	.053	.015	.097	.051	.015	.091	.048	.014	.086	.046	.014	
6.0	.101	.051	.014	.098	.049	.014	.093	.047	.014	.088	.046	.013	.083	.044	.013	
7.0	.095	.047	.013	.093	.046	.013	.088	.045	.013	.084	.043	.013	.080	.041	.012	
8.0	.091	.044	.012	.089	.044	.012	.085	.042	.012	.081	.041	.012	.077	.040	.012	
9.0	.086	.042	.012	.085	.041	.012	.081	.040	.011	.078	.039	.011	.074	.038	.011	
10.0	.083	.040	.011	.081	.039	.011	.078	.038	.011	.075	.037	.011	.072	.036	.010	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.170	.159	.149	.145	.136	.128	.099	.094	.089	.057	.054	.052	.018	.017	.017	
2.0	.152	.134	.119	.130	.115	.103	.089	.080	.072	.051	.046	.042	.016	.015	.014	
3.0	.137	.115	.097	.118	.099	.084	.081	.069	.059	.047	.040	.035	.015	.013	.011	
4.0	.125	.099	.080	.107	.086	.069	.074	.060	.049	.043	.035	.029	.014	.011	.009	
5.0	.114	.087	.067	.098	.075	.058	.068	.053	.041	.039	.031	.024	.013	.010	.008	
6.0	.105	.077	.057	.090	.067	.049	.062	.047	.035	.036	.027	.021	.012	.009	.007	
7.0	.098	.069	.049	.084	.060	.042	.058	.042	.030	.034	.025	.018	.011	.008	.006	
8.0	.091	.062	.042	.078	.054	.037	.054	.038	.026	.032	.022	.016	.010	.007	.005	
9.0	.085	.056	.037	.074	.049	.032	.051	.034	.023	.030	.020	.014	.010	.007	.005	
10.0	.080	.052	.032	.069	.045	.028	.048	.032	.020	.028	.019	.012	.009	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz Lamp Flux:999.105x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	35.9	36.6	36.1	36.8	36.9	37.6	38.3	37.8	38.4	38.6
3H	35.9	36.5	36.2	36.7	36.9	38.3	38.9	38.6	39.1	39.3
4H	35.8	36.4	36.1	36.6	36.9	38.4	39.0	38.6	39.2	39.4
6H	35.8	36.3	36.0	36.5	36.8	38.3	38.9	38.6	39.1	39.3
8H	35.7	36.3	36.0	36.5	36.8	38.3	38.8	38.6	39.1	39.3
12H	35.7	36.2	36.0	36.5	36.7	38.2	38.8	38.5	39.0	39.3
4H 2H	36.5	37.1	36.7	37.3	37.5	37.9	38.5	38.1	38.7	38.9
3H	36.5	37.0	36.8	37.3	37.5	38.7	39.2	39.0	39.5	39.7
4H	36.4	36.9	36.7	37.2	37.5	38.8	39.2	39.1	39.5	39.8
6H	36.3	36.7	36.7	37.1	37.4	38.7	39.1	39.1	39.4	39.8
8H	36.3	36.7	36.6	37.0	37.4	38.6	39.0	39.0	39.4	39.8
12H	36.2	36.6	36.6	36.9	37.3	38.6	39.0	39.0	39.3	39.7
8H 4H	36.4	36.8	36.8	37.1	37.5	38.6	39.0	39.0	39.4	39.8
6H	36.3	36.6	36.7	37.0	37.4	38.6	38.9	39.0	39.3	39.7
8H	36.2	36.5	36.7	36.9	37.4	38.5	38.8	39.0	39.2	39.7
12H	36.2	36.4	36.6	36.9	37.3	38.5	38.7	38.9	39.2	39.6
12H 4H	36.3	36.7	36.7	37.1	37.5	38.6	39.0	39.0	39.3	39.7
6H	36.2	36.5	36.7	36.9	37.4	38.5	38.8	39.0	39.2	39.7
8H	36.2	36.4	36.6	36.9	37.3	38.5	38.7	38.9	39.2	39.6
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.1 / - 1.9					+ 0.6 / - 0.8				
1.5H	+ 0.7 / - 1.9					+ 0.4 / - 0.5				
2.0H	+ 1.6 / - 4.1					+ 0.8 / - 0.8				

CIE Pub.117, 999.1 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.0)
Area: 1e-005 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz Lamp Flux:999.105x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	89	83	79	88	83	79	88	82	79	76
0.80	96	91	87	95	90	87	94	90	86	83
1.00	100	95	91	99	94	91	98	94	91	87
1.25	104	99	96	103	99	95	101	97	95	91
1.50	107	102	99	105	101	98	103	100	97	93
2.00	109	105	102	108	104	101	105	102	100	95
2.50	111	107	104	109	106	103	106	103	101	95
3.00	112	109	106	110	107	105	107	105	103	97
4.00	114	111	109	112	110	108	108	107	105	98
5.00	115	113	111	113	111	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz Lamp Flux:999.105x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

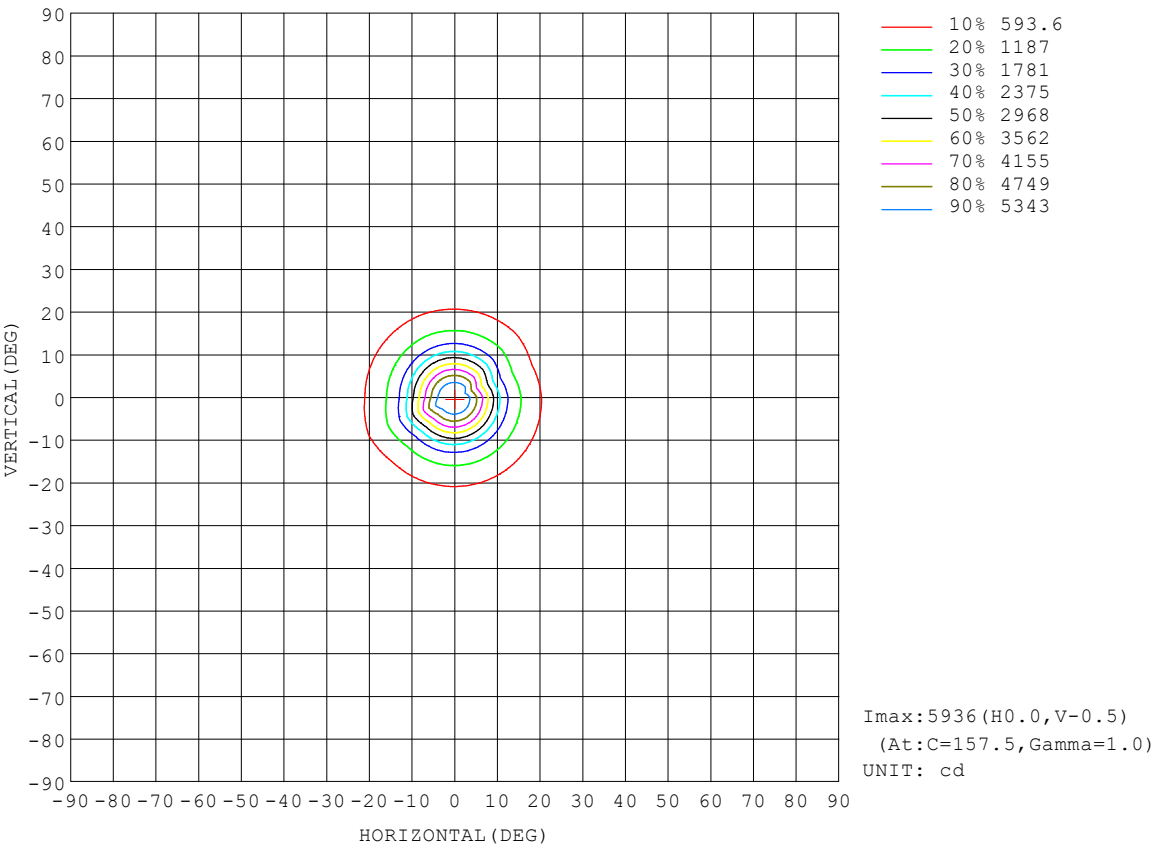

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-27	Remarks:

AAI Figure

Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz Lamp Flux:999.105x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

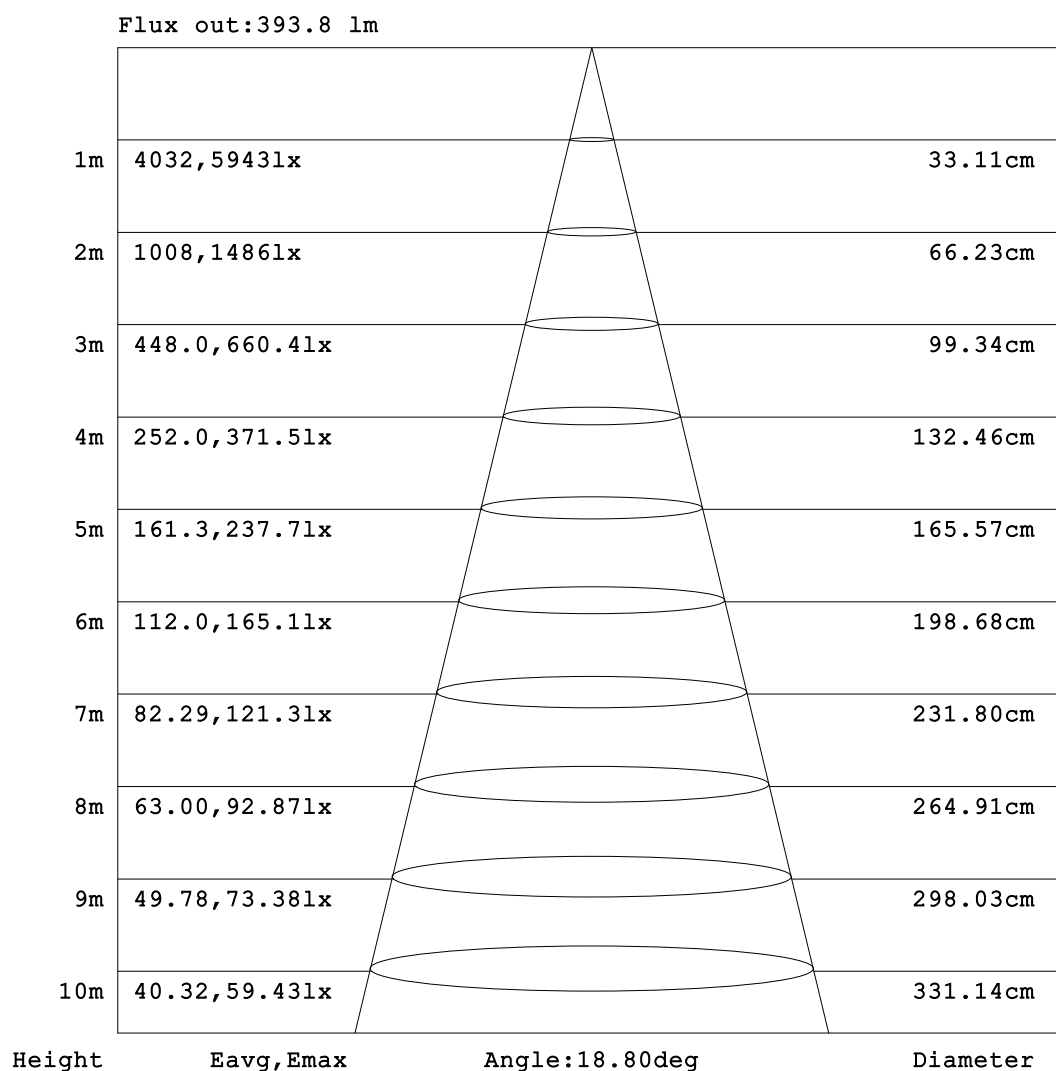


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ISOLUX DIAGRAM


Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz Lamp Flux:999.105x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

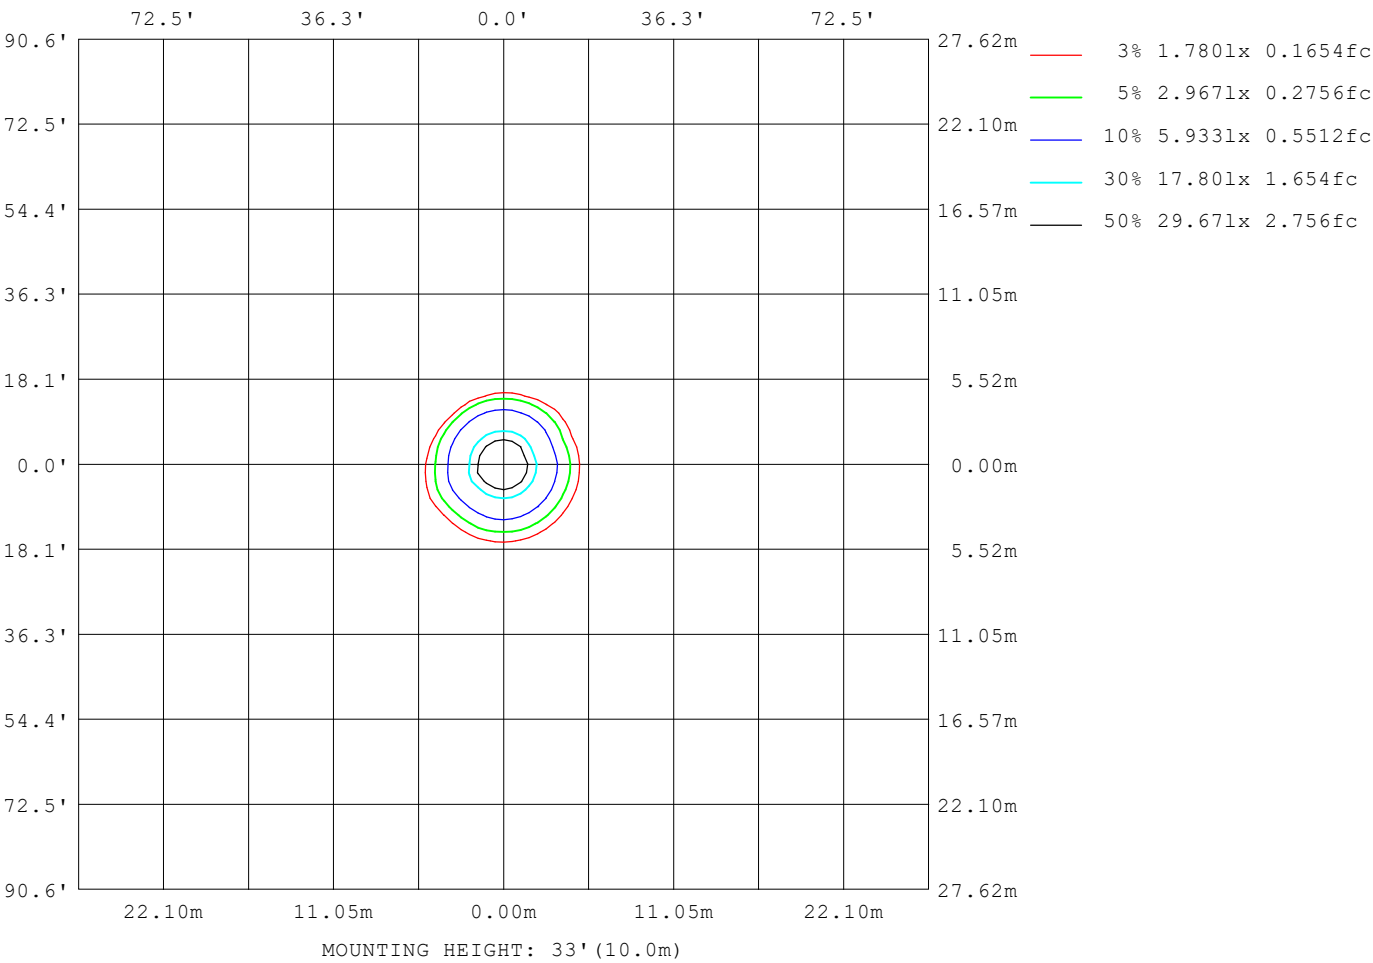

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

Planar Illuminance Curve

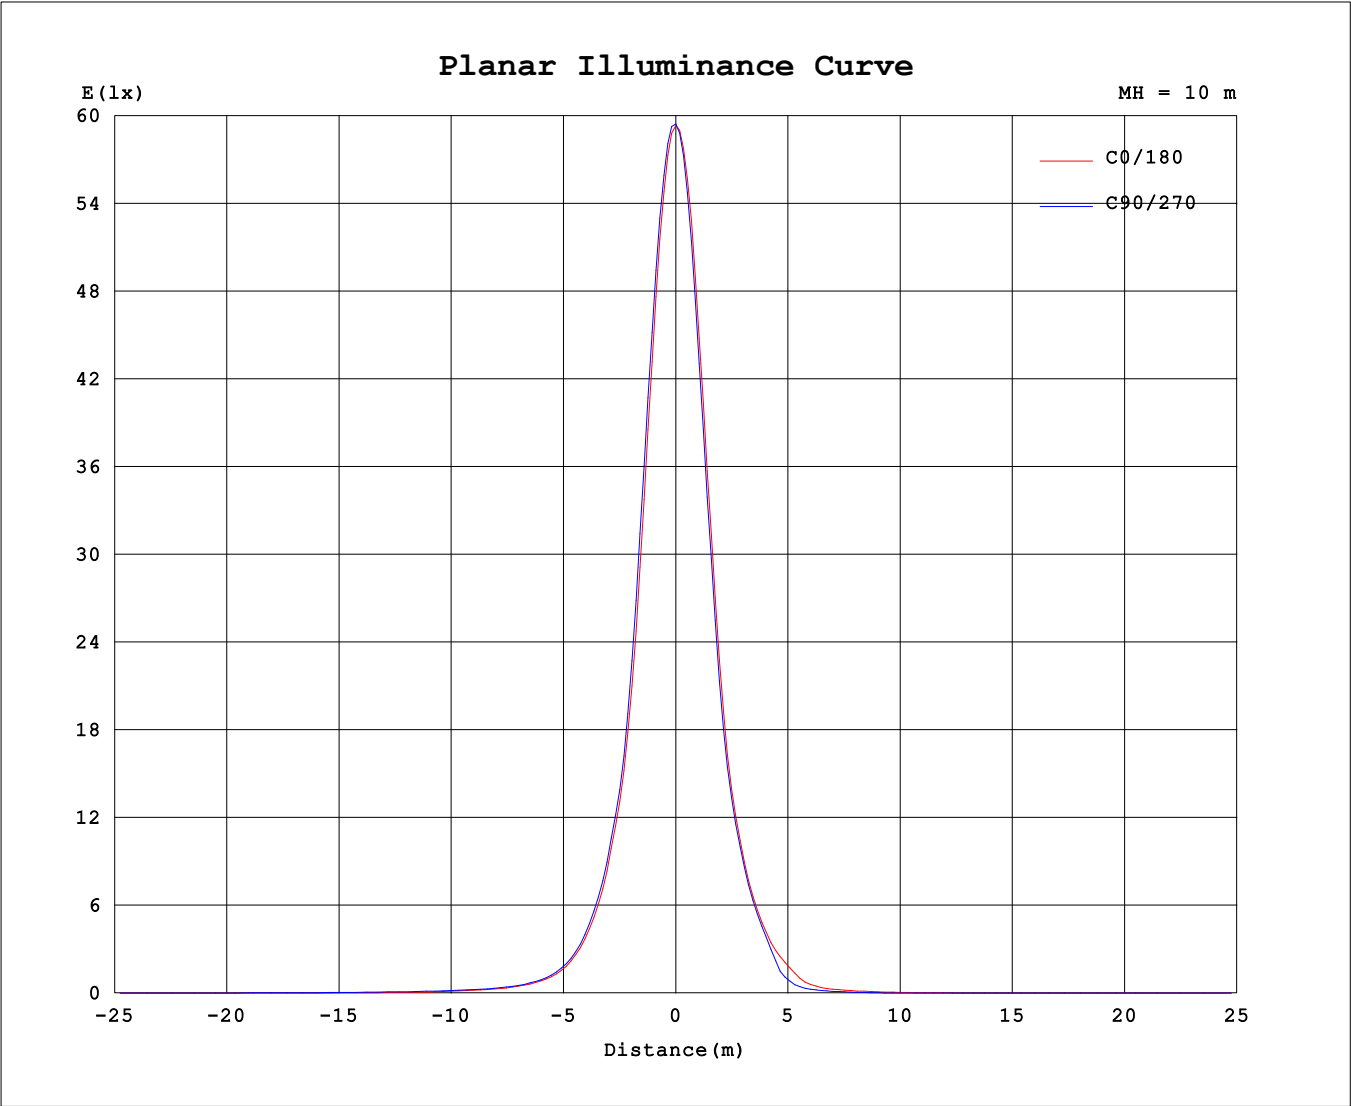

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:1.4194A P:13.800W PF:0.7507 Freq:60.00Hz Lamp Flux:999.105x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																			
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5				
0	5933	5936	5939	5938	5943	5942	5941	5897	5933	5936	5939	5938	5943	5942	5941	5897				
5	4819	4867	4905	4953	4999	4997	4994	5313	4949	4912	4876	4836	4790	4793	4797	4388				
10	2593	2635	2702	2751	2814	2820	2809	3215	2834	2785	2755	2715	2670	2656	2665	2250				
15	1275	1293	1314	1335	1355	1342	1345	1510	1344	1329	1320	1301	1284	1281	1287	1126				
20	624	641	652	664	677	677	674	774	685	680	665	660	651	643	645	552				
25	297	303	312	318	322	325	326	380	336	286	212	200	201	232	303	259				
30	149	154	158	161	163	164	165	187	117	75.6	56.7	53.0	53.6	64.0	93.7	118				
35	88.9	92.9	95.3	97.5	97.7	97.8	97.2	90.6	51.1	34.8	26.5	23.5	23.6	29.6	43.4	58.0				
40	56.5	65.3	66.2	67.2	67.1	66.4	63.7	50.9	29.5	19.2	13.1	11.2	11.4	15.5	23.2	34.6				
45	38.0	50.4	51.4	51.8	51.5	51.1	44.7	31.8	17.4	8.78	2.05	1.42	1.47	4.82	13.1	21.5				
50	24.5	37.9	41.3	41.4	41.2	40.5	30.6	20.6	8.41	1.08	0.00	0.00	0.00	0.39	3.84	13.0				
55	16.4	25.6	32.5	32.8	32.4	30.0	20.7	12.3	1.63	0.03	0.00	0.00	0.00	0.00	0.61	4.48				
60	8.64	17.5	23.7	25.2	24.6	20.5	12.7	4.59	0.30	0.00	0.00	0.00	0.00	0.00	0.09	0.98				
65	2.29	10.2	16.2	18.8	17.7	12.8	5.45	1.13	0.17	0.00	0.00	0.00	0.00	0.00	0.03	0.29				
70	0.81	3.43	8.91	11.9	10.3	5.63	1.46	0.39	0.07	0.00	0.00	0.00	0.00	0.00	0.00	0.20				
75	0.41	1.11	2.72	4.30	3.44	1.52	0.51	0.27	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.08				
80	0.29	0.58	0.95	1.15	0.97	0.57	0.36	0.14	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
85	0.15	0.46	0.66	0.68	0.58	0.43	0.23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
90	0.01	0.31	0.53	0.57	0.46	0.30	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
95	0.00	0.16	0.37	0.41	0.31	0.17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
100	0.00	0.01	0.21	0.25	0.17	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
105	0.00	0.00	0.05	0.10	0.04	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
110	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.02	0.03	0.03	0.03	0.03	0.03	0.07				
140	0.15	0.15	0.15	0.15	0.14	0.14	0.14	0.09	0.30	0.31	0.32	0.32	0.33	0.33	0.33	0.41				
145	0.41	0.43	0.43	0.43	0.42	0.42	0.42	0.36	0.76	0.79	0.81	0.81	0.82	0.82	0.82	0.92				
150	0.55	0.58	0.59	0.59	0.59	0.58	0.58	0.53	1.29	1.33	1.35	1.36	1.37	1.37	1.37	1.47				
155	0.66	0.69	0.70	0.71	0.71	0.70	0.70	0.66	1.82	1.84	1.88	1.89	1.89	1.89	1.89	1.96				
160	0.64	0.66	0.67	0.68	0.68	0.68	0.67	0.67	2.12	2.12	2.17	2.17	2.17	2.17	2.17	2.16				
165	0.60	0.61	0.62	0.62	0.62	0.62	0.61	0.61	2.09	2.09	2.11	2.12	2.11	2.10	2.10	2.05				
170	0.60	0.60	0.60	0.61	0.61	0.61	0.60	0.61	1.86	1.86	1.85	1.85	1.85	1.84	1.83	1.75				
175	0.66	0.65	0.65	0.65	0.65	0.65	0.65	0.64	1.45	1.45	1.43	1.42	1.40	1.39	1.39	1.26				
180	0.92	0.90	0.89	0.87	0.88	0.87	0.85	0.81	0.92	0.93	0.91	0.89	0.88	0.89	0.88	0.82				

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: