


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz Lamp Flux:1973.37x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 73.09 lm/W
MODEL	SMART FIXTURE 3000K	Imax (cd)	6581	S/MH(C0/180)	0.45	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.43	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	1973.4	η UP,DN(C0-180)	0.1,55.2	
NOMINAL FLUX(lm)	1973.37	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,44.6	
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.50	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

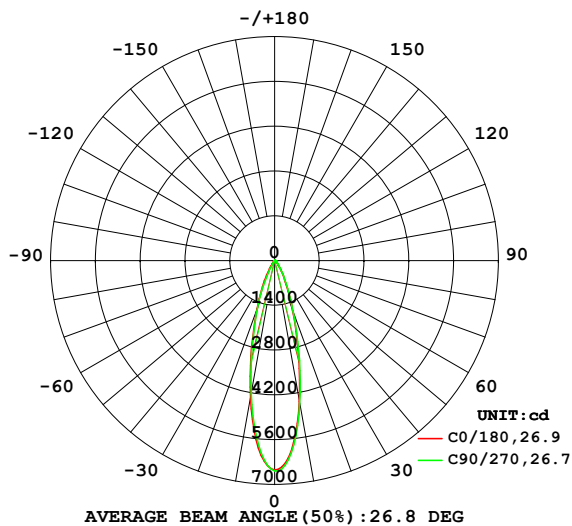

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

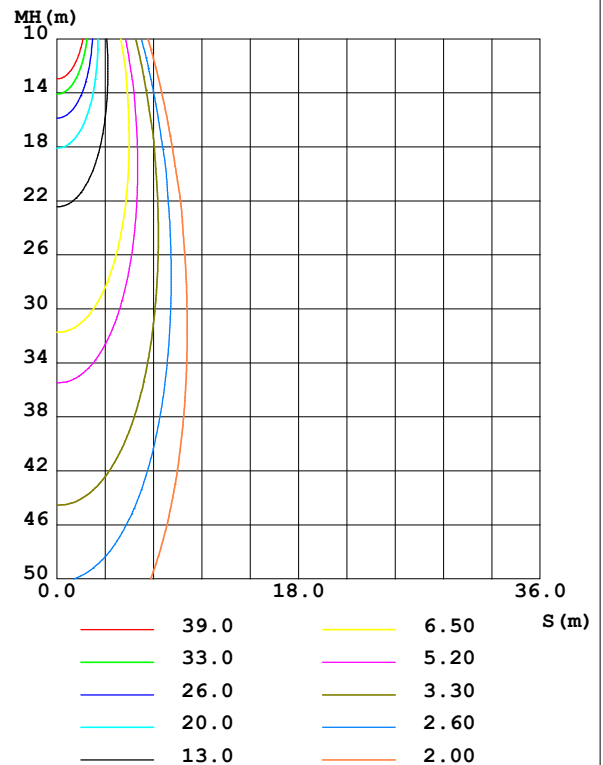

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	4475	4523	4540	4502	4367	4229	4228	4386	0- 10	515.7	515.7	26.1,26.1
20	1661	1727	1714	1700	1612	1598	1570	1644	10- 20	777.5	1293	65.5,65.5
30	540.4	574.4	562.1	564.4	430.2	241.0	218.7	386.3	20- 30	421.5	1715	86.9,86.9
40	186.4	222.3	218.8	213.9	73.90	28.73	25.22	59.43	30- 40	151.4	1866	94.6,94.6
50	60.79	106.7	105.5	74.81	16.10	0.0751	0	8.527	40- 50	60.74	1927	97.6,97.6
60	17.21	54.29	55.58	24.66	0.9990	0	0	0.5268	50- 60	27.60	1955	99,99
70	2.517	18.33	20.42	3.871	0.4809	0	0	0.1208	60- 70	11.45	1966	99.6,99.6
80	1.134	3.008	2.931	1.272	0	0	0	0	70- 80	2.951	1969	99.8,99.8
90	0.4067	1.850	1.622	0.6376	0	0	0	0	80- 90	0.7985	1970	99.8,99.8
100	0	0.9867	0.8764	0.0499	0	0	0	0	90-100	0.4328	1970	99.8,99.8
110	0	0.1704	0.2147	0	0	0	0	0	100-110	0.1435	1970	99.8,99.8
120	0	0	0	0	0	0	0	0	110-120	0.0093	1970	99.8,99.8
130	0	0	0	0	0.0825	0.1069	0.0975	0.0785	120-130	0.0043	1970	99.8,99.8
140	0.5244	0.4910	0.4938	0.5254	0.9552	1.000	0.9923	0.9596	130-140	0.2410	1971	99.9,99.9
150	1.095	1.103	1.096	1.107	2.479	2.561	2.557	2.515	140-150	0.7966	1971	99.9,99.9
160	1.526	1.534	1.530	1.518	3.751	3.772	3.774	3.769	150-160	1.053	1972	100,100
170	1.598	1.554	1.535	1.543	3.496	3.453	3.429	3.439	160-170	0.7430	1973	100,100
180	2.351	2.244	2.246	2.240	2.338	2.295	2.214	2.224	170-180	0.2294	1973	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1902.8 lm

%lum = 96.4%

%lamp = 96.4%

Conical surface Flux(120deg): 1954.5 lm

%lum = 99.0%


%lamp = 99.0%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz Lamp Flux:1973.37x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

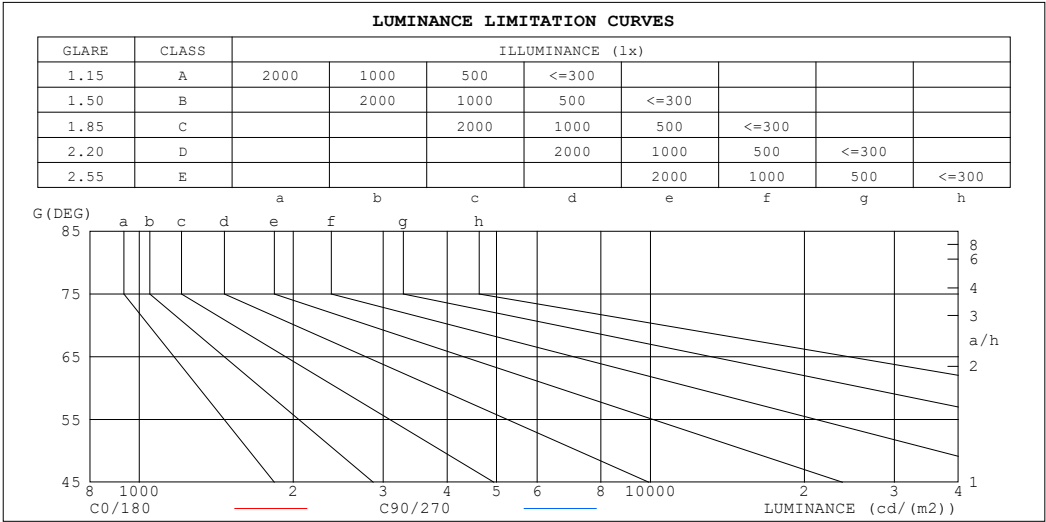

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	900007	2190009
80	652780	1688131
75	552471	3389072
70	735875	5971815
65	1513448	8729202
60	3441019	11116460
55	6026015	13379149
50	9456830	16417231
45	14919914	21071047


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz		
Lamp Flux:1973.37x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	Coefficients of Utilization(CU)															
	RCR:Room Cavity Ratio															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.10	1.08	1.10	1.08	1.06	1.06	1.04	1.03	1.02	1.01	.00	.99	.98	.97	.95
2.0	1.06	1.02	.99	1.04	1.01	.98	1.01	.98	.96	.98	.96	.94	.95	.94	.92	.91
3.0	1.00	.96	.93	.99	.95	.92	.96	.93	.91	.94	.91	.89	.92	.90	.88	.86
4.0	.95	.91	.87	.94	.90	.87	.92	.89	.86	.90	.87	.85	.88	.86	.84	.82
5.0	.91	.86	.83	.90	.86	.82	.88	.85	.82	.87	.83	.81	.85	.82	.80	.79
6.0	.87	.82	.79	.86	.82	.78	.85	.81	.78	.84	.80	.77	.82	.79	.77	.76
7.0	.83	.79	.75	.83	.78	.75	.82	.78	.75	.81	.77	.74	.79	.76	.74	.73
8.0	.80	.75	.72	.80	.75	.72	.79	.75	.72	.78	.74	.71	.77	.74	.71	.70
9.0	.77	.72	.69	.77	.72	.69	.76	.72	.69	.75	.71	.69	.74	.71	.68	.67
10.0	.74	.70	.67	.74	.70	.67	.73	.69	.66	.73	.69	.66	.72	.69	.66	.65

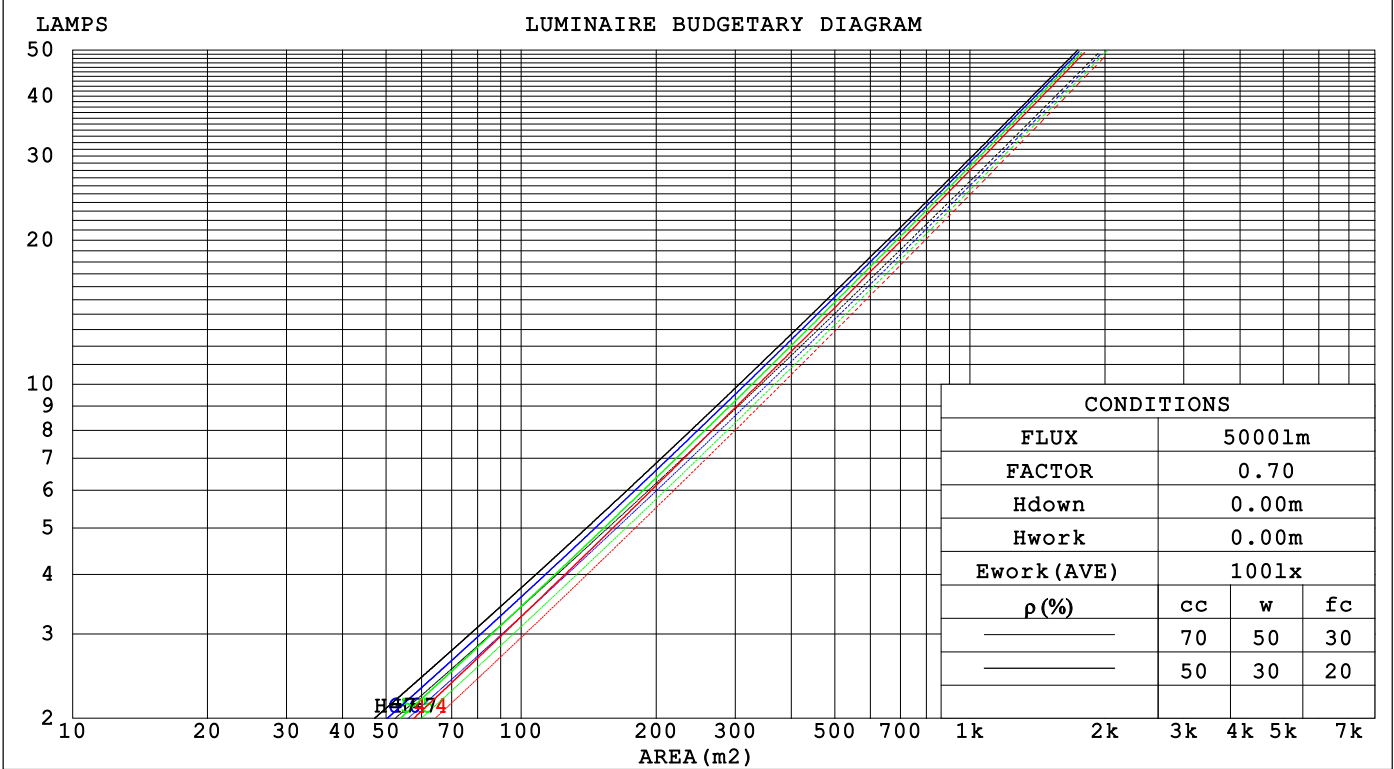

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-27

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz Lamp Flux:1973.37x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.154	.088	.028	.147	.084	.027	.135	.077	.025	.123	.071	.023	.112	.065	.021															
2.0	.145	.079	.024	.139	.077	.024	.129	.072	.022	.119	.067	.021	.110	.062	.020															
3.0	.136	.072	.022	.131	.070	.021	.123	.066	.020	.114	.063	.019	.107	.059	.018															
4.0	.128	.067	.020	.124	.065	.019	.117	.062	.019	.110	.059	.018	.103	.056	.017															
5.0	.121	.062	.018	.118	.061	.018	.112	.058	.017	.105	.056	.017	.100	.053	.016															
6.0	.115	.058	.017	.112	.057	.016	.107	.055	.016	.101	.053	.015	.096	.051	.015															
7.0	.110	.054	.015	.107	.053	.015	.102	.052	.015	.097	.050	.015	.093	.048	.014															
8.0	.105	.051	.014	.102	.050	.014	.098	.049	.014	.094	.048	.014	.090	.046	.013															
9.0	.100	.048	.013	.098	.048	.013	.094	.046	.013	.090	.045	.013	.087	.044	.013															
10.0	.096	.046	.013	.094	.045	.013	.090	.044	.012	.087	.043	.012	.084	.042	.012															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.171	.159	.148	.146	.136	.127	.100	.094	.088	.058	.054	.051	.018	.017	.017	
2.0	.154	.134	.117	.132	.115	.101	.090	.080	.071	.052	.046	.041	.017	.015	.014	
3.0	.140	.115	.095	.120	.099	.082	.082	.069	.058	.048	.040	.034	.015	.013	.011	
4.0	.129	.100	.078	.110	.086	.068	.076	.060	.048	.044	.035	.028	.014	.011	.009	
5.0	.119	.088	.065	.102	.076	.056	.070	.053	.040	.041	.031	.024	.013	.010	.008	
6.0	.110	.078	.055	.095	.068	.048	.065	.047	.034	.038	.028	.020	.012	.009	.007	
7.0	.103	.070	.047	.089	.061	.041	.061	.043	.029	.036	.025	.017	.012	.008	.006	
8.0	.097	.063	.041	.083	.055	.035	.058	.039	.025	.034	.023	.015	.011	.007	.005	
9.0	.091	.058	.035	.079	.050	.031	.055	.035	.022	.032	.021	.013	.010	.007	.004	
10.0	.087	.053	.031	.075	.046	.027	.052	.033	.019	.030	.019	.012	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz Lamp Flux:1973.37x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	38.2	39.0	38.5	39.2	39.3	40.0	40.7	40.2	40.9	41.1
3H	38.2	38.9	38.4	39.1	39.3	40.3	41.0	40.6	41.2	41.4
4H	38.1	38.8	38.4	39.0	39.2	40.3	41.0	40.6	41.2	41.5
6H	38.0	38.6	38.3	38.9	39.1	40.3	40.9	40.6	41.2	41.4
8H	38.0	38.6	38.3	38.8	39.1	40.2	40.9	40.6	41.1	41.4
12H	37.9	38.5	38.2	38.8	39.1	40.2	40.8	40.5	41.1	41.3
4H 2H	38.5	39.2	38.8	39.4	39.6	40.1	40.7	40.3	40.9	41.2
3H	38.5	39.1	38.8	39.3	39.6	40.5	41.1	40.8	41.4	41.6
4H	38.4	38.9	38.7	39.2	39.5	40.5	41.1	40.9	41.4	41.7
6H	38.3	38.8	38.7	39.1	39.5	40.5	41.0	40.9	41.3	41.6
8H	38.3	38.7	38.7	39.1	39.4	40.4	40.9	40.8	41.2	41.6
12H	38.2	38.6	38.6	39.0	39.4	40.4	40.8	40.8	41.2	41.6
8H 4H	38.4	38.8	38.7	39.1	39.5	40.4	40.9	40.8	41.2	41.6
6H	38.3	38.6	38.7	39.0	39.4	40.4	40.7	40.8	41.1	41.6
8H	38.2	38.5	38.7	39.0	39.4	40.3	40.7	40.8	41.1	41.5
12H	38.2	38.5	38.6	38.9	39.4	40.3	40.6	40.8	41.0	41.5
12H 4H	38.3	38.7	38.7	39.1	39.5	40.4	40.8	40.8	41.2	41.5
6H	38.2	38.5	38.7	39.0	39.4	40.3	40.6	40.8	41.1	41.5
8H	38.2	38.5	38.6	38.9	39.4	40.3	40.6	40.8	41.0	41.5
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.6 / - 3.2					+ 1.2 / - 1.6				
1.5H	+ 2.2 / - 2.9					+ 1.6 / - 1.3				
2.0H	+ 2.4 / - 4.9					+ 1.9 / - 1.4				

CIE Pub.117, 1973 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 2.4$)
Area: 1e-005 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz Lamp Flux:1973.37x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	88	82	78	88	82	78	87	81	78	75
0.80	95	90	86	95	89	86	94	89	86	82
1.00	100	94	91	99	94	90	97	94	90	86
1.25	104	99	95	103	98	95	101	97	94	90
1.50	106	102	98	105	101	98	103	99	97	92
2.00	109	105	102	107	104	101	105	102	99	94
2.50	110	107	104	109	105	103	106	103	101	95
3.00	112	109	106	110	107	105	107	105	103	96
4.00	114	111	109	112	110	108	108	106	105	98
5.00	115	113	111	113	111	110	109	108	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz Lamp Flux:1973.37x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

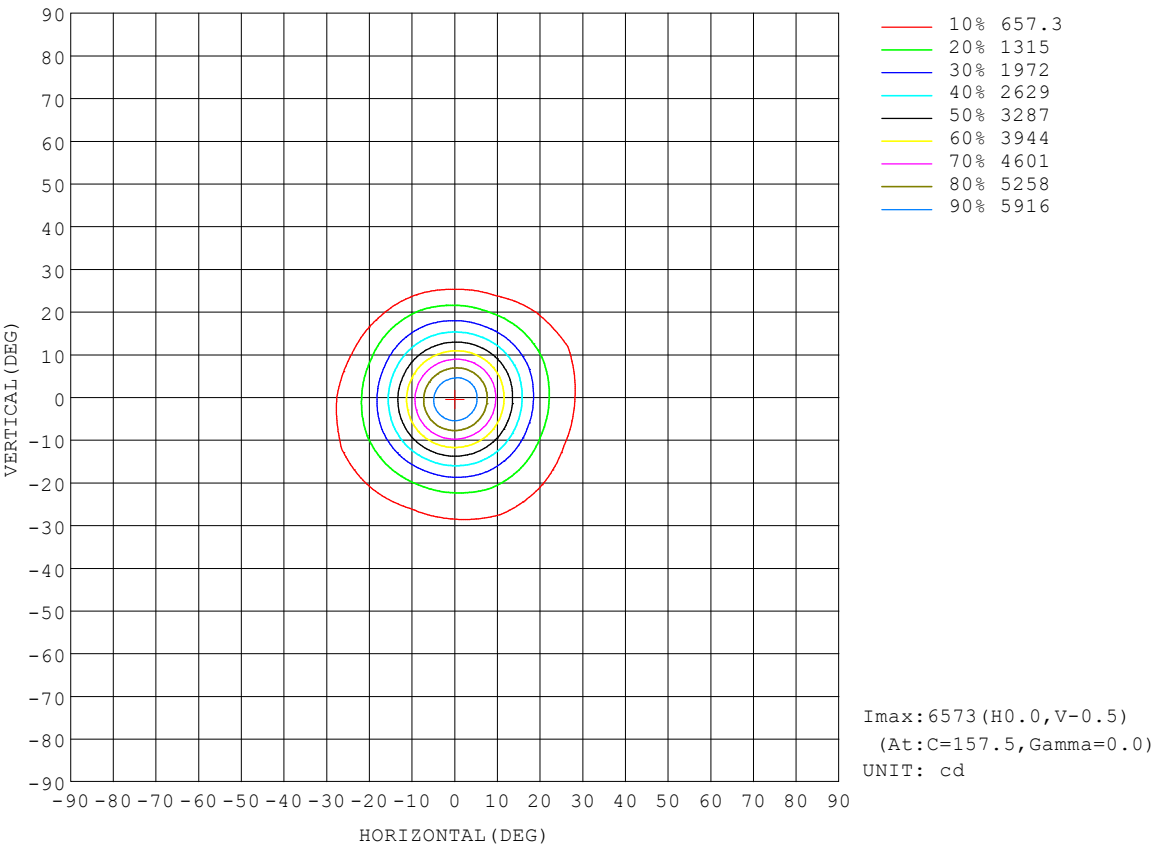

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-27	Remarks:

AAI Figure

Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz Lamp Flux:1973.37x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

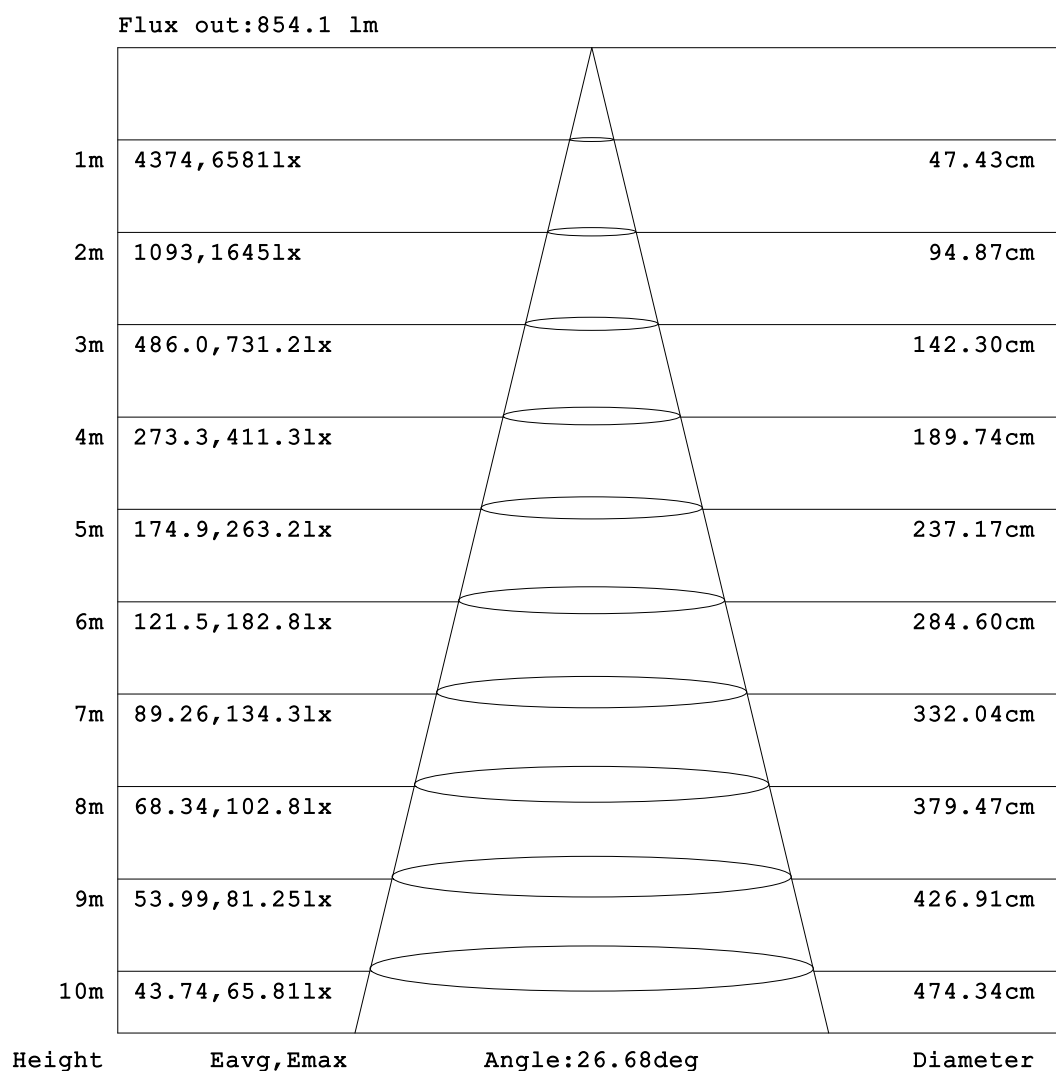


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Allen
Test Date: 2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:

ISOLUX DIAGRAM


Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz Lamp Flux:1973.37x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

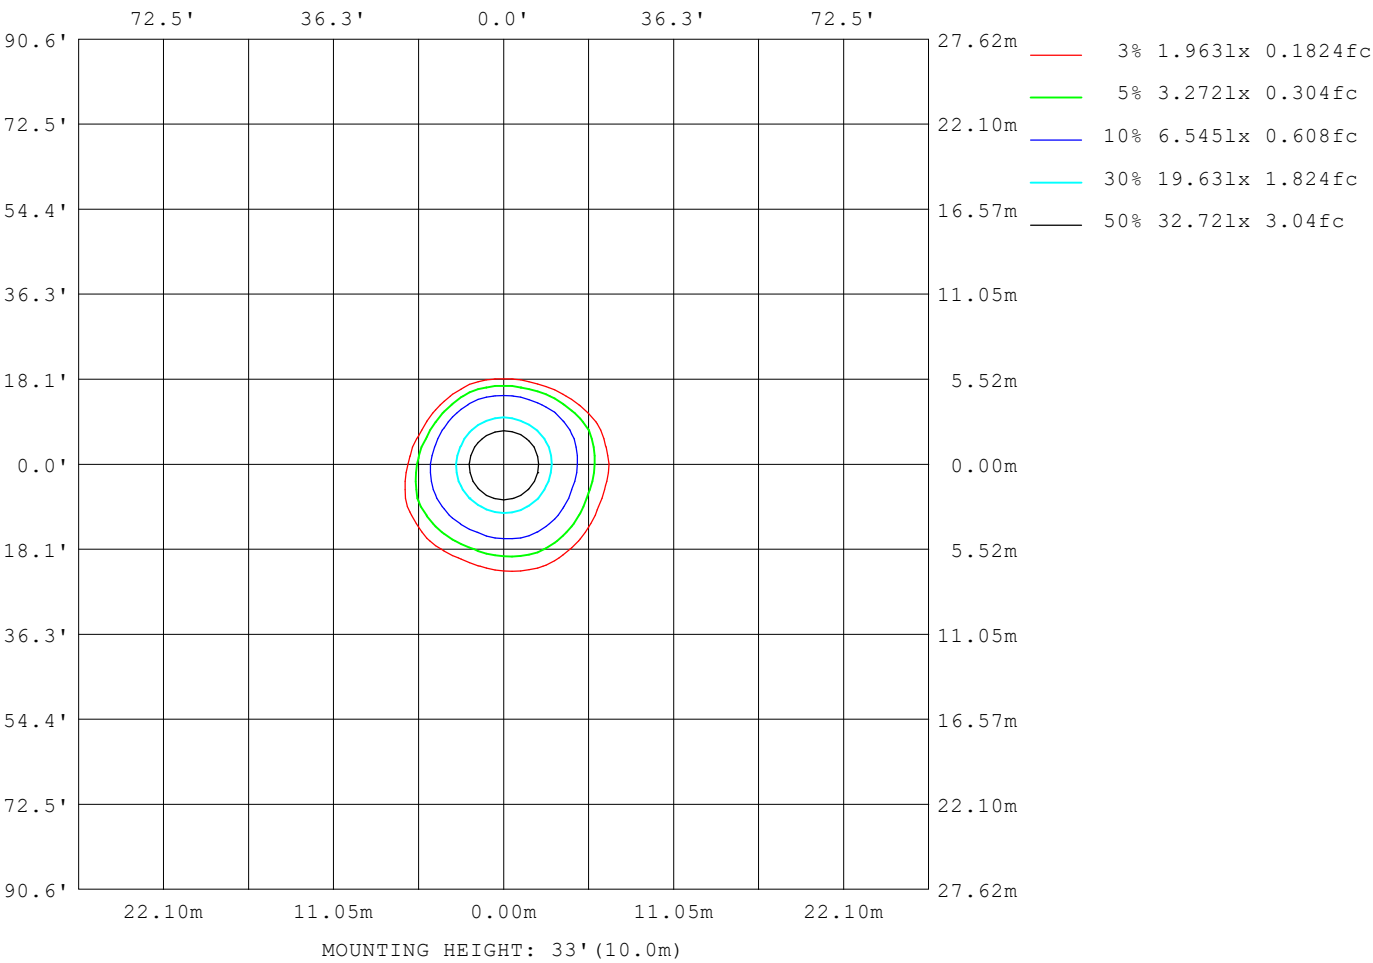

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

Planar Illuminance Curve

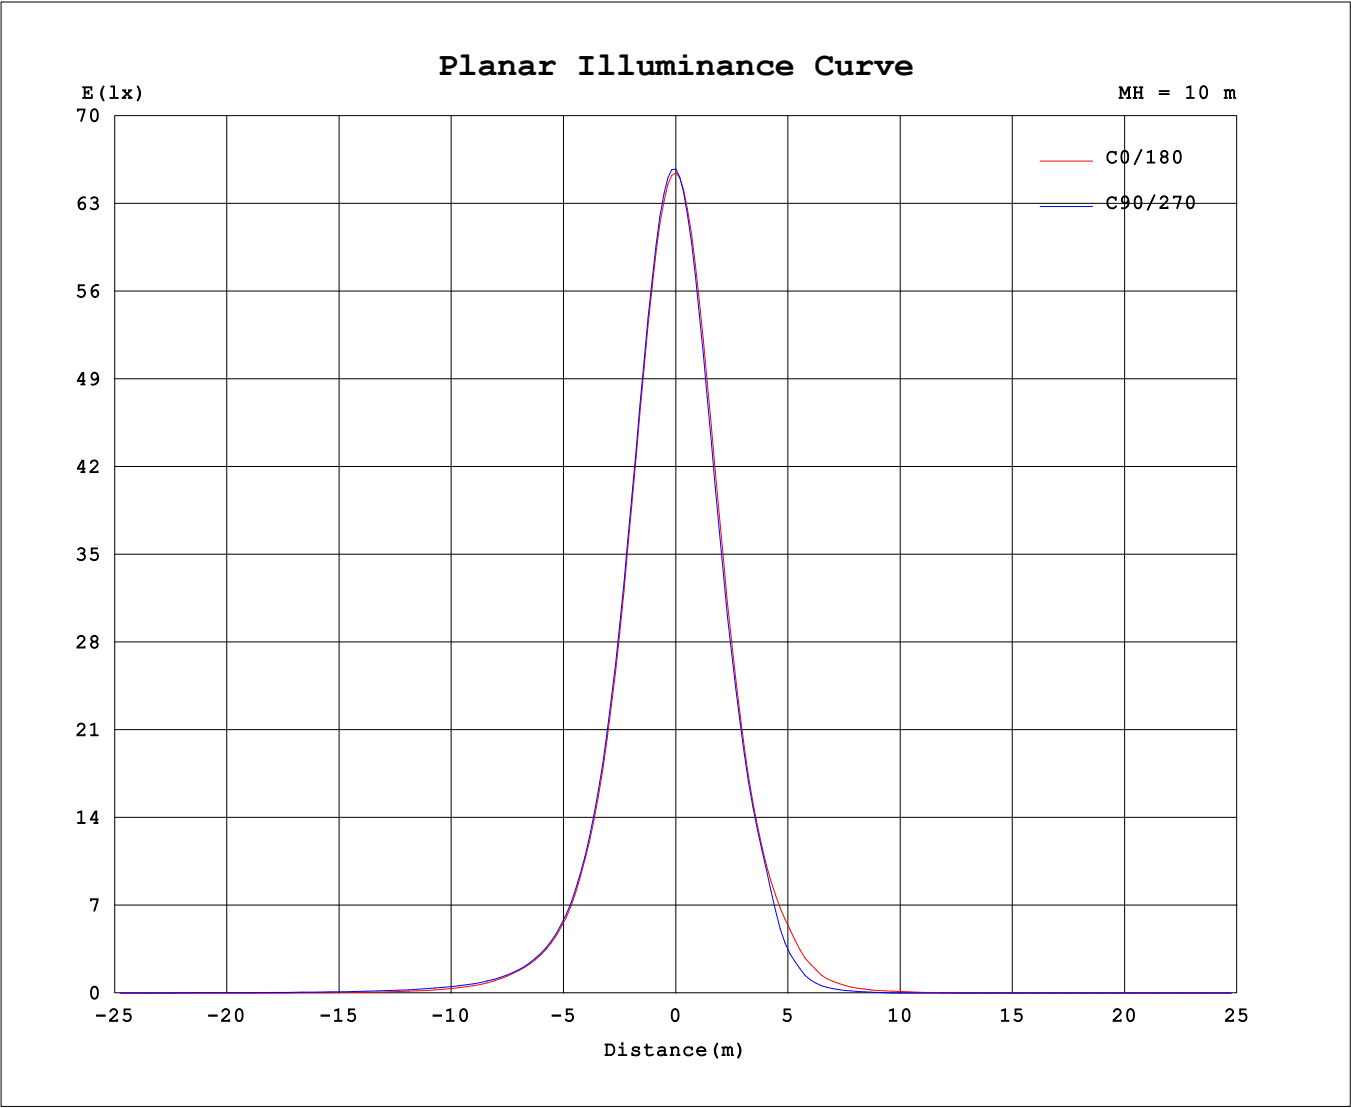

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:2.6884A P:27.000W PF:0.8188 Freq:60.03Hz Lamp Flux:1973.37x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	6545	6550	6555	6566	6574	6576	6578	6581	6545	6550	6555	6566	6574	6576	6578	6581			
5	5974	6002	6022	6029	6034	6022	5996	5952	5881	5822	5781	5767	5792	5867	5907	5962			
10	4475	4502	4523	4530	4540	4537	4502	4441	4367	4273	4229	4204	4228	4301	4386	4456			
15	2850	2867	2919	2940	2921	2897	2889	2839	2790	2716	2715	2709	2702	2738	2823	2890			
20	1661	1652	1727	1764	1714	1666	1700	1689	1612	1551	1598	1617	1570	1558	1644	1707			
25	937	912	990	1034	973	921	972	985	914	799	733	736	692	734	927	993			
30	540	517	574	615	562	519	564	587	430	295	241	239	219	245	386	576			
35	326	310	348	379	340	309	342	310	173	97.4	72.9	68.8	65.1	78.9	147	271			
40	186	200	222	245	219	199	214	147	73.9	42.3	28.7	24.9	25.2	34.7	59.4	127			
45	105	137	151	165	149	137	126	75.2	37.2	16.1	4.30	3.08	3.37	9.26	29.2	60.2			
50	60.8	91.7	107	115	106	96.9	74.8	40.2	16.1	2.52	0.08	0.00	0.00	1.13	8.53	31.4			
55	34.6	60.4	77.8	81.7	76.7	66.6	44.5	20.3	3.76	0.36	0.01	0.00	0.00	0.14	1.78	13.0			
60	17.2	37.1	54.3	58.6	55.6	43.3	24.7	7.53	1.00	0.26	0.00	0.00	0.00	0.06	0.53	3.41			
65	6.40	20.2	34.3	40.8	36.9	24.9	11.5	2.55	0.73	0.07	0.00	0.00	0.00	0.00	0.38	1.19			
70	2.52	8.81	18.3	25.1	20.4	11.9	3.87	1.22	0.48	0.00	0.00	0.00	0.00	0.00	0.12	0.91			
75	1.43	3.36	7.76	10.9	8.77	4.24	1.62	0.95	0.13	0.00	0.00	0.00	0.00	0.00	0.00	0.63			
80	1.13	1.93	3.01	3.54	2.93	1.84	1.27	0.63	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.29			
85	0.78	1.61	2.18	2.20	1.91	1.50	0.96	0.28	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.41	1.24	1.85	1.93	1.62	1.18	0.64	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.07	0.82	1.43	1.55	1.26	0.83	0.33	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.43	0.99	1.12	0.88	0.51	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.09	0.54	0.69	0.52	0.23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.17	0.31	0.21	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.08	0.10	0.11	0.10	0.10	0.09	0.08	0.06			
135	0.18	0.16	0.14	0.13	0.14	0.16	0.17	0.19	0.40	0.42	0.43	0.43	0.42	0.42	0.40	0.36			
140	0.52	0.52	0.49	0.48	0.49	0.51	0.53	0.53	0.96	0.99	1.00	0.99	0.99	0.99	0.96	0.91			
145	0.86	0.87	0.85	0.85	0.86	0.88	0.88	0.87	1.70	1.75	1.77	1.76	1.76	1.76	1.72	1.66			
150	1.09	1.11	1.10	1.09	1.10	1.11	1.11	1.09	2.48	2.52	2.56	2.56	2.56	2.55	2.52	2.45			
155	1.38	1.40	1.40	1.39	1.39	1.39	1.38	1.37	3.26	3.27	3.32	3.32	3.32	3.32	3.29	3.24			
160	1.53	1.53	1.53	1.53	1.53	1.53	1.52	1.50	3.75	3.75	3.77	3.77	3.77	3.78	3.77	3.72			
165	1.55	1.55	1.53	1.53	1.52	1.51	1.50	1.51	3.76	3.75	3.73	3.73	3.72	3.73	3.73	3.71			
170	1.60	1.58	1.55	1.54	1.54	1.54	1.54	1.56	3.50	3.49	3.45	3.44	3.43	3.44	3.44	3.42			
175	1.81	1.78	1.75	1.73	1.73	1.74	1.75	1.77	3.01	3.02	2.97	2.92	2.90	2.89	2.91	2.91			
180	2.35	2.30	2.24	2.21	2.25	2.23	2.24	2.24	2.34	2.35	2.30	2.24	2.21	2.24	2.22	2.24			

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: