


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz Lamp Flux:932.982x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 67.61 lm/W
MODEL	SMART FIXTURE 3000K	Imax (cd)	2364	S/MH(C0/180)	0.54	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.49	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	932.98	η UP,DN(C0-180)	0.1,57.6	
NOMINAL FLUX(lm)	932.982	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,42.3	
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.55	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

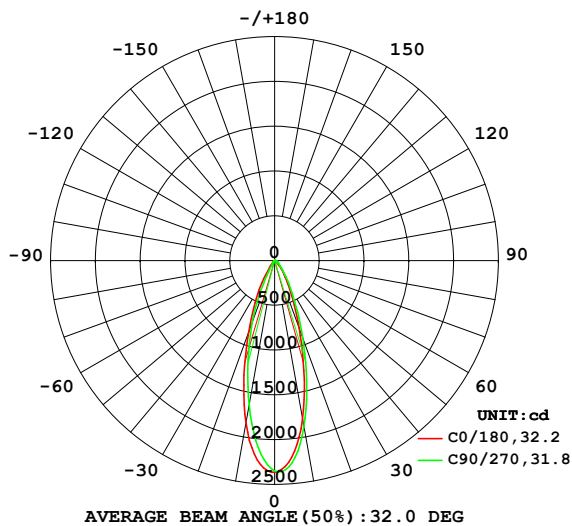

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

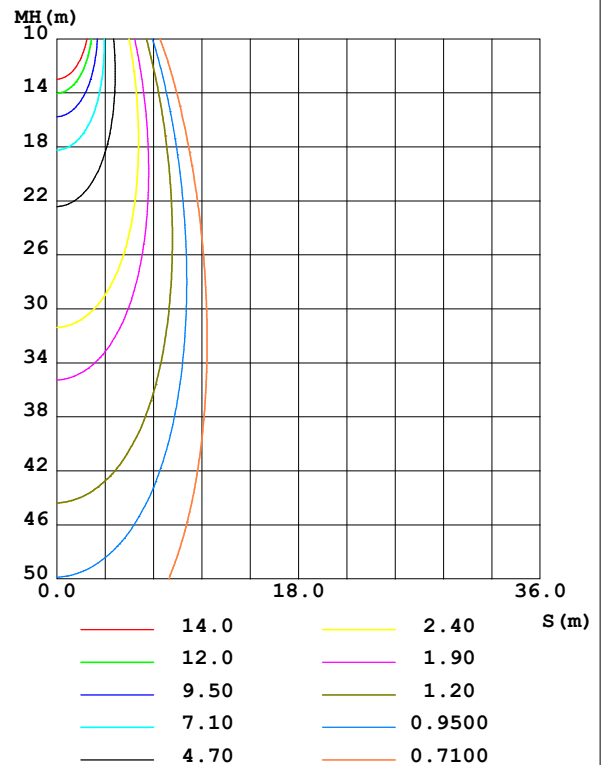

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1797	1769	1888	1951	1846	1763	1645	1700	0- 10	196.7	196.7	21.1,21.1
20	807.3	826.6	919.2	962.2	853.6	830.5	732.6	756.5	10- 20	353.0	549.7	58.9,58.9
30	297.1	322.2	351.7	367.3	282.6	176.9	120.4	199.3	20- 30	229.6	779.3	83.5,83.5
40	105.7	130.6	140.2	144.9	48.57	18.58	11.12	30.74	30- 40	92.74	872.0	93.5,93.5
50	31.26	58.90	63.15	47.69	8.927	0.0008	0	2.916	40- 50	36.24	908.3	97.4,97.4
60	8.231	27.06	30.65	14.36	0.4906	0	0	0.1853	50- 60	15.22	923.5	99,99
70	1.191	8.783	11.70	2.528	0.1840	0	0	0	60- 70	6.070	929.6	99.6,99.6
80	0.5160	1.452	1.718	0.6428	0	0	0	0	70- 80	1.594	931.2	99.8,99.8
90	0.1104	0.9076	0.8263	0.2964	0	0	0	0	80- 90	0.3990	931.6	99.8,99.8
100	0	0.4304	0.4191	0	0	0	0	0	90-100	0.2030	931.8	99.9,99.9
110	0	0	0.0438	0	0	0	0	0	100-110	0.0553	931.8	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0.0011	931.8	99.9,99.9
130	0	0	0	0	0	0	0.0001	0.0000	120-130	0.0000	931.8	99.9,99.9
140	0.1436	0.1232	0.0845	0.0966	0.3351	0.3493	0.4191	0.4221	130-140	0.0624	931.9	99.9,99.9
150	0.3762	0.3753	0.3499	0.3461	0.9553	0.9823	1.063	1.062	140-150	0.2932	932.2	99.9,99.9
160	0.5921	0.5952	0.5856	0.5782	1.485	1.494	1.520	1.519	150-160	0.4082	932.6	100,100
170	0.6689	0.6532	0.6453	0.6472	1.438	1.429	1.400	1.397	160-170	0.2986	932.9	100,100
180	1.040	1.006	0.9483	0.9506	1.033	1.022	0.9445	0.9454	170-180	0.0959	933.0	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 894.2 lm

%lum = 95.8%

%lamp = 95.8%

Conical surface Flux(120deg): 923.5 lm

%lum = 99.0%


%lamp = 99.0%

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz Lamp Flux:932.982x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

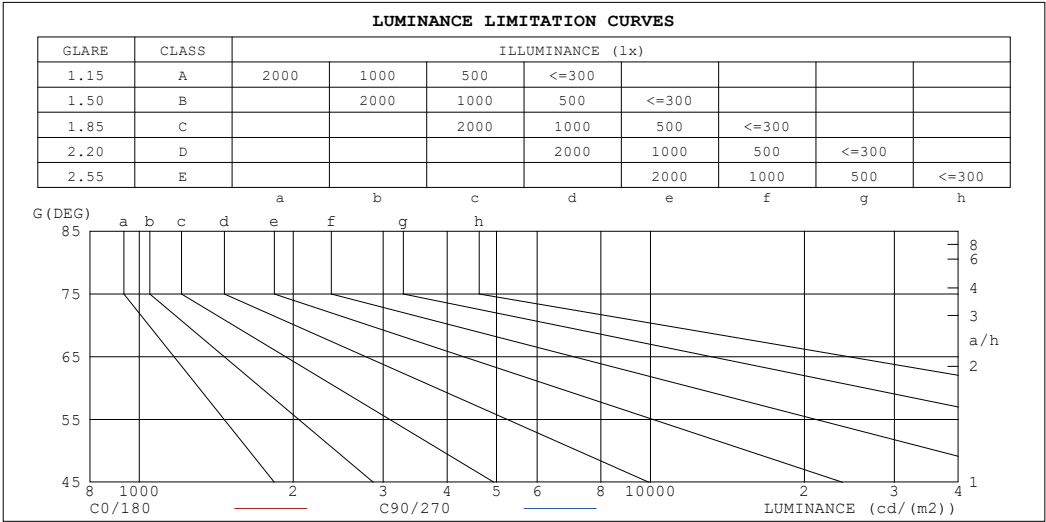

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	366267	1121451
80	297143	989261
75	262783	1999593
70	348206	3420803
65	707332	4780907
60	1646294	6129422
55	2871988	7645327
50	4863134	9824207
45	8131697	13107043


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz		
Lamp Flux:932.982x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
p _w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
p _{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.09	1.07	1.09	1.07	1.06	1.05	1.04	1.02	1.02	1.00	.99	.98	.97	.96	.95
2.0	1.05	1.01	.98	1.03	.90	.97	1.00	.97	.95	.97	.95	.93	.94	.93	.91	.90
3.0	.99	.95	.91	.98	.94	.90	.95	.92	.89	.93	.90	.88	.90	.88	.86	.85
4.0	.94	.89	.85	.93	.88	.85	.91	.87	.84	.89	.85	.83	.87	.84	.82	.80
5.0	.89	.84	.80	.88	.83	.80	.86	.82	.79	.85	.81	.78	.83	.80	.78	.76
6.0	.85	.80	.76	.84	.79	.76	.83	.78	.75	.81	.77	.75	.80	.77	.74	.73
7.0	.81	.76	.72	.80	.75	.72	.79	.75	.71	.78	.74	.71	.77	.73	.71	.70
8.0	.77	.72	.69	.77	.72	.69	.76	.71	.68	.75	.71	.68	.74	.70	.68	.66
9.0	.74	.69	.66	.74	.69	.65	.73	.68	.65	.72	.68	.65	.71	.67	.65	.64
10.0	.71	.66	.63	.71	.66	.63	.70	.66	.63	.69	.65	.62	.69	.65	.62	.61

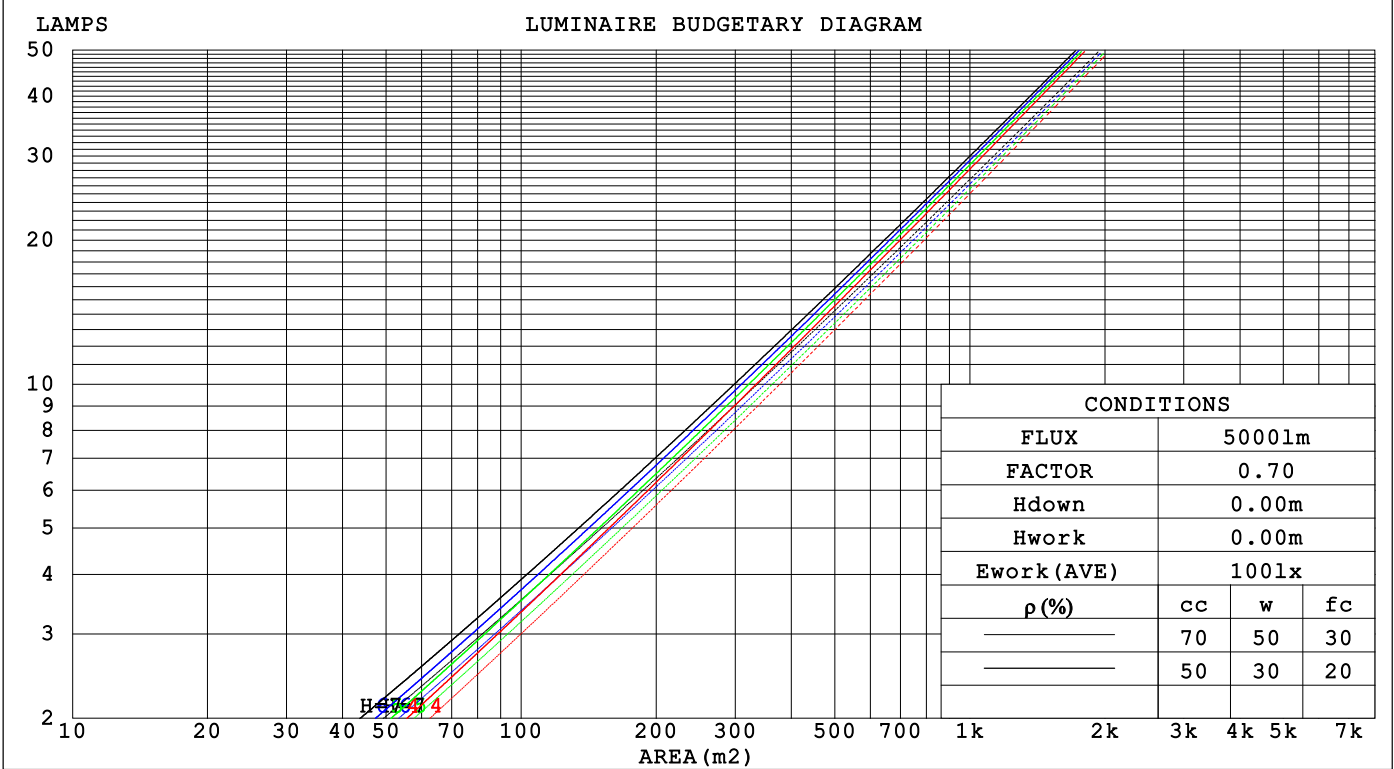

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-27

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz Lamp Flux:932.982x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.161	.092	.029	.154	.088	.028	.142	.081	.026	.130	.075	.024	.120	.069	.022															
2.0	.152	.084	.026	.147	.081	.025	.136	.076	.024	.127	.071	.022	.118	.067	.021															
3.0	.144	.077	.023	.139	.075	.022	.130	.071	.021	.122	.067	.021	.114	.063	.020															
4.0	.136	.071	.021	.132	.069	.020	.124	.066	.020	.117	.063	.019	.111	.060	.018															
5.0	.129	.066	.019	.125	.064	.019	.119	.062	.018	.113	.060	.018	.107	.057	.017															
6.0	.123	.061	.018	.120	.060	.017	.114	.058	.017	.108	.056	.017	.103	.054	.016															
7.0	.117	.058	.016	.114	.057	.016	.109	.055	.016	.104	.053	.016	.100	.052	.015															
8.0	.111	.054	.015	.109	.054	.015	.105	.052	.015	.100	.051	.015	.096	.050	.014															
9.0	.107	.052	.014	.105	.051	.014	.101	.050	.014	.097	.049	.014	.093	.047	.014															
10.0	.102	.049	.014	.100	.048	.014	.097	.047	.013	.093	.046	.013	.090	.045	.013															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.171	.159	.147	.146	.136	.127	.100	.094	.088	.058	.054	.051	.018	.017	.016	
2.0	.155	.134	.116	.133	.115	.100	.091	.080	.070	.052	.046	.041	.017	.015	.013	
3.0	.141	.115	.093	.121	.099	.081	.083	.069	.057	.048	.040	.033	.015	.013	.011	
4.0	.130	.100	.076	.112	.086	.066	.077	.060	.047	.044	.035	.028	.014	.011	.009	
5.0	.121	.088	.063	.104	.076	.055	.071	.053	.039	.041	.031	.023	.013	.010	.008	
6.0	.113	.078	.053	.097	.068	.047	.067	.047	.033	.039	.028	.020	.012	.009	.006	
7.0	.106	.070	.046	.091	.061	.040	.063	.043	.028	.036	.025	.017	.012	.008	.006	
8.0	.100	.064	.039	.086	.055	.034	.059	.039	.024	.034	.023	.015	.011	.008	.005	
9.0	.094	.058	.034	.081	.051	.030	.056	.036	.021	.033	.021	.013	.011	.007	.004	
10.0	.089	.054	.030	.077	.047	.026	.054	.033	.019	.031	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz Lamp Flux:932.982x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	39.3	40.1	39.5	40.2	40.4	41.5	42.3	41.7	42.5	42.7
3H	39.1	39.9	39.4	40.1	40.3	41.8	42.6	42.1	42.8	43.0
4H	39.1	39.8	39.3	40.0	40.2	41.8	42.5	42.1	42.7	43.0
6H	39.0	39.7	39.3	39.9	40.1	41.8	42.4	42.0	42.7	42.9
8H	38.9	39.6	39.2	39.8	40.1	41.7	42.4	42.0	42.6	42.9
12H	38.9	39.5	39.2	39.8	40.1	41.7	42.3	42.0	42.6	42.8
4H 2H	39.5	40.2	39.7	40.4	40.6	41.5	42.2	41.8	42.4	42.7
3H	39.4	40.0	39.7	40.3	40.5	41.9	42.5	42.2	42.8	43.0
4H	39.3	39.9	39.6	40.2	40.5	41.9	42.5	42.3	42.8	43.1
6H	39.2	39.7	39.6	40.0	40.4	41.9	42.4	42.2	42.7	43.0
8H	39.2	39.6	39.6	40.0	40.3	41.8	42.3	42.2	42.6	43.0
12H	39.1	39.5	39.5	39.9	40.3	41.8	42.2	42.2	42.6	43.0
8H 4H	39.2	39.7	39.6	40.1	40.4	41.8	42.3	42.2	42.6	43.0
6H	39.2	39.5	39.6	39.9	40.3	41.7	42.1	42.2	42.5	42.9
8H	39.1	39.4	39.6	39.9	40.3	41.7	42.0	42.2	42.5	42.9
12H	39.1	39.4	39.5	39.8	40.3	41.7	42.0	42.1	42.4	42.9
12H 4H	39.2	39.6	39.6	40.0	40.4	41.7	42.2	42.1	42.5	42.9
6H	39.1	39.4	39.6	39.9	40.3	41.7	42.0	42.1	42.4	42.9
8H	39.1	39.4	39.5	39.8	40.3	41.7	41.9	42.1	42.4	42.9
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.8 / - 3.9					+ 1.3 / - 2.0				
1.5H	+ 2.4 / - 3.4					+ 1.8 / - 1.4				
2.0H	+ 2.8 / - 5.2					+ 2.4 / - 1.8				

CIE Pub.117, 933.0 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.2)
Area: 1e-005 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz Lamp Flux:932.982x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	81	77	87	81	77	86	81	77	74
0.80	95	89	85	94	89	85	93	88	85	81
1.00	99	94	90	98	93	90	97	93	89	85
1.25	103	98	95	102	98	94	100	96	93	89
1.50	106	101	98	105	101	97	102	99	96	92
2.00	109	104	101	107	103	101	104	101	99	94
2.50	110	106	104	109	105	103	106	103	101	95
3.00	112	108	106	110	107	105	107	104	102	96
4.00	114	111	109	112	109	107	108	106	105	98
5.00	115	113	111	113	111	109	109	108	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz Lamp Flux:932.982x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

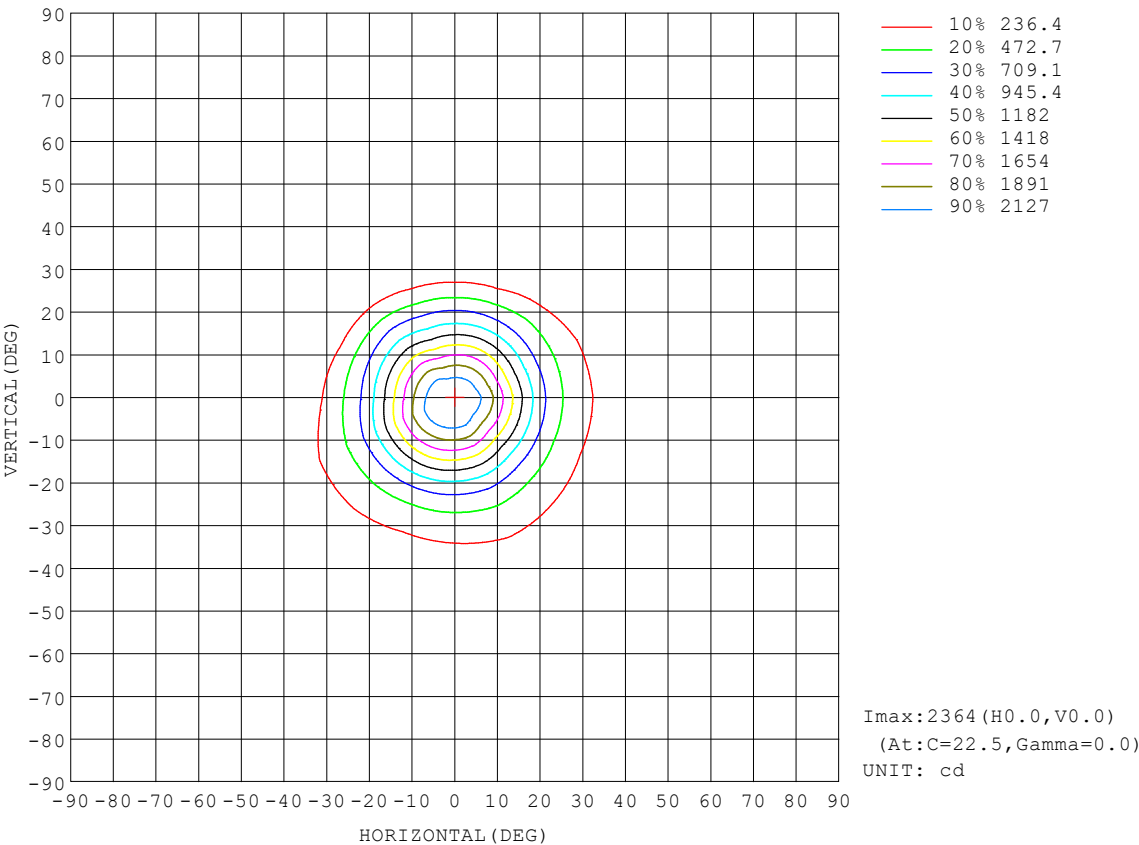


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

AAI Figure

Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz Lamp Flux:932.982x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

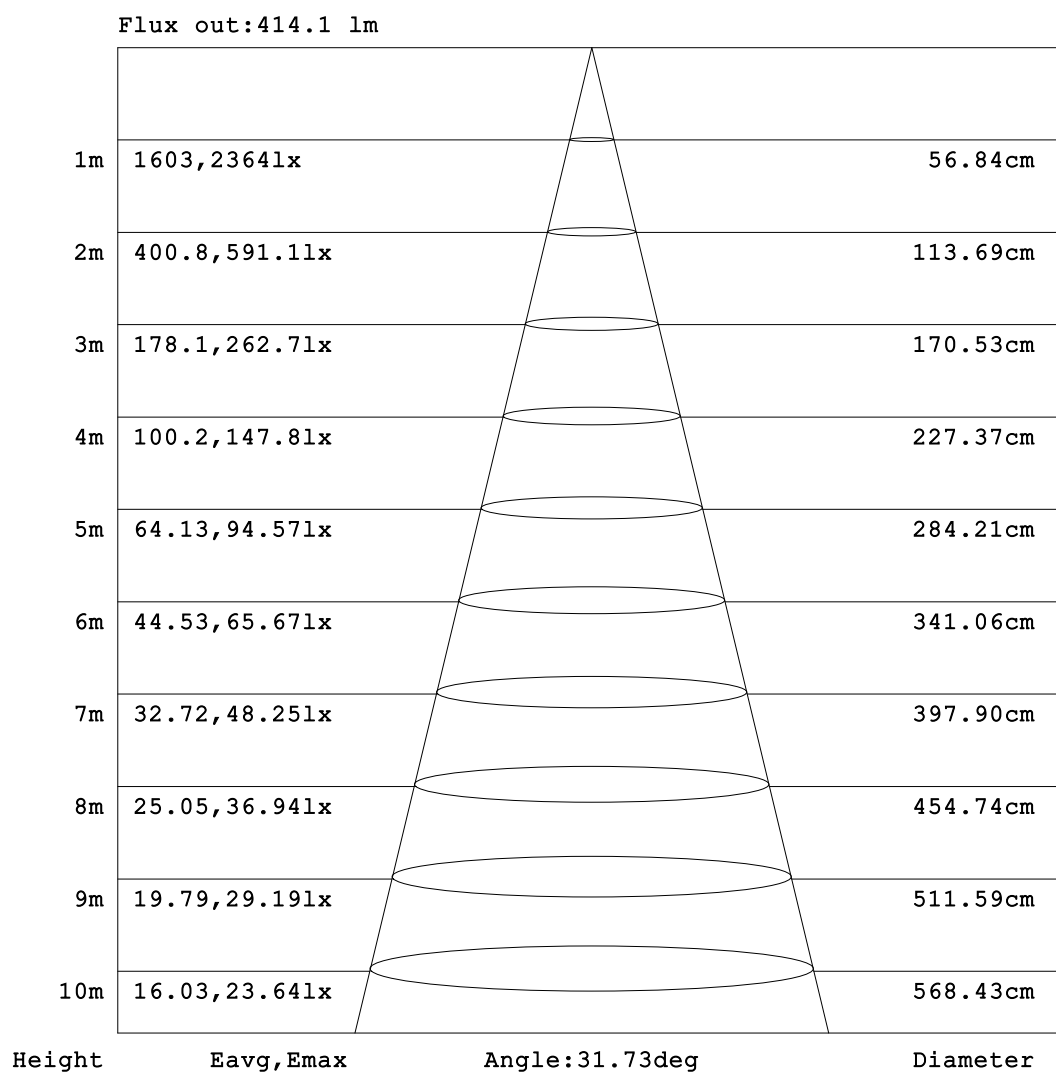


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

ISOLUX DIAGRAM


Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz Lamp Flux:932.982x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

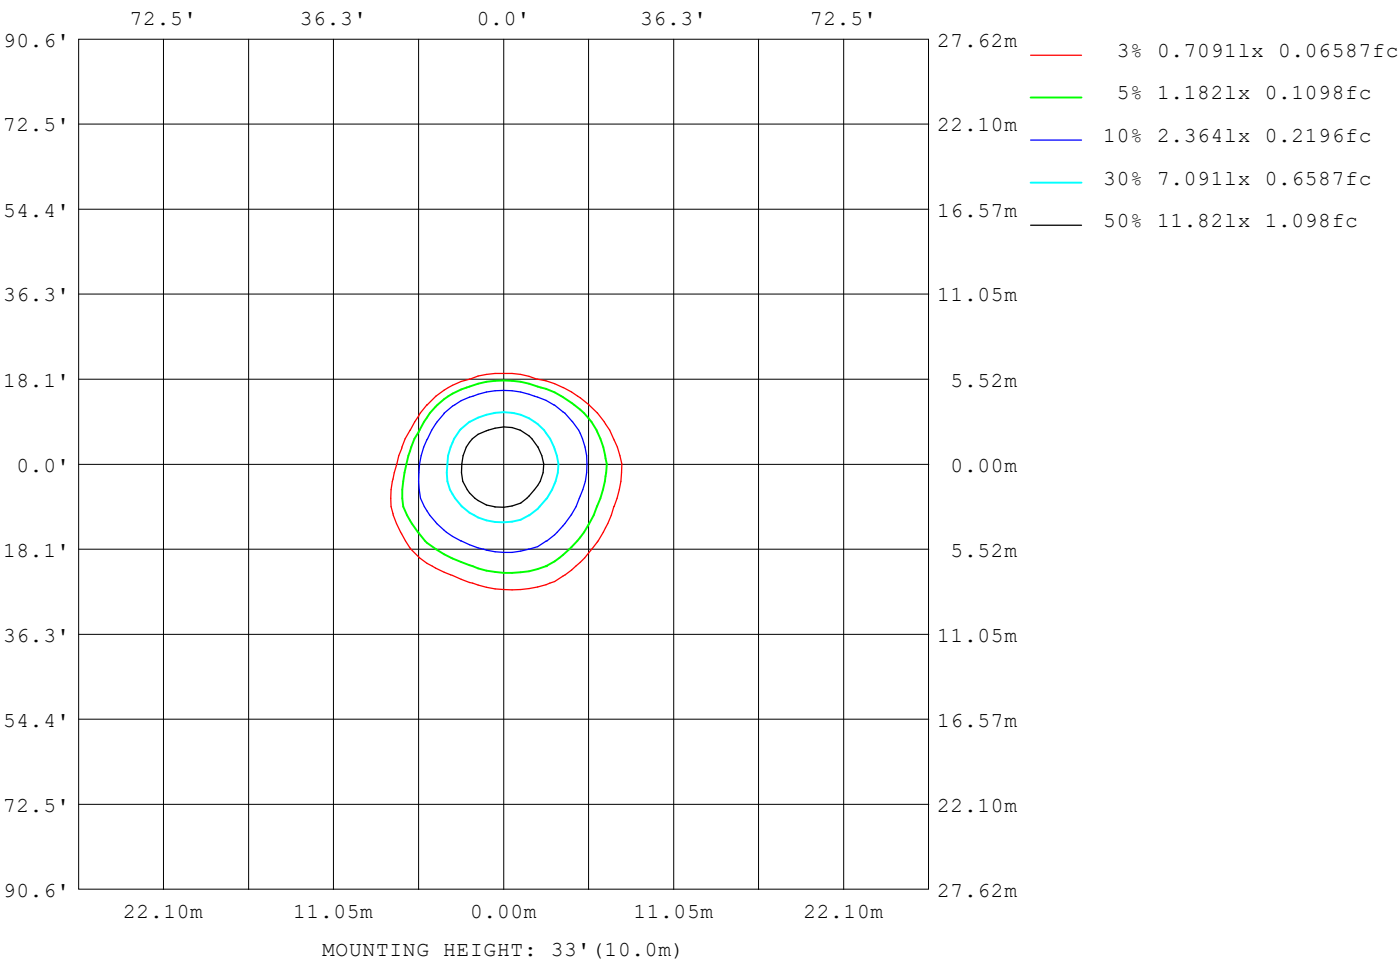

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

Planar Illuminance Curve

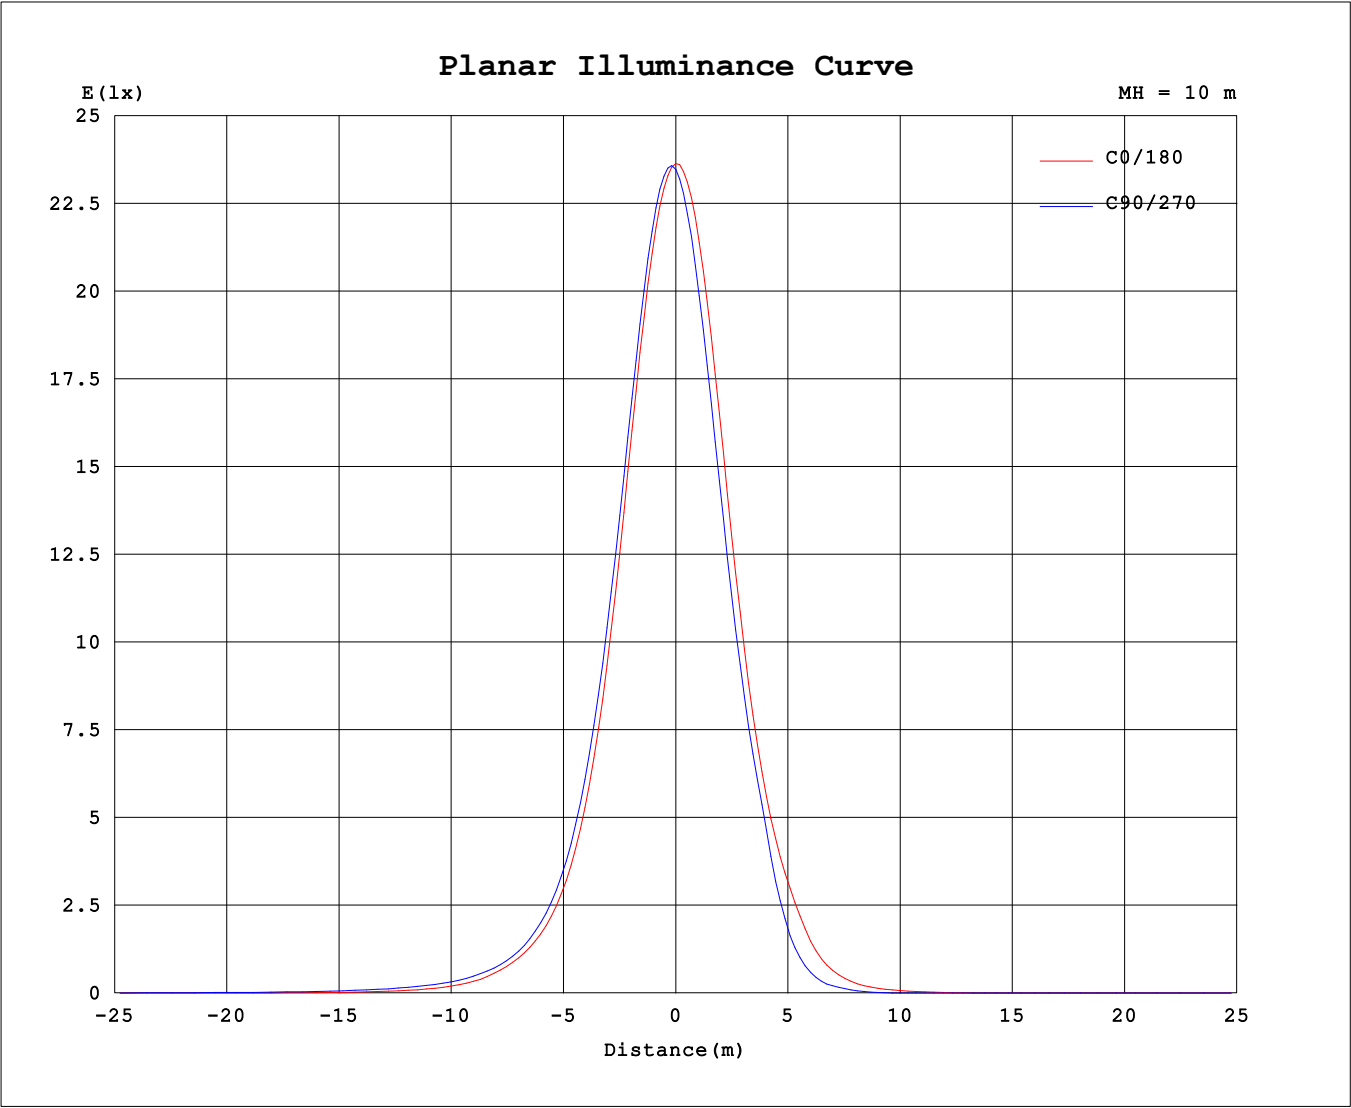

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-27	Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:1.4145A P:13.800W PF:0.7509 Freq:59.93Hz Lamp Flux:932.982x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	2364	2364	2360	2349	2347	2347	2348	2347	2364	2364	2360	2349	2347	2347	2348	2347			
5	2206	2200	2193	2254	2263	2275	2281	2278	2236	2210	2186	2098	2097	2113	2132	2146			
10	1797	1785	1769	1867	1888	1921	1951	1948	1846	1803	1763	1639	1645	1676	1700	1711			
15	1268	1270	1266	1362	1388	1430	1453	1443	1326	1297	1264	1140	1147	1173	1187	1191			
20	807	812	827	903	919	946	962	955	854	838	830	741	733	740	757	762			
25	490	487	518	576	573	576	600	601	522	488	456	372	355	376	452	473			
30	297	290	322	365	352	340	367	376	283	198	177	132	120	131	199	283			
35	184	178	203	234	219	203	228	224	118	71.2	56.3	39.7	38.7	41.2	78.5	139			
40	106	114	131	153	140	129	145	113	48.6	27.3	18.6	11.6	11.1	15.4	30.7	65.1			
45	57.5	75.9	86.7	102	92.7	83.8	84.9	54.3	21.3	9.31	2.73	1.02	1.10	3.13	12.3	29.7			
50	31.3	48.2	58.9	68.9	63.1	57.1	47.7	25.9	8.93	1.42	0.00	0.00	0.00	0.16	2.92	13.5			
55	16.5	30.1	40.7	47.1	43.9	37.7	27.0	12.8	2.16	0.11	0.00	0.00	0.00	0.00	0.55	4.89			
60	8.23	17.7	27.1	32.4	30.6	23.9	14.4	5.17	0.49	0.05	0.00	0.00	0.00	0.00	0.19	1.37			
65	2.99	9.60	16.4	22.0	20.2	14.1	7.07	1.58	0.31	0.00	0.00	0.00	0.00	0.00	0.09	0.51			
70	1.19	4.07	8.78	13.6	11.7	7.07	2.53	0.64	0.18	0.00	0.00	0.00	0.00	0.00	0.00	0.38			
75	0.68	1.62	3.60	6.15	5.18	2.66	0.96	0.47	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.21			
80	0.52	0.95	1.45	2.07	1.72	1.03	0.64	0.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02			
85	0.32	0.77	1.09	1.14	0.98	0.76	0.48	0.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.11	0.57	0.91	0.99	0.83	0.59	0.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.00	0.34	0.68	0.79	0.63	0.40	0.12	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.12	0.43	0.56	0.42	0.22	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.00	0.19	0.32	0.22	0.06	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.10	0.04	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
135	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.09	0.10	0.10	0.15	0.15	0.16	0.15	0.14			
140	0.14	0.14	0.12	0.08	0.08	0.09	0.10	0.10	0.34	0.35	0.35	0.41	0.42	0.43	0.42	0.40			
145	0.28	0.28	0.27	0.24	0.24	0.25	0.25	0.25	0.64	0.65	0.66	0.73	0.74	0.75	0.74	0.72			
150	0.38	0.38	0.38	0.35	0.35	0.35	0.35	0.34	0.96	0.97	0.98	1.05	1.06	1.07	1.06	1.04			
155	0.51	0.51	0.51	0.48	0.48	0.48	0.47	0.47	1.27	1.27	1.29	1.35	1.36	1.37	1.36	1.33			
160	0.59	0.59	0.60	0.58	0.59	0.58	0.58	0.57	1.48	1.48	1.49	1.51	1.52	1.52	1.52	1.50			
165	0.63	0.63	0.62	0.61	0.61	0.61	0.60	0.61	1.51	1.51	1.50	1.50	1.50	1.50	1.50	1.48			
170	0.67	0.66	0.65	0.65	0.65	0.65	0.65	0.66	1.44	1.44	1.43	1.41	1.40	1.40	1.40	1.38			
175	0.80	0.79	0.78	0.74	0.74	0.74	0.74	0.75	1.28	1.28	1.27	1.20	1.19	1.19	1.19	1.18			
180	1.04	1.02	1.01	0.94	0.95	0.95	0.95	0.95	1.03	1.04	1.02	0.96	0.94	0.95	0.95	0.95			

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: