


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz Lamp Flux:835.378x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 60.53 lm/W
MODEL	SMART FIXTURE 3000K	Imax (cd)	1625	S/MH(C0/180)	0.68	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.39	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	835.38	η UP,DN(C0-180)	0.1,57.1	
NOMINAL FLUX(lm)	835.378	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,42.7	
LAMPS INSIDE	1	η up (%)	0.1	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)		η down (%)	99.9	CIBSE SHR MAX	0.60	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

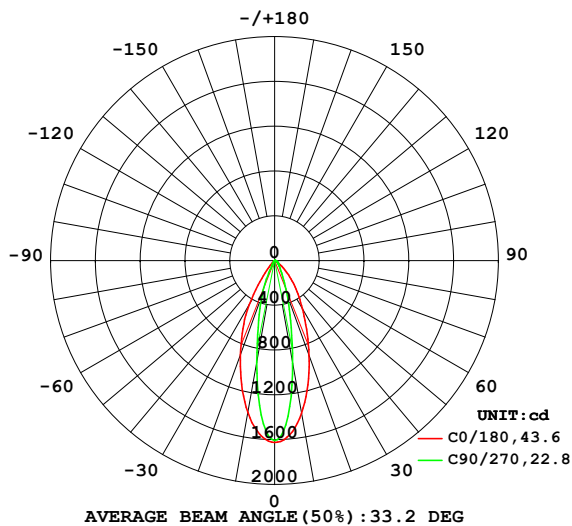

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

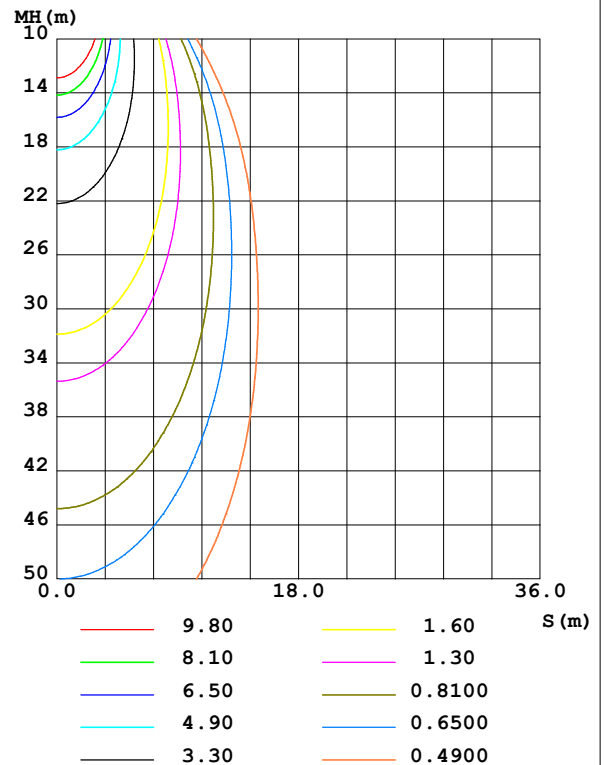

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3 °C
Operators: Allen
Test Date: 2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1387	917.7	933.5	1439	1380	914.6	926.6	1343	0- 10	129.8	129.8	15.5,15.5
20	901.2	322.8	336.3	1017	895.2	323.3	331.5	897.6	10- 20	238.7	368.4	44.1,44.1
30	499.5	120.2	125.9	609.5	453.6	54.49	53.60	403.8	20- 30	212.7	581.1	69.6,69.6
40	258.5	63.54	65.34	339.7	95.50	13.63	11.87	64.47	30- 40	141.6	722.7	86.5,86.5
50	96.39	41.46	42.24	157.4	12.10	0.1584	0.0401	4.674	40- 50	74.09	796.8	95.4,95.4
60	18.93	24.15	25.71	44.17	1.614	0	0	0.8903	50- 60	27.74	824.5	98.7,98.7
70	2.419	8.947	10.61	5.144	0.8471	0	0	0.1635	60- 70	7.315	831.8	99.6,99.6
80	1.319	1.509	1.652	1.679	0	0	0	0	70- 80	1.842	833.7	99.8,99.8
90	0.4674	0.8663	0.8447	0.9242	0	0	0	0	80- 90	0.5793	834.3	99.9,99.9
100	0	0.3979	0.3839	0.1503	0	0	0	0	90-100	0.2606	834.5	99.9,99.9
110	0	0	0.0106	0	0	0	0	0	100-110	0.0525	834.6	99.9,99.9
120	0	0	0	0	0	0	0	0	110-120	0.0000	834.6	99.9,99.9
130	0.0107	0	0	0	0.0077	0	0	0.0951	120-130	0.0017	834.6	99.9,99.9
140	0.2042	0.0321	0.0024	0.0750	0.2983	0.1208	0.1441	0.4429	130-140	0.0510	834.6	99.9,99.9
150	0.3356	0.3211	0.2313	0.1959	0.6171	0.6323	0.6682	0.8091	140-150	0.1996	834.8	99.9,99.9
160	0.4684	0.5006	0.4494	0.3309	0.8487	0.9894	1.140	1.095	150-160	0.2811	835.1	100,100
170	0.5122	0.5640	0.5282	0.4531	0.8365	0.8942	1.108	1.049	160-170	0.2090	835.3	100,100
180	0.7431	0.7426	0.7891	0.7385	0.7360	0.7300	0.7230	0.7575	170-180	0.0712	835.4	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 767 lm

%lum = 91.8%

%lamp = 91.8%

Conical surface Flux(120deg): 824.51 lm

%lum = 98.7%


%lamp = 98.7%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz Lamp Flux:835.378x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

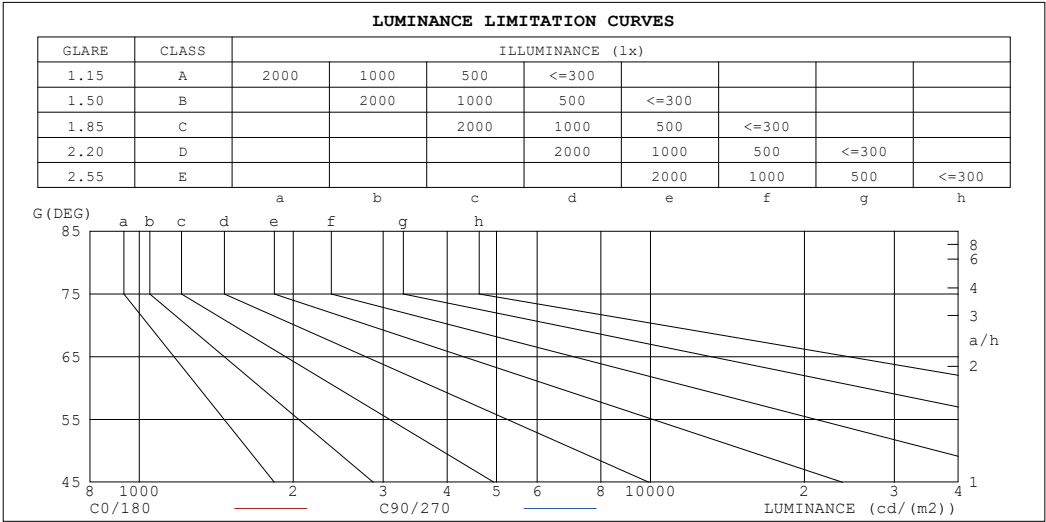

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	1062853	1177363
80	759431	951477
75	616791	1762494
70	707254	3102153
65	1396728	4200953
60	3785820	5141025
55	8352855	5864273
50	14995843	6571053
45	23409905	7374330


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz		
Lamp Flux:835.378x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.11	1.08	1.06	1.08	1.06	1.04	1.04	1.03	1.01	1.01	.99	.98	.97	.96	.95	.93
2.0	1.03	.99	.95	1.01	.97	.94	.98	.95	.92	.95	.92	.90	.92	.90	.88	.87
3.0	.96	.91	.87	.94	.90	.86	.92	.88	.85	.89	.86	.83	.87	.84	.82	.81
4.0	.90	.84	.80	.89	.83	.79	.86	.82	.78	.84	.81	.78	.82	.79	.77	.75
5.0	.84	.78	.74	.83	.78	.74	.81	.77	.73	.80	.76	.72	.78	.75	.72	.70
6.0	.79	.73	.69	.78	.73	.69	.77	.72	.68	.75	.71	.68	.74	.70	.67	.66
7.0	.75	.69	.64	.74	.68	.64	.73	.68	.64	.71	.67	.64	.70	.66	.63	.62
8.0	.71	.65	.61	.70	.64	.60	.69	.64	.60	.68	.63	.60	.67	.63	.60	.58
9.0	.67	.61	.57	.66	.61	.57	.65	.60	.57	.65	.60	.57	.64	.60	.57	.55
10.0	.64	.58	.54	.63	.58	.54	.62	.57	.54	.62	.57	.54	.61	.57	.54	.52

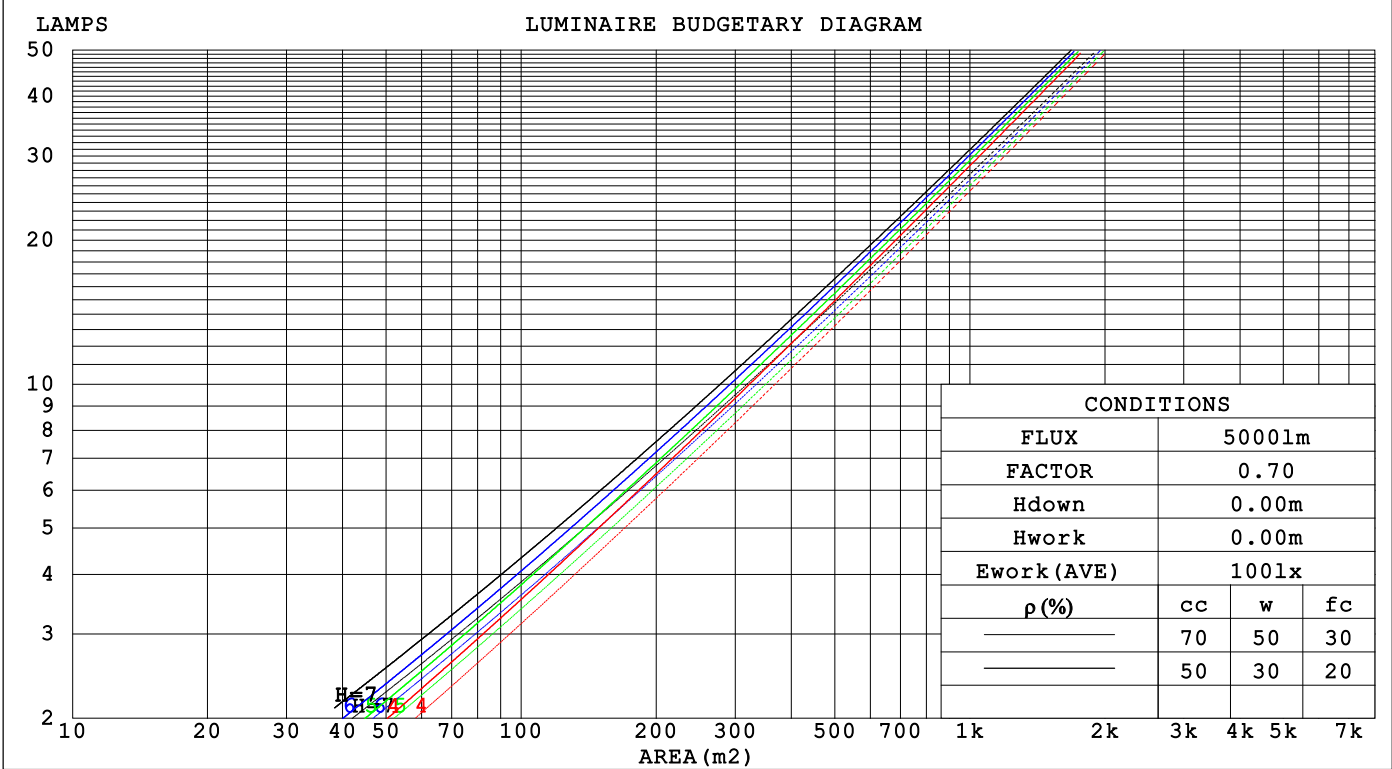

C Range: 0 - 360DEG

C Interval: 22.5DEG

Test Speed: HIGH

Temperature:25.3℃

Operators:Allen

Test Date:2026-01-27

γ Range: 0 - 180DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459

Humidity:45%

Test Distance:2.900m [K=0.8783]

Remarks:

WEC AND CCEC

Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz Lamp Flux:835.378x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.180	.102	.032	.173	.099	.031	.160	.092	.029	.148	.086	.027	.138	.080	.026															
2.0	.172	.094	.029	.167	.092	.028	.156	.087	.027	.146	.082	.026	.137	.077	.024															
3.0	.164	.087	.026	.159	.085	.026	.150	.081	.025	.141	.078	.024	.134	.074	.023															
4.0	.156	.081	.024	.151	.079	.023	.144	.076	.023	.136	.073	.022	.129	.070	.021															
5.0	.148	.075	.022	.144	.074	.022	.137	.072	.021	.131	.069	.021	.125	.067	.020															
6.0	.141	.071	.020	.138	.069	.020	.131	.067	.020	.126	.065	.019	.121	.063	.019															
7.0	.134	.066	.019	.131	.065	.019	.126	.064	.018	.121	.062	.018	.116	.060	.018															
8.0	.128	.062	.018	.125	.062	.017	.121	.060	.017	.116	.059	.017	.112	.057	.017															
9.0	.122	.059	.016	.120	.058	.016	.116	.057	.016	.112	.056	.016	.108	.055	.016															
10.0	.117	.056	.016	.115	.055	.015	.111	.054	.015	.107	.053	.015	.104	.052	.015															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.172	.158	.146	.147	.136	.125	.101	.093	.087	.058	.054	.050	.019	.017	.016	
2.0	.157	.134	.114	.135	.115	.098	.092	.080	.068	.053	.046	.040	.017	.015	.013	
3.0	.145	.115	.090	.124	.099	.078	.085	.069	.055	.049	.040	.032	.016	.013	.011	
4.0	.135	.100	.073	.116	.086	.064	.080	.060	.045	.046	.035	.027	.015	.011	.009	
5.0	.126	.088	.060	.108	.076	.053	.075	.053	.037	.043	.031	.022	.014	.010	.007	
6.0	.119	.079	.051	.102	.068	.044	.070	.048	.031	.041	.028	.019	.013	.009	.006	
7.0	.112	.071	.043	.096	.062	.038	.067	.043	.027	.039	.026	.016	.012	.008	.005	
8.0	.106	.065	.037	.091	.057	.032	.063	.040	.023	.037	.023	.014	.012	.008	.005	
9.0	.101	.060	.032	.087	.052	.028	.060	.037	.020	.035	.022	.012	.011	.007	.004	
10.0	.096	.056	.029	.083	.048	.025	.058	.034	.018	.034	.020	.011	.011	.007	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz Lamp Flux:835.378x1 lm										
NAME:			TYPE:			WEIGHT:				
SPEC.:			DIM.:			SERIAL No.:				
MFR.:			SUR.:			Shielding Angle:				
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	41.4	42.4	41.7	42.6	42.7	38.5	39.4	38.7	39.6	39.8
3H	41.3	42.2	41.6	42.4	42.6	39.2	40.1	39.4	40.3	40.5
4H	41.3	42.1	41.6	42.3	42.6	39.3	40.1	39.5	40.3	40.5
6H	41.2	42.0	41.5	42.2	42.5	39.2	40.0	39.5	40.2	40.5
8H	41.2	41.9	41.5	42.2	42.4	39.2	39.9	39.5	40.2	40.5
12H	41.1	41.8	41.4	42.1	42.4	39.2	39.9	39.5	40.1	40.4
4H 2H	41.4	42.2	41.7	42.5	42.7	38.8	39.6	39.1	39.8	40.1
3H	41.4	42.1	41.7	42.4	42.6	39.6	40.3	39.9	40.5	40.8
4H	41.3	41.9	41.6	42.2	42.6	39.7	40.3	40.0	40.6	40.9
6H	41.2	41.8	41.6	42.1	42.5	39.6	40.2	40.0	40.5	40.9
8H	41.2	41.7	41.6	42.1	42.4	39.6	40.1	40.0	40.5	40.9
12H	41.2	41.6	41.6	42.0	42.4	39.6	40.1	40.0	40.4	40.8
8H 4H	41.2	41.7	41.6	42.1	42.5	39.6	40.1	40.0	40.5	40.8
6H	41.1	41.6	41.6	42.0	42.4	39.6	40.0	40.0	40.4	40.8
8H	41.1	41.5	41.6	41.9	42.4	39.5	39.9	40.0	40.3	40.8
12H	41.1	41.4	41.6	41.9	42.3	39.5	39.9	40.0	40.3	40.8
12H 4H	41.2	41.6	41.6	42.0	42.4	39.5	40.0	39.9	40.4	40.8
6H	41.1	41.5	41.5	41.9	42.3	39.5	39.9	40.0	40.3	40.8
8H	41.1	41.4	41.5	41.8	42.3	39.5	39.8	40.0	40.3	40.7
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 4.5 / - 3.4					+ 0.4 / - 0.6				
1.5H	+ 5.4 / - 4.4					+ 0.2 / - 0.3				
2.0H	+ 6.5 / - 4.2					+ 0.8 / - 0.9				

CIE Pub.117, 835.4 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.6)
Area: 1e-005 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz Lamp Flux:835.378x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	83	76	72	82	76	71	82	75	71	67
0.80	91	84	80	90	84	80	89	83	80	76
1.00	96	90	86	96	90	86	94	90	85	81
1.25	101	95	91	100	95	91	98	93	90	86
1.50	104	99	95	103	98	95	100	96	93	89
2.00	107	103	99	106	102	98	103	100	97	91
2.50	109	105	102	107	104	101	104	101	99	93
3.00	111	107	104	109	106	103	106	103	101	94
4.00	113	110	108	111	108	106	107	105	103	96
5.00	114	112	110	112	110	108	108	106	105	97
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-27

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz Lamp Flux:835.378x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

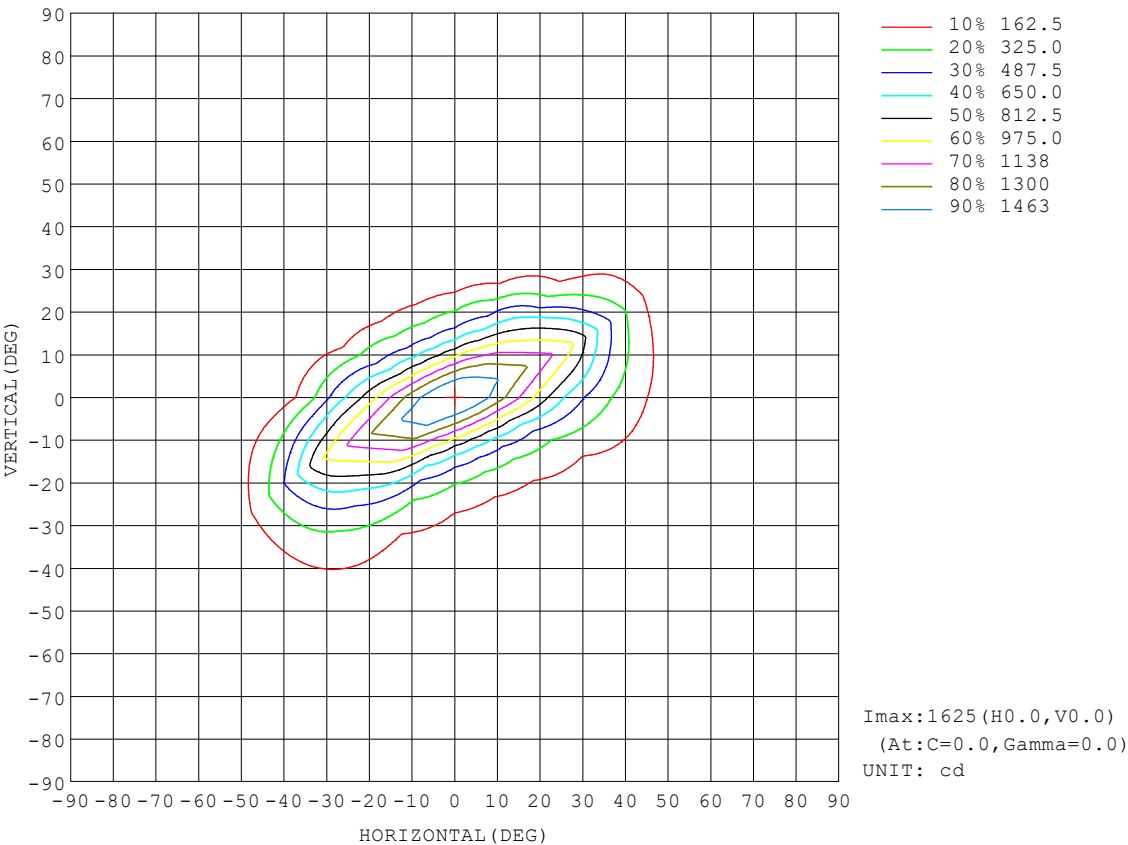

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-27	Remarks:

AAI Figure

Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz Lamp Flux:835.378x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

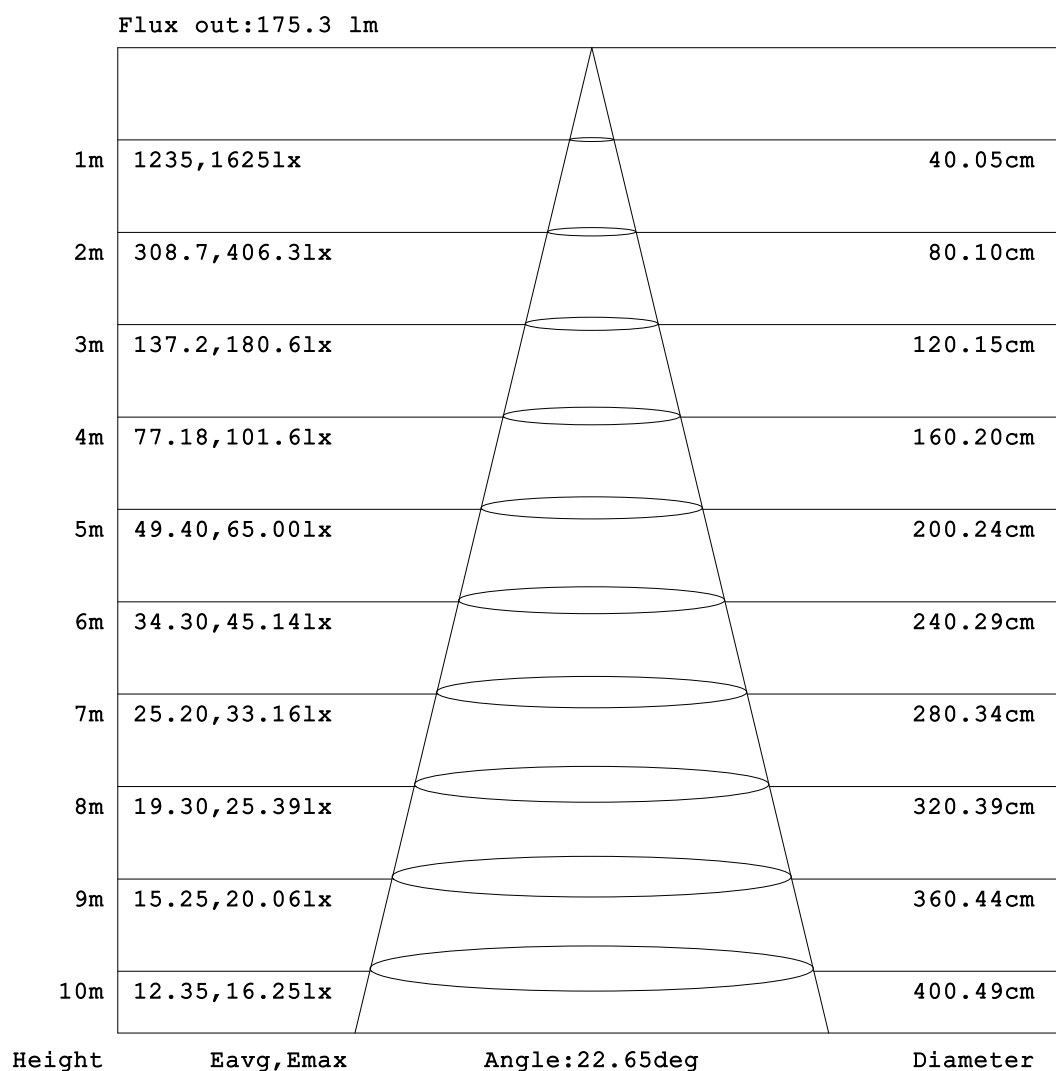


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:


ISOLUX DIAGRAM

Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz Lamp Flux:835.378x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

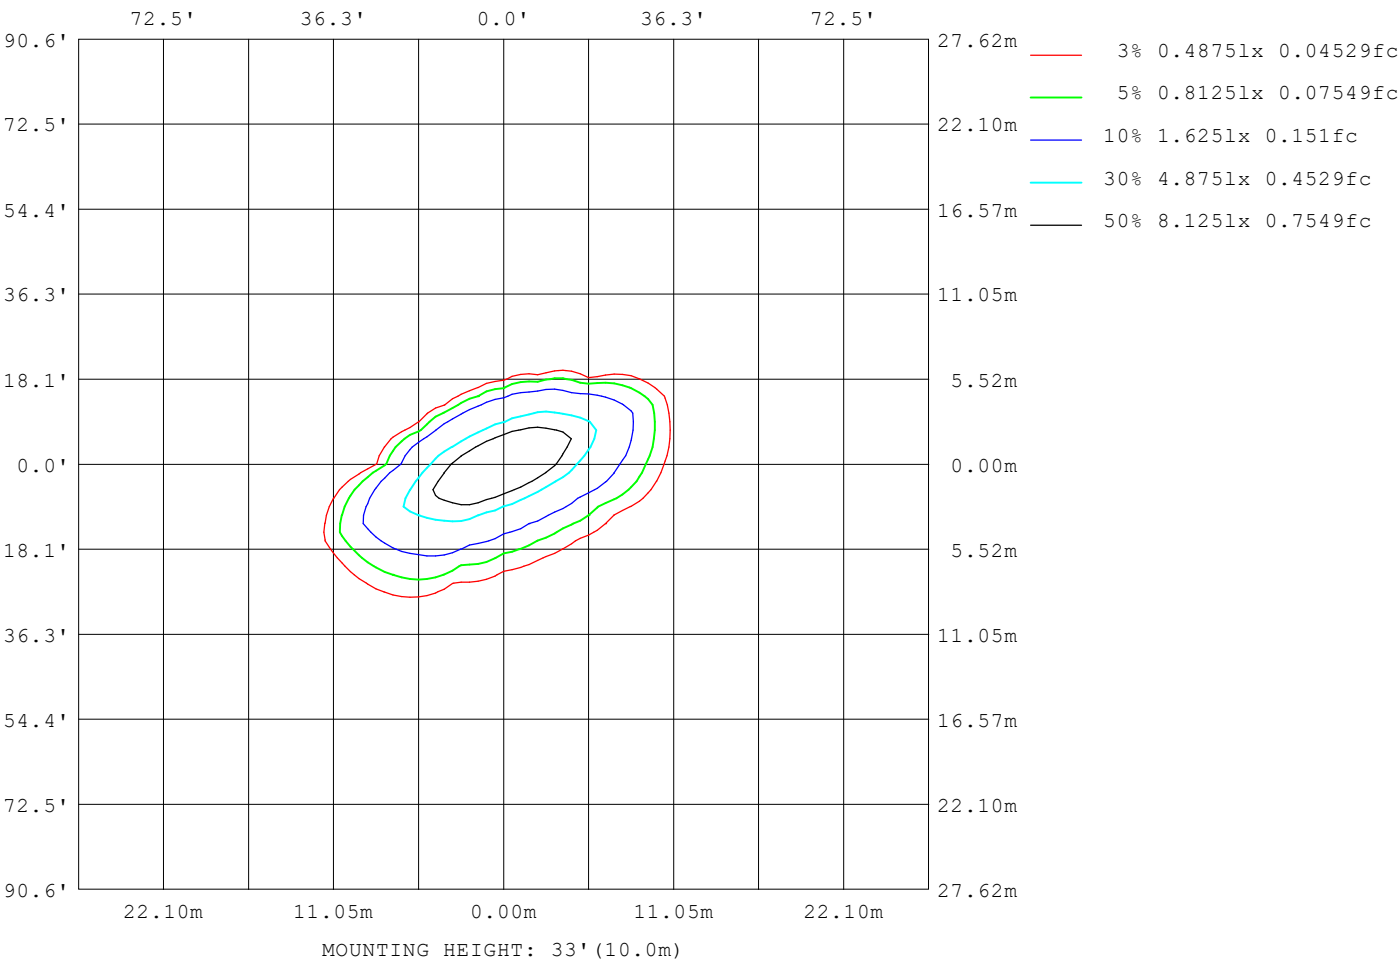

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-27	Remarks:

Planar Illuminance Curve

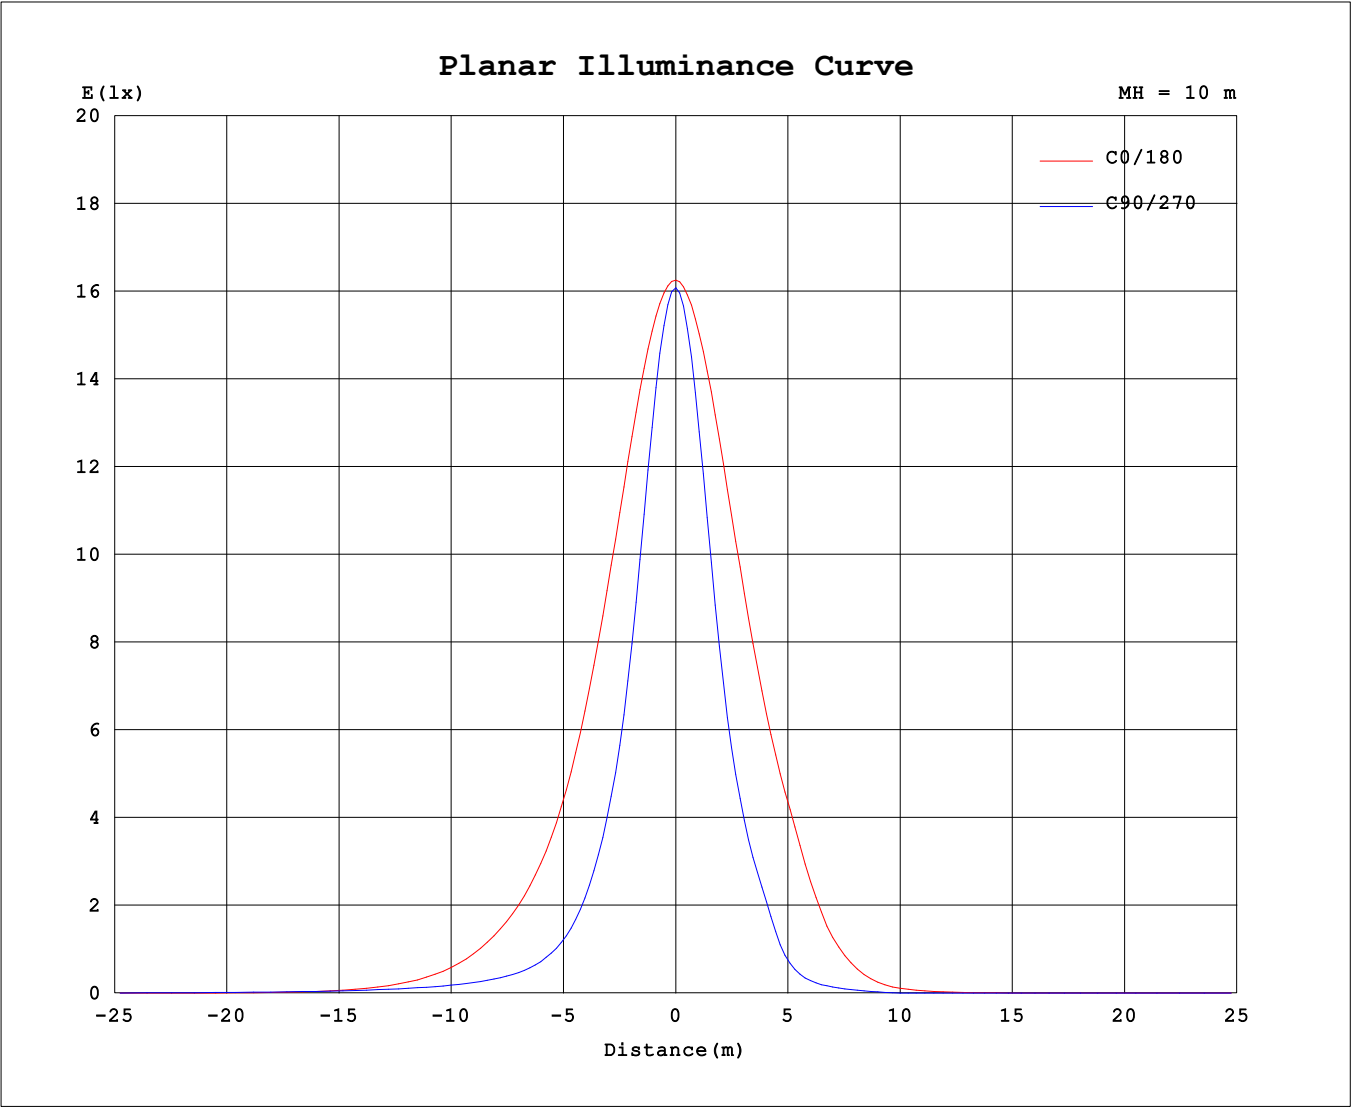

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:1.3862A P:13.800W PF:0.7509 Freq:60.03Hz Lamp Flux:835.378x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	1625	1620	1615	1611	1608	1605	1596	1597	1625	1620	1615	1611	1608	1605	1596	1597			
5	1561	1474	1393	1363	1396	1475	1573	1584	1555	1466	1386	1356	1385	1460	1514	1561			
10	1387	1114	918	858	934	1143	1439	1528	1380	1110	915	856	927	1125	1343	1486			
15	1149	741	543	495	558	782	1242	1441	1143	741	544	491	553	767	1125	1386			
20	901	483	323	284	336	518	1017	1332	895	484	323	278	332	505	898	1269			
25	678	315	190	163	199	345	799	1209	672	297	145	113	148	299	681	1142			
30	500	204	120	104	126	227	609	1079	454	120	54.5	46.6	53.6	120	404	992			
35	366	135	83.2	75.9	86.2	150	457	921	231	45.0	28.0	24.4	26.0	39.4	192	735			
40	258	92.5	63.5	59.7	65.3	103	340	673	95.5	21.4	13.6	11.3	11.9	17.0	64.5	491			
45	166	66.1	51.1	48.9	52.1	72.8	243	446	33.0	9.60	2.74	1.70	2.06	5.54	18.4	291			
50	96.4	46.9	41.5	39.9	42.2	52.9	157	257	12.1	2.18	0.16	0.00	0.04	1.00	4.67	136			
55	47.9	32.2	32.9	31.8	33.6	37.8	90.6	119	3.89	0.70	0.05	0.00	0.00	0.36	1.42	42.9			
60	18.9	20.6	24.1	24.2	25.7	25.7	44.2	34.7	1.61	0.52	0.00	0.00	0.00	0.22	0.89	2.81			
65	5.90	11.8	15.8	17.2	17.8	15.6	16.6	3.44	1.26	0.18	0.00	0.00	0.00	0.00	0.64	1.47			
70	2.42	5.60	8.95	10.5	10.6	8.20	5.14	1.90	0.85	0.00	0.00	0.00	0.00	0.00	0.16	1.21			
75	1.60	2.50	3.73	4.18	4.56	3.57	2.26	1.54	0.27	0.00	0.00	0.00	0.00	0.00	0.00	0.82			
80	1.32	1.44	1.51	1.48	1.65	1.64	1.68	1.09	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.32			
85	0.93	1.21	1.05	0.91	1.03	1.33	1.34	0.56	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
90	0.47	0.94	0.87	0.75	0.84	1.07	0.92	0.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
95	0.07	0.61	0.64	0.55	0.62	0.74	0.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
100	0.00	0.28	0.40	0.34	0.38	0.44	0.15	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
105	0.00	0.01	0.16	0.16	0.18	0.17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
110	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
130	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.10	0.08			
135	0.10	0.02	0.00	0.00	0.00	0.00	0.00	0.01	0.14	0.05	0.00	0.00	0.00	0.12	0.25	0.22			
140	0.20	0.16	0.03	0.00	0.00	0.08	0.07	0.09	0.30	0.24	0.12	0.08	0.14	0.32	0.44	0.38			
145	0.28	0.30	0.19	0.11	0.13	0.17	0.15	0.16	0.47	0.46	0.37	0.31	0.39	0.55	0.63	0.55			
150	0.34	0.38	0.32	0.25	0.23	0.23	0.20	0.20	0.62	0.65	0.63	0.61	0.67	0.77	0.81	0.69			
155	0.42	0.46	0.44	0.40	0.36	0.32	0.27	0.27	0.76	0.80	0.87	0.89	0.94	0.99	0.98	0.83			
160	0.47	0.51	0.50	0.49	0.45	0.39	0.33	0.33	0.85	0.87	0.99	1.07	1.14	1.15	1.09	0.92			
165	0.48	0.53	0.52	0.53	0.50	0.42	0.36	0.36	0.84	0.85	0.95	1.09	1.18	1.19	1.10	0.93			
170	0.51	0.55	0.56	0.57	0.53	0.49	0.45	0.44	0.84	0.84	0.89	1.02	1.11	1.13	1.05	0.91			
175	0.61	0.61	0.62	0.62	0.62	0.63	0.60	0.58	0.82	0.82	0.84	0.90	0.94	0.97	0.92	0.85			
180	0.74	0.74	0.74	0.72	0.79	0.78	0.74	0.71	0.74	0.74	0.73	0.74	0.72	0.78	0.76	0.74			

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-27

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: