


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz Lamp Flux:1641.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 64.88 lm/W
MODEL	SMART FIXTURE 2700K	Imax (cd)	3464	S/MH(C0/180)	0.34	
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	0.88	
RATED VOLTAGE(V)		TOTAL FLUX(lm)	1641.6	η UP,DN(C0-180)	0.1,55.0	
NOMINAL FLUX(lm)	1641.61	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.1,44.8	
LAMPS INSIDE	1	η up (%)	0.2	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)		η down (%)	99.8	CIBSE SHR MAX	0.30	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

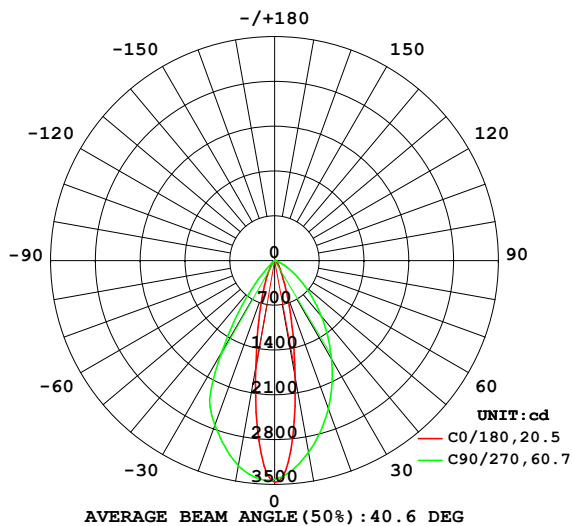

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

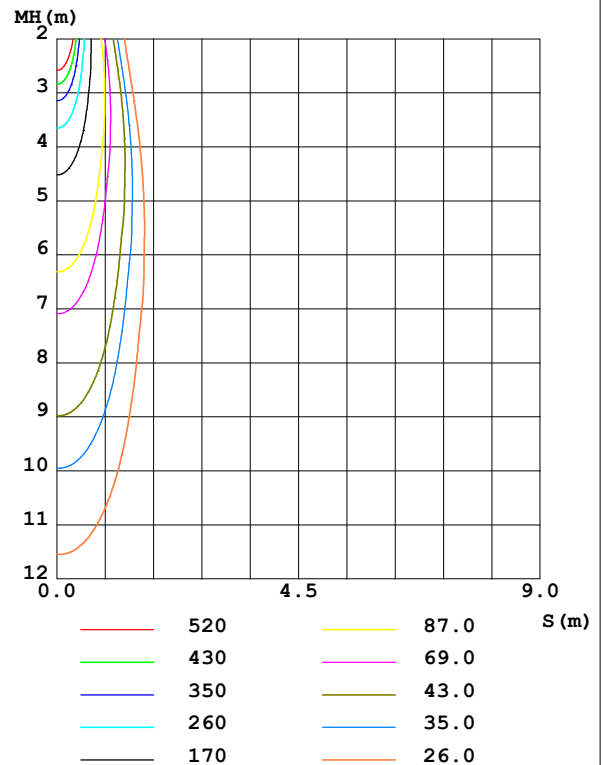

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3 °C
Operators: Allen
Test Date: 2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity: 45%
Test Distance: 2.900m [K=0.8783]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1856	2208	3047	2307	1707	2179	3254	2621	0- 10	273.0	273.0	16.6,16.6
20	592.0	884.2	2460	1034	542.3	869.7	2738	1245	10- 20	487.8	760.8	46.3,46.3
30	202.3	341.6	1784	458.5	177.1	226.8	1666	501.1	20- 30	425.4	1186	72.3,72.3
40	94.80	155.1	1140	206.9	70.13	40.98	471.3	93.58	30- 40	253.5	1440	87.7,87.7
50	42.23	84.12	619.3	76.95	26.15	2.908	1.668	10.35	40- 50	120.1	1560	95,95
60	10.04	39.40	259.6	30.56	3.430	0.1527	0	0.3864	50- 60	54.60	1614	98.3,98.3
70	1.215	12.41	63.11	7.785	0.9061	0	0	0.0003	60- 70	19.41	1634	99.5,99.5
80	0.5745	2.901	4.794	3.021	0.2053	0	0	0	70- 80	3.792	1638	99.8,99.8
90	0.0008	1.561	3.390	1.486	0	0	0	0	80- 90	1.206	1639	99.8,99.8
100	0	0.4929	1.578	0.3546	0	0	0	0	90-100	0.5854	1639	99.9,99.9
110	0	0	0.3634	0	0	0	0	0	100-110	0.1627	1640	99.9,99.9
120	0	0	0	0	0	0	0.0671	0	110-120	0.0102	1640	99.9,99.9
130	0	0	0.0824	0.0721	0	0.0759	0.3617	0.1190	120-130	0.0290	1640	99.9,99.9
140	0.1915	0.2660	0.3769	0.5499	0.3914	0.7322	0.9785	0.7466	130-140	0.2023	1640	99.9,99.9
150	0.7473	0.6030	0.5780	0.8919	1.500	1.727	1.668	1.553	140-150	0.5246	1640	99.9,99.9
160	1.213	0.9792	0.8496	1.167	2.529	2.607	2.243	2.063	150-160	0.6700	1641	100,100
170	1.390	1.150	1.047	1.275	2.487	2.572	2.266	2.019	160-170	0.4960	1641	100,100
180	1.688	1.838	1.802	1.777	1.686	1.747	1.827	1.757	170-180	0.1697	1642	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1512 lm

%lum = 92.1%

%lamp = 92.1%

Conical surface Flux(120deg): 1614.4 lm

%lum = 98.3%


%lamp = 98.3%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:Allen
 Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity:45%
 Test Distance:2.900m [K=0.8783]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz Lamp Flux:1641.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

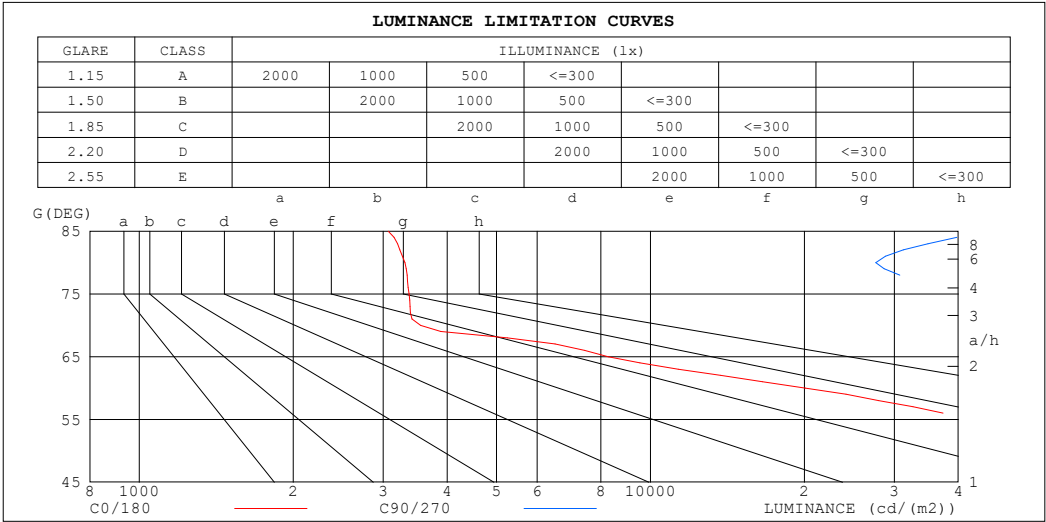

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	3071	46515
80	3308	27607
75	3372	60615
70	3551	184526
65	8267	349053
60	20084	519243
55	42199	726517
50	65696	963484
45	91067	1218618


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz		
Lamp Flux:1641.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.11	1.08	1.06	1.09	1.06	1.04	1.04	1.03	1.01	1.01	.99	.98	.97	.96	.95	.93
2.0	1.03	.99	.96	1.01	.98	.95	.98	.95	.93	.95	.93	.91	.92	.90	.89	.87
3.0	.96	.91	.87	.95	.90	.87	.92	.88	.85	.90	.87	.84	.88	.85	.83	.81
4.0	.90	.85	.81	.89	.84	.80	.87	.83	.79	.85	.81	.78	.83	.80	.77	.76
5.0	.85	.79	.75	.84	.79	.75	.82	.77	.74	.80	.76	.73	.79	.75	.73	.71
6.0	.80	.74	.70	.79	.74	.70	.78	.73	.69	.76	.72	.69	.75	.71	.68	.67
7.0	.76	.70	.66	.75	.69	.65	.74	.69	.65	.72	.68	.65	.71	.67	.64	.63
8.0	.72	.66	.62	.71	.66	.62	.70	.65	.62	.69	.64	.61	.68	.64	.61	.60
9.0	.68	.62	.59	.68	.62	.58	.67	.62	.58	.66	.61	.58	.65	.61	.58	.57
10.0	.65	.59	.56	.64	.59	.56	.64	.59	.55	.63	.58	.55	.62	.58	.55	.54

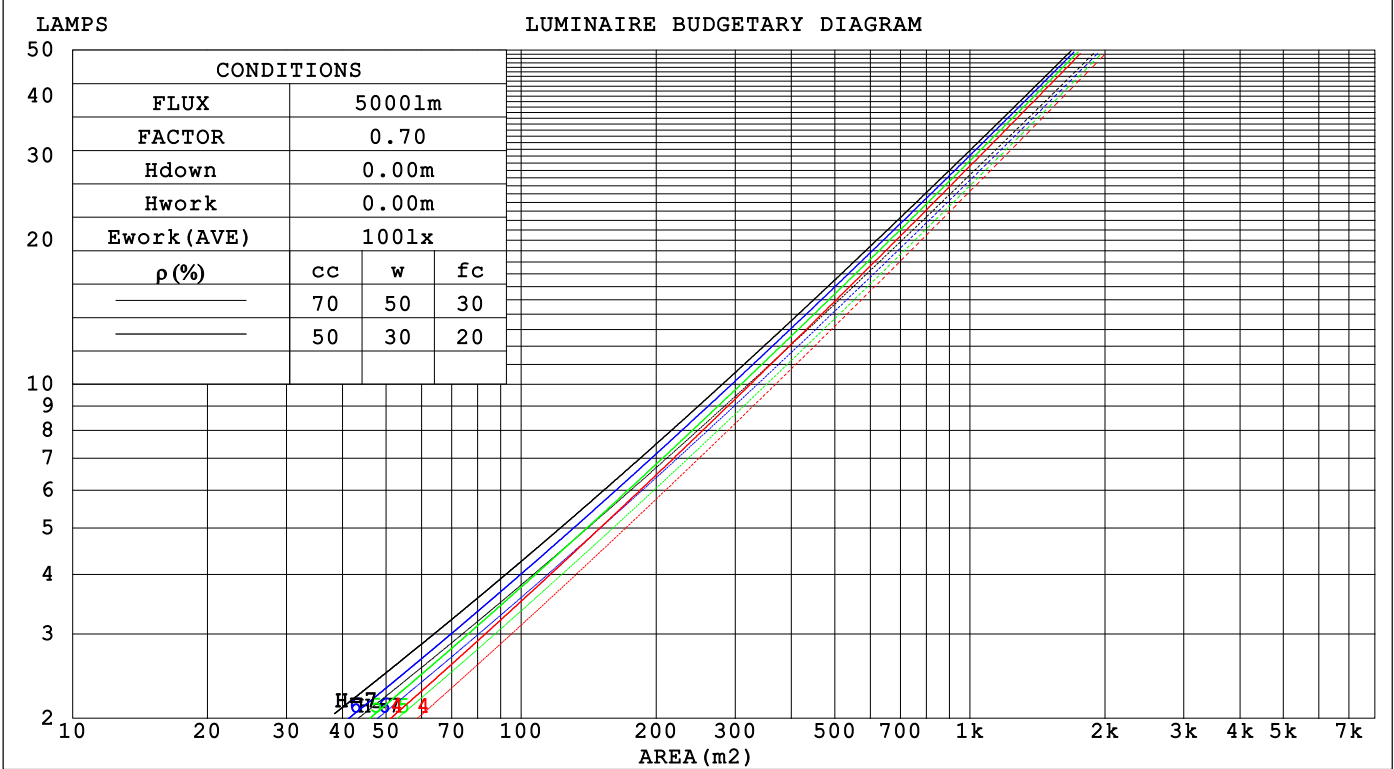

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

WEC AND CCEC

Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz Lamp Flux:1641.61x1 lm					
NAME:		TYPE:		WEIGHT:	
SPEC.:		DIM.:		SERIAL No.:	
MFR.:		SUR.:		Shielding Angle:	

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.177	.101	.032	.171	.097	.031	.158	.091	.029	.146	.084	.027	.135	.079	.025															
2.0	.170	.093	.029	.164	.090	.028	.153	.085	.026	.143	.080	.025	.134	.076	.024															
3.0	.161	.086	.026	.156	.084	.025	.147	.080	.024	.139	.076	.023	.131	.072	.022															
4.0	.153	.079	.023	.149	.078	.023	.141	.075	.022	.134	.072	.022	.127	.069	.021															
5.0	.145	.074	.021	.141	.073	.021	.135	.070	.021	.128	.068	.020	.122	.065	.020															
6.0	.138	.069	.020	.135	.068	.020	.129	.066	.019	.123	.064	.019	.118	.062	.018															
7.0	.131	.065	.018	.128	.064	.018	.123	.062	.018	.118	.061	.018	.113	.059	.017															
8.0	.125	.061	.017	.123	.060	.017	.118	.059	.017	.113	.057	.017	.109	.056	.016															
9.0	.120	.058	.016	.117	.057	.016	.113	.056	.016	.109	.055	.016	.105	.053	.015															
10.0	.114	.055	.015	.112	.054	.015	.109	.053	.015	.105	.052	.015	.102	.051	.015															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.172	.159	.146	.148	.136	.126	.101	.094	.087	.058	.054	.051	.019	.017	.016	
2.0	.157	.134	.114	.135	.115	.099	.092	.080	.069	.053	.046	.040	.017	.015	.013	
3.0	.145	.115	.091	.124	.099	.079	.085	.069	.055	.049	.040	.033	.016	.013	.011	
4.0	.134	.100	.074	.115	.087	.064	.079	.060	.045	.046	.035	.027	.015	.012	.009	
5.0	.126	.089	.061	.108	.077	.053	.074	.054	.038	.043	.031	.022	.014	.010	.007	
6.0	.118	.079	.051	.101	.069	.045	.070	.048	.032	.041	.028	.019	.013	.009	.006	
7.0	.111	.072	.044	.096	.062	.038	.066	.044	.027	.038	.026	.016	.012	.008	.005	
8.0	.105	.065	.038	.091	.057	.033	.063	.040	.023	.037	.023	.014	.012	.008	.005	
9.0	.100	.060	.033	.086	.052	.029	.060	.037	.020	.035	.022	.012	.011	.007	.004	
10.0	.095	.056	.029	.082	.048	.025	.057	.034	.018	.033	.020	.011	.011	.007	.004	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz Lamp Flux:1641.61x1 lm										
NAME:					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.:					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	20.2	21.2	20.5	21.3	21.5	31.9	32.8	32.1	33.0	33.1
3H	20.1	21.0	20.4	21.2	21.4	32.1	33.0	32.4	33.2	33.4
4H	20.1	20.9	20.3	21.1	21.3	32.1	32.9	32.3	33.1	33.3
6H	20.0	20.7	20.3	21.0	21.2	32.0	32.7	32.3	33.0	33.2
8H	19.9	20.7	20.2	20.9	21.2	31.9	32.7	32.2	32.9	33.2
12H	19.9	20.6	20.2	20.9	21.1	31.9	32.6	32.2	32.9	33.1
4H 2H	20.9	21.8	21.2	22.0	22.2	31.6	32.5	31.9	32.7	32.9
3H	20.9	21.6	21.2	21.8	22.1	31.9	32.6	32.2	32.9	33.1
4H	20.8	21.4	21.1	21.7	22.0	31.8	32.5	32.2	32.8	33.1
6H	20.7	21.3	21.1	21.6	21.9	31.7	32.3	32.1	32.6	33.0
8H	20.7	21.2	21.1	21.5	21.9	31.7	32.2	32.1	32.6	32.9
12H	20.6	21.1	21.0	21.5	21.9	31.7	32.1	32.1	32.5	32.9
8H 4H	20.8	21.3	21.2	21.7	22.0	31.7	32.2	32.1	32.6	32.9
6H	20.7	21.1	21.1	21.5	22.0	31.6	32.0	32.0	32.4	32.8
8H	20.7	21.0	21.1	21.5	21.9	31.6	31.9	32.0	32.4	32.8
12H	20.6	20.9	21.1	21.4	21.9	31.5	31.8	32.0	32.3	32.8
12H 4H	20.8	21.2	21.2	21.6	22.0	31.6	32.1	32.0	32.5	32.9
6H	20.7	21.1	21.1	21.5	21.9	31.5	31.9	32.0	32.3	32.8
8H	20.7	21.0	21.1	21.4	21.9	31.5	31.8	32.0	32.3	32.7
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.6 / - 2.9					+ 3.7 / - 3.3				
1.5H	+ 1.1 / - 2.2					+ 4.7 / - 7.1				
2.0H	+ 2.1 / - 5.2					+ 6.2 / - 8.7				

CIE Pub.117, 1642 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 1.7$)
Area: 0.001 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz Lamp Flux:1641.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	84	77	73	83	77	72	82	76	72	68
0.80	92	85	81	91	85	81	90	84	81	76
1.00	97	91	87	96	90	86	94	90	86	82
1.25	101	96	92	100	95	91	98	94	91	86
1.50	104	99	95	103	98	95	101	97	94	89
2.00	107	103	99	106	102	99	103	100	97	92
2.50	109	105	102	108	104	101	104	101	99	93
3.00	111	107	104	109	106	103	106	103	101	94
4.00	113	110	108	111	108	106	107	105	104	96
5.00	114	112	110	112	110	108	108	107	105	97
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOCANDELA DIAGRAM


Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz Lamp Flux:1641.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

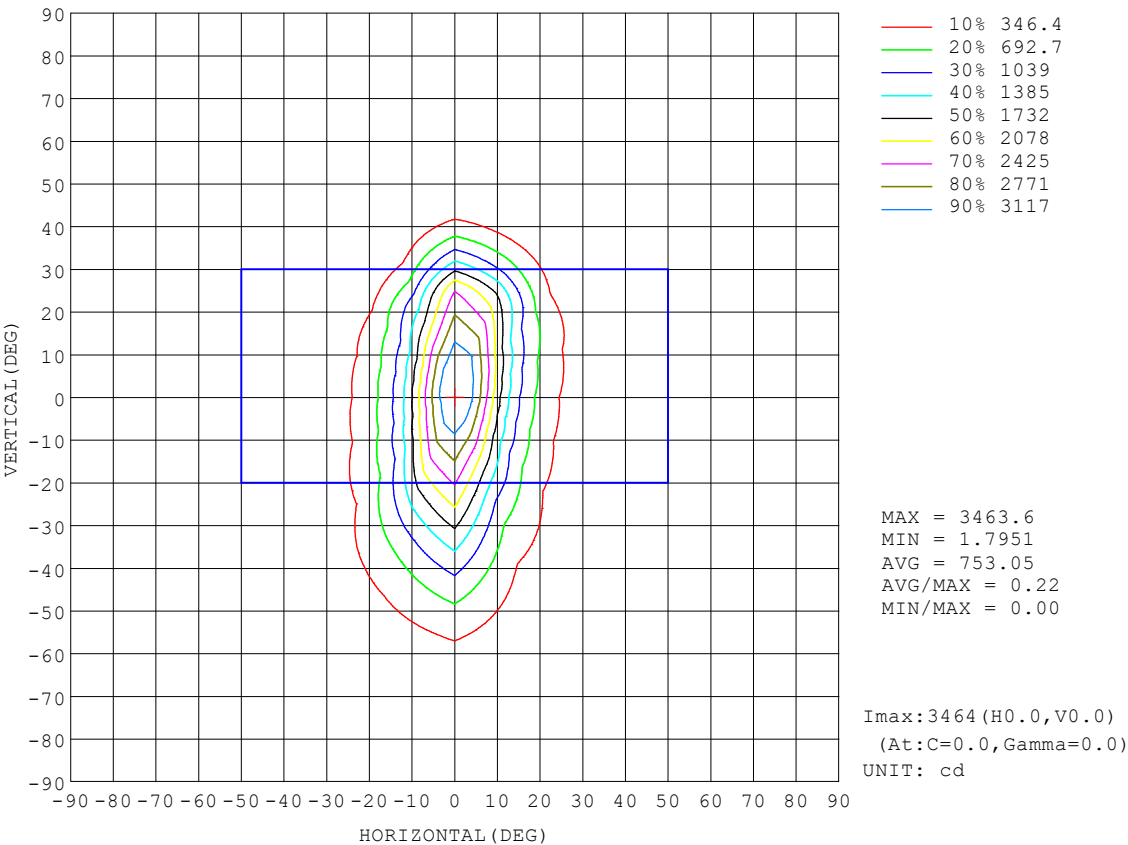

C Range: 0 - 360DEG	γ Range: 0 - 180DEG
C Interval: 22.5DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Temperature:25.3℃	Humidity:45%
Operators:Allen	Test Distance:2.900m [K=0.8783]
Test Date:2026-01-29	Remarks:

AAI Figure

Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz Lamp Flux:1641.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

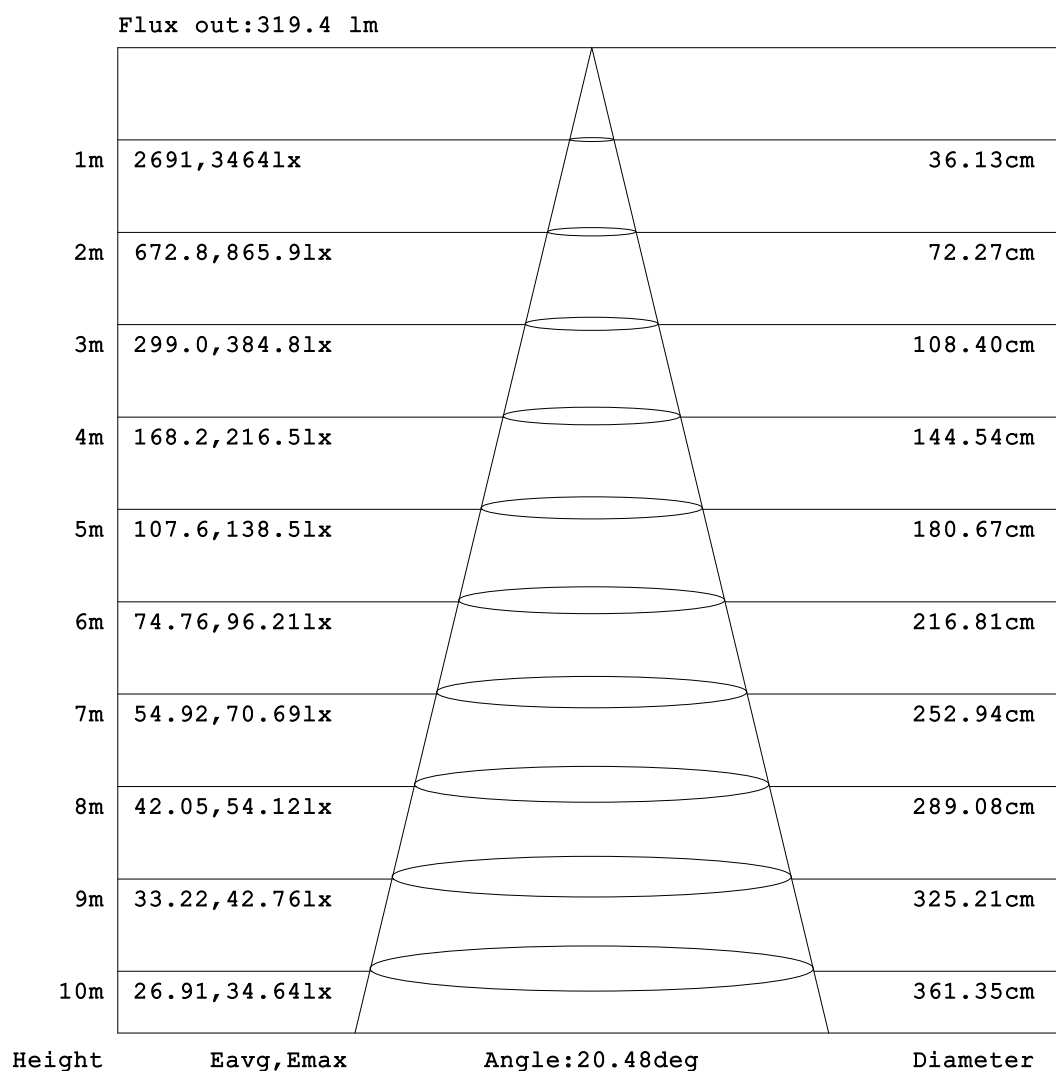


C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3℃
 Operators: Allen
 Test Date: 2026-01-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-R5000_V2 SYSTEM V2.00.459
 Humidity: 45%
 Test Distance: 2.900m [K=0.8783]
 Remarks:

ISOLUX DIAGRAM


Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz Lamp Flux:1641.61x1 lm		
NAME:	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

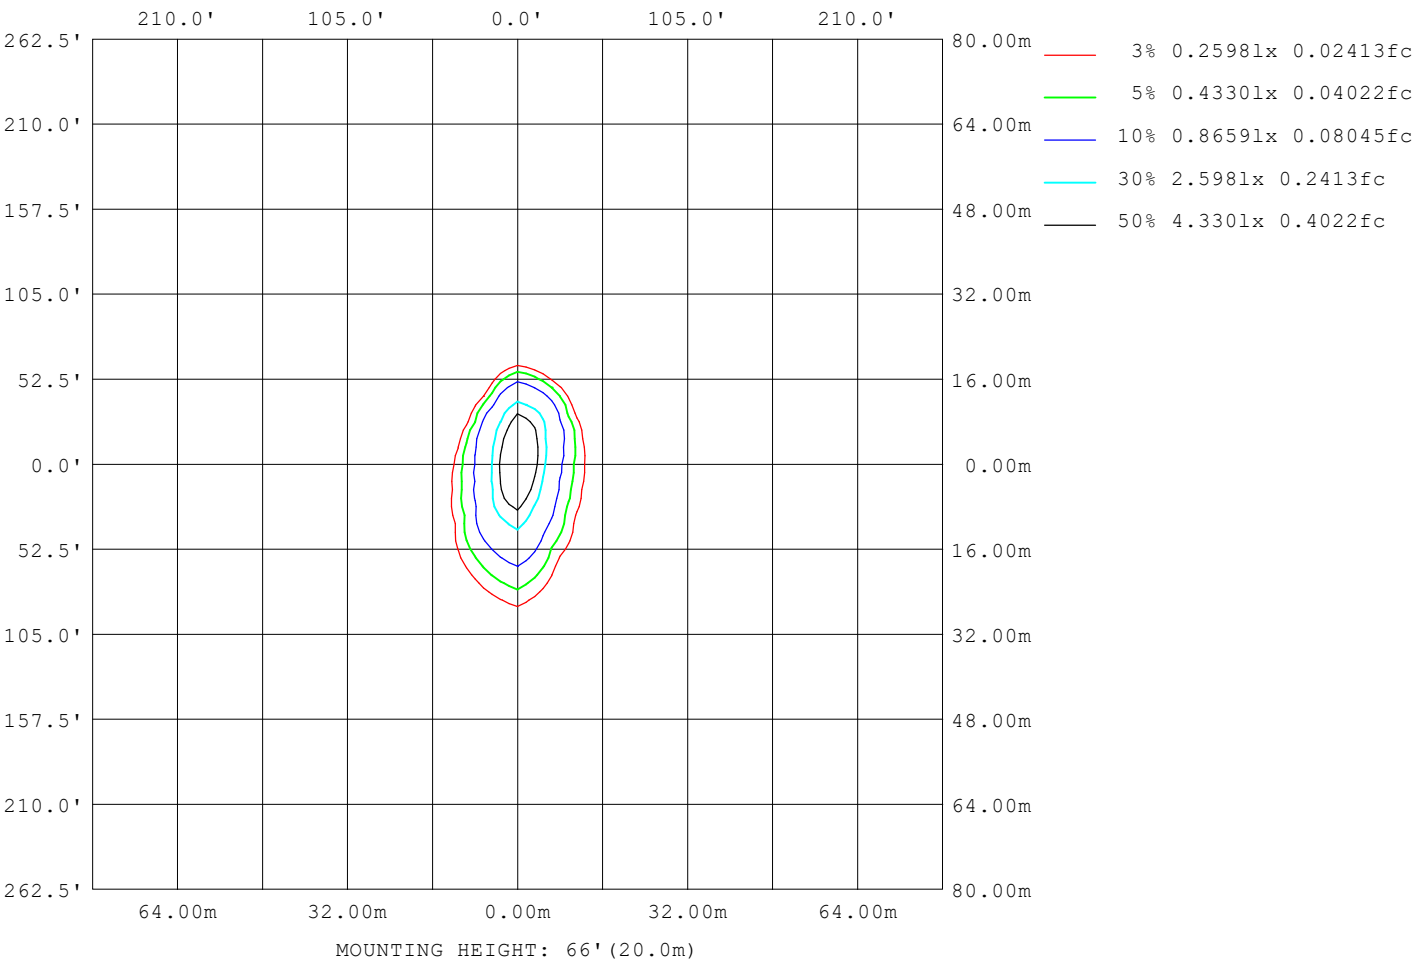

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

Planar Illuminance Curve

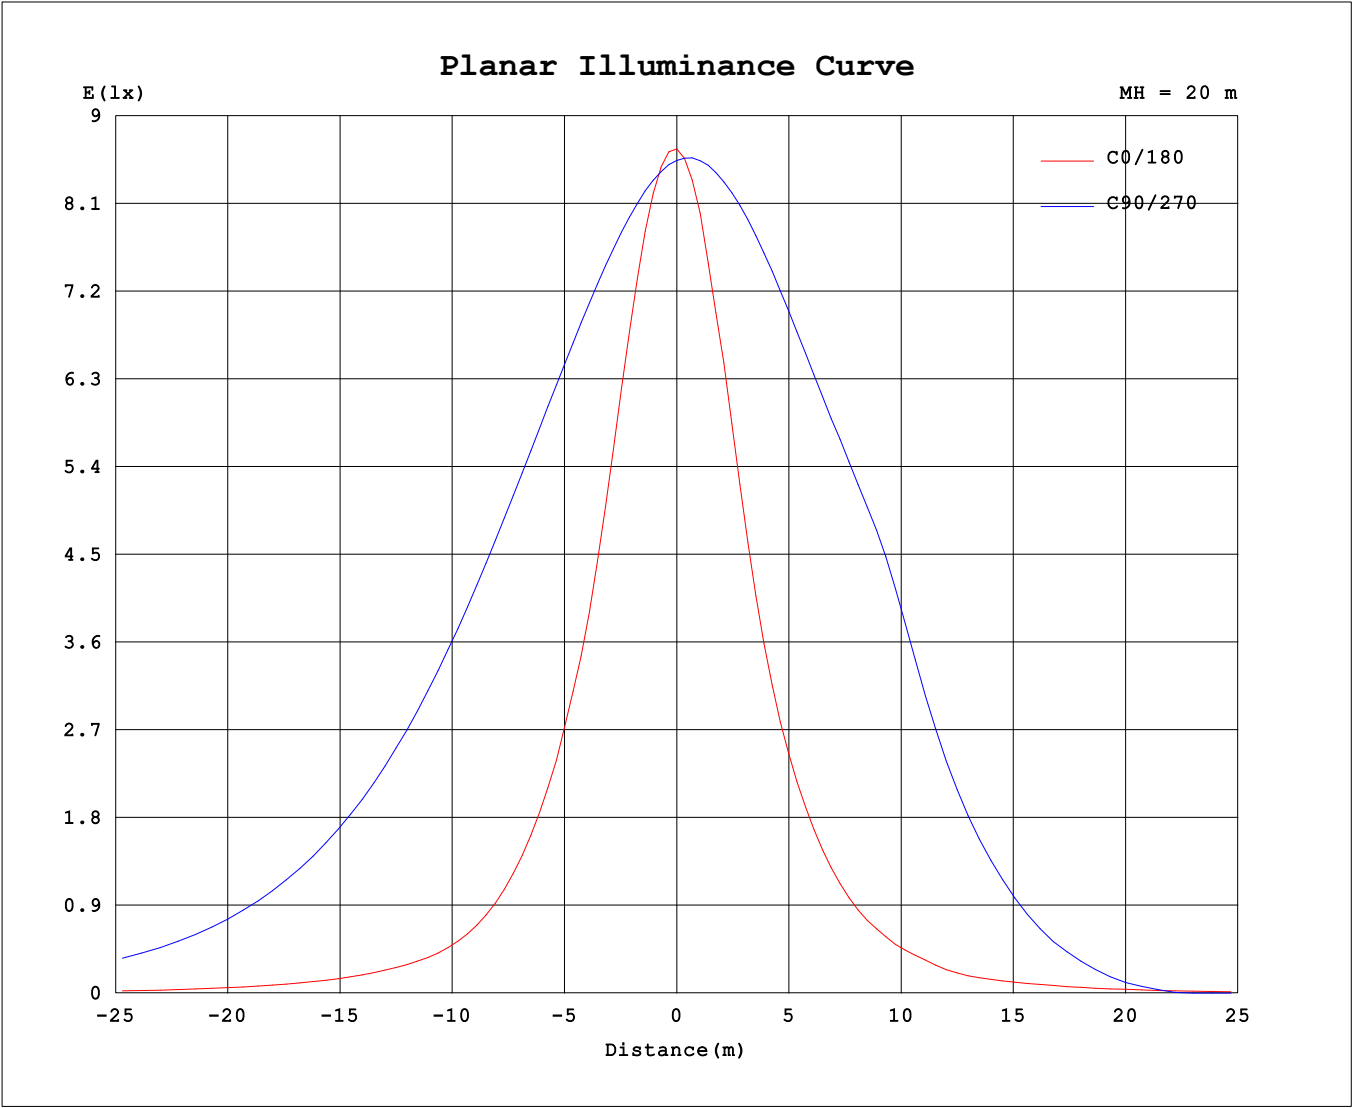

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:12.000V I:2.6691A P:25.304W PF:0.8296 Freq:60.01Hz Lamp Flux:1641.61x1 lm																	
NAME:									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.:									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

γ (DEG)	C (DEG)																
	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5	
0	3464	3446	3435	3425	3417	3411	3406	3404	3464	3446	3435	3425	3417	3411	3406	3404	
5	2969	2958	3067	3208	3279	3214	3039	2857	2824	2884	3063	3276	3406	3387	3240	3057	
10	1856	1887	2208	2719	3047	2865	2307	1836	1707	1792	2179	2804	3254	3150	2621	2103	
15	1061	1091	1401	2121	2770	2440	1564	1080	964	1031	1369	2188	3012	2775	1850	1272	
20	592	624	884	1556	2460	1992	1034	646	542	594	870	1609	2738	2324	1245	770	
25	327	352	550	1106	2129	1565	691	383	311	340	531	1130	2405	1865	848	447	
30	202	217	342	782	1784	1188	459	238	177	157	227	595	1666	1197	501	260	
35	137	153	222	551	1448	878	306	150	104	86.4	91.9	247	993	638	233	137	
40	94.8	114	155	382	1140	635	207	96.8	70.1	50.6	41.0	70.0	471	260	93.6	80.7	
45	64.4	85.1	114	261	862	451	128	68.0	44.8	28.1	16.2	12.8	123	59.4	35.7	46.9	
50	42.2	59.6	84.1	177	619	311	77.0	44.9	26.2	10.5	2.91	0.91	1.67	2.95	10.4	25.6	
55	24.2	40.9	60.3	119	417	198	49.8	28.0	10.7	2.58	0.21	0.00	0.00	0.09	1.98	9.90	
60	10.0	24.7	39.4	75.0	260	102	30.6	14.2	3.43	0.60	0.15	0.00	0.00	0.05	0.39	2.90	
65	3.49	11.6	24.0	42.0	148	45.6	16.9	5.36	1.25	0.44	0.00	0.00	0.00	0.00	0.29	0.82	
70	1.21	4.35	12.4	20.7	63.1	17.6	7.78	2.55	0.91	0.19	0.00	0.00	0.00	0.00	0.00	0.64	
75	0.87	1.92	5.12	9.32	15.7	7.41	4.00	1.78	0.57	0.00	0.00	0.00	0.00	0.00	0.00	0.38	
80	0.57	1.32	2.90	4.43	4.79	4.31	3.02	1.24	0.21	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
85	0.27	0.89	2.23	3.63	4.05	3.68	2.24	0.73	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
90	0.00	0.51	1.56	2.89	3.39	2.82	1.49	0.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
95	0.00	0.21	0.96	2.02	2.46	1.91	0.83	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
100	0.00	0.00	0.49	1.25	1.58	1.15	0.35	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
105	0.00	0.00	0.16	0.65	0.87	0.56	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
110	0.00	0.00	0.00	0.22	0.36	0.14	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
115	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.00	0.00	0.00	
120	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.07	0.02	0.00	0.00	
125	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.12	0.17	0.11	0.00	0.00	
130	0.00	0.00	0.00	0.01	0.08	0.14	0.07	0.00	0.00	0.00	0.08	0.33	0.36	0.28	0.12	0.00	
135	0.00	0.00	0.06	0.14	0.20	0.29	0.28	0.09	0.09	0.13	0.33	0.63	0.64	0.54	0.38	0.13	
140	0.19	0.17	0.27	0.33	0.38	0.48	0.55	0.37	0.39	0.45	0.73	1.01	0.98	0.87	0.75	0.46	
145	0.48	0.43	0.46	0.46	0.50	0.62	0.78	0.69	0.89	0.96	1.22	1.43	1.34	1.23	1.18	0.96	
150	0.75	0.65	0.60	0.56	0.58	0.71	0.89	0.93	1.50	1.56	1.73	1.82	1.67	1.54	1.55	1.50	
155	1.04	0.91	0.81	0.75	0.74	0.87	1.06	1.14	2.10	2.16	2.22	2.21	1.99	1.83	1.88	2.00	
160	1.21	1.10	0.98	0.88	0.85	0.99	1.17	1.25	2.53	2.57	2.61	2.52	2.24	2.03	2.06	2.25	
165	1.30	1.22	1.06	0.94	0.89	1.03	1.21	1.31	2.62	2.65	2.70	2.59	2.30	2.06	2.04	2.21	
170	1.39	1.30	1.15	1.09	1.05	1.11	1.28	1.40	2.49	2.49	2.57	2.50	2.27	2.06	2.02	2.13	
175	1.48	1.45	1.45	1.47	1.44	1.41	1.44	1.52	2.15	2.15	2.23	2.25	2.13	2.00	1.97	2.02	
180	1.69	1.75	1.84	1.83	1.80	1.77	1.78	1.82	1.69	1.69	1.75	1.83	1.83	1.79	1.76	1.77	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Allen
Test Date:2026-01-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-R5000_V2 SYSTEM V2.00.459
Humidity:45%
Test Distance:2.900m [K=0.8783]
Remarks: