

Report File Name: 07000178.pac Date of Report: 29/04/2021 Time of Report: 12:35:00

LightID	AVG(cd)	Max(cd)	%ICAO	Distance	Color	Result
1	13.56000	21.75	0	0.68	R	Pass
2	16.02625	20.53	0	1.58	Υ	Pass
3	14.66125	20.58	0	1.70	R	Pass
4	16.29250	21.98	0	0.96	W	Pass
5	15.43875	21.13	0	1.08	G	Pass
6	14.85125	21.60	0	0.70	R	Fail
7	14.07000	18.93	0	1.57	R	Pass
8	16.70250	21.22	0	1.77	R	Pass
9	14.92625	21.21	0	1.39	Υ	Pass
10	13.51000	18.26	0	1.15	Υ	Pass
11	15.93500	20.94	0	0.70	W	Pass
12	16.03625	21.10	0	1.80	G	Pass
13	16.04250	21.62	0	1.36	R	Pass
14	15.22875	21.55	0	1.71	W	Pass
15	13.28625	18.70	0	0.91	Υ	Pass

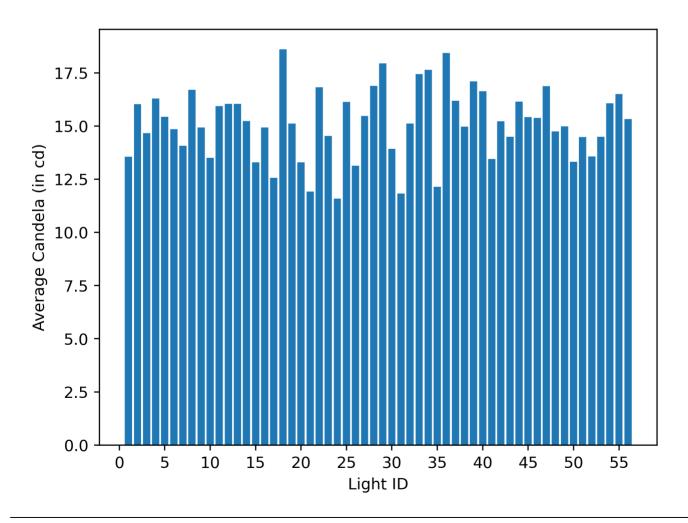


Report File Name: 07000178.pac Date of Report: 29/04/2021 Time of Report: 12:35:00

LightID	AVG(cd)	Max(cd)	%ICAO	Distance	Color	Result
16	14.93500	20.31	0	1.11	Υ	Pass
17	12.56875	19.41	0	0.89	G	Pass
18	18.60750	21.74	0	1.31	Υ	Pass
19	15.11000	21.90	0	1.28	R	Pass
20	13.29875	19.76	0	1.60	Υ	Pass
21	11.91250	14.53	0	0.62	R	Pass
22	16.82250	21.43	0	1.41	W	Pass
23	14.53125	21.70	0	0.66	G	Pass
24	11.58750	16.47	0	1.35	G	Pass
25	16.13125	21.30	0	1.54	W	Pass
26	13.14000	21.66	0	1.48	R	Pass
27	15.47750	21.39	0	0.79	G	Fail
28	16.89125	21.56	0	1.61	G	Pass
29	17.93750	20.54	0	1.07	G	Pass
30	13.93250	19.28	0	0.53	W	Pass

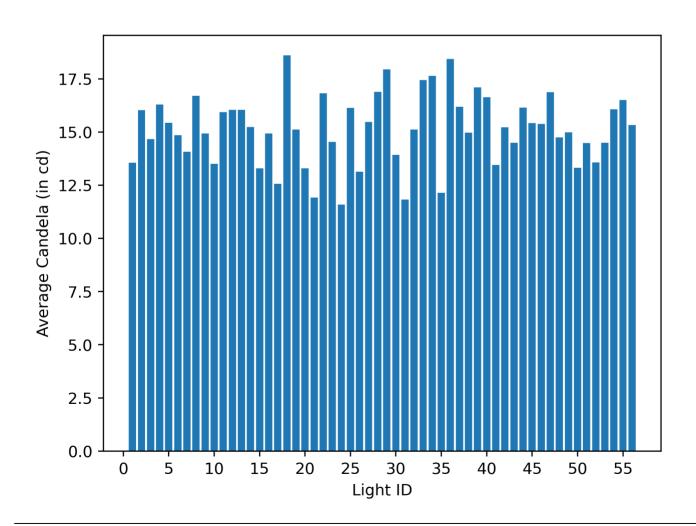

Report File Name: 07000178.pac Date of Report: 29/04/2021 Time of Report: 12:35:00

LightID	AVG(cd)	Max(cd)	%ICAO	Distance	Color	Result
31	11.82250	18.88	0	0.98	G	Pass
32	15.12125	19.97	0	0.81	W	Pass
33	17.44000	21.37	0	0.97	Υ	Pass
34	17.64125	21.76	0	0.63	W	Pass
35	12.14250	21.69	0	1.49	G	Pass
36	18.43750	21.69	0	0.94	G	Pass
37	16.18125	20.23	0	1.50	G	Fail
38	14.96500	20.67	0	0.92	W	Pass
39	17.09375	21.66	0	0.62	W	Pass
40	16.63500	21.34	0	0.89	G	Pass
41	13.45000	21.17	0	1.33	W	Pass
42	15.22750	21.46	0	1.41	R	Pass
43	14.49125	21.37	0	1.21	R	Pass
44	16.14750	21.37	0	1.53	G	Pass
45	15.41875	20.58	0	1.27	G	Fail

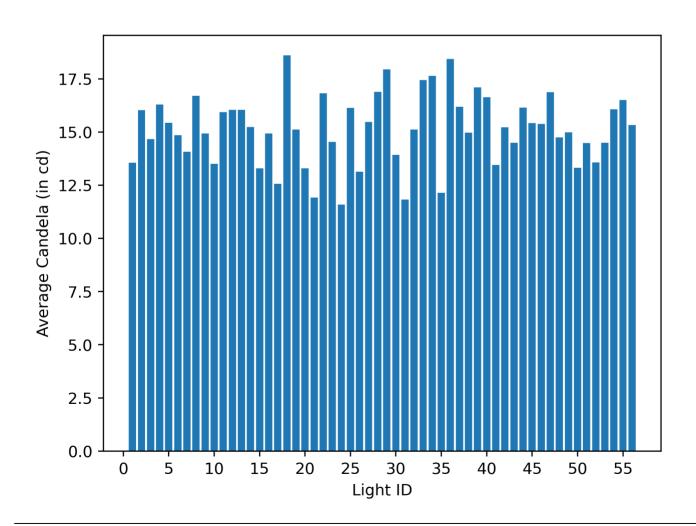

Report File Name: 07000178.pac Date of Report: 29/04/2021 Time of Report: 12:35:00

LightID	AVG(cd)	Max(cd)	%ICAO	Distance	Color	Result
46	15.38125	21.81	0	1.40	Υ	Pass
47	16.87875	21.86	0	1.63	G	Pass
48	14.75125	19.62	0	1.49	W	Pass
49	14.98750	21.13	0	0.92	G	Pass
50	13.32000	18.30	0	1.43	R	Fail
51	14.47500	19.36	0	1.00	Υ	Pass
52	13.57375	18.46	0	0.73	Υ	Pass
53	14.49250	20.73	0	1.68	Υ	Pass
54	16.07125	19.70	0	0.52	Υ	Pass
55	16.50250	21.61	0	1.06	Υ	Pass
56	15.32125	20.18	0	1.22	R	Pass

