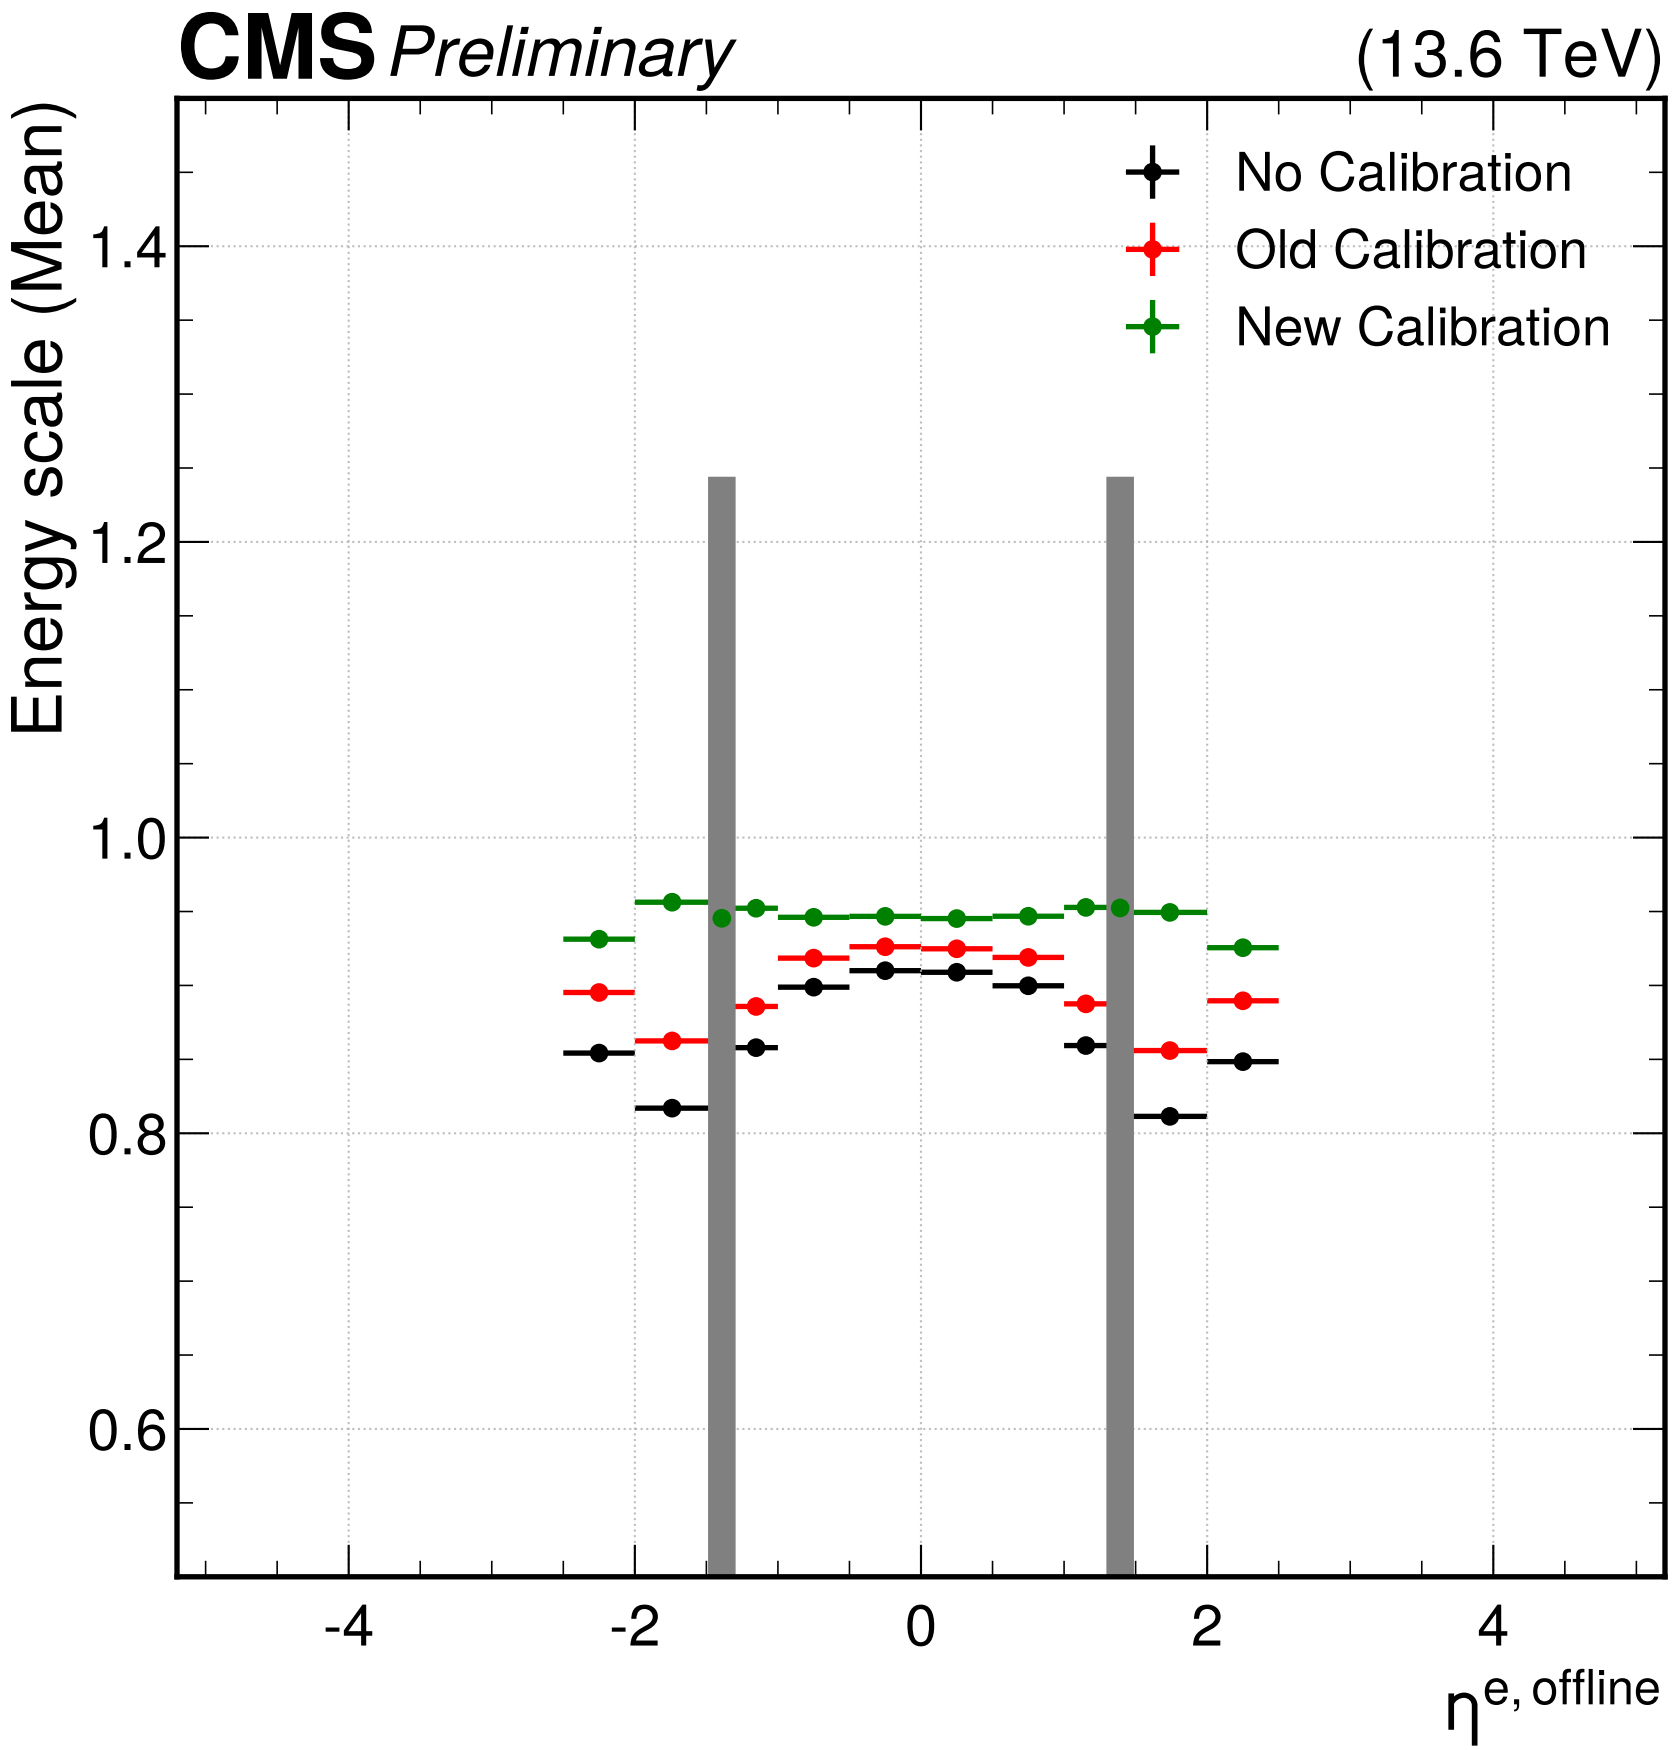
CMS Preliminary
(13.6 TeV)
No Calibration
Old Calibration
New Calibration
Energy scale (Mean)
1.4
1.2
1.0
0.8
0.6
-4
-2
0
2
4
$\eta^{e,\,offline}$