


GENERAL ARRANGEMENT DRAWING - COOLING TOWER CELL FAN (CT-7801)

Type: Induced Draft Cooling Tower Fan | Area 7800 - COOLING WATER SYSTEM

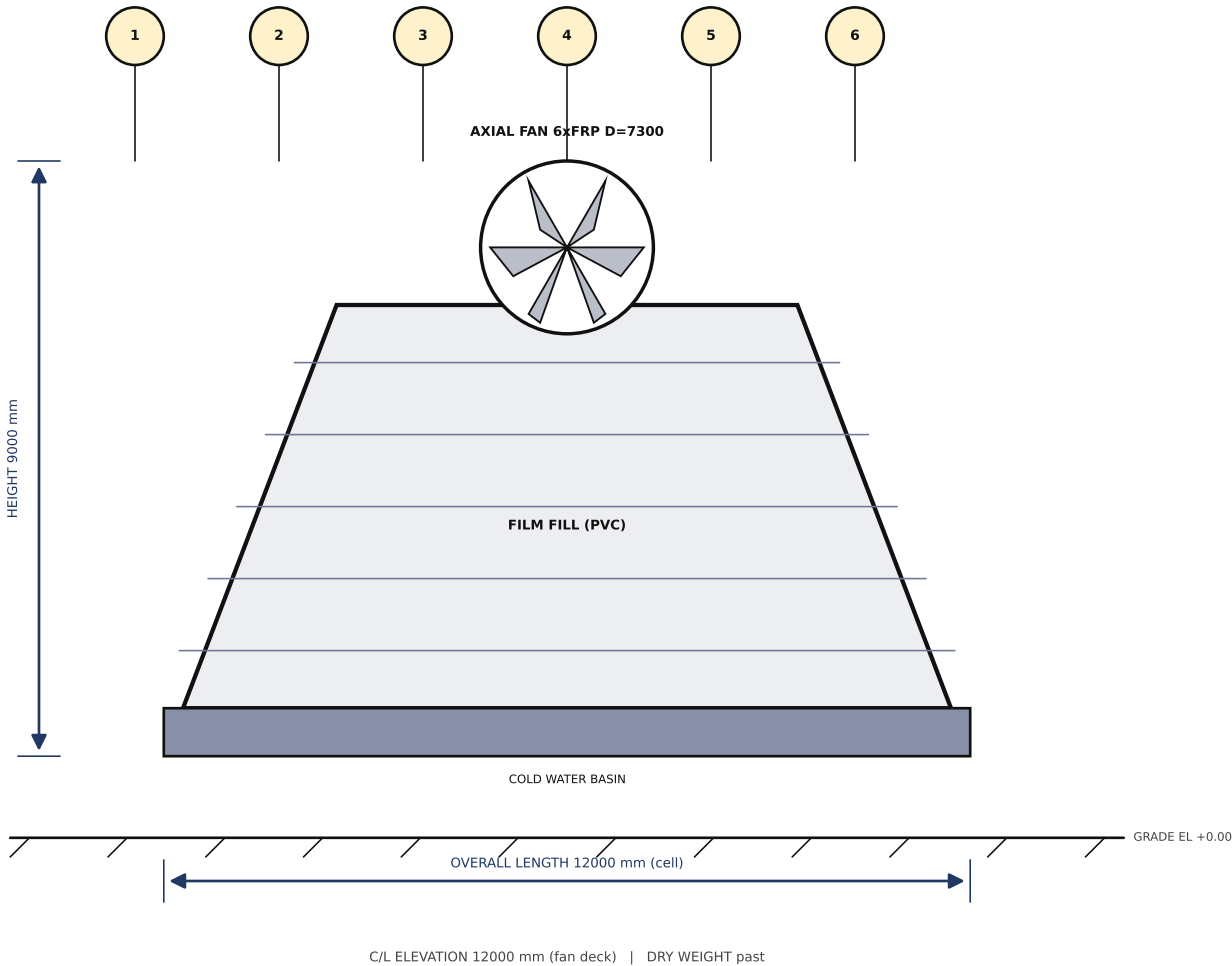

NOZZLE / CONNECTION SCHEDULE

MARK	SERVICE	SIZE-RATING	FACE	REMARKS
N1	HOT WATER IN	24"	FLG	Warm return header
N2	COLD WATER OUT	30"	FLG	From cold basin
N3	MAKE-UP	6"	FLG	Make-up water
N4	BLOWDOWN	4"	FLG	Blowdown

BILL OF MATERIAL

No	PART NAME	MATERIAL	QTY
1	FAN BLADE (FRP)	GRP	6
2	FAN HUB	CAST ALUMINIUM	1
3	GEARBOX (RIGHT ANGLE)	CAST IRON	1
4	FLOATING DRIVE SHAFT	COMPOSITE	1
5	MOTOR	TECO 55kW	1
6	FAN DECK / STACK	FRP	1
7	DRIFT ELIMINATOR	PVC	1 set
8	FILM FILL	PVC	1 set
9	GEARBOX OIL SEAL	NBR	2
10	FAN BEARING	SPHERICAL ROLLER	2
11	VIBRATION SWITCH	-	1
12	BARSCREEN	SS304	1

NOTES:

- MATERIAL OF CONSTRUCTION PER WPN-MAT-001.
- SURFACE PREP & PAINTING PER WPN-PAINT-001.
- ALL DIMENSIONS IN mm UNLESS NOTED.
- WEIGHTS ARE ESTIMATED (DRY / ERECTION).
- FOR NOZZLE LOADS REFER TO VENDOR DRAWING.
- ASSOC DOCS: P&ID TJC-LLD-PID-7801, INTERLOCK SEQ-7801.

REVISION HISTORY

REV	DESCRIPTION	BY	DATE
A	ISSUED FOR REVIEW	RS	15-05-2026
B	ISSUED FOR APPROVAL	RS	27-05-2026
D	ISSUED FOR CONSTRUCTION	RS	05-06-2026

This is sample data provided

for CALIBER purposes only

TITLE:
GENERAL ARRANGEMENT DRAWING

COOLING TOWER CELL FAN - Induced Draft Cooling Tower Fan

DWG No.
TJC-LLD-GA-CT-7801

REV: 0
SHEET 1 OF 1