


PLOT PLAN - LINEAR LOW DENSITY POLYETHYLENE (LLDPE) UNIT

Unit Layout at Grade | Highlighted: CT-7801 - COOLING TOWER CELL FAN (Area 7800)

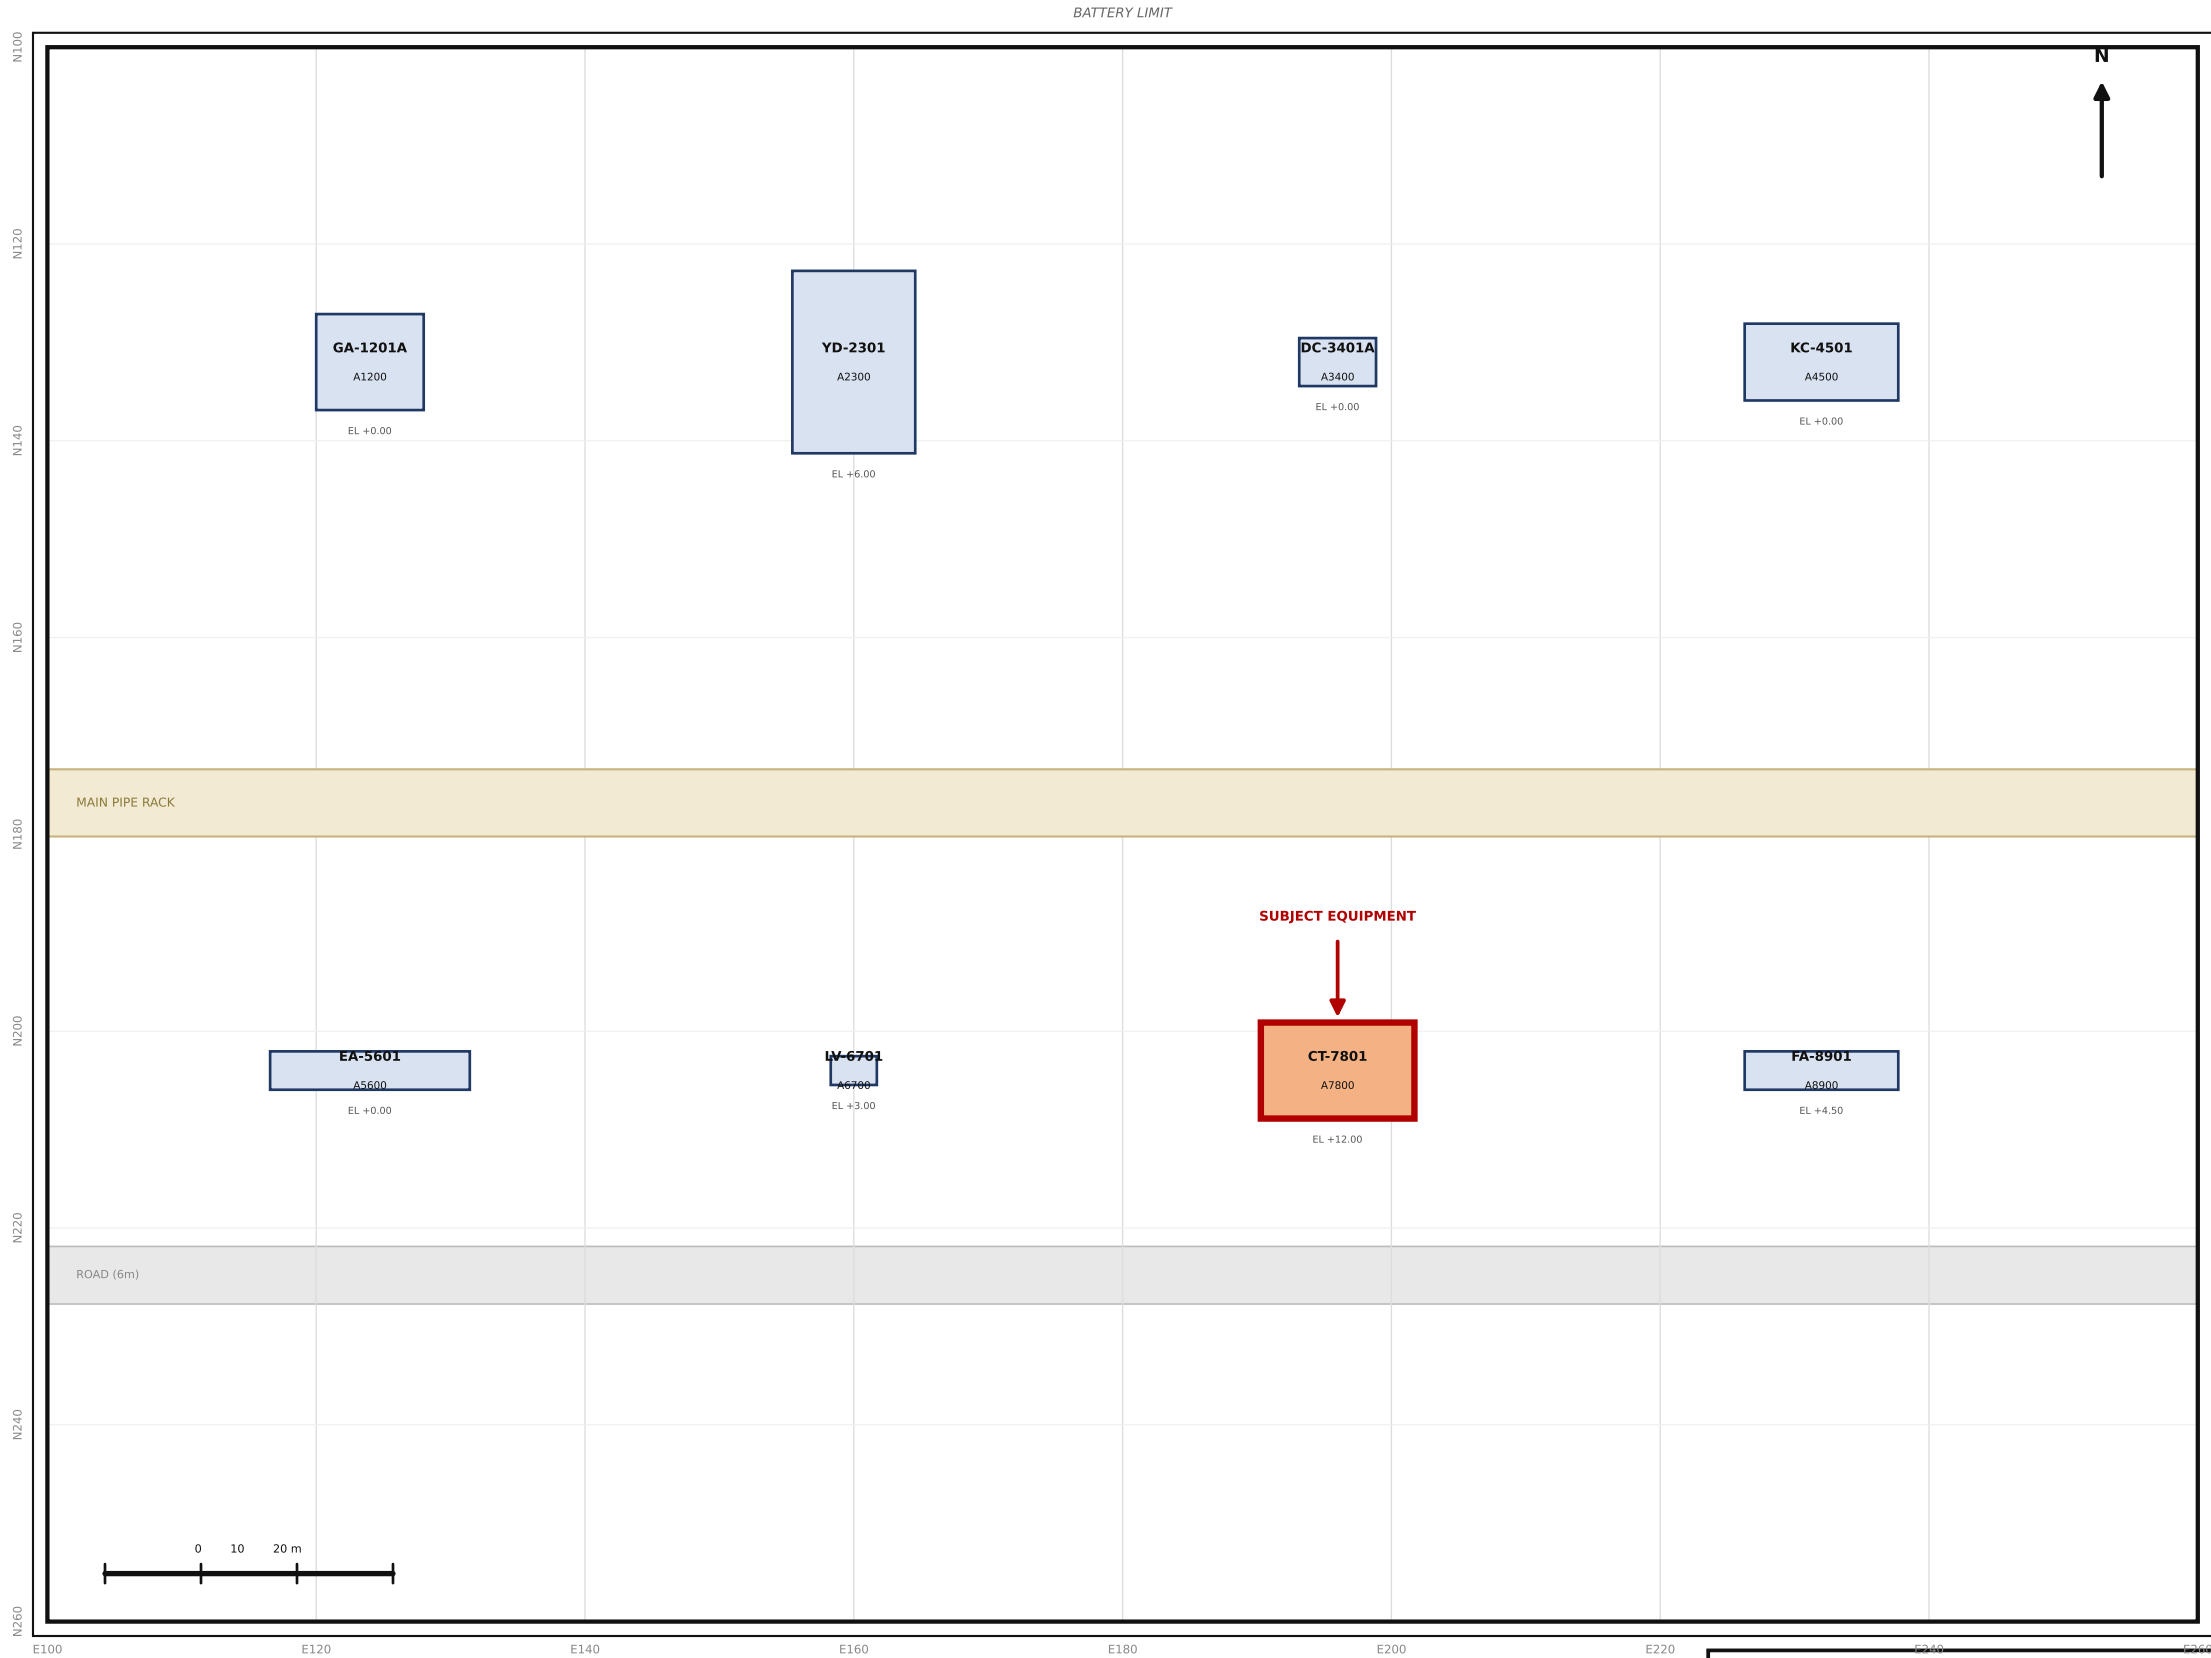

EQUIPMENT LOCATION DETAIL

TAG	CT-7801
EQUIPMENT	COOLING TOWER CELL FAN
AREA	7800 - COOLING WATER SYSTEM
GRID REF	G-2
ELEVATION	EL +12.00
FUNCTIONAL LOC.	TJC-LLD-7800-01
FOOTPRINT	5.0 x 5.0 m (approx)

AREA LEGEND

	1200 - FEED PREPARATION & PURIFICATION
	2300 - POLYMER SEPARATION & DRYING
	3400 - CATALYST PREPARATION
	4500 - GAS RECOVERY & COMPRESSION
	5600 - SOLVENT RECOVERY SYSTEM
	6700 - PRODUCT SEPARATION
	7800 - COOLING WATER SYSTEM
	8900 - SOLVENT FRACTIONATION

NOTES:

- COORDINATES IN PLANT GRID (E/N), METRES.
- ELEVATIONS RELATIVE TO GRADE EL +0.00.
- EQUIPMENT SHOWN AT APPROX FOOTPRINT SCALE.
- REFER TO GA DRAWINGS FOR DETAIL.
- HAZARDOUS AREA CLASSIFICATION PER WPN-MAT-001.

REVISION HISTORY

REV	DESCRIPTION	BY	DATE
A	ISSUED FOR REVIEW	RS	15-05-2026
B	ISSUED FOR APPROVAL	RS	27-05-2026
D	ISSUED FOR CONSTRUCTION	RS	05-06-2026

PT Wangsa Petrokimia Nusantara

Talang Jaya Petrochemical Complex - SDK Polyolefin Expansion Project

DUMMY / TRAINING - FICTIONAL DATA (KNOWLEDGE HUB)

TITLE:
PLOT PLAN / EQUIPMENT LOCATION

AREA 7800 - COOLING TOWER SYSTEM
ENG BY: NIPPO ENGINEERING CORPORATION - TOKYO, JAPAN

DWG No.
TJC-LLD-PP-CT-7801

REV: 0
SHEET 1 OF 1