(wafer2,0,1,-1,-1,2,2) Plots and Summary

- Cell Size = 10um

- Number of Times Accessed = 22

- Last Stimulated = 2022/March/17 at 04:12:31PM

Stimulated at 03:30:18PM on 2022/March/17

Activity = reset

Start Voltage = 0V

End Voltage = -3V

Ramp Rate = 1V/s


Compliance Current = 6.0mA


Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Successfully reset

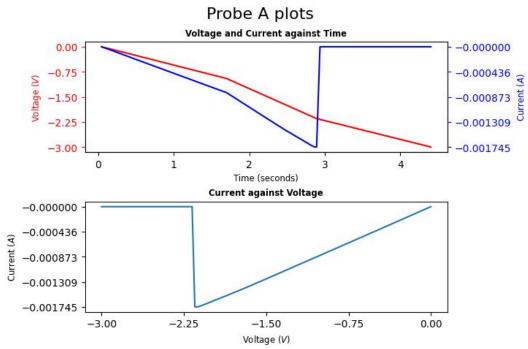

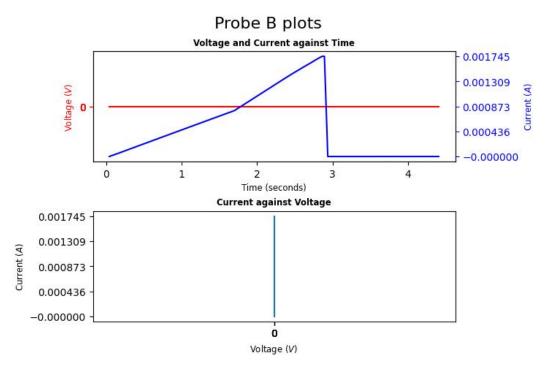

Stimulated at 03:31:47PM on 2022/March/17

Activity = set

Start Voltage = 0V

End Voltage = 5V

Ramp Rate = 1V/s


Compliance Current = 20.0uA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Set at 3.1 V

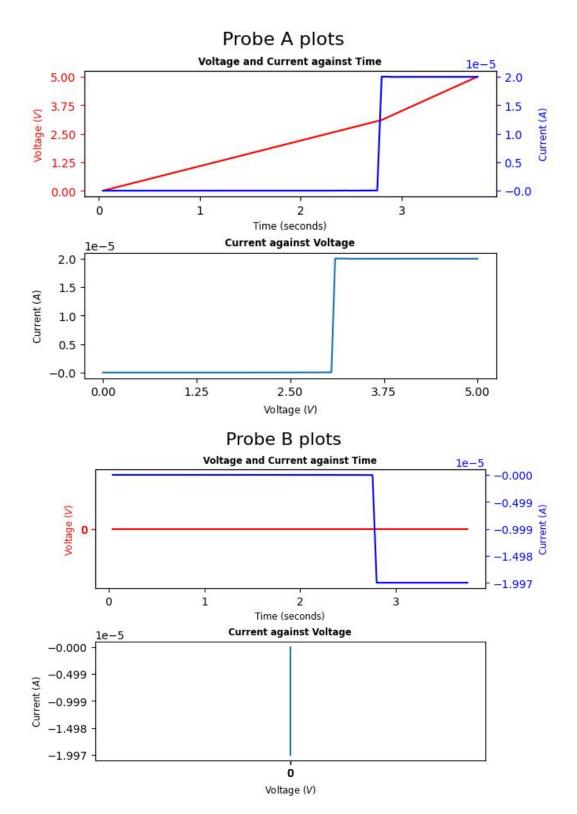

Activity = reset

Start Voltage = 0V

End Voltage = -3V

Ramp Rate = 1V/s


Compliance Current = 6.0mA


Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Did not reset

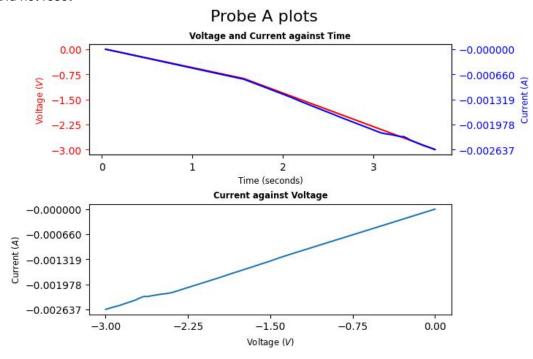

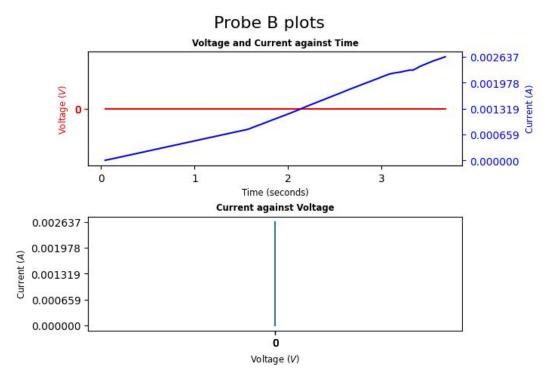

Stimulated at 03:32:57PM on 2022/March/17

Activity = reset

Start Voltage = 0V

End Voltage = -4V

Ramp Rate = 1V/s


Compliance Current = 6.0mA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Reset successfully

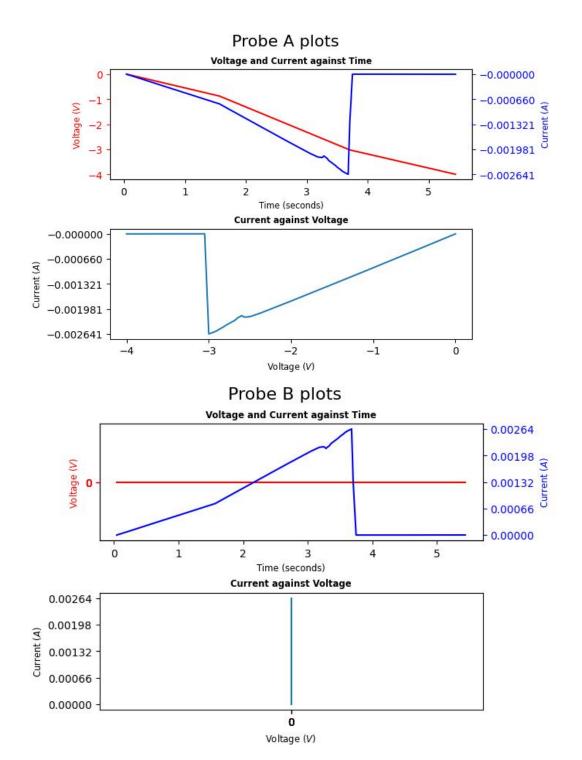

Stimulated at 03:34:02PM on 2022/March/17

Activity = set

Start Voltage = 0V

End Voltage = 5V

Ramp Rate = 1V/s


Compliance Current = 20.0uA


Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Set at 2.15 V

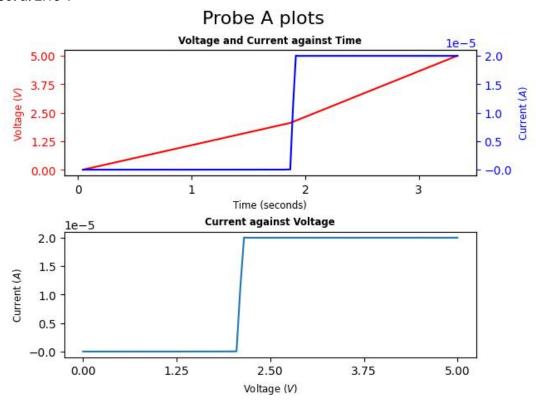

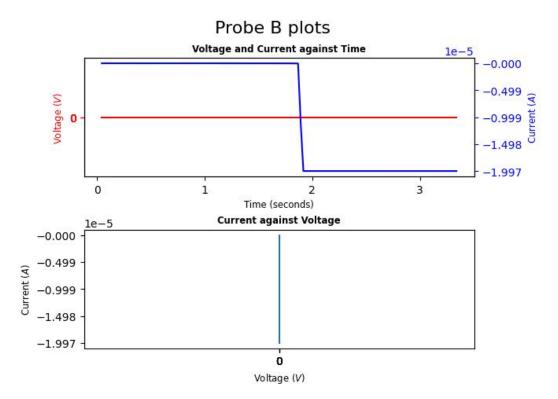

Stimulated at 03:34:55PM on 2022/March/17

Activity = reset

Start Voltage = 0V

End Voltage = -4V

Ramp Rate = 1V/s


Compliance Current = 6.0mA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Unknown

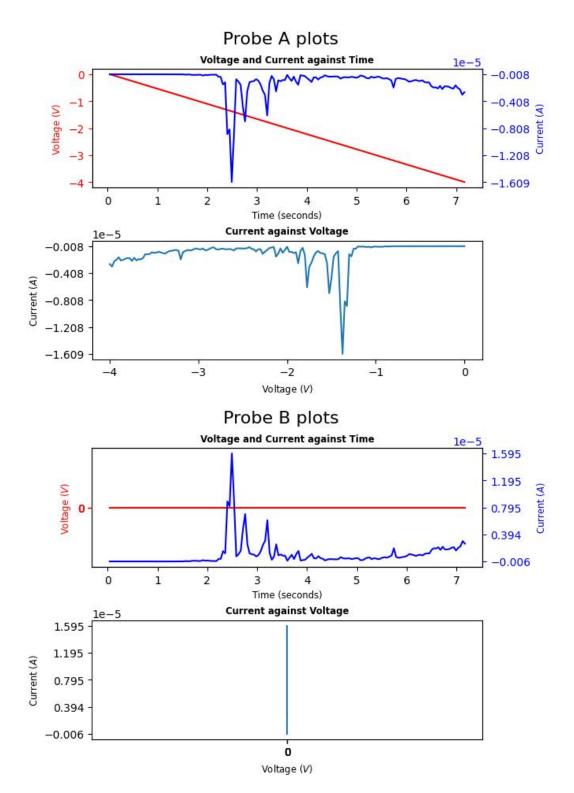

Stimulated at 03:35:36PM on 2022/March/17 Activity = observe Start Voltage = <2 probe observe activity, so invalid>

End Voltage = <2 probe observe activity, so invalid>

Ramp Rate = <2 probe observe activity, so invalid>

Compliance Current = 20.0uA


Platinum Voltage = 0V


Copper Voltage = 0.100V

Run Folder Name = <2 probe, so invalid>

Comments = Reset State: Reset*



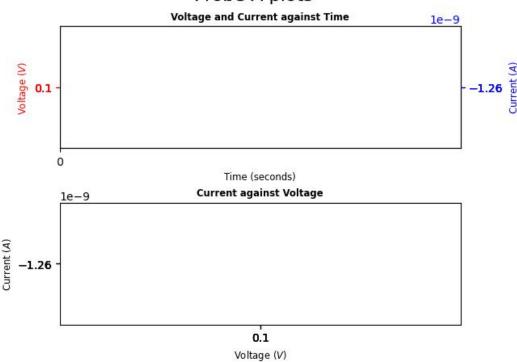

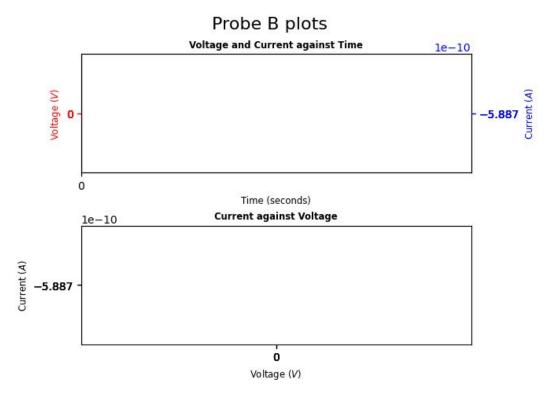

Stimulated at 03:35:59PM on 2022/March/17

Activity = set

Start Voltage = 0V

End Voltage = 5V

Ramp Rate = 1V/s


Compliance Current = 20.0uA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Set at 2.35 V

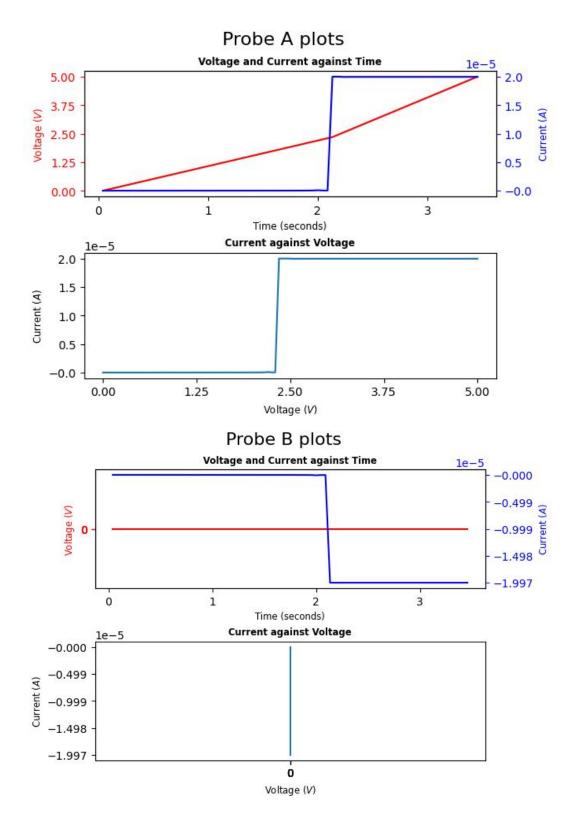

Activity = reset

Start Voltage = 0V

End Voltage = -4V

Ramp Rate = 1V/s


Compliance Current = 6.0mA


Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Vacancies and stuff

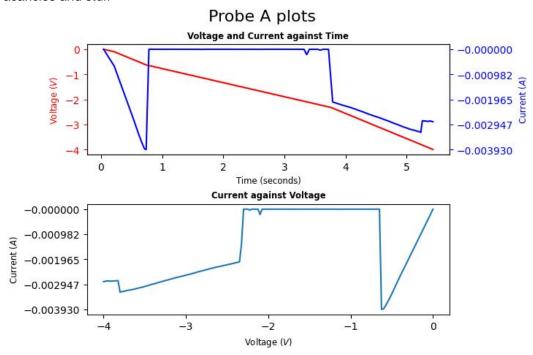

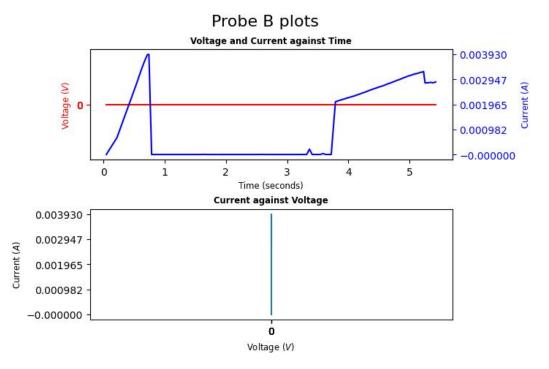

Stimulated at 04:03:42PM on 2022/March/17

Activity = form

Start Voltage = 0V

End Voltage = 5V

Ramp Rate = 1V/s


Compliance Current = 20.0uA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Formed at 4.5 V

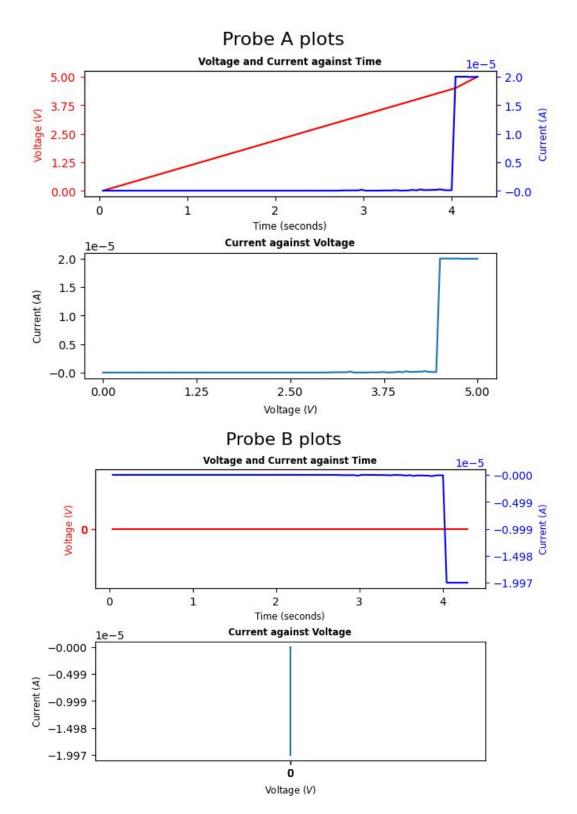

Activity = reset

Start Voltage = 0V

End Voltage = -3V

Ramp Rate = 1V/s


Compliance Current = 6.0mA


Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Reset

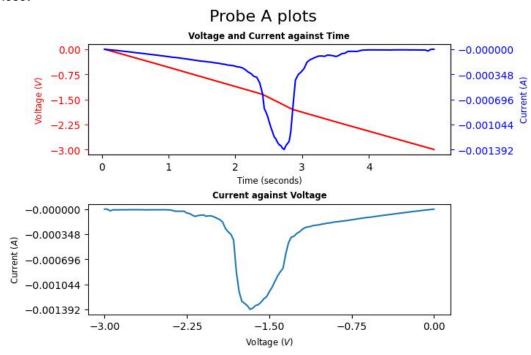

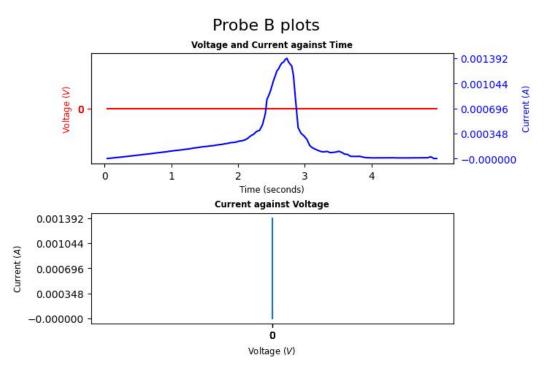

Stimulated at 04:05:02PM on 2022/March/17

Activity = observe

Start Voltage = <2 probe observe activity, so invalid>

End Voltage = <2 probe observe activity, so invalid>

Ramp Rate = <2 probe observe activity, so invalid>


Compliance Current = 20.0uA

Platinum Voltage = 0V

Copper Voltage = 0.100V

Run Folder Name = <2 probe, so invalid>

Comments = Reset State: Reset*

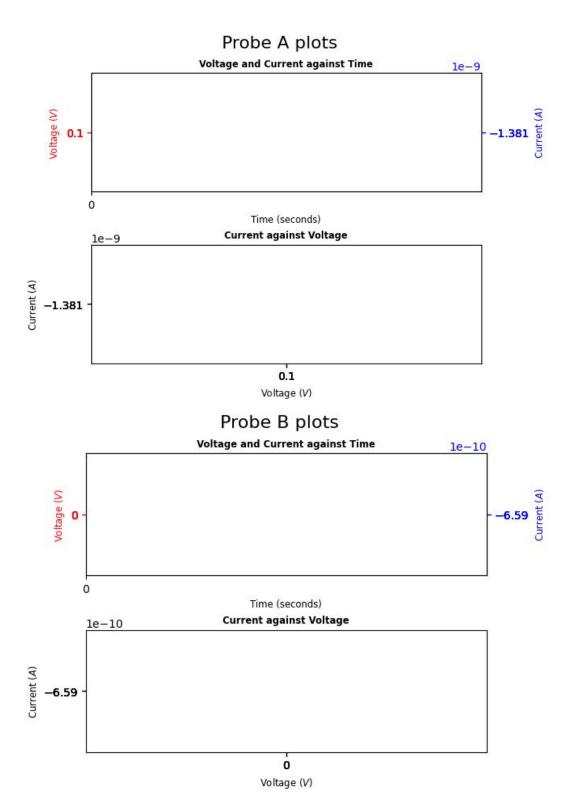

Stimulated at 04:05:28PM on 2022/March/17

Start Voltage = 0V

End Voltage = 5V

Ramp Rate = 1V/s


Compliance Current = 20.0uA


Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Set at 2.3 V

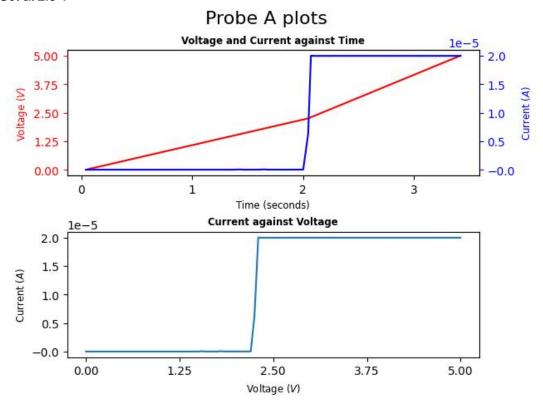

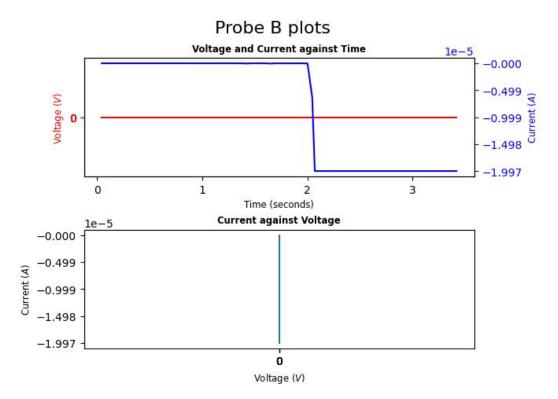

Stimulated at 04:06:03PM on 2022/March/17

Activity = reset

Start Voltage = 0V

End Voltage = -3V

Ramp Rate = 1V/s


Compliance Current = 6.0mA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Reset again

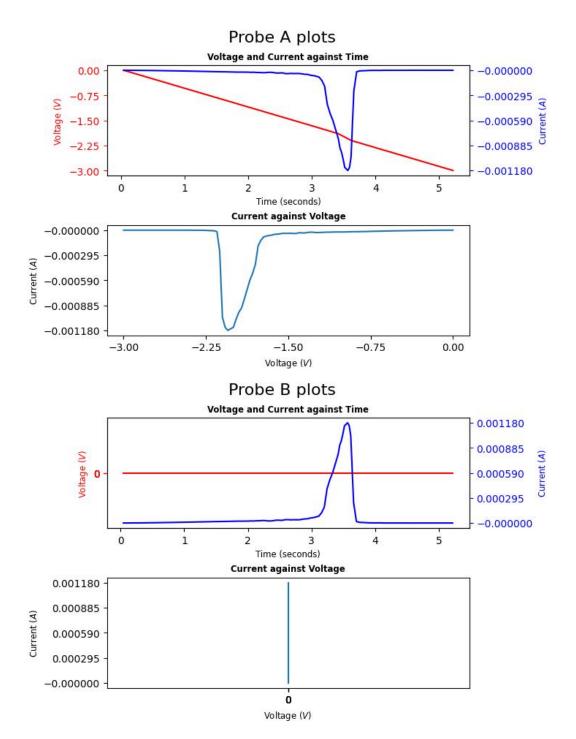

Stimulated at 04:06:47PM on 2022/March/17

Activity = observe

Start Voltage = <2 probe observe activity, so invalid>

End Voltage = <2 probe observe activity, so invalid>

Ramp Rate = <2 probe observe activity, so invalid>

Compliance Current = 20.0uA


Platinum Voltage = 0V


Copper Voltage = 0.100V

Run Folder Name = <2 probe, so invalid>

Comments = Reset State: Reset*



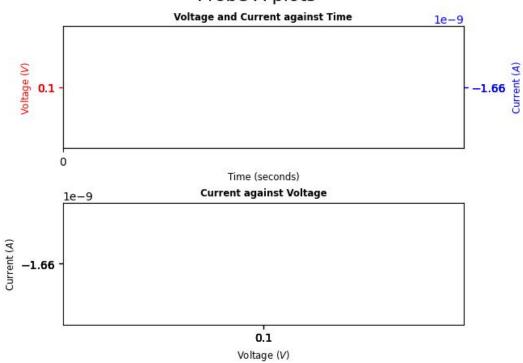

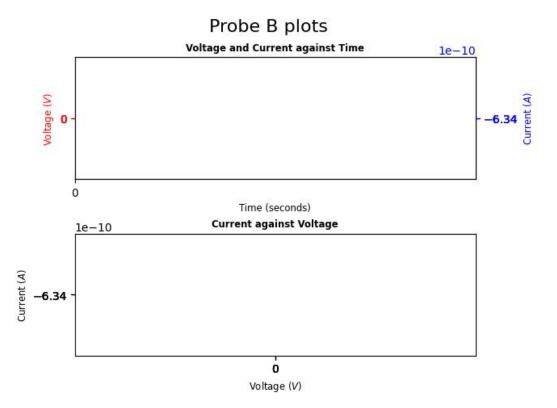

Stimulated at 04:07:06PM on 2022/March/17

Activity = set

Start Voltage = 0V

End Voltage = 5V

Ramp Rate = 1V/s


Compliance Current = 20.0uA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Set at 3.1 V

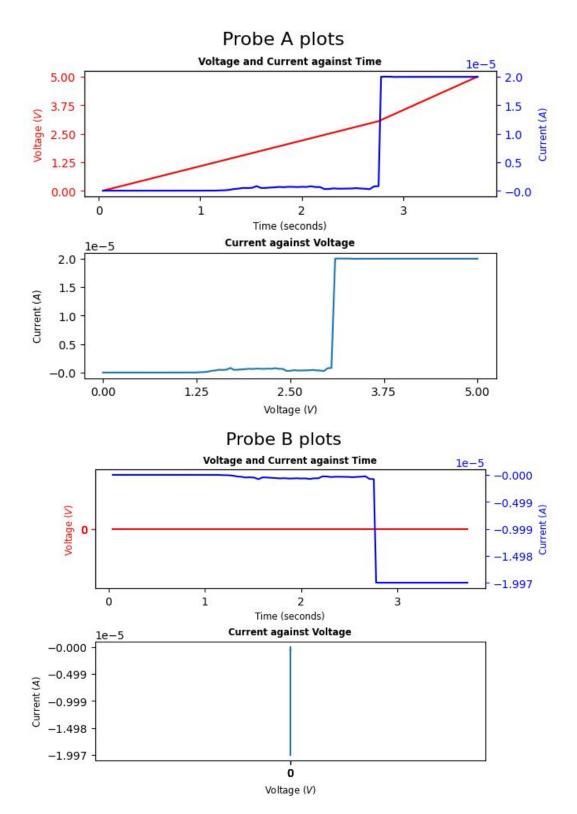

Activity = reset

Start Voltage = 0V

End Voltage = -3V

Ramp Rate = 1V/s


Compliance Current = 6.0mA


Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = No reset

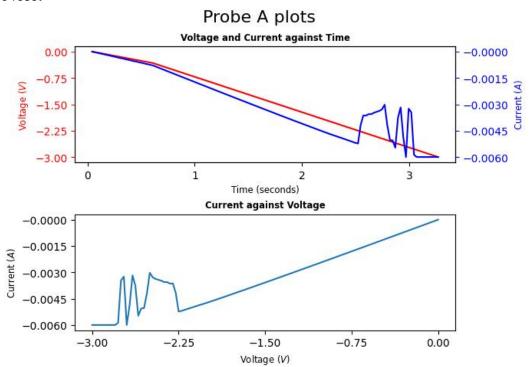

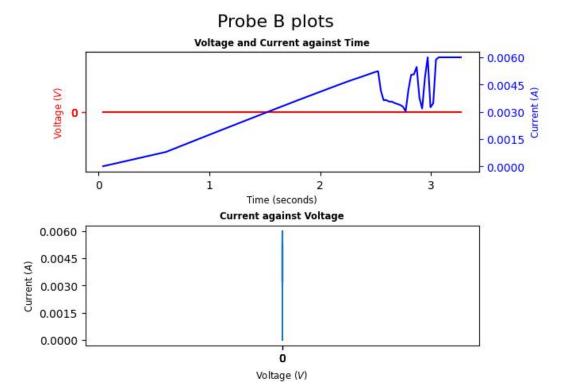

Stimulated at 04:08:39PM on 2022/March/17

Activity = reset

Start Voltage = 0V

End Voltage = -4V

Ramp Rate = 1V/s


Compliance Current = 6.0mA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = No reset

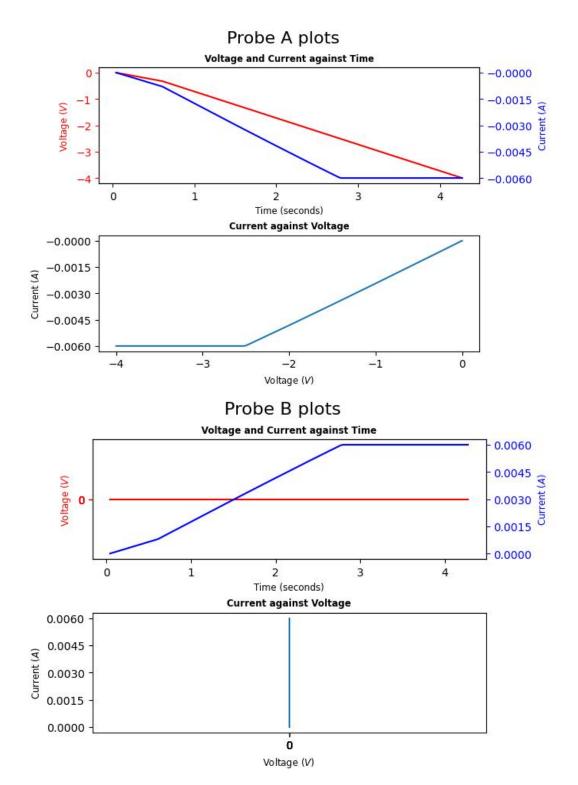

Stimulated at 04:09:20PM on 2022/March/17

Activity = reset

Start Voltage = 0V

End Voltage = -4V

Ramp Rate = 1V/s


Compliance Current = 8.0mA


Platinum Voltage =


Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = No reset



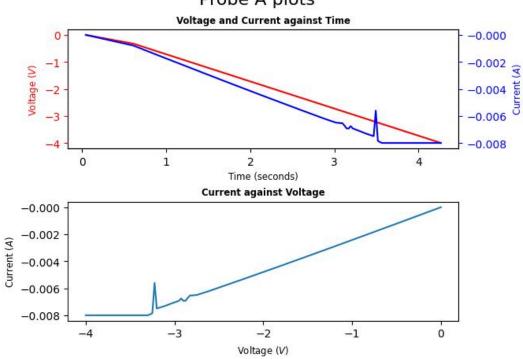

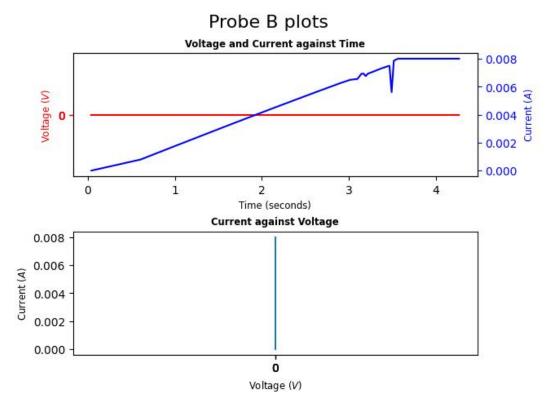

Stimulated at 04:10:02PM on 2022/March/17

Activity = reset

Start Voltage = 0V

End Voltage = -5V

Ramp Rate = 1V/s


Compliance Current = 8.0mA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = No reset

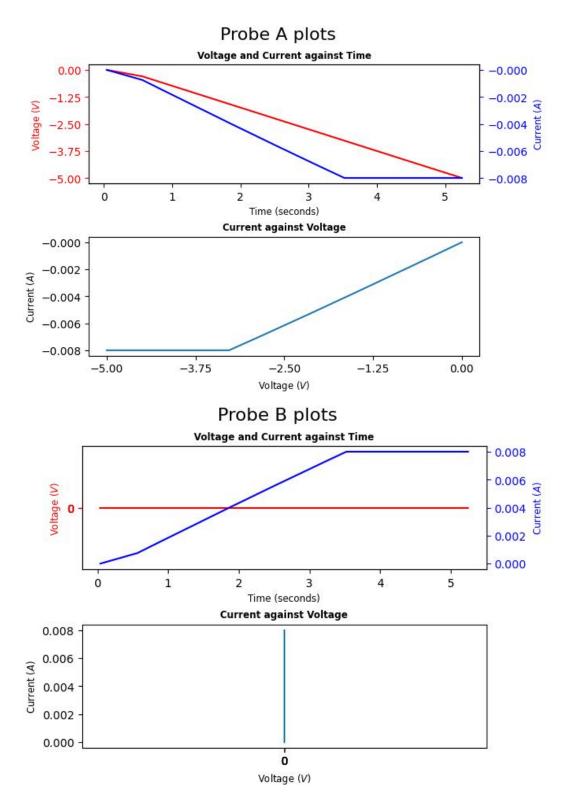

Stimulated at 04:10:36PM on 2022/March/17

Activity = reset

Start Voltage = 0V

End Voltage = -5V

Ramp Rate = 1V/s


Compliance Current = 10.0mA


Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = No reset

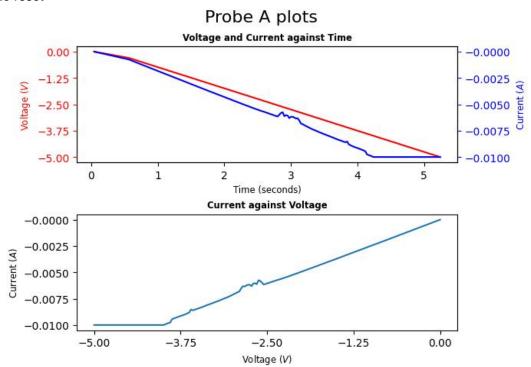

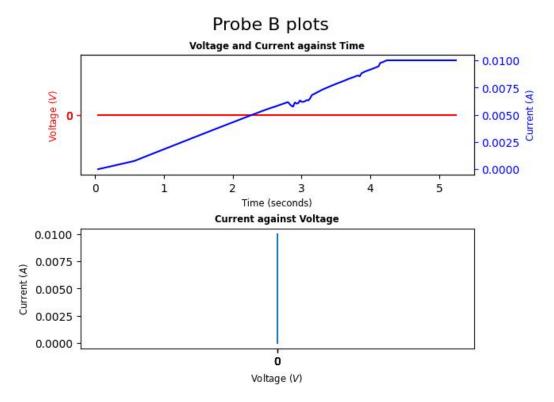

Stimulated at 04:12:31PM on 2022/March/17

Activity = reset

Start Voltage = 0V

End Voltage = -4V

Ramp Rate = 1V/s


Compliance Current = 8.0mA

Platinum Voltage =

Copper Voltage =

Run Folder Name = <2 probe, so invalid>

Comments = Amrita adjusted the probes. No reset

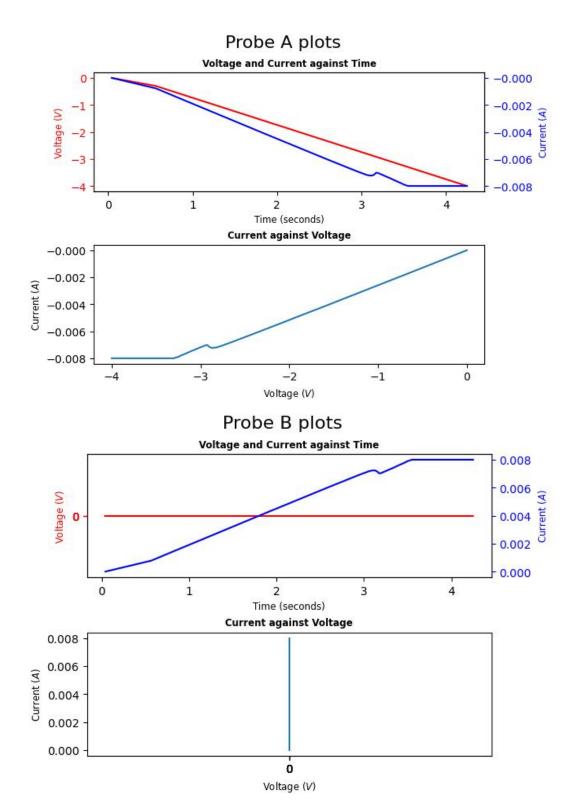

.....