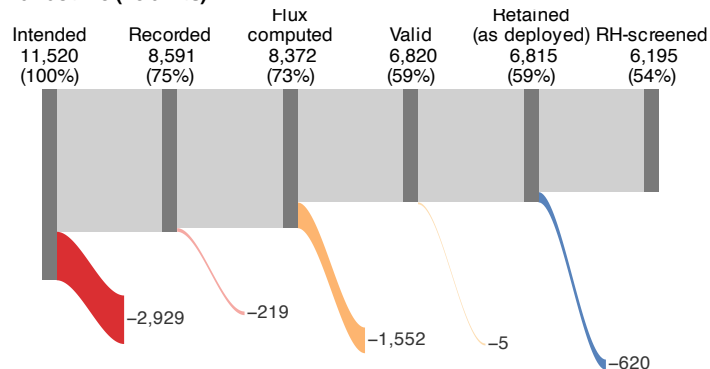
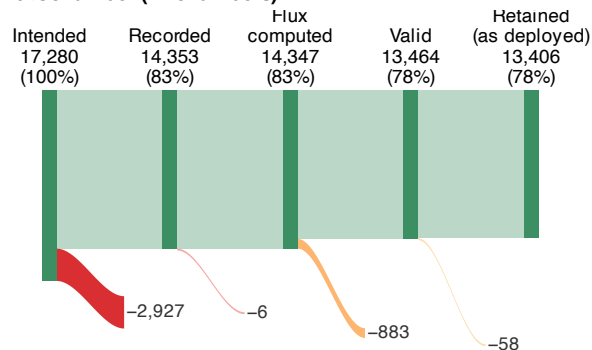


a**Fluxbot 2.0 (16 units)****Autochamber (12 chambers)****Closures lost at each step**

- No data: no record (logger, power, transmission)
- No data: too few records to fit a flux
- Removed by QC: failed fit or chamber check
- Removed by QC: spike
- Wet sensor (RH-screened subset only)

b**Agreement of array means at each stage**

	Offset	r, hourly	r, daily
Valid	-10.1%	0.72	0.83
Retained (as deployed)	-9.9%	0.71	0.83
RH-screened subset	-8.5%	0.75	0.88