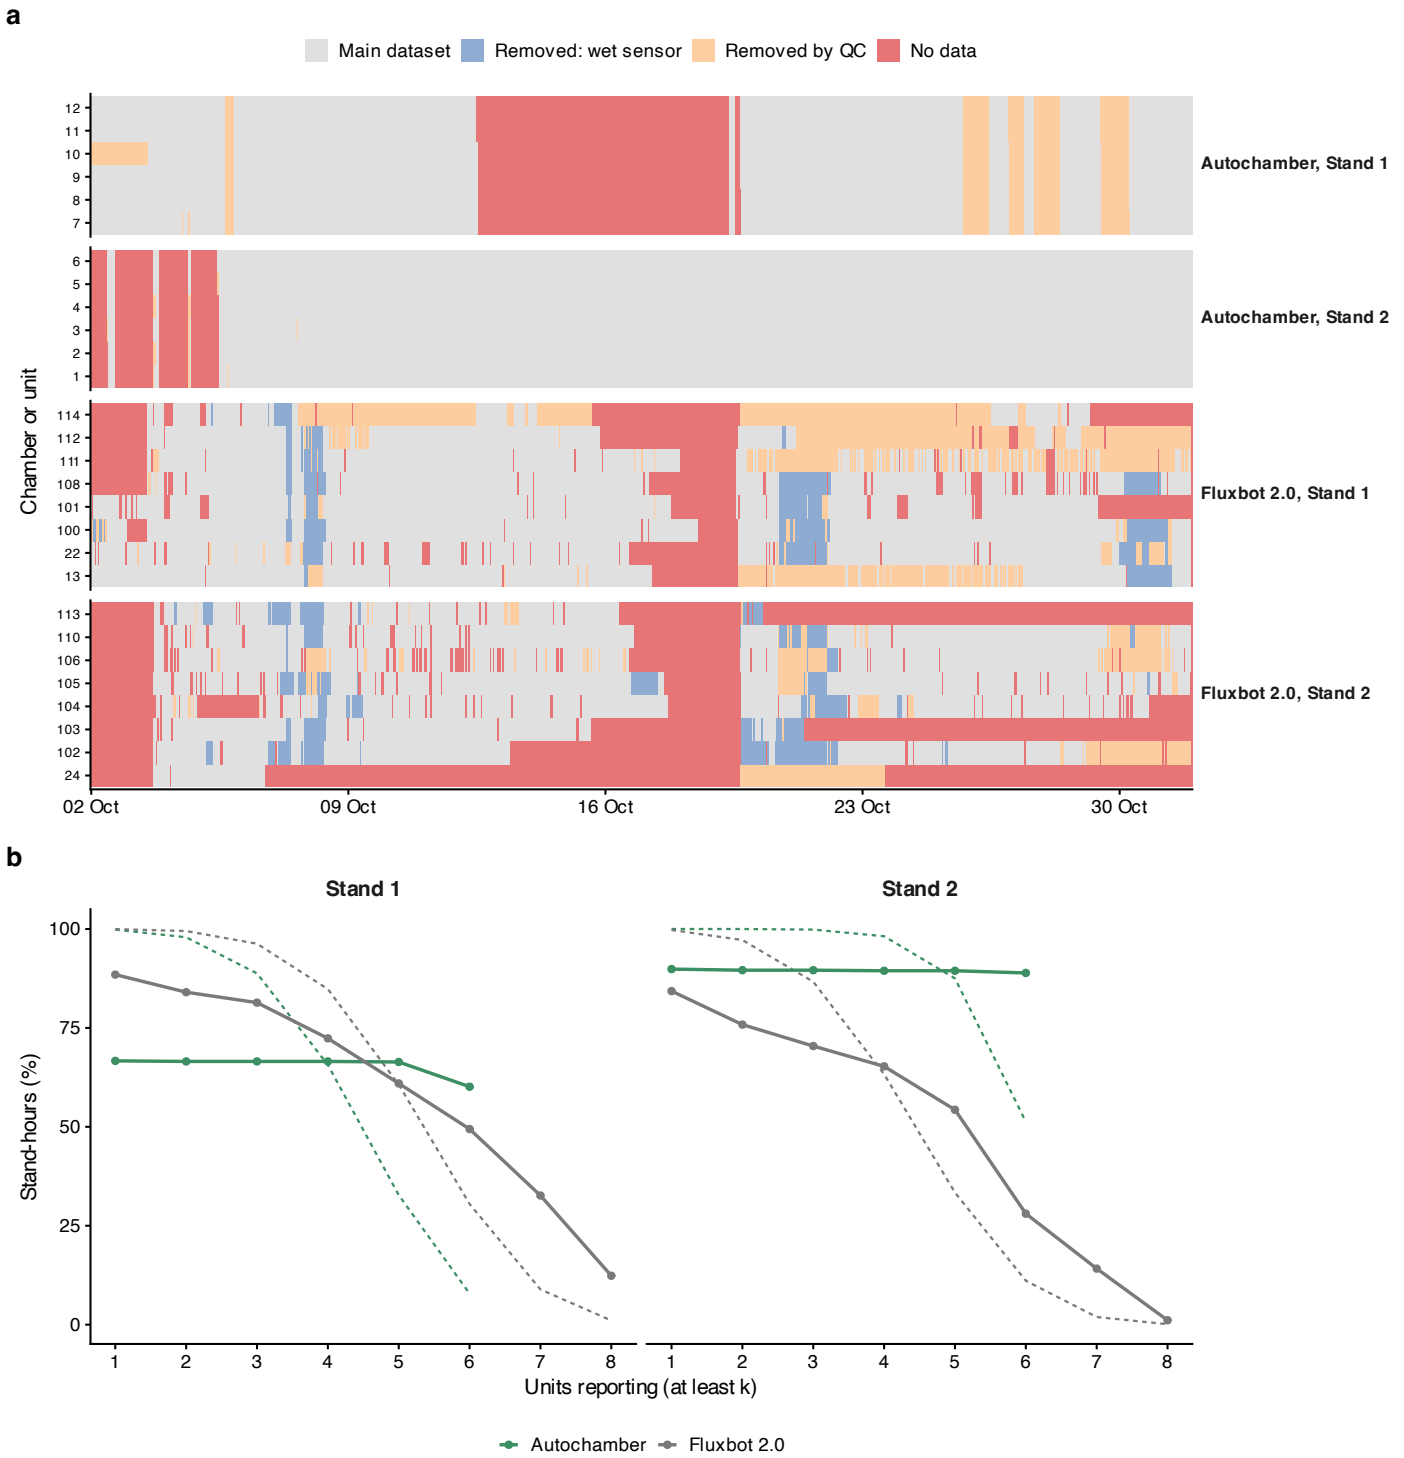
a
Main dataset
Removed: wet sensor
Removed by QC
No data
Chamber or unit
Autochamber, Stand 1
Autochamber, Stand 2
Fluxbot 2.0, Stand 1
Fluxbot 2.0, Stand 2
02 Oct
09 Oct
16 Oct
23 Oct
30 Oct
b
Stand 1
Stand 2
Stand-hours (%)
Units reporting (at least k)
Autochamber
Fluxbot 2.0