

Executive Overview

Total Assets

500

P1 Count

57

P1 Replacement Cost (NZD)


15M

Avg Risk Score


0.34

Risk Matrix: Probability vs Consequence of Failure

priority ▲ P1_Critical ▲ P2_High ▲ P3_Medium ▲ P4_Low

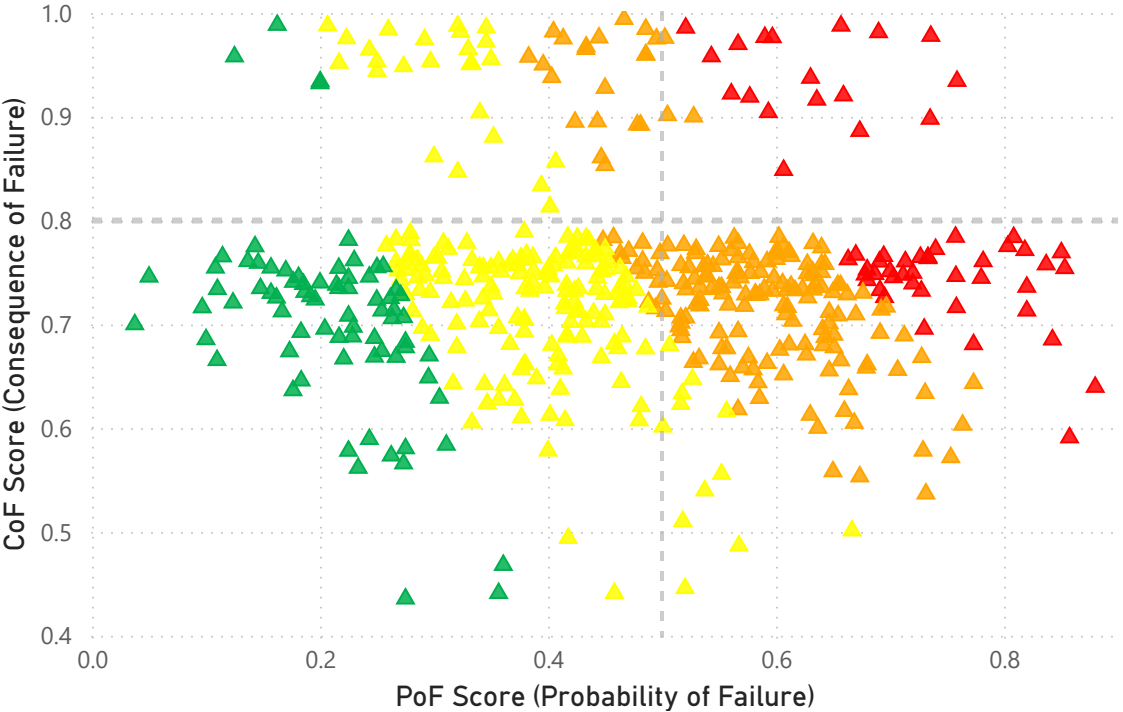


Asset Priority Distribution

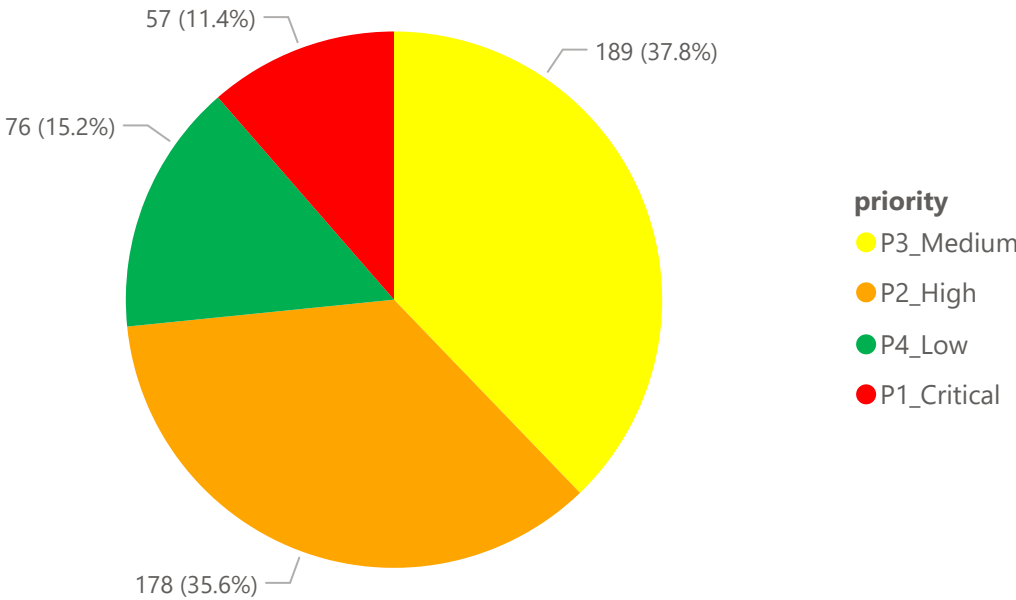

Zone Analysis


P1 Critical Assets by Zone

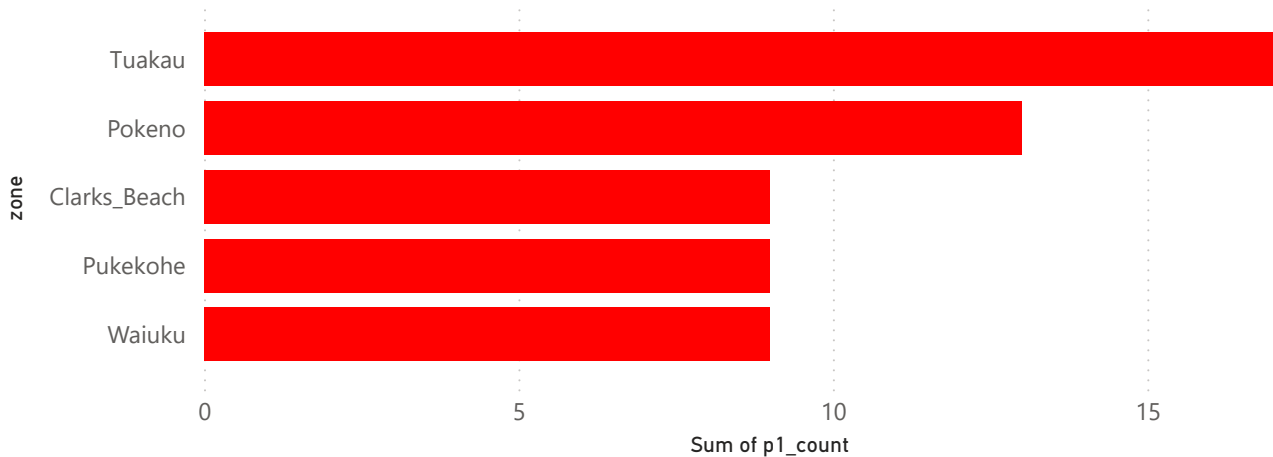

Risk Summary by Zone

zone	Total assets by zone	P1 risk count	Avg risk	Total cost to replace
Clarks_Beach	104	9	0.32	28M
Pokeno	92	13	0.35	25M
Pukekohe	100	9	0.34	23M
Tuakau	105	17	0.35	29M
Waiuku	99	9	0.35	24M
Total	500	57	1.71	128M

Total Replacement Cost by Zone (NZD)

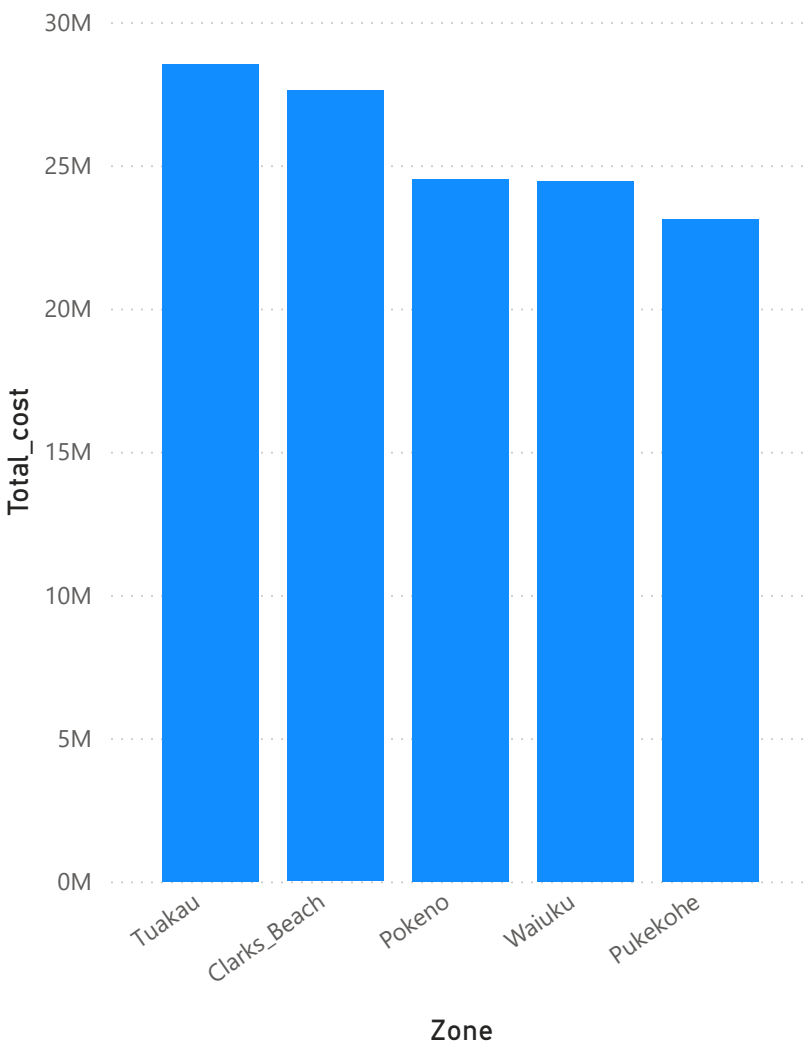

Investment Plan

Type	Asset Type	Zone	Asset Age (years)	Risk Score	Priority	Customers	Cost (NZD)
CE-0037	OH_Line	Tuakau	37	0.72	P1_Critical	1494	\$409,201
CE-0331	Transformer	Waiuku	34	0.71	P1_Critical	1459	\$26,371
CE-0289	UG_Cable	Tuakau	31	0.68	P1_Critical	1771	\$247,186
CE-0380	Transformer	Tuakau	30	0.66	P1_Critical	584	\$124,450
CE-0308	Transformer	Pokeno	32	0.65	P1_Critical	1550	\$383,554
CE-0339	Transformer	Pokeno	25	0.65	P1_Critical	1726	\$418,587
CE-0193	OH_Line	Tuakau	41	0.64	P1_Critical	1192	\$439,682
CE-0354	Transformer	Pukekohe	32	0.63	P1_Critical	1318	\$361,506
Total			1530	28.76		61096	\$13,652,090

Cumulative Cost by asset_id

