



A Literature positive controls recovered de novo, SH-SY5Y 75 ng/mL

Stringent-filter calls, MAPQ-filtered junction set; labels give knockdown/control junction reads

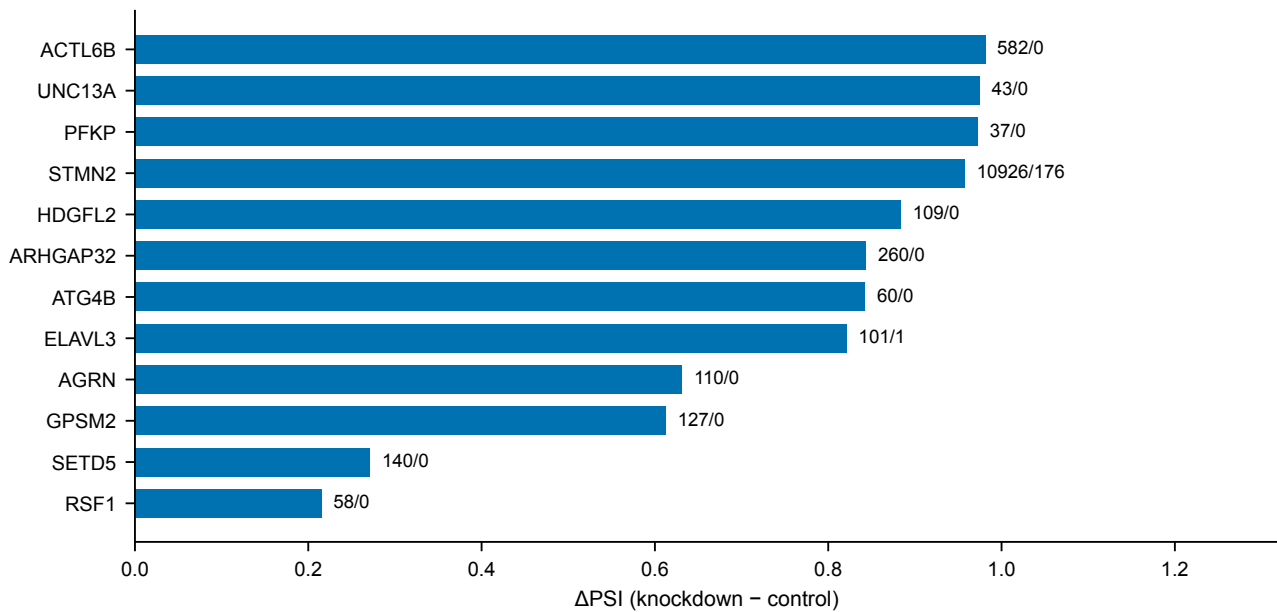

B Cumulative Ca^{2+} gene panels, SH-SY5Y 75 ng/mL

Same call set as A; the tiers are nested, so the counts are not independent

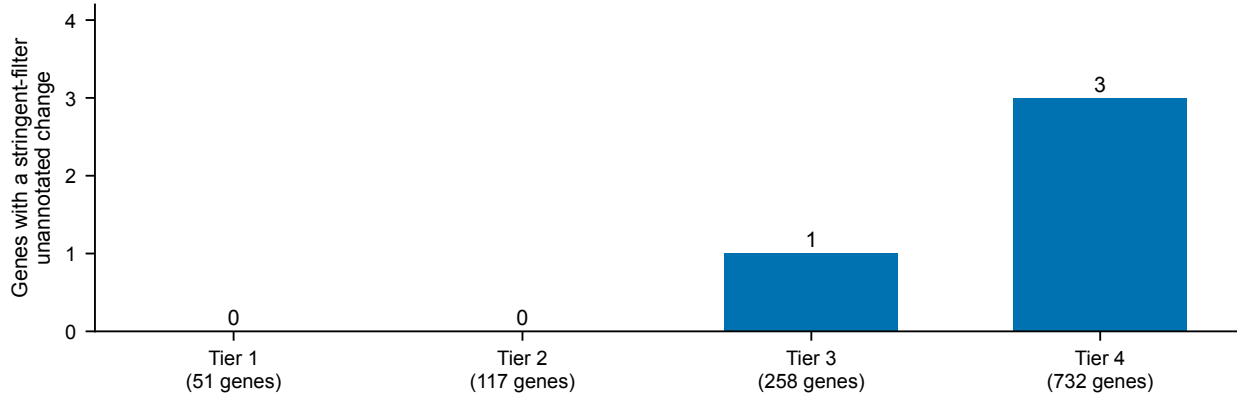

C Human comparison datasets, permissive definition (regtools junction set)

iPSC-MN: 2 controls after TDP-43 knockdown versus none after FUS or TAF15 (Fisher exact $p = 0.48$); not a specificity test

