

FLOOR PLAN NOTES

1. Install 5/8" type 'x' sheetrock @ walls and ceiling under stairs and between garage and house.
2. Door between house and garage shall be 20 min. fire rated 1 3/8" solid core with self closer.
3. Provide 22" x 30" min. underfloor and attic access as required per code.
4. Provide minimum 36" inch deep landing outside all exterior doors.
5. Step downs may not exceed 7 3/4" inches for in-swinging and sliding doors.
6. Thresholds at doorways shall not exceed 3/4" in height for sliding doors and max. 1/2" floor level change for out swing doors. Landings or finished floors at required egress door shall be not more than 1-1/2 inches lower than the top of the threshold.
7. Provide egress window @ all sleeping rooms. Minimum net opening must be 24" height x 20" width and 5.7 square feet. The bottom of opening must be no more than 44" above finish floor.
8. Provide natural lighting (window, skylight) with an area of not less than 1/10 of the floor area.
9. Provide natural ventilation (window, door, operable skylight) with an area of not less than 1/20 of floor area.
10. Safety glazing (tempered) is required for all panes within 24" of door - 18" off finish floor - 60" above a standing surface and drain inlet @ tubs and showers, and stair landings. All other exterior glazing requires min. one pane tempered glass per WUI code requirements.
11. Handrails are required at stairways with more than 3 risers.
12. Handrails must have a 1-1/4" - 2 inch graspable cross section, no sharp corners, 34-38 inches above stair nosing, extend continuously from top to bottom riser, and terminate at newel posts or return to walls.
13. Required guards shall not have openings from the walking surface to the required guard height that allow passage of a sphere 4 inches. The triangular openings at the open side of stair, formed by the riser, tread and bottom rail of a guard, shall not allow passage of a sphere 6 inches in diameter. Guards on the open side of stair shall not have openings that allow passage of a sphere 43/8 inches in diameter.
14. All tub and shower wall must have a smooth, hard, and nonabsorbent surface over a moisture resistant underlayment to a height of 72" above drain inlet.
15. Floor area used for parking of automobiles or other vehicles shall be sloped to facilitate movement of liquids to a drain or toward the main vehicle entry doorway.


16. Shower stalls shall have a clear interior finish area of 1,024 square inches and be able to accommodate a minimum 30" circle at the threshold level. These clearances shall be maintained up to a height of 70" above shower drain.
17. Shower door enclosures shall have tempered safety glazing and minimum 22" clear opening.
18. No water closet shall be set closer than 15 inches from its center to a side wall or obstruction. The clear space in front of a water closet or lavatory shall be not less than 24 inches.
19. Attached private garages shall comply with EV infrastructure requirements in accordance with the California Green Building Standards Code.
20. Shower stalls shall have a clear interior finish area of 1,024 square inches and be able to accommodate a minimum 30" circle at the threshold level. These clearances shall be maintained up to a height of 70" above shower drain. Shower door size to allow minimum 22" clearance.
21. Shower door enclosures shall have tempered safety glazing.
22. No water closet shall be set closer than 15 inches from its center to a side wall or obstruction. The clear space in front of a water closet or lavatory shall be not less than 24 inches.
23. Landings or finished floors at the required egress door shall be not more than 1-1/2 inches lower than the top of the threshold.
24. Landing or floor on the exterior side shall be not more than 7-3/4 inches below the top of the threshold provided that the door does not swing over the landing or floor.
25. Doors other than the required egress door shall be provided with landings or floors not more than 7-3/4 inches below the top of the threshold.
26. Windows and Doors must be tested and labeled to comply with AAMA standards, Safety glazing and Energy certification

DOOR SCHEDULE					
NUMBER	QTY	FLOOR	WIDTH	HEIGHT	DESCRIPTION
D01	1	0	36"	84"	EXT. HINGED-DOOR E21
D02	1	0	84"	90"	CUSTOM ROLL UP
D03	1	1	42"	145"	CUSTOM ENTRY
D04	1	1	196"	96"	EXT. QUAD SLIDER-GLASS PANEL
D05	1	1	34"	84"	HINGED-DOOR P04
D06	1	0	32"	84"	HINGED-PANEL
D07	11	1	32"	84"	HINGED-DOOR P04
D08	1	0	204"	96"	CUSTOM ROLL UP
D09	1	0	32"	84"	HINGED-DOOR P04
D10	1	1	32"	84"	EXT. HINGED-PANEL
D15	1	0	36"	84"	EXT. HINGED-PANEL
D17	1	1	72"	84"	EXT. SLIDER-GLASS PANEL
D19	2	1	72"	84"	SLIDER-DOOR P04
D20	1	0	96"	84"	EXT. SLIDER-GLASS PANEL

TEMPERED GLASS IS REQUIRED FOR ALL DOORS AND WINDOWS TO COMPLY WITH CRC R337/CBC TA& WUI construction requirements.

WINDOW SCHEDULE								
NUMBER	QTY	FLOOR	WIDTH	HEIGHT	EGRESS	DESCRIPTION	COMMENTS	
W01	1	0	21"	48"		SINGLE CASEMENT-HR		
W02	1	1	30"	48"		SINGLE CASEMENT-HR		
W03	1	1	48"	66"	YES	FIXED GLASS		
W04	2	1	36"	24"		FIXED GLASS		
W05	2	1	60"	60"	YES	DOUBLE CASEMENT-LHL/RHR		
W06	1	1	60"	24"		FIXED GLASS		
W07	1	1	30"	54"	YES	SINGLE CASEMENT-HR		
W08	1	1	24"	66"	YES	SINGLE CASEMENT-HR		
W09	1	1	48"	110"		FIXED GLASS-AT		
W10	1	1	96"	22"		TRIPLE CASEMENT-LHL		
W11	1	1	72"	60"		DOUBLE CASEMENT-LHL		
W12	1	1	72"	60"		DOUBLE CASEMENT-RHR		
W13	1	1	96"	60"		TRIPLE CASEMENT-LHL/RHR		
W14	2	1	60"	54"	YES	DOUBLE CASEMENT-LHL/RHR		
W15	1	1	72"	60"	YES	TRIPLE CASEMENT-LHL/RHR		
W16	1	1	36"	48"		SINGLE CASEMENT-HR		
W17	1	0	21"	48"		SINGLE CASEMENT-HL		
W18	1	1	36"	48"		SINGLE CASEMENT-HL		
W19	1	1	24"	66"	YES	SINGLE CASEMENT-HL		
W20	1	1	196"	60 1/2"		MULLED UNIT-LHL/RHL		
W21	1	0	55 5/8"	48"		LOUVERED		
W22	6	0	24"	7 1/16"		LOUVERED		

County of Santa Cruz
Community Development & Infrastructure
Reviewed for Code Compliance
By: GII
Date: 8/8/2024
Permit: APP-231007*
CCD/DEF: N/A

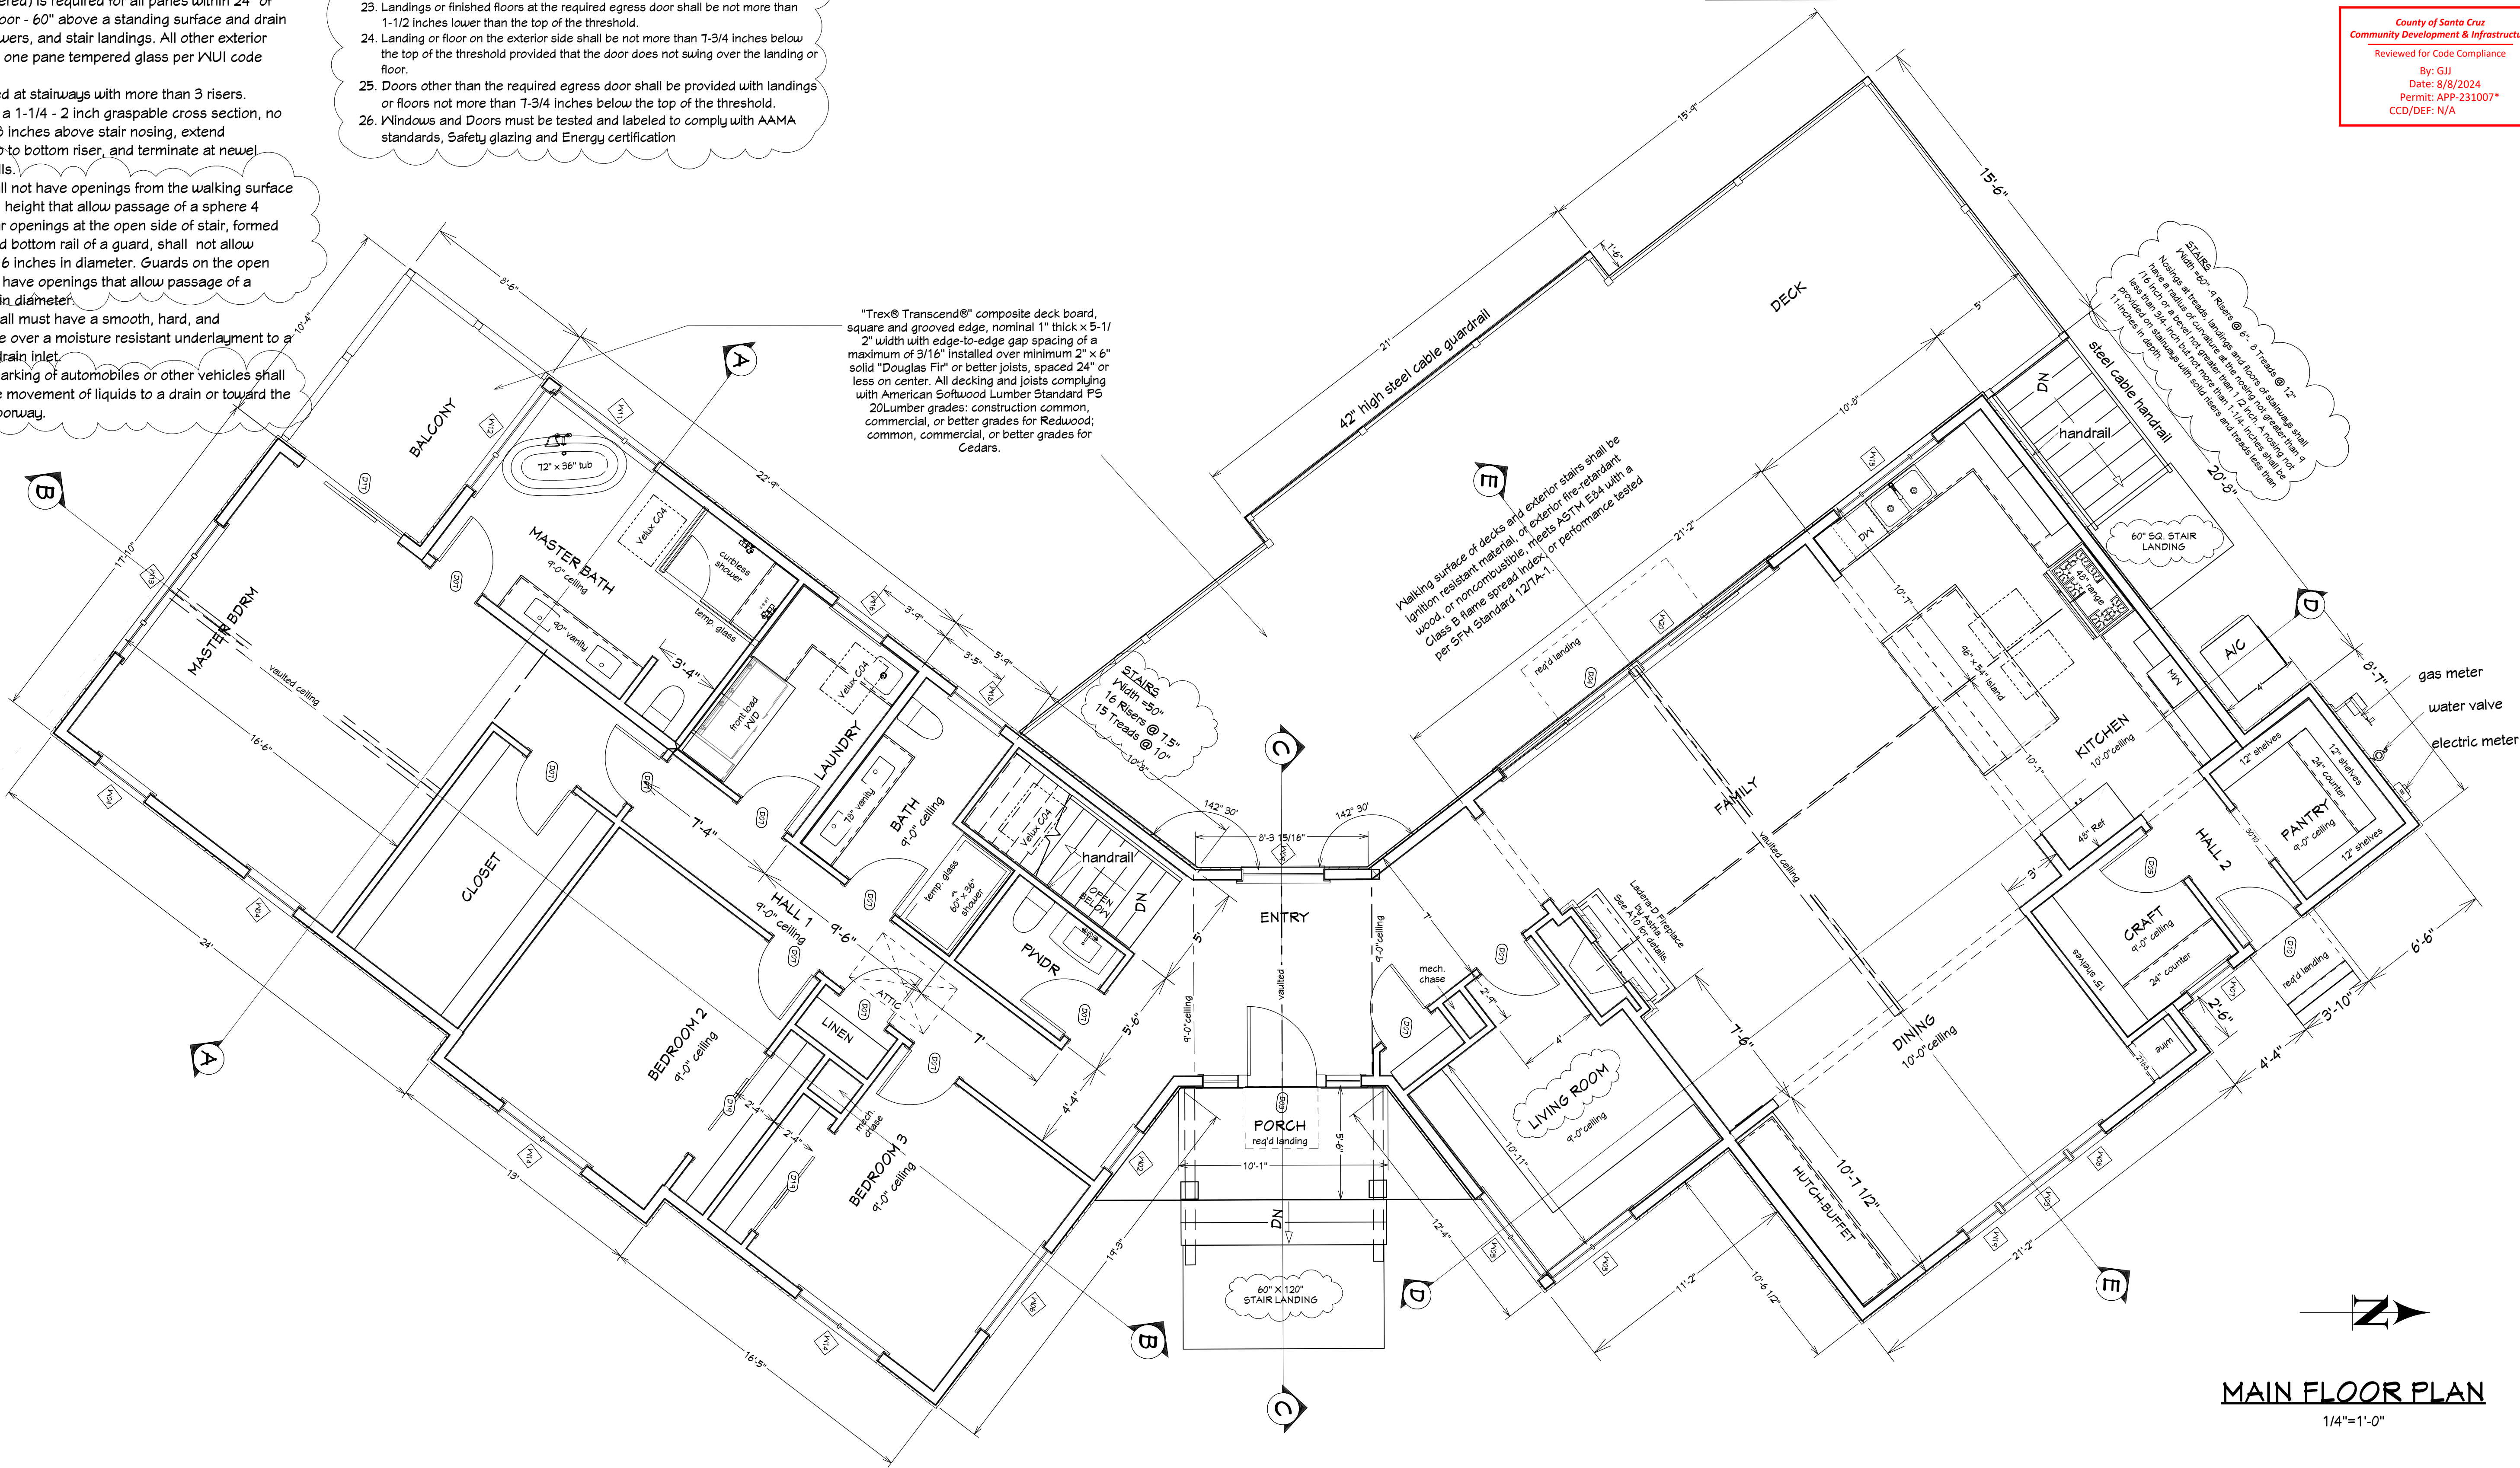

MAIN FLOOR PLAN
1/4"=1'-0"

These documents are the property of Michael Vierhus Architect and shall not be used or reproduced in any way without his consent.

Michael Vierhus
ARCHITECT
P.O.Box 098 Los Gatos CA 95031
408.867.5808

MV
ARCHITECT

Michael Vierhus



ARCHITECTURAL PLANS FOR:

STEVE & MICHELLE BELL
90 BLOSSOM WAY SCOTTS VALLEY CA
APN 056-131-09

printed 7/16/2024
revisions
5/20/24

sheet
A-5