

Development Proposal - AC controller for Unimation Robotics - Revised




07 Nov 2023


Requirements Capture

- ▷ Design and Develop an Air Conditioner controller device as per inputs
- ▷ Two versions
- ▷ BLE mesh
- ▷ Gateway unit – BLE Mesh / LTE / GPS / IR Tx-Rx / USB Powered
- ▷ Node Unit – BLE Mesh / IT Tx-Rx / USB Powered


BLE Mesh Architecture

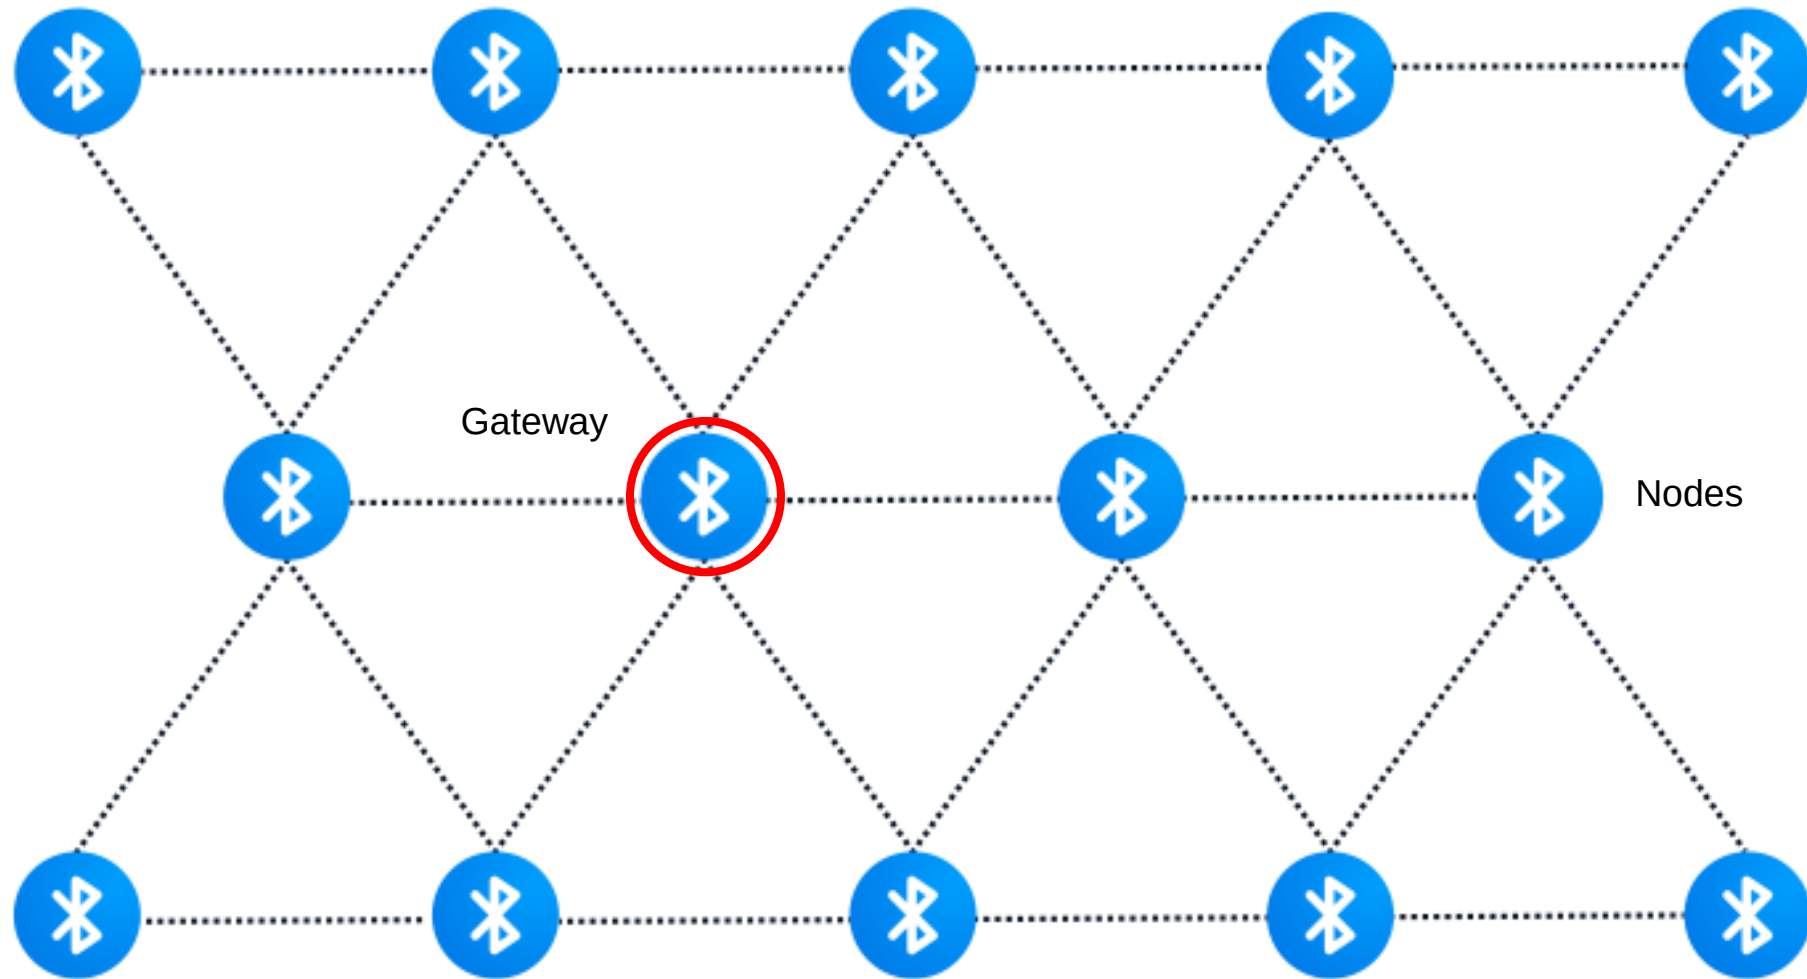

Block Diagram – Gateway Unit

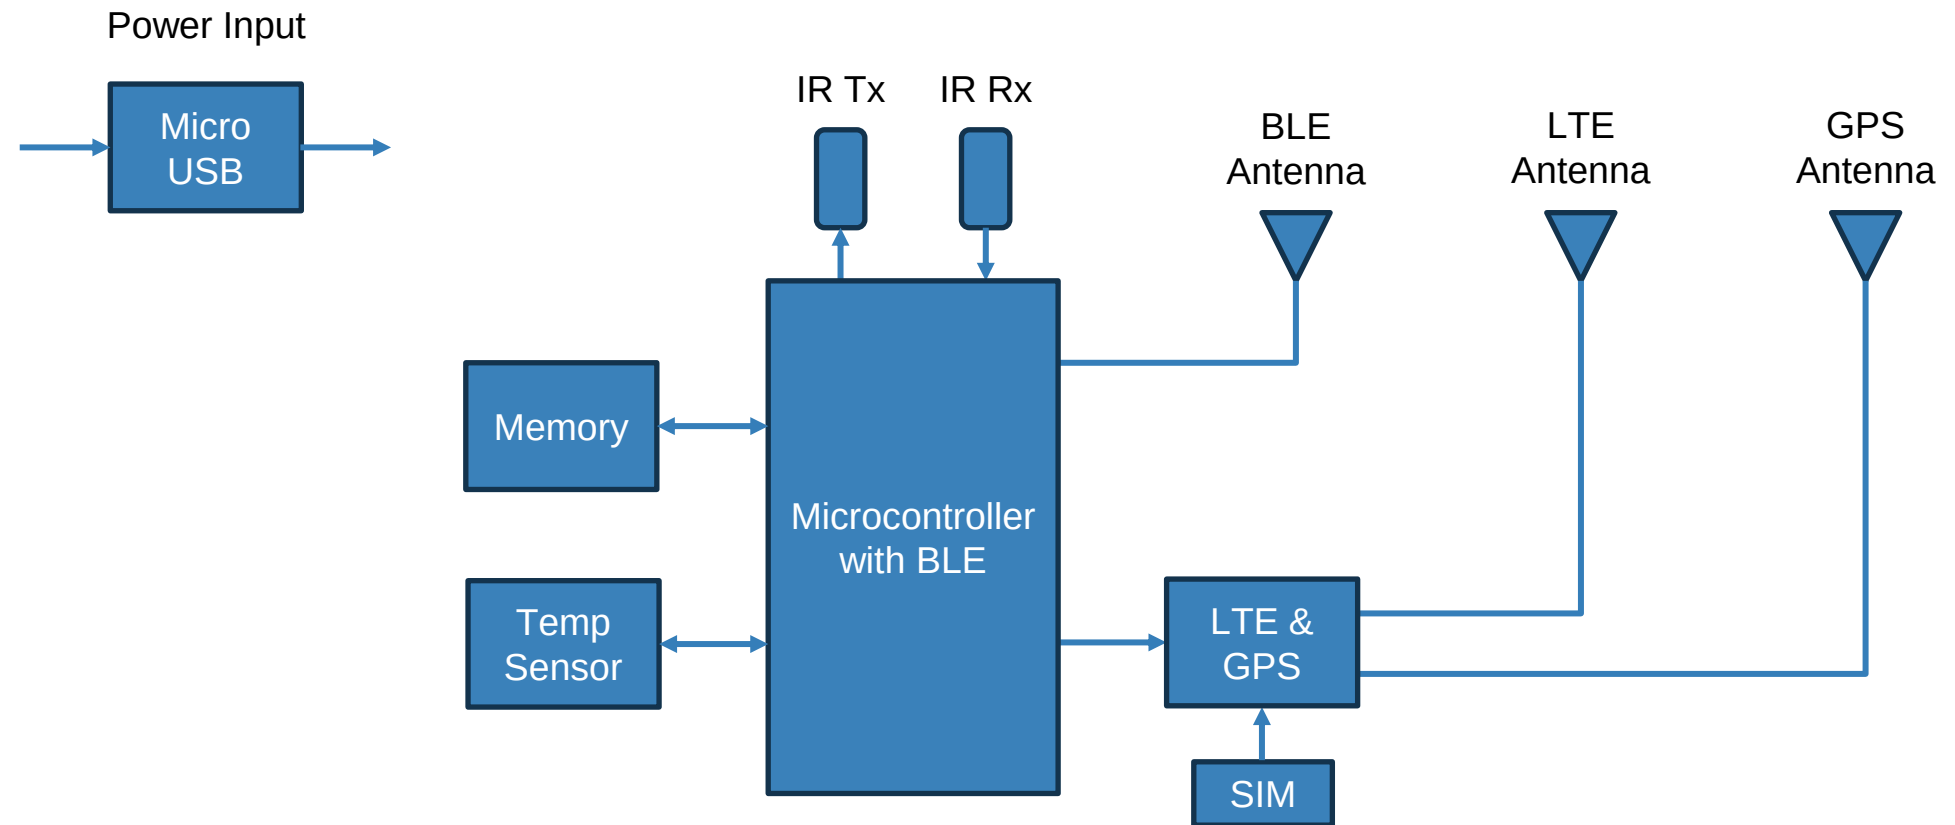

Block Diagram – Node Unit

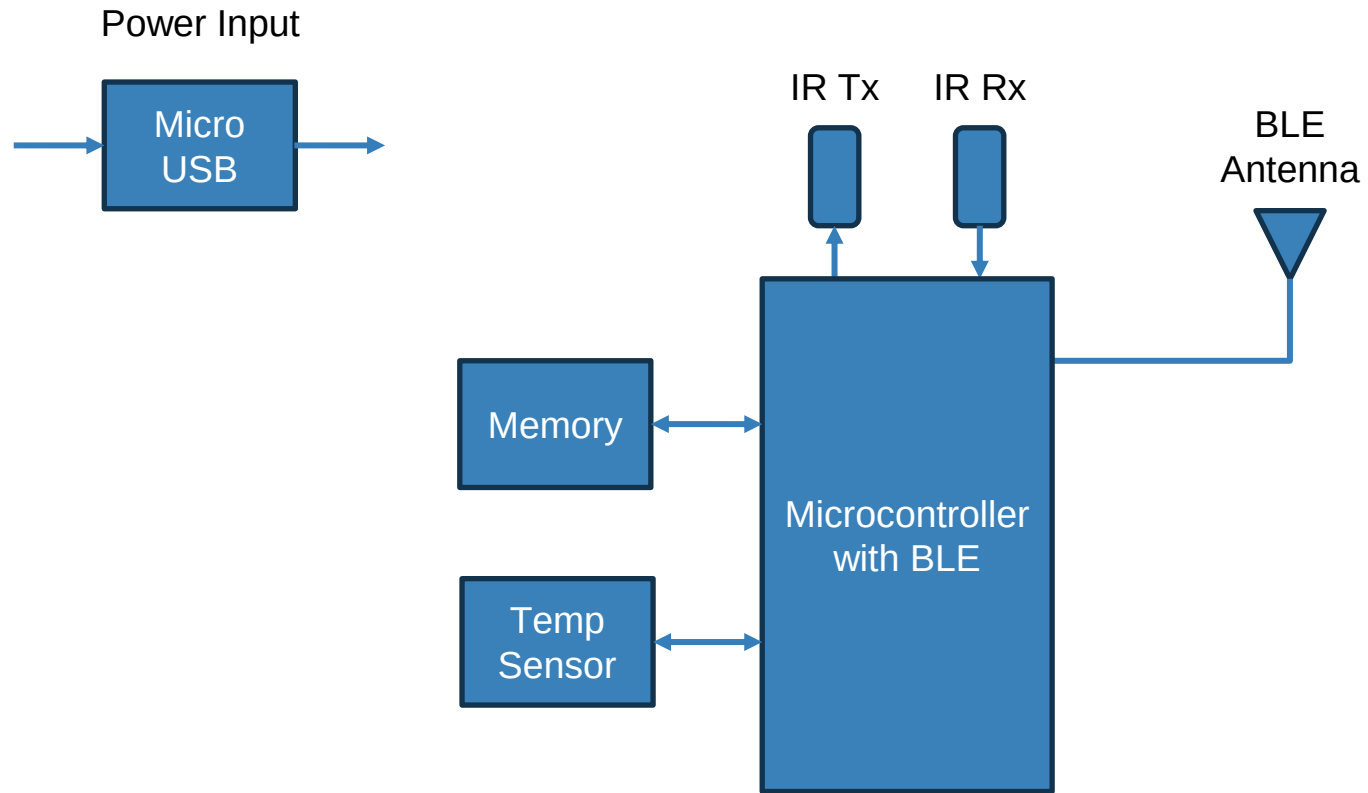

Scope

- ▷ Hardware Design
- ▷ Schematic Entry
- ▷ PCB Design
- ▷ FW Development for IR Control
- ▷ Mechanical Design
- ▷ Prototype Build and Testing
- ▷ Prototype Shipment

Note:

- ▷ IR remote teaching needs to be done manually.
- ▷ Customer shall supply the code set or Remote controls for IR programming
- ▷ Memory locations will be available to store 30-40 IR Code Sets.

Exclusions

- ▷ BLE Mesh Stack and Gateway source code shall not be shared. Binary will be shared for the same.
- ▷ Power Adapter
- ▷ Compliance testing and Certification
- ▷ Cloud Server and Dashboard
- ▷ Mobile App
- ▷ Field Testing
- ▷ All External Agency Fees
- ▷ Any activity which is not listed under “Scope of Work” is considered out of scope

Sl. No	Description
1	Schematics
2	PCB Layout database
3	PCB Fabrication Files (Gerbers)
4	PCB Assembly Files
5	Firmware Source Code for IR Control (BLE Mesh Stack and Gateway code excluded)
6	Test Cases and Test Reports
7	Mechanical Design Files
8	Prototype units – 3 Units each
9	BOM
10	Component Data sheets