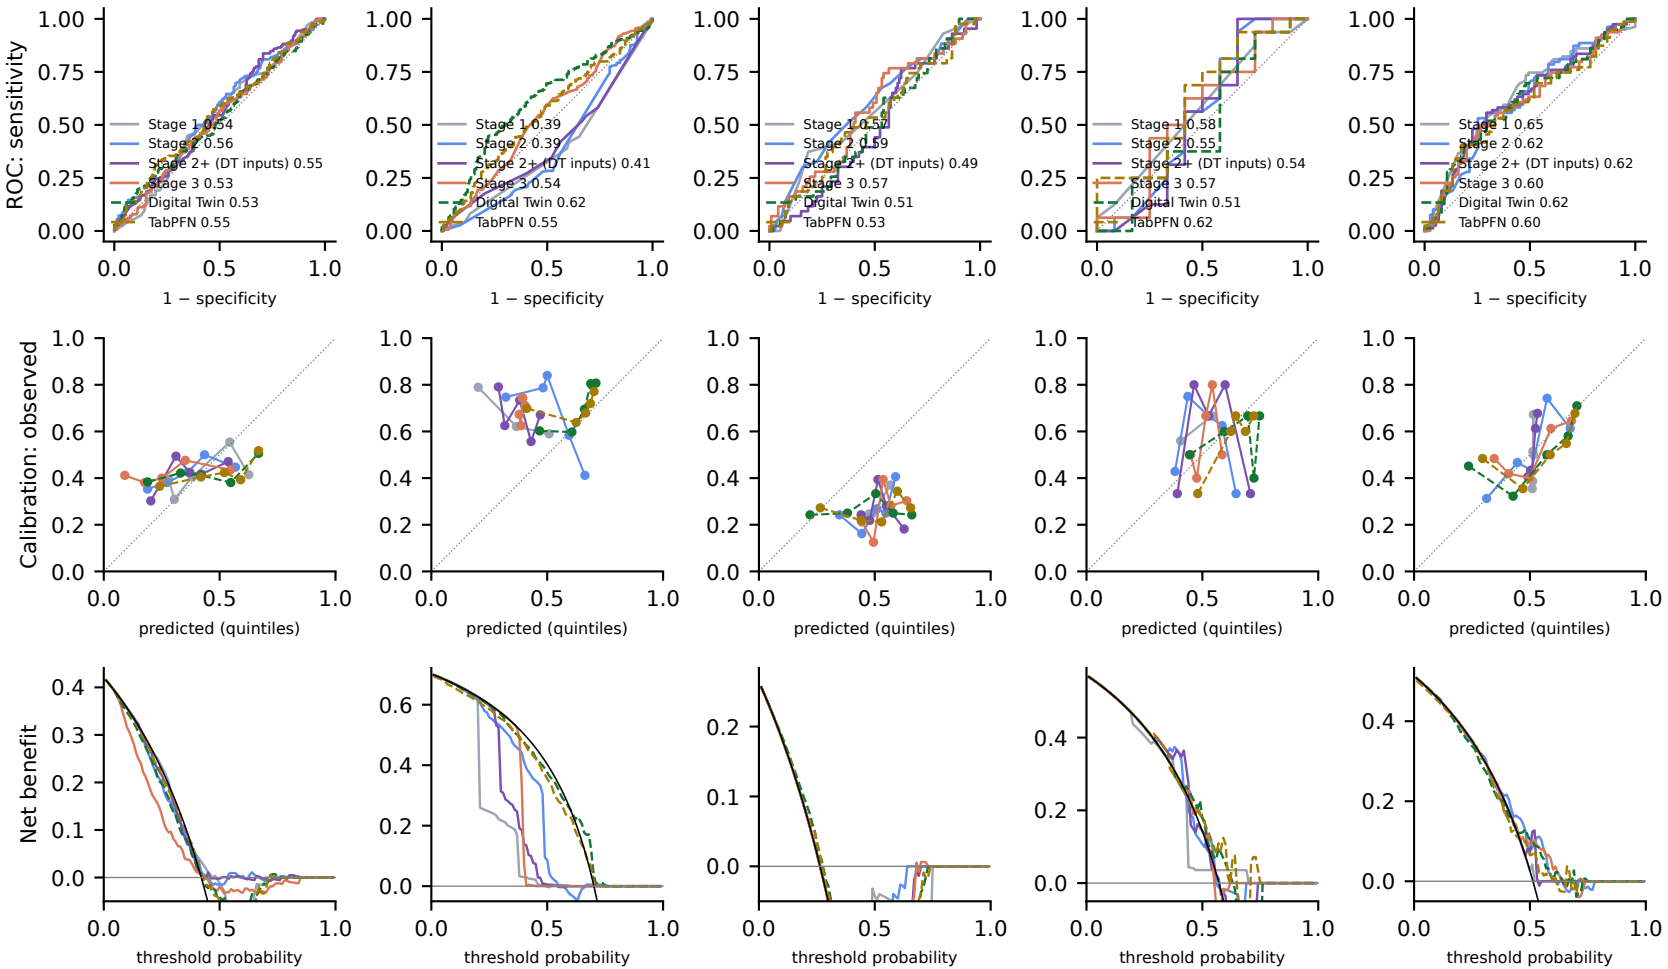

External: Centre A held out
(n=423, pregnant 42%)
External: Centre B held out
(n=412, pregnant 70%)
External: Centre C held out
(n=163, pregnant 26%)
External: 4th centre held out
(n=28, pregnant 57%)
Internal test (15%)
(n=154, pregnant 51%)
ROC: sensitivity
1 − specificity
Stage 1 0.54
Stage 2 0.56
Stage 2+ (DT inputs) 0.55
Stage 3 0.53
Digital Twin 0.53
TabPFN 0.55
Stage 1 0.39
Stage 2 0.39
Stage 2+ (DT inputs) 0.41
Stage 3 0.54
Digital Twin 0.62
TabPFN 0.55
Stage 1 0.57
Stage 2 0.59
Stage 2+ (DT inputs) 0.49
Stage 3 0.57
Digital Twin 0.51
TabPFN 0.53
Stage 1 0.58
Stage 2 0.55
Stage 2+ (DT inputs) 0.54
Stage 3 0.57
Digital Twin 0.51
TabPFN 0.62
Stage 1 0.65
Stage 2 0.62
Stage 2+ (DT inputs) 0.62
Stage 3 0.60
Digital Twin 0.62
TabPFN 0.60
Calibration: observed
predicted (quintiles)
Net benefit
threshold probability