

DATA AC GEDUNG A & B 2026

Update Januari 2026


Daya Outdoor (Watt) Daikin VRV X
sesuai nameplate

2,006,730

Jumlah Unit

308


Jumlah AC Berdasarkan Jenis

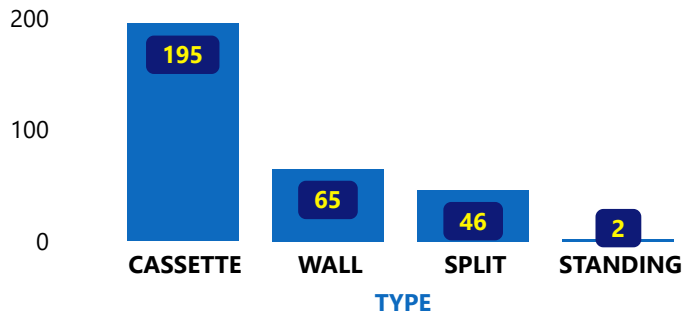


Kapasitas AC

KODE IU_1	KAPASITAS	Btu/h
I.U:1.1-	9600	Btu/h
I.U:1.1-	24100	Btu/h
I.U:1.1-	47800	Btu/h
I.U:1.2-	9000	Btu/h
I.U:1.2-	9600	Btu/h
I.U:1.2-	12300	Btu/h
I.U:1.2-	19100	Btu/h
I.U:1.2-	24100	Btu/h
I.U:1.2-	47800	Btu/h
I.U:2-	45000	Btu/h



DATA INDOOR UNIT

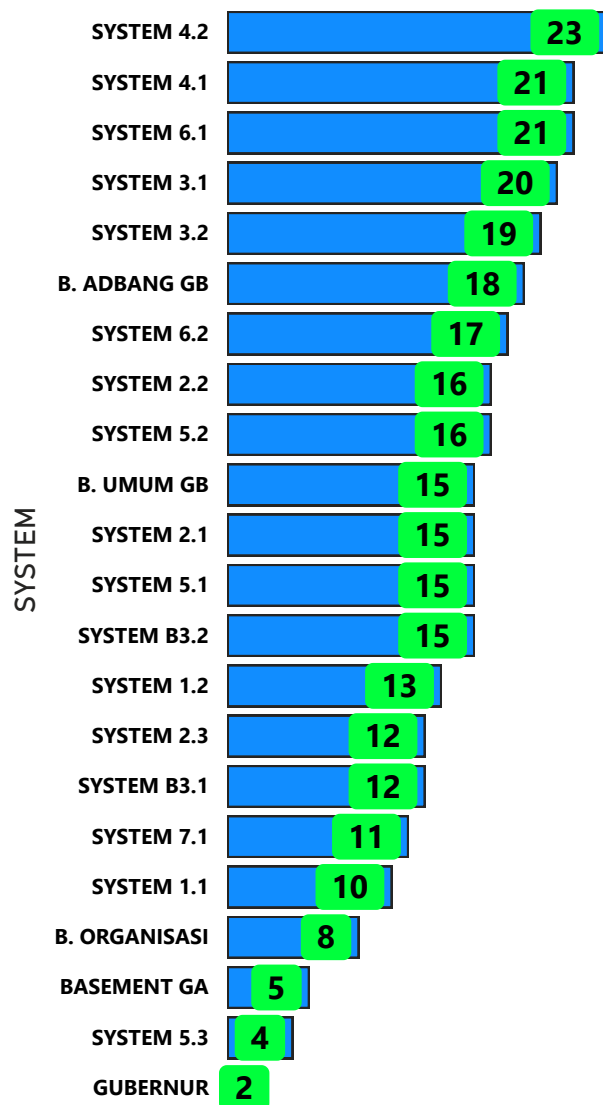

DATA OUTDOOR UNIT

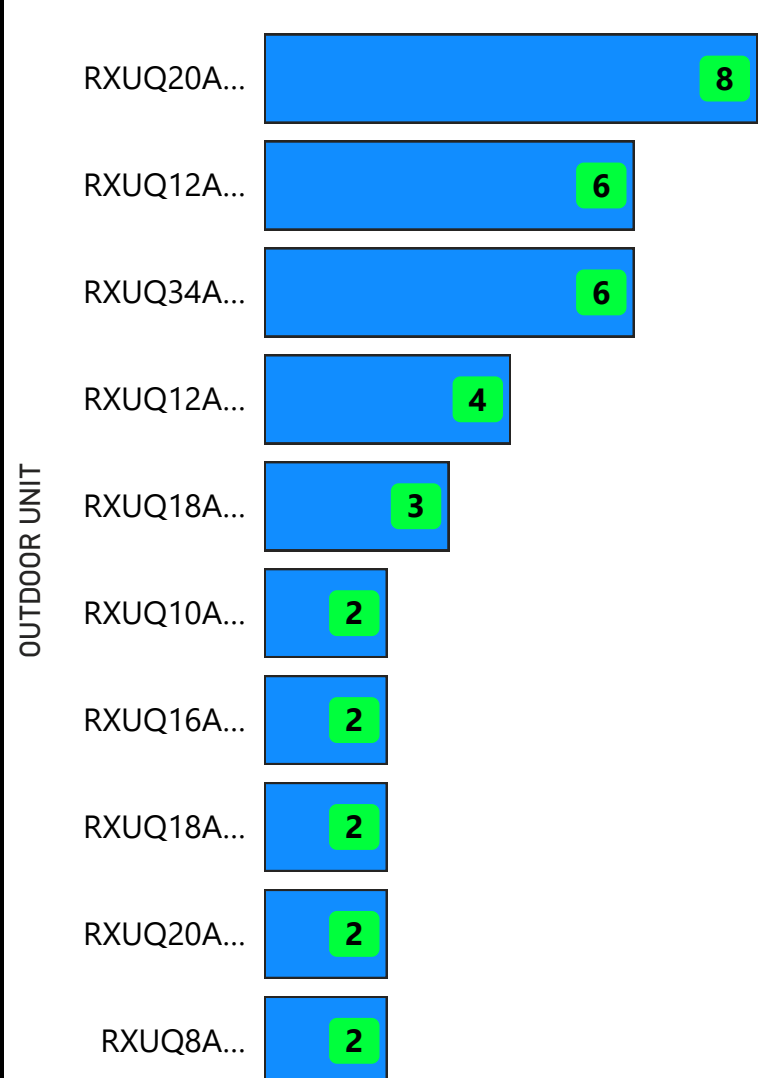

HASIL PENGUKURAN TEMPERATUR & HUMIDITY GD A

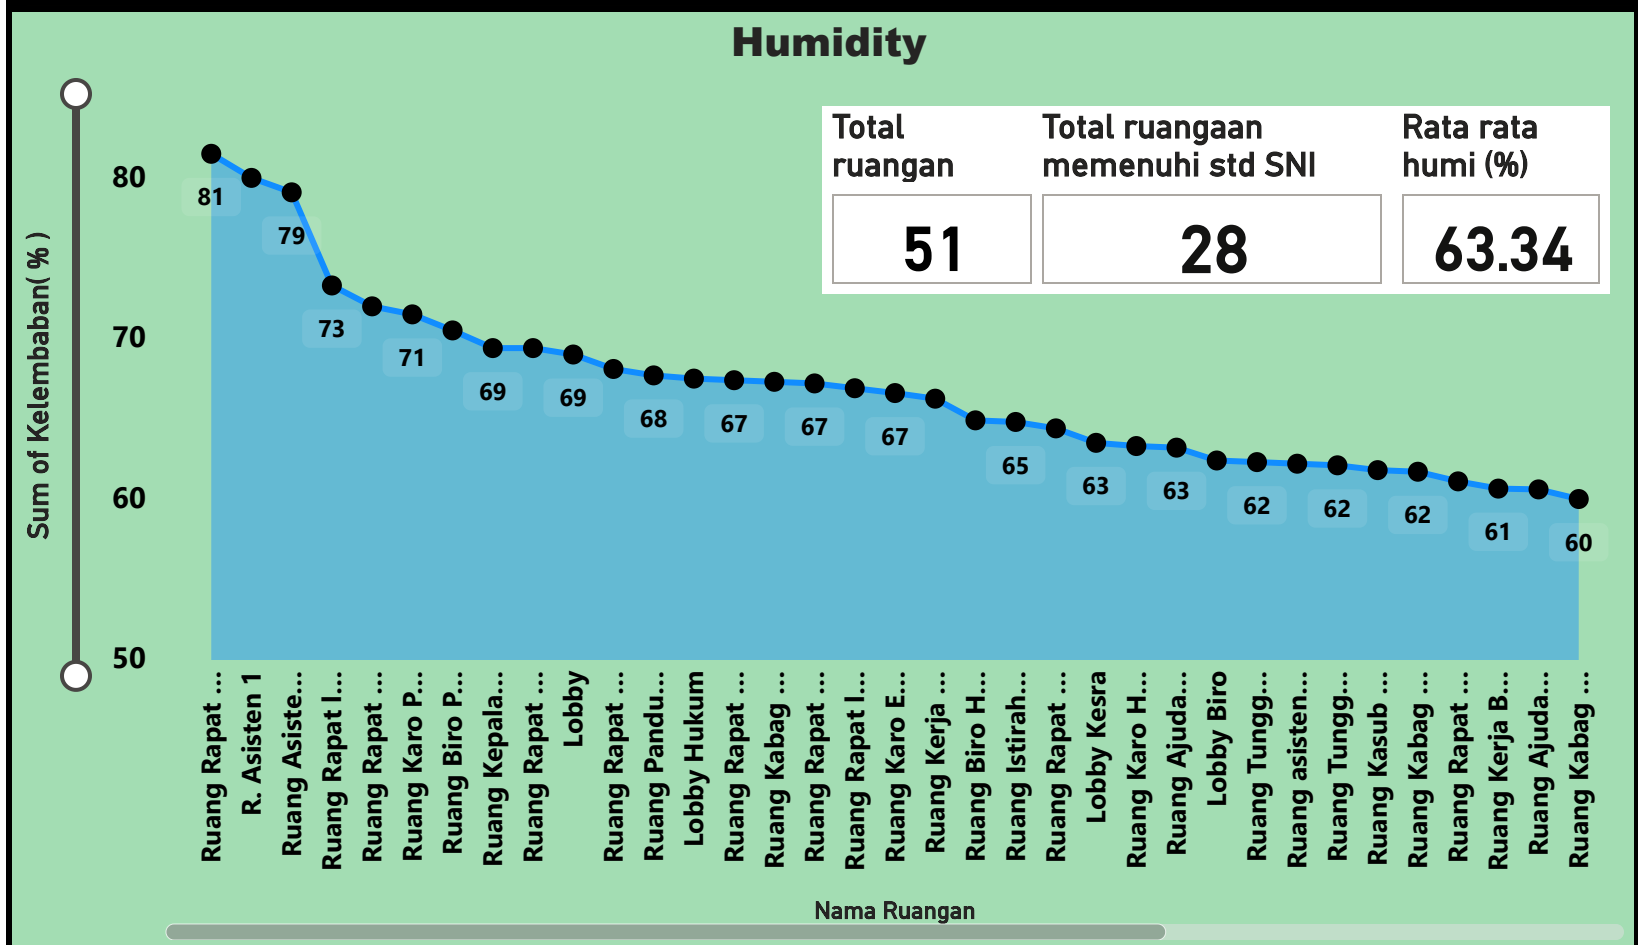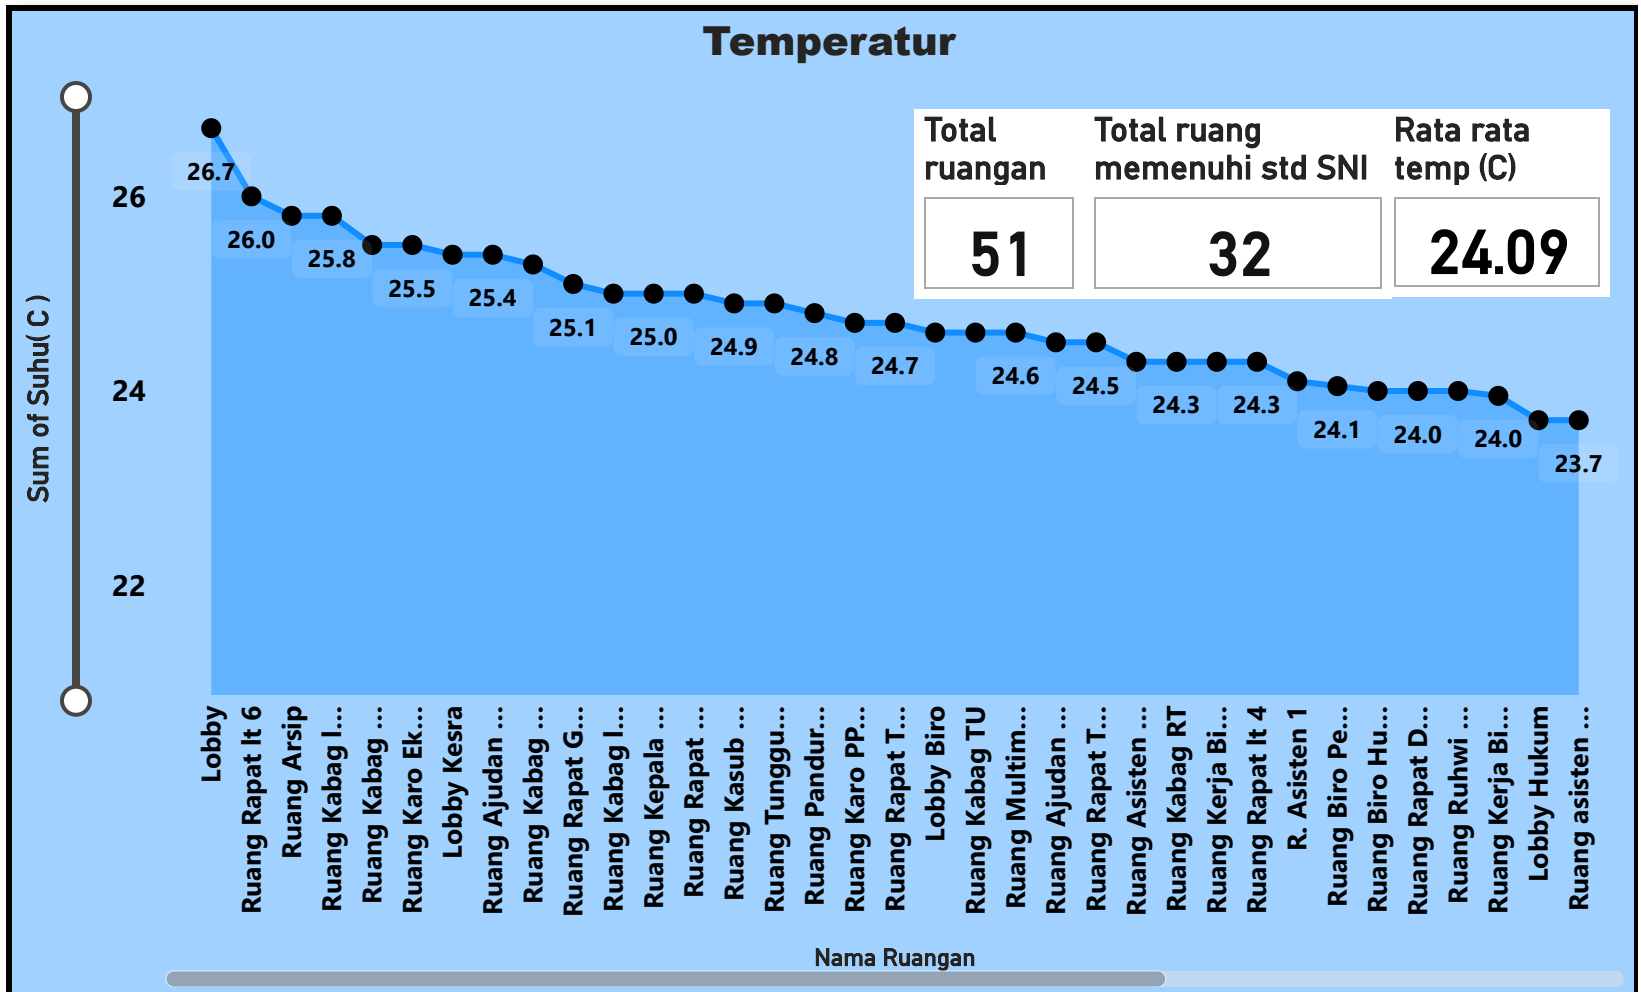

HASIL PENGUKURAN KADAR CO2 DI UDARA GD A & B

Data September 2025

Baku Mutu
1.000 ppm

Total Ruangan

51


Rata2 Co2

344.71

Total Ruangan Memenuhi SNI

51

KADAR CO2 RUANG KERJA

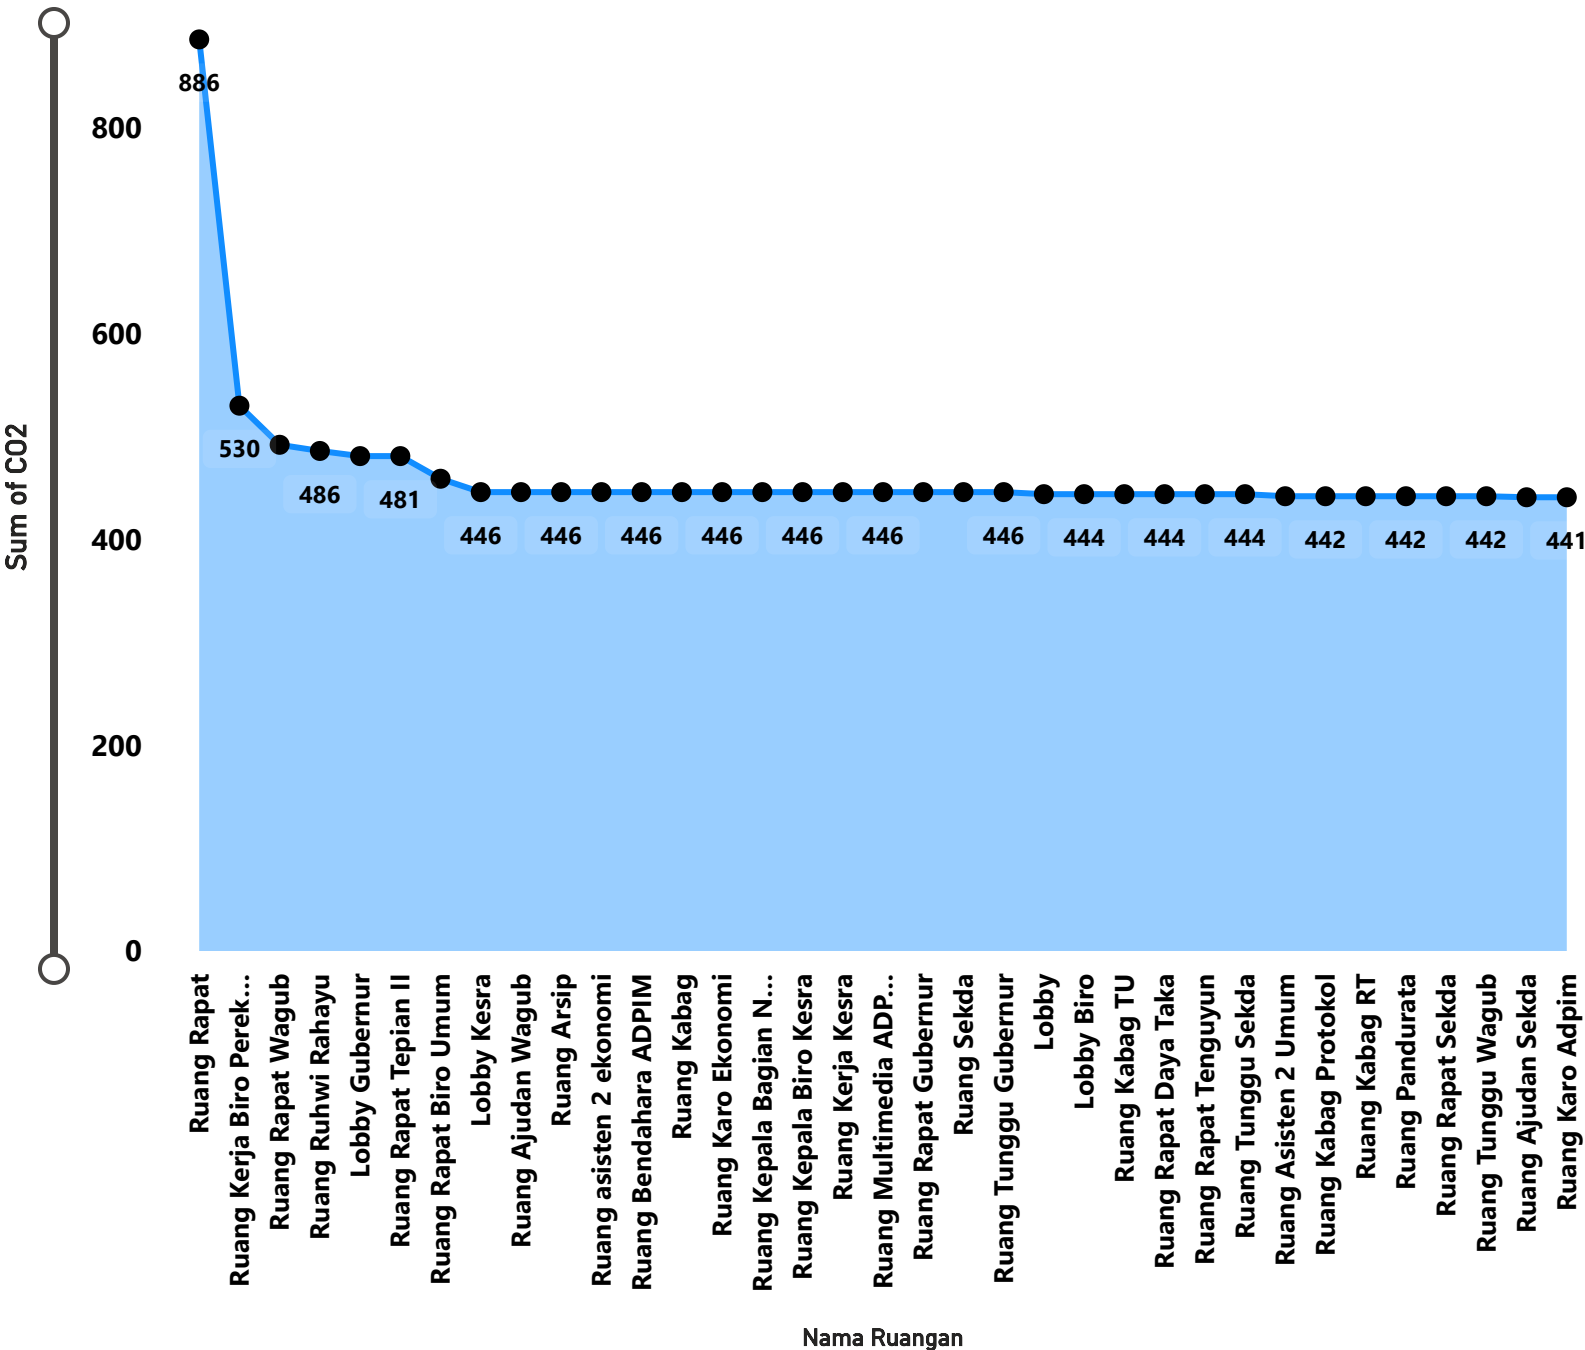

Nama Ruangan

☐ Select all

☐ (Blank)

PenilaianTemperatur

Memenuhi

Tidak Memenuhi