


Water stewardship

SUE report card - Aerospace & Defense | Withdrawal, consumption, discharge, water risk
163 of 3371 passages are about this category (PCA projection)

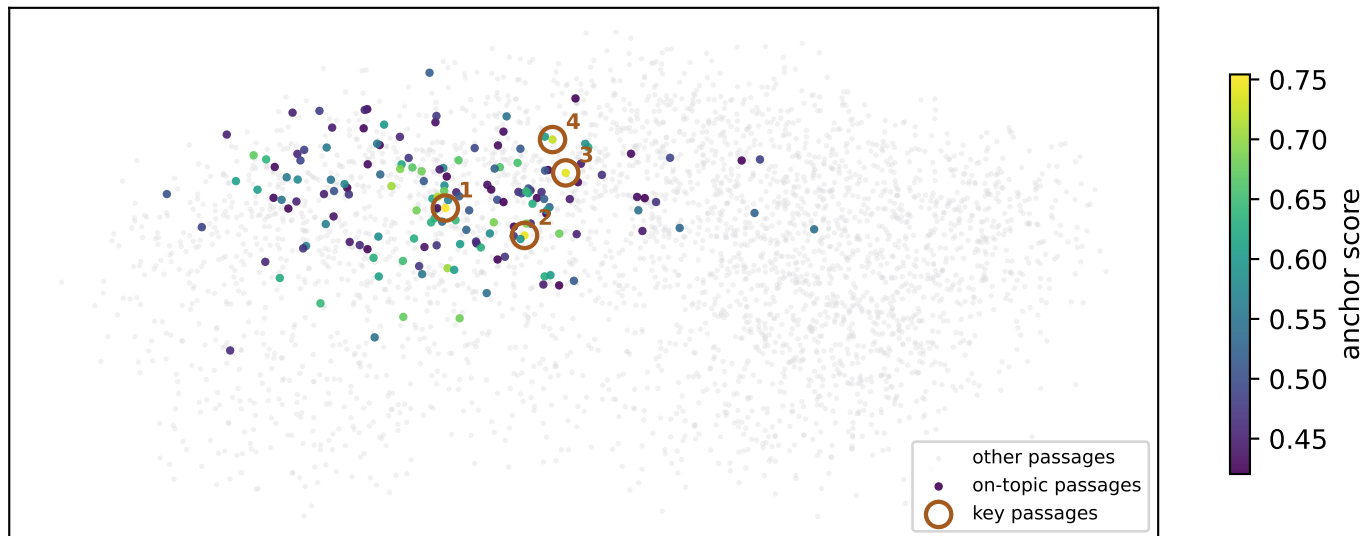

KEY PASSAGES (the evidence the verdict leans on)

[1] Northrop Grumman - 2025 Northrop_Grumman_2025_Sustainability_Report.pdf (pp.16-17) - score 0.75

vation projects across the company expected to reduce 59 million gallons of water annually (75% in water-stressed locations). Improved water metering and leak detection systems at 3 sites, all of which are in water-stressed areas, with an expected annual reduction of 30 million gallons. Upgraded water-intensive equipment and/or processes at 14 sites, 70% of which are in water-stressed areas, with an annual anticipate...

[2] Boeing - 2025 Boeing_2025_Sustainability_Report.pdf (p.53) - score 0.74

(surface, ground and reclaimed water) and company generation (on-site well, on-site reclamation and rain capture). This sourced water supports manufacturing, sanitation, drinking water, cooling and irrigation across the company. The majority of our water is from public water supply systems, and most withdrawal measurement is from water system meters. Water used within our facilities is discharged to public sanitary s...

[3] AEROVIRONMENT INC - 2025 AeroVironment_2025_Corporate_Social_Responsibility_Report.pdf (p.23) - score 0.74

ygienic purposes, and we maintain our "No Exposure Certificate" with both local and federal Environmental Protection Agency (EPA) authorities in the U.S. We are unable to accurately track and report water withdrawals and consumption at several of our offices and facilities, as these locations are leased and water usage is typically included within the lease agreements. To maintain transparency where feasible, we acti...

[4] Boeing - 2025 Boeing_2025_Sustainability_Report.pdf (p.54) - score 0.72

ch Safety & Quality People & Culture Sustainability & Resilience Reporting & Disclosures Key Data GRI Index SASB Index TCFD Index Forward-Looking Statements Disclosure Disclosure Title Report Section(s) Additional Reference(s)/Links 303-1 Interactions with water as a shared resource Sustainability & Resilience, Pages 26-32 The water used within our facilities is sourced from local public utilities (surface, ground an...

VERDICT

Boeing leads the peer group on water stewardship (depth 0.68 vs. group tail 0.40), and its passages above are noticeably more concrete than the group norm. Credit where due: GE Aerospace goes beyond the standard report here, publishing a standalone data supplement - over-delivery of this kind is a stronger signal than polished prose.