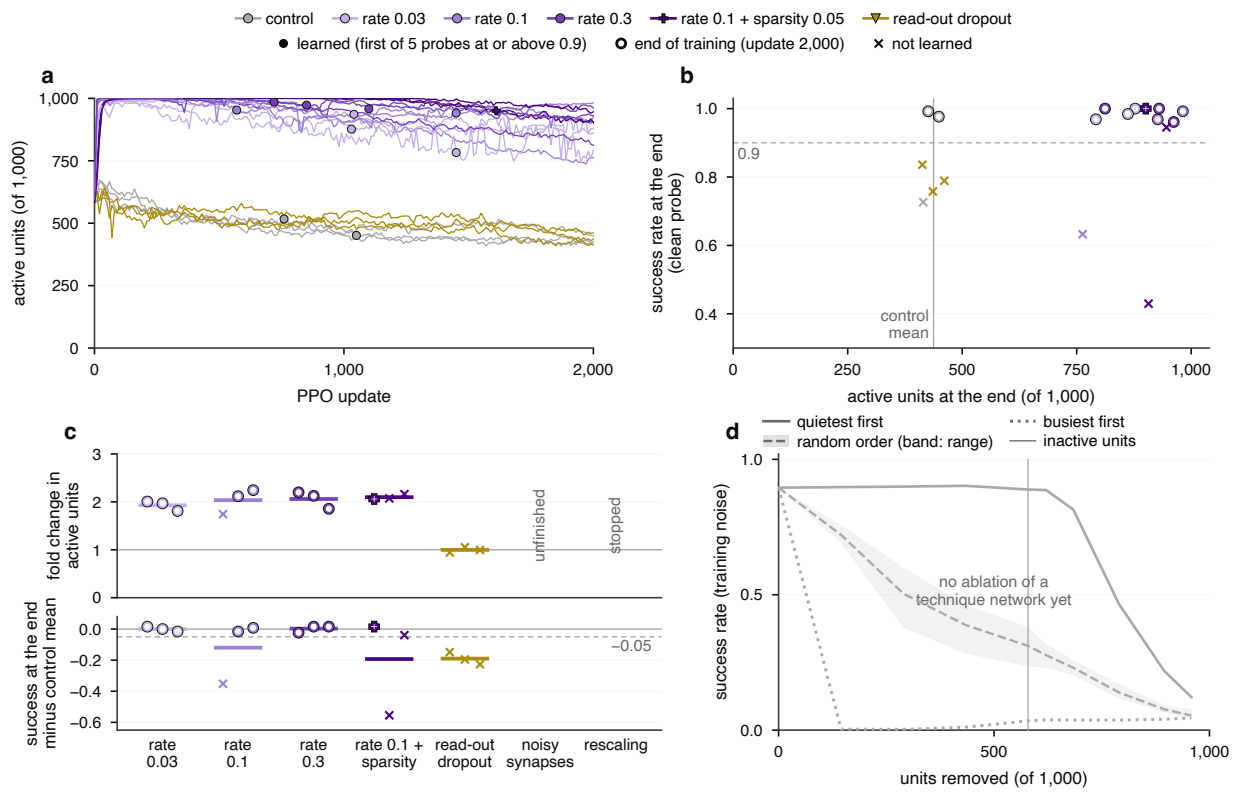
control
rate 0.03
rate 0.1
rate 0.3
rate 0.1 + sparsity 0.05
read-out dropout
learned (first of 5 probes at or above 0.9)
end of training (update 2,000)
not learned
a
active units (of 1,000)
PPO update
b
success rate at the end (clean probe)
0.9
control mean
active units at the end (of 1,000)
c
fold change in active units
unfinished
stopped
success at the end minus control mean
−0.05
rate 0.03
rate 0.1
rate 0.3
rate 0.1 + sparsity
read-out dropout
noisy synapses
rescaling
d
quietest first
random order (band: range)
busiest first
inactive units
success rate (training noise)
no ablation of a technique network yet
units removed (of 1,000)