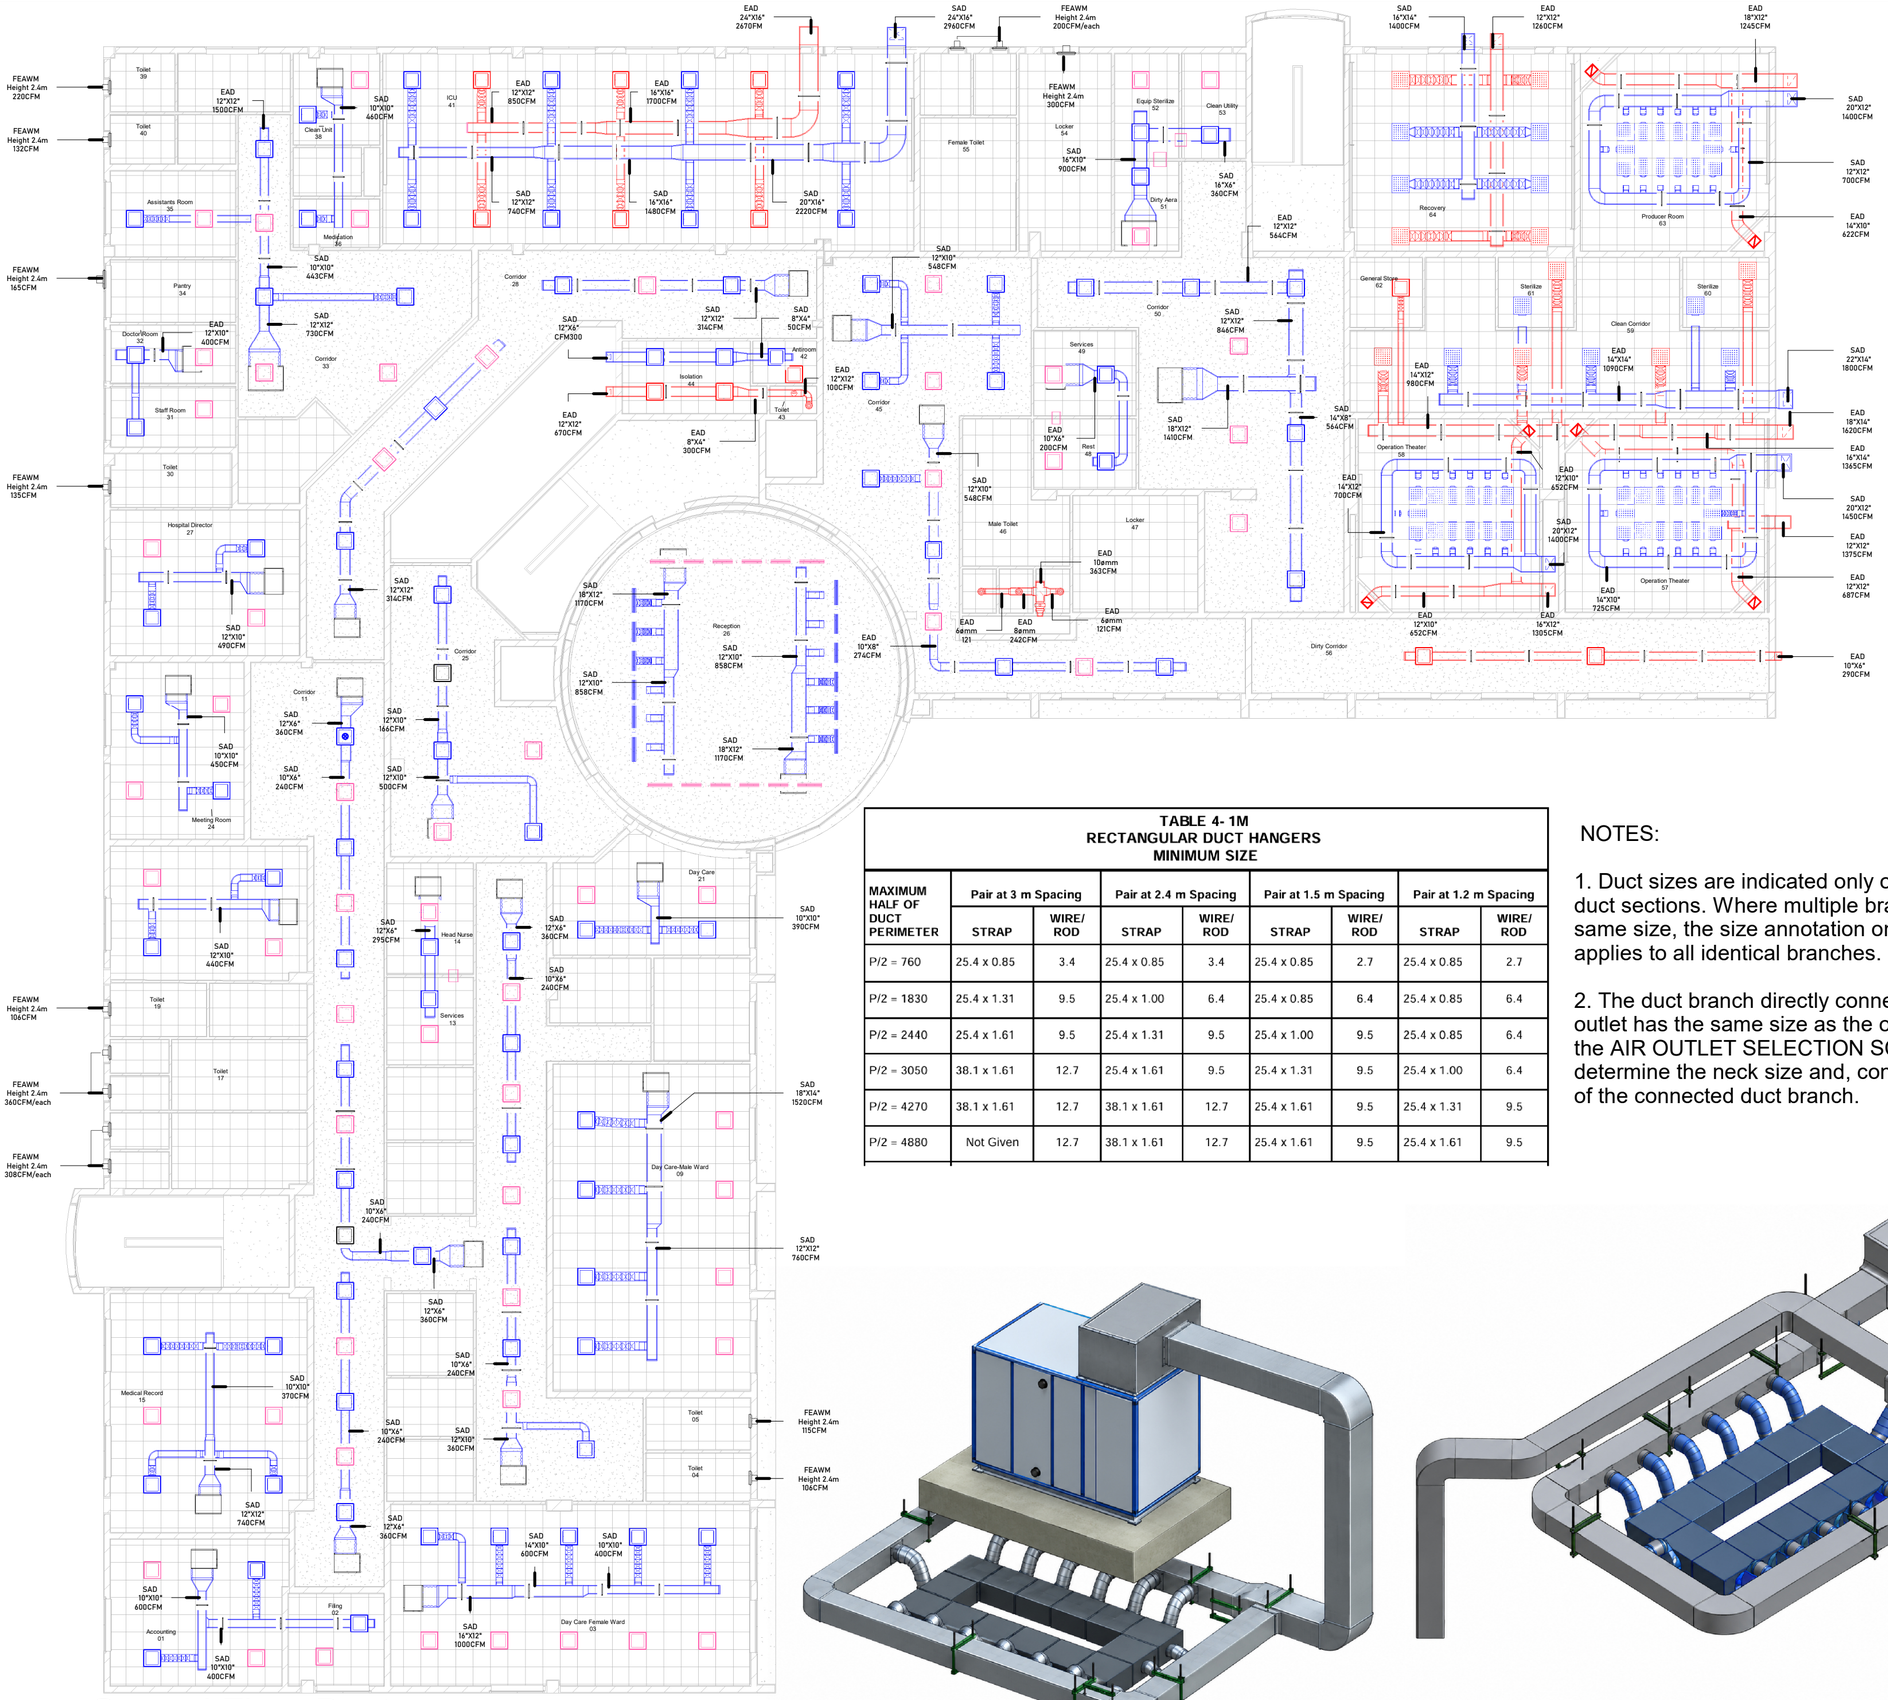


1 Ground Floor Duct

1 : 150


TABLE 4- 1M
RECTANGULAR DUCT HANGERS
MINIMUM SIZE

MAXIMUM HALF OF DUCT PERIMETER	Pair at 3 m Spacing		Pair at 2.4 m Spacing		Pair at 1.5 m Spacing		Pair at 1.2 m Spacing	
	STRAP	WIRE/ ROD	STRAP	WIRE/ ROD	STRAP	WIRE/ ROD	STRAP	WIRE/ ROD
P/2 = 760	25.4 x 0.85	3.4	25.4 x 0.85	3.4	25.4 x 0.85	2.7	25.4 x 0.85	2.7
P/2 = 1830	25.4 x 1.31	9.5	25.4 x 1.00	6.4	25.4 x 0.85	6.4	25.4 x 0.85	6.4
P/2 = 2440	25.4 x 1.61	9.5	25.4 x 1.31	9.5	25.4 x 1.00	9.5	25.4 x 0.85	6.4
P/2 = 3050	38.1 x 1.61	12.7	25.4 x 1.61	9.5	25.4 x 1.31	9.5	25.4 x 1.00	6.4
P/2 = 4270	38.1 x 1.61	12.7	38.1 x 1.61	12.7	25.4 x 1.61	9.5	25.4 x 1.31	9.5
P/2 = 4880	Not Given	12.7	38.1 x 1.61	12.7	25.4 x 1.61	9.5	25.4 x 1.61	9.5


NOTES:

1. Duct sizes are indicated only once for identical duct sections. Where multiple branches have the same size, the size annotation on one branch applies to all identical branches.

2. The duct branch directly connected to each air outlet has the same size as the outlet neck. Refer to the AIR OUTLET SELECTION SCHEDULE to determine the neck size and, consequently, the size of the connected duct branch.

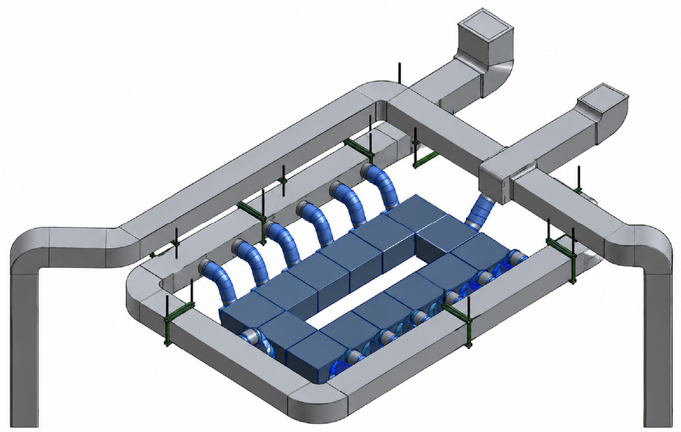

Key Plan



Legends:

	Linear Slot Diffuser
	Round Diffuser
	Fan Wall Mounted
	Flexible Duct
	Diffuser Supply
	Perforated Diffuser
	Fan Coil Unit

EDA	Exhaust Duct Air
SDA	Sypply Air Duct
CFM	Cubic Feet Per Minute
FEAWM	Fan Exhaust Axial Wall Mounted

MOHAMED SHABAN
MECHANICAL ENGINEER

Project:	Hospital
Owner:	انجكس ENGX ENGINEERING TRAINING
Date:	23/10/2026
Designer:	M.Shaban
Checked by:	Taha Hussein
DRAWING:	Ground Floor Duct
DISCIPLINE:	HVAC
Scale:	1:150