


3WL Secondary Disconnect Layout

8 Circuit diagrams

8.1 Terminal assignment

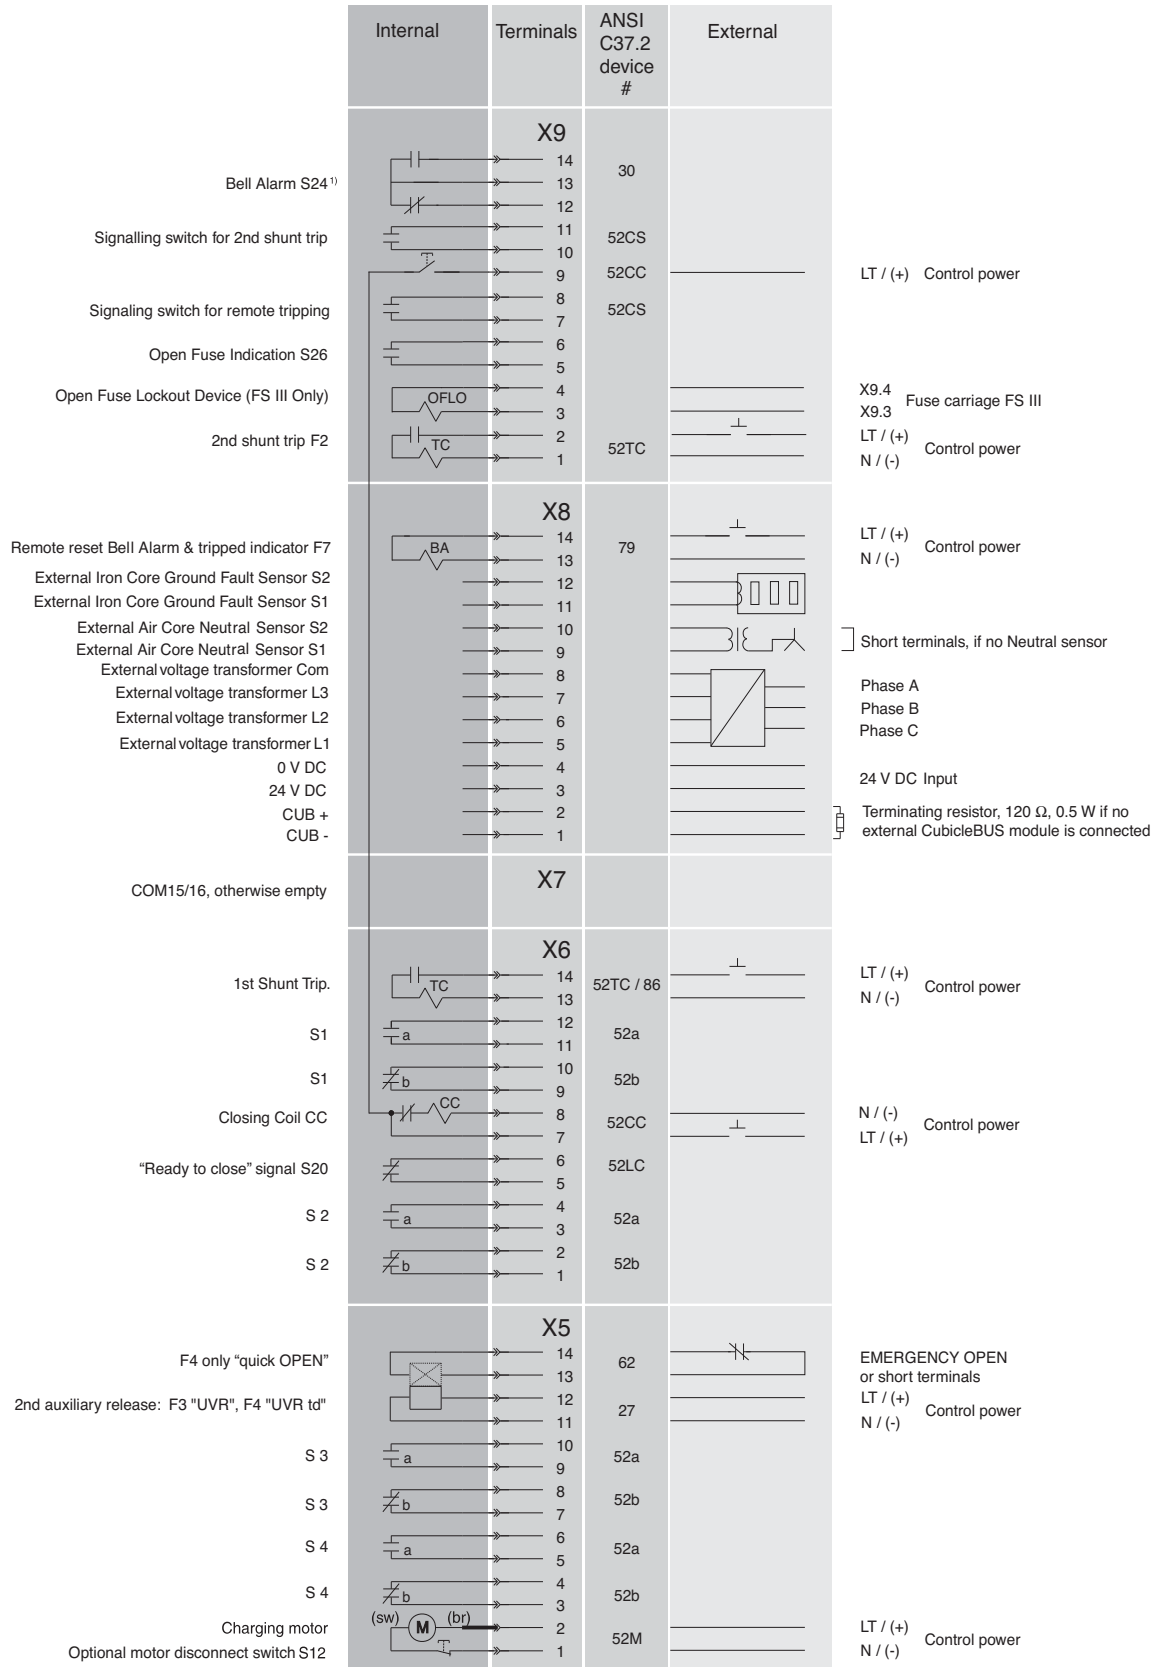

1) The breaker is untripped, and the bell alarm is shown reset