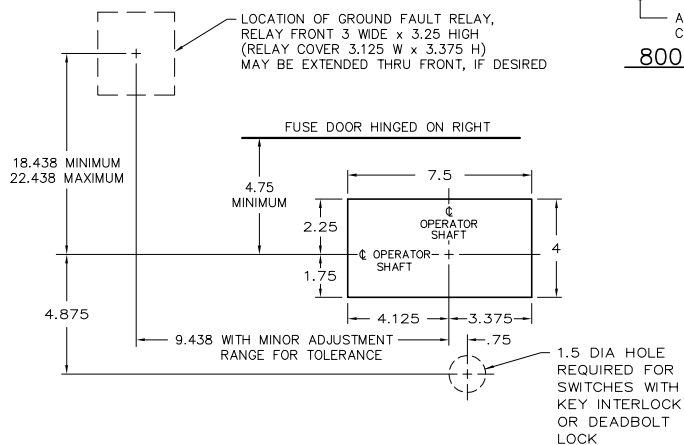
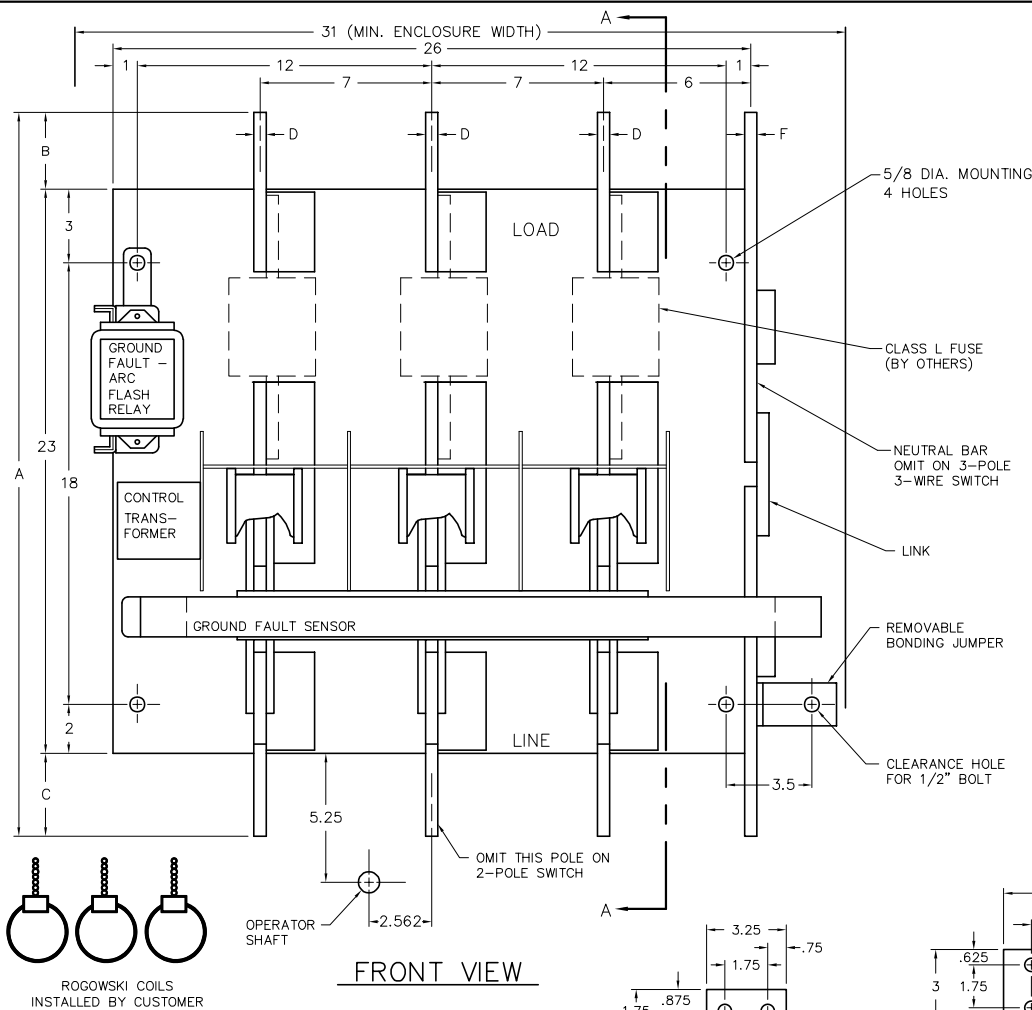


VENTILATION

WHEN THE SWITCH IS TOTALLY ENCLOSED, VENTILATING LOUVERS MUST BE PROVIDED YIELDING A MINIMUM OPEN AREA OF "H" SQUARE INCHES NEAR THE TOP OF THE ENCLOSURE, AND "H" SQUARE INCHES NEAR THE BOTTOM OF THE ENCLOSURE.



OPERATOR DETAILS

FOR OPERATOR DETAILS AND ALTERNATE FRONT CUT-OUTS, REFER TO DWG NO. 0-1090A

KEY INTERLOCK

KEY INTERLOCK SPECIFICATIONS FOR SWITCHES EQUIPPED WITH KEY INTERLOCK PROVISIONS ARE:

- .375 BOLT PROJECTION WHEN WITHDRAWN
- KIRK TYPE B
- SUPERIOR TYPE B6003

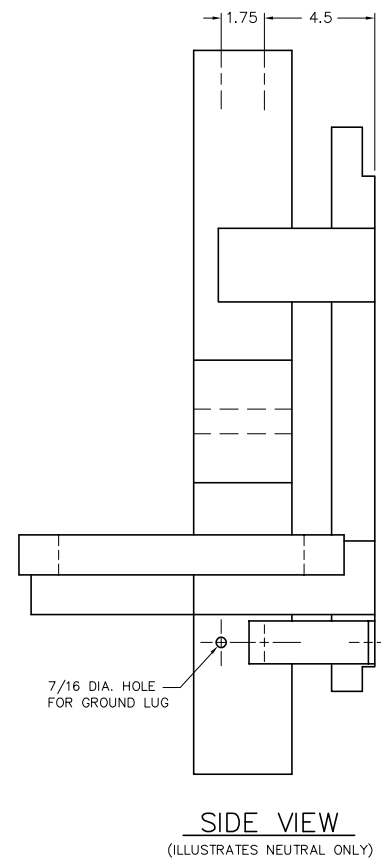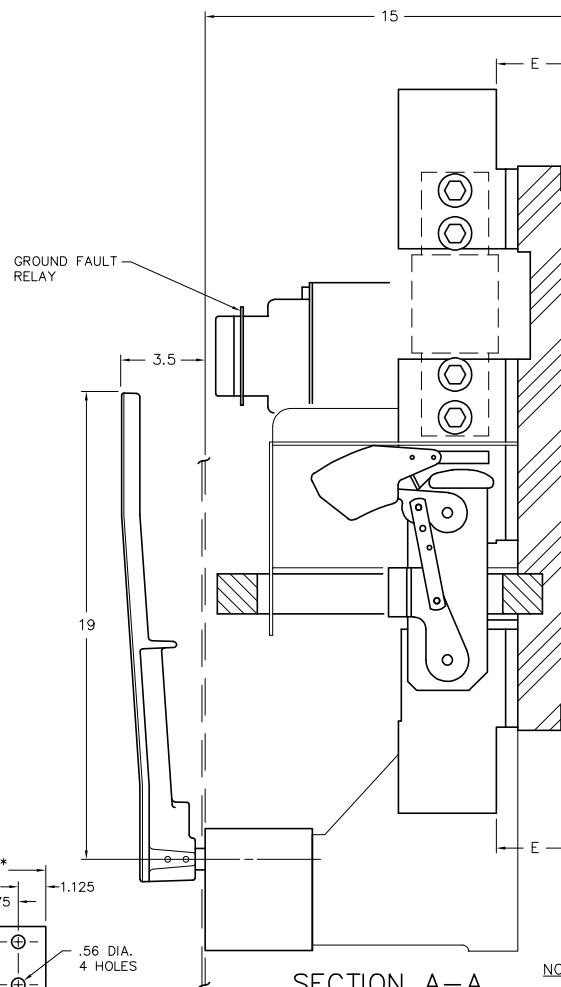

NOTE: FOR WIRING DIAGRAM OF GROUND FAULT RELAY REFER TO DWG. NO. 0-1431.

AMP	CATALOG #	NET WEIGHT	A	B	C	D	E	F	H
800	VLB347XXX	214	27	1.625	2.375	.375	3	.25	NONE
1200	VLB348XXX	216	29.5	3.125	3.375	.375	3	.31	NONE
1600	VLB349XXX	218	29.5	3.125	3.375	.375	3	.375	60 SQ. IN.
2000	VLB3410XXX	235	29.5	3.125	3.375	.5	3.125	.5	60 SQ. IN.
2500	VLB3411XXX	250	29.5	3.125	3.375	.625	3.125	.625	80 SQ. IN.
3000	VLB3412XXX	262	29.5	3.125	3.375	.75	3.125	.75	120 SQ. IN.

SERIES VLB SWITCHES WITH INTEGRAL GROUND FAULT AND ARC FLASH			
SCALE:		APPROVED BY:	
DATE: 04/25/025		DRAWN BY: A C	
		REVISED	
<i>boltswitch, inc.</i> CRYSTAL LAKE, ILLINOIS 60014			DRAWING NUMBER O-1291A