


# 3WL Secondary Disconnect Layout

## 8 Circuit diagrams

### 8.1 Terminal assignment

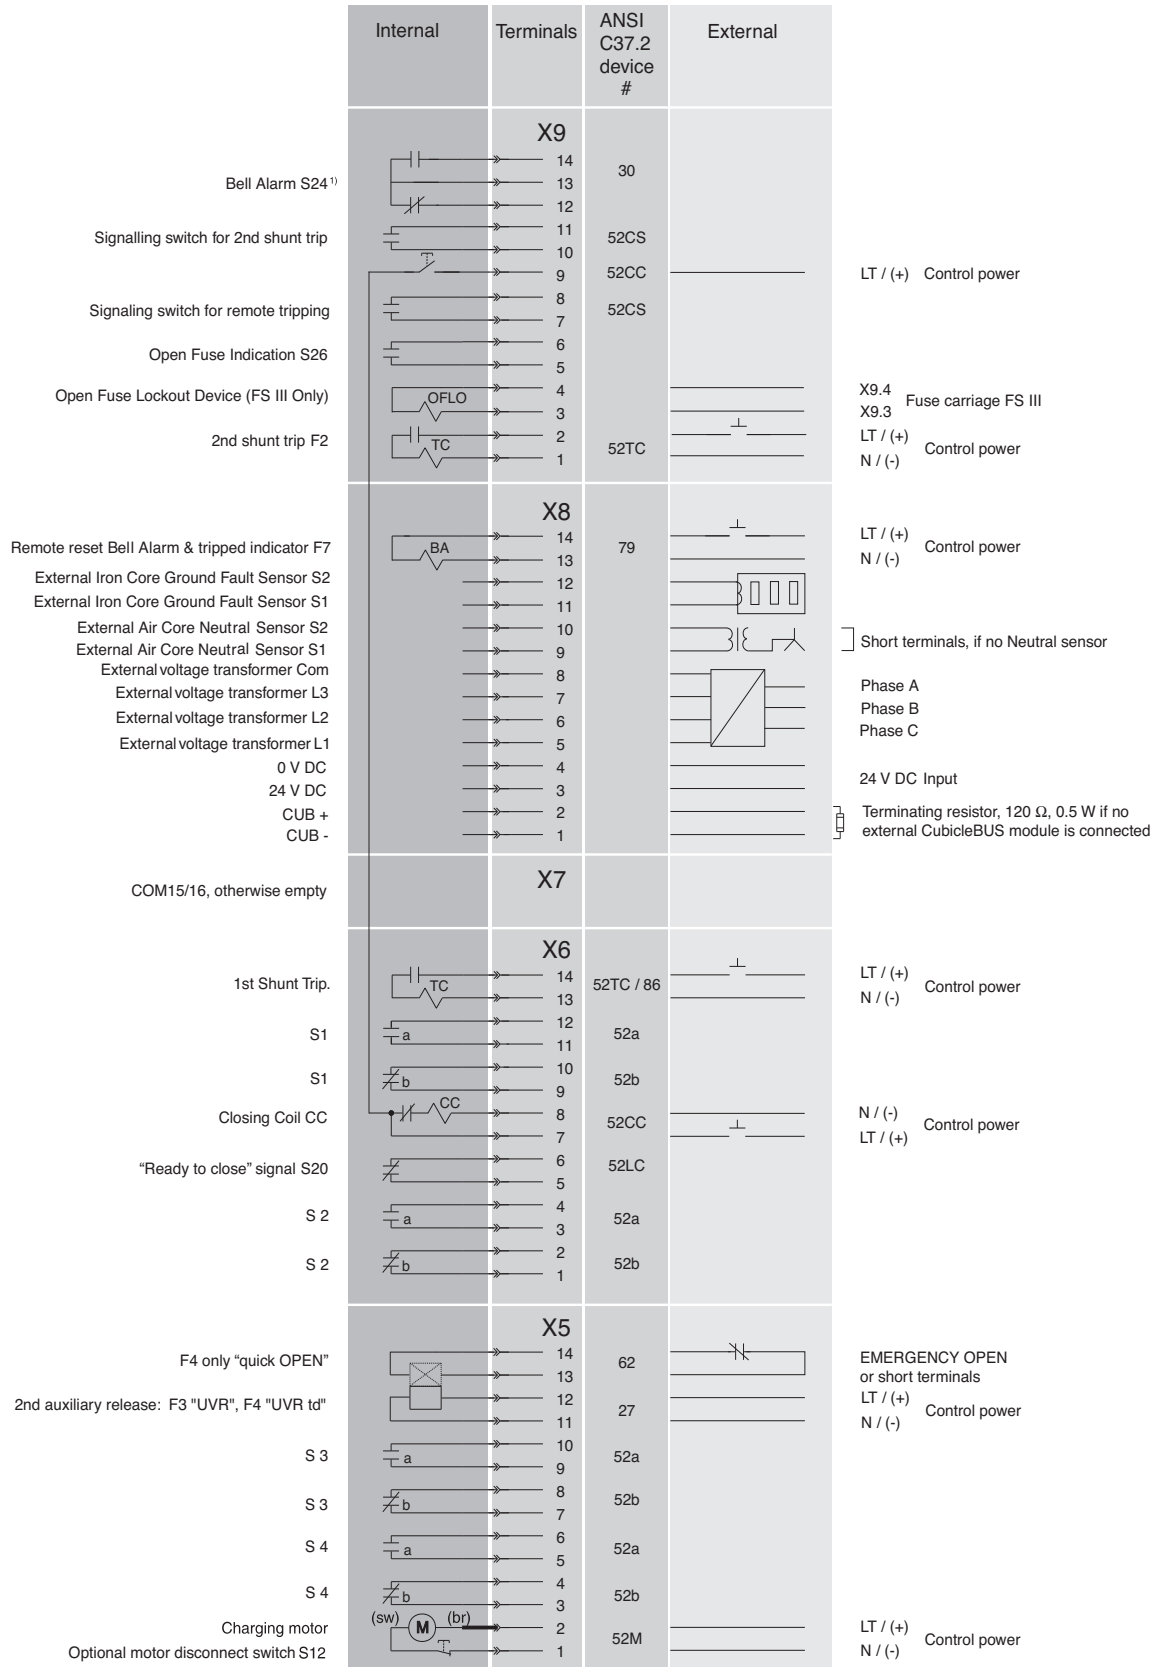

1) The breaker is untripped, and the bell alarm is shown reset

### 5.1.2.2 ETU600 terminal assignment diagram

