


RAEC 200 MMscfd Gas Supply From OKNU For The DSV Gas Hub Alongside RAEC Phase-1 GSPA 270 MMscfd Gas Supply to the BFPCL Gas Processing Plant



Pipeline Scope Limit Definition & Tie-in Point to GPP Inlet (Slug Catcher)

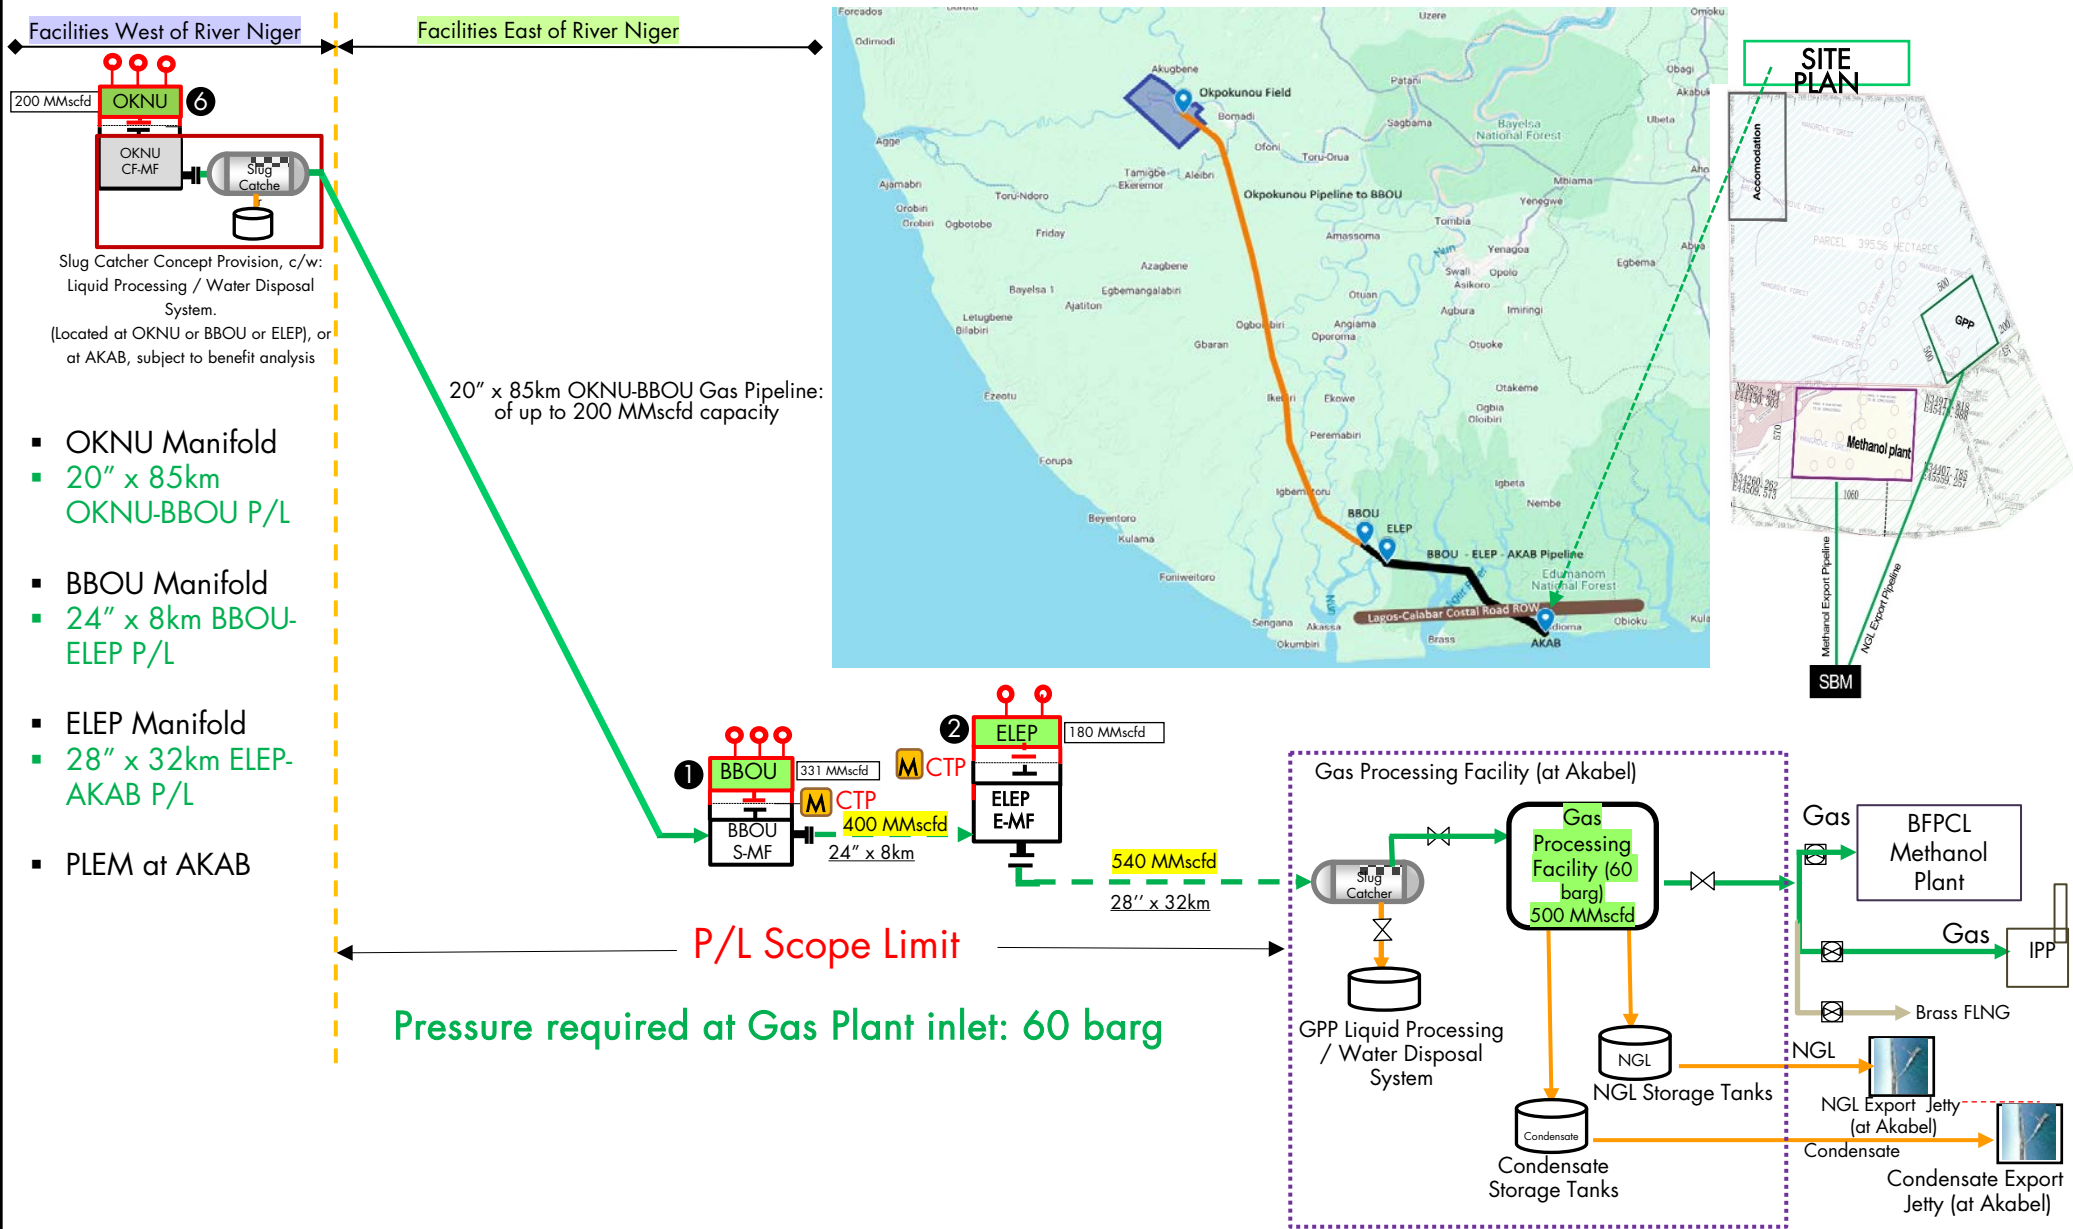